
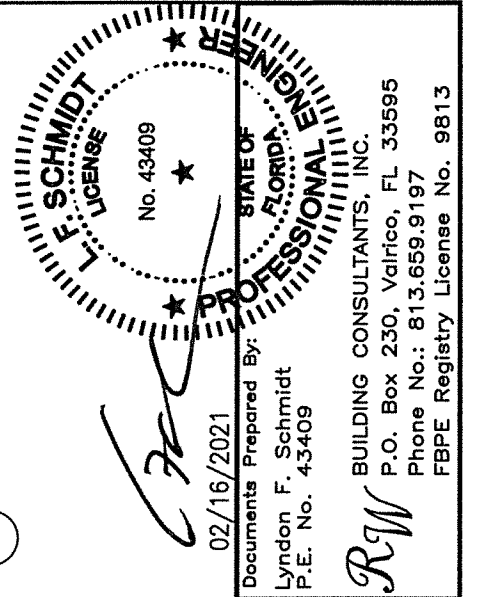
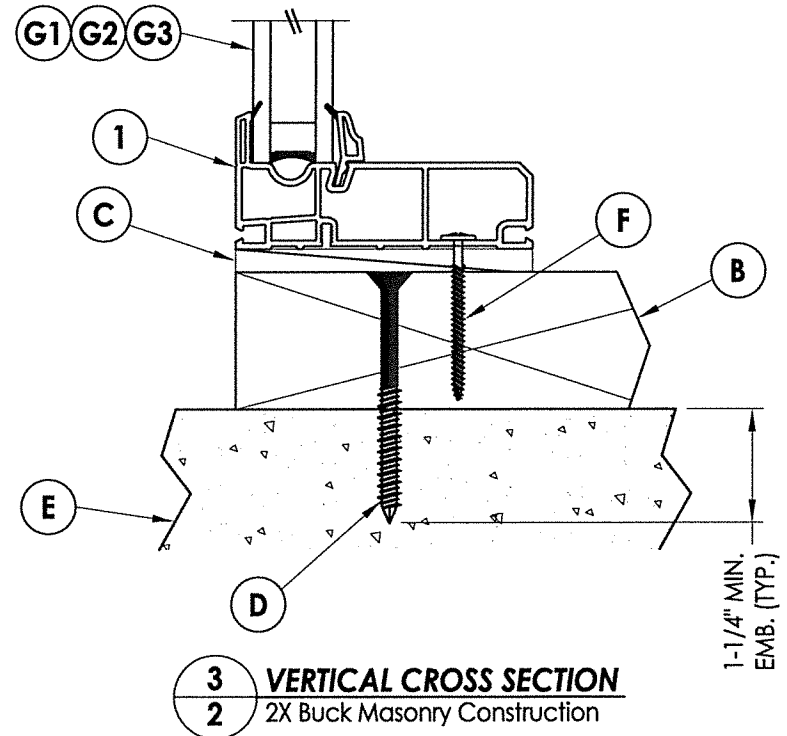
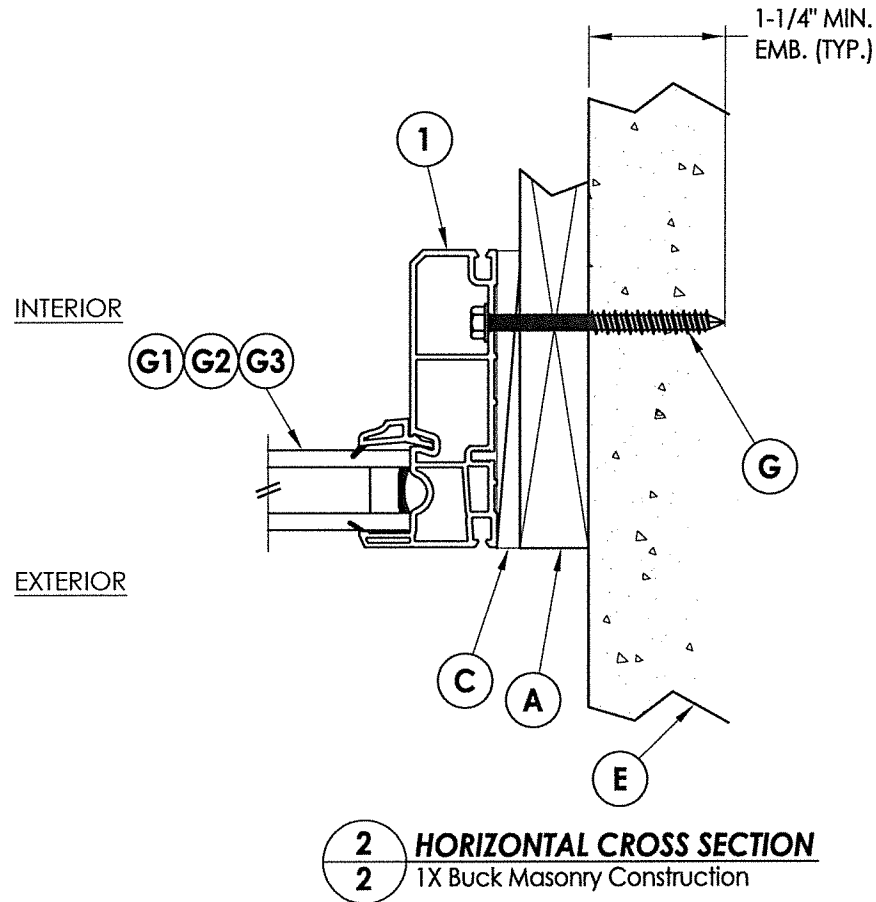
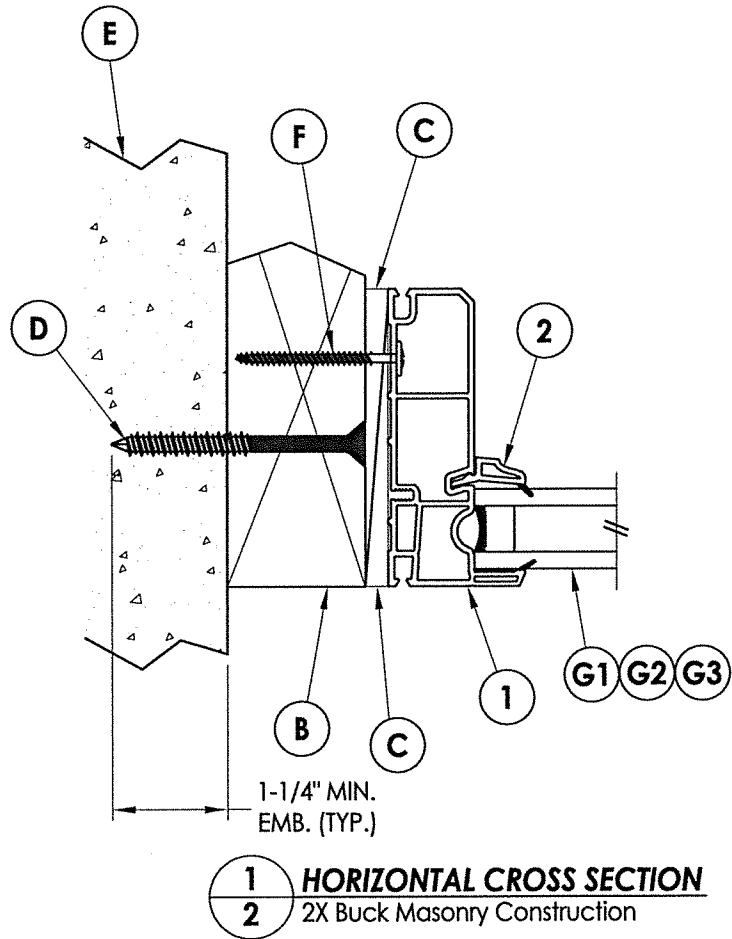
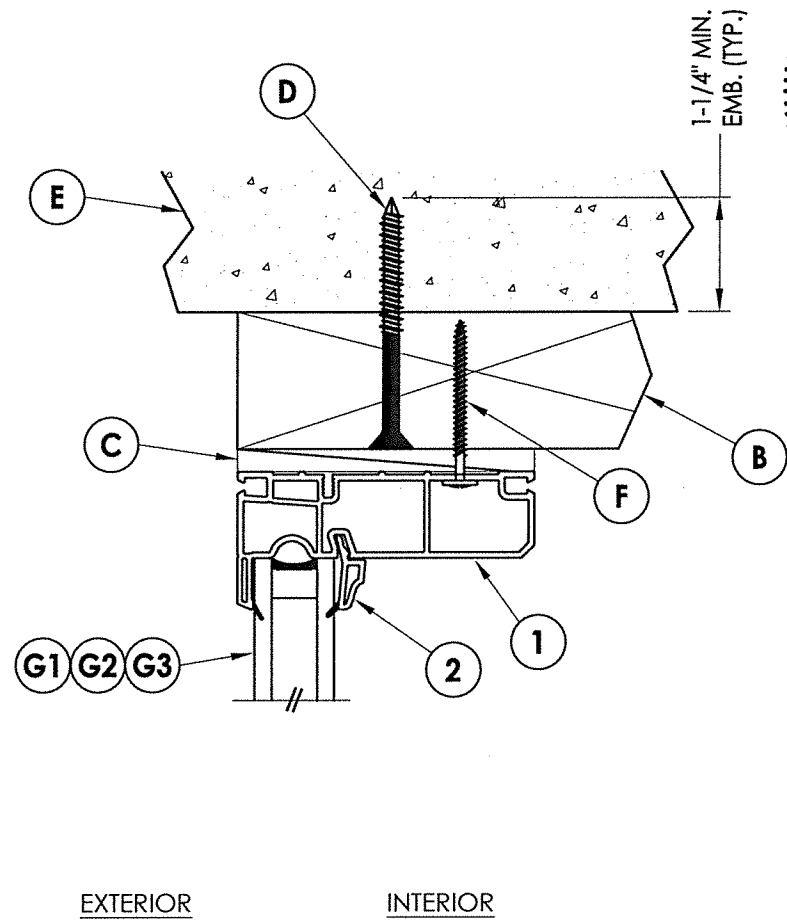
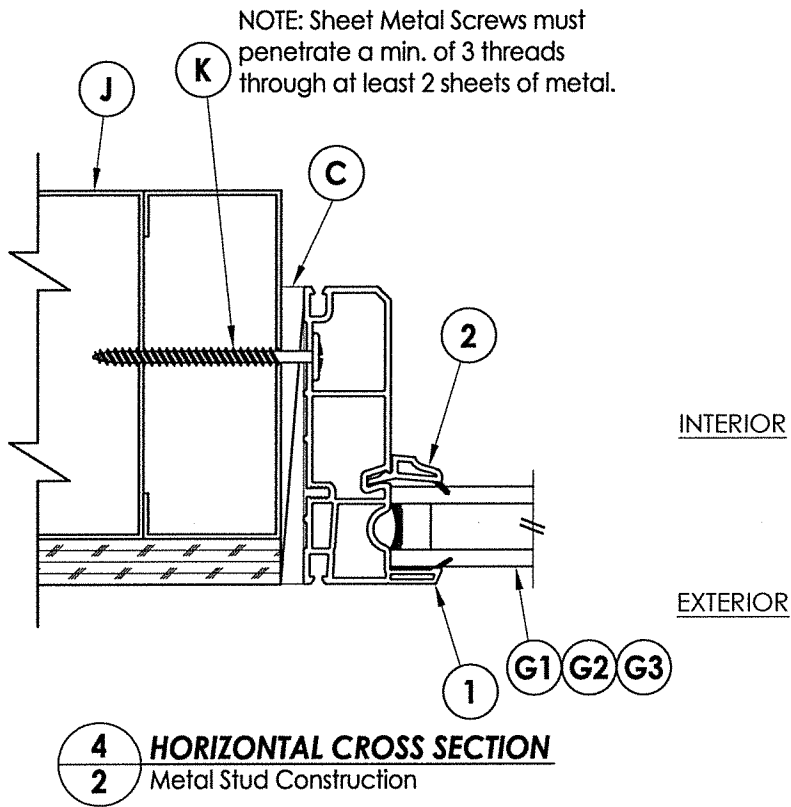



© 2021 R.W. BUILDING CONSULTANTS INC.

Z:\Clients\Sunrise Windows\A - Florida Product Approvals\FL-26908 - Fixed Window\C - Drawings\FL 26908 (2020)\FL-26908.20.dwg

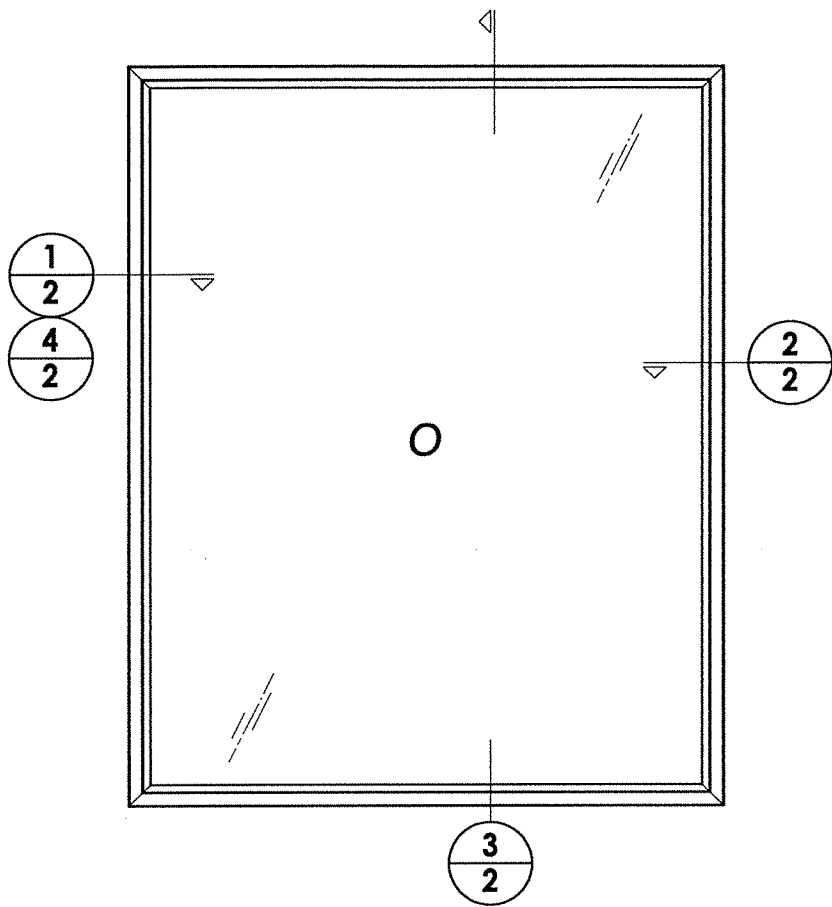


Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		02/16/2021		STATE OF FLORIDA PROFESSIONAL ENGINEER	
PRODUCT: Narrow Picture Window		PART OR ASSEMBLY: VERTICAL & HORIZONTAL CROSS SECTIONS		BY	
				NO. DATE	
				REVISIONS	
DATE: 2/16/21		SCALE: N.T.S.		DWG. BY: RW	
				CHK. BY: LFS	
				DRAWING NO.: FL-26908.20	
SHEET 2 OF 4					

Z:\Clients\Sunrise Windows\A - Florida Product Approvals\FL-26908 - Fixed Window\C - Drawings\FL 26908 (2020)\FL-26908.20.dwg

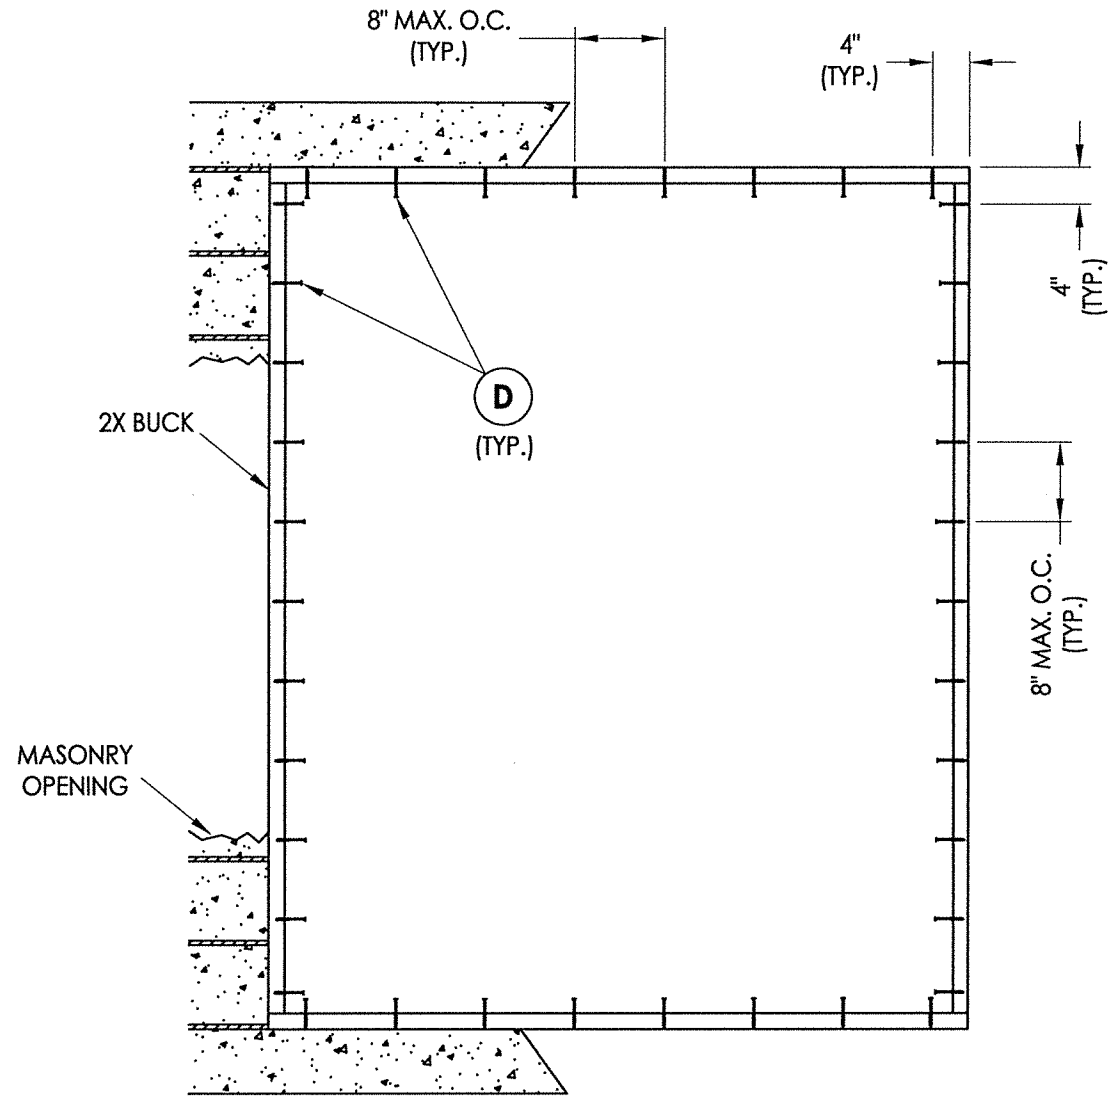

BUCK ANCHORING

8" O.C. ANCHOR SPACING SHOWN FOR MAX. DESIGN PRESSURE = 65 PSF
(11" O.C. ANCHOR SPACING FOR MAX. DESIGN PRESSURE = 45 PSF)

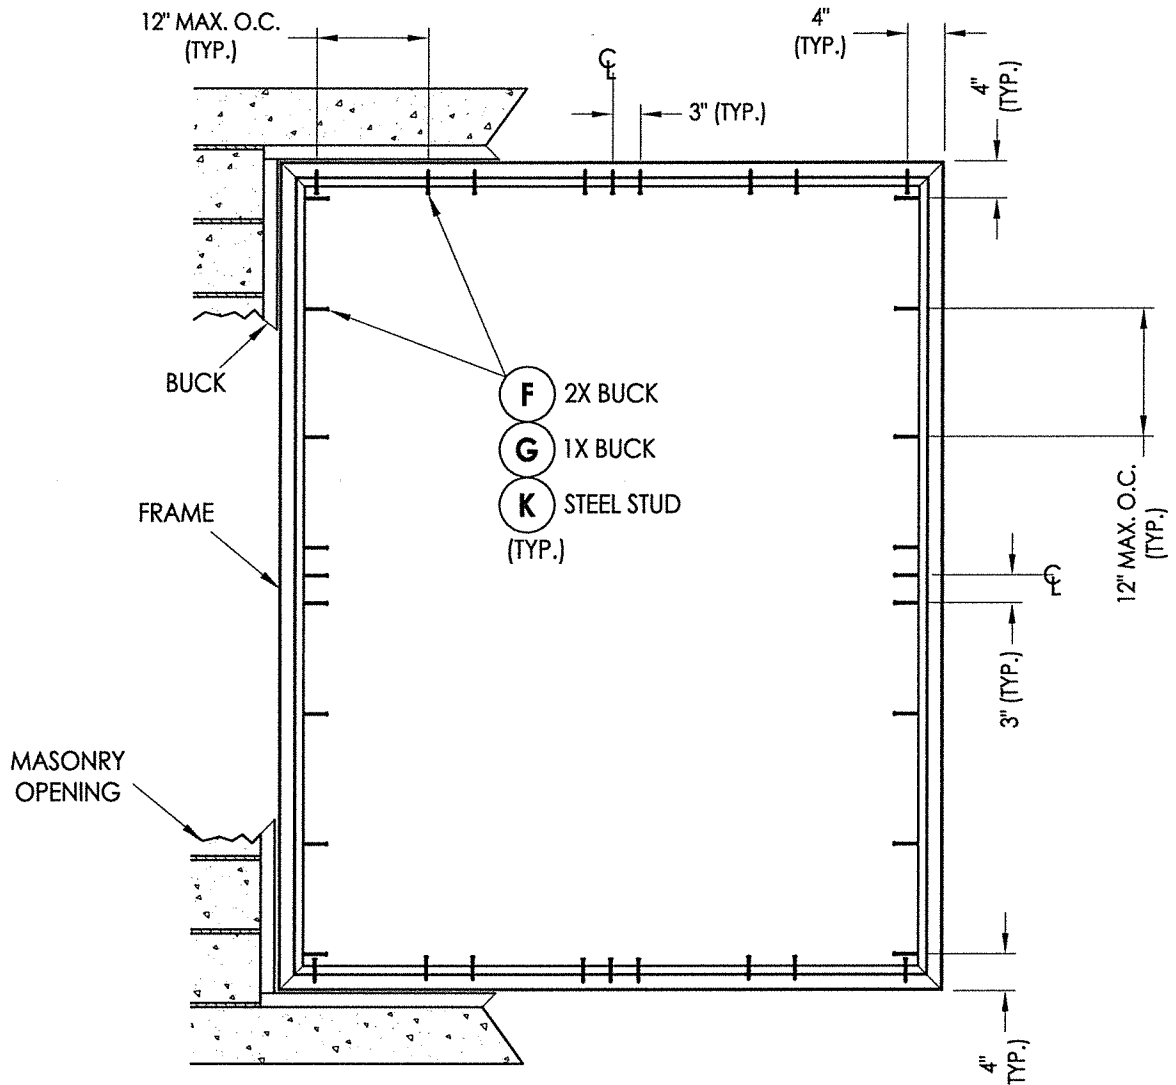

FRAME ANCHORING


CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON+®	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:

- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

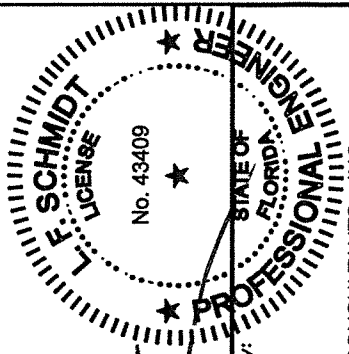


02/16/2021
Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry License No. 9813


<u>PRODUCT:</u>		Narrow Picture Window	
<u>PART OR ASSEMBLY:</u>		BUCK & FRAME ANCHORING	

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (SG >= 0.42)	WOOD
B	2X BUCK (SG >= 0.42)	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" HWH DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	#10 X 1-3/4" MODIFIED TRUSS HEAD (7/16"Ø HEAD) SMS (1-3/8" MIN. EMBEDMENT)	STEEL
G	1/4" X 3-1/4" HWH DeWALT OR ITW CONCRETE SCREW	STEEL
J	STEEL STUD Min. Thk .033" (ASTM A653 GRADE 33 Fy=33 ksi min., Fu=45 ksi min.)	STEEL
K	#10 PPH SELF-DRILLING SMS	STEEL
1	EXTRUDED VINYL FRAME *	RIGID PVC
2	EXTRUDED VINYL GLAZING BEAD *	RIGID PVC


* THE APPROVED WHITE RIGID PVC EXTERIOR EXTRUSIONS FOR WINDOWS ARE TO BE PRODUCED BY EXTRUDERS LICENSEES IN "AAMA CERTIFICATION PROGRAMS FOR RIGID PVC EXTRUSIONS".

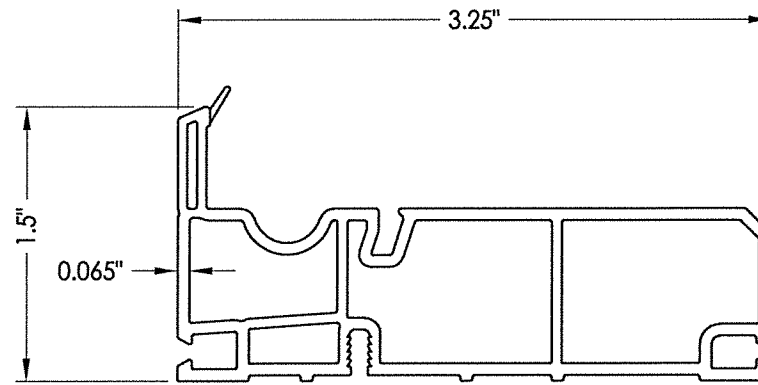


1 FRAME




2 GLAZING BEAD

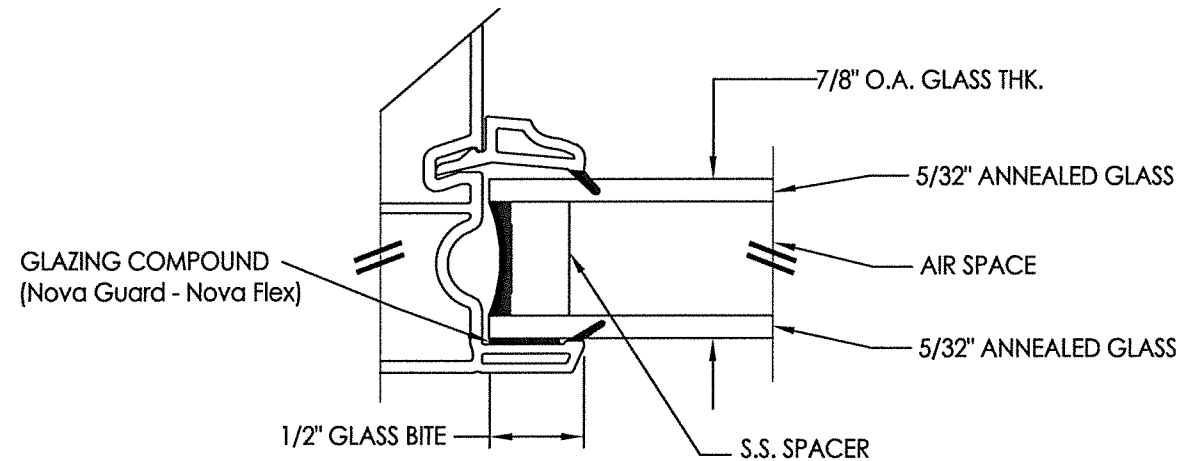


G2 GLAZING DETAIL

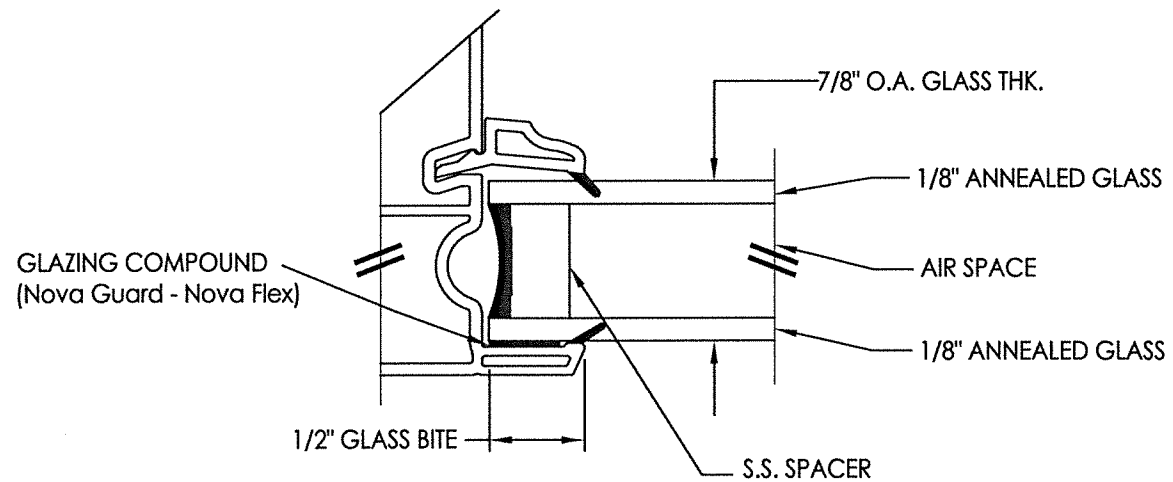

G1 GLAZING DETAIL

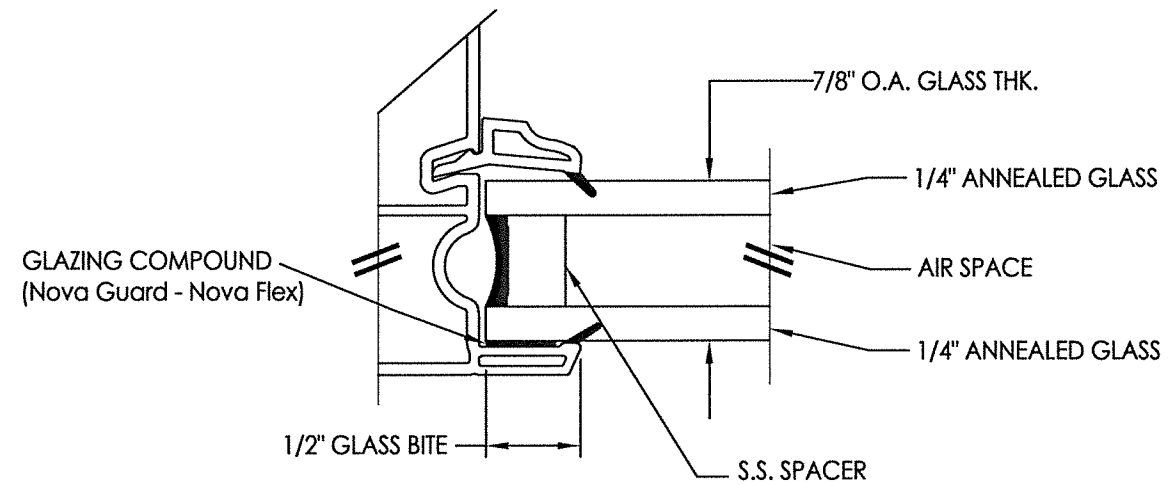

G3 GLAZING DETAIL

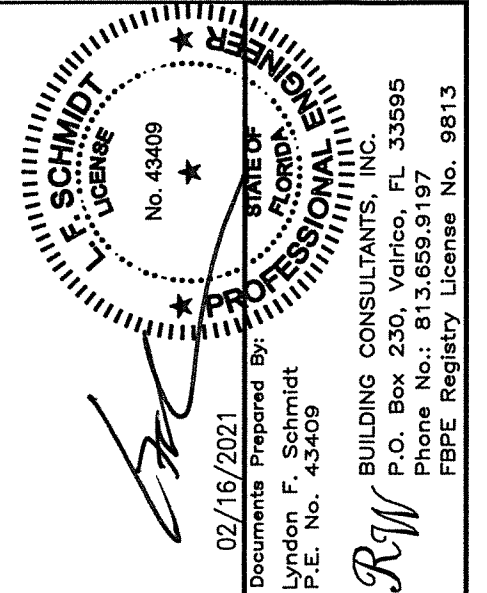

PRODUCT: Narrow Picture Window

PART OR ASSEMBLY:
**BILL OF MATERIALS, COMPONENTS
AND GLAZING DETAILS**

DATE:	2/16/21	
SCALE:	N.T.S.	
DWG. BY:	RW	
CHK. BY:	LFS	
DRAWING NO.:	FL-26908.20	
SHEET	4	OF 4