


EUROCRAFT INDUSTRIES INC.
*SERIES "76MD" VINYL FIXED WINDOW - LMI
(HVHZ)(IMPACT)*

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-11
 - ASTM E 1886-13
 - ASTM E 1996-17
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/4$ INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
5. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS. IN HVHZ AREAS, ONE TIME PRODUCT APPROVAL TO BE OBTAINED FROM MIAMI-DADE RER OR AHJ.
6. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
7. WINDOW FRAME MATERIAL: VINYL U-PVC
8. GLASS MEETS THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAILS.

MAX OVERALL SIZE		CONFIG.	DESIGN PRESSURE	MISSILE IMPACT RATING
WIDTH	HEIGHT			
59"	98.5"	"O"	+/- 75 PSF	LMI

TABLE OF CONTENTS		
SHEET	REVISION	SHEET DESCRIPTION
1	A	INSTALLATION AND GENERAL NOTES
2	A	ELEVATIONS & ANCHOR LAYOUTS
3	A	VERTICAL & HORIZONTAL SECTIONS
4	A	INSTALLATION NOTES, & ANCHOR DETAILS
5	A	BILL OF MATERIALS & COMPONENTS

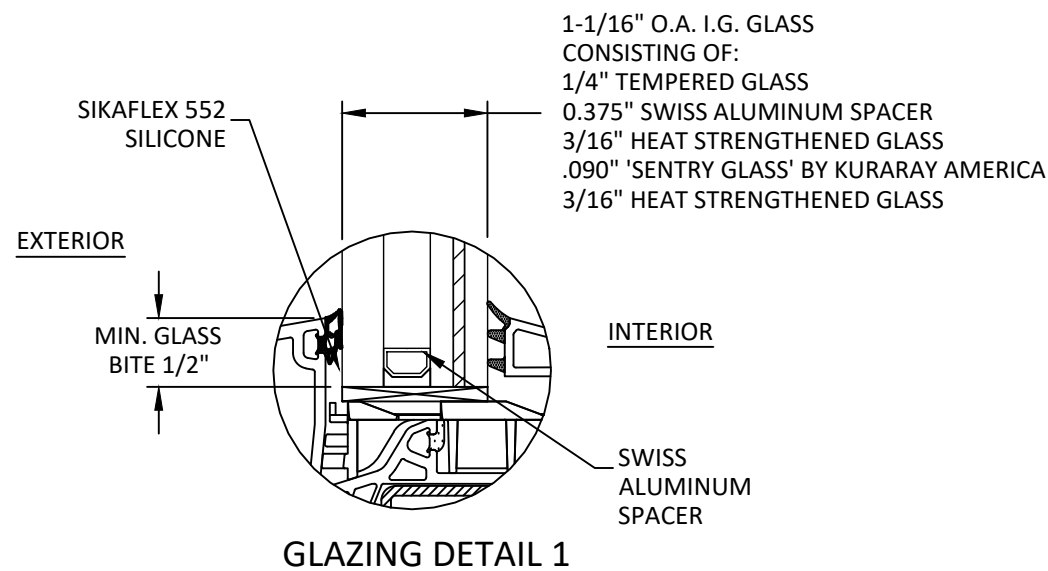

NOTE:

1. GLASS TYPE THICKNESS SHALL COMPLY WITH ASTM E-1300 GLASS CHART REQUIREMENTS.
2. ALL GLAZING CONFIGURATIONS SHALL COMPLY WITH SAFETY GLAZING REQUIREMENTS OUTLINED IN CH 24 OF THE CURRENT FBC
3. SETTING BLOCK SHOULD BE 70-90 DUROMETER AS PER CH 24 OF THE CURRENT FBC.
4. GLASS LITES THAT EXCEED 36" IN WIDTH SHALL USE SETTING BLOCKS AT 1/4 SPAN FROM CORNERS.



7905 NW 77TH AVE
MEDLEY, FL 33166
PH: (305) 888-5718 FX: (305) 220-5073

TITLE: 76MD FIXED WINDOW
(HVHZ)(IMPACT)

INSTALLATION & GENERAL NOTES

PREPARED BY:


BUILDING DROPS, INC.
E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
A-CODE CHANGE 2020	YC	09/20/20

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL IN NATURE AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT

Digitally signed by Hermes F Norero
Reason: I am approving this document
Date: 2020.12.18 16:52:18 +05'00'

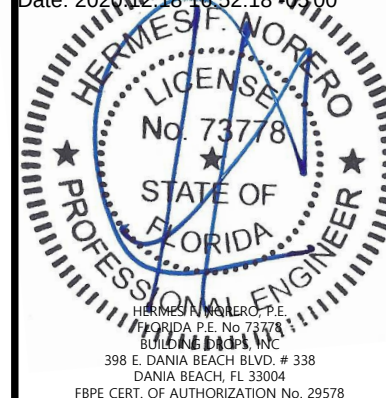

FL #: **FL27614**

DATE: 06.21.18

DWG. BY: AR	CHK. BY: HFN
-----------------------	------------------------

SCALE: NTS


DWG. #: EC1001

SHEET:


1

OF 5


s:\projects\eurocraft industries inc\cc-20-0916-fbc code change (ver. 7)12-revision due to alum. anchors\127614\dwg\ec001 - fx.dwg 12/18/2020 9:04 AM

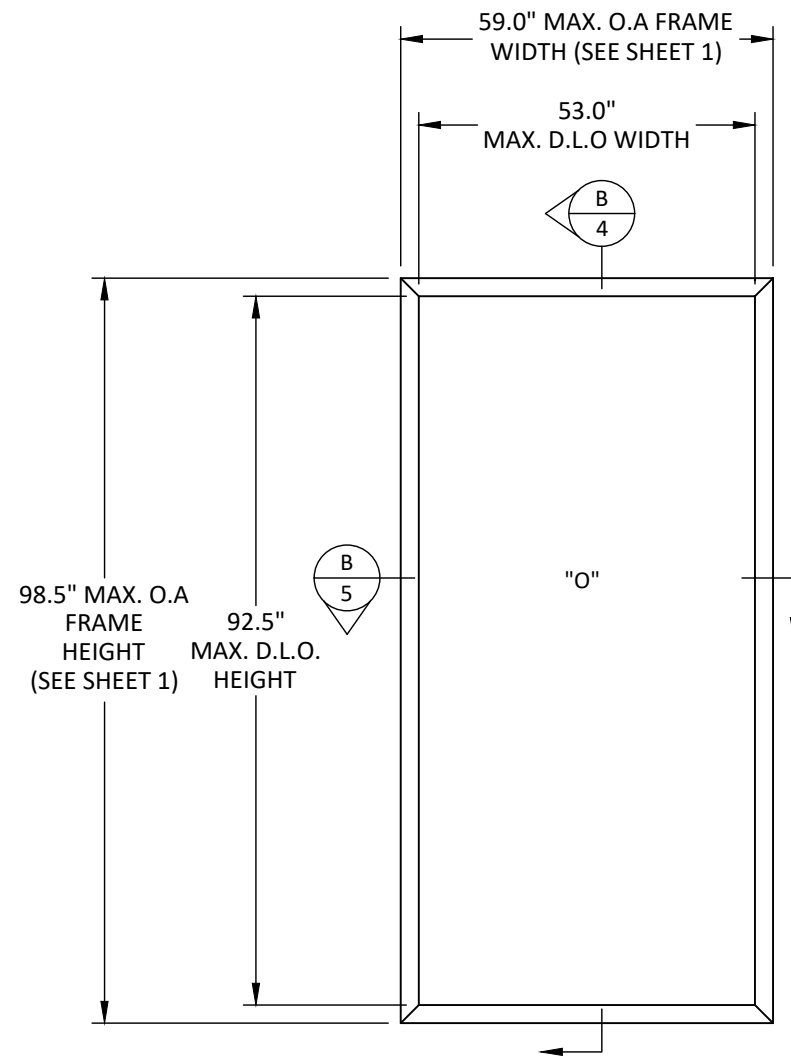


ELEVATION
FIXED WINDOW - SINGLE

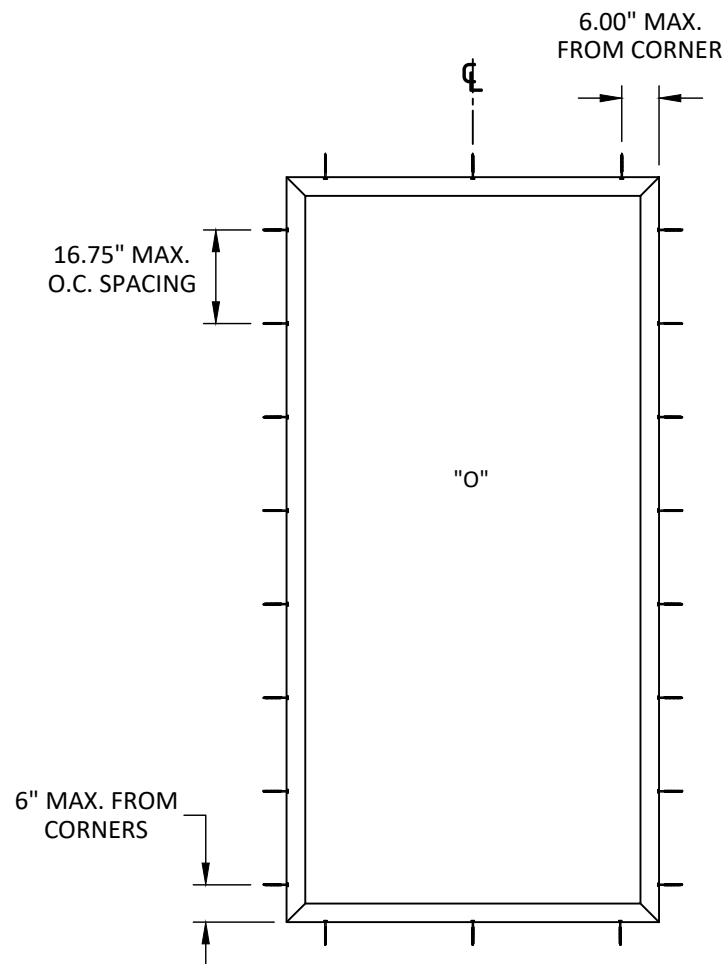

ANCHOR LAYOUT
THROUGH FRAME

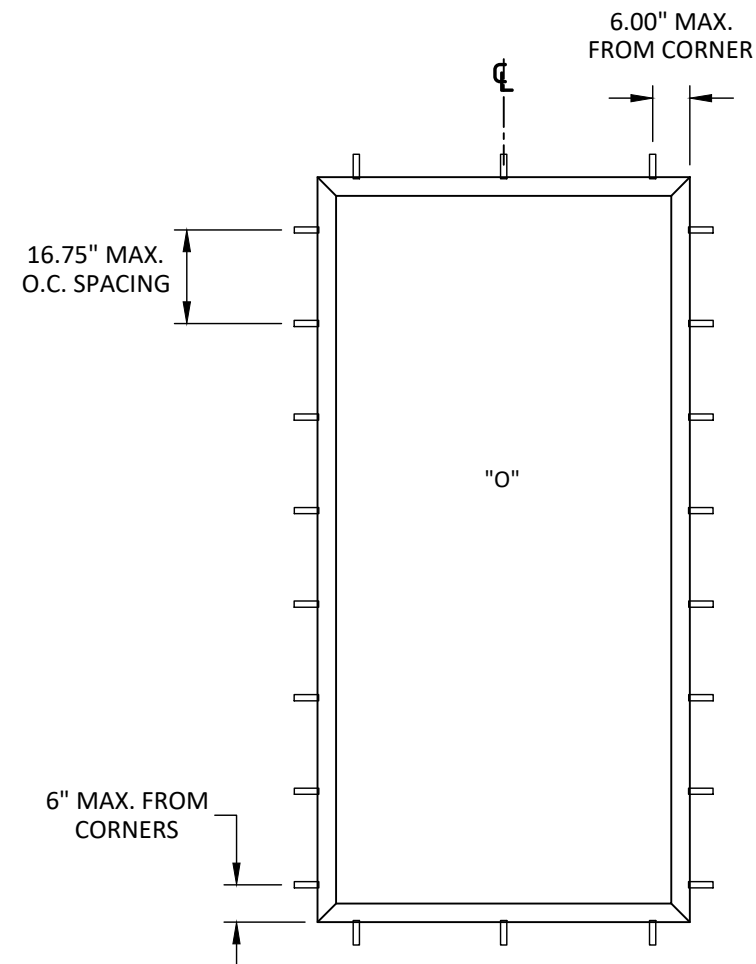

ANCHOR LAYOUT
STRAP

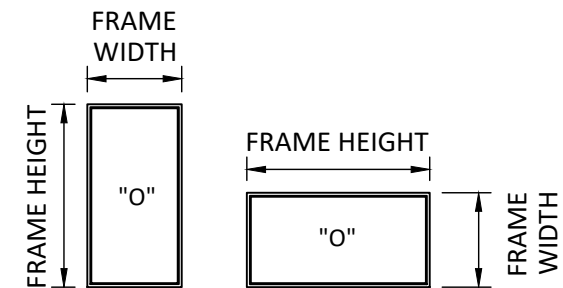

NOTE:
WINDOW WIDTH AND HEIGHT ARE
INTERCHANGEABLE FOR ALL SIZES
SHOWN HEREIN NOT TO EXCEED
MAXIMUM QUALIFIED SQUARE
FOOT AREA.



7905 NW 77TH AVE
MEDLEY, FL 33166
PH: (305) 888-5718 FX: (305) 220-5073


TITLE: 76MD FIXED WINDOW (HVHZ)(IMPACT)

ELEVATIONS AND ANCHOR LAYOUTS

PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
A-CODE CHANGE 2020	YC	09/20

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

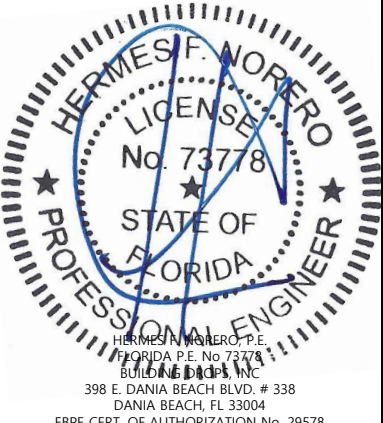

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL27614

DATE: 06.21.18

DWG. BY: AR	CHK. BY: HFN
-------------	--------------

SCALE: NTS


DWG. #: EC1001

SHEET:


2

OF 5

s:\projects\eurocraft industries inc\cc-20-0916-fbc code change (ver. 7)12-revision due to alum. anchors\127614\dwg\eci001 - fx.dwg 12/18/2020 9:04 AM

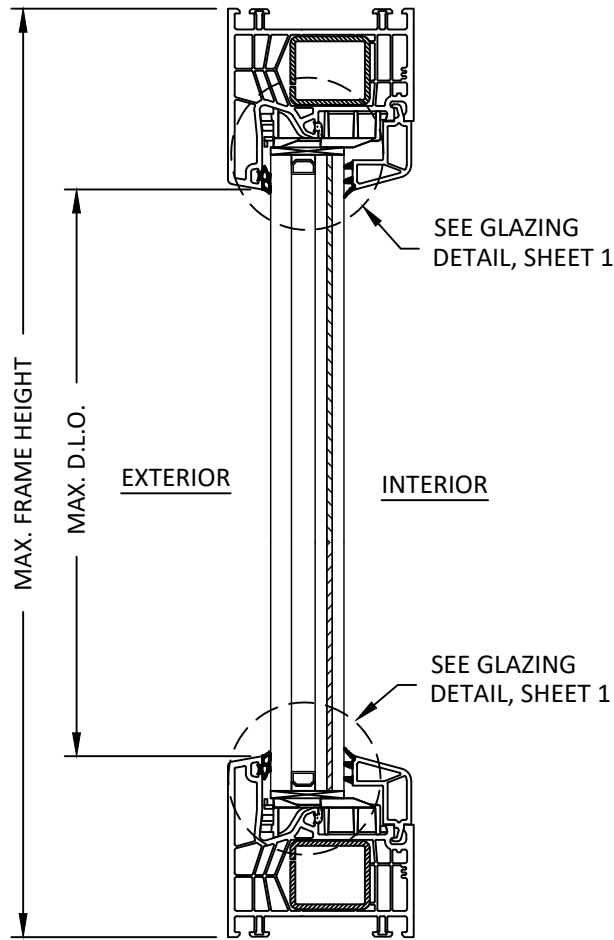

A
3 **VERTICAL SECTION**
FIXED WINDOW

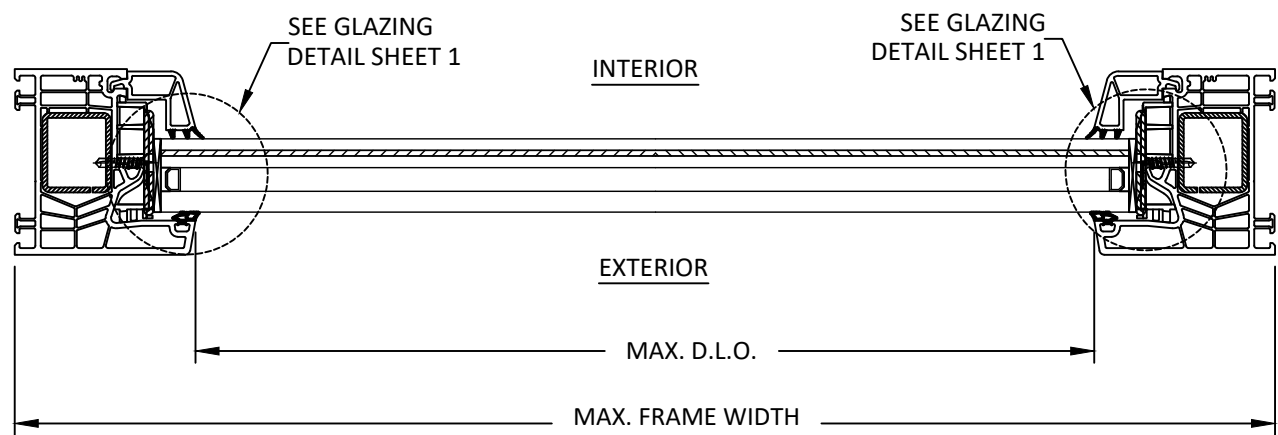

B
3 **HORIZONTAL SECTION**
FIXED WINDOW



7905 NW 77TH AVE
MEDLEY, FL 33166
PH: (305) 888-5718 FX: (305) 220-5073

TITLE: 76MD FIXED WINDOW
(HVHZ)(IMPACT)

VERTICAL & HORIZONTAL
SECTIONS


PREPARED BY:

BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
A-CODE CHANGE 2020	YC	09/20

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

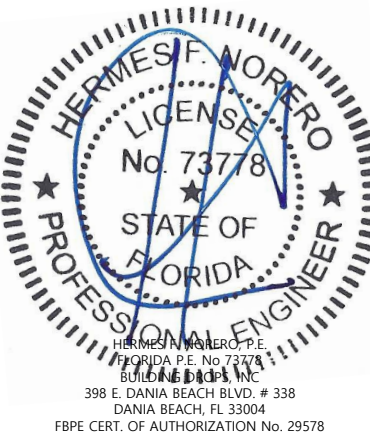


FL #:		FL27614
DATE:		06.21.18
DWG. BY:	CHK. BY:	
AR	HFN	
SCALE:		NTS
DWG. #:		ECI001
SHEET:		3

s:\projects\eurocraft industries inc\cc-20-0916-fbx code change (ver. 7)12-revision due to alum. anchors\127614\dwg\ec001 - fx.dwg
12/18/2020 9:04 AM

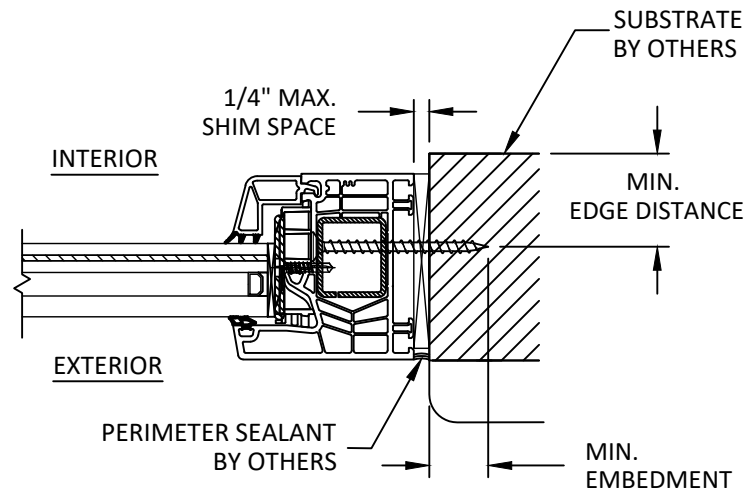

A
4 **HORIZONTAL SECTION**
THROUGH FRAME (JAMB)

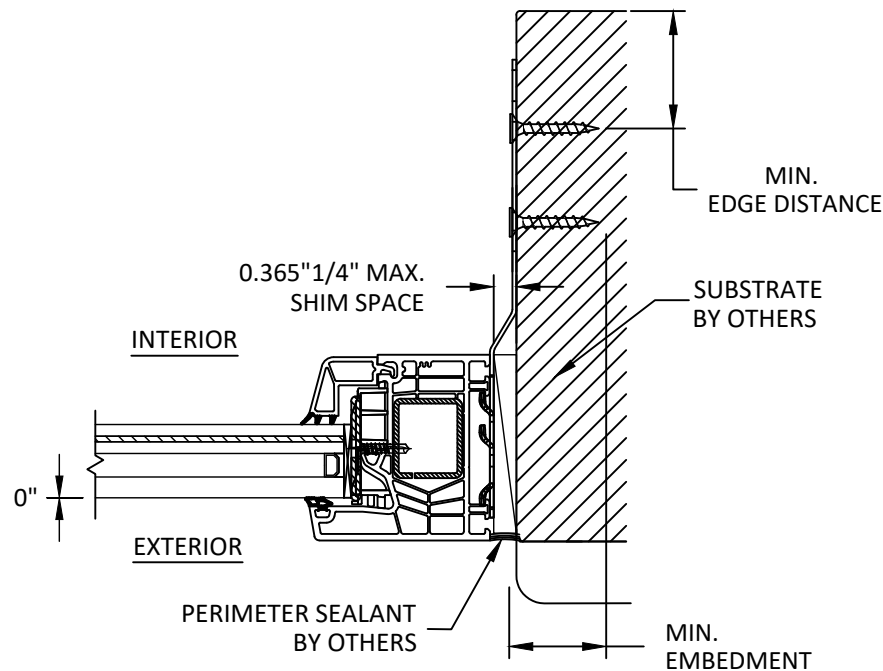

B
4 **HORIZONTAL SECTION**
STRAP (JAMB)

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/4$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR SCHEDULE	MIN EMBEDMENT	MIN. EDGE DISTANCE
THROUGH FRAME	WOOD: MIN. SG = 0.55	#14 WOOD SCREW FLAT HEAD	1.5"	0.75"
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI	1/4" TEK SCREW FLAT HEAD	3 THREADS MIN PENETRATION BEYOND METAL	0.5"
	METAL: ALUMINUM MIN. 1/8" THICKNESS (6063-T5 MIN.)			
	CONCRETE: MIN. f'c=3000PSI	1/4" ITW TAPCON FLATHEAD	1.75"	2.5
	MASONRY: CMU per ASTM C90 MIN. 2000 PSI	1/4" ITW TAPCON FLATHEAD	1"	2.5
STRAP	WOOD: MIN. SG = 0.55	#14 WOOD SCREW FLAT HEAD	1.5"	0.75"
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI	1/4" TEK SCREW FLAT HEAD	3 THREADS MIN PENETRATION BEYOND METAL	0.5"
	METAL: ALUMINUM MIN. 1/8" THICKNESS (6063-T5 MIN.)			
	CONCRETE: MIN. f'c=3000PSI	1/4" ITW TAPCON FLATHEAD	1.75"	2.5
	MASONRY: CMU per ASTM C90 MIN. 2000 PSI	1/4" ITW TAPCON FLATHEAD	1"	2.5



7905 NW 77TH AVE
MEDLEY, FL 33166
PH: (305) 888-5718 FX: (305) 220-5073

TITLE: 76MD FIXED WINDOW
(HVHZ)(IMPACT)

INSTALLATION NOTES,
& ANCHOR DETAILS

PREPARED BY:

BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004


PH: (954) 399-8478
FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
A-CODE CHANGE 2020	YC	09/20

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

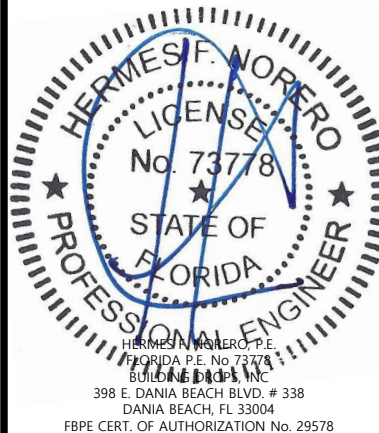

FL #:

FL27614

DATE: **06.21.18**

DWG. BY: AR	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**

DWG. #: **ECI001**





SHEET:

4


OF 5

s:\projects\eurocraft industries inc\cc-20-0916-fbc code change (ver. 7)12-revision due to alum. anchors\1027614\dwg\eci001 - fx.dwg 12/18/2020 9:04 AM


BILL OF MATERIALS			
ITEM	PART No.	DESCRIPTION	MATERIAL
1	76171	MAIN FRAME - RIGID VINYL	VINYL
2	2636	GLAZING BEAD FRAME	VINYL
3	M138	GLAZING INSERT	VINYL
4	PCE	GLAZING GASKET (RUBBER 70 DUR)	EPDM
5	V309	REINFORCEMENT	STEEL
6	S041	ANCHOR STRAP	-

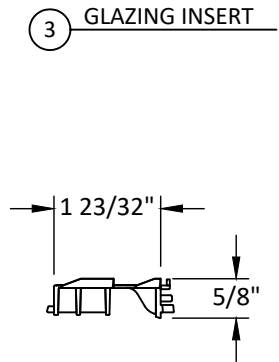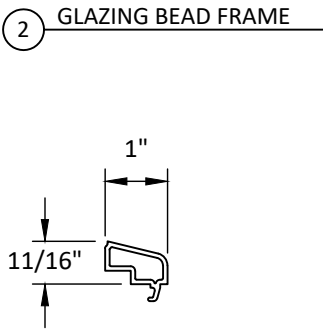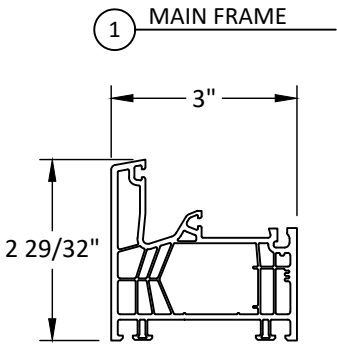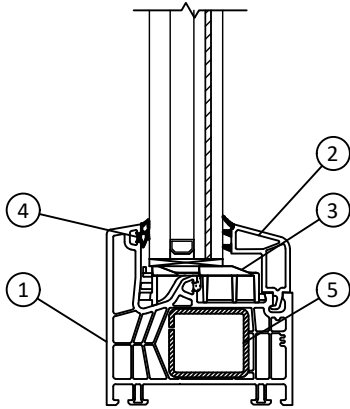

5 REINFORCEMENT

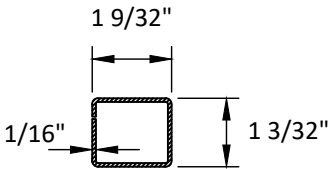

6 ANCHOR STRAP

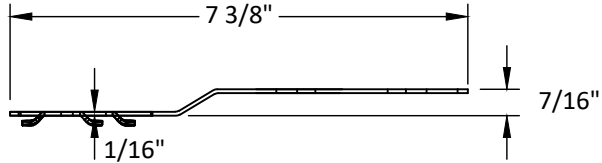



7905 NW 77TH AVE
MEDLEY, FL 33166
PH: (305) 888-5718 FX: (305) 220-5073

TITLE: 76MD FIXED WINDOW (HVHZ)(IMPACT)


BILL OF MATERIALS & COMPONENTS

PREPARED BY: 

BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
A-CODE CHANGE 2020	YC	09/20

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

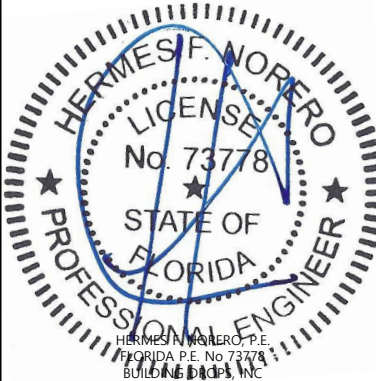

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL27614**

DATE: **06.21.18**

DWG. BY: AR	CHK. BY: HFN
--------------------	---------------------

SCALE: **NTS**

DWG. #: **ECI001**

SHEET: **5**

OF 5