

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING THE HVHZ.
2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL.
4. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1–1/2” UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER’S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
5. WHERE WOOD BUCK THICKNESS IS 1–1/2” OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER’S PUBLISHED INSTALLATION INSTRUCTIONS.
6. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
7. BUCKS SHALL EXTEND BEYOND UNIT FRAME INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
8. SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16” OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4”.
9. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
10. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
11. FRAME MATERIAL: EXTRUDED RIGID PVC.
12. UNITS MUST BE GLAZED PER ASTM E1300–04/09, SEE SHEET 9 FOR GLASS DETAILS.
13. APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
14. FOR ANCHORING THROUGH FRAME INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4” MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.

15. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 1/4” TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4” MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2” MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. FOR ANCHORING THROUGH FRAME INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
17. ALL FASTENERS TO BE CORROSION RESISTANT.
18. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER’S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:

A. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42

B. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.

C. MASONRY: HOLLOW/FILLED BLOCK PER ASTM C90 WITH Fm=2,000PSI MINIMUM.

D. METAL STRUCTURE: STEEL 18GA (.048”) FY=33KSI/FU=52KSI OR ALUMINUM 6063–T5 FU=30KSI .060” THICK MINIMUM

SIGNED: 09/17/2018

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2	ELEVATION
3	DESIGN PRESSURE CHART
4 – 5	CROSS SECTIONS
6 – 8	INSTALLATION DETAILS
9 – 10	COMPONENTS AND GLAZING DETAIL

REILLY WINDOWS & DOORS
901 BURMAN BLVD., BUILDING 701
CALVERTON, NEW YORK 11933

RWD40F FLUSH SILL SLIDER
IMPACT HVHZ
NOTES

DRAWN:
A.R.

DWG NO.
08–03214

REV
–

SCALE NTS

DATE 02/23/18



SHEET 1 OF 10

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@lrlomaspe.com



Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

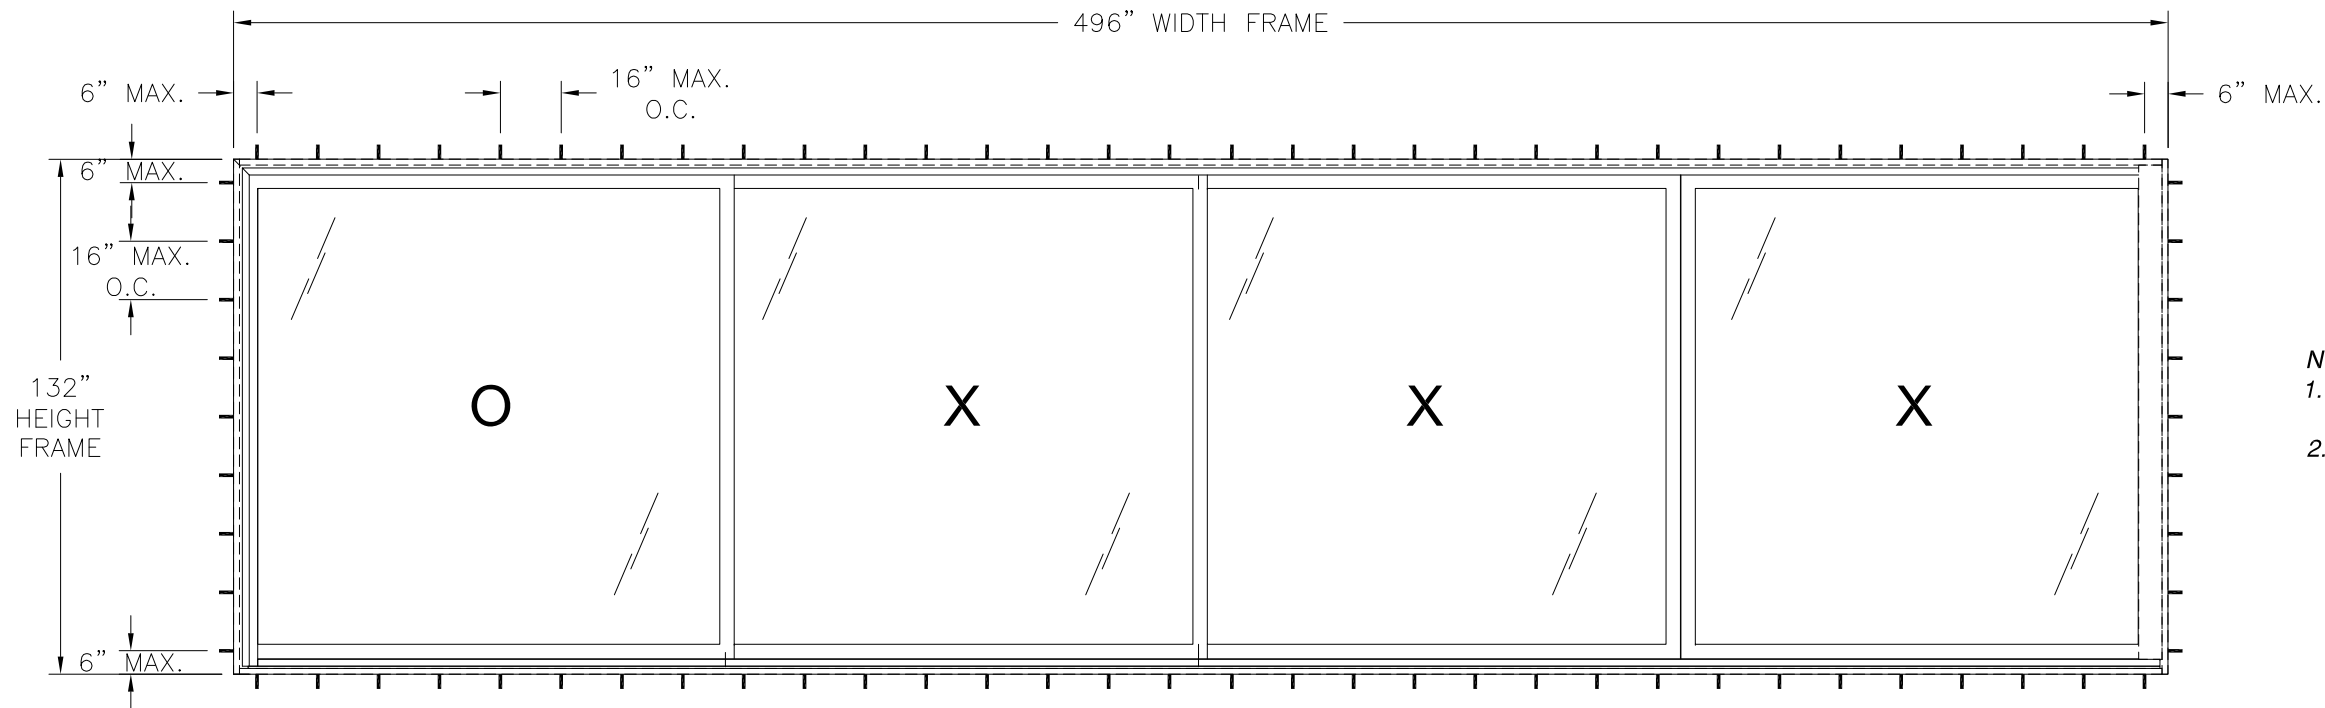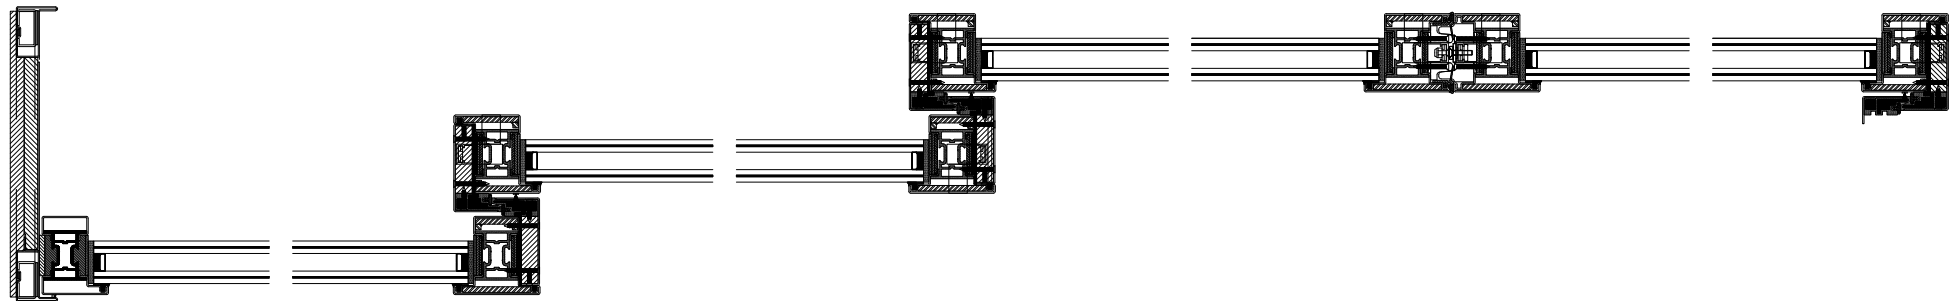

- NOTES:
- SASH SIZE FIXED = 126" x 126 1/8"
SASH SIZE OPERABLE = 125" x 126 1/8"
 - D.L.O. FIXED : 118 1/2" x 118 5/8"
D.L.O. OPERABLE: 117 5/8" x 118 3/4"

RWD40F FLUSH SILL SLIDER
EXTERIOR VIEW

DESIGN PRESSURE RATING	IMPACT RATING
±50.0PSF	LARGE AND SMALL MISSILE IMPACT

MISSILE LEVEL D, WIND ZONE 4, AND HVHZ


(4) PANELS SHOWN, UNLIMITED CONFIGURATIONS IN UNLIMITED NUMBER OF PANELS IS APPLICABLE AS LONG AS INDIVIDUAL PANEL AREA DOES NOT EXCEED 109.46 FT²
REFER TO CHART #1 SHEET 3 FOR RATINGS

HARDWARE SCHEDULE

A.	(6 ASSEMBLIES) CARRIAGE ROLLER KIT, AT EACH OPERABLE DOOR PANELS' BOTTOM RAIL
B.	(4) LOCK BOLT TYPE N COAXIAL, AT BI-PART MEETING STILES, 6" FROM THE TOP WITH A CENTER TO CENTER SPACING OF 36", 38" & 37" THEREAFTER
C.	304 STAINLESS STEEL FLAT STOCK, AT RIGTH STILE OF FIXED PANEL AND RIGHT STILE OF OPERABLE B SASH
D.	304 STAINLESS STEEL FLAT STOCK, TWO AT LEFT STILE OF A SASH, B SASH, AND POCKED MEETING STILE. ONE AT EACH BI-PART MEETING STILE
E.	304 STAINLESS STEEL FLAT STOCK, AT RIGTH STILE OF FIXED PANEL, RIGHT STILE OF OPERABLE B SASH AND BOTH BI-PART MEETING STILES
F.	304 STAINLESS STEEL ROLLED TUBE, TWO AT FRAME HEAD AND TWO AT FRAME JAMB ADJACENT TO FIXED PANEL
G.	304 STAINLESS STEEL FLAT STOCK, ONE AT THERMAL BREAK HOLLOW OF EACH BOTTOM RAIL ON OPERABLE SASH

SIGNED: 09/17/2018

REILLY WINDOWS & DOORS 901 BURMAN BLVD., BUILDING 701 CALVERTON, NEW YORK 11933		
RWD40F FLUSH SILL SLIDER IMPACT HVHZ ELEVATION		
DRAWN: A.R.	DWG NO. 08-03214	REV -
SCALE NTS	DATE 02/23/18	SHEET 2 OF 10
L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@lrlomaspe.com		

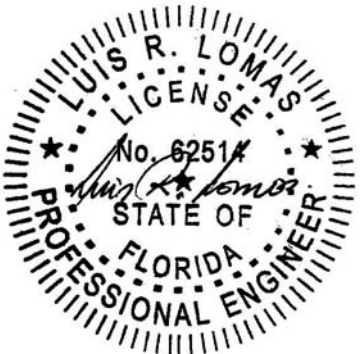

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

Chart #1

Maximum Design pressure (psf)																													
Panel Height (in)	Single Panel Width (in)																												
	48.0		54.0		60.0		66.0		72.0		78.0		84.0		90.0		96.0		102.0		108.0		114.0		120.0		126.1		
	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	
80.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	
86.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	
92.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	
98.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	
104.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	
110.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	59.7	59.7	56.8	56.8
116.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	59.4	59.4	59.1	59.1	56.6	56.6	53.9	53.9	
122.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	59.2	59.2	57.4	57.4	56.0	56.0	54.9	54.9	54.1	54.1	53.6	53.6	53.4	53.4	51.2	51.2	
125.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	59.3	59.3	57.0	57.0	55.2	55.2	53.8	53.8	52.7	52.7	51.8	51.8	51.3	51.3	51.0	51.0	50.0	50.0	
128.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	57.3	57.3	55.0	55.0	52.8	52.8	51.0	51.0	49.6	49.6	48.6	48.6	47.8	47.8	47.3	47.3	-	-	
134.0	60.0	60.0	60.0	60.0	60.0	60.0	56.3	56.3	52.6	52.6	49.6	49.6	47.1	47.1	45.1	45.1	43.5	43.5	42.2	42.2	41.1	41.1	40.3	40.3	-	-	-	-	
140.0	60.0	60.0	58.0	58.0	53.0	53.0	48.9	48.9	45.7	45.7	43.0	43.0	40.8	40.8	38.9	38.9	37.4	37.4	36.2	36.2	35.2	35.2	-	-	-	-	-	-	
144.0	59.0	59.0	53.1	53.1	48.5	48.5	44.7	44.7	41.7	41.7	39.2	39.2	37.1	37.1	35.4	35.4	34.0	34.0	32.8	32.8	31.9	31.9	-	-	-	-	-	-	

SIGNED: 09/17/2018

REILLY WINDOWS & DOORS
901 BURMAN BLVD., BUILDING 701
CALVERTON, NEW YORK 11933

RWD40F FLUSH SILL SLIDER
IMPACT HVHZ
DESIGN PRESSURE CHART

DRAWN:
A.R.

DWG NO.
08-03214


REV
-

SCALE
NTS

DATE
02/23/18


SHEET
3 OF 10

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@lrlomaspe.com

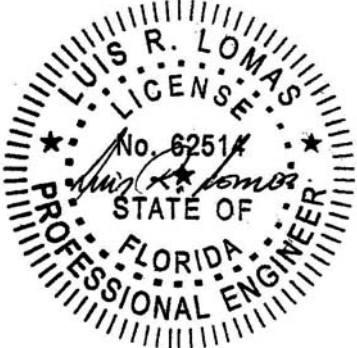

Luis R. Lomas P.E.
FL No.: 62514

BILL OF MATERIALS				
ITEM NO.:	PART NUMBER	DESCRIPTION	MANUFACTURER	MATERIAL
1	P1105	SASH RAILS		STAINLESS STEEL
1a	P9999E	BI-PART MEETING STILE		STAINLESS STEEL
1c	P1106	OPERABLE SASH BOTTOM RAIL		STAINLESS STEEL
2	P1193	JAMB HEAD AND LEG		STAINLESS STEEL
3	P1101	FIXED SASH STILE		STAINLESS STEEL
4	P9999C	SASH STILES		STAINLESS STEEL
5	P1142	STILE CAPS		STAINLESS STEEL
6	P9999D	SASH STILES		STAINLESS STEEL
7	RWD SILL	REILLY CUSTOM SILL		ALUMINUM
10	RE001	REINFORCING	RWD	304 STAINLESS STEEL
11	RE002	REINFORCING	RWD	304 STAINLESS STEEL
12	RE006	REINFORCING	RWD	304 STAINLESS STEEL
13	RE009	REINFORCING (TUBE)	RWD	304 STAINLESS STEEL
15	BRONZE SILL TRACK	CUSTOM BILT TRACK	RWD	BRONZE
16	SILL GUIDE	CUSTOM ALUMINUM SILL GUIDE	RWD	ALUMINUM
17	HEAD TRACK	CUSTOM ALUMINUM HEAD TRACK	RWD	ALUMINUM
18	BL1.5/BL1.6	BLOCKING FOR FIXED SASH	RWD	
19	RL.9	CUSTOM GUIDE	RWD	
20	BL1.5	INTERLOCK BLOCK	RWD	DERLIN
21	BL.9A	INTERLOCK BLOCK	RWD	DERLIN
23	SLIDER PLATE	IMPACT GUIDE PLATE	RWD	17-4 PH STAINLESS STEEL
24	LAD255SH30/50	GEAR	FFI	304 STAINLESS STEEL
25	LAR3000012/A18	CARRIAGE ROLLER KIT, W/ MIDDLE CARRIAGE (LAR400T002)	FFI	304 STAINLESS STEEL
26	LLB.631.12	LOCK BOLT TYPE N COAXIAL, BLACK	FFI	
27	.25" X 1"	TUBE	YARDE METALS	304 STAINLESS STEEL
28	847329	BRIDGE SEAL	SIEGENIA	
29		WEEP COVER		
31		No. 10 x 3" LAG SCREW		ZINC COATED STEEL
33		No. 8 x 2" WOOD SCREW		STAINLESS STEEL
34		No. 10 x 2" MACHINE SCREW		ZINC COATED STEEL
35		No. 8 x 1.5" MACHINE SCREW		STAINLESS STEEL
36		4.2 MM x 25 MM SHEET METAL SCREW		STAINLESS STEEL
37		4.2 MM x 19 MM SHEET METAL SCREW		STAINLESS STEEL
38		No. 6 x .75" SHEET METAL SCREW		STAINLESS STEEL
39		M5 x 25 MM MACHINE SCREW		STAINLESS STEEL
40	995-BK	STRUCTURAL SILICONE SEALANT		DOW
41	GE 1105S	SEAL AT HEAD		SECCO
42	GE 1106S	SEAL AT SILL AND BI-PARTING MEETING STILE		SECCO
43	GE 1142	BULB SEAL AT INTERLOCK		SECCO
44	#34P	BRUSH SEAL AT INTERLOCK		ZERO
45	618-BK-5625	GLAZING TAPE, D/S 1/16" x 5/16"		LAMATEK

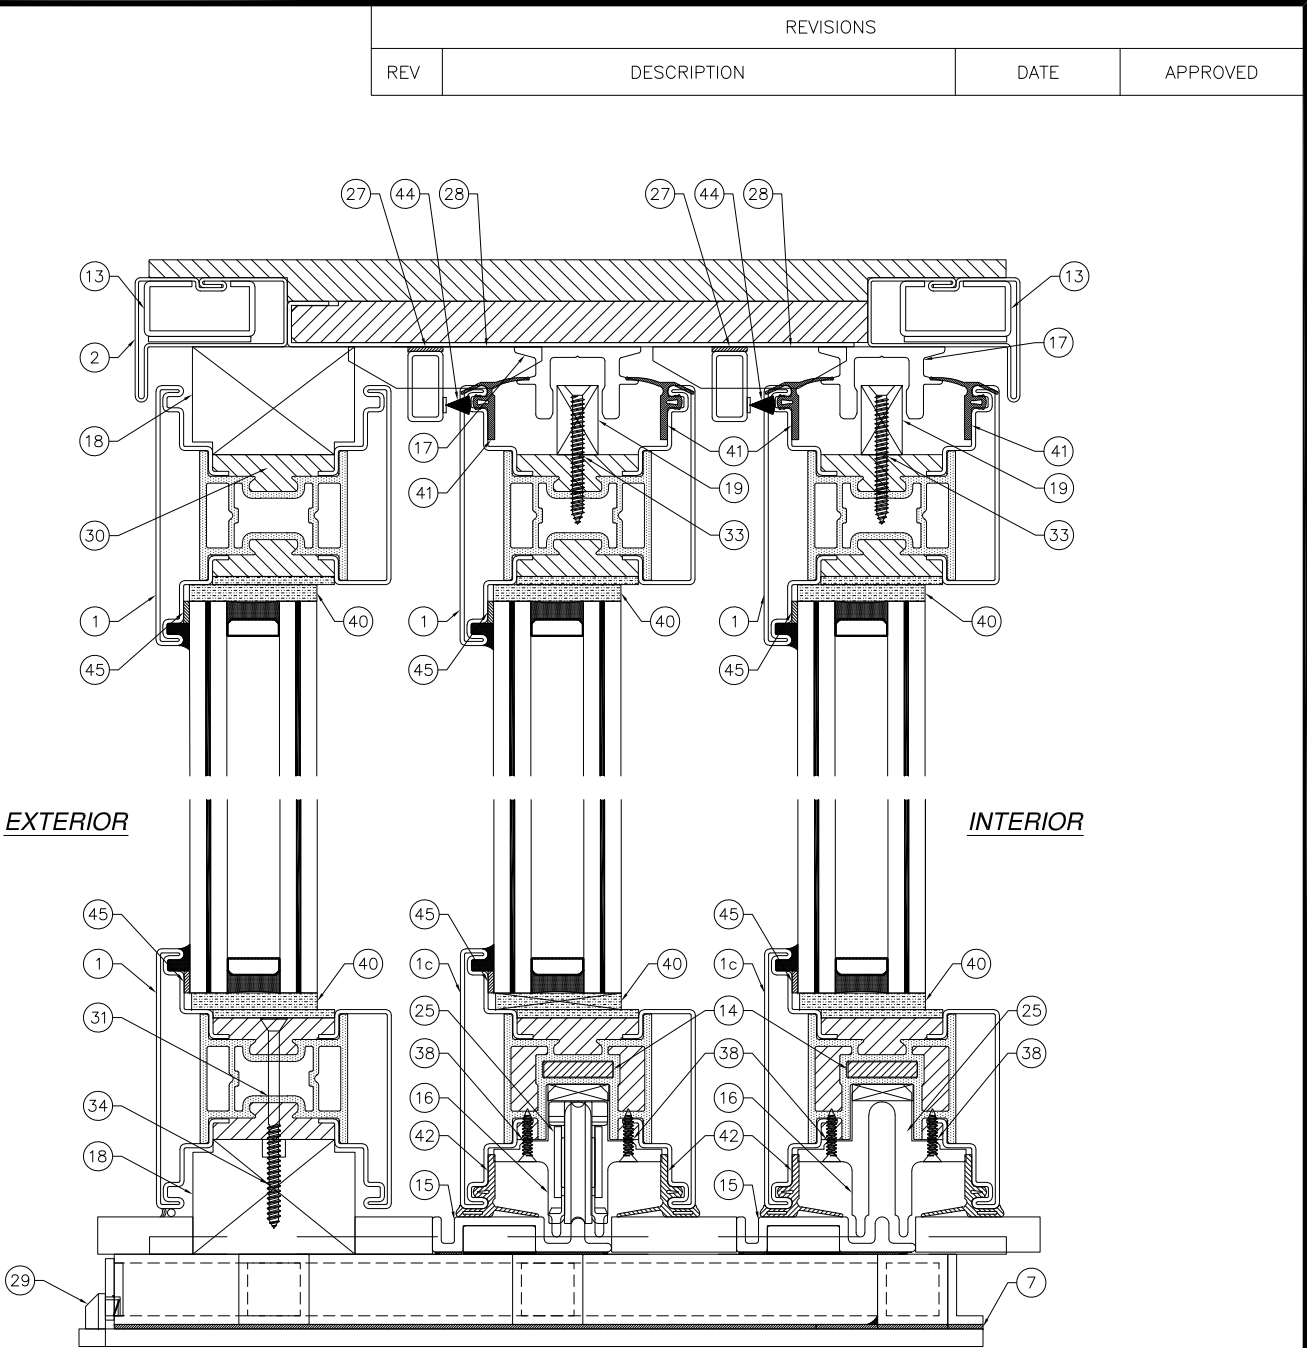

VERTICAL CROSS SECTION

SIGNED: 09/17/2018

REILLY WINDOWS & DOORS
901 BURMAN BLVD., BUILDING 701
CALVERTON, NEW YORK 11933

RWD40F FLUSH SILL SLIDER
IMPACT HVHZ
VERTICAL CROSS SECTIONS

DRAWN:
A.R.

DWG NO.
08-03214


REV
-

SCALE
NTS

DATE
02/23/18


SHEET
4 OF 10

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@lrlomaspe.com

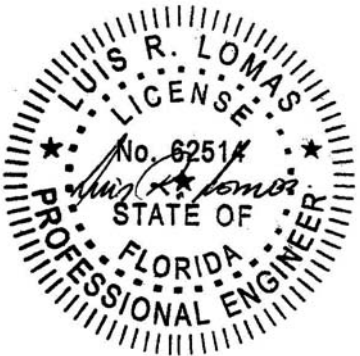

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

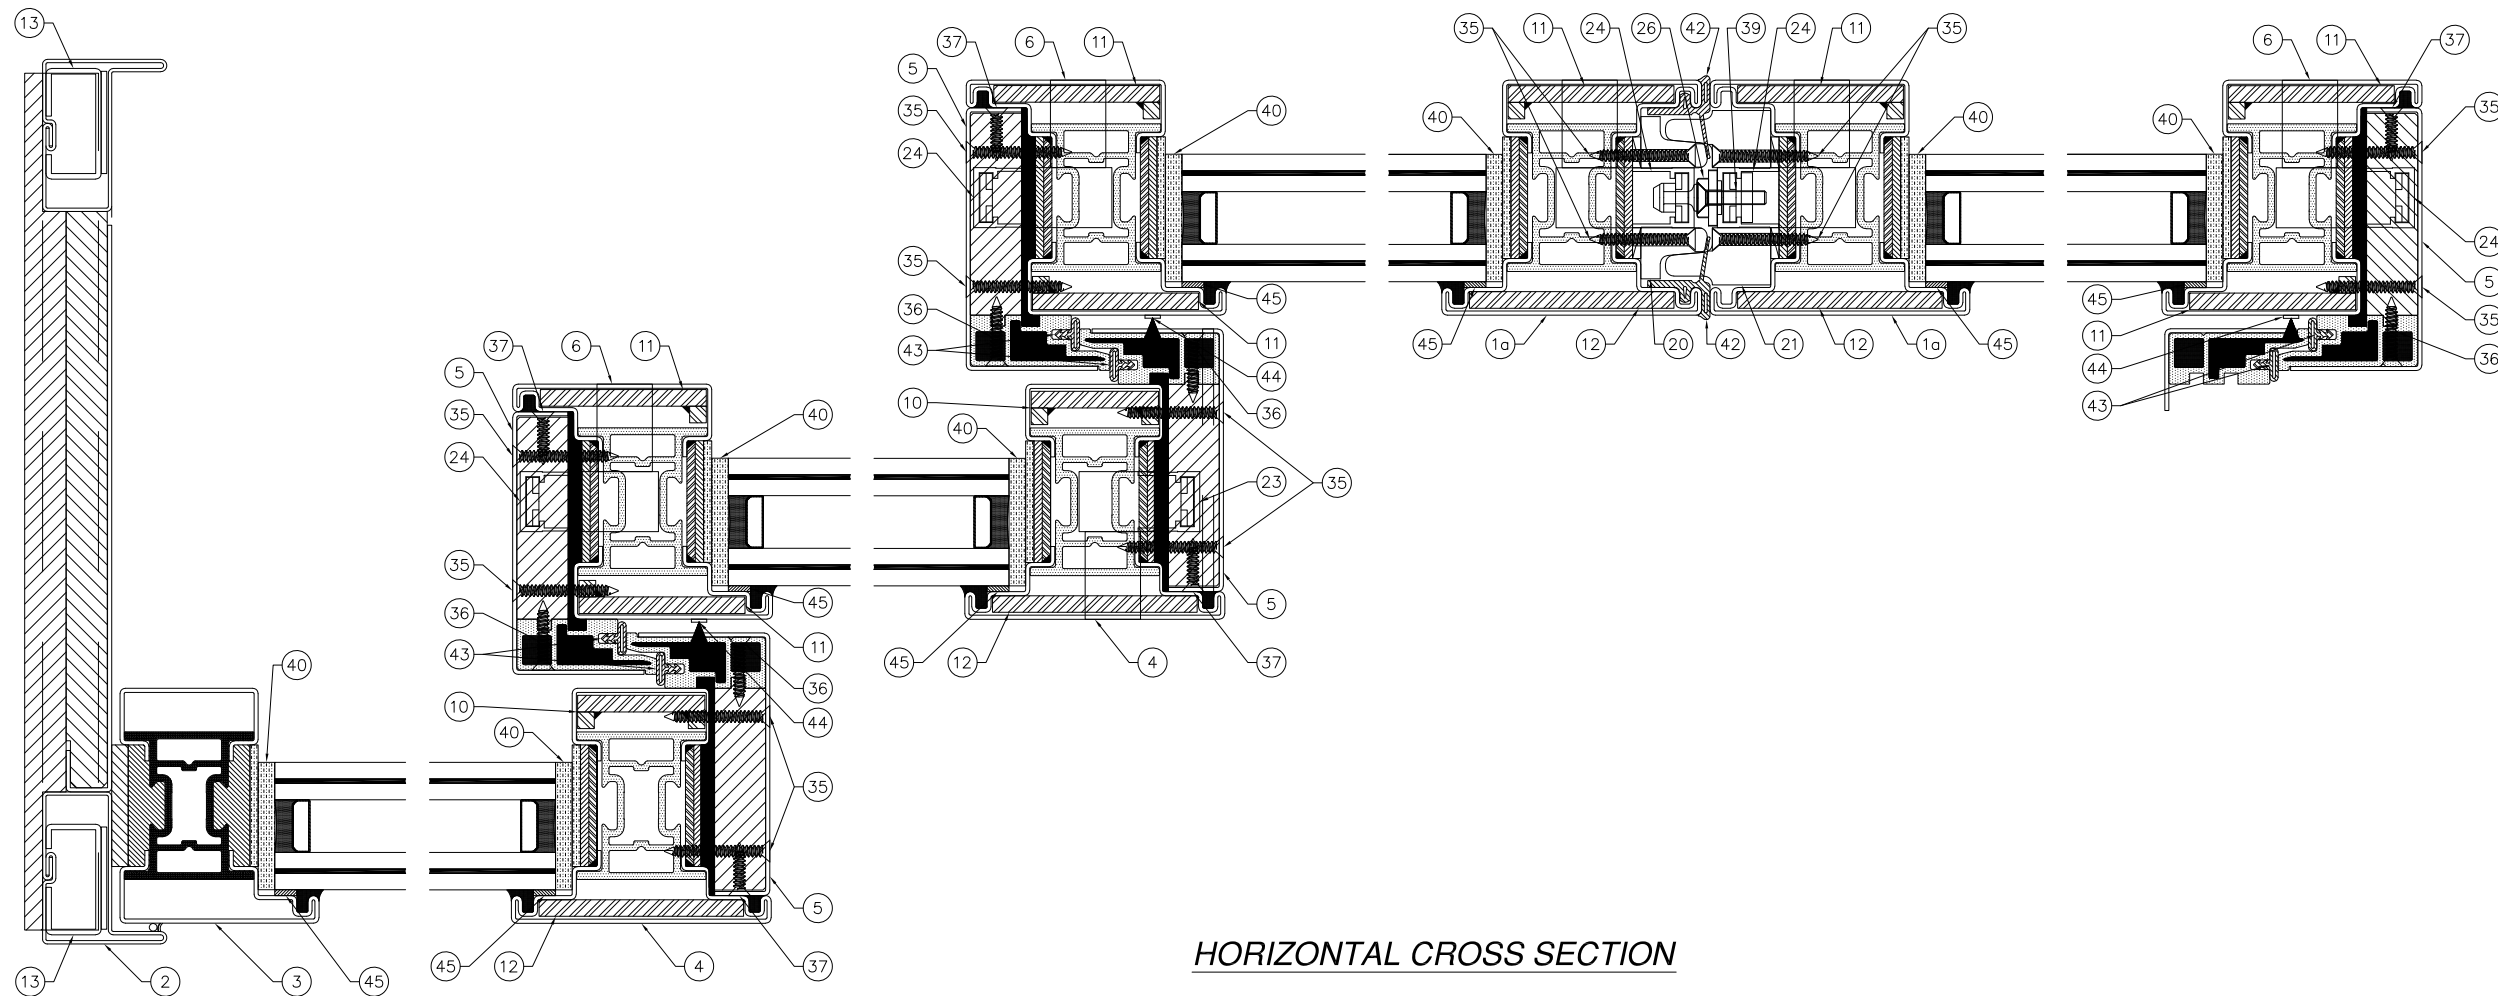


HORIZONTAL CROSS SECTION

SIGNED: 09/17/2018


REILLY WINDOWS & DOORS 901 BURMAN BLVD., BUILDING 701 CALVERTON, NEW YORK 11933		
RWD40F FLUSH SILL SLIDER IMPACT HVHZ HORIZONTAL CROSS SECTIONS		
DRAWN: A.R.	DWG NO. 08-03214	REV -
SCALE NTS	DATE 02/23/18	SHEET 5 OF 10
L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@lrlomaspe.com		

Luis R. Lomas P.E.
FL No.: 62514

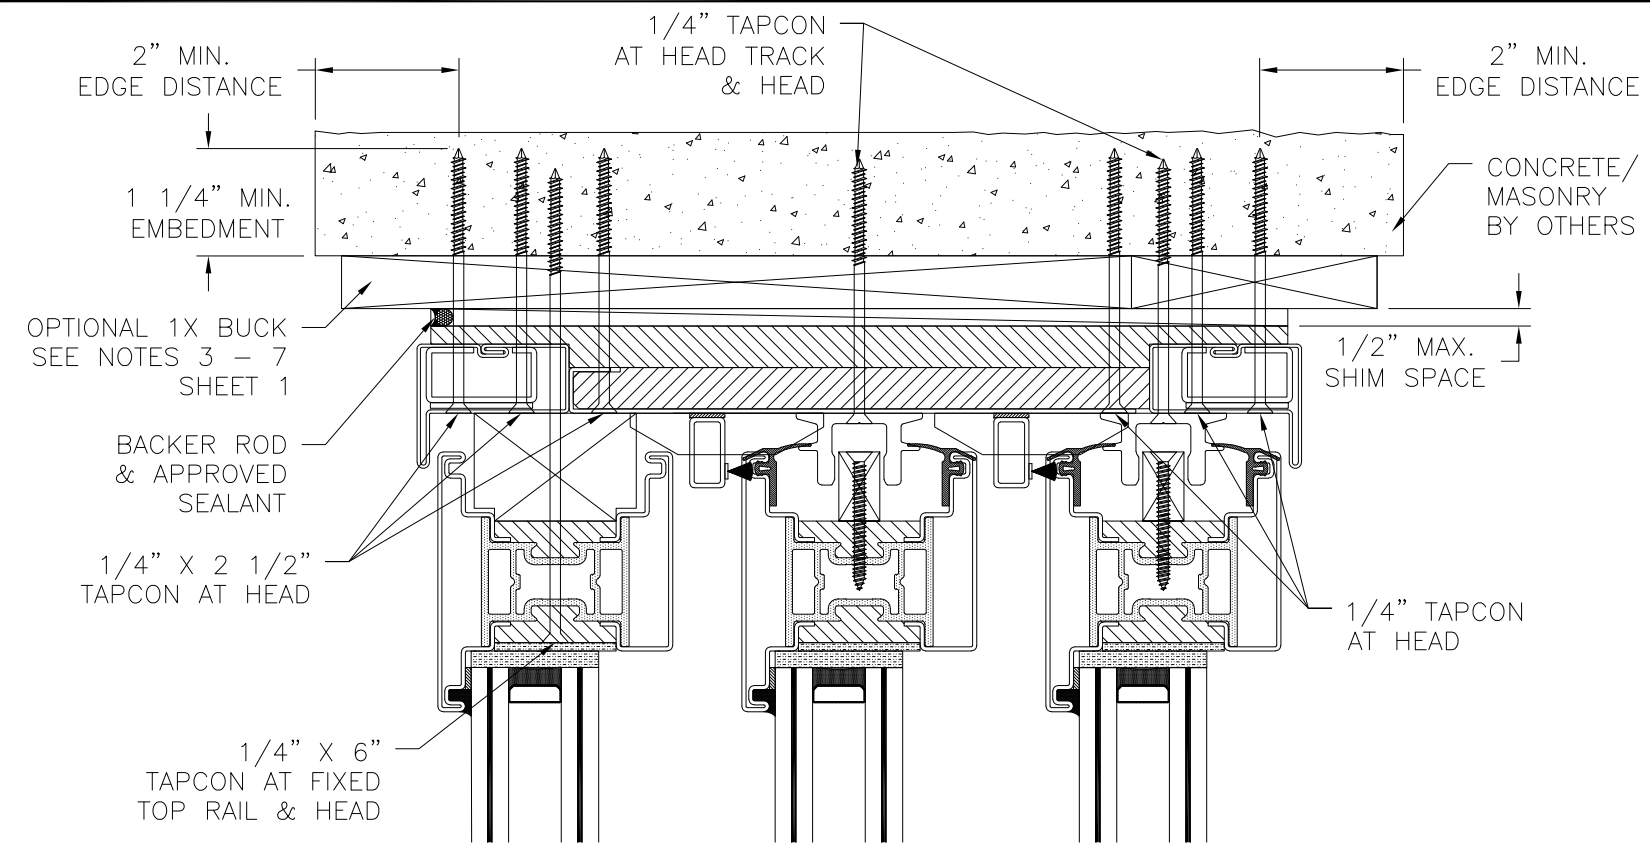

EXTERIOR


INTERIOR

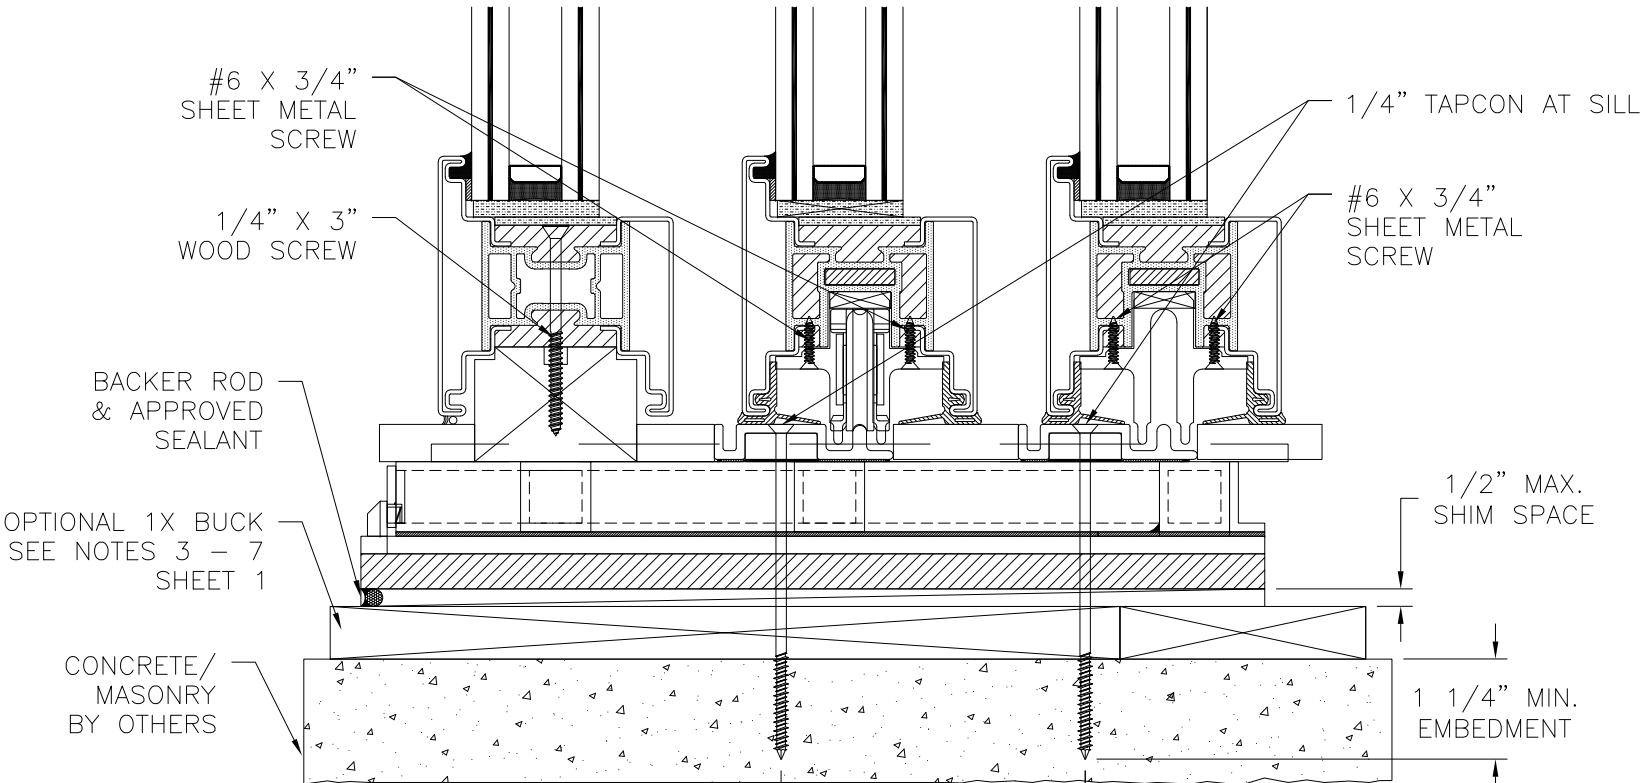

VERTICAL CROSS SECTION
CONCRETE/MASONRY INSTALLATION

- NOTES:**
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

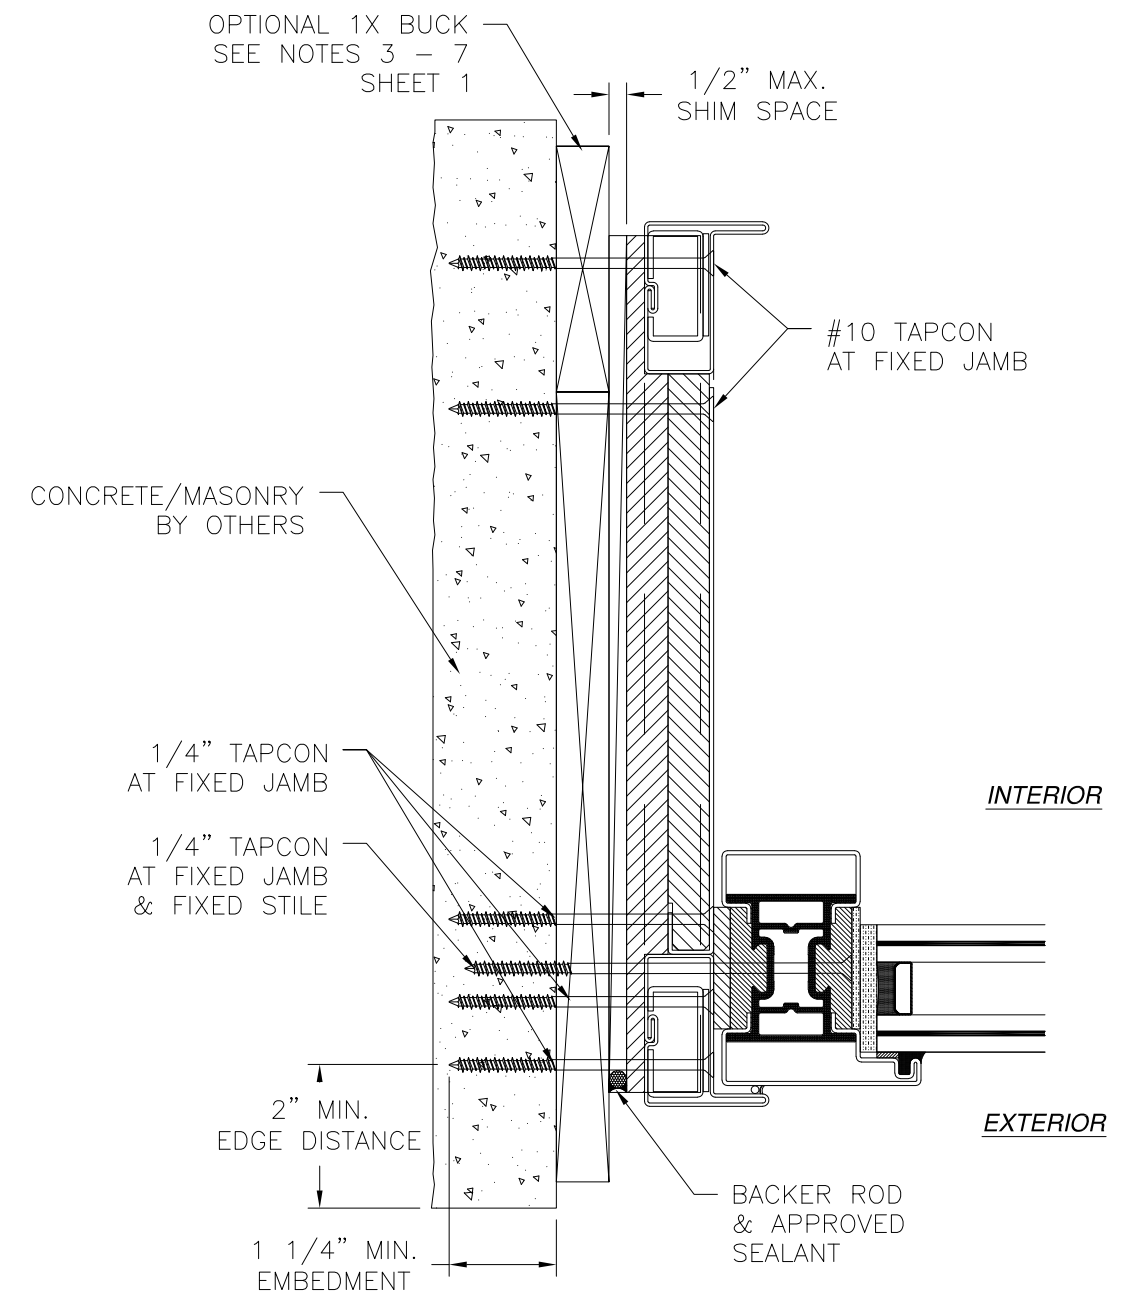


INTERIOR

EXTERIOR

JAMB INSTALLATION DETAIL
CONCRETE/MASONRY INSTALLATION


SIGNED: 09/17/2018

REILLY WINDOWS & DOORS 901 BURMAN BLVD., BUILDING 701 CALVERTON, NEW YORK 11933		
RWD40F FLUSH SILL SLIDER IMPACT HVHZ INSTALLATION DETAILS		
DRAWN: A.R.	DWG NO. 08-03214	REV -
SCALE NTS	DATE 02/23/18	SHEET 8 OF 10
L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@lrlomaspe.com		

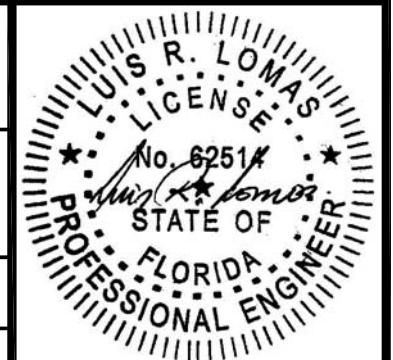


Luis R. Lomas P.E.
FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

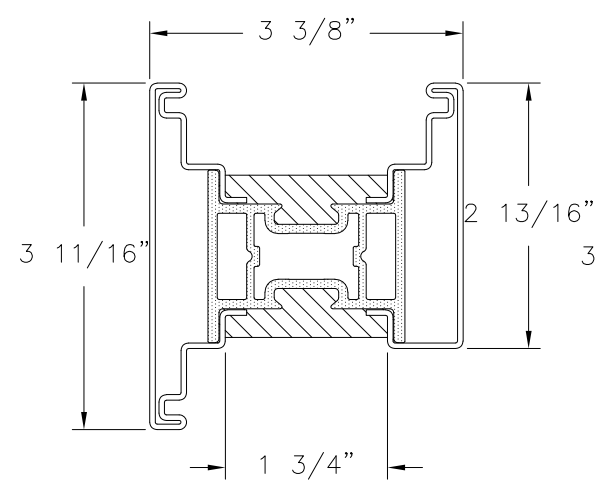


SASH RAILS
STAINLESS STEEL (P1105)

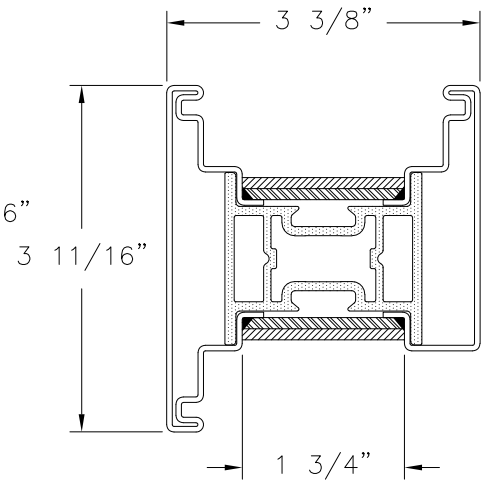


BI-PART MEETING STILE
STAINLESS STEEL (P9999E)

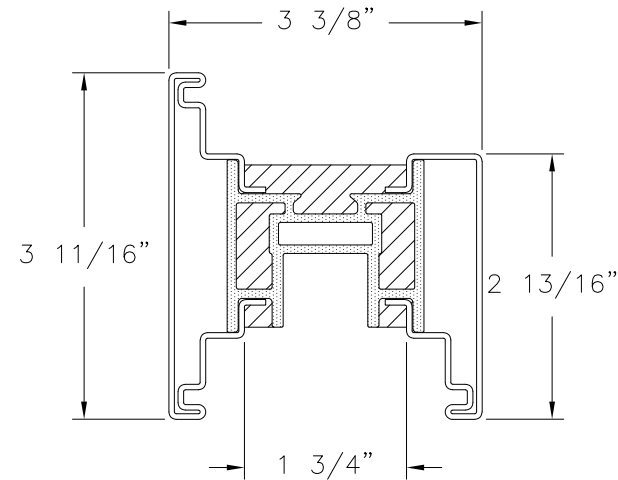


OPERABLE SASH BOTTOM RAILS
STAINLESS STEEL (P1106)

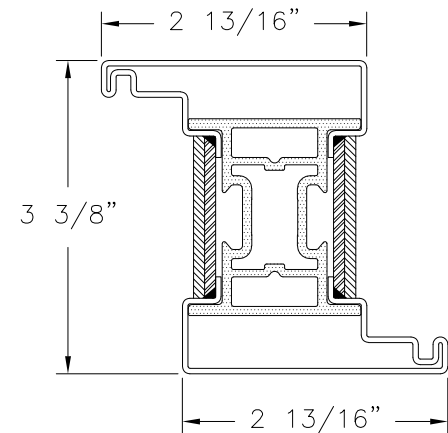


SASH STILES
STAINLESS STEEL (P9999D)

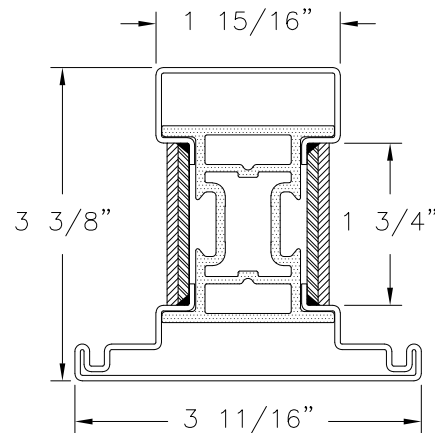


SASH STILES
STAINLESS STEEL (P9999C)

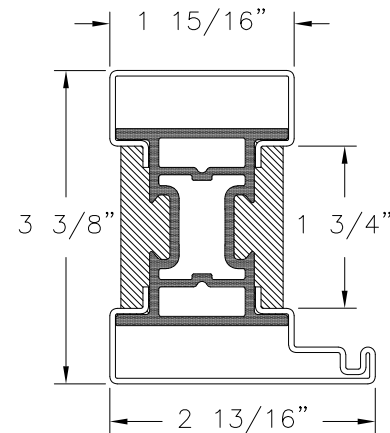

FIXED SASH STILE
STAINLESS STEEL (P1101)

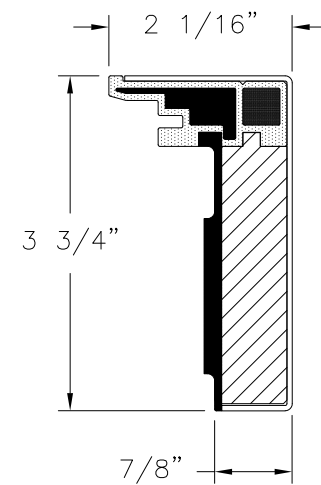

STILE CAPS
STAINLESS STEEL (P1142)

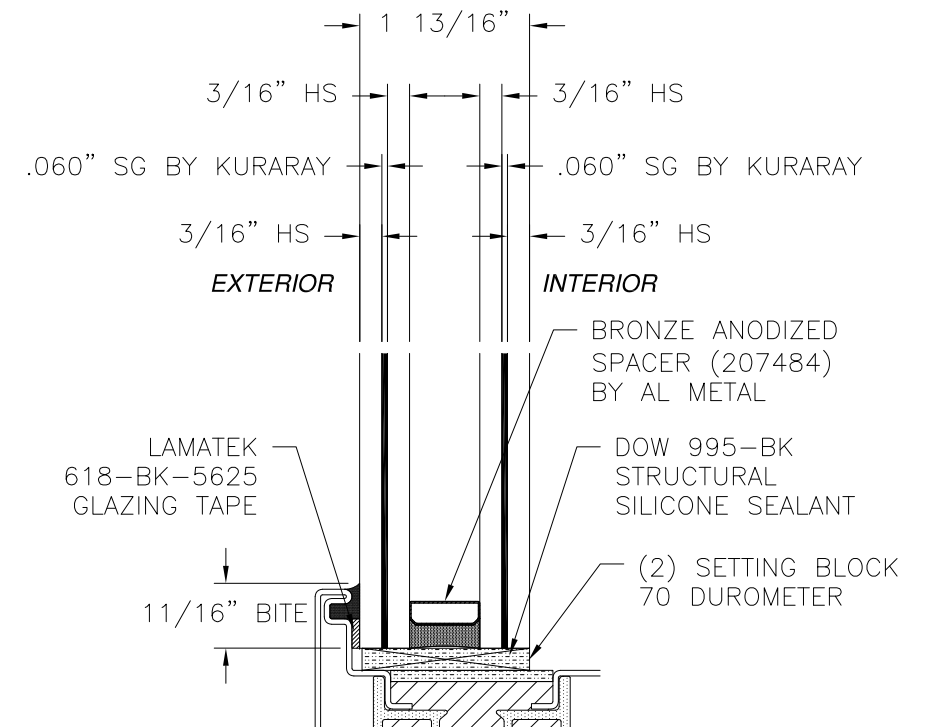


GLAZING DETAIL

SIGNED: 09/17/2018


REILLY WINDOWS & DOORS 901 BURMAN BLVD., BUILDING 701 CALVERTON, NEW YORK 11933		
RWD40F FLUSH SILL SLIDER IMPACT HVHZ COMPONENTS AND GLAZING DETAIL		
DRAWN: A.R.	DWG NO. 08-03214	REV -
SCALE NTS	DATE 02/23/18	SHEET 9 OF 10
L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@lrlomaspe.com		

Luis R. Lomas P.E.
FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

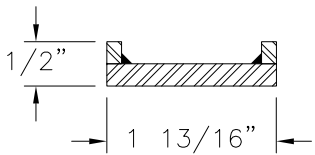


REINFORCEMENT
304 STAINLESS STEEL (RE001)

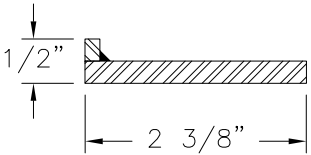


REINFORCEMENT
304 STAINLESS STEEL (RE002)

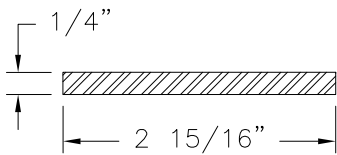


REINFORCEMENT
304 STAINLESS STEEL (RE006)




REINFORCEMENT
304 STAINLESS STEEL (RE009)




REINFORCEMENT
304 STAINLESS STEEL (RE011)

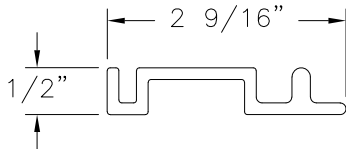


REINFORCEMENT
304 STAINLESS STEEL (BRONZE SILL TRACK)

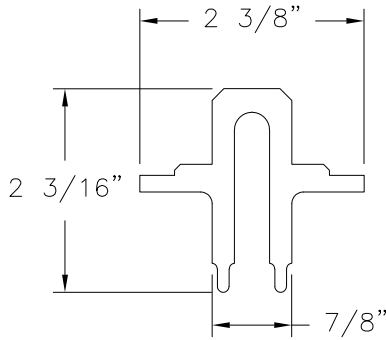


SILL GUIDE
ALUMINUM 6063-T5

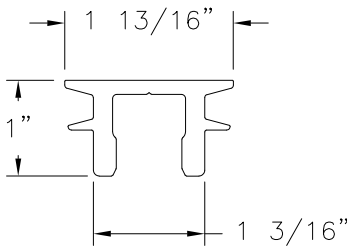


HEAD TRACK
ALUMINUM 6063-T5

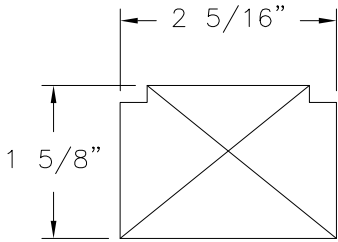


BLOCKING FOR FIXED SASH
BL1.5/BL1.6




GUIDE
RL.9




INTERLOCK BLOCK
DERLIN (BL1.5)

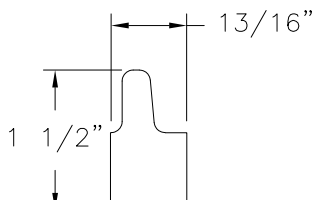


INTERLOCK BLOCK
DERLIN (BL.9A)




TUBE
304 STAINLESS STEEL




GEAR
304 STAINLESS STEEL
(LAD255SH30/50)

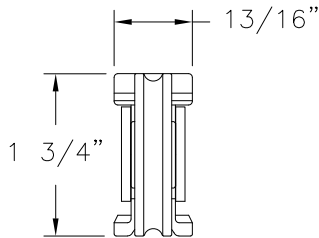


CARRIAGE ROLLER KIT
304 STAINLESS STEEL
(LAR3000012/A18)




LOCK BOLT TYPE N COAXIAL
LLB.631.12

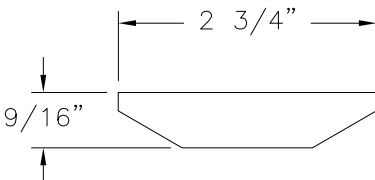


BRIDGE SEAL
847329




SEAL AT HEAD
GE 11055




**BULB SEAL
AT INTERLOCK**
GE 1142




**BRUSH SEAL
AT INTERLOCK**
#34P

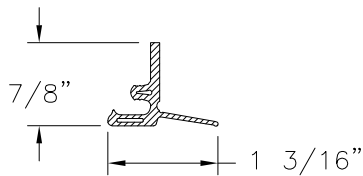

**SEAL AT SILL AND BI-PARTING
MEETING STILE**
GE11065

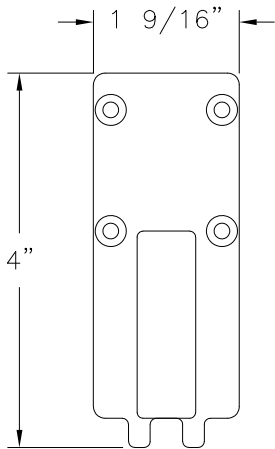


IMPACT GUIDE PLATE
17-4 PH STAINLESS STEEL (BI-PART PLATE)

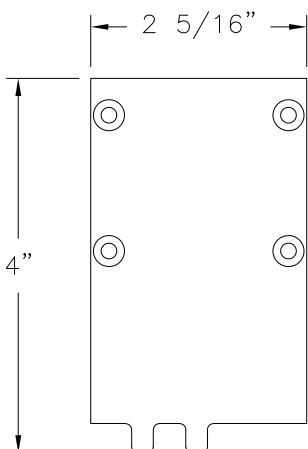

IMPACT GUIDE PLATE
17-4 PH STAINLESS STEEL (SLIDER PLATE)

REILLY WINDOWS & DOORS 901 BURMAN BLVD., BUILDING 701 CALVERTON, NEW YORK 11933		
RWD40F FLUSH SILL SLIDER IMPACT HVHZ COMPONENTS		
DRAWN: A.R.	DWG NO. 08-03214	REV -
SCALE NTS	DATE 02/23/18	SHEET 10 OF 10
L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@lrlomaspe.com		

SIGNED: 09/17/2018

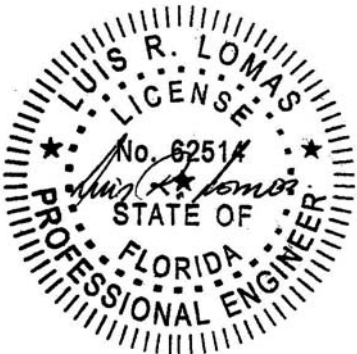

Luis R. Lomas P.E.
FL No.: 62514