

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
G	REVISED MANUFACTURER ADDRESS	07/10/2026	R.L.

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING, METAL STRUCTURE AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
4. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
5. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
6. BUCKS SHALL EXTEND BEYOND UNIT FRAME INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
7. SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
8. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
9. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
10. FRAME MATERIAL: COMPOSITE.
11. UNITS MUST BE GLAZED PER ASTM E1300, WITH SAFETY GLAZING.
12. APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.

13. FOR ANCHORING THROUGH FRAME INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
14. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 3/16" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 3/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 1 1/8" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
15. FOR ANCHORING THROUGH FRAME INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. ALL FASTENERS TO BE CORROSION RESISTANT.
17. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:W
 - 17.1. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42
 - 17.2. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.
 - 17.3. MASONRY: GROUT/FILLED BLOCK PER ASTM C90 WITH Fm=2,000PSI MINIMUM. GROUT FILLED.
 - 17.4. METAL STRUCTURE: STEEL 18GA (.048") FY=33KSI/FU=52KSI OR ALUMINUM 6063-T5 FU=30KSI 1/8" THICK MINIMUM

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2	ELEVATION
3 – 8	INSTALLATION DETAILS
9 – 10	COMPONENTS
11	APPROVED PANEL CONFIGURATIONS
12	APPROVED SLAB CONFIGURATIONS

NAN YA PLASTICS CORPORATION U.S.A.

4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES ENTRY DOOR INSWING FIBERGLASS
SIDE HINGED DOOR, NON-IMPACT
NOTES

DRAWN:
A.R.

DWG NO.
08-03306

REV
G


SCALE NTS

DATE 08/30/18


SHEET 1 OF 12

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@rlomaspe.com

SIGNED: 07/10/2026

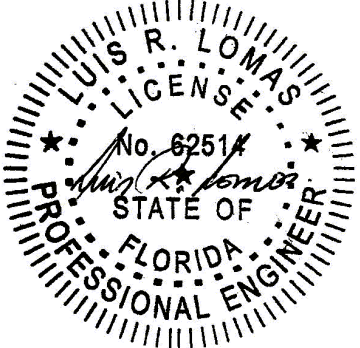

Luis R. Lomas P.E.
FL No.: 62514

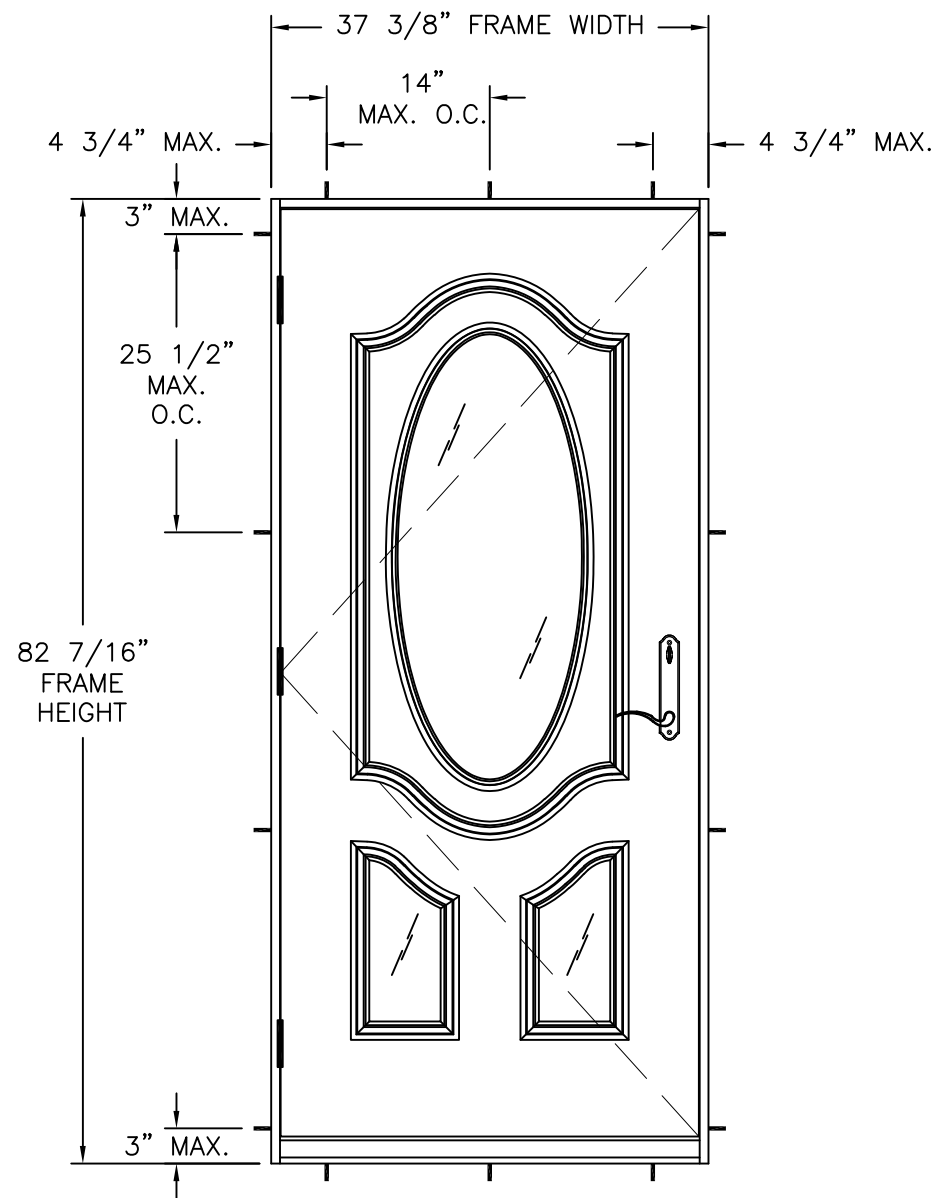

SERIES "PATIO DOOR INSWING" SIDE HINGED DOOR
EXTERIOR VIEW

- NOTES:
- 1. PANEL SIZE: 35 3/4" X 79 1/4"
 - 2. D.L.O.: 15 3/4" X 38"

APPROVED HARDWARE		
MANUFACTURER	MODEL	
Kwikset	Knob:	Signature Series
	Deadbolt:	Signature Series (980)
Schlage	Knob:	F Series
	Deadbolt:	B Series
Endura	Multi-Point	3000

Design Pressure Rating	Impact Rating
+40.0/-50.0PSF	NONE

WHERE WATER PENETRATION RESISTANCE IS REQUIRED

Design Pressure Rating	Impact Rating
±50.0PSF	NONE

WHERE WATER PENETRATION RESISTANCE IS NOT REQUIRED

35 3/4" X 79 1/4" PANEL SHOWN. OTHER SIZES APPROVED AS LONG
AS PANEL AREA DOES NOT EXCEED 19.67 FT²

Hardware Schedule	
A.	Handle Sets (Die Cast) at Panel
B.	Steel Deadbolt with Keeper at Active Panel Stile
C.	Steel Latch with Keeper at Active Panel Stile
D.	(3) 4 X 4 Door Hinge at Active Panel Hinge Stile

Revisions			
Rev	Description	Date	Approved
G	Revised Manufacturer Address	07/10/2026	R.L.

NAN YA PLASTICS CORPORATION U.S.A.
4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES ENTRY DOOR INSWING FIBERGLASS
SIDE HINGED DOOR, NON-IMPACT
ELEVATION

Drawn:
A.R.

DWG NO.
08-03306

REV
G


Scale
NTS

Date
08/30/18




Sheet
2 OF 12

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 07/10/2026

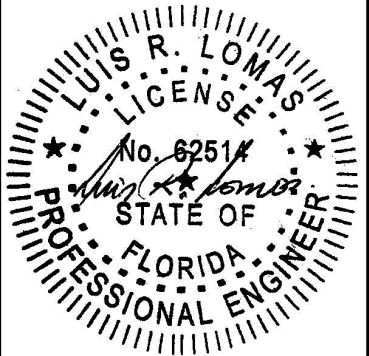

Luis R. Lomas P.E.
FL No.: 62514

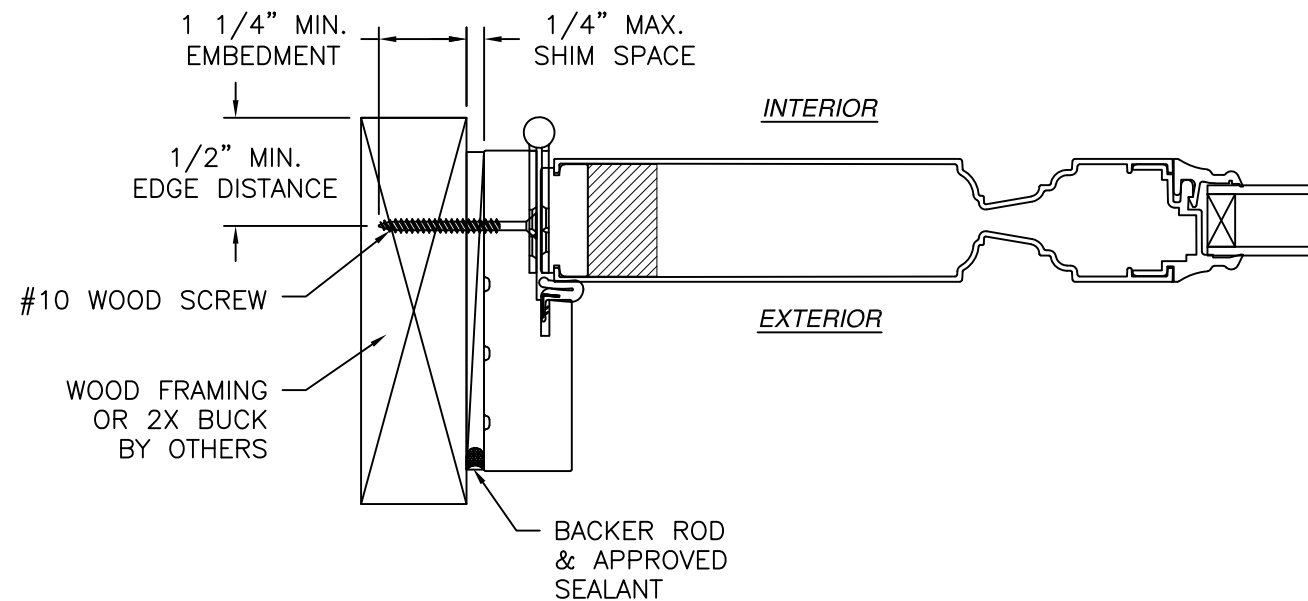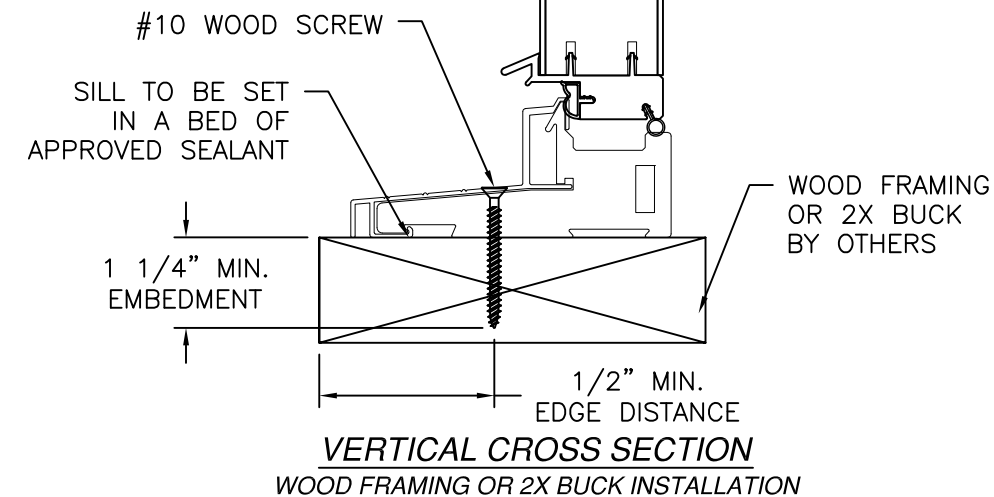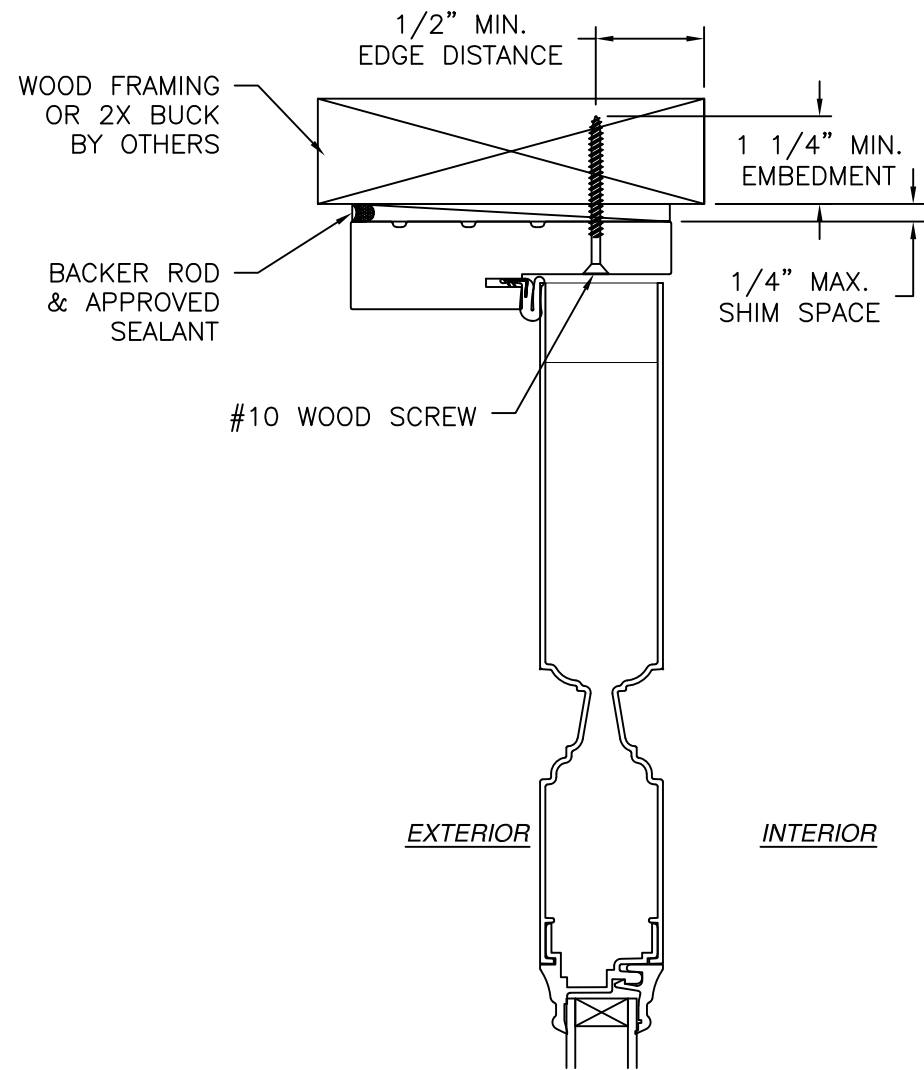

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
G	REVISED MANUFACTURER ADDRESS	07/10/2026	R.L.


NAN YA PLASTICS CORPORATION U.S.A.
4016 SHADRACK ST.
HOUSTON, TX 77013

**SERIES ENTRY DOOR INSWING FIBERGLASS
SIDE HINGED DOOR, NON-IMPACT
INSTALLATION DETAILS**

DRAWN: A.R.	DWG NO. 08-03306	REV G
SCALE NTS	DATE 08/30/18	SHEET 3 OF 12



L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 07/10/2026

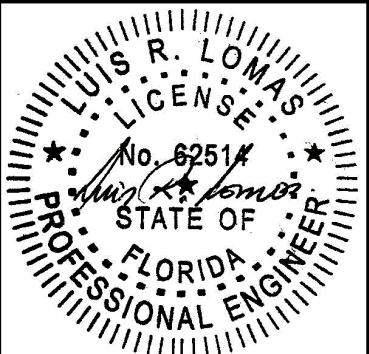

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
G	REVISED MANUFACTURER ADDRESS	07/10/2026	R.L.

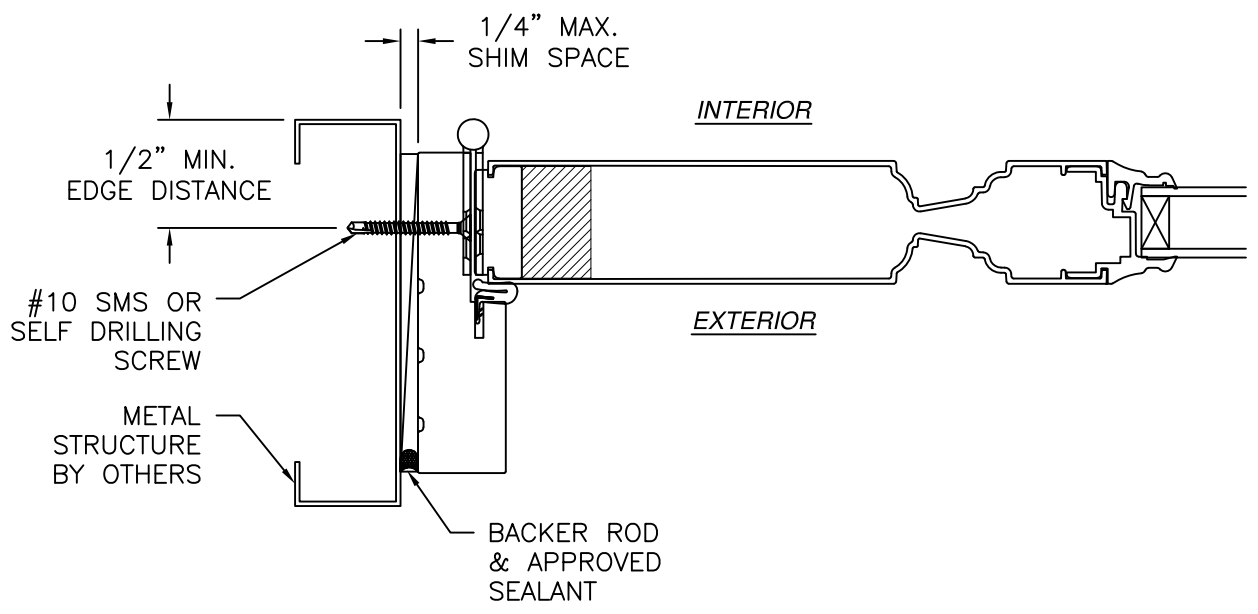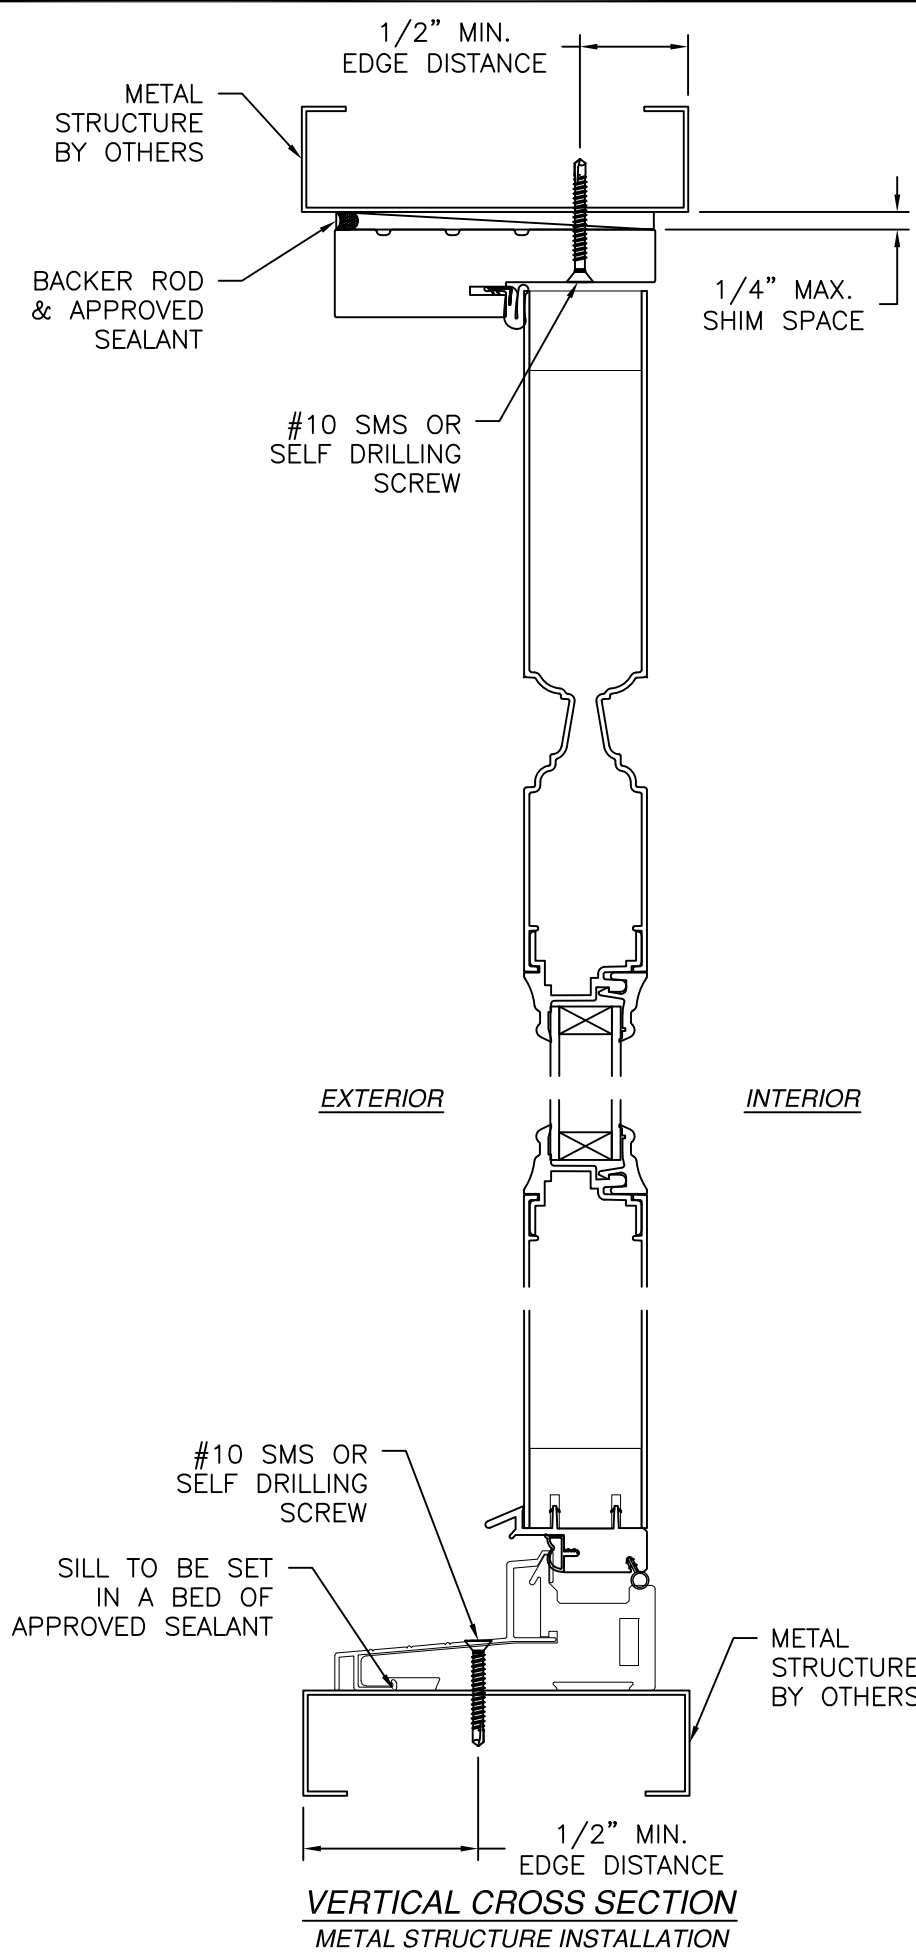


- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 07/10/2026

NAN YA PLASTICS CORPORATION U.S.A.		
4016 SHADRACK ST. HOUSTON, TX 77013		
SERIES ENTRY DOOR INSWING FIBERGLASS SIDE HINGED DOOR, NON-IMPACT INSTALLATION DETAILS		
DRAWN: A.R.	DWG NO. 08-03306	REV G
SCALE NTS	DATE 08/30/18	SHEET 4 OF 12
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		


Professional Engineer Seal for Luis R. Lomas, State of Florida, License No. 62514.

Luis R. Lomas P.E.
FL No.: 62514

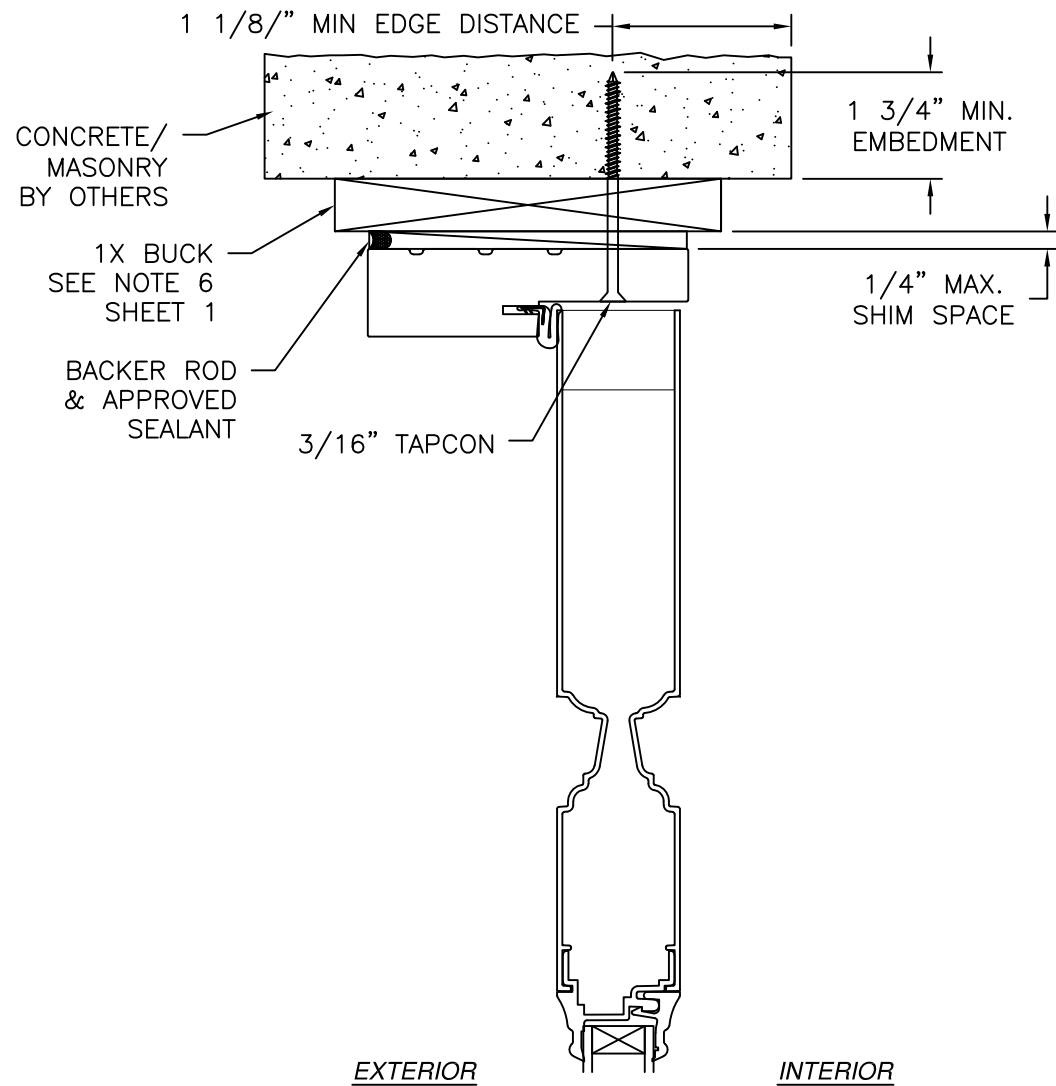

VERTICAL CROSS SECTION

CONCRETE/MASONRY WITH 1X BUCK INSTALLATION
FOR CONCRETE/MASONRY WITHOUT 1X BUCK REFER TO
JAMB INSTALLATION DETAIL

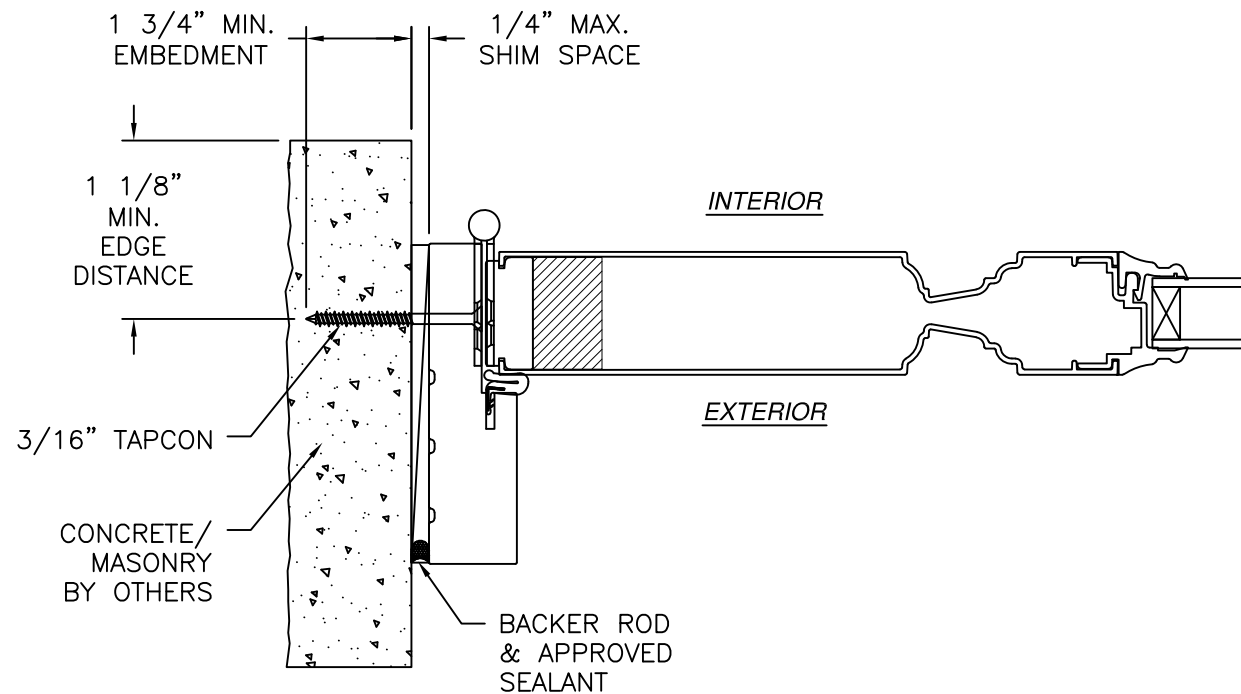

JAMB INSTALLATION DETAIL
CONCRETE/MASONRY WITHOUT 1X BUCK INSTALLATION
FOR CONCRETE/MASONRY INSTALLATION WITH 1X BUCK REFER TO
HEAD AND SILL INSTALLATION DETAILS

NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
G	REVISED MANUFACTURER ADDRESS	07/10/2026	R.L.

NAN YA PLASTICS CORPORATION U.S.A.


4016 SHADRACK ST.
HOUSTON, TX 77013

**SERIES ENTRY DOOR INSWING FIBERGLASS
SIDE HINGED DOOR, NON-IMPACT
INSTALLATION DETAILS**

DRAWN: A.R.	DWG NO. 08-03306	REV G
SCALE NTS	DATE 08/30/18	SHEET 5 OF 12

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@rlomaspe.com

SIGNED: 07/10/2026

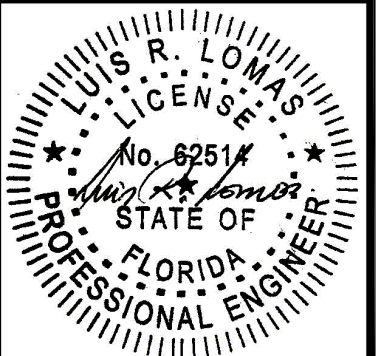


Luis R. Lomas P.E.
FL No.: 62514


SILLS ANCHORS LOCATIONS

FOR ANCHOR TYPE, EMBEDMENT, EDGE DISTANCE AND SUBSTRATE REFER TO SHEETS 3 - 5
SILLS TO BE SET IN A BED OF APPROVED SEALANT


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
G	REVISED MANUFACTURER ADDRESS	07/10/2026	R.L.

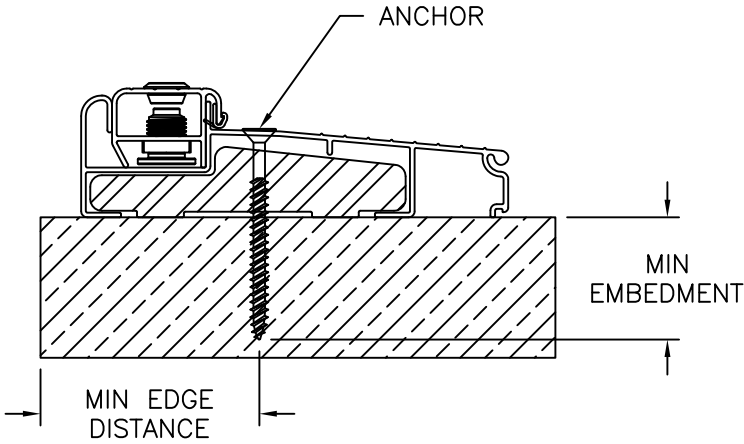


ENDURA THRESHOLD ZILAA4565

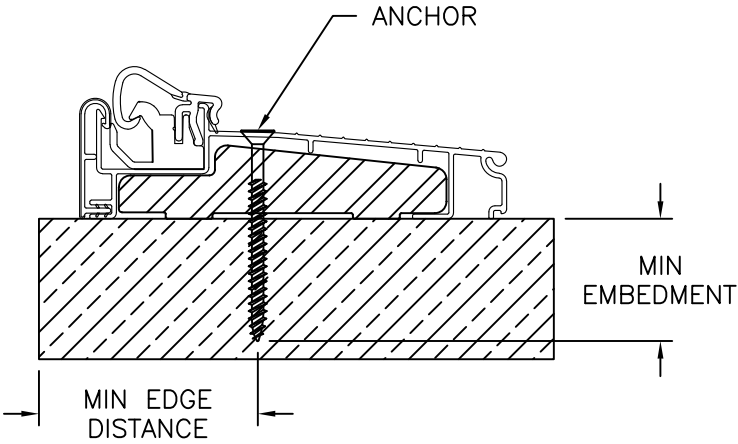


ENDURA THRESHOLD ZA4565

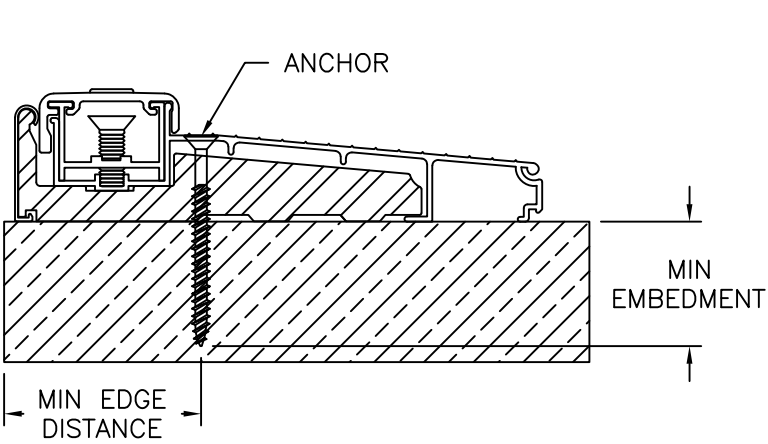


COLUMBIA THRESHOLD ESCON-34

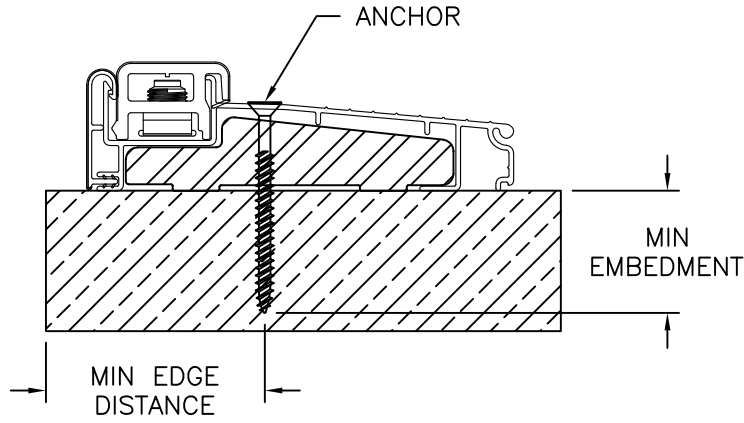


ENDURA THRESHOLD ZIL4565

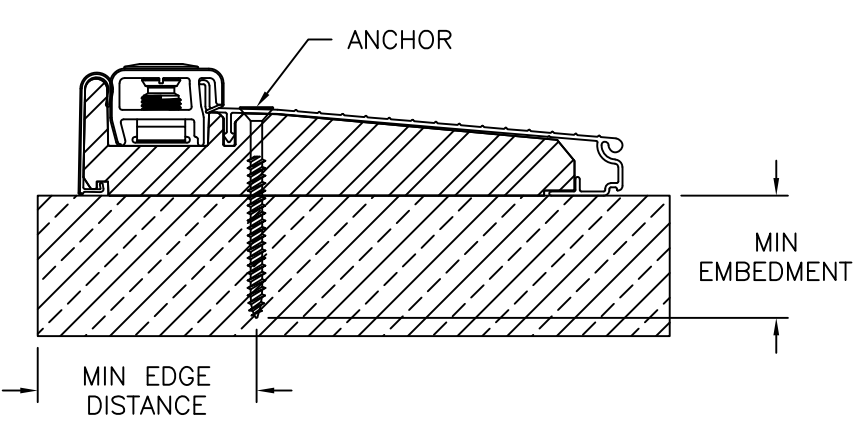


ENDURA THRESHOLD ZAI5815FN

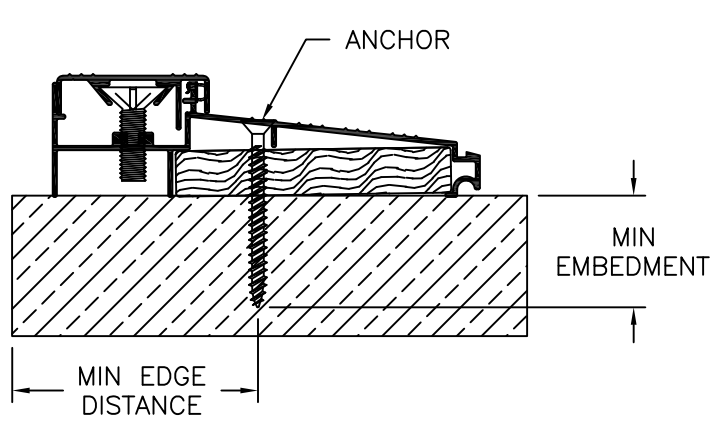

DLP THRESHOLD ISCS

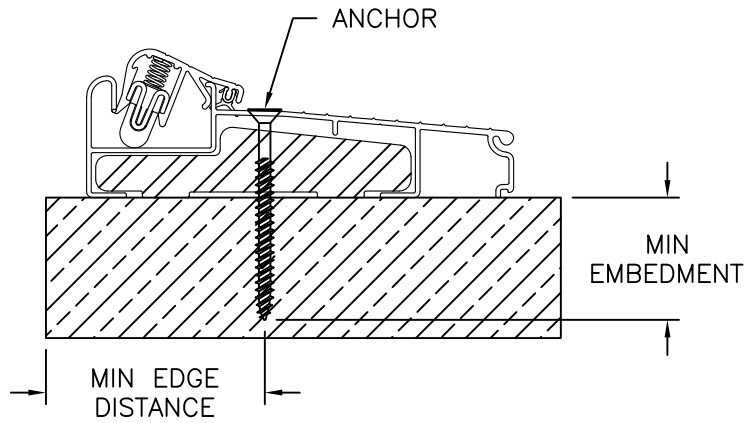

ENDURA THRESHOLD ZA4565

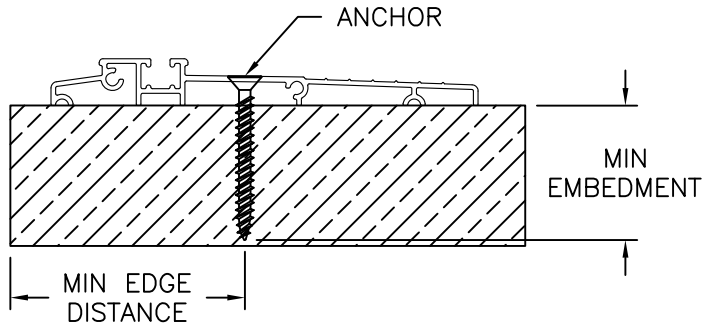

ENDURA ADA THRESHOLD ZH4565
TO BE USED ONLY WHERE WATER PENETRATION
RESISTANCE IS NOT REQUIRED


NAN YA PLASTICS CORPORATION U.S.A.
4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES ENTRY DOOR INSWING FIBERGLASS
SIDE HINGED DOOR, NON-IMPACT
INSTALLATION DETAILS

DRAWN: A.R.	DWG NO. 08-03306	REV G
SCALE NTS	DATE 08/30/18	SHEET 6 OF 12

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@rlomaspe.com

SIGNED: 07/10/2026

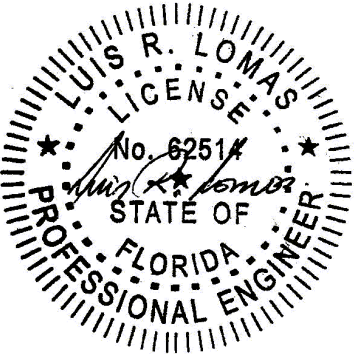


Luis R. Lomas P.E.
FL No.: 62514


ALTERNATE SILLS ANCHORS LOCATIONS

FOR ANCHOR TYPE, EMBEDMENT, EDGE DISTANCE AND SUBSTRATE REFER TO SHEETS 3 - 5
SILLS TO BE SET IN A BED OF APPROVED SEALANT


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
G	REVISED MANUFACTURER ADDRESS	07/10/2026	R.L.

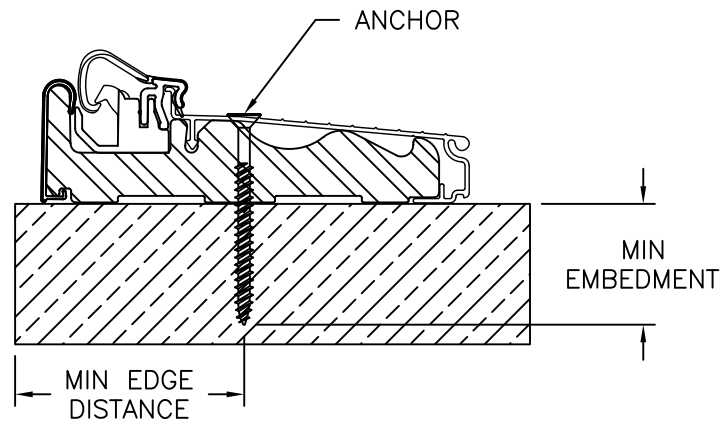


ENDURA THRESHOLD ZAC4565

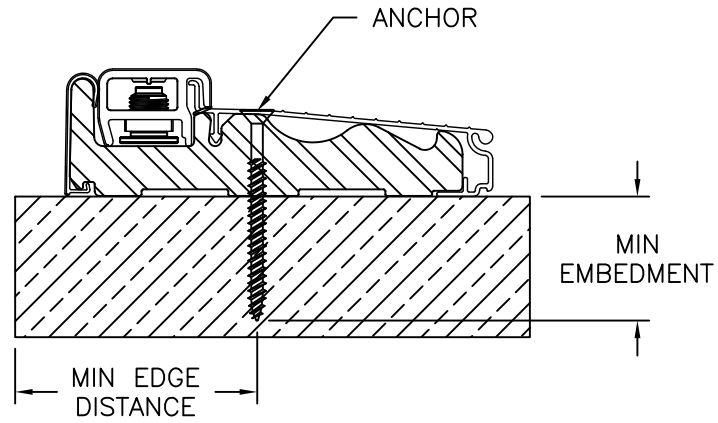


ENDURA THRESHOLD ZAILH4565

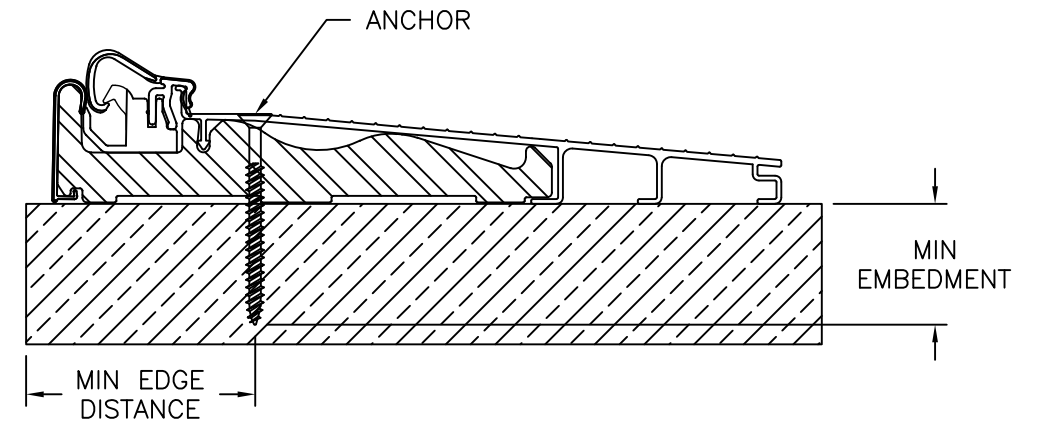


ENDURA THRESHOLD ZAC4565

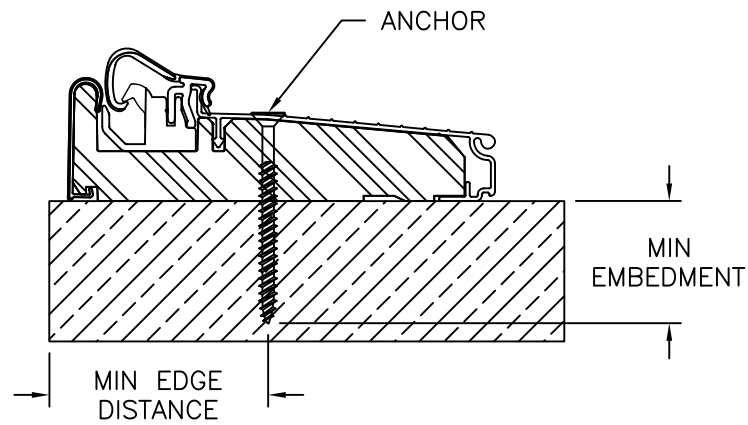


ENDURA THRESHOLD ZAC4565FN

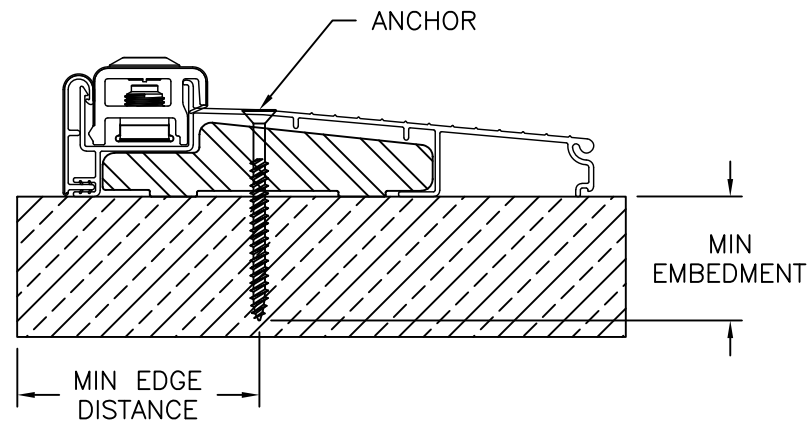

ENDURA THRESHOLD ZAIL5625

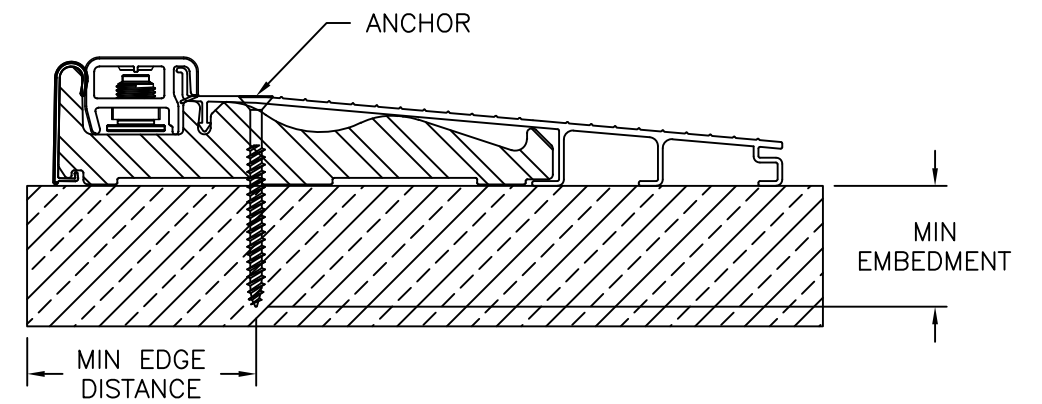

ENDURA THRESHOLD ZAILH7625

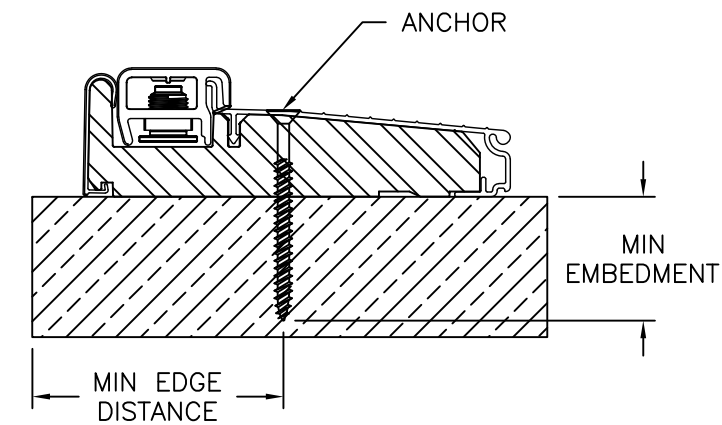

ENDURA THRESHOLD ZAI4565FN


NAN YA PLASTICS CORPORATION U.S.A.
4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES ENTRY DOOR INSWING FIBERGLASS
SIDE HINGED DOOR, NON-IMPACT
INSTALLATION DETAILS

DRAWN: A.R.	DWG NO. 08-03306	REV G
SCALE NTS	DATE 08/30/18	SHEET 7 OF 12


L. ROBERTO LOMAS P.E.
208 7th Ave, INDIAN LANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 07/10/2026

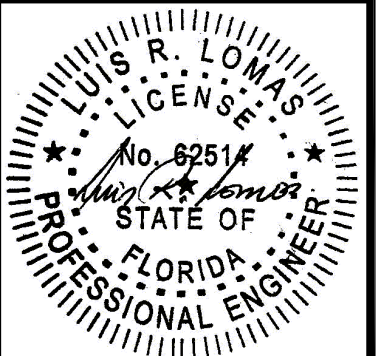


Luis R. Lomas P.E.
FL No.: 62514




REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
G	REVISED MANUFACTURER ADDRESS	07/10/2026	R.L.

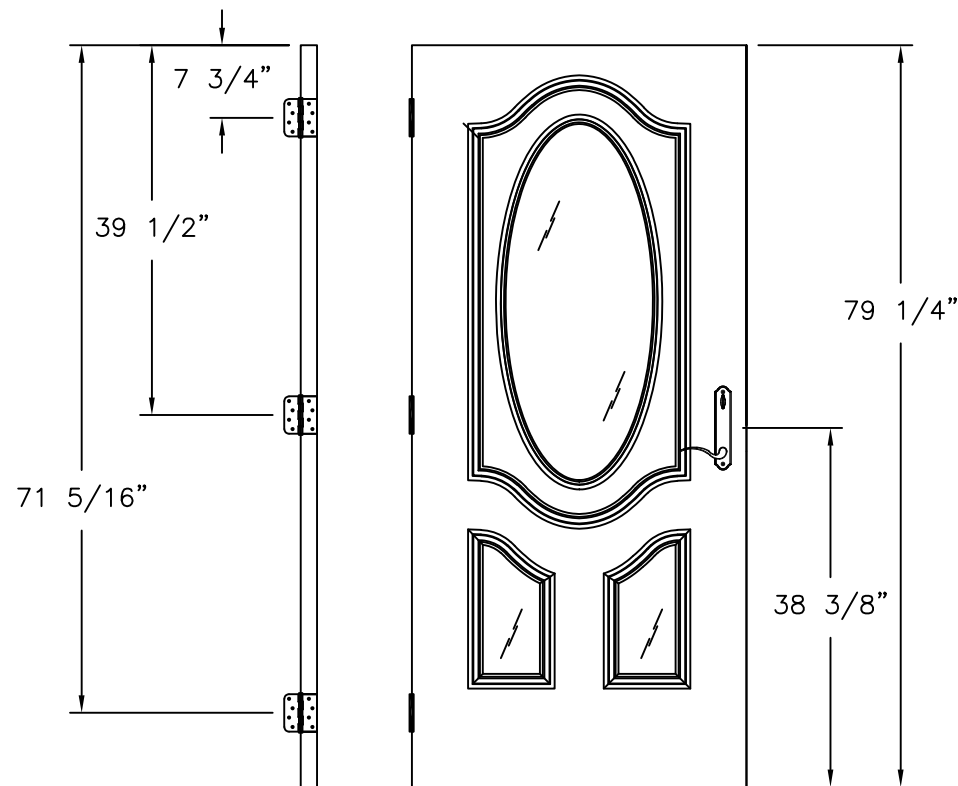


LOCK AND HINGES LOCATIONS
WITH HANDLE

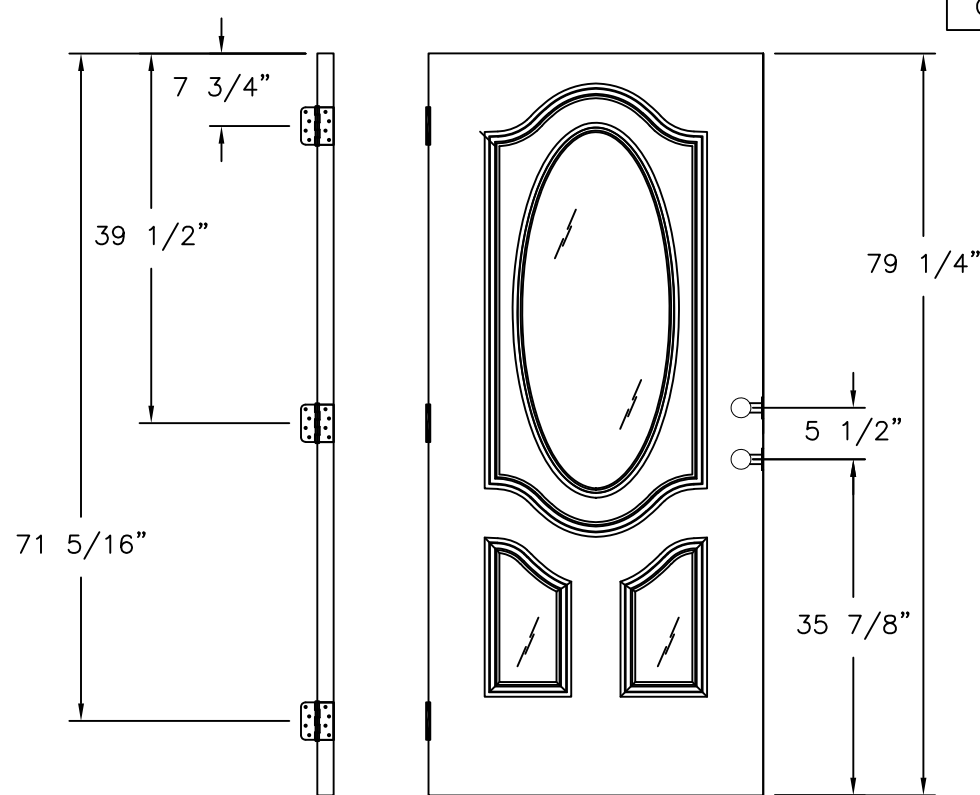

LOCK AND HINGES LOCATIONS
WITH LATCH AND DEADBOLT

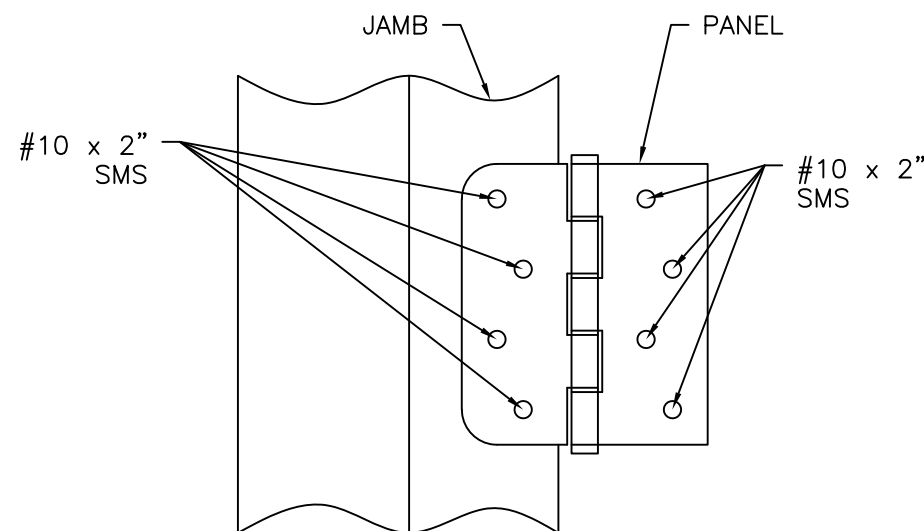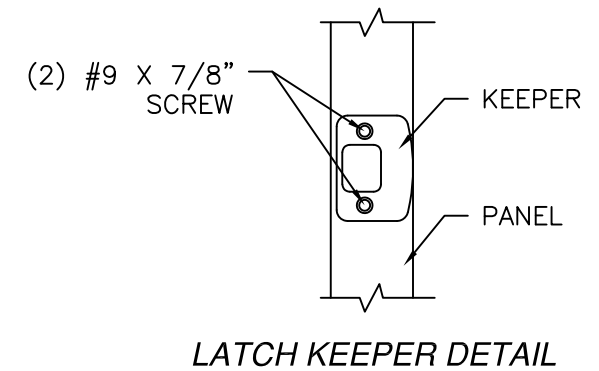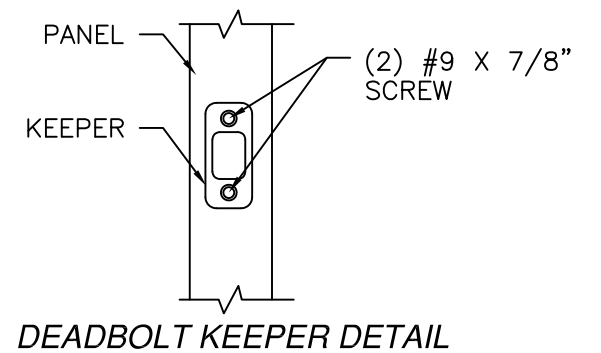

HINGE INSTALLATION DETAIL
WOOD AND METAL INSTALLATION

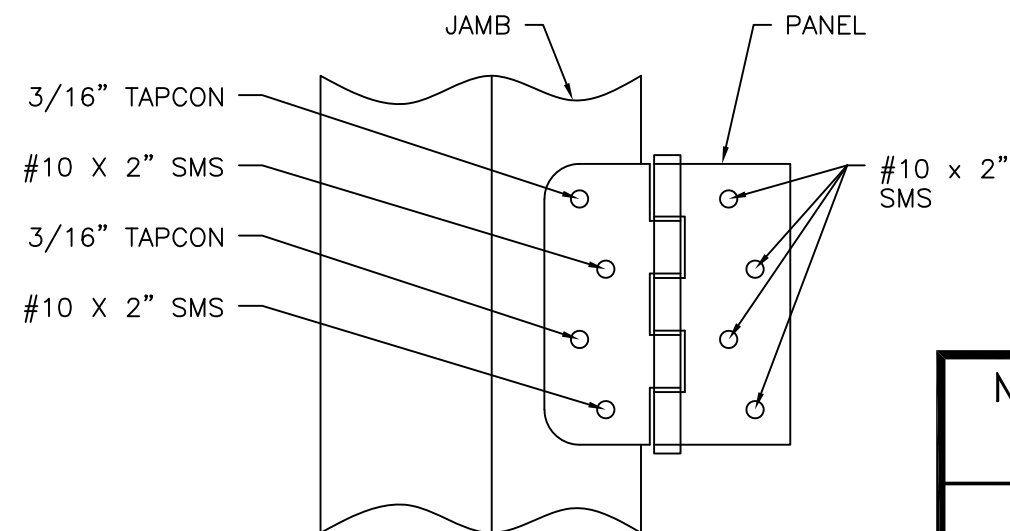

HINGE INSTALLATION DETAIL
MASONRY/CONCRETE INSTALLATION


NAN YA PLASTICS CORPORATION U.S.A.
4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES ENTRY DOOR INSWING FIBERGLASS
SIDE HINGED DOOR, NON-IMPACT
INSTALLATION DETAILS


DRAWN: A.R.	DWG NO. 08-03306	REV G
SCALE NTS	DATE 08/30/18	SHEET 8 OF 12

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@rlomaspe.com


SIGNED: 07/10/2026

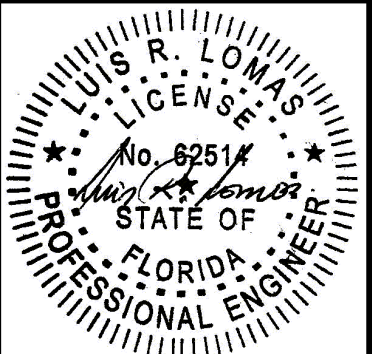


Luis R. Lomas P.E.
FL No.: 62514

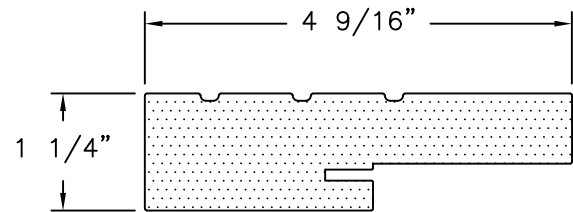


HEAD FRAME & JAMB
COMPOSITE

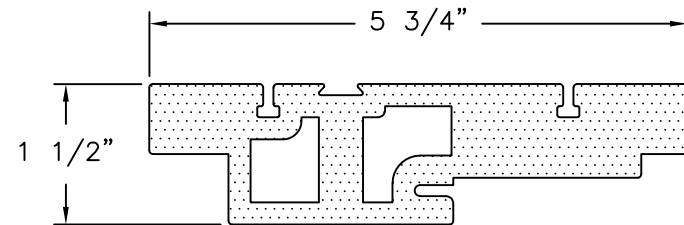


NEUMA HEAD FRAME & JAMB
COMPOSITE

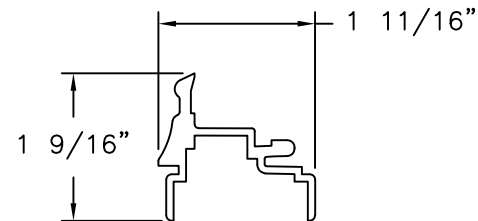


GLAZING FRAME
ABS

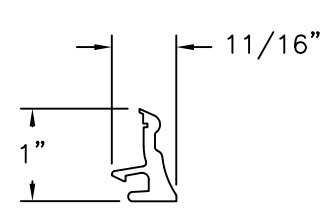


GLAZING BEAD
ABS

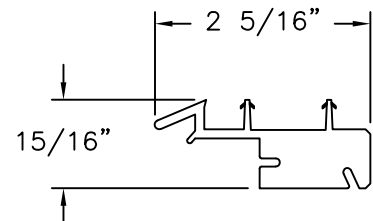

DOOR BOTTOM
RIGID PVC CO-EX

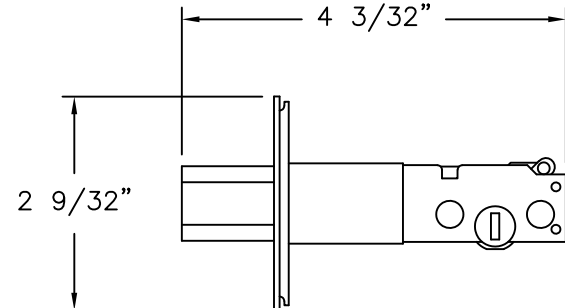


DOOR DEADBOLT
STEEL

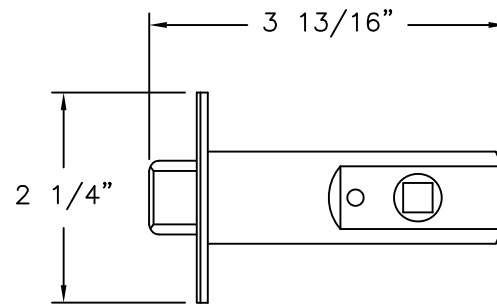


DOOR LATCH
STEEL




TRILENNIUM 3000

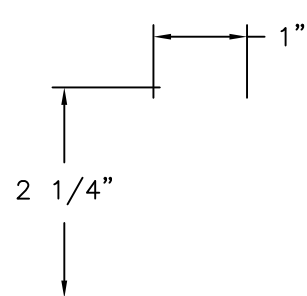


DEADBOLT KEEPER
STAINLESS STEEL

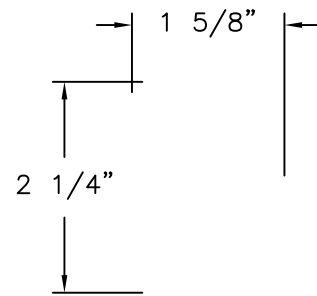

LATCH KEEPER
STAINLESS STEEL

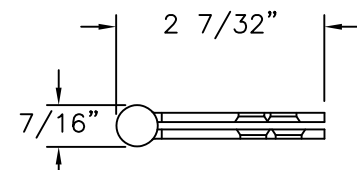

4" X 4" DOOR HINGE
STEEL

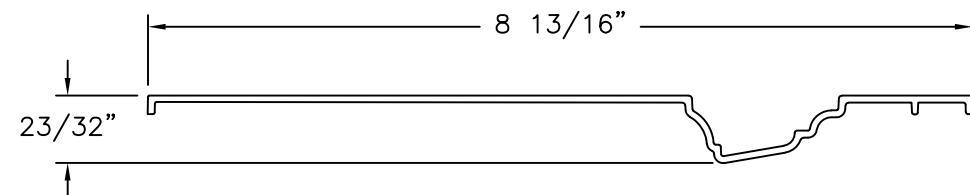

SHEET MOLDING COMPOUND SKIN
FIBERGLASS

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
G	REVISED MANUFACTURER ADDRESS	07/10/2026	R.L.

NAN YA PLASTICS CORPORATION U.S.A.

4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES ENTRY DOOR INSWING FIBERGLASS
SIDE HINGED DOOR, NON-IMPACT
COMPONENTS

DRAWN:
A.R.

DWG NO.

08-03306

REV
G

SCALE NTS

DATE


08/30/18

SHEET


9 OF 12

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@rlomaspe.com


SIGNED: 07/10/2026

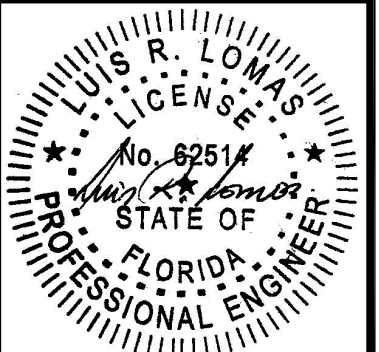


Luis R. Lomas P.E.
FL No.: 62514

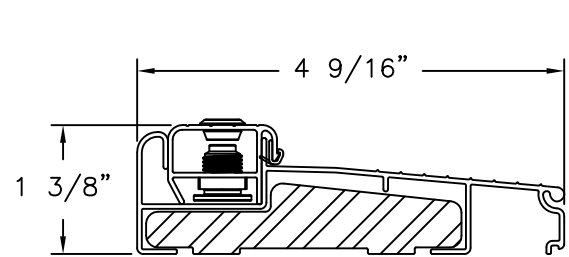


ENDURA THRESHOLD ZAILAA4565
ALTERNATE

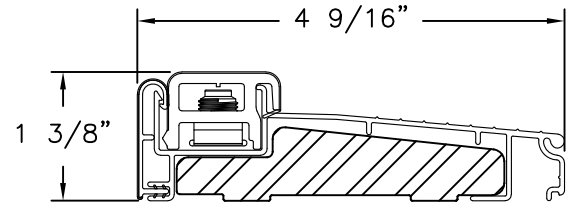


ENDURA THRESHOLD ZAIL4565
ALTERNATE

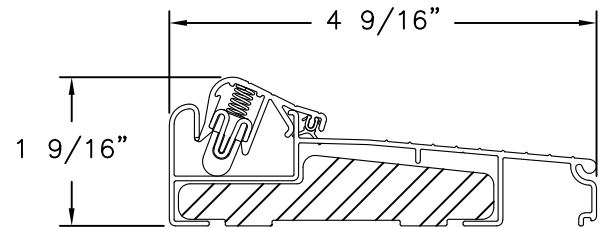


ENDURA THRESHOLD ZACLAA4565
ALTERNATE

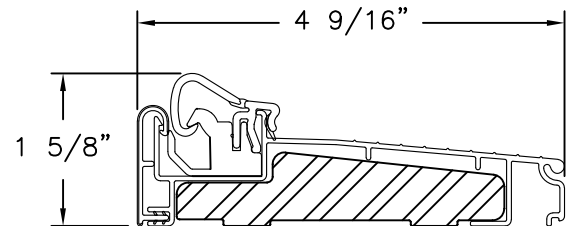


ENDURA THRESHOLD ZACL4565
ALTERNATE

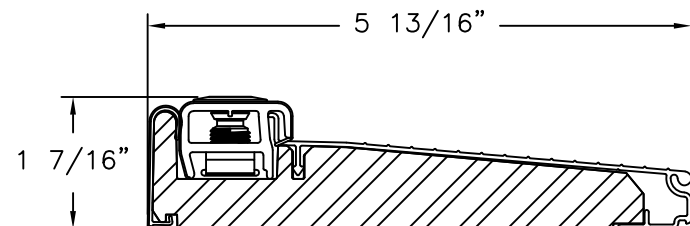


ENDURA THRESHOLD ZAI5815FN
ALTERNATE

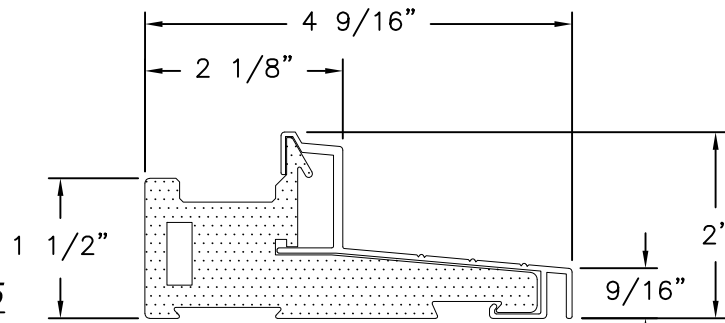


DOOR SILL
FOAM PVC CO-EX & ALUMINUM

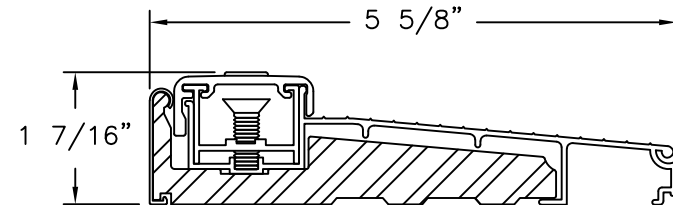


COLUMBIA THRESHOLD ESCON-34
ALTERNATE

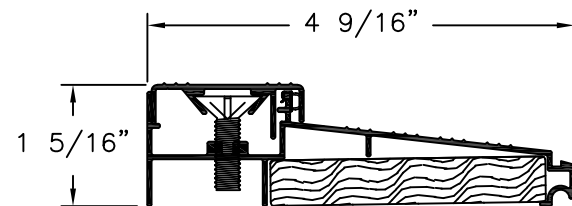


DLP THRESHOLD ISCS
ALTERNATE

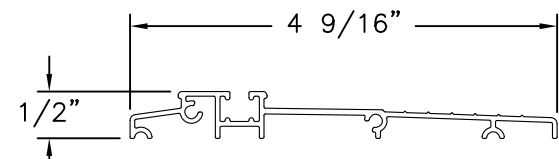


ENDURA ADA THRESHOLD ZHCI4565
ALTERNATE

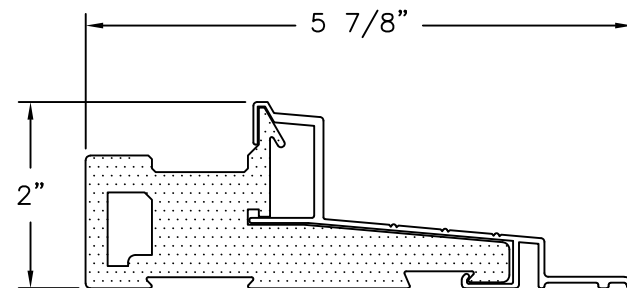


NEUMA SILL
ALTERNATE

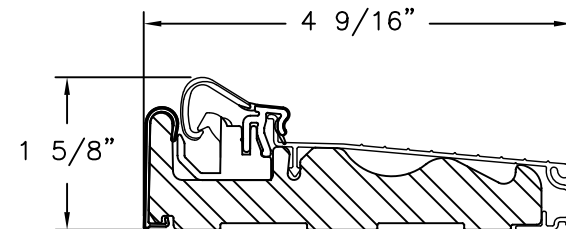


ENDURA THRESHOLD ZACLH4565

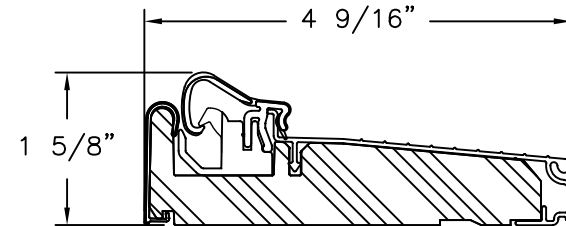

ENDURA THRESHOLD ZAC4565FN

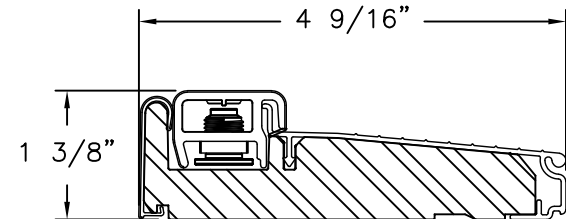


ENDURA THRESHOLD ZAI4565FN

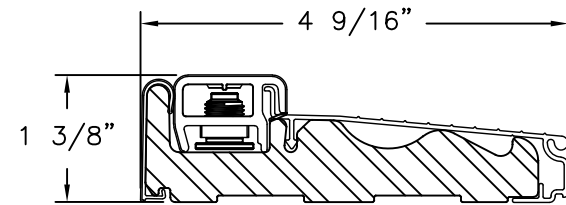


ENDURA THRESHOLD ZAILH4565


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
G	REVISED MANUFACTURER ADDRESS	07/10/2026	R.L.

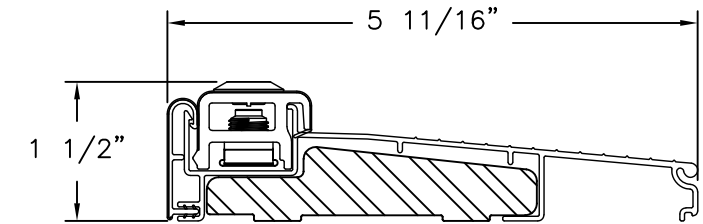

ENDURA THRESHOLD ZAIL5625

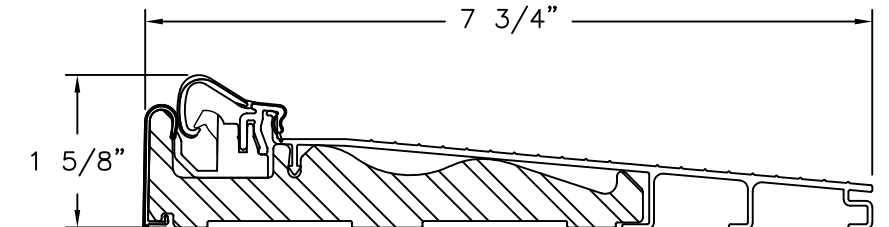

ENDURA THRESHOLD ZACLH7815

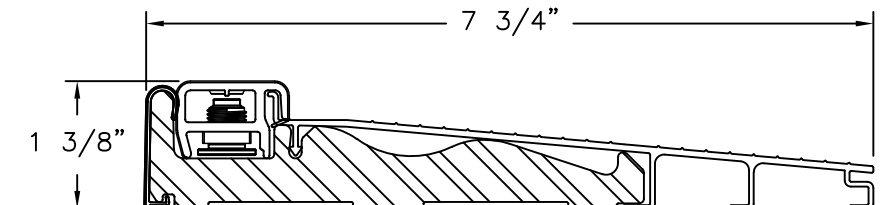

ENDURA THRESHOLD ZAILH7625


NAN YA PLASTICS CORPORATION U.S.A.
4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES ENTRY DOOR INSWING FIBERGLASS
SIDE HINGED DOOR, NON-IMPACT
COMPONENTS

DRAWN: A.R.	DWG NO. 08-03306	REV G
SCALE NTS	DATE 08/30/18	SHEET 10 OF 12

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@rlomaspe.com

SIGNED: 07/10/2026

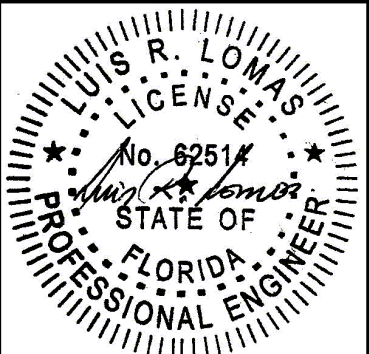


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
G	REVISED MANUFACTURER ADDRESS	07/10/2026	R.L.


APPROVED PANEL CONFIGURATIONS

DIRECT GLAZING

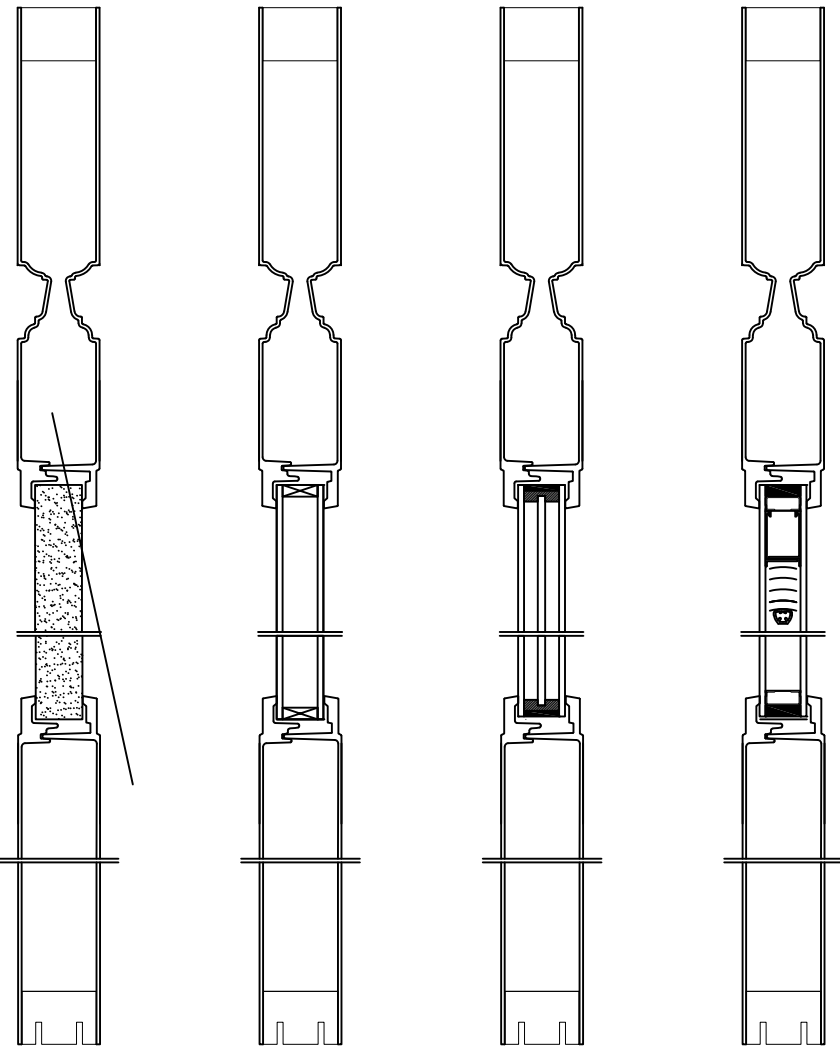

W/PVC FOAM BOARD W/STD GLASS W/MATTE GLASS W/MINI-BLIND

OPEN GLAZING BEAD

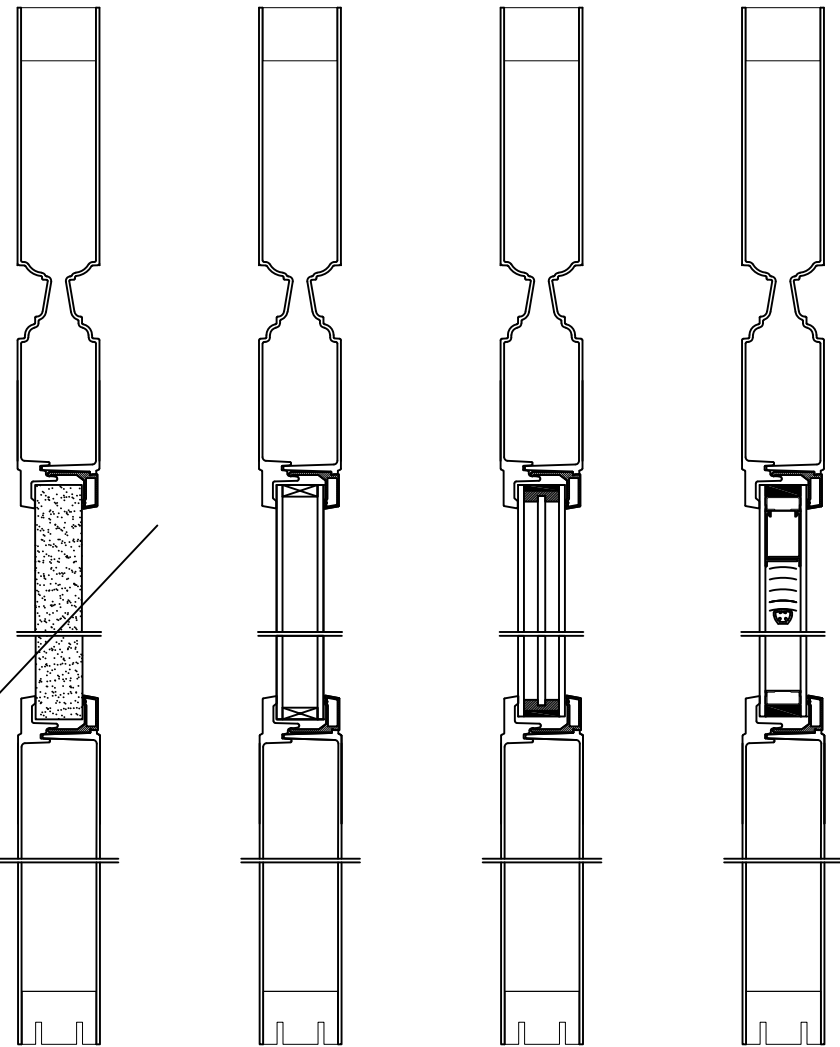


W/PVC FOAM BOARD W/STD GLASS W/MATTE GLASS W/MINI-BLIND

SIGNED: 07/10/2026

NAN YA PLASTICS CORPORATION U.S.A.
4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES ENTRY DOOR INSWING FIBERGLASS
SIDE HINGED DOOR, NON-IMPACT
APPROVED PANEL CONFIGURATIONS


DRAWN: A.R.	DWG NO. 08-03306	REV G
SCALE NTS	DATE 08/30/18	SHEET 11 OF 12
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

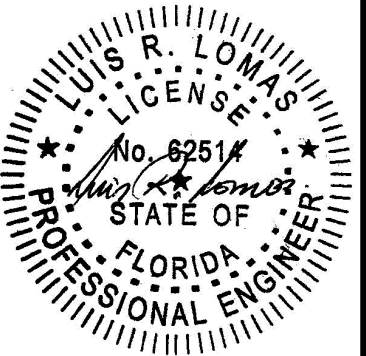

Luis R. Lomas P.E.
FL No.: 62514

APPROVED SLAB CONFIGURATIONS


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
G	REVISED MANUFACTURER ADDRESS	07/10/2026	R.L.

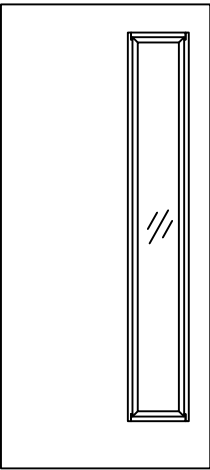


NAP
FOAM PVC




SNAP
FOAM PVC

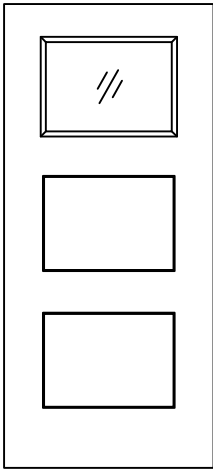


3JP
FOAM PVC

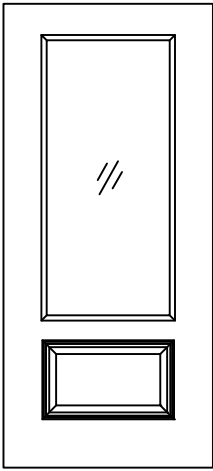


25P
FOAM PVC

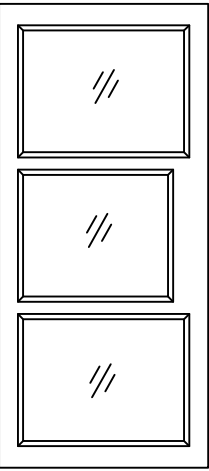


ANP
FOAM PVC

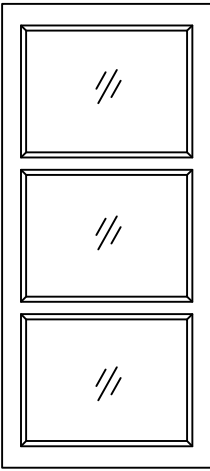


ANP
FOAM PVC

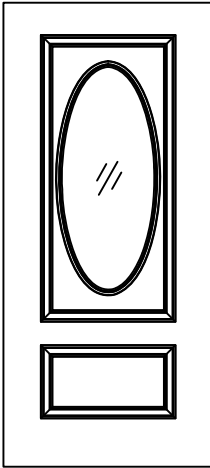


2HP
ABS

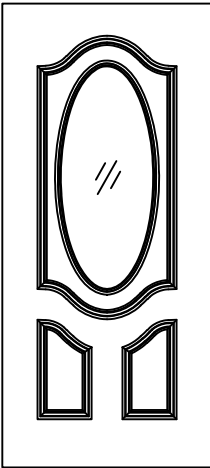


3HP
ABS

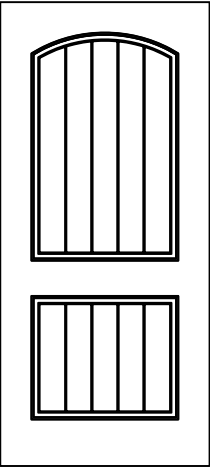


22P
SOLID

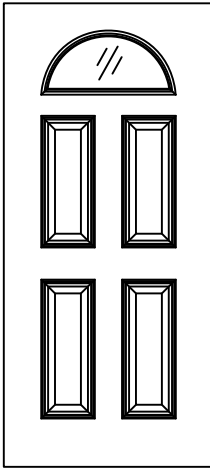


4GP
ABS

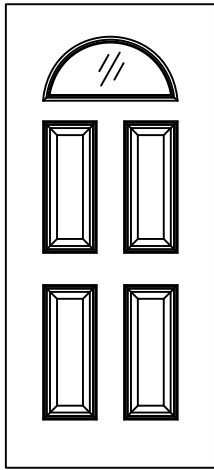


4KP
ABS

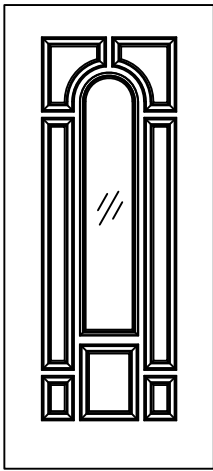


8HP
ABS

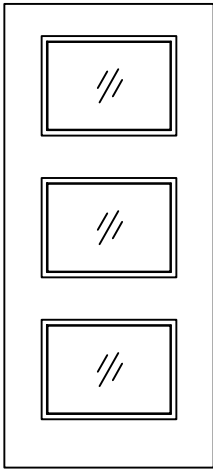


3GP
ABS

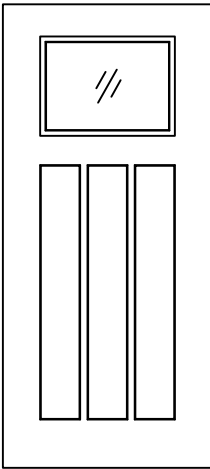


4HP
ABS

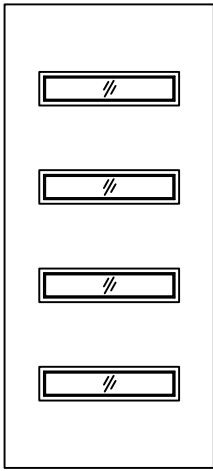


4LP
ABS

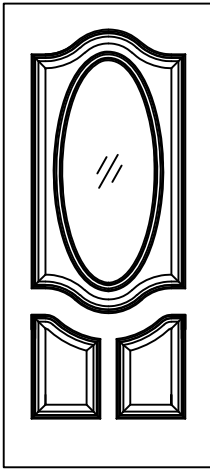


36P
ABS

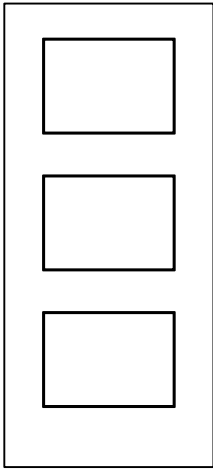


3JP
SOLID

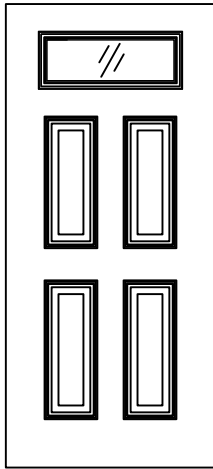


46P
ABS

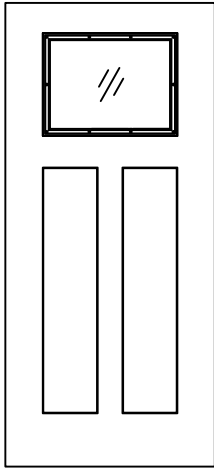


3DP
ABS

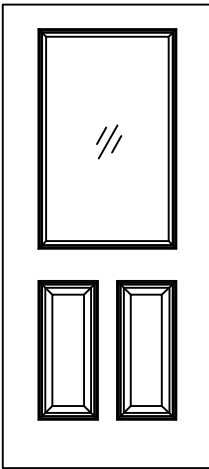

23P
ABS



71P
SOLID

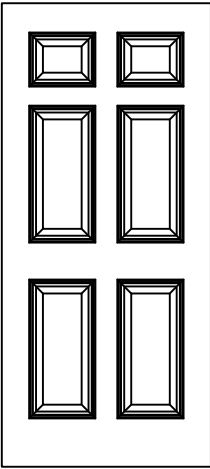

67P
SOLID

NAN YA PLASTICS CORPORATION U.S.A.

4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES ENTRY DOOR INSWING FIBERGLASS
SIDE HINGED DOOR, NON-IMPACT
APPROVED DOOR CONFIGURATIONS

DRAWN:

A.R.

DWG NO.

08-03306

REV

G

SCALE NTS

DATE


08/30/18

SHEET

12 OF 12

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@rlomaspe.com

SIGNED: 07/10/2026

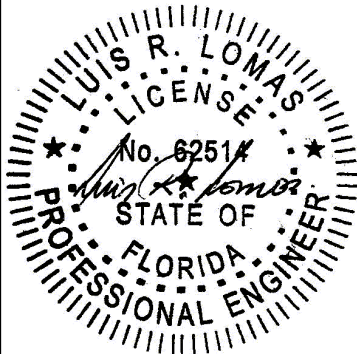

Luis R. Lomas P.E.
FL No.: 62514