


GENERAL NOTES

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE REQUIREMENTS OF THE 9TH EDITION (2026) FLORIDA BUILDING CODE FOR USE OUTSIDE THE HIGH VELOCITY HURRICANE ZONE
2. THIS DOCUMENT ADDRESSES ONLY PRODUCT ANCHORAGE TO ACHIEVE THE INDICATED DESIGN PRESSURES AT THE INDICATED SIZES, IN THE CONFIGURATIONS INDICATED. INSTALL PRODUCTS WITH MAXIMUM SHIM GAP, MINIMUM EDGE DISTANCE AND EMBEDMENT, AND WITH FASTENER TYPE AS SHOWN IN THE DETAILS AND AS INDICATED IN TABLE 1. FOR FBC 1711 COASTAL COMPLIANCE SEE EVALUATION REPORT. FOR FULL PRODUCT CONSTRUCTION DETAILS SEE INTERTEK TEST REPORTS I6450/1/2/3.01-201-44-r0 AND I8280/1.01-201-44-r0.
3. THIS PRODUCT AS SHOWN IN THIS DRAWING IS NON-IMPACT, AND REQUIRES THE USE OF IMPACT PROTECTIVE DEVICES (SHUTTERS) IN WINDBORNE DEBRIS REGIONS.
4. GLAZING SHALL BE COMPLIANT WITH ASTM E-1300 AND SAFETY GLAZING REQUIREMENTS OF THE FLORIDA BUILDING CODE.
5. THE 4/3 ALLOWABLE STRESS INCREASE FACTOR (SHORT-TERM INCREASE FACTOR) HAS NOT BEEN USED IN THE ANCHOR ANALYSIS FOR THIS SYSTEM. THE 1.6 Cd FACTOR WAS USED IN THE ANALYSIS OF ANCHORAGE INTO WOOD SUBSTRATE.
6. THE OPENING SUBSTRATE MATERIALS (FRAMING, MASONRY, BUCKS) AND ATTACHMENT OF BUCKS TO THE SUBSTRATE ARE BY OTHERS AND SHALL BE VERIFIED BY THE ARCHITECT OR ENGINEER OF RECORD OR AS APPROVED BY THE AUTHORITY HAVING JURISDICTION (AHJ). BUCKING, OPENINGS, & BUCKING FASTENERS MUST BE PROPERLY DESIGNED & INSTALLED BY OTHERS IN ACCORDANCE WITH THE FBC TO TRANSFER SUPERIMPOSED LOADS TO THE STRUCTURE. WITH MASONRY OPENINGS, WOOD BUCKS ARE OPTIONAL.
7. DISSIMILAR MATERIALS THAT COME INTO CONTACT SHALL BE COATED OR OTHERWISE PROTECTED TO PREVENT GALVANIC REACTIONS. WOOD BUCKS, IF USED, SHALL BE PRESSURE TREATED, WITH EITHER A TREATMENT OR COATING COMPATIBLE WITH THIS PRODUCT.
8. ANCHORAGE NOTES: ALL ANCHORS USED SHALL BE OF A MATERIAL OR HAVE A COATING COMPATIBLE WITH THE PRESSURE TREATED WOOD BUCKS AND ALL OTHER WINDOW MATERIALS. INSTALL TWO ANCHORS AT EACH LOCATION SHOWN IN THE ELEVATION, ALWAYS IN THE INNERMOST AND OUTERMOST TRACKS OF THE FRAME ASSEMBLY. INSTALL SHIMS AT EACH ANCHOR LOCATION WHERE A GAP OF 1/16" OR GREATER EXISTS BETWEEN PRODUCT FRAME AND SUBSTRATE. SHIMS SHALL BE LOAD-BEARING (PLASTIC OR METALLIC) AND CAPABLE OF TRANSFERRING LOADS TO SUBSTRATE. SPECIFIED ANCHOR EMBEDMENT TO SUBSTRATE SHALL BE BEYOND WALL FINISH OR STUCCO.
9. WOOD BUCKS LESS THAN 1-1/2" THICK ARE OPTIONAL AND MAY BE USED WITH CONCRETE/CMU, WITH ANCHOR EMBEDMENT BEYOND WOOD BUCKS AND INTO MASONRY.
10. ALL HARDWARE & FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS, OR AS APPROVED, SIGNED, AND SEALED BY A FLORIDA-REGISTERED PROFESSIONAL ENGINEER ON A SITE-SPECIFIC BASIS.
11. SEALING AND FLASHING STRATEGIES FOR OVERALL WATER INFILTRATION RESISTANCE OF THE INSTALLED PRODUCT SHALL BE THE RESPONSIBILITY OF OTHERS AND ARE NOT ADDRESSED BY THIS DOCUMENT.

MODERN MULTI-SLIDE DOORS

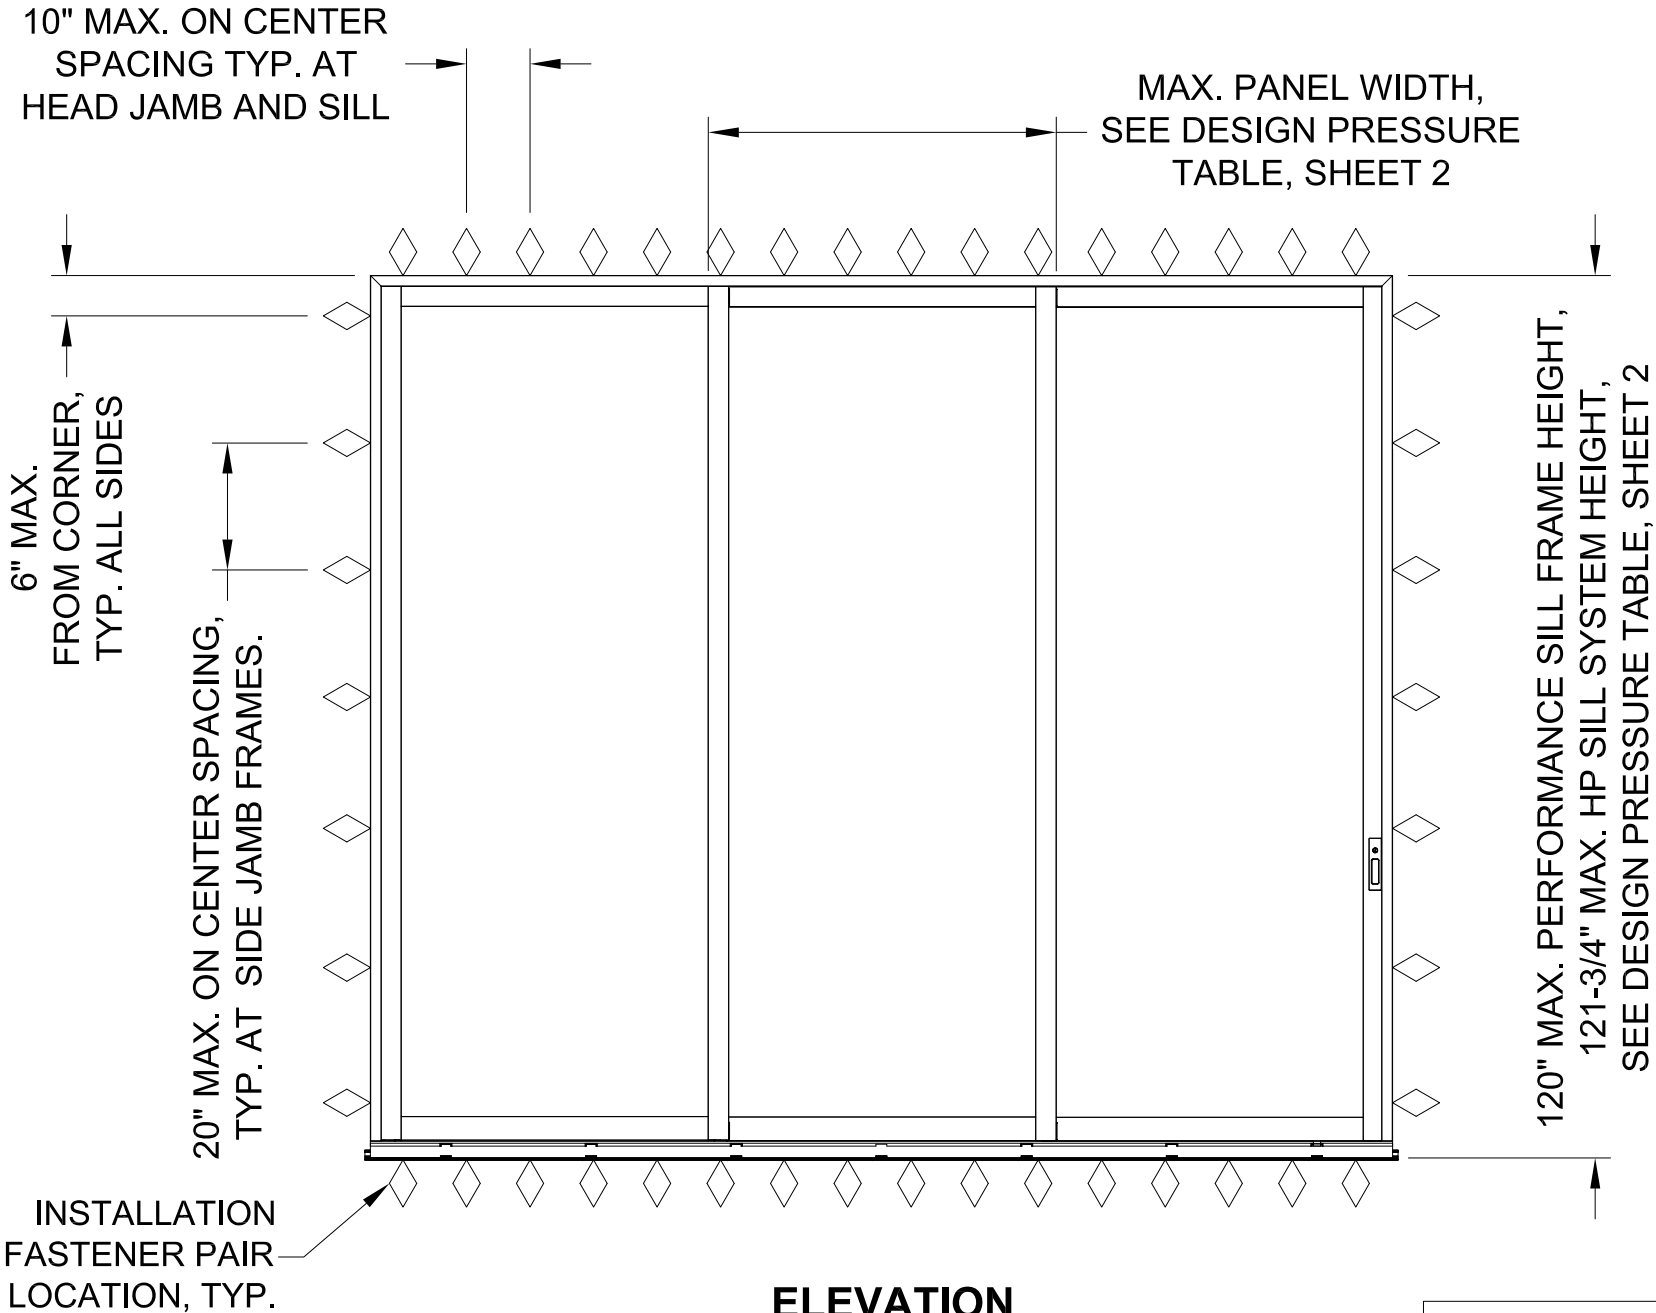


ELEVATION
SEE DETAILS SHEETS 2 AND 3

3-PANEL ELEVATION IS FOR ILLUSTRATIVE PURPOSES ONLY, FOR ALLOWABLE CONFIGURATIONS AND DESIGN PRESSURES, SEE SHEET 2

Lucas Turner
2026.09.25
14:28:45
-05'00'

MARVIN  WARROAD, MN U.S.A. PH. (218) 386-1430	
SHEET DESCRIPTION: NOTES, ELEVATION	DATE DRAWN: 10/23/2018
SCALE: NTS	REV: C
DRAWING: Install-MMSD (FL28429)	SHEET: 1 OF 5

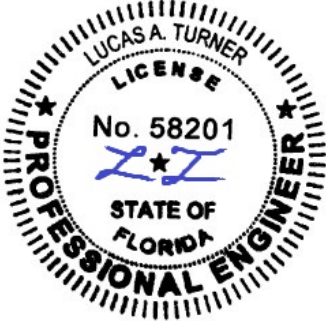

9/25/2026
Lucas A. Turner, P.E.
FL PE #58201
2428 Old Natchez Trc.
Trl., Camden, TN 38320
Ph. 941-380-1574

MODERN MULTI-SLIDE DOORS

CONFIGURATION	FRAME WIDTH	PANEL WIDTH	DESIGNATION	FRAME HEIGHT	PG RATING PERF. SILL	DESIGNATION	SYSTEM HEIGHT	PG RATING HP SILL
OX OR XO	143 11/16	72.375	MMSD STK	120	+40/-45	MMSD STK HP	121 3/4	+45/-45
OXX OR XXO	212 13/16	72.375	MMSD STK	120	+40/-45	MMSD STK HP	121 3/4	+45/-45
OXXX OR XXXO	281 15/16	72.375	MMSD STK	120	+40/-45	MMSD STK HP	121 3/4	+45/-45
OXXXX OR XXXXO	351 1/16	72.375	MMSD STK	120	+40/-45	MMSD STK HP	121 3/4	+45/-45
OXXXXX OR XXXXXO	420 3/16	72.375	MMSD STK	120	+40/-45	MMSD STK HP	121 3/4	+45/-45
OX-XO	285 3/4	72.375	MMSD STK	120	+35/-35	MMSD STK HP	121 3/4	+35/-35
OXX-XXO	424	72.375	MMSD STK	120	+35/-35	MMSD STK HP	121 3/4	+35/-35
OXXX-XXXO	562 1/4	72.375	MMSD STK	120	+35/-35	MMSD STK HP	121 3/4	+35/-35
OXXXX-XXXXO	700 1/2	72.375	MMSD STK	120	+35/-35	MMSD STK HP	121 3/4	+35/-35
OX-XO	237 3/4	60.375	MMSD STK	120	+40/-45	MMSD STK HP	121 3/4	+40/-45
OXX-XXO	340	60.375	MMSD STK	120	+40/-45	MMSD STK HP	121 3/4	+40/-45
OXXX-XXXO	466 1/4	60.375	MMSD STK	120	+40/-45	MMSD STK HP	121 3/4	+40/-45
OXXXX-XXXXO	580 1/2	60.375	MMSD STK	120	+40/-45	MMSD STK HP	121 3/4	+40/-45
XP OR PX	150 11/16	72.375	MMSD PKT	120	NA	MMSD PKT HP	121 3/4	+50/-45
XXP OR PXX	219 7/16	72.375	MMSD PKT	120	+40/-40	MMSD PKT HP	121 3/4	+50/-45
XXXP OR PXXX	288 9/16	72.375	MMSD PKT	120	+40/-40	MMSD PKT HP	121 3/4	+50/-45
XXXXP OR PXXXX	357 11/16	72.375	MMSD PKT	120	+40/-40	MMSD PKT HP	121 3/4	+50/-45
XXXXXP OR PXXXXX	426 13/16	72.375	MMSD PKT	120	+40/-40	MMSD PKT HP	121 3/4	+50/-45
XXXXXXP OR PXXXXXX	495 15/16	72.375	MMSD PKT	120	+40/-40	MMSD PKT HP	121 3/4	+50/-45
PX-XP	299 13/16	72.375	MMSD PKT	120	NA	MMSD PKT HP	121 3/4	+35/-35
PXX-XXP	437 1/4	72.375	MMSD PKT	120	+35/-35	MMSD PKT HP	121 3/4	+35/-35
PXXX-XXXP	575 1/2	72.375	MMSD PKT	120	+35/-35	MMSD PKT HP	121 3/4	+35/-35
PXXXX-XXXXP	713 3/4	72.375	MMSD PKT	120	+35/-35	MMSD PKT HP	121 3/4	+35/-35
PXXXXX-XXXXXP	852	72.375	MMSD PKT	120	+35/-35	MMSD PKT HP	121 3/4	+35/-35
PX-XP	251 13/16	60.375	MMSD PKT	120	NA	MMSD PKT HP	121 3/4	+40/-45
PXX-XXP	365 1/4	60.375	MMSD PKT	120	+40/-45	MMSD PKT HP	121 3/4	+40/-45
PXXX-XXXP	479 1/2	60.375	MMSD PKT	120	+40/-45	MMSD PKT HP	121 3/4	+40/-45
PXXXX-XXXXP	593 3/4	60.375	MMSD PKT	120	+40/-45	MMSD PKT HP	121 3/4	+40/-45
PXXXXX-XXXXXP	708	60.375	MMSD PKT	120	+40/-45	MMSD PKT HP	121 3/4	+40/-45



9/25/2026

Lucas A. Turner, P.E.

FL PE #58201

2428 Old Natchez Trc.

Trl., Camden, TN 38320

Ph. 941-380-1574

MARVIN® 

WARROAD, MN U.S.A.
PH. (218) 386-1430

SHEET DESCRIPTION:
CONFIGS. / DESIGN PRESSURES

DATE DRAWN:
10/23/2018


SCALE: NTS

REV: C

DRAWING: Install-MMSD (FL28429)

SHEET: 2 OF 5

MODERN
MULTI-SLIDE
DOORS

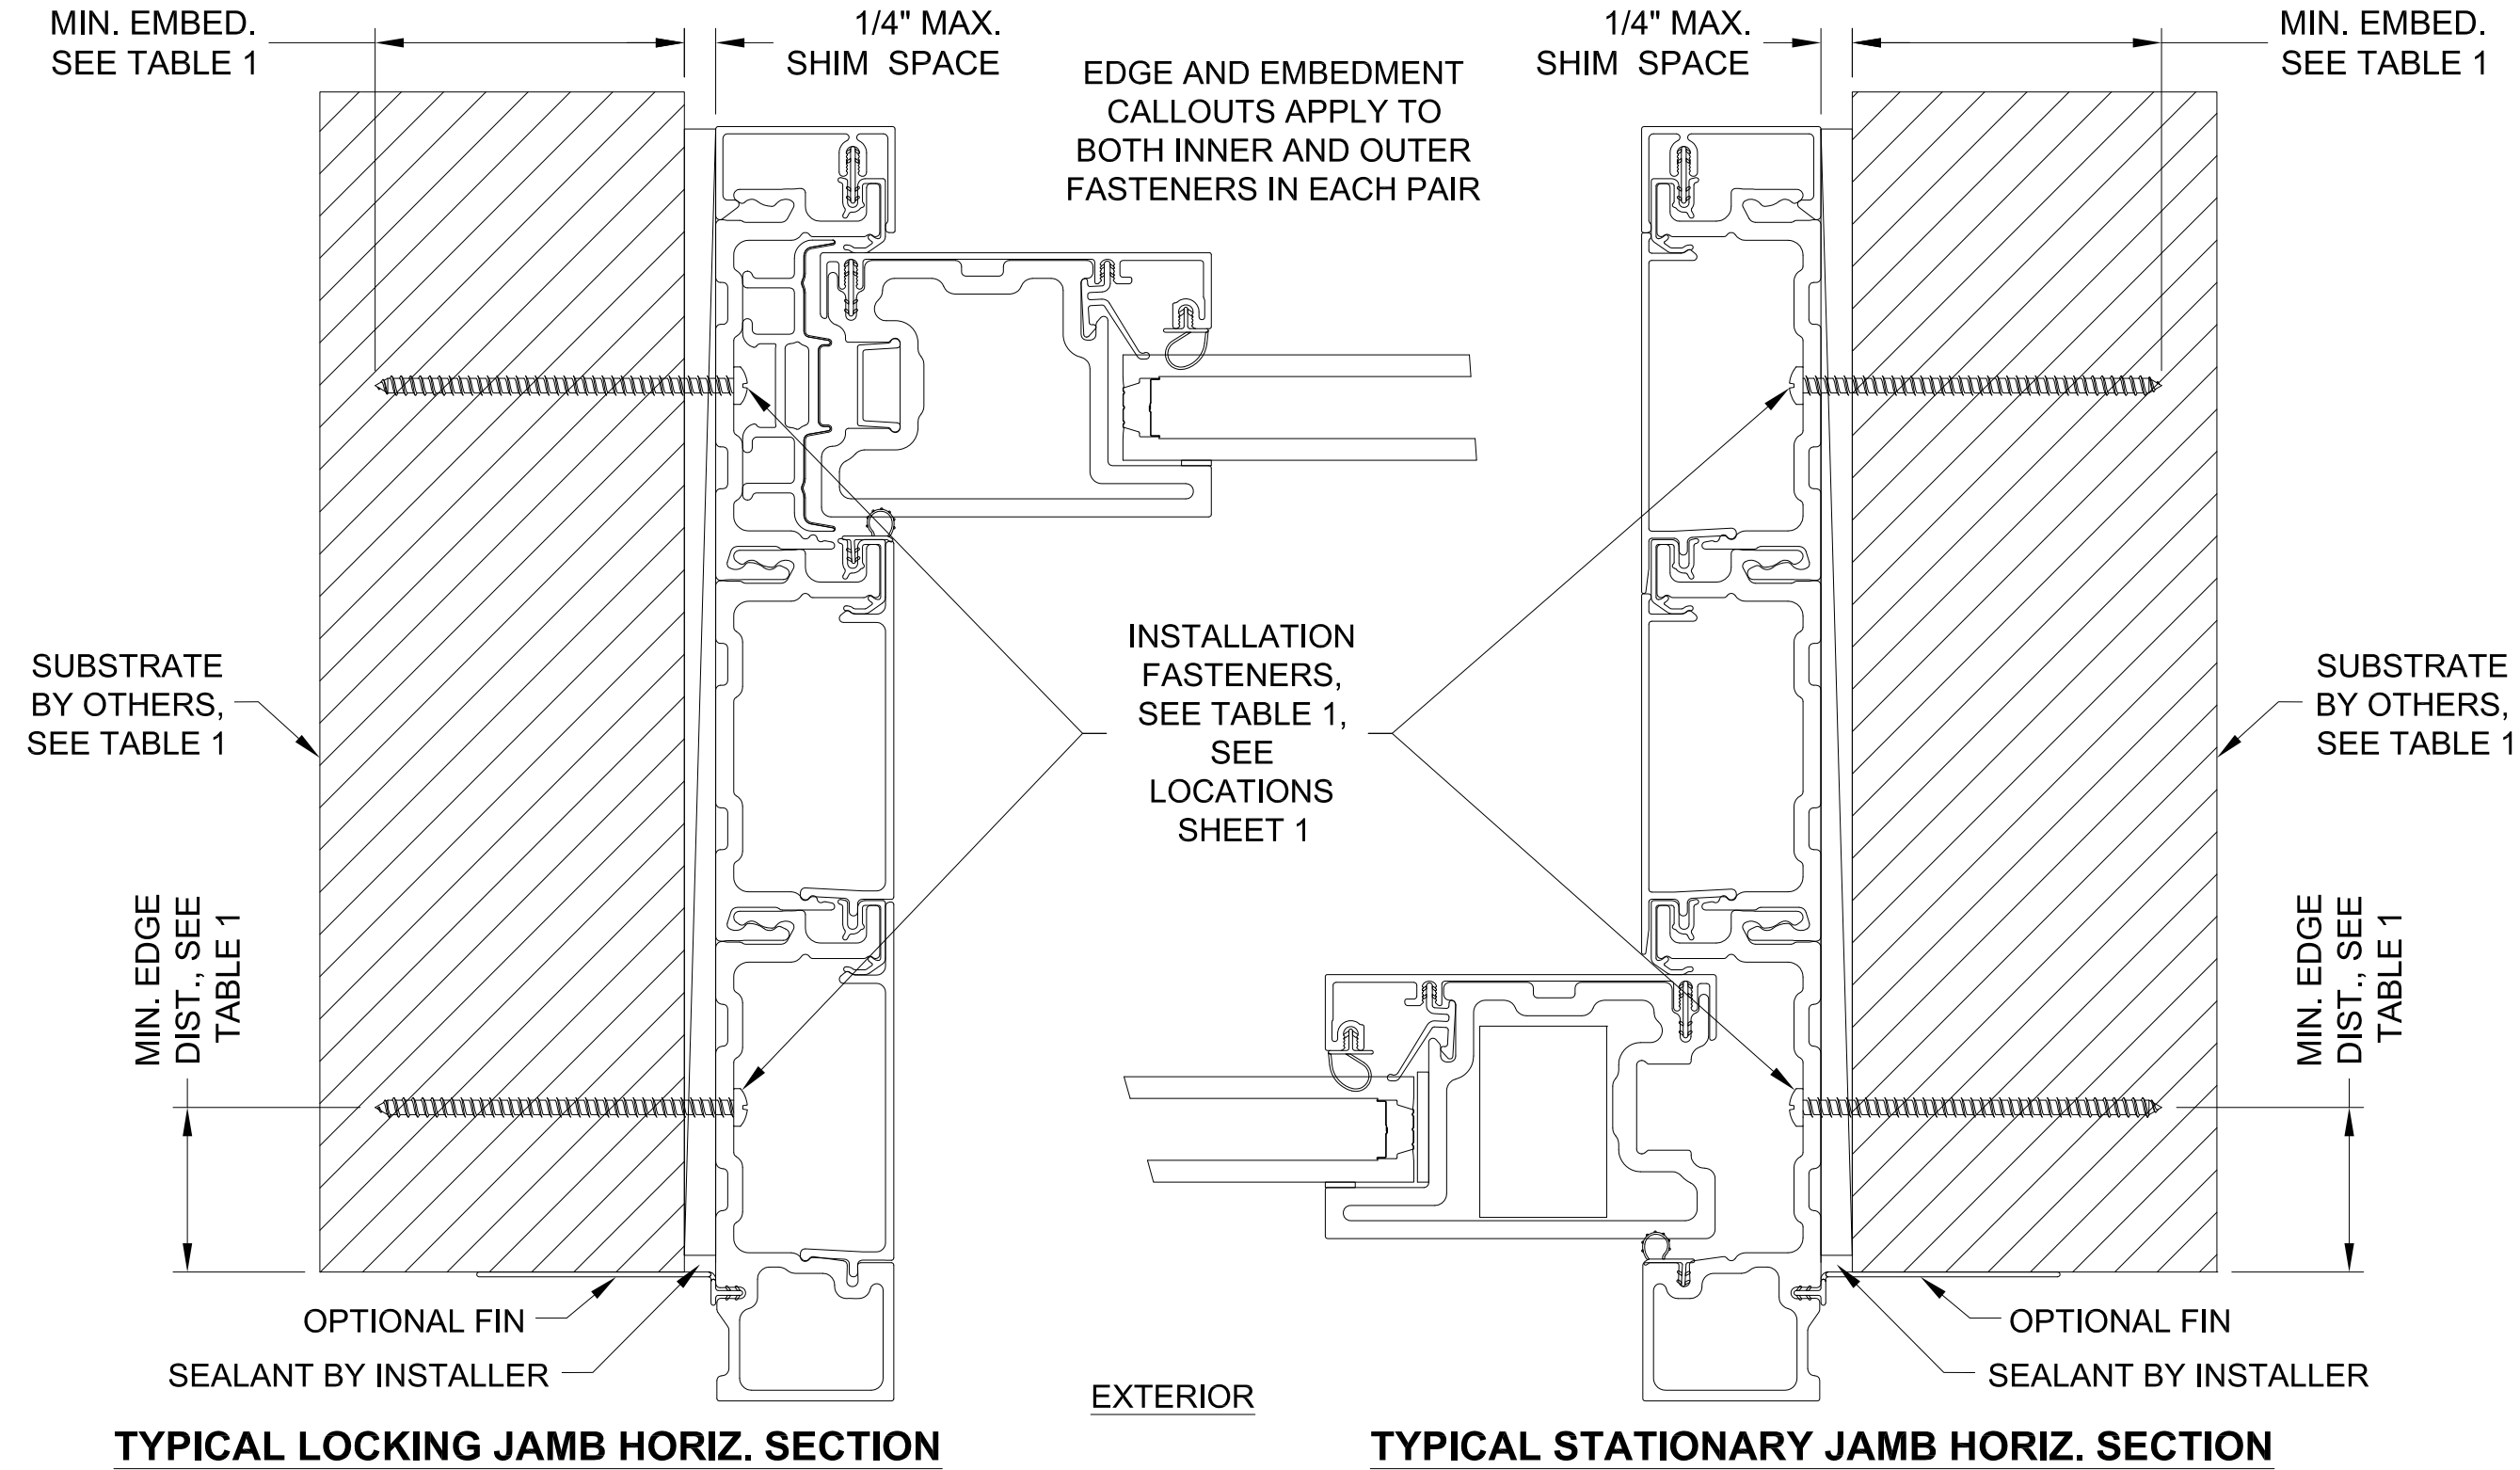

CONFIGURATION
NOTE:
THREE-PANEL OPTION
SHOWN; ALL
CONFIGURATIONS
SHOWN ON SHEET 2
ARE ALLOWABLE.
DIFFERENT NUMBERS
OF TRACKS ARE
PERMISSIBLE BY
ADDING OR REMOVING
TRACK MODULES.
ALWAYS INSTALL
FASTENERS IN
INNERMOST AND
OUTERMOST TRACKS.

TABLE 1: FRAME INSTALLATION ANCHOR REQUIREMENTS TABLE

SUBSTRATE TYPE	ANCHOR TYPE	MIN. EMBED.	MIN. EDGE DIST.
CONCRETE (2.0 KSI MIN)	3/16" ITW TAPCON	1-1/2"	1 1/8"
HOLLOW OR GROUT-FILLED CMU (117 PCF MIN.)	3/16" ITW TAPCON	1"	2"
16 GAUGE (0.060") MIN. STEEL STUD, 33KSI YIELD MIN., OR 1/8" ALUM. 6063-T5 MIN.	#10-16 HILTI KWIK-FLEX OR ITW TEKS SELF-DRILLING SCREW	3 THREADS BEYOND METAL WALL	1/2"

MARVIN



WARROAD, MN U.S.A.
PH. (218) 386-1430

SHEET DESCRIPTION:
INSTALLATION DETAILS, TABLE


DATE DRAWN:
10/23/2018

SCALE: NTS

REV: C


DRAWING: Install-MMSD (FL28429)

SHEET: 3 OF 5

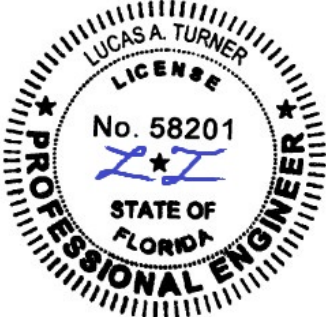


9/25/2026
Lucas A. Turner, P.E.
FL PE #58201
2428 Old Natchez Trc.
Trl., Camden, TN 38320
Ph. 941-380-1574

MODERN MULTI-SLIDE DOORS

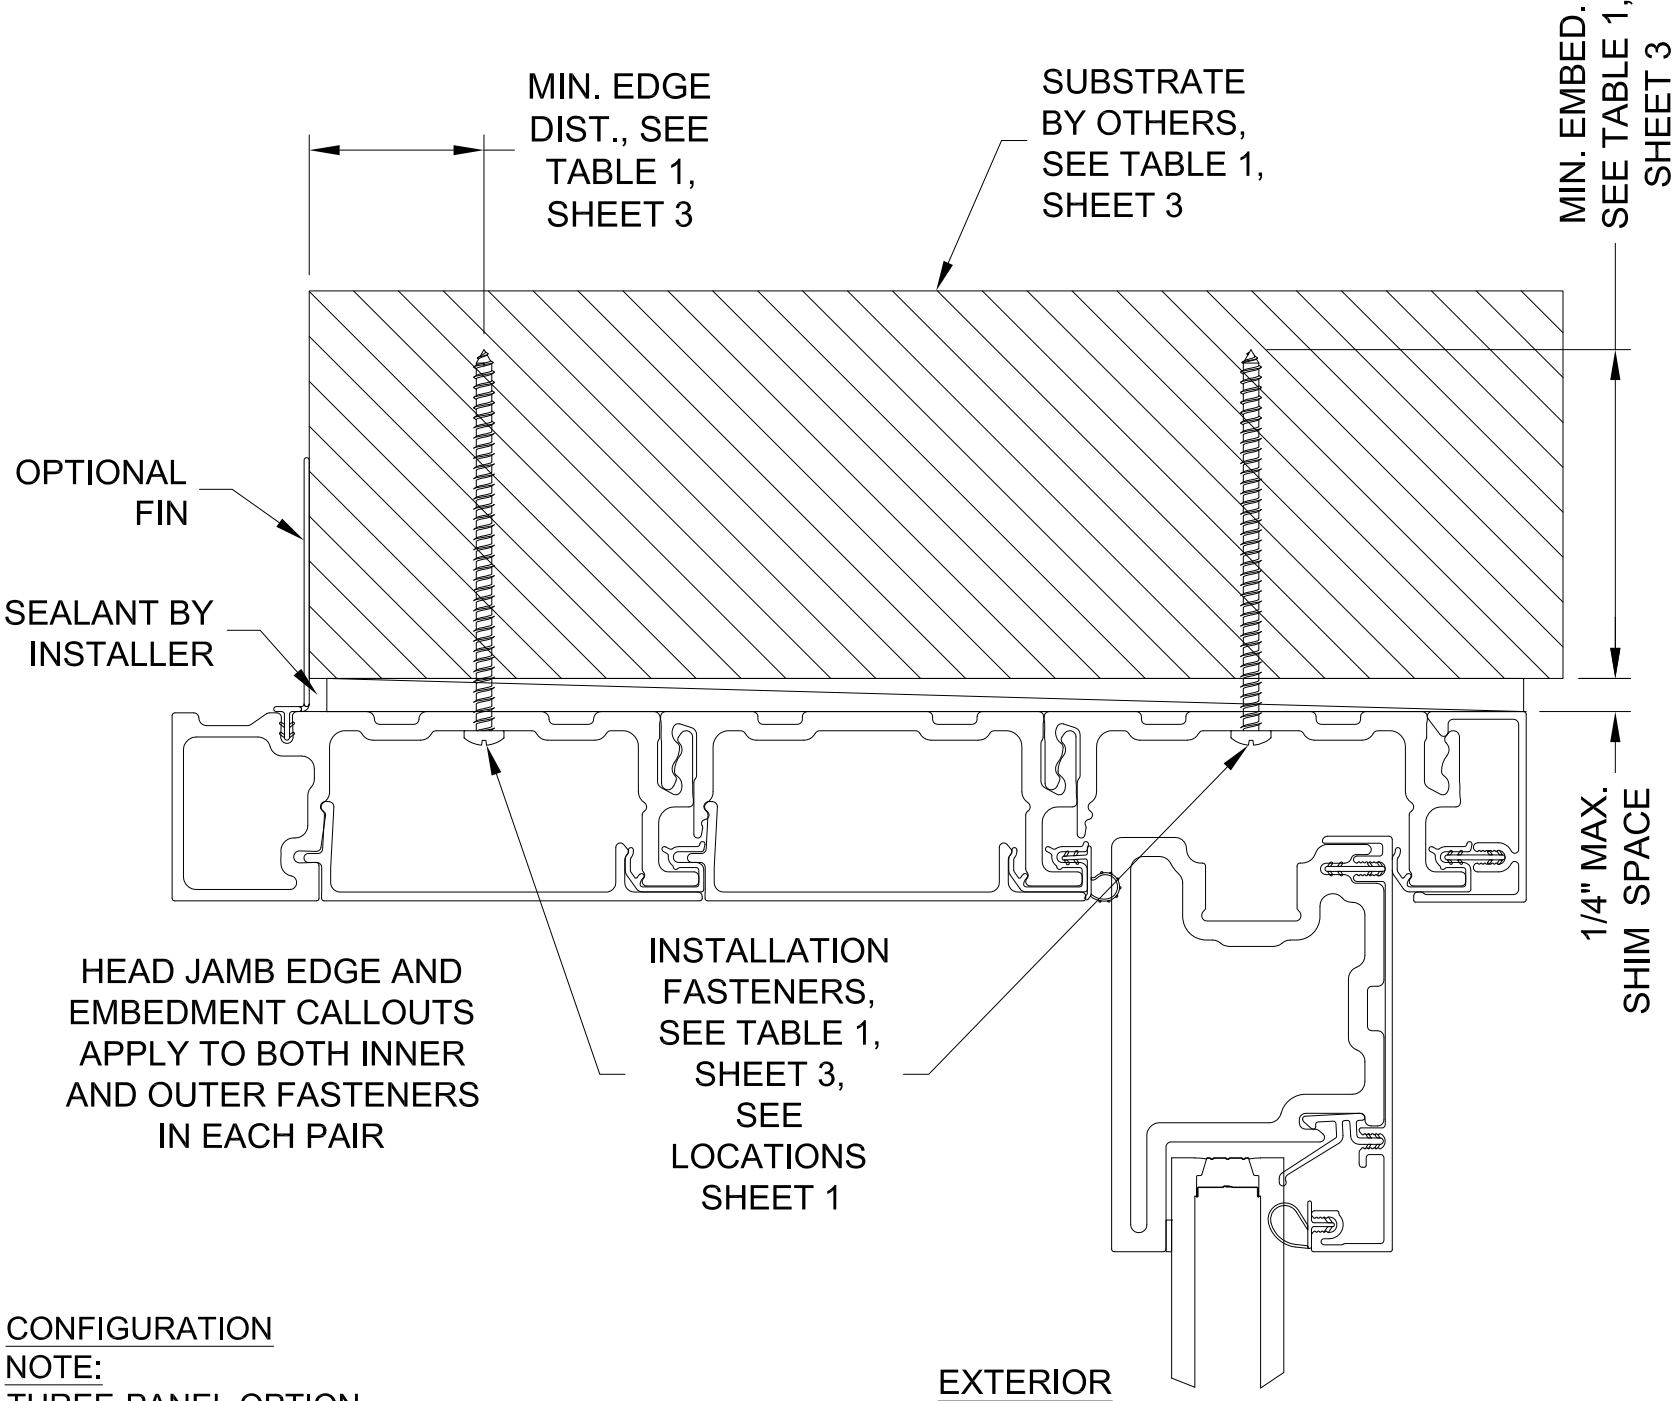

CONFIGURATION NOTE:
THREE-PANEL OPTION SHOWN, HOWEVER ALL CONFIGURATIONS SHOWN ON SHEET 2 ARE ALLOWABLE. DIFFERENT NUMBERS OF TRACKS ARE PERMISSIBLE BY ADDING OR REMOVING TRACK MODULES. ALWAYS INSTALL FASTENERS IN INNERMOST AND OUTERMOST TRACKS.

TYPICAL HEAD JAMB VERTICAL SECTION

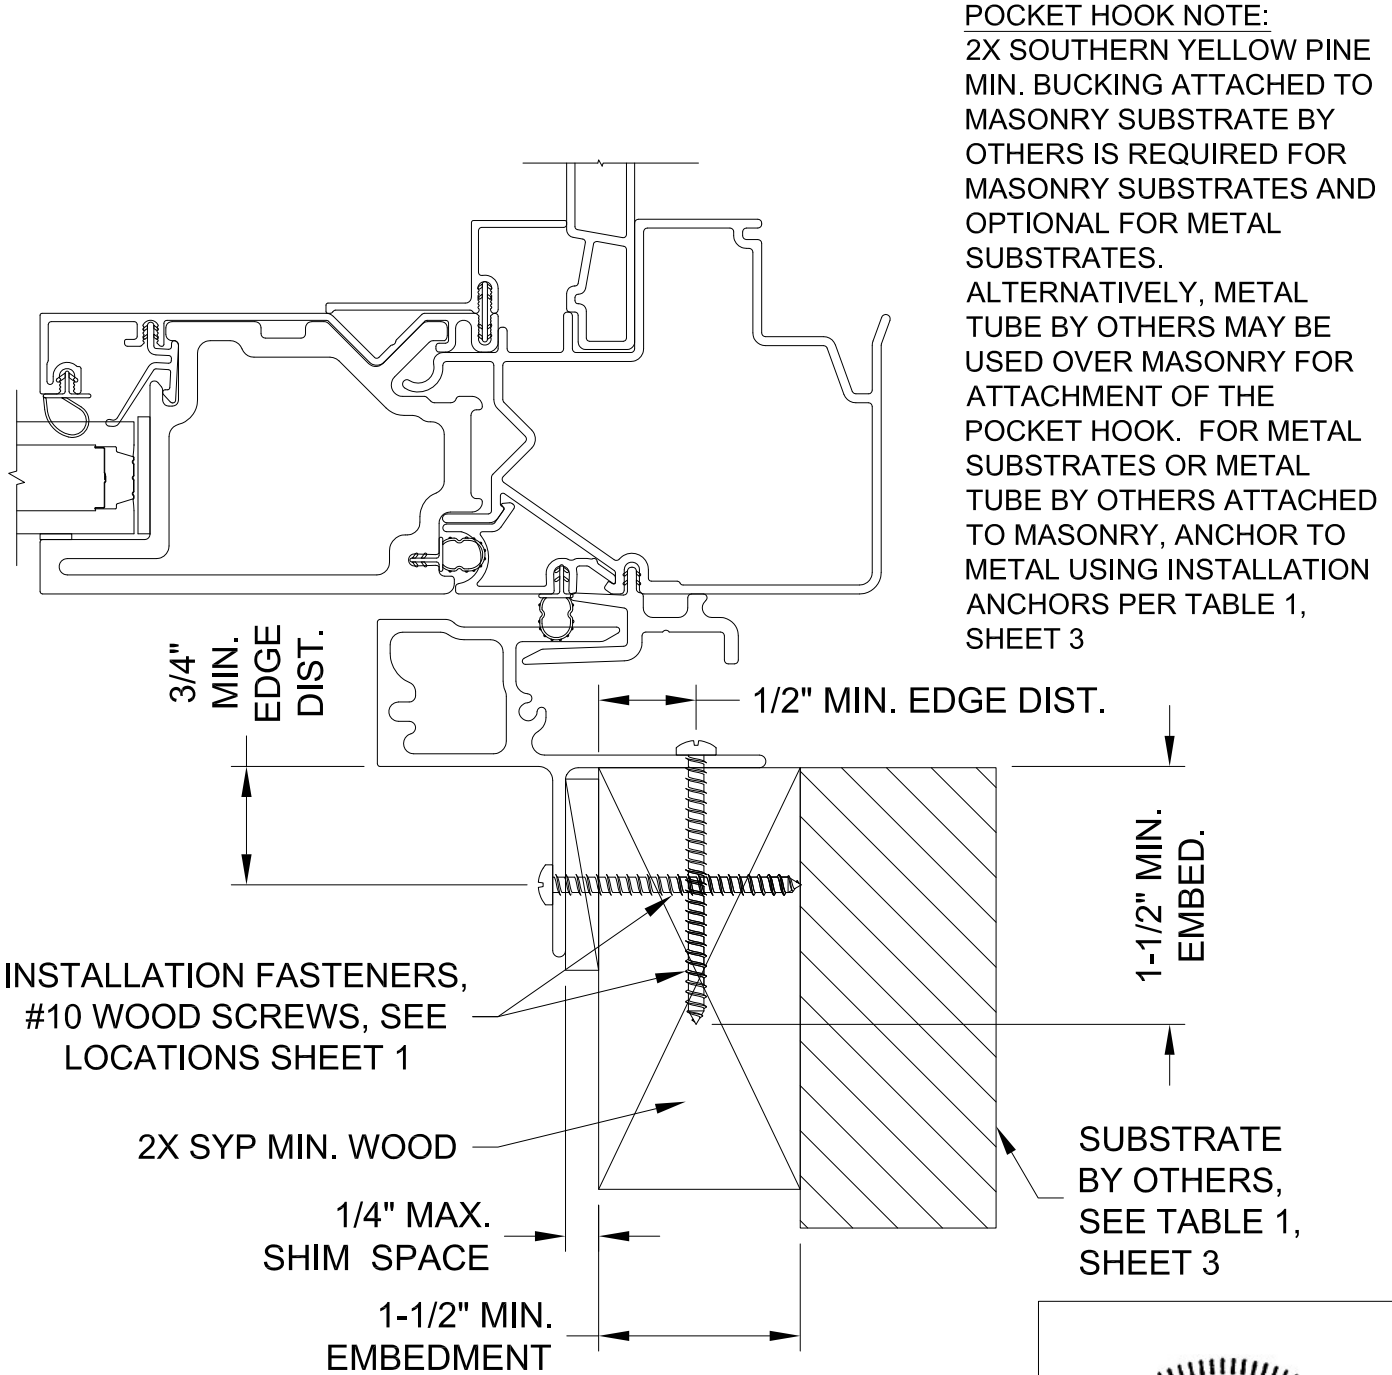

TYPICAL POCKET HORIZ. SECTION



WARROAD, MN U.S.A.
PH. (218) 386-1430

SHEET DESCRIPTION:
INSTALLATION DETAILS


DATE DRAWN:
10/23/2018

SCALE: NTS


REV: C

DRAWING: Install-MMSD (FL28429)

SHEET: 4 OF 5

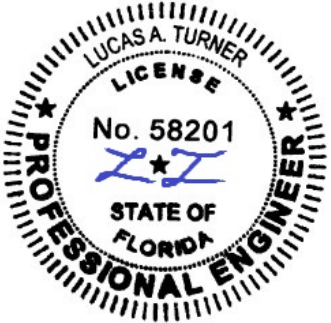


9/25/2026
Lucas A. Turner, P.E.
FL PE #58201
2428 Old Natchez Trc.
Trl., Camden, TN 38320
Ph. 941-380-1574

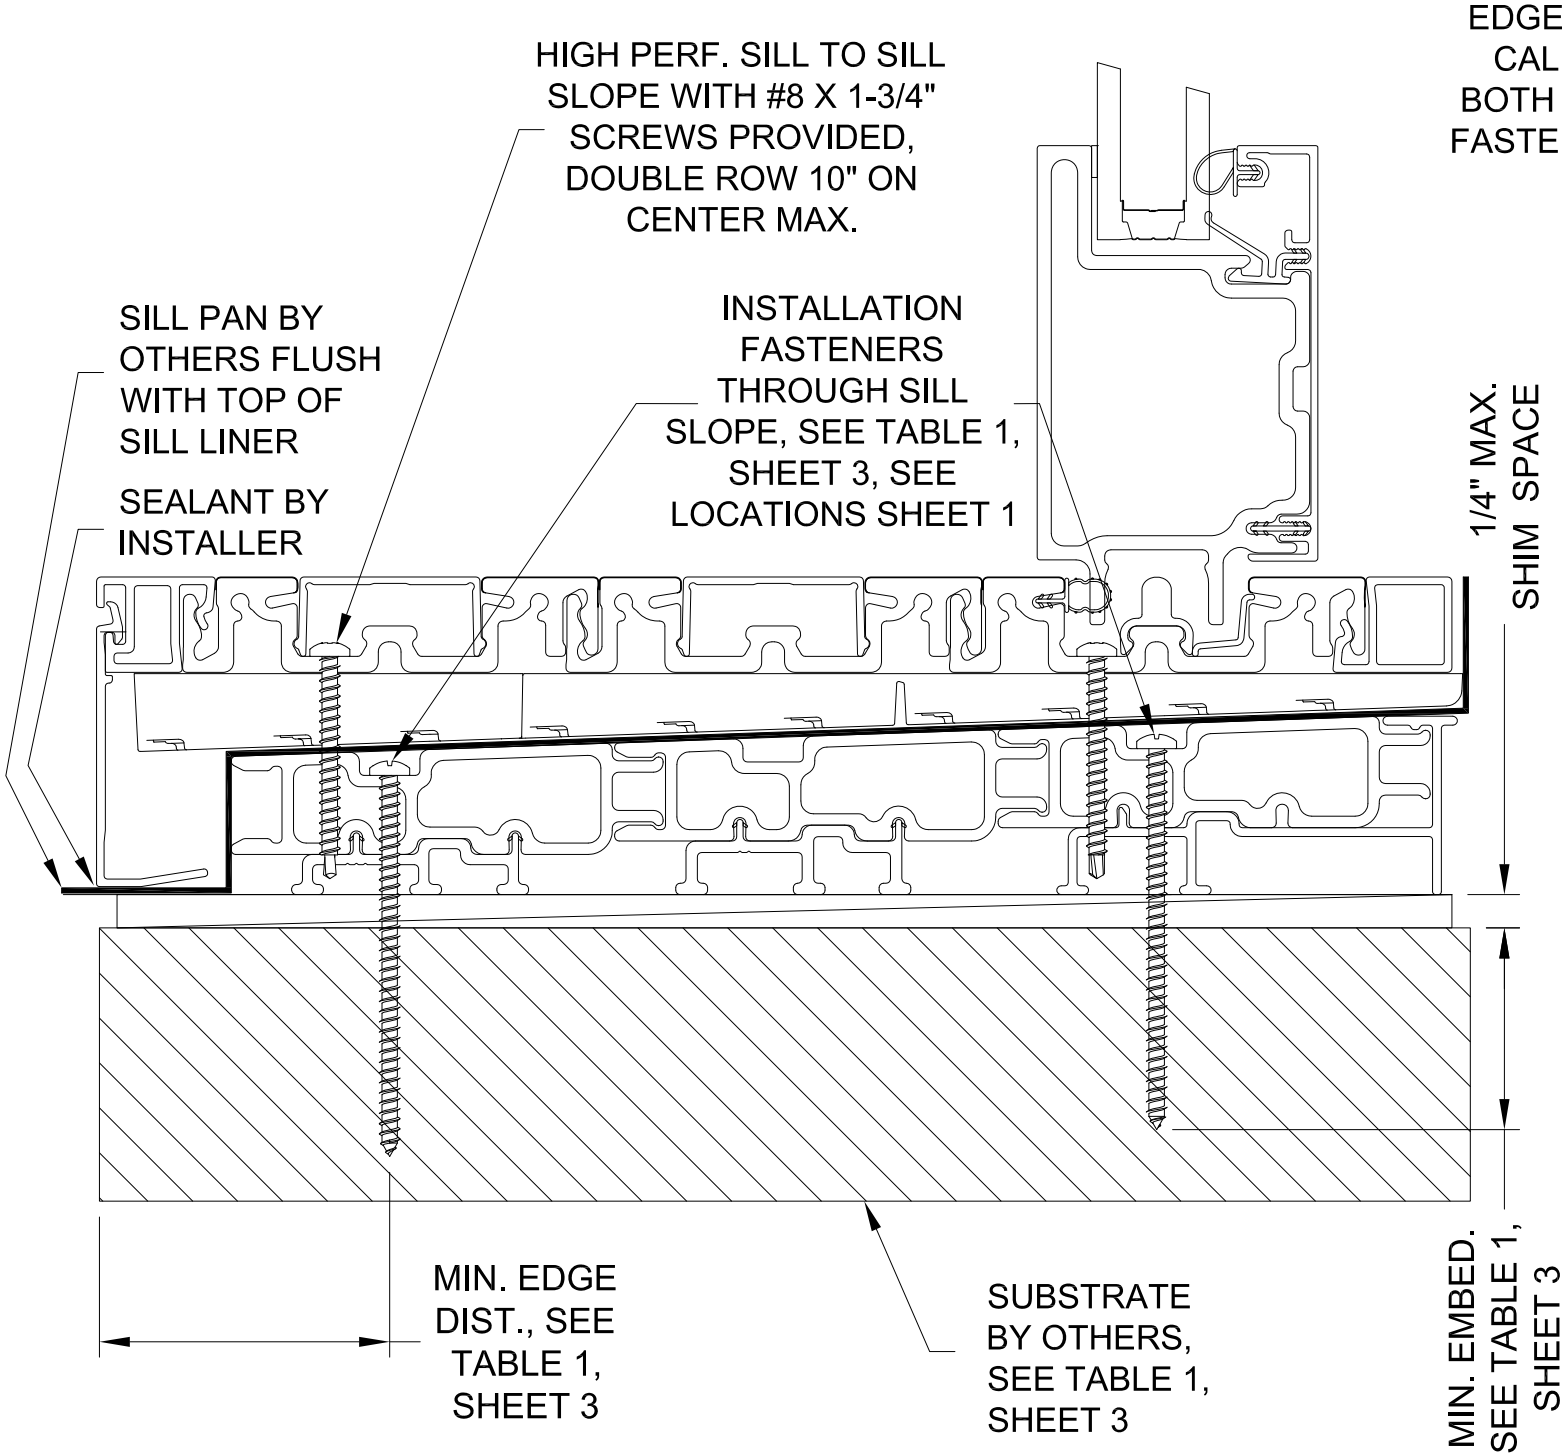

TYPICAL HP SILL VERTICAL SECTION

EDGE AND EMBEDMENT
CALLOUTS APPLY TO
BOTH INNER AND OUTER
FASTENERS IN EACH PAIR

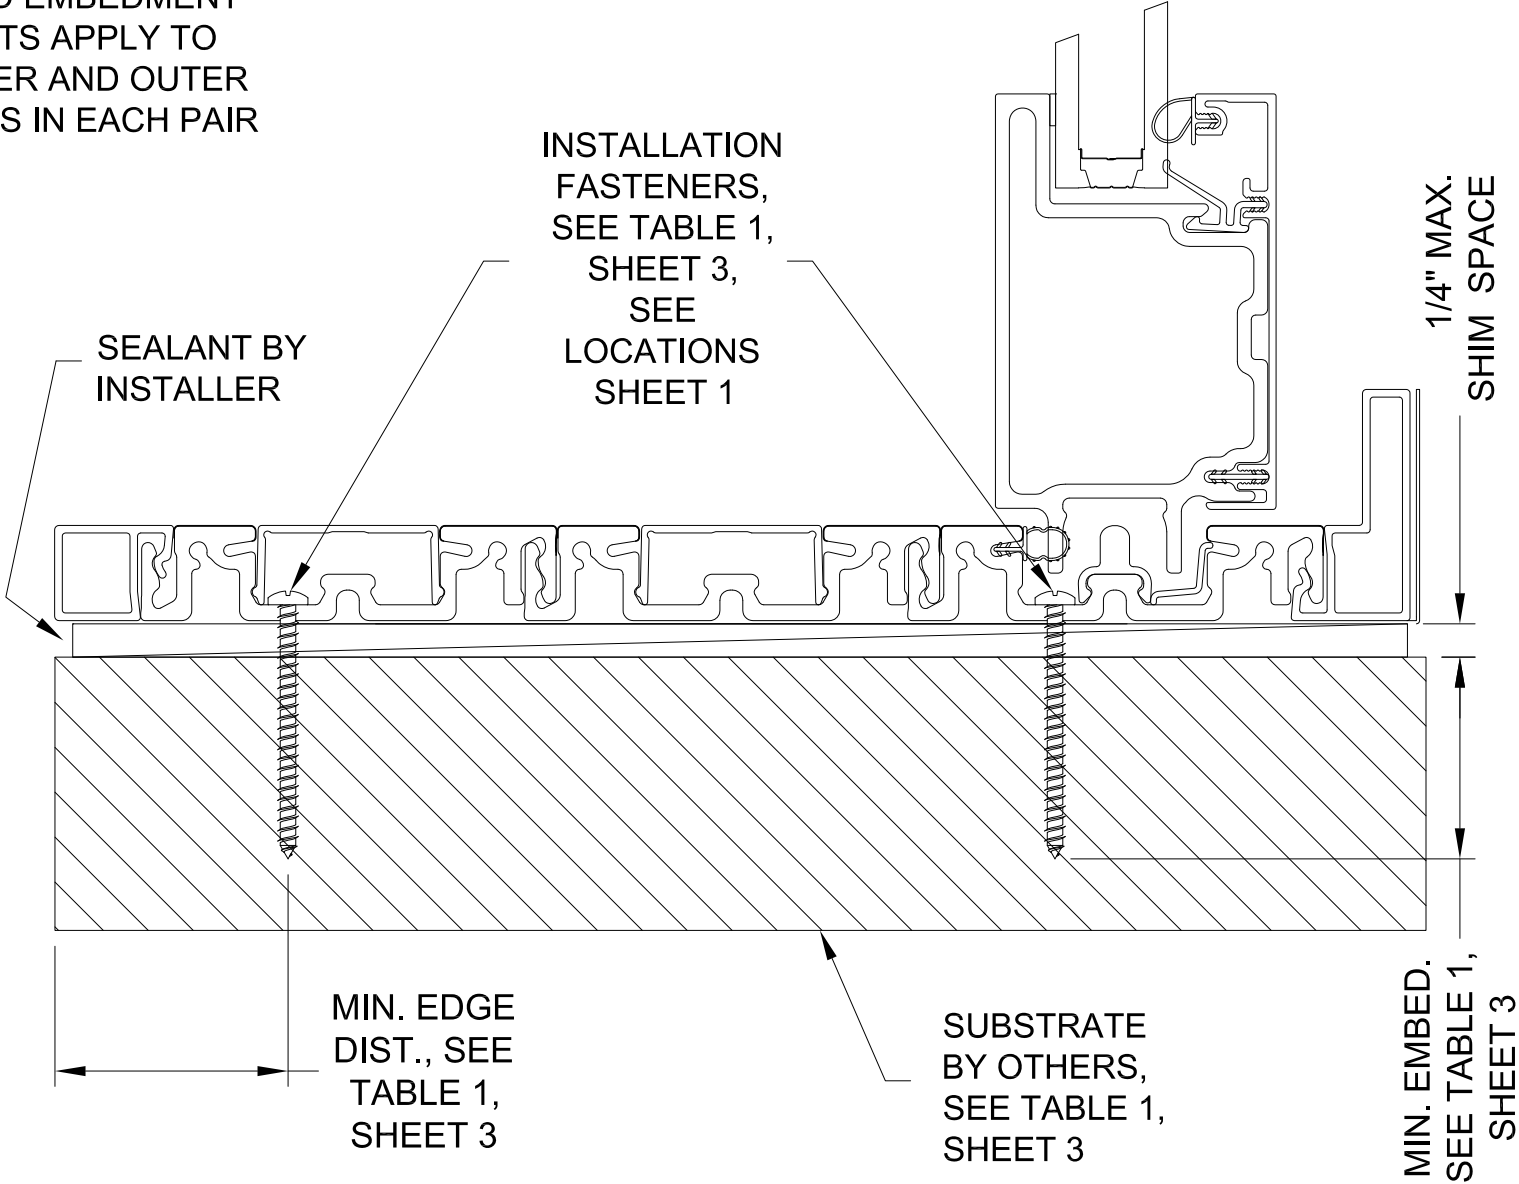

TYPICAL PERFORMANCE SILL VERTICAL SECTION


CONFIGURATION NOTE:
THREE-PANEL OPTION SHOWN, HOWEVER
ALL CONFIGURATIONS SHOWN ON SHEET 2
ARE ALLOWABLE. DIFFERENT NUMBERS
OF TRACKS ARE PERMISSIBLE BY ADDING
OR REMOVING TRACK MODULES. ALWAYS
INSTALL FASTENERS IN INNERMOST AND
OUTERMOST TRACKS.

MARVIN



WARROAD, MN U.S.A.
PH. (218) 386-1430

SHEET DESCRIPTION: INSTALLATION DETAILS	DATE DRAWN: 10/23/2018
SCALE: NTS	REV: C
DRAWING: Install-MMSD (FL28429)	SHEET: 5 OF 5

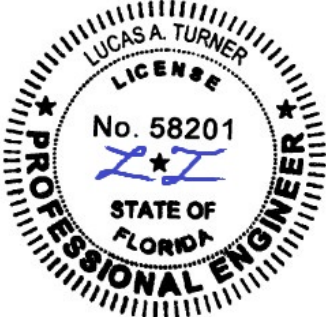

9/25/2026
Lucas A. Turner, P.E.
FL PE #58201
2428 Old Natchez Trc.
Trl., Camden, TN 38320
Ph. 941-380-1574