

s:\projects\bator north america\fb-c-16-0934.1 industrial folding door\dwg\bna001.dwg 12/3/2018 6:35 PM

BATOR NORTH AMERICA


INDUSTRIAL DOORS

BATOR HURRICANE FOUR FOLD DOOR

STEEL BI-FOLDING DOOR ASSEMBLY

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X and 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. DOOR FRAME MATERIAL: STEEL A513
7. GLASS MEETS THE REQUIREMENTS OF ASTM E 1300-04 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAIL.

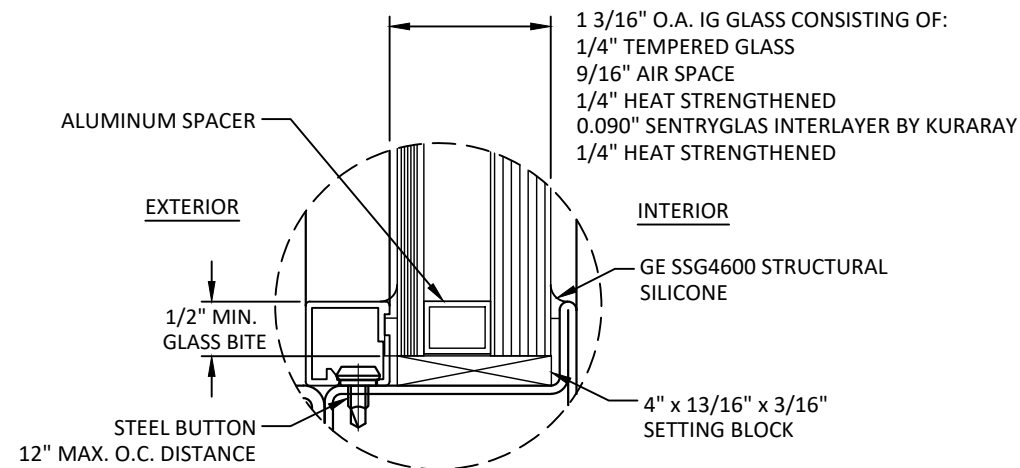

GLAZING DETAIL

TABLE OF CONTENTS		
SHEET	REVISION	SHEET DESCRIPTION
1	-	GENERAL NOTES & GLAZING DETAIL
2	-	ELEVATION, SECTION & DETAILS
3	-	ANCHOR LAYOUT
4	-	VERTICAL SECTIONS
5	-	HORIZONTAL SECTIONS
6	-	INSTALLATION NOTES AND ANCHOR DETAIL
7	-	BILL OF MATERIALS & COMPONENTS
8	-	COMPONENTS

DESIGN PRESSURE RATING	
DESIGN PRESSURE	MISSILE IMPACT RATING
+120.0 / -120.0 PSF	LARGE MISSILE IMPACT RATED

GLAZING NOTES:

1. GLASS TYPE AND THICKNESS COMPLIES WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. THICKNESS, TEMPER, AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
3. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
4. D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.

bator®

BATOR NORTH AMERICA
1451 S ELM-EUGENE ST
GREENSBORO, NC 27406
PH: (336)907-2286 FAX: (336)907-2287

TITLE: BATOR HURRICANE FOUR FOLD DOOR
STEEL BI-FOLDING DOOR ASSEMBLY
GENERAL NOTES AND
GLAZING DETAIL


PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2018.12.04 05:44:58 -05'00'

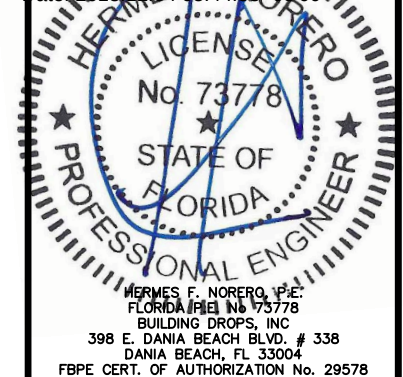

FL #: **FL28451**

DATE: **10.31.18**

DWG. BY: **JA** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **BNA001**


SECTION: **1**

12/2/2018 6:35 PM


s:\projects\bator north america\lbc-16-0934.1 industrial folding sliding door\dwg\bna001.dwg

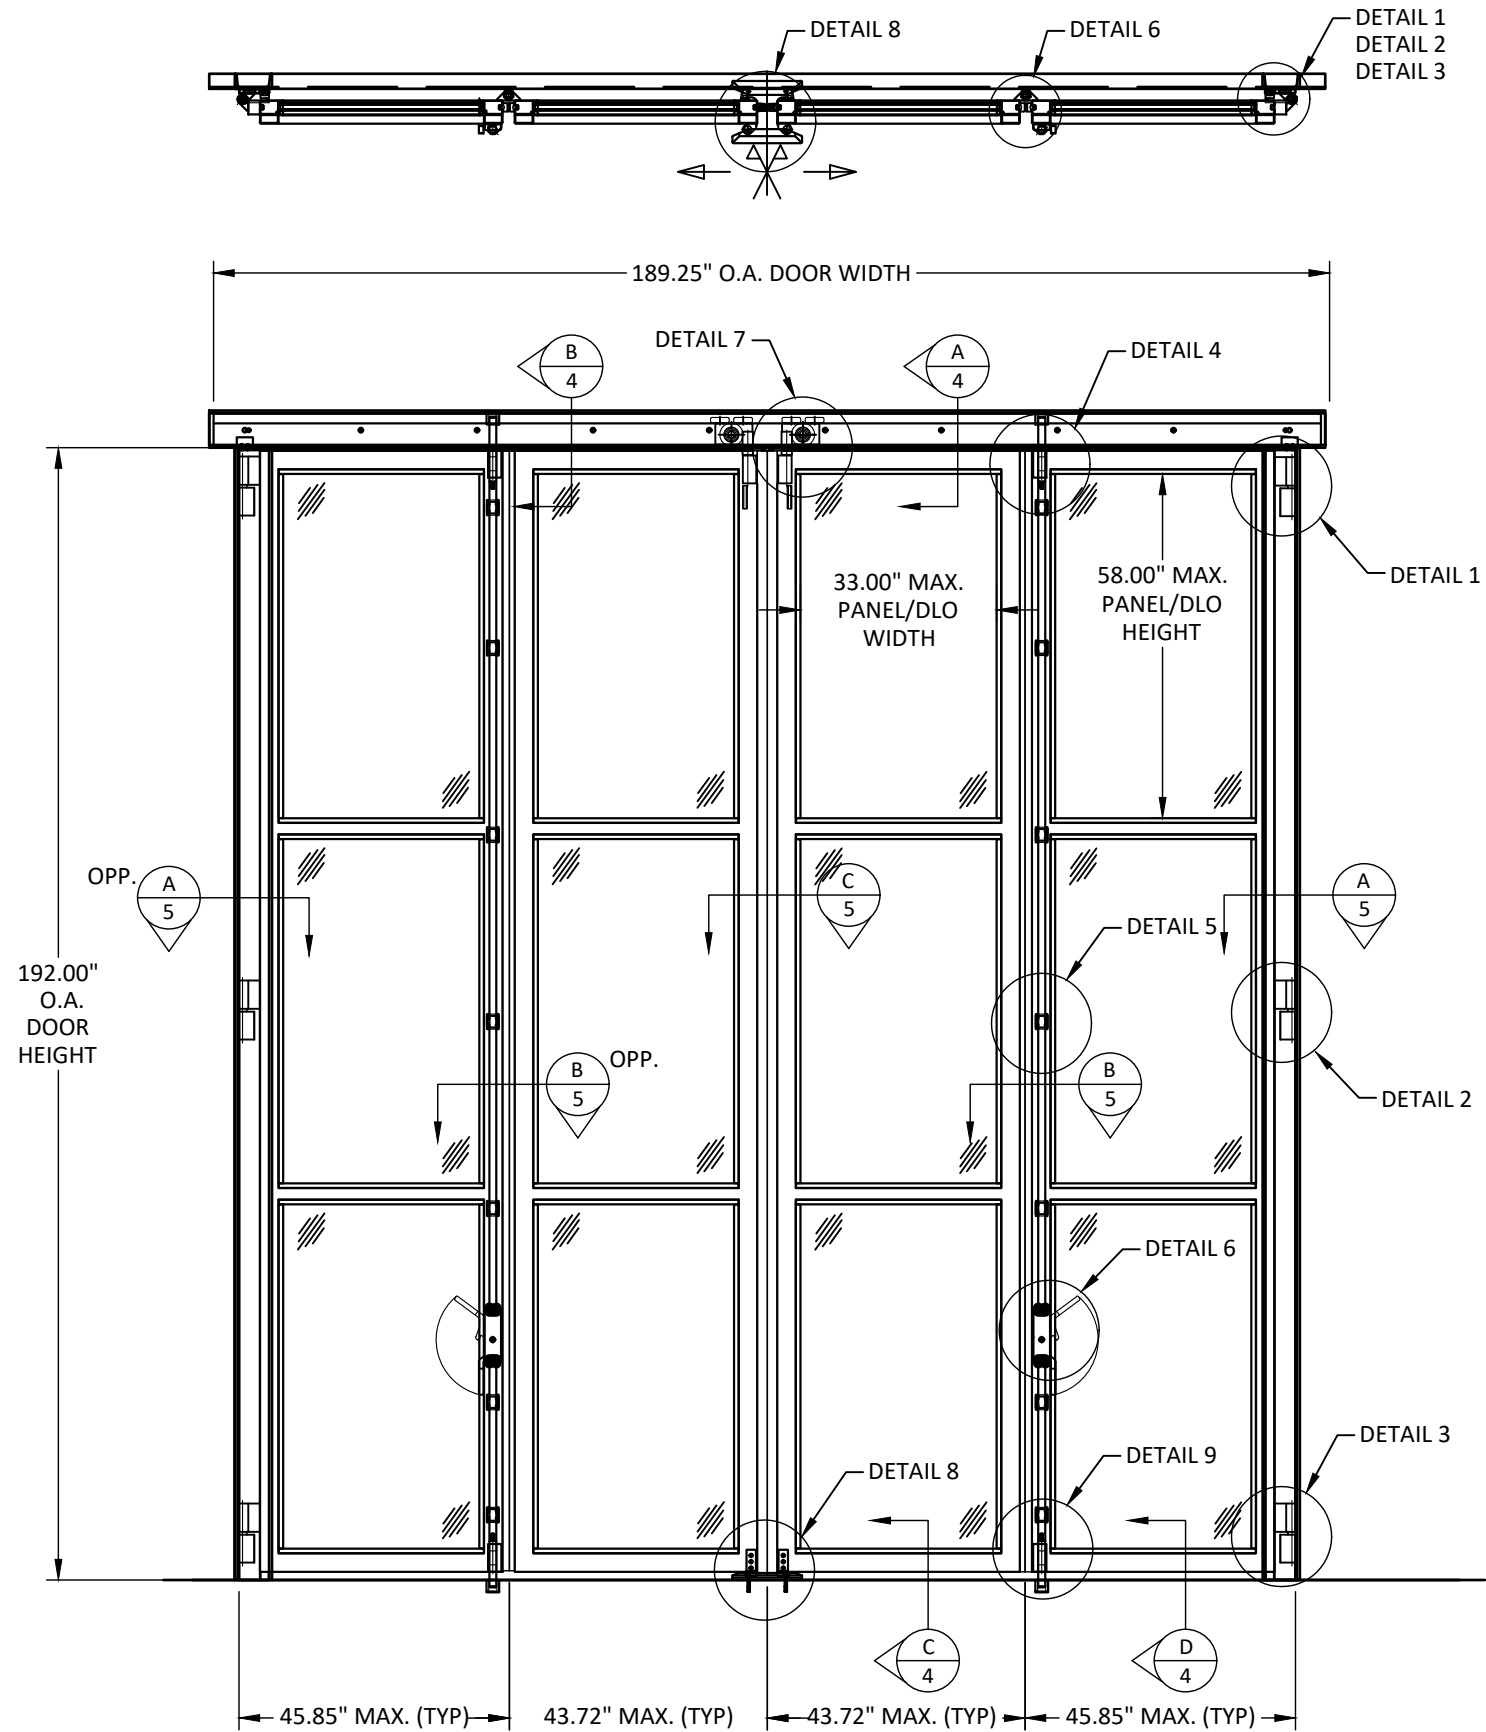

A
2 EXTERIOR ELEVATION

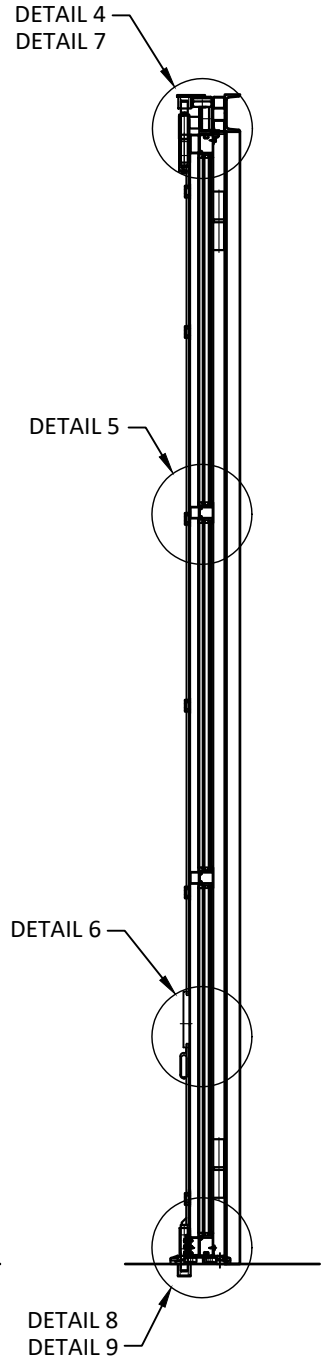

B
2 VERTICAL SECTION

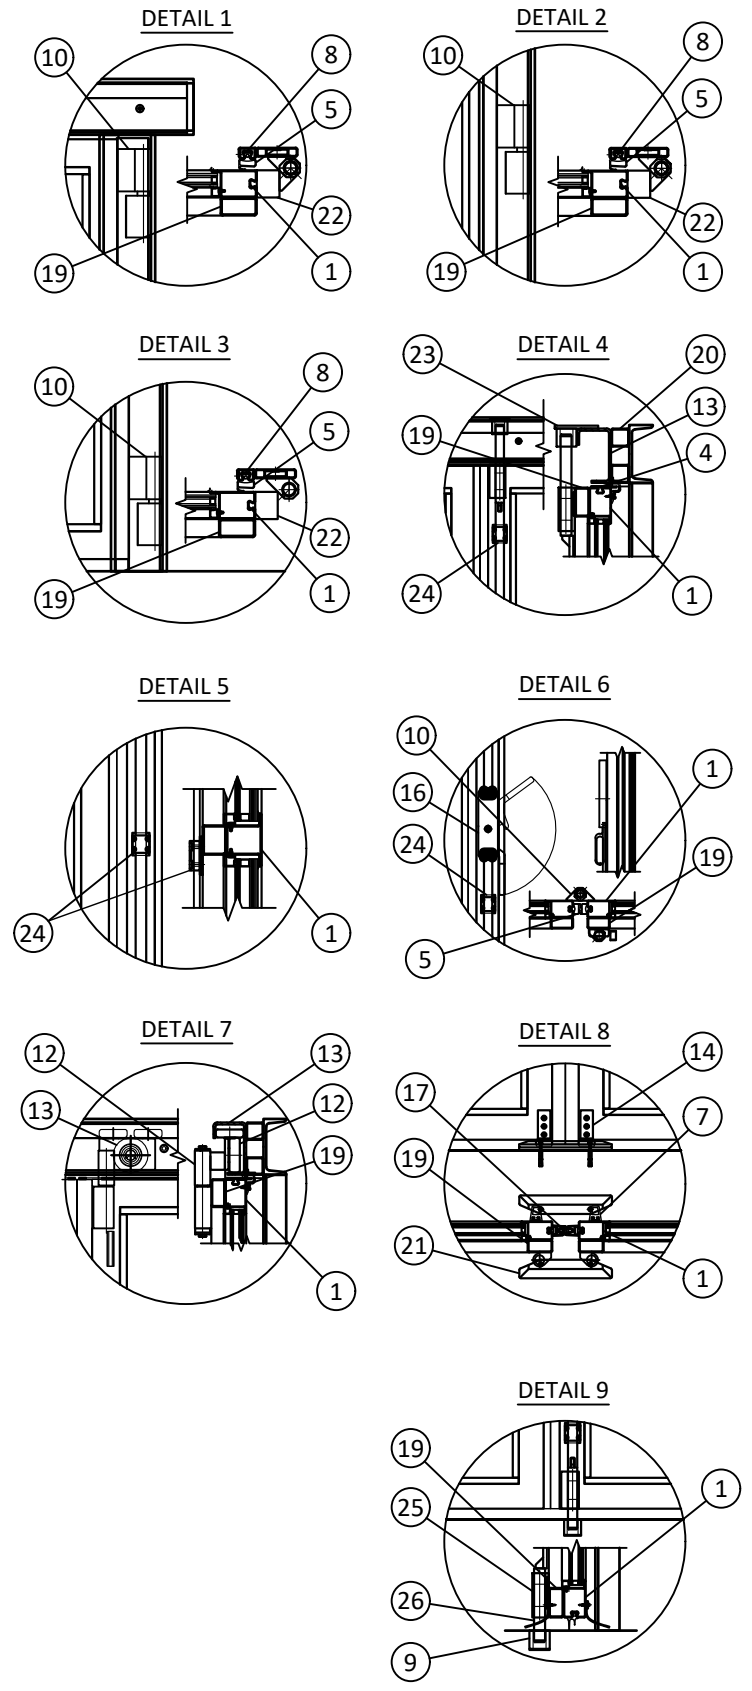


bator[®]

BATOR NORTH AMERICA
1451 S ELM-EUGENE ST
GREENSBORO, NC 27406
PH: (336)907-2286 FAX: (336)907-2287

TITLE: BATOR HURRICANE FOUR FOLD DOOR
STEEL BI-FOLDING DOOR ASSEMBLY
ELEVATION, SECTION
& DETAILS
PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT

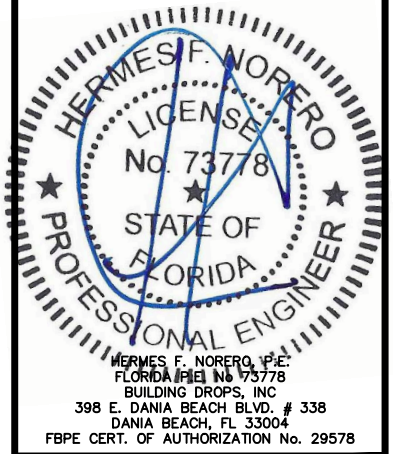


FL #: **FL28451**
DATE: **10.31.18**
DWG. BY: **JA** CHK. BY: **HFN**
SCALE: **NTS**
DWG. #: **BNA001**
SECTION:

12/3/2018 6:35 PM

s:\projects\bator north america\fbc-16-0934.1 industrial folding door\dwg\bna001.dwg

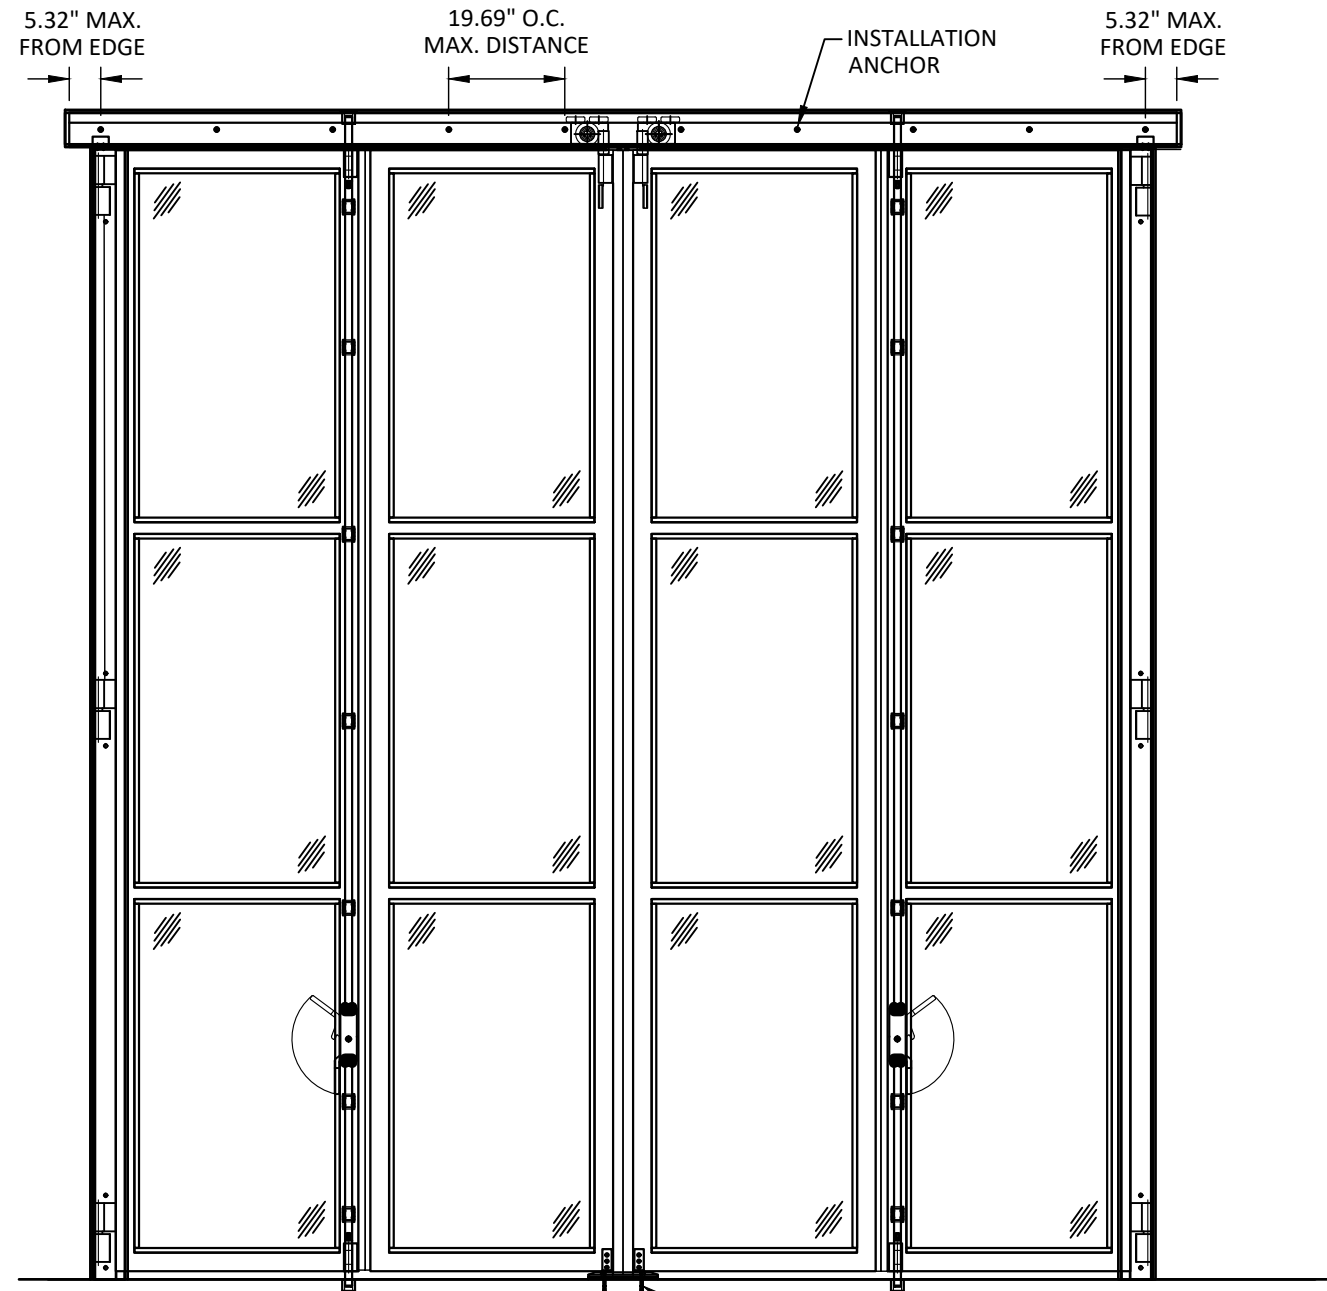

A
3 **ANCHOR LAYOUT**
INTERIOR ELEVATION

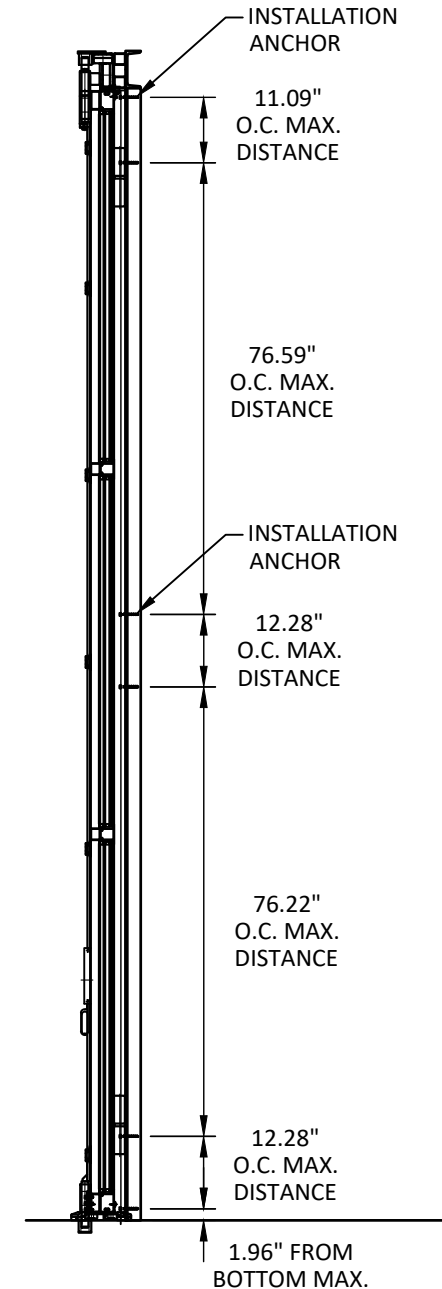

B
3 **ANCHOR LAYOUT**
VERTICAL SECTION

bator®

BATOR NORTH AMERICA

1451 S ELM-EUGENE ST
GREENSBORO, NC 27406


PH: (336)907-2286 FAX: (336)907-2287

TITLE:
BATOR HURRICANE FOUR FOLD DOOR
STEEL BI-FOLDING DOOR ASSEMBLY

ANCHOR LAYOUTS


PREPARED BY:
BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

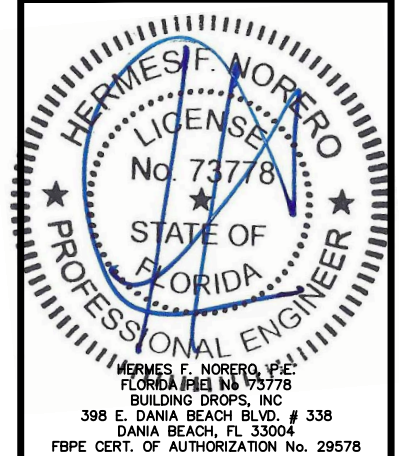

FL #:
FL28451


DATE: **10.31.18**

DWG. BY: **JA** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **BNA001**


SECTION:
3

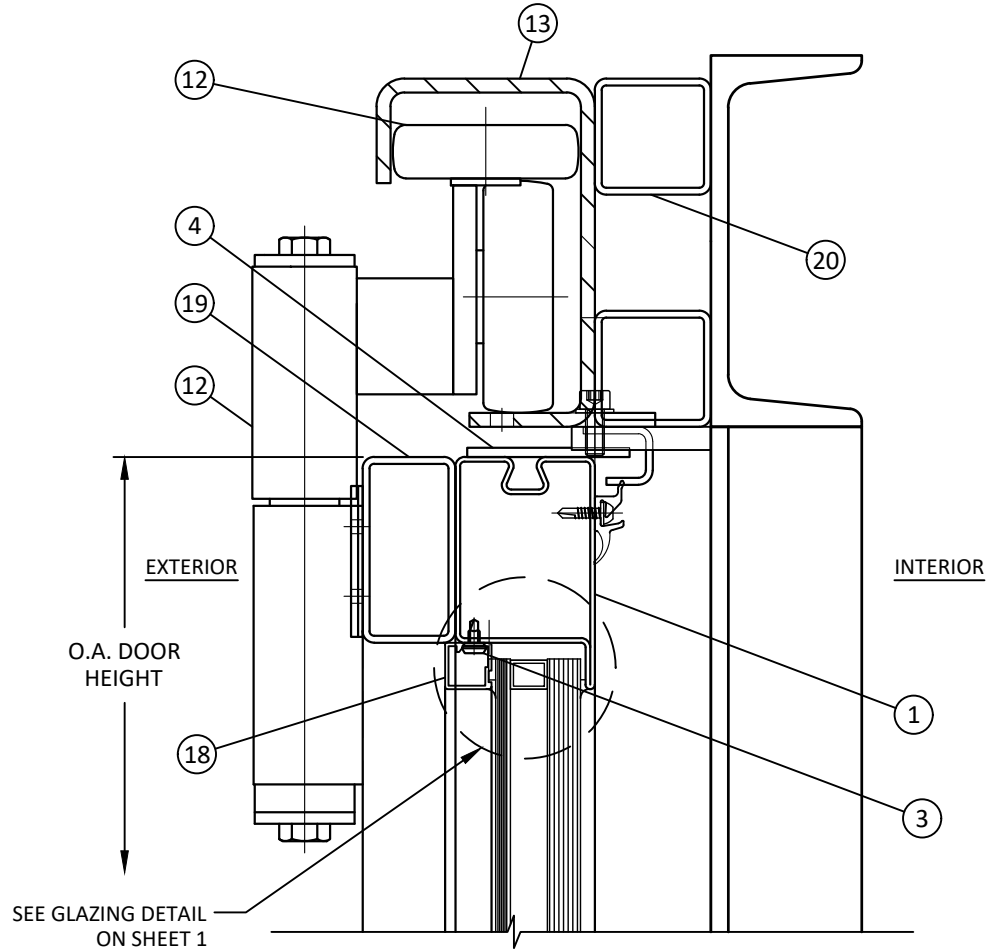


A
4 VERTICAL SECTION
TOP RAIL - ASTRAGAL

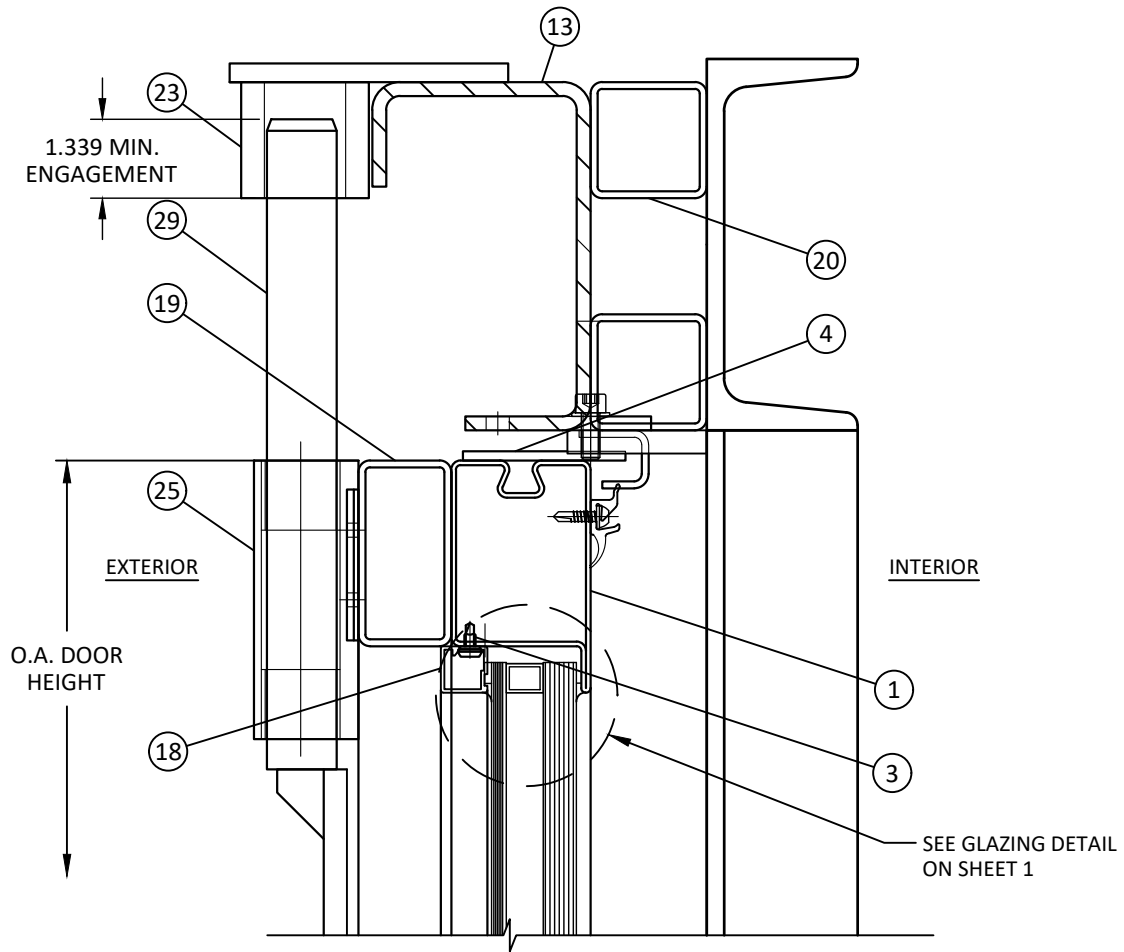

B
4 VERTICAL SECTION
TOP RAIL - HINGE

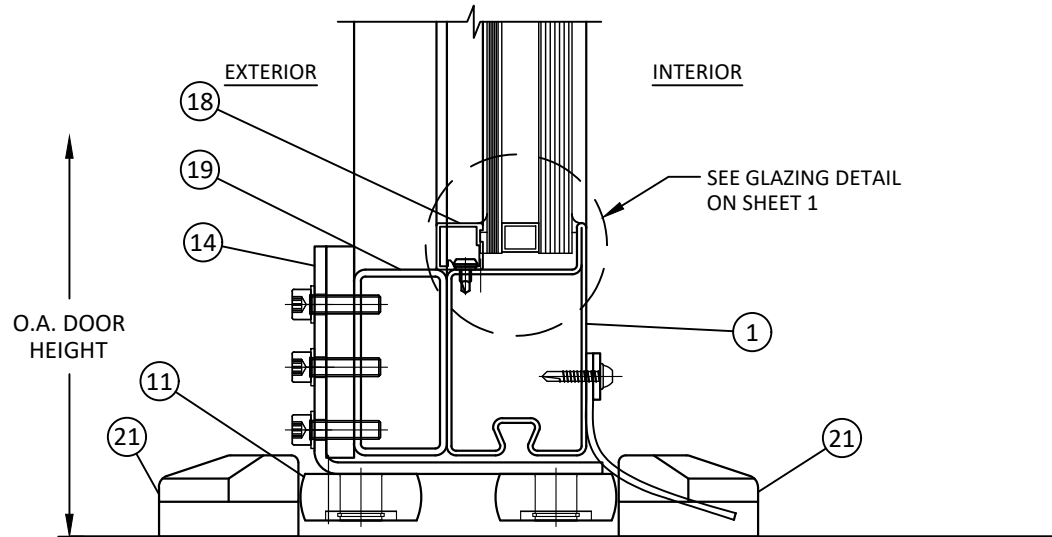

C
4 VERTICAL SECTION
BOTTOM RAIL - ASTRAGAL

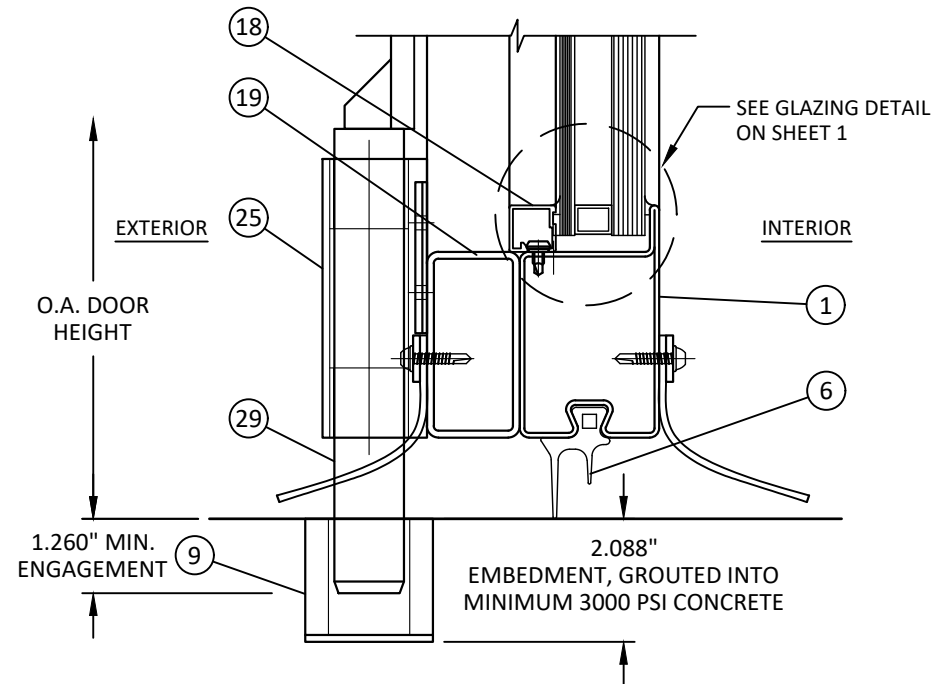

D
4 VERTICAL SECTION
BOTTOM RAIL - HINGE


bator®

BATOR NORTH AMERICA
1451 S ELM-EUGENE ST
GREENSBORO, NC 27406
PH: (336)907-2286 FAX: (336)907-2287

TITLE:
BATOR HURRICANE FOUR FOLD DOOR
STEEL BI-FOLDING DOOR ASSEMBLY


VERTICAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT

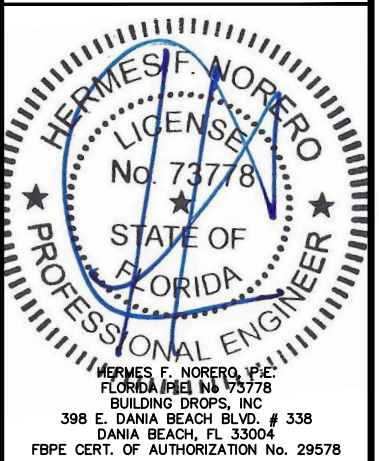

FL #:
FL28451

DATE: **10.31.18**

DWG. BY: **JA** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **BNA001**


SECTION:
4

12/3/2018 6:35 PM


s:\projects\bator north america\fbc-16-0934.1 industrial folding sliding door\dwg\bna001.dwg

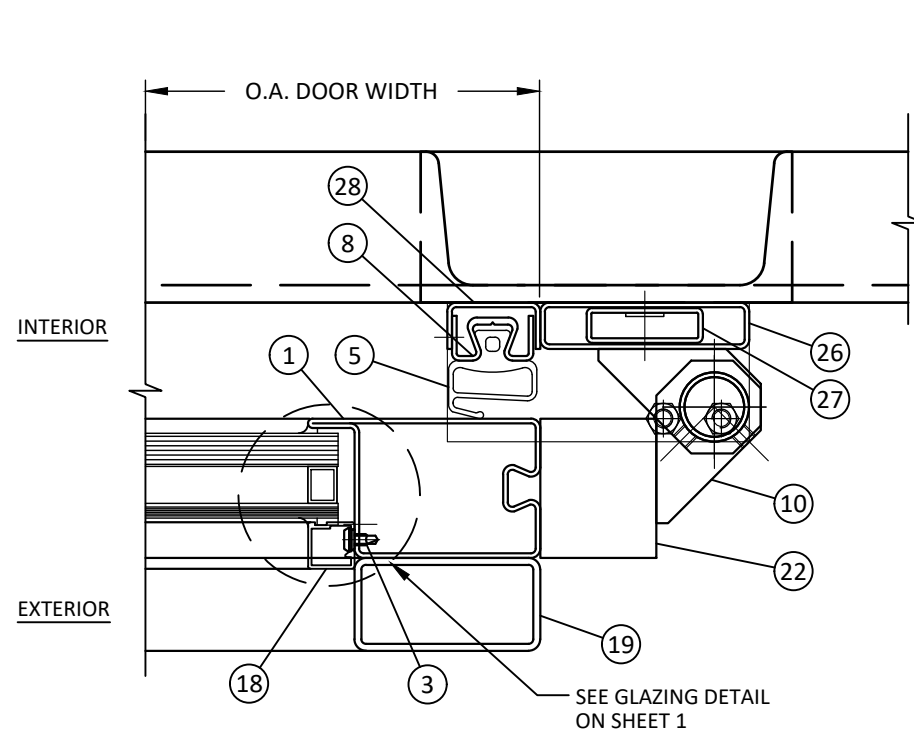

A HORIZONTAL SECTION
5 JAMB

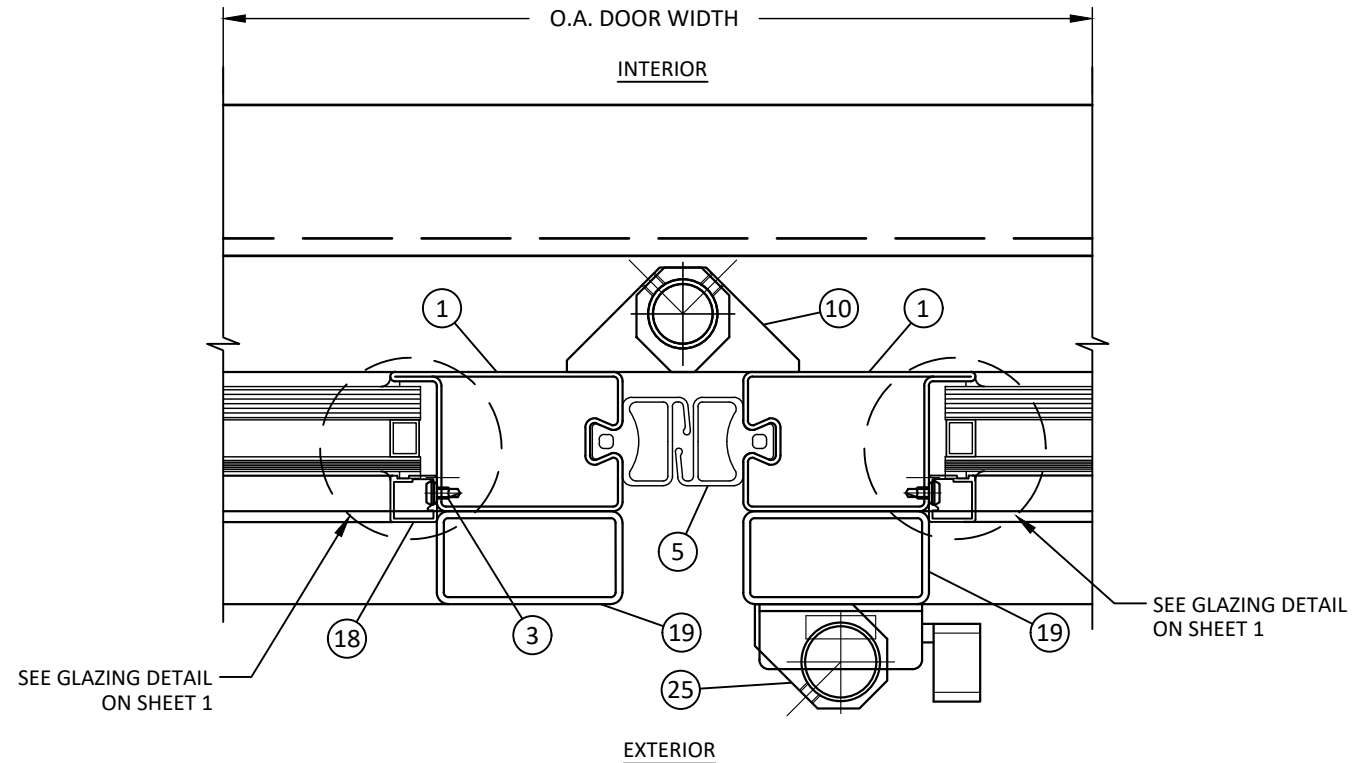

B HORIZONTAL SECTION
5 HINGE

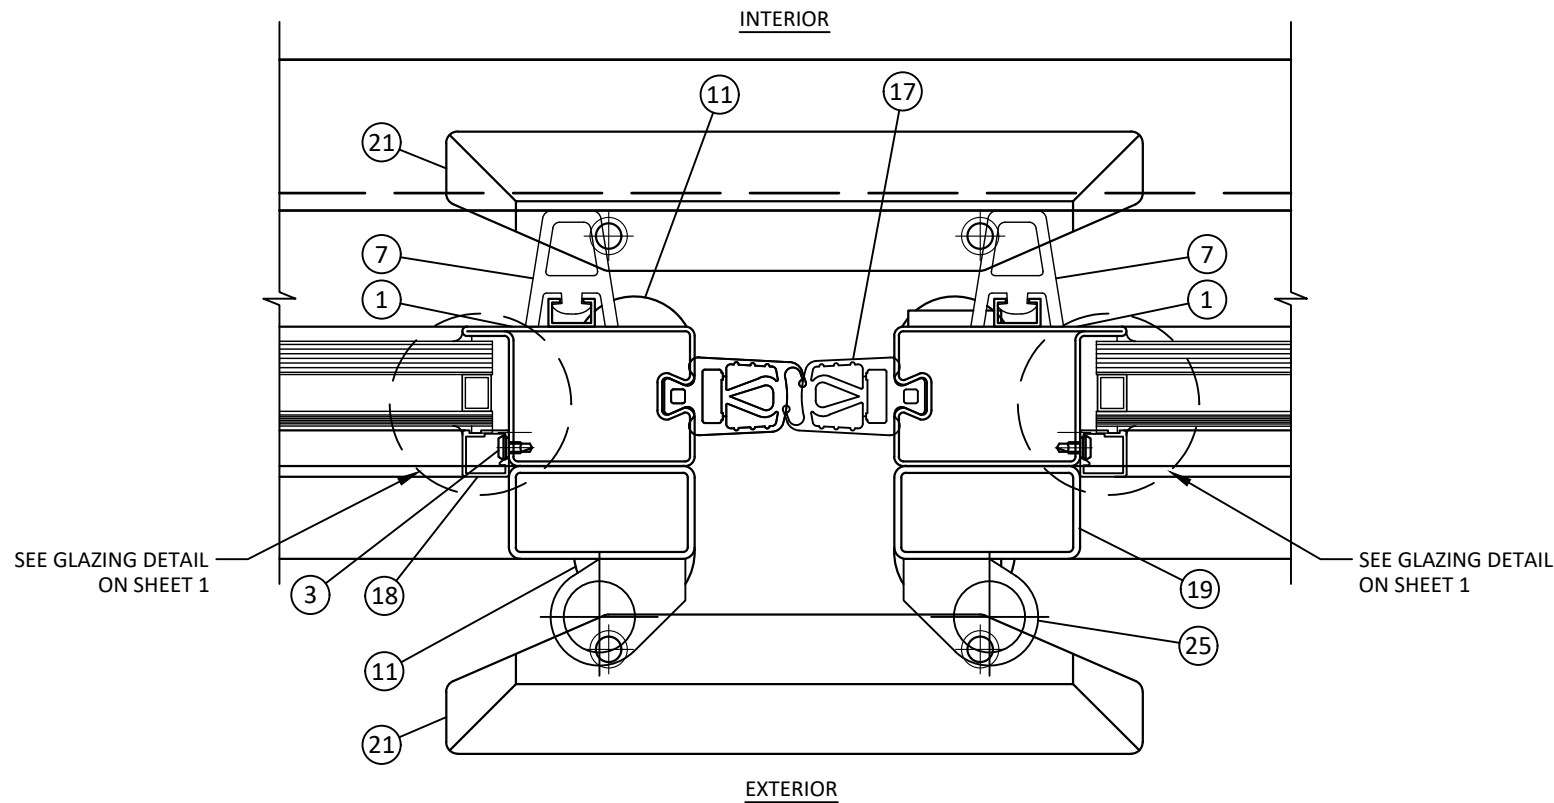

C HORIZONTAL SECTION
5 ASTRAGAL

bator®

BATOR NORTH AMERICA

1451 S ELM-EUGENE ST
GREENSBORO, NC 27406


PH: (336)907-2286 FAX: (336)907-2287

TITLE:
BATOR HURRICANE FOUR FOLD DOOR
STEEL BI-FOLDING DOOR ASSEMBLY

HORIZONTAL SECTIONS


PREPARED BY:
BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT

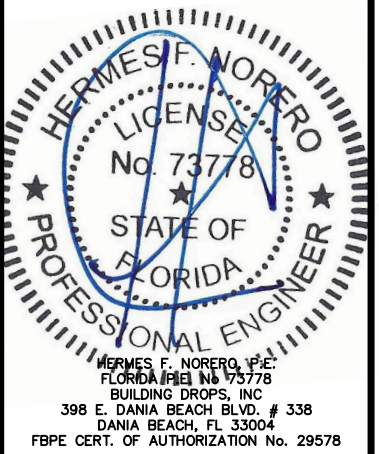

FL #: **FL28451**




DATE: **10.31.18**

DWG. BY: **JA** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **BNA001**

SECTION:
5

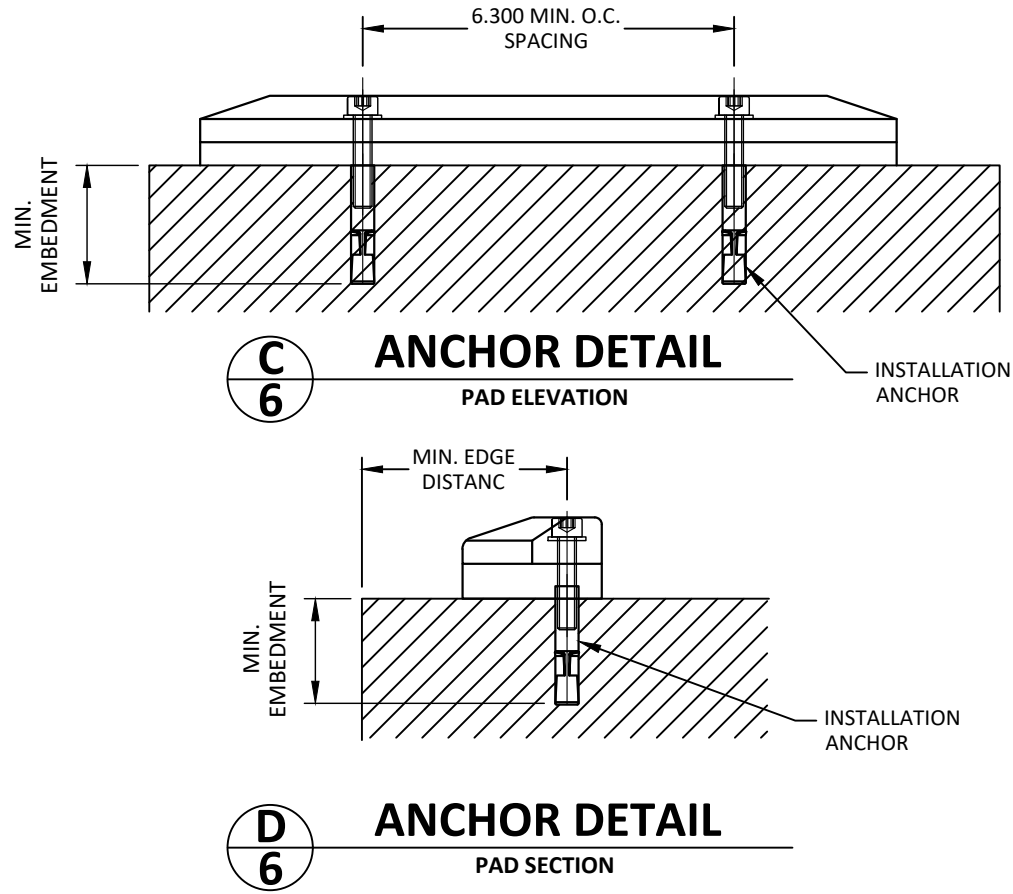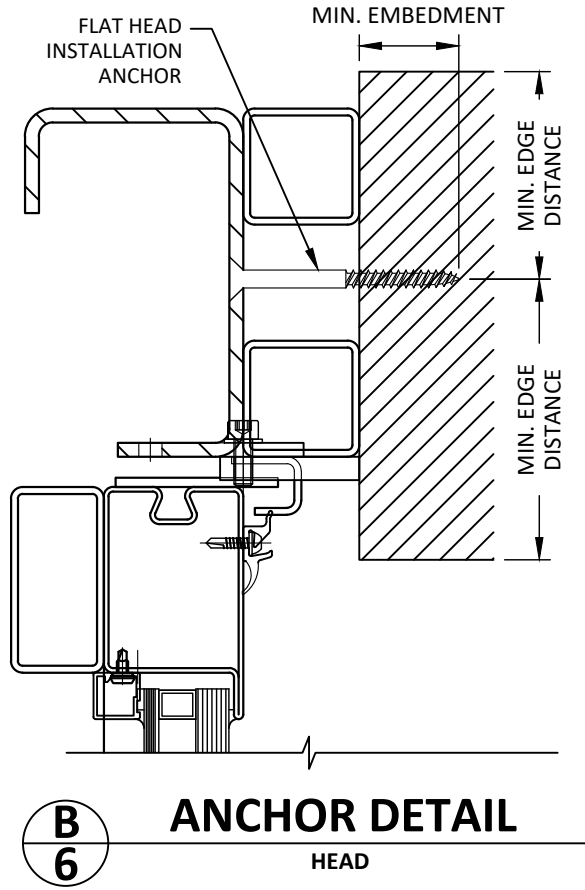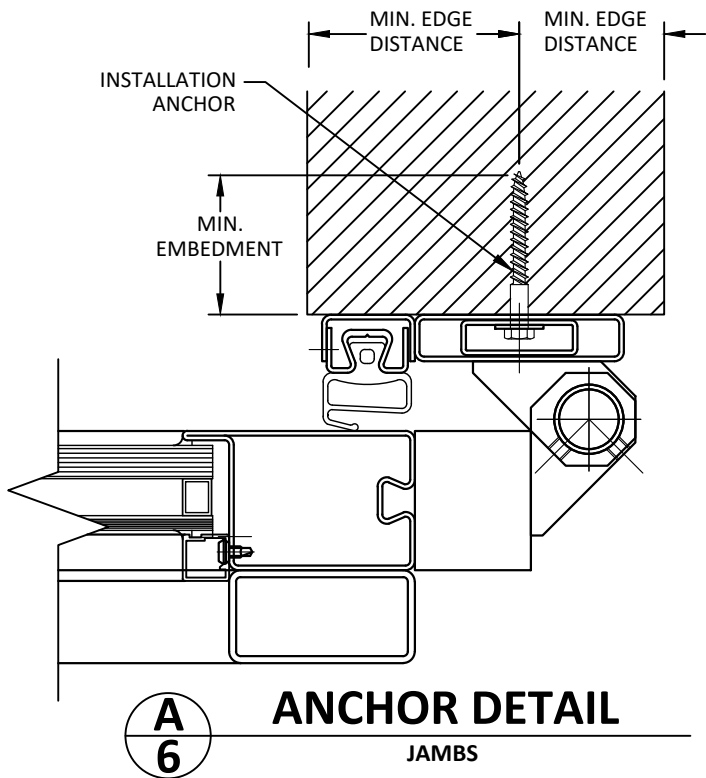

ANCHOR	SUBSTRATE	EMBEDMENT	EDGE DISTANCE
3/8" POWER-BOLT	3000 PSI CONCRETE	3-1/2"	3-3/4"
3/8" SELF DRILLING SCREW	1/4" THICK STEEL, MIN. FY = 33 KSI OR 3/8" THICK 6063-T5 ALUMINUM	3 THREADS MIN. PENETRATION BEYOND METAL	3/4"
3/8" LAG SCREW	SG = 0.55 WOOD	3"	1-1/2"

- ALL ANCHOR TYPES LISTED ABOVE VALID FOR MIN. SPECIFIED SUBSTRATE OR GREATER
- ANCHOR OPTION MUST MEET MINIMUM EMBEDMENT, EDGE DISTANCE SPECIFIED

ANCHOR TABLE A - HEADER

ANCHOR	SUBSTRATE	EMBEDMENT	EDGE DISTANCE
3/8" POWER-BOLT	3000 PSI CONCRETE	2"	3-3/4"
1/2" POWER-BOLT	1500 PSI GROUT-FILLED MASONRY	3"	7-7/8"
3/8" SELF-DRILLING SCREW	1/4" THICK STEEL, MIN. FY = 33 KSI OR 3/8" THICK 6063-T5 ALUMINUM	3 THREADS MIN. PENETRATION BEYOND METAL	3/4"
3/8" LAG SCREW	SG = 0.55 WOOD	3"	1-1/2"

- ALL ANCHOR TYPES LISTED ABOVE VALID FOR MIN. SPECIFIED SUBSTRATE OR GREATER
- ANCHOR OPTION MUST MEET MINIMUM EMBEDMENT, EDGE DISTANCE SPECIFIED

ANCHOR TABLE B - JAMB

ANCHOR	SUBSTRATE	EMBEDMENT	EDGE DISTANCE
1/2" POWER-BOLT	3000 PSI CONCRETE	2-1/2"	6"

- ALL ANCHOR TYPES LISTED ABOVE VALID FOR MIN. SPECIFIED SUBSTRATE OR GREATER
- ANCHOR OPTION MUST MEET MINIMUM EMBEDMENT, EDGE DISTANCE SPECIFIED

ANCHOR TABLE C - SILL

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN, UNLESS OTHERWISE STATED.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - A. WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - B. CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
 - C. MASONRY - STRENGTH CONFORMANCE TO ASTM C-90, HOLLOW BLOCK CMU MINIMUM COMPRESSIVE STRENGTH OF 1500 PSI.
 - D. A36 STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM WALL THICKNESS OF 1/4".
 - E. 6063-T5 ALUMINUM - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM WALL THICKNESS OF 3/8".

bator[®]

BATOR NORTH AMERICA
1451 S ELM-EUGENE ST
GREENSBORO, NC 27406
PH: (336)907-2286 FAX: (336)907-2287

TITLE:
BATOR HURRICANE FOUR FOLD DOOR
STEEL BI-FOLDING DOOR ASSEMBLY

INSTALLATION NOTES AND
ANCHOR DETAILS AND SCHEDULE


PREPARED BY:

BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT

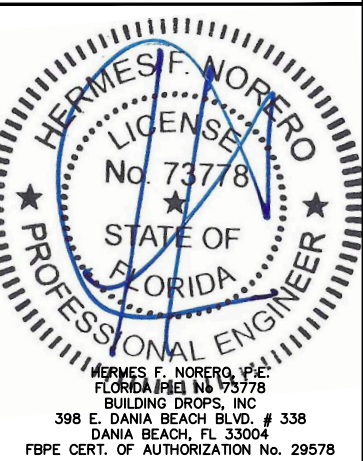

FL #:
FL28451

DATE: **10.31.18**

DWG. BY: **JA** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **BNA001**


SECTION:
6

BILL OF MATERIALS

ITEM NO.	DESCRIPTION	PART No.	MATERIAL	MANUFACTURER
1	BATOR FLANGE PROFILE	100155	A513 STEEL	WELSER AG
2	FLANGE PROFILE	100126	A513 STEEL	MÜLLER AG
3	STEEL BUTTON	102959	A513 STEEL	FORSTER PROFILSYSTEME AG
4	WELDED FLAT BAR	100566	A513 STEEL	MÜLLER AG
5	RUBBER SEAL PROFILE	100783	-	MOBIL WERKE AG
6	RUBBER SEAL PARALLEL SWORD PROFILE	100782	-	FLEVO RUBBER EXTRUSION B.V.
7	RUBBER PROFILE A-SHAPE	101539	-	MOBIL WERKE AG
8	RUBBER PROFILE	100366	-	-
9	PRECISION STEEL TUBE	100017	A513 STEEL	MÜLLER AG
10	HINGE 120 MSB	101228	-	BRÜGGER MECHANIK AG
11	ROLL (2" DIA.)	101377	-	CELLPACK AG
12	CHARIOT COMPL. RIGHT BR60	101356	-	BATOR AG
13	GUIDE BOX	100642	A513 STEEL	PROFIBLECH AG
14	3.78" X 3.86" X 0197" STEEL ANGLE	100411	A513 STEEL	MÜLLER AG
15	LOCK BAR LEFT HANDLE	101134	-	MTS METALLBAUBESCHLÄGE AG
16	LOCK BAR RIGHT HANDLE	101136	-	MTS METALLBAUBESCHLÄGE AG
17	RUBBER PROFILE ASFT+ST	100768	-	MOBIL WERKE AG
18	GLAZING BEAD	100336	ALUMINUM	ALUMINIUM-LAUFEN AG
19	1-9/16" X 3-5/32" STEEL TUBE	100173	S235 JR	MÜLLER AG
20	1-9/16" X 1-31/32" STEEL TUBE	100202	A513 STEEL	MÜLLER AG
21	PAD	100440 + 100425	-	MÜLLER AG
22	1.969" X 2.362" STEEL BAR	100569	A513 STEEL	MÜLLER AG
23	PRECISION STEEL TUBE WITH FLAT BAR	100017 + 100548	S235 JR	MÜLLER AG
24	LOCK BAR PAD	100926	PLASTIC	MÜLLER AG
25	HINGE 1.18" DIAMETER	101228	A513 STEEL	BRÜGGER MECHANIK AG
26	JAMB COMPONENT 1	-	E235 STEEL	-
27	JAMB COMPONENT 2	-	E235 STEEL	-
28	C SHAPE JAMB	-	-	-
29	LOCK BAR	100468 + 100443	A513 STEEL	BATOR AG


1

BATOR FLANGE PROFILE

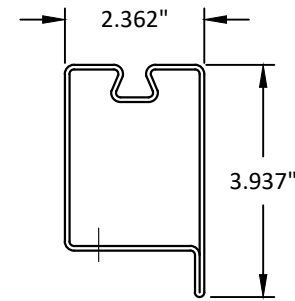


2

FLANGE PROFILE




3

STEEL BUTTON




4

WELDED FLAT BAR

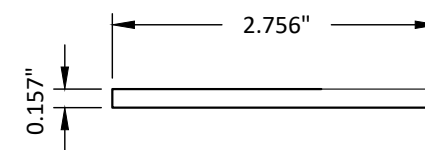


5

RUBBER SEAL PROFILE




6

RUBBER SEAL PARALLEL SWORD PROFILE




7

RUBER PROFILE A-SHAPE




8

RUBBER PROFILE

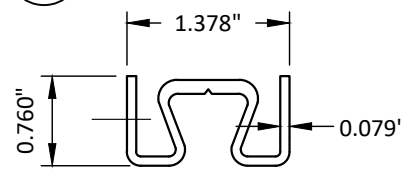


9

PRECISION STEEL TUBE FOR LOCK BAR




10

HINGE 120 MSB



11


ROLL DIA. 2.05"

**bator**®

BATOR NORTH AMERICA

1451 S ELM-EUGENE ST
GREENSBORO, NC 27406


PH: (336)907-2286 FAX: (336)907-2287

TITLE:
BATOR HURRICANE FOUR FOLD DOOR
STEEL BI-FOLDING DOOR ASSEMBLYBILL OF MATERIALS
& COMPONENTSPREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS

BY

DATE

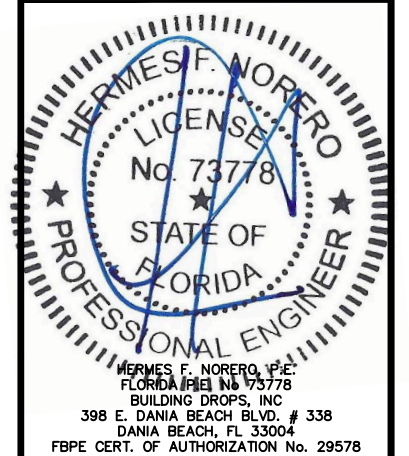THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT

FL #:


FL28451DATE: **10.31.18**DWG. BY:
JACHK. BY:
HFNSCALE: **NTS**DWG. #: **BNA001**

SECTION:


7

OF 8


12 101356 CHARIOT COMPL. RIGHT BR60

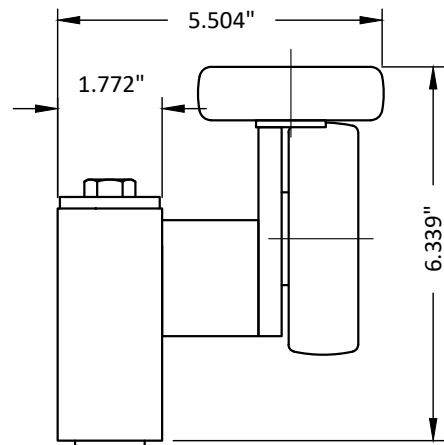


13 GUIDE BOX

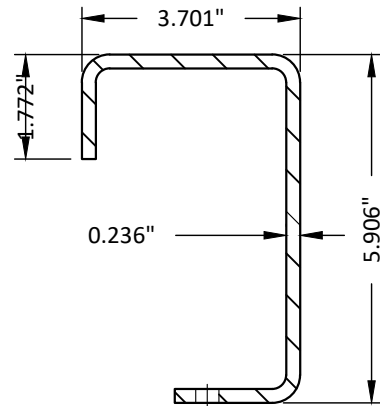


14 3.78" X 3.86" X 0.197" STEEL ANGLE

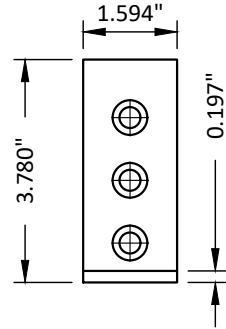


15 LOCK BAR LEFT HANDLE

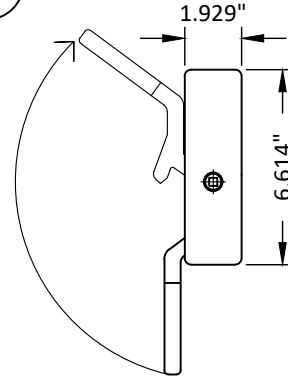


16 LOCK BAR RIGHT HANDLE

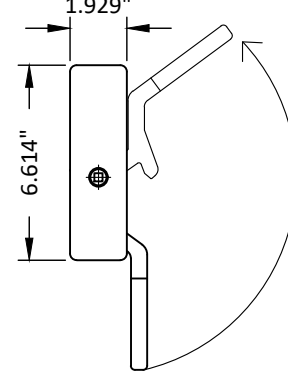


17 RUBBER PROFILE ASFT+ST FOR CONTACT SWITCH




18 GLAZING BEAD




19 STEEL TUBE 1-9/16" x 3-5/32"




20 STEEL TUBE 1-9/16" x 1-31/32"




21 PAD

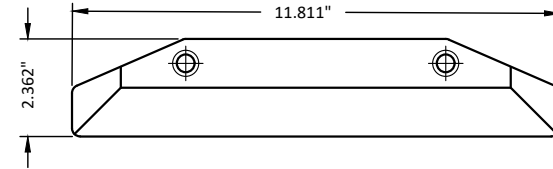


22 STEEL BAR




23 PRECISION STEEL TUBE

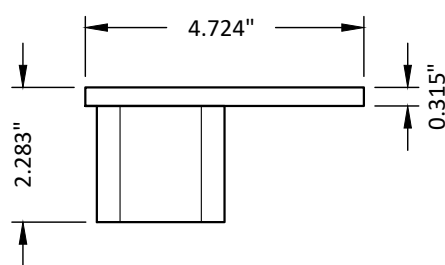


24 LOCK BAR PAD




25 LOCK BAR PAD

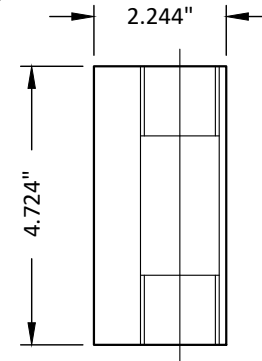


26 JAMB COMPONENT 1



27 JAMB COMPONENT 1



28 C SHAPE JAMB




bator®

BATOR NORTH AMERICA
1451 S ELM-EUGENE ST
GREENSBORO, NC 27406
PH: (336)907-2286 FAX: (336)907-2287

TITLE: BATOR HURRICANE FOUR FOLD DOOR
STEEL BI-FOLDING DOOR ASSEMBLY


COMPONENTS

PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

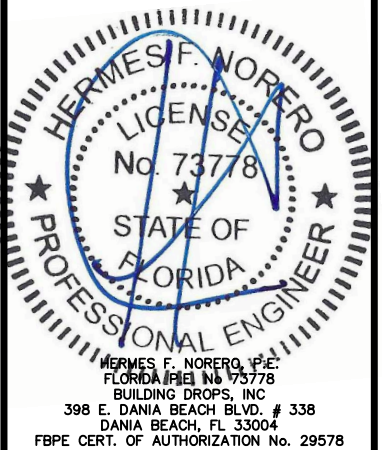

FL #: **FL28451**

DATE: **10.31.18**

DWG. BY: **JA** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **BNA001**

SECTION: