

c:\users\harley\pant\building drops, inc\building drops, inc\projects\arcadia custom\2026 code change\dwgs\128911\acwd004-b.dwg 9/17/2026 11:56 AM

ARCADIA CUSTOM

TSX3000 CASEMENT WINDOW


(WZ3)(IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-11
 - ASTM E1886-13a
 - ASTM E1996-23
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN WIND ZONES 3 OR LESS.
6. APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN WIND ZONE 4.
7. FRAME MATERIAL: STAINLESS STEEL
8. GLASS MEETS THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAIL.

MAX OVERALL SIZE	DESIGN PRESSURE	MISSILE IMPACT RATING
SEE PRESSURE TABLE ON PAGE 2	SEE PRESSURE TABLE ON PAGE 2	LMI

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES & GLAZING DETAIL
2	ELEVATION & ANCHOR LAYOUT
3	VERTICAL SECTIONS
4	HORIZONTAL SECTIONS
5	INSTALLATION NOTES, ANCHOR DETAILS & SCHEDULE

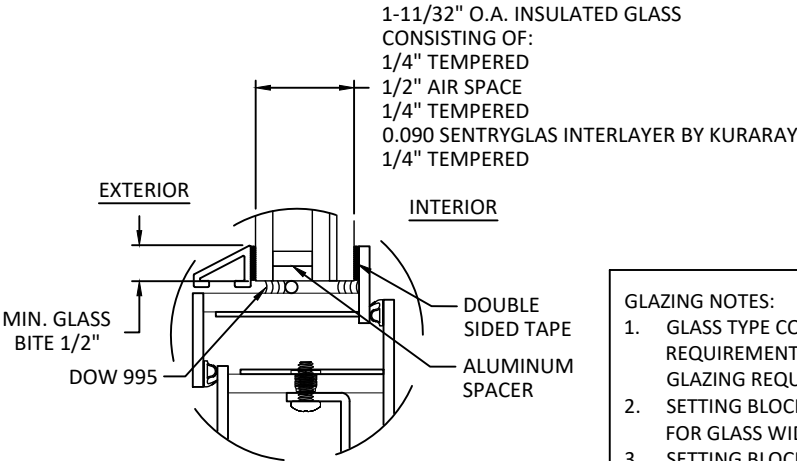

- GLAZING NOTES:
1. GLASS TYPE COMPLIES WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC.
2. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
3. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.



ARCADIA CUSTOM
9280 E OLD VAIL RD,
TUCSON, AZ 85747
PH: (520) 284-2061 FX: (520) 349-1964

TITLE:
TSX3000 CASEMENT WINDOW
(WZ3)(IMPACT)

GENERAL NOTES & GLAZING DETAIL


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
ANCHOR UPDATE	MG	6.20.23
2026 CODE CHANGE	HJ	3.7.26

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.10.05 17:53:59 -07'00'

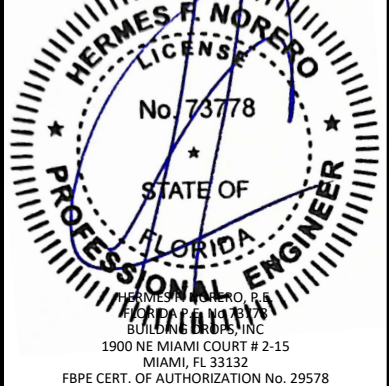

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI COURT # 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL#:
FL28911

DATE: **02.15.19**

DWG. BY: **EG** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **ACWD004**

SHEET:
1


REV. **B**

OF 5


c:\users\harley\pant\building drops, inc\building drops landing - common\projects\arcadia custom\cc-26-0126 - 2026 code change\dwgs\arcadia custom\cc-26-0126 - 2026 code change\dwgs\128911\acwd004-b.dwg 9/17/2026 11:56 AM

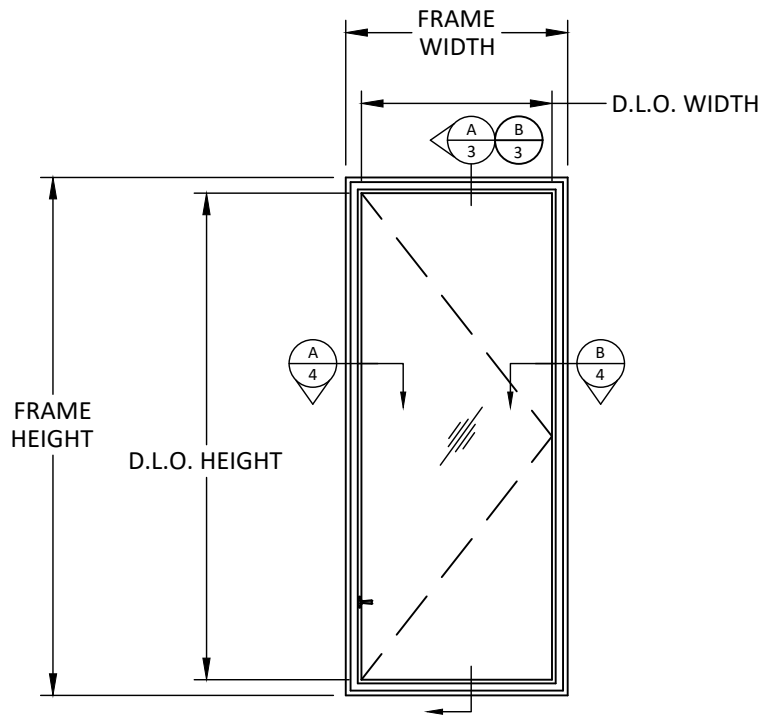

ELEVATION
CASEMENT WINDOW
EXTERIOR VIEW

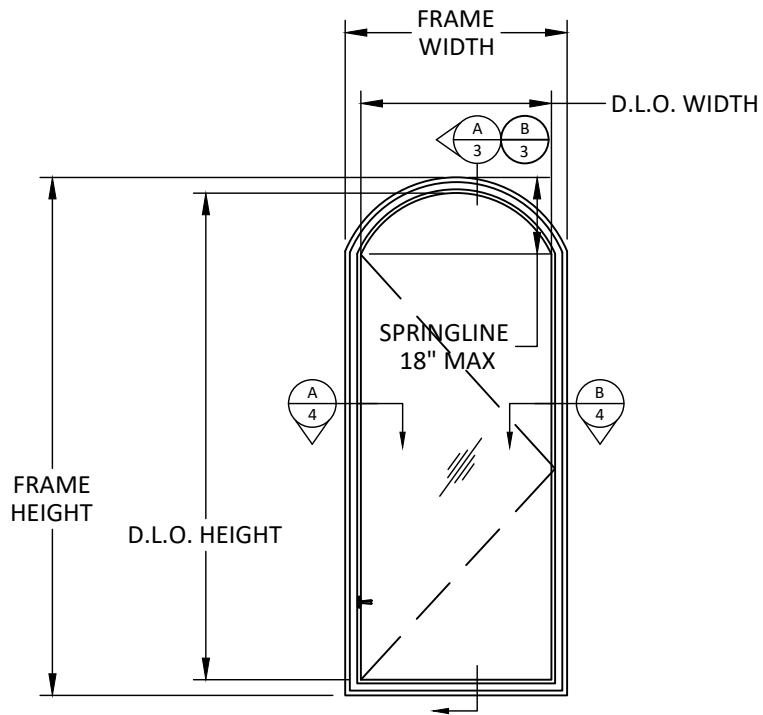

ELEVATION
CASEMENT FLAT TOP ARCH WINDOW
EXTERIOR VIEW

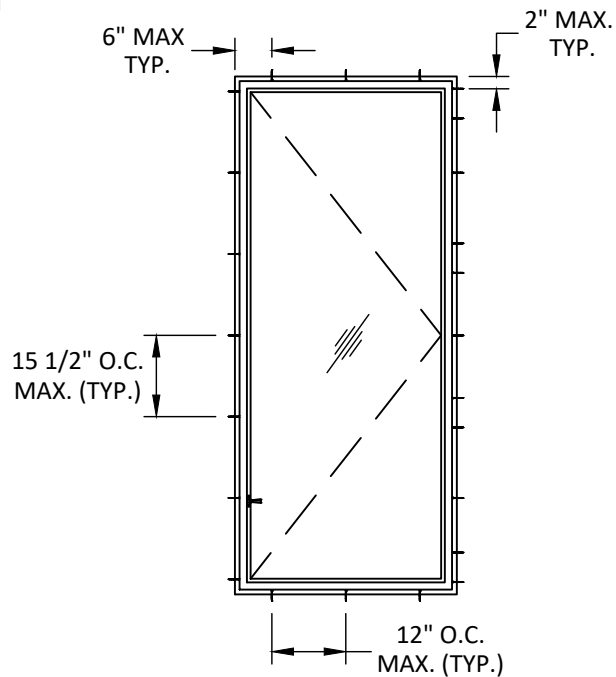

ANCHOR LAYOUT(TYP.)
CLIP/THROUGH FRAME

NOTE:

DLO HEIGHT = FRAME HEIGHT - 5.125"
DLO WIDTH = FRAME WIDTH - 5.0625"

DESIGN PRESSURE TABLE (PSF)							
FRAME WIDTH (INCHES)							
FRAME HEIGHT (INCHES)		18	24	30	36	42	48
	36	50.0	50.0	50.0	50.0	50.0	50.0
	42	50.0	50.0	50.0	50.0	42.9	42.9
	48	50.0	50.0	50.0	50.0	42.9	37.5
	54	50.0	50.0	50.0	50.0	42.9	37.5
	60	50.0	50.0	50.0	50.0	42.9	37.5
	66	50.0	50.0	50.0	50.0	42.9	
	72	50.0	50.0	50.0	50.0	42.9	
	78	50.0	50.0	50.0	50.0		
	84.1875	50.0	50.0	50.0	50.0		
	90	50.0	50.0	50.0			
	96	50.0	50.0	50.0			
	102	50.0	50.0				
	108	50.0	50.0				
	114	50.0	50.0				



ARCADIA CUSTOM
9280 E OLD VAIL RD,
TUCSON, AZ 85747

PH: (520) 284-2061 FX: (520) 349-1964

TITLE: TSX3000 CASEMENT WINDOW
(WZ3)(IMPACT)
ELEVATION AND ANCHOR LAYOUT

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
ANCHOR UPDATE	MG	6.20.23
2026 CODE CHANGE	HJ	3.7.26

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL#: **FL28911**

DATE: **02.15.19**

DWG. BY: EG	CHK. BY: HFN
-----------------------	------------------------


SCALE: **NTS**

DWG. #: **ACWD004**

SHEET: 2	REV. B
--------------------	------------------

OF 5


c:\users\harley\pant\building drops, inc.\building drops\landing - common\projects\arcadia custom\cc-26-0126 - 2026 code change\dwgs\128911\acwd004-b.dwg 9/17/2026 11:57 AM

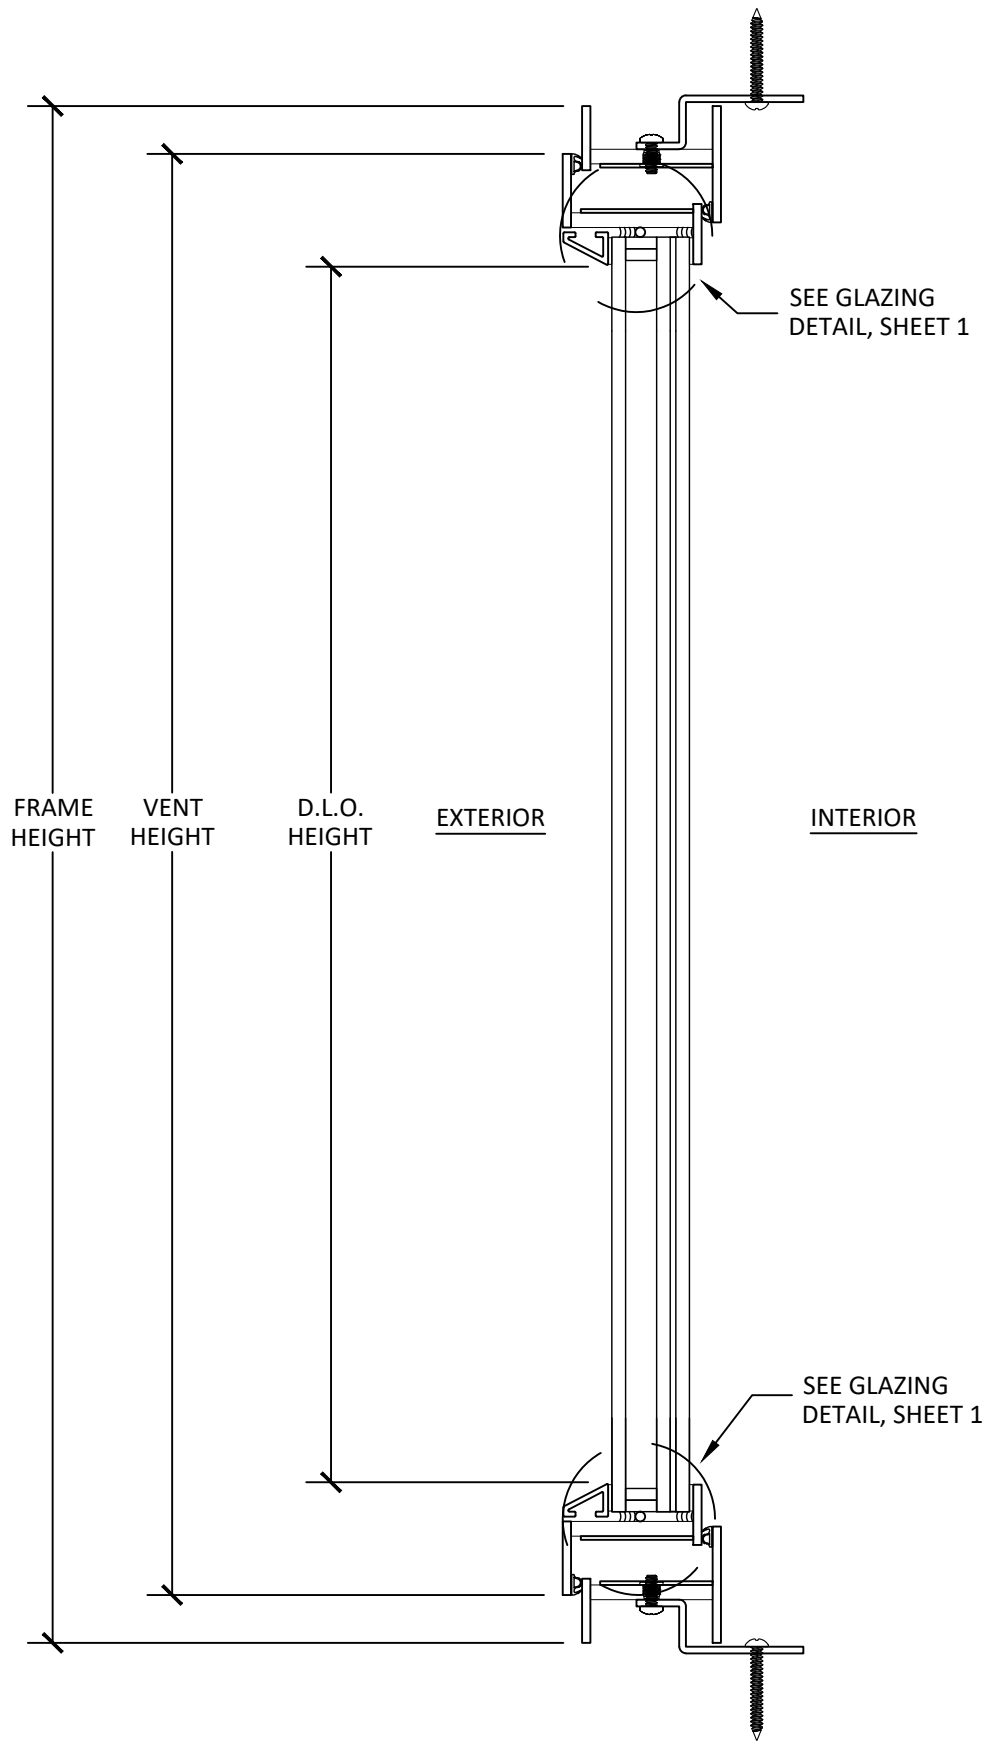

A
3

VERTICAL SECTION

CASEMENT - CLIP

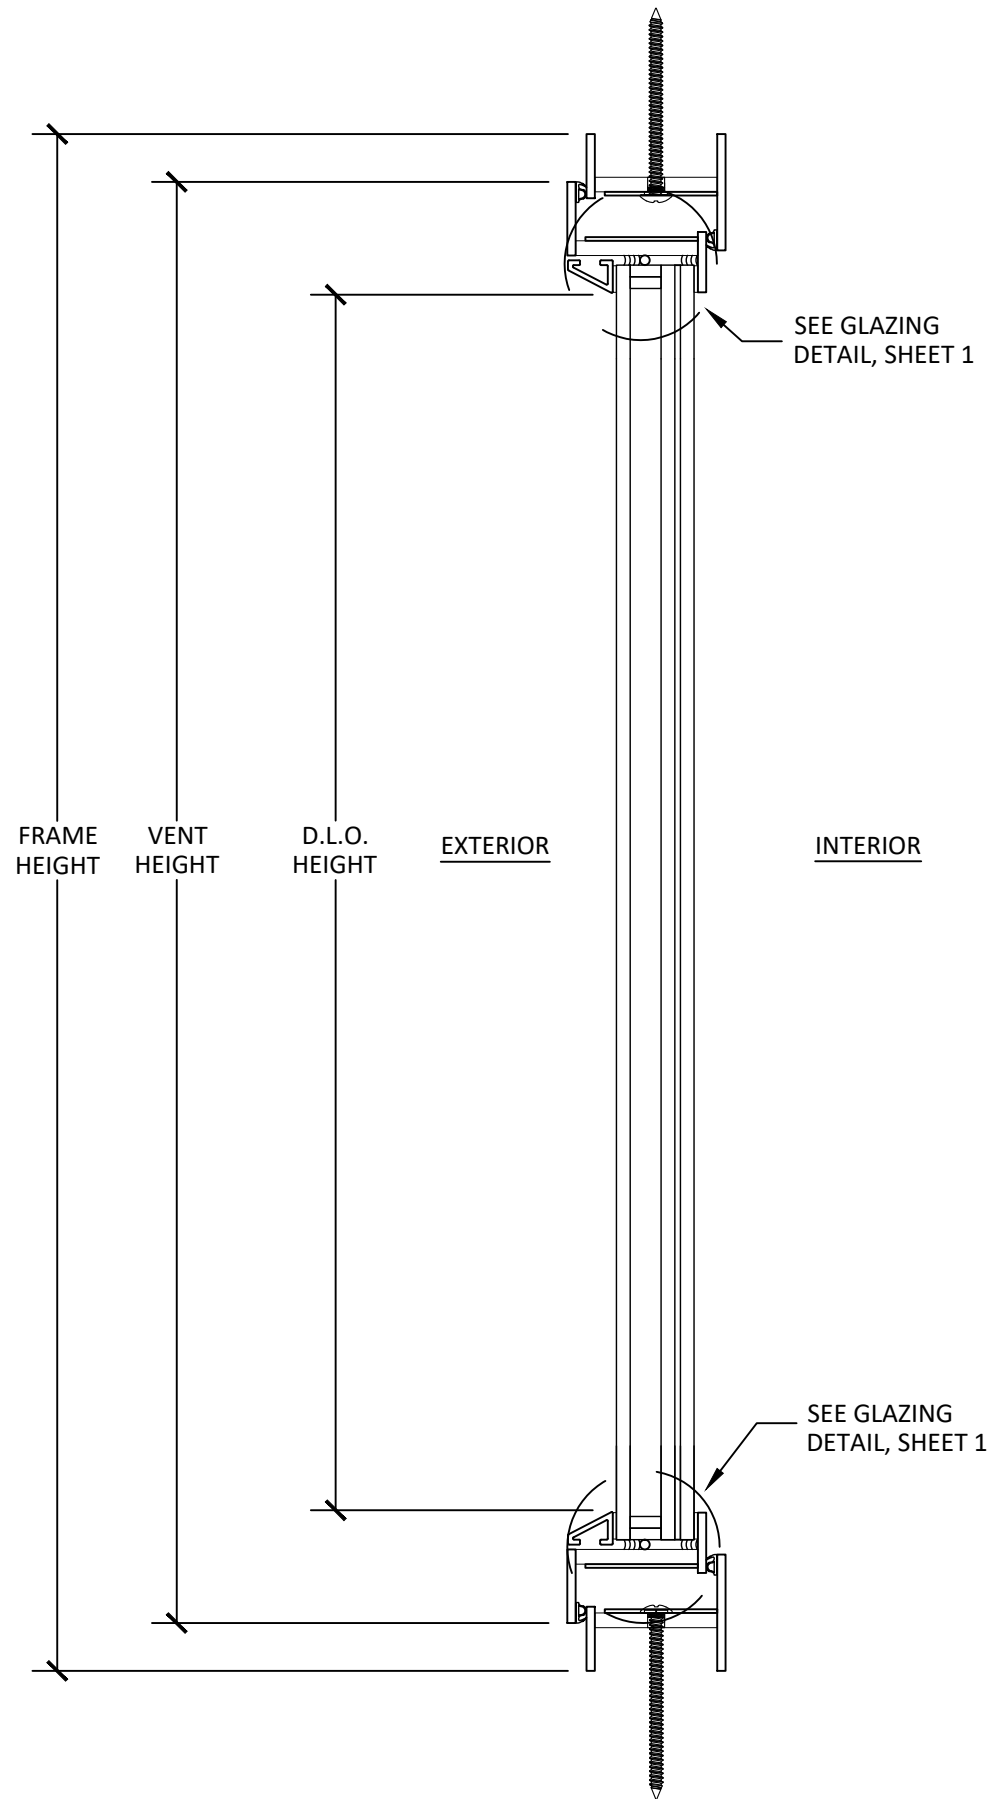

B
3

VERTICAL SECTION

CASEMENT - THROUGH FRAME



ARCADIA CUSTOM
9280 E OLD VAIL RD,
TUCSON, AZ 85747

PH: (520) 284-2061 FX: (520) 349-1964

TITLE: TSX3000 CASEMENT WINDOW
(WZ3)(IMPACT)

VERTICAL SECTIONS


PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132

PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
ANCHOR UPDATE	MG	6.20.23
2026 CODE CHANGE	HJ	3.7.26

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

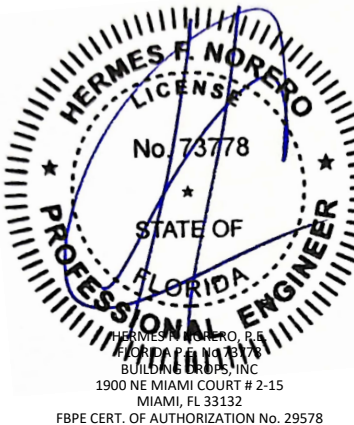

FL#:

FL28911

DATE: 02.15.19

DWG. BY: EG

CHK. BY: HFN

SCALE: NTS

DWG. #: ACWD004

SHEET:


REV.

3

B

OF 5

c:\users\harley\pant\building drops, inc\building drops landing - common\projects\arcadia custom\2026 code change projects\arcadia custom\cc-26-0126 - 2026 code change\dwgs\128911\acwd004-b.dwg 9/17/2026 11:57 AM

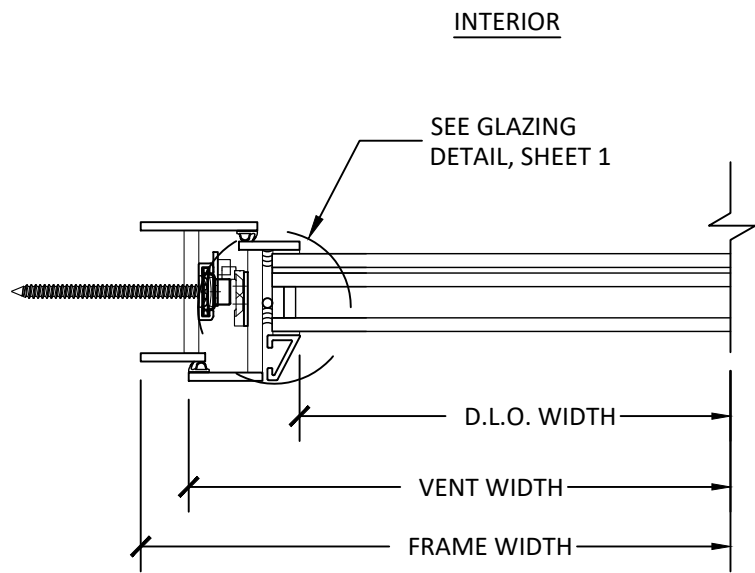


EXTERIOR

A
4

HORIZONTAL SECTION

CASEMENT JAMB - THROUGH FRAME

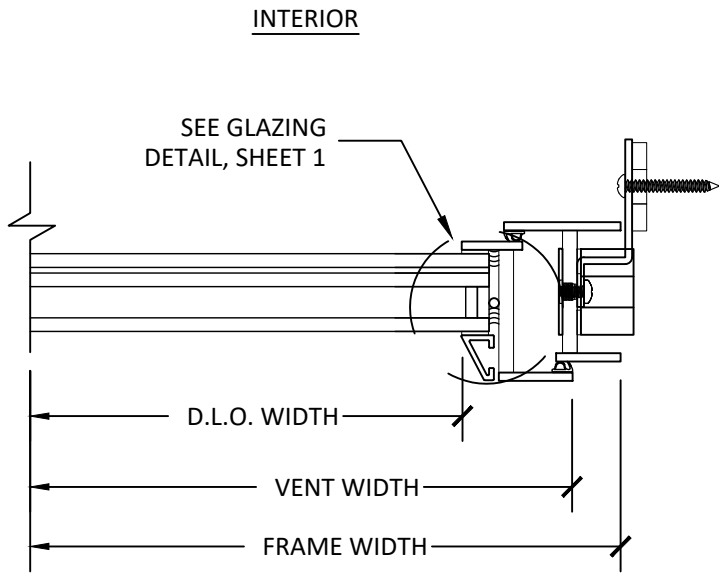

EXTERIOR

B
4

HORIZONTAL SECTION

CASEMENT JAMB - CLIP



ARCADIA CUSTOM
9280 E OLD VAIL RD,
TUCSON, AZ 85747

PH: (520) 284-2061 FX: (520) 349-1964

TITLE: TSX3000 CASEMENT WINDOW
(WZ3)(IMPACT)

HORIZONTAL SECTIONS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15

MIAMI, FL 33132

PH: (954) 399-8478

FAX: (954) 744-4738

WEB: www.buildingdrops.com





REMARKS	BY	DATE
ANCHOR UPDATE	MG	6.20.23
2026 CODE CHANGE	HJ	3.7.26

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL#:	FL28911
DATE:	02.15.19
DWG. BY:	CHK. BY:
EG	HFN
SCALE:	NTS
DWG. #:	ACWD004
SHEET:	REV.
4	B
OF 5	

c:\users\harley\pant\building drops, inc\building drops landing - common\projects\arcadia custom\cc-26-0126 - 2026 code change\dwgs\128911\acwd004-b.dwg 9/17/2026 11:57 AM

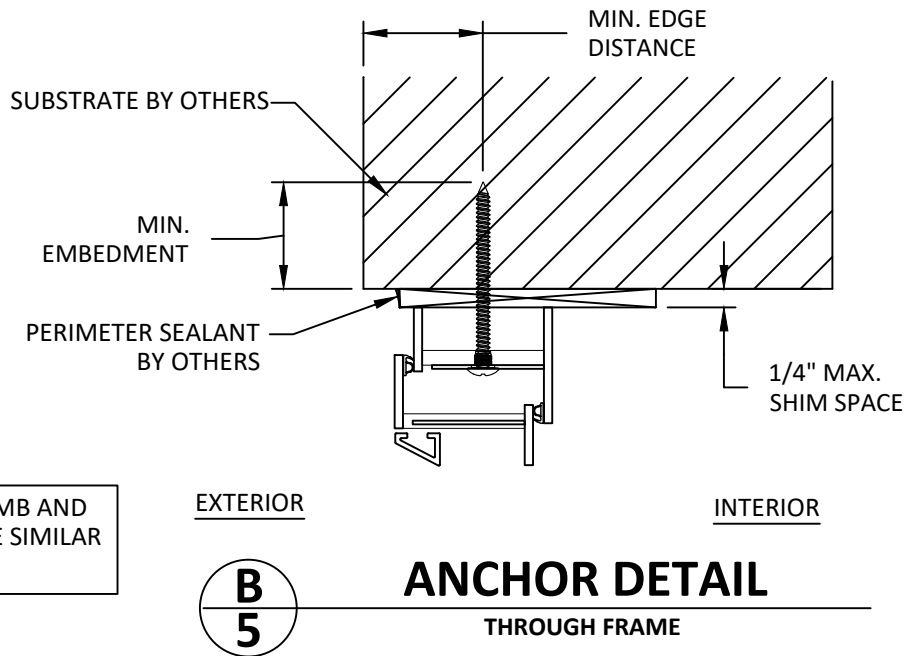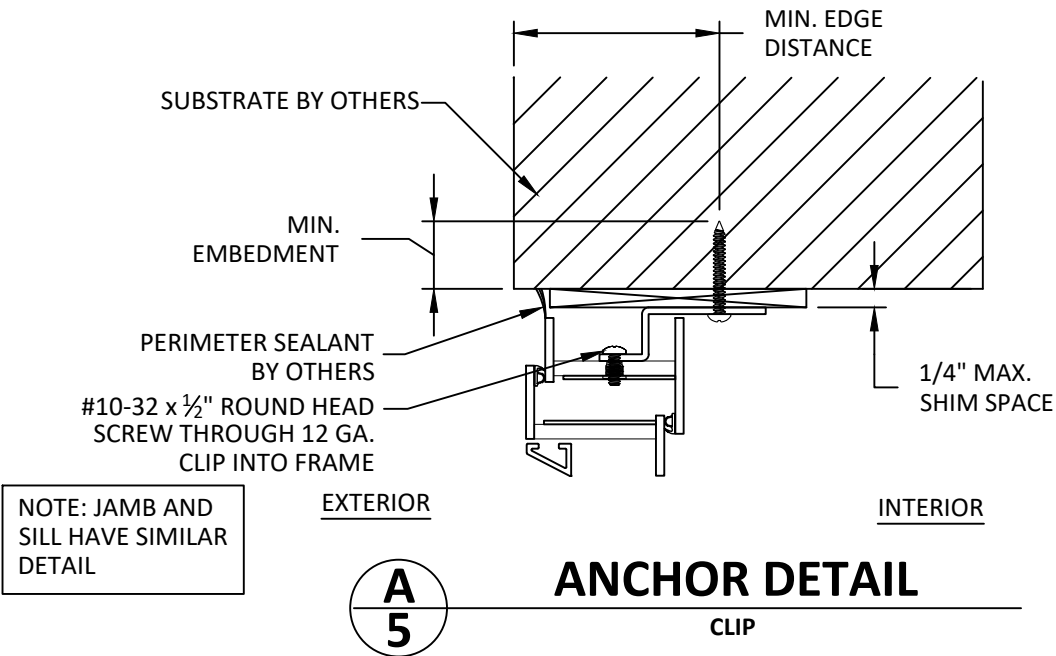

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN ON SHEET 2.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/4$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
 - FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).
 - CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE					
METHOD	SUBSTRATE	ANCHOR SCHEDULE	MIN EMBEDMENT	MIN. EDGE DISTANCE	QUANTITY PER LOCATION
THROUGH FRAME	WOOD: MIN. SG = 0.55	#12 WOOD SCREW	1.50"	0.75"	1
	METAL: STEEL 18 GA. MIN. Fy = 33KSI, ALUMINUM 1/8" MIN. 6063-T5	#12 TEK SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.50"	1
	CONCRETE: MIN. f'c = 3000 PSI	3/16" ITW TAPCON	1.25"	2.5"	1
	MASONRY: CMU MIN. 2000 PSI		1.25"	2.5"	1
CLIP	WOOD: MIN. SG = 0.55	#12 WOOD SCREW	1.50"	0.75"	1
	METAL: STEEL 18 GA. MIN. Fy = 33KSI, ALUMINUM 1/8" MIN. 6063-T5	#12 TEK SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.50"	1
	CONCRETE: MIN. f'c = 3000 PSI	3/16" ITW TAPCON	1.25"	2.5"	1
	MASONRY: CMU MIN. 2000 PSI		1.00"	2.5"	1



ARCADIA CUSTOM
9280 E OLD VAIL RD,
TUCSON, AZ 85747

PH: (520) 284-2061 FX: (520) 349-1964

TITLE: TSX3000 CASEMENT WINDOW
(WZ3)(IMPACT)

INSTALLATION NOTES, ANCHOR DETAILS
AND SCHEDULE

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15

MIAMI, FL 33132

PH: (954) 399-8478

FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
ANCHOR UPDATE	MG	6.20.23
2026 CODE CHANGE	HJ	3.7.26

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL#:

FL28911

DATE: 02.15.19

DWG. BY:
EG

CHK. BY:
HFN

SCALE: NTS

DWG. #: ACWD004

SHEET:

5

REV.

B

OF 5