


AIR-LUX TECHNIK AG

SERIES 173 WINDOW WALL

(WZ3) (IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), EXCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
 - AAMA/WDMA/CSA 101/I.S.2/A440-11
 - ASTM E1886-13a
 - ASTM E1996-17
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN WIND ZONES 3 OR LESS.
6. APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN WIND ZONE 4.
7. FRAME MATERIAL: ALUMINUM 6063-T5
8. ALL STRUCTURAL MATERIALS & DISSIMILAR METALS SHALL BE PROTECTED, TREATED, PAINTED, COATED, AND/OR ISOLATED AS REQUIRED IN THE APPLICABLE SECTIONS OF THE CURRENT FLORIDA BUILDING CODE AND REFERENCED DESIGN SPECIFICATIONS.

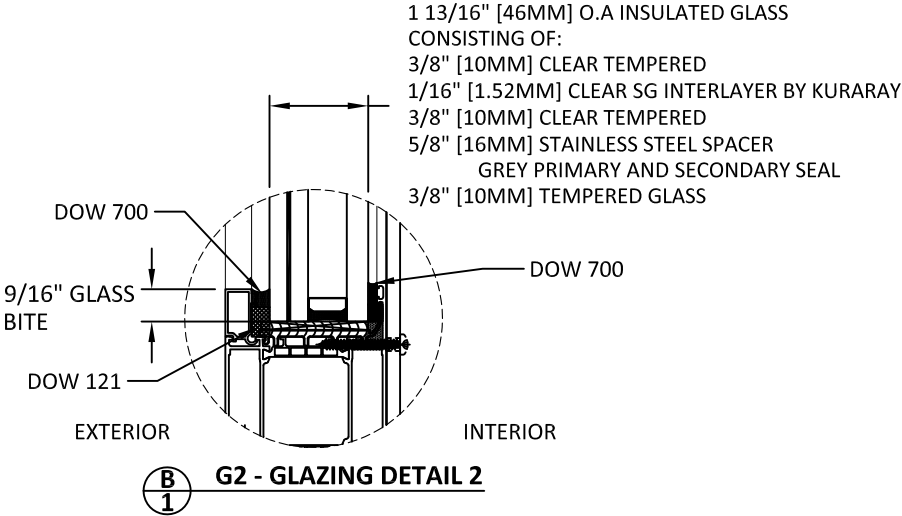

- GLAZING NOTES:
1. GLASS TYPE COMPLIES WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.

2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.

3. TWO APPROVED SETTING BLOCKS SHALL BE USED FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.

4. D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES IN SIZE CHARTS.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES, TABLE OF CONTENTS & GLAZING DETAILS
2	ELEVATION AND ANCHORS LAYOUT
3	ELEVATION AND ANCHORS LAYOUT
4	VERTICAL SECTIONS
5	HORIZONTAL SECTIONS
6	HORIZONTAL SECTIONS
7	ANCHOR DETAILS, SCHEDULE & INSTALLATION NOTES
8	COMPONENTS AND BILL OF MATERIALS (SCREWS AND JOINTS)

MISSILE IMPACT RATING	DESIGN PRESSURE
LMI & SMI RATED	SEE SHEETS 2 AND 3 FOR DESIGN PRESSURE LIMITATIONS

air-lux®

AIR-LUX TECHNIK AG
BREITSCHACHENSTRASSE 52
9032 ENGELBURG/SG
SWITZERLAND
PH: +41 71 272 2600 FX: +41 71 272 2601

TITLE:

AIR-LUX SERIES 173
WINDOW WALL (WZ3) (IMPACT)

GENERAL NOTES, TABLE OF
CONTENTS & GLAZING DETAILS

PREPARED BY:


BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2020 FBC UPDATE	MS	11/20
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.09.19 10:54:17 -0400'

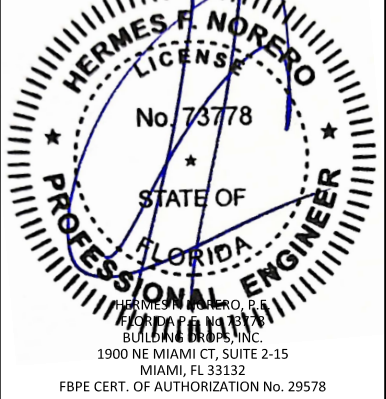

HERMES F. NORERO, P.E.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL29500

DATE:
04.09.19

DWG. BY:
RV

CHK. BY:
HFN

SCALE:
NTS


DWG. #:
ALT004

SHEET:
1


REV.
B

OF 8

c:\users\sebastianherrerros\building drops, inc\building drops landing - common\projects\2026 code change projects\air-lux technik ag\cc-26-04801 - 2026 code change\dwgs\fl29500-r2\alt004-b.dwg 9/10/2026 4:29 PM

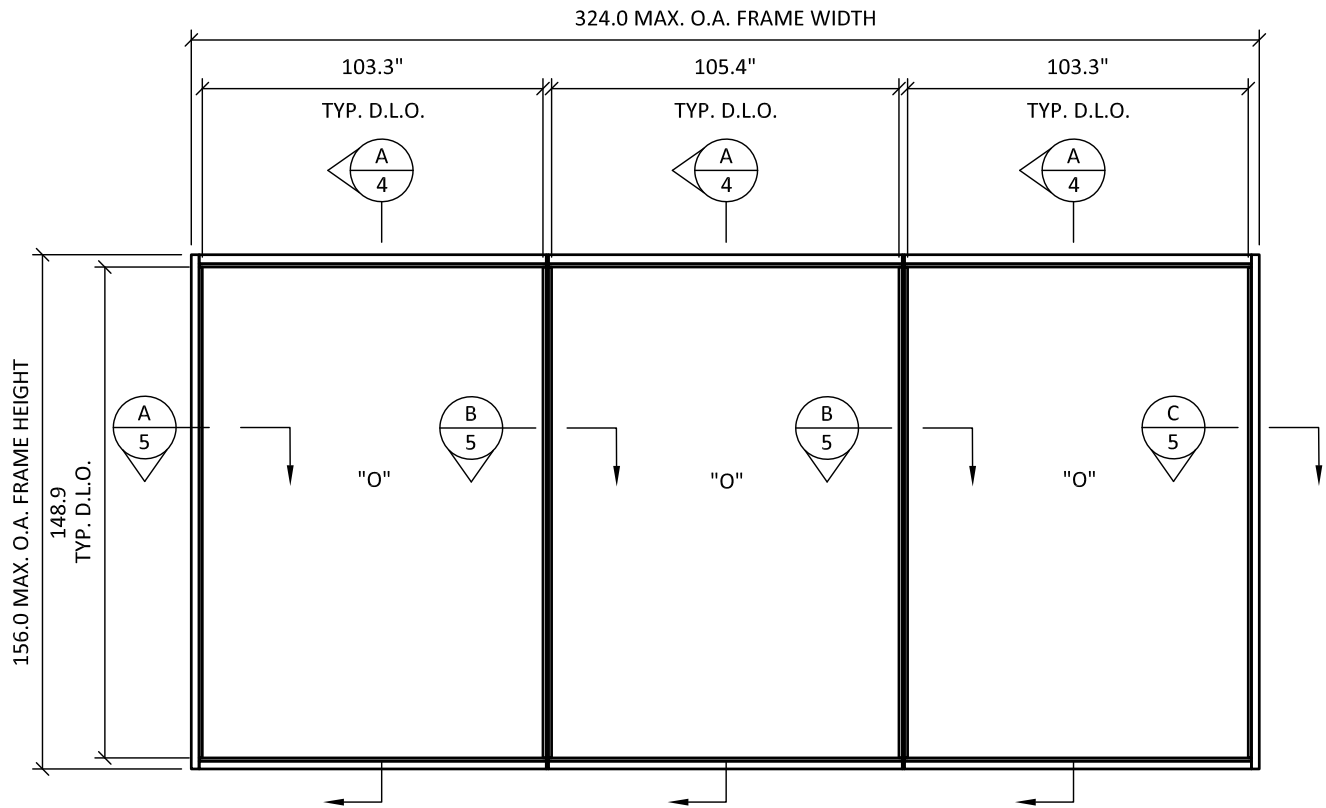

ELEVATION
WINDOW WALL

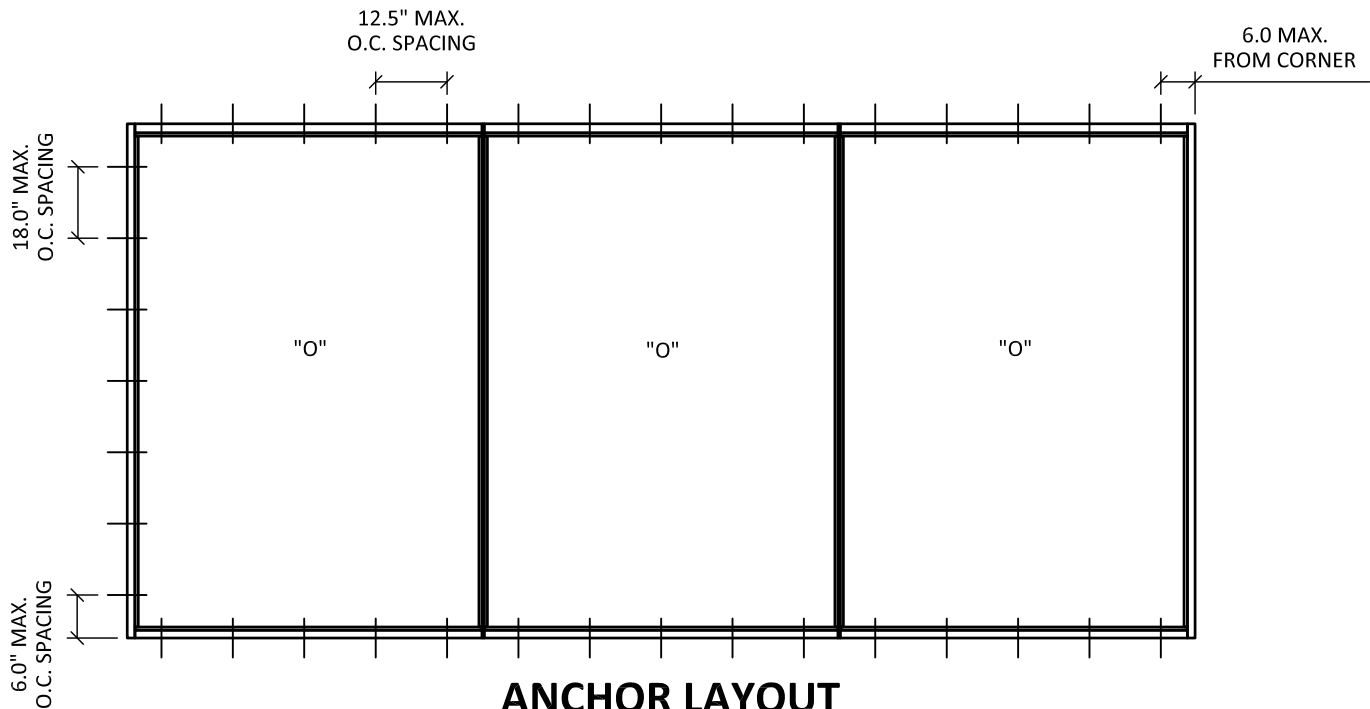

ANCHOR LAYOUT
THROUGH FRAME

DESIGN PRESSURE TABLE - WINDOW WALL WITH STEEL REINFORCEMENT																		
PANEL WIDTH (INCHES)																		
FRAME HEIGHT (INCHES)		24	30	36	42	48	54	60	66	72	78	84	90	96	102	108	114	120
	24	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0
	36	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0
	48	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0
	60	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0
	72	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0
	84	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	49.5
	96	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	48.6
	108	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	47.5
	120	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	47.4
	132	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	47.4
	144	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	47.4
	156	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	
	168	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	49.5	46.6	44.2	42.1			
168	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	46.0	42.6	39.8	37.4	35.4					

- QUALIFIED CONFIGURATIONS:
1. TYPICAL ELEVATIONS ARE SHOWN. SYSTEM IS QUALIFIED FOR CONFIGURATIONS NOT EXCEEDING THE PANEL SIZES SHOWN IN THE ABOVE TABLE, USING UNLIMITED PANELS.
 2. OPERABLE PANELS ARE LOCATED ON EXTERIOR TRACK. FIXED PANELS ON INTERIOR TRACK.
 3. MOTORIZATION IS OUTSIDE THE SCOPE OF THIS APPROVAL.
 4. ALL CONFIGURATIONS ARE RATED FOR AIR AND WATER INFILTRATION REQUIREMENTS.

air-lux®

AIR-LUX TECHNIK AG
BREITSCHACHENSTRASSE 52
9032 ENGELBURG/SG
SWITZERLAND
PH: +41 71 272 2600 FX: +41 71 272 2601


TITLE: AIR-LUX SERIES 173
WINDOW WALL (WZ3) (IMPACT)
ELEVATIONS AND
ANCHORS LAYOUT

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2020 FBC UPDATE	MS	11/20
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

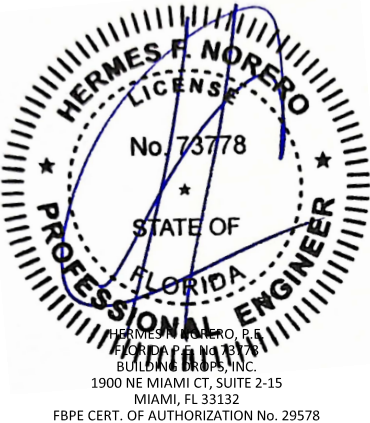

FL #:

FL29500

DATE: 04.09.19

DWG. BY: RV

CHK. BY: HFN


SCALE: NTS

DWG. #: ALT004


SHEET: 2 OF 8

REV. B

c:\users\sebastianherrerros\building drops, inc\building drops landing - common\projects\2026 code change projects\air-lux technik ag\cc-26-0480.1 - 2026 code change\dwgs\fl29500-r2\alt004-b.dwg 9/10/2026 4:29 PM

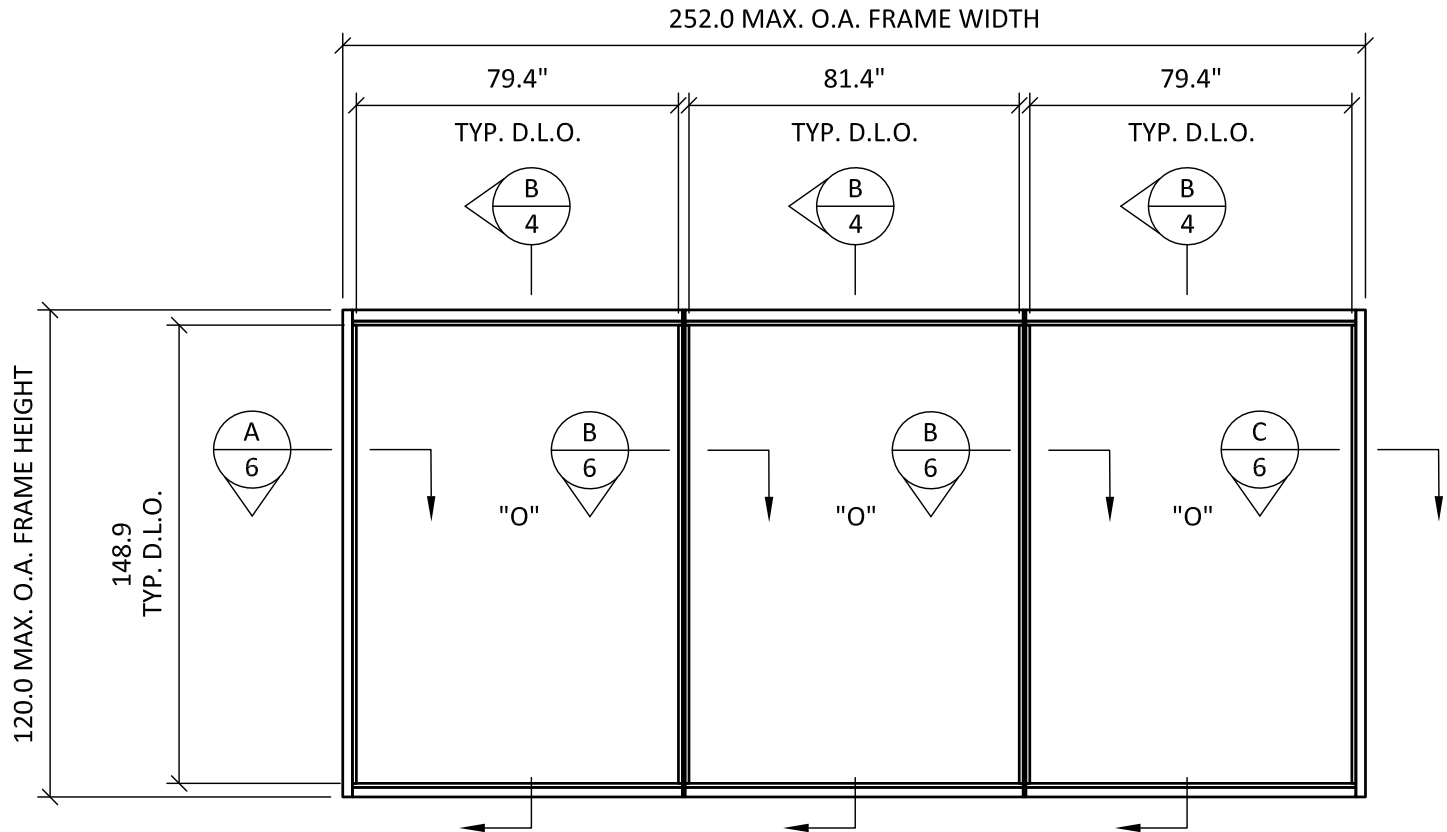

ELEVATION
WINDOW WALL

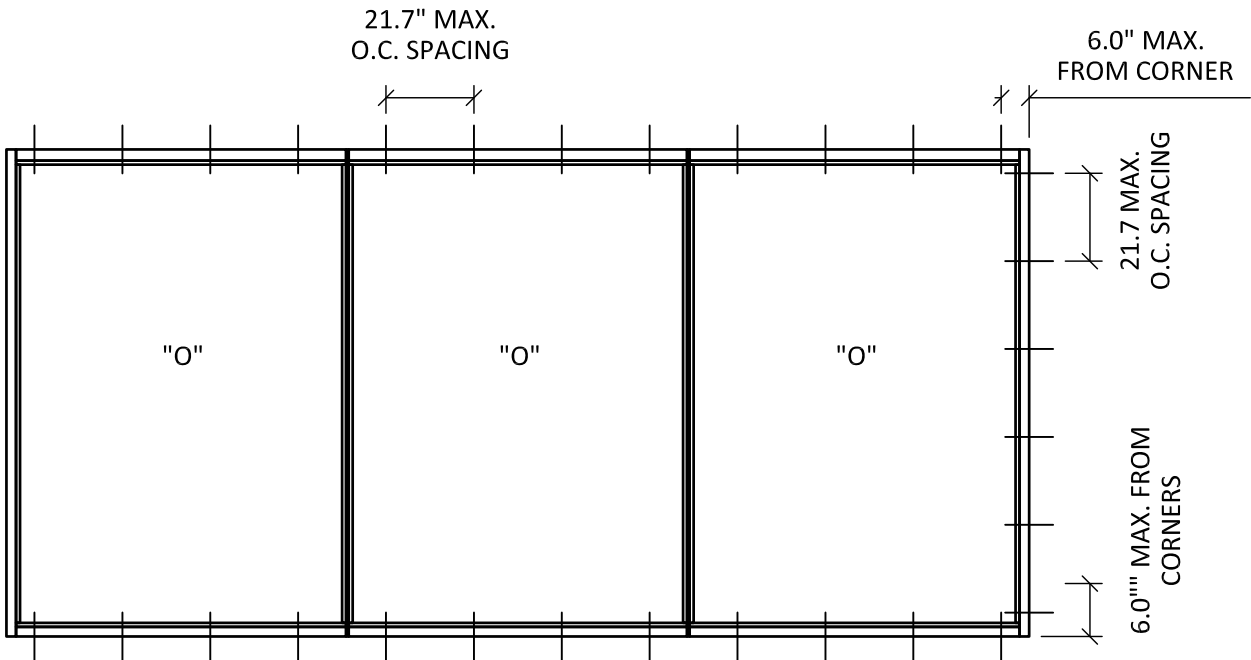

ANCHOR LAYOUT
THROUGH FRAME

DESIGN PRESSURE TABLE - WINDOW WALL WITHOUT STEEL REINFORCEMENT																		
	PANEL WIDTH (INCHES)																	
		24	30	36	42	48	54	60	66	72	78	84	90	96	102	108	114	120
FRAME HEIGHT (INCHES)	24	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0
	30	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0
	36	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0
	42	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0
	48	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0
	54	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0
	60	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	19.8	19.4	19.0	18.7
	66	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	19.4	18.8	18.3	17.9	17.6
	72	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	19.4	18.7	18.0	17.5	17.1	16.7
	78	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	19.0	18.1	17.4	16.9	16.4	16.0
	84	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	18.8	17.8	17.0	16.4	15.8	15.4
	90	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	18.7	17.6	16.7	16.0		
	96	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	18.7	17.5	16.5			
	102	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	18.7	17.5				
	108	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	18.7					
	114	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0						
	120	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0						
	126	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	18.8	17.8	0.0						
	132	20.0	20.0	20.0	20.0	20.0	20.0	18.6	17.2	16.1	15.2	14.5						
	138	20.0	20.0	20.0	20.0	19.7	17.7	16.2	15.0	14.0	13.1							
	144	20.0	20.0	20.0	20.0	19.7	17.7	16.2	15.0									

QUALIFIED CONFIGURATIONS:

1. TYPICAL ELEVATIONS ARE SHOWN. SYSTEM IS QUALIFIED FOR CONFIGURATIONS NOT EXCEEDING THE PANEL SIZES SHOWN IN THE ABOVE TABLE, USING UNLIMITED PANELS.
2. OPERABLE PANELS ARE LOCATED ON EXTERIOR TRACK. FIXED PANELS ON INTERIOR TRACK.
3. MOTORIZATION IS OUTSIDE THE SCOPE OF THIS APPROVAL.
4. ALL CONFIGURATIONS ARE RATED FOR AIR AND WATER INFILTRATION REQUIREMENTS.

air-lux®

AIR-LUX TECHNIK AG
BREITSCHACHENSTRASSE 52
9032 ENGELBURG/SG
SWITZERLAND
PH: +41 71 272 2600 FX: +41 71 272 2601

TITLE: AIR-LUX SERIES 173
WINDOW WALL (WZ3) (IMPACT)

ELEVATION AND ANCHORS LAYOUT

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2020 FBC UPDATE	MS	11/20
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:

FL29500

DATE: 04.09.19

DWG. BY: RV CHK. BY: HFN


SCALE: NTS

DWG. #: ALT004


SHEET: 3 OF 8

REV. B

c:\users\sebastianherrerros\building drops, inc\building drops landing - common\projects\2026 code change projects\air-lux technik ag\cc-26-0480.1 - 2026 code change\dwgs\fl29500-r2\alt004-b.dwg 9/10/2026 4:29 PM

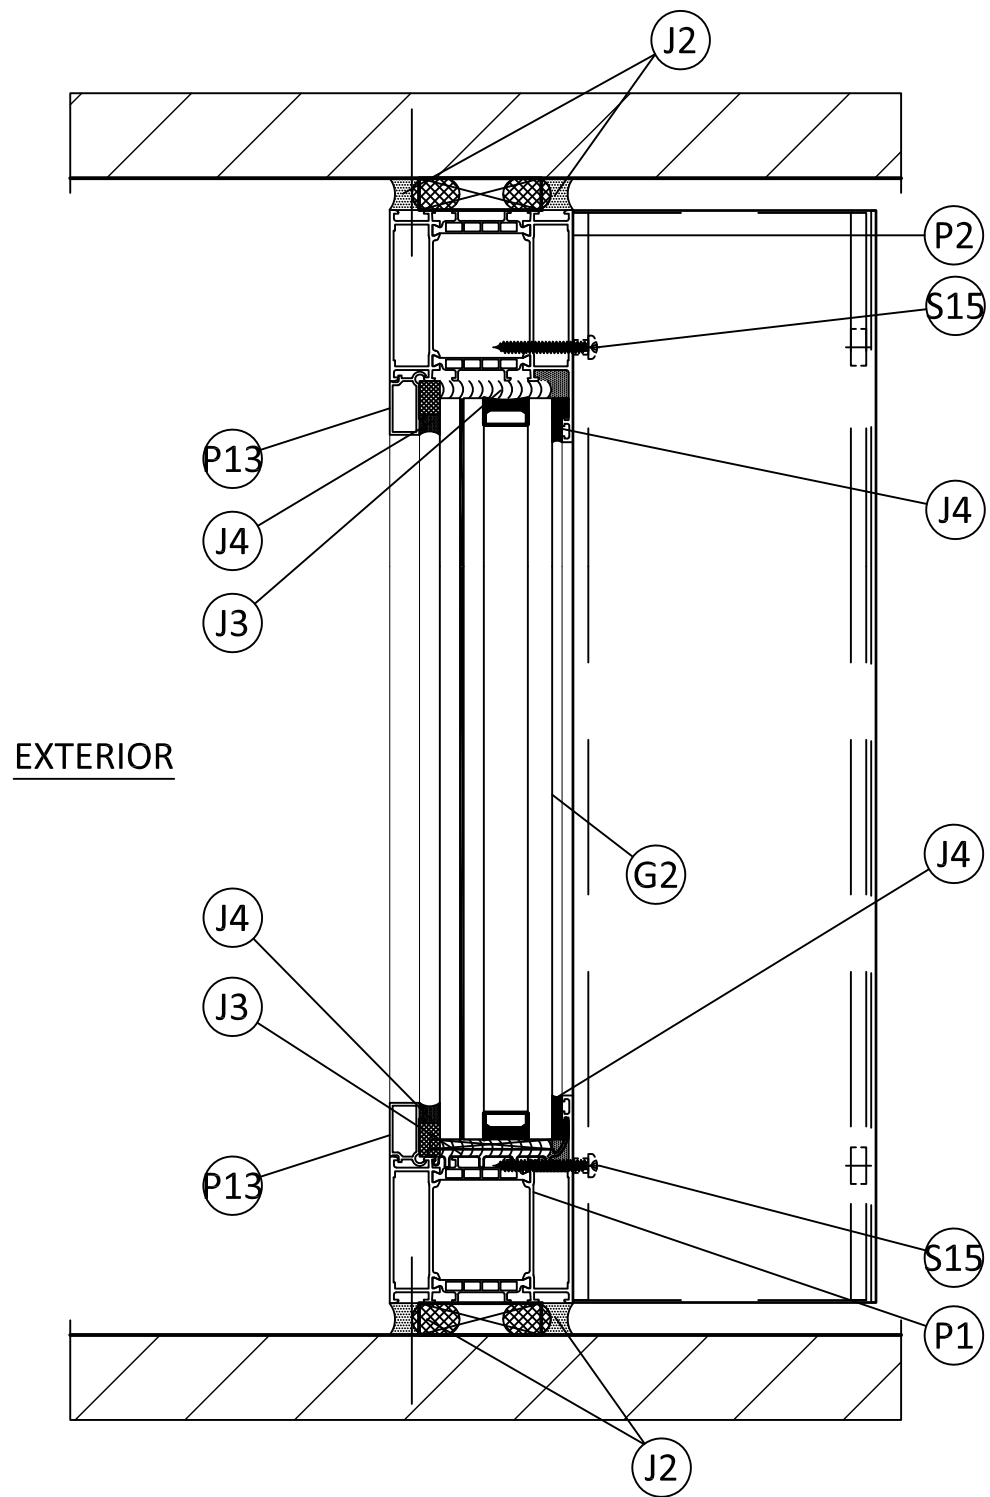

A
4 VERTICAL SECTION
THROUGH FRAME

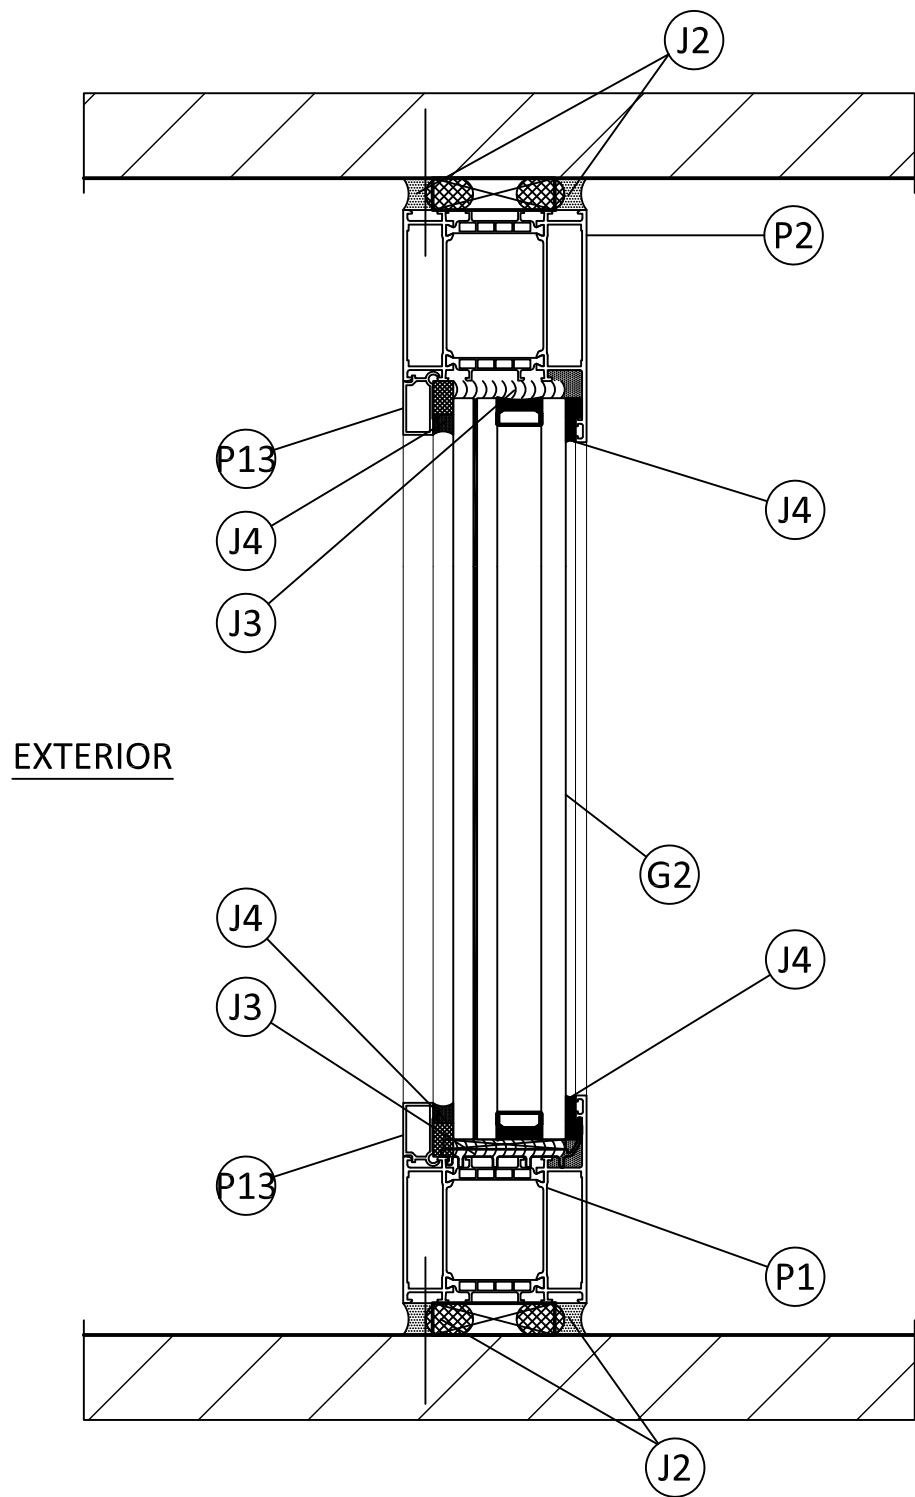

B
4 VERTICAL SECTION
THROUGH FRAME

air-lux®

AIR-LUX TECHNIK AG
BREITSCHACHENSTRASSE 52
9032 ENGELBURG/SG
SWITZERLAND
PH: +41 71 272 2600 FX: +41 71 272 2601

TITLE: AIR-LUX SERIES 173
WINDOW WALL (WZ3) (IMPACT)

VERTICAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2020 FBC UPDATE	MS	11/20
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.




FL #:	FL29500
DATE:	04.09.19
DWG. BY:	CHK. BY:
RV	HFN
SCALE:	NTS
DWG. #:	ALT004
SHEET:	REV. B

4

OF 8

c:\Users\sebastianherrerros\building drops, inc\building drops landing - common\projects\2026 code change projects\air-lux technik ag\cc-26-0480.1 - 2026 code change\dwgs\fl29500-r2\alt004-b.dwg 9/10/2026 4:29 PM

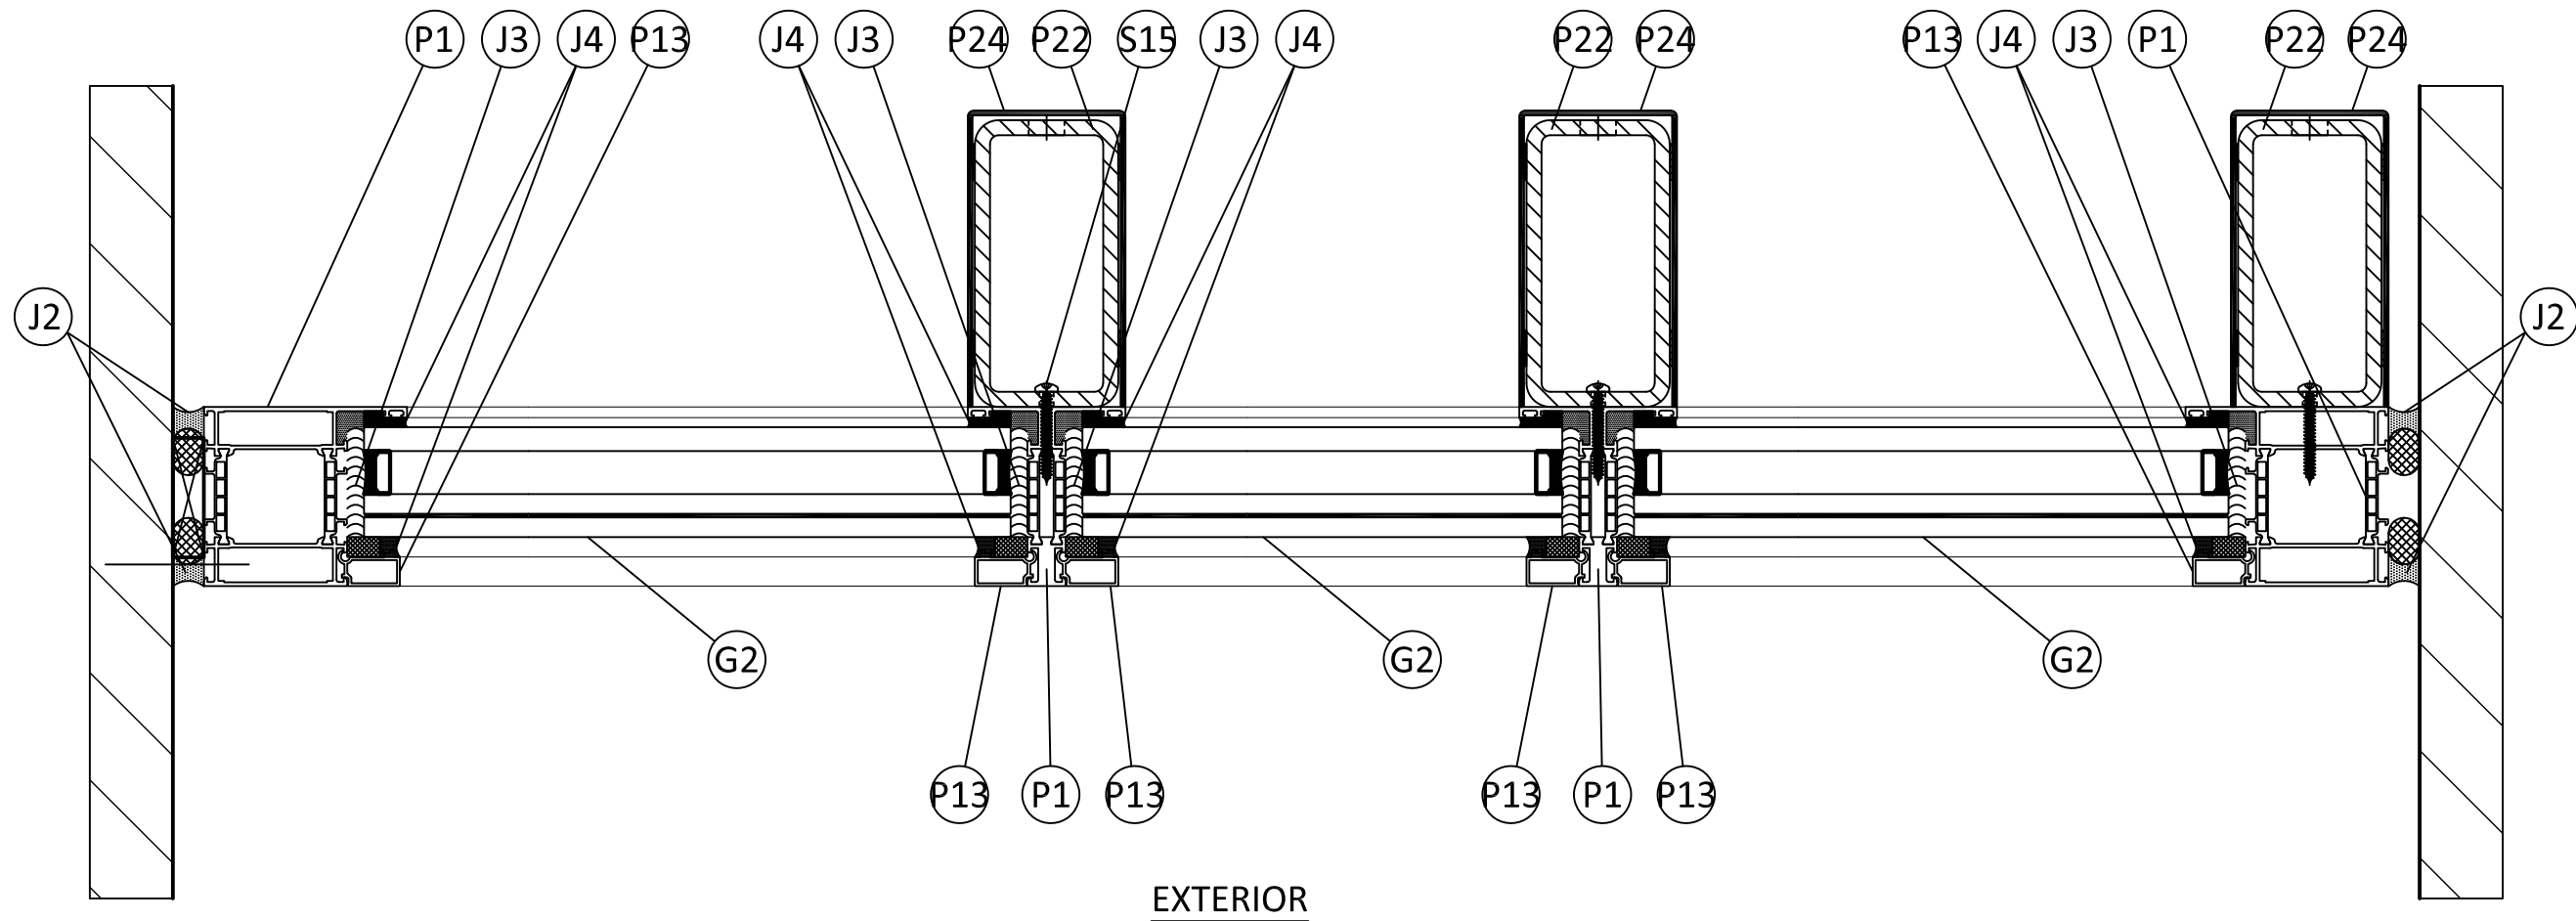

A
5

HORIZONTAL SECTION

THROUGH FRAME - ANCHORED JAMB

B
5

HORIZONTAL SECTION

THROUGH FRAME

C
5

HORIZONTAL SECTION

THROUGH FRAME - FLOATING JAMB

air-lux®

AIR-LUX TECHNIK AG
BREITSCHACHENSTRASSE 52
9032 ENGELBURG/SG
SWITZERLAND
PH: +41 71 272 2600 FX: +41 71 272 2601

TITLE:
AIR-LUX SERIES 173
WINDOW WALL (WZ3) (IMPACT)

HORIZONTAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2020 FBC UPDATE	MS	11/20
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.




FL #:	FL29500
DATE:	04.09.19
DWG. BY:	CHK. BY:
RV	HFN
SCALE:	NTS
DWG. #:	ALT004
SHEET:	REV.
5	B

OF 8

HORIZONTAL SECTIONS

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL IN NATURE AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC PROJECT OR SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED PROFESSIONAL ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



DWG. BY: RV	CHK. BY: HFN
-----------------------	------------------------

DWG. #: **ALT004**

REV. **B**

OF 8



HORIZONTAL SECTION


HORIZONTAL SECTION

HORIZONTAL SECTION


BILL OF MATERIALS (PROFILES)			
ITEM	DESCRIPTION	MATERIAL	MANUF./SUPPLIER/REMARKS
P1	FRAME PROFILE	ALUMINUM 6060-T66	AIR-LUX
P2	FRAME PROFILE	ALUMINUM 6060-T66	AIR-LUX
P13	GLASS STRIP FIXED PANEL	ALUMINUM 6060-T66	AIR-LUX
P22	REINFORCING POSTS	STEEL	AIR-LUX
P24	COVER	ALUMINUM 5005	AIR-LUX

BILL OF MATERIALS (SCREWS)		
ITEM	DESCRIPTION	MATERIAL
S15	PAN HEAD, TORX, SEF-TAPPING SCREW	ISO14585 STAINLESS 3/16"x1 1/2" [4,2x38MM]


BILL OF MATERIALS (JOINTS)		
ITEM	DESCRIPTION	MATERIAL
J1	JOINT FRAME-STRUCTURE	LIQUID PLASTIC TRIFLEX PRO DETAIL
J2	JOINT FRAME-STRUCTURE	DOWSIL 791
J3	JOINT GLASS FRAME	DOWSIL 791
J4	PAN HEAD, SOCKET HEX DRV., MACHINE SCREW	DOWSIL 791

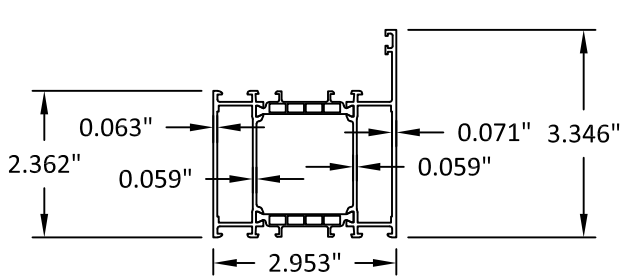


P1 FRAME PROFILE

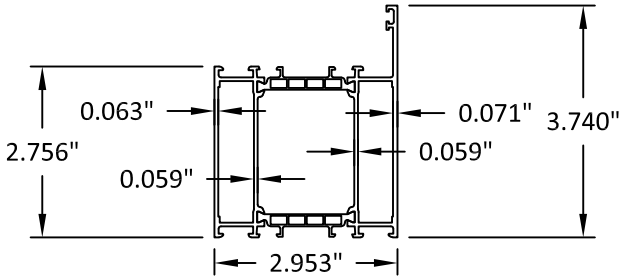


P2 FRAME PROFILE



P13 GLASS STRIP FIXED PANEL

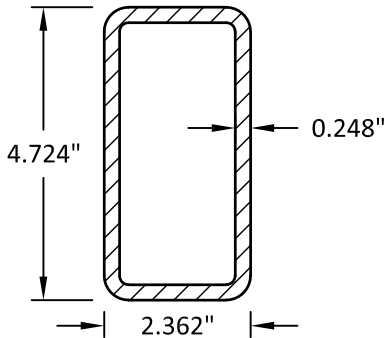

P22 REINFORCING POSTS

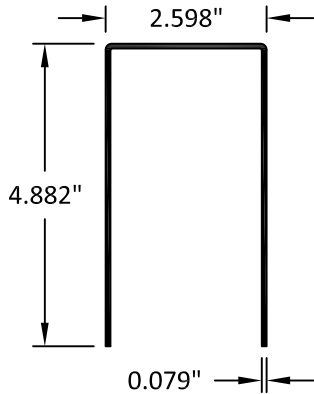

P24 COVER



AIR-LUX TECHNIK AG
BREITSCHACHENSTRASSE 52
9032 ENGELBURG/SG
SWITZERLAND
PH: +41 71 272 2600 FX: +41 71 272 2601


AIR-LUX SERIES 173
WINDOW WALL (WZ3) (IMPACT)
COMPONENTS AND
BILL OF MATERIALS
(SCREWS AND JOINTS)

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2020 FBC UPDATE	MS	11/20
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

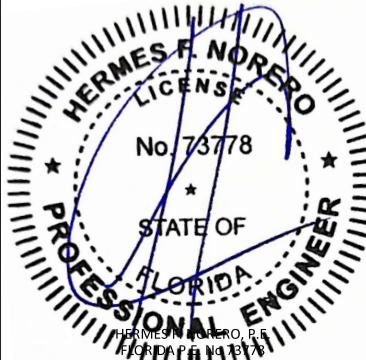

HERMES F. NORERO, P.E.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL29500

DATE: **04.09.19**

DWG. BY:
RV

CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **ALT004**

SHEET:
8

REV.
B

OF 8