



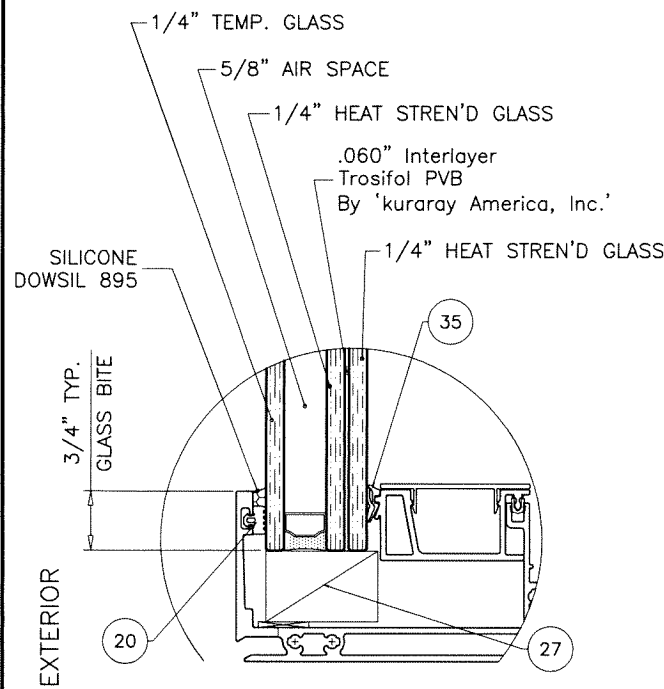

GLASS TYPE 'A'
1-3/8" OVERALL INSUL. LAM. GLASS

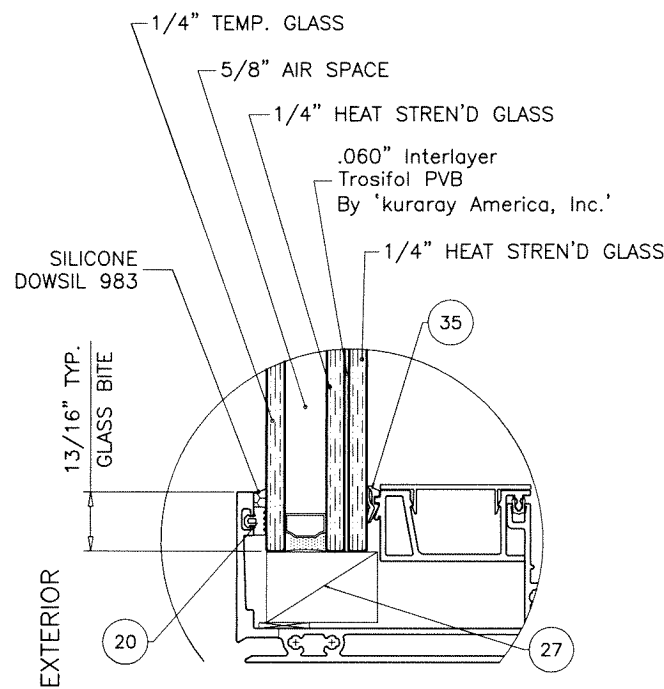

GLASS TYPE 'A1'
1-3/8" OVERALL INSUL. LAM. GLASS

5/8" AIR SPACE CONSISTING OF:
SPACER:
'HELIMA' LOW PROFILE ALUMINUM SPACER
BY 'LINGERMANN GMBH'
AROUND THE PERIMETER OF THE GLASS.
PERIMETER SEALANT:
SILICONE
DOWSIL 791
GE 2000

PRODUCT WITH GLASS TYPE 'A1' COMPLIES WITH REQUIREMENTS OF ANSI Z97.1.
SAFEGUARD REQUIREMENTS TO BE VERIFIED.

ES-LS7035

ALUMINUM SLIDING GLASS DOOR

DESIGN LOAD RATING FOR DOORS TO BE AS PER CHARTS SHOWN
ON SHEET 3.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE
REQUIREMENTS OF THE 2023 (8TH EDITION) FLORIDA BUILDING CODE
INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS
AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE
MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT
COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE
REQUIREMENTS OF THE 2023 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION
FOR A SITE SPECIFIC PROJECT, I.E. LIFE SAFETY OF THIS PRODUCT, ADEQUACY
OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR
WATER INFILTRATION RESISTANCE ETC.
CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY,
AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.


MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION
IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE.
LABELING TO COMPLY WITH SECTION 1709.9.2.

THESE DOORS ARE RATED FOR SMALL MISSILE IMPACT.
F.B.C. APPROVED IMPACT RESISTANT SHUTTERS
REQUIRED FOR INSTALLATIONS UP TO 30 FT. OF GRADE.
SHUTTERS NOT REQD. FOR INSTALLATIONS ABOVE 30 FT. OF GRADE.

DAYLITE OPENINGS WIDTHS:
OPERABLE PANEL WIDTH - 7.375"
FIXED PANEL WIDTH - 5.525"

DAYLITE OPENING HEIGHT:
OPERABLE PANEL HEIGHT - 9.50"
FRAME HEIGHT - 6.0"
PANEL HEIGHT = DOOR FRAME HEIGHT - 3.250"

DOOR HT. UPTO	DESIGN LOADS UPTO	NO. OF ANCHOR PAIRS AT HEAD			NO. OF IN LINE ANCHORS AT SILL		
		JAMB ENDS	INTERLOCK ENDS	JAMB ENDS	INTERLOCK ENDS	JAMB ENDS	INTERLOCK ENDS
122"	120 PSF	1/2" SHIM 3/4" SHIM	1/2" SHIM 3/4" SHIM	3/8" SHIM 5/8" SHIM	3/8" SHIM 5/8" SHIM	3/8" SHIM 5/8" SHIM	3/8" SHIM 5/8" SHIM
147-3/8"	78 PSF	4	4	7	7	6	6
		3	-	5	-	6	10

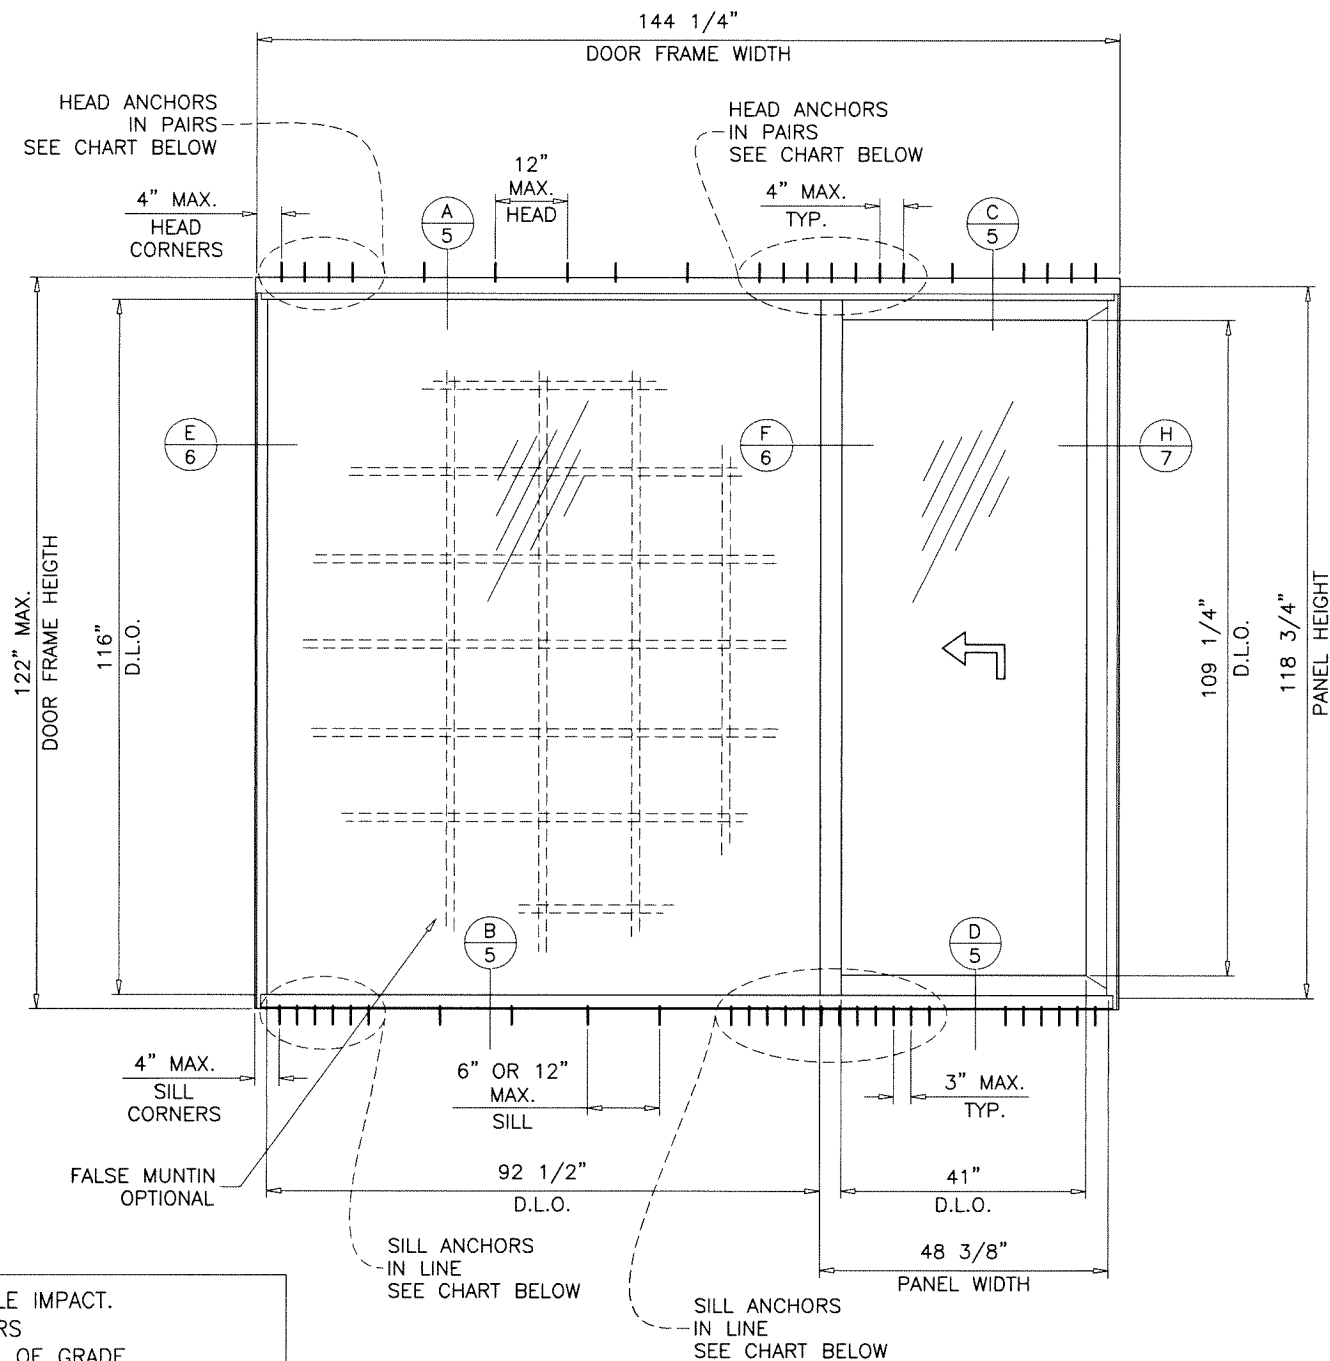

TYPICAL ELEVATION

(OX)
TESTED UNIT

Sealed: 6/20/2025

INSUL. LAM. GLASS
SMALL MISSILE IMPACT


FL #29516

A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND
INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION
PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED
ON THIS DOCUMENT.

B- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF
ALTERED BY ANY MEANS.

C- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED
ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.)
FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER
USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED
ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE
SPECIFIC DRAWINGS FOR REVIEW.

D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF
THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

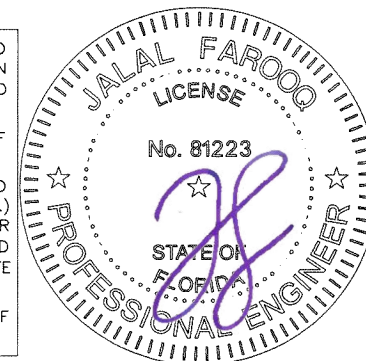

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL 19-30F-ES

ES-LS7035 ALUMINUM SLIDING GL. DOOR (S.M.I.)


E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	no.	date	by	description
	A	12.10.20		UPDATED TO 2020 FBC
	B	02.03.23		NEW TESTS ADDED
	C	09.19.23		UPDATED TO 2023 FBC
	D	02.18.25		PRODUCT SERIES REVISED
	E	06.19.25		ALT. JAMB ADDED


date: 03-30-19
scale: 3/8"=1'-0"
dr. by: TARIQ
chk. by:

drawing no.
19-30F


sheet 1 of 10

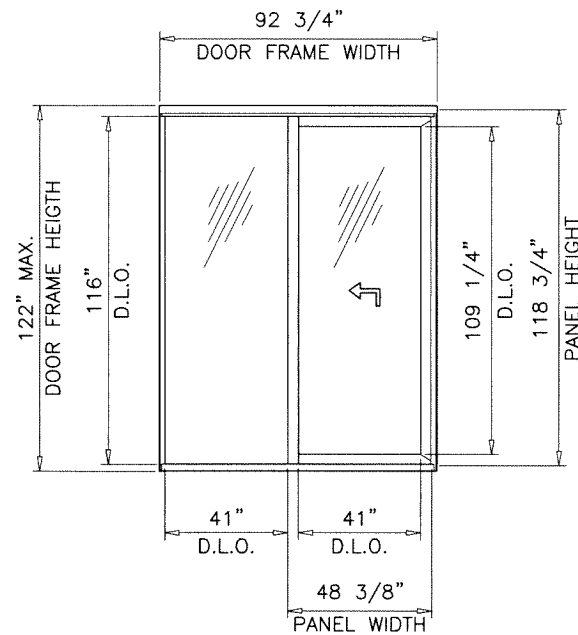

GLASS TYPE 'A'
 MAXIMUM DESIGN LOAD RATING = + 120.0 PSF
 (FOR SIZES SHOWN ABOVE OR SMALLER) - 120.0 PSF

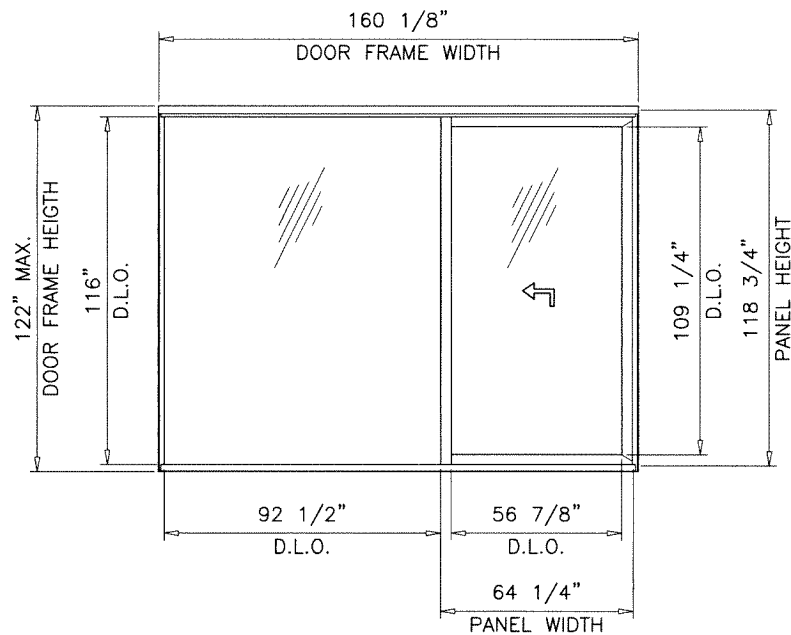

GLASS TYPE 'A'
 MAXIMUM DESIGN LOAD RATING = + 80.0 PSF
 (FOR SIZES SHOWN ABOVE OR SMALLER) - 80.0 PSF

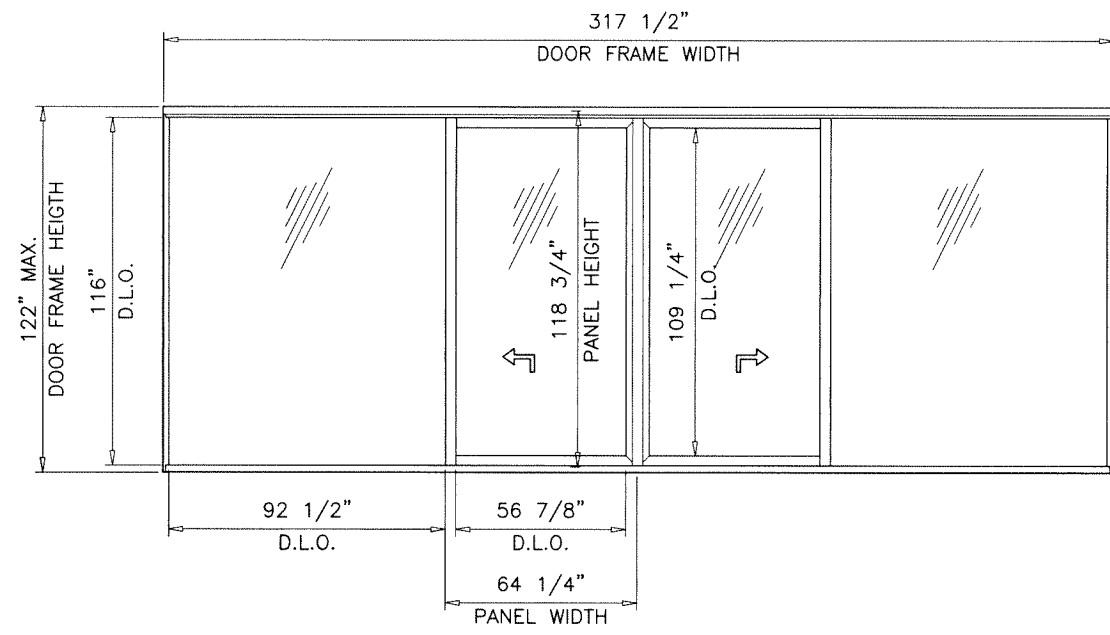


GLASS TYPE 'A'
 MAXIMUM DESIGN LOAD RATING = + 80.0 PSF
 (FOR SIZES SHOWN ABOVE OR SMALLER) - 80.0 PSF

NOTE:
 GLASS CAPACITIES ON THIS SHEET ARE
 BASED ON ASTM E1300-09 (3 SEC. GUSTS)
 AND FLORIDA BUILDING COMMISSION
 DECLARATORY STATEMENT DCA05-DEC-219

DOOR HEIGHT AND WIDTH SIZE MUST COMPLY
 EGRESS REQUIREMENTS PER FBC AS REQUIRED.

Sealed: 6/20/2025

FL #29516

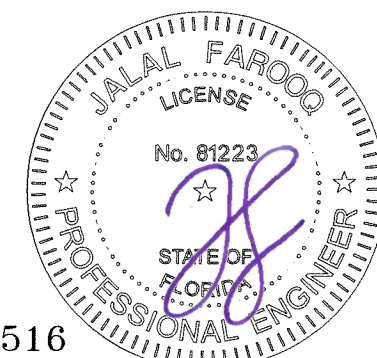


afc


AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173 (C.A.N. 3538)
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\19-30F-ES

ES-LS7035 ALUMINUM SLIDING GL. DOOR (S.M.I.)
E.S. WINDOWS, LLC
 3550 N.W. 49 STREET
 MIAMI, FL. 33142
 TEL. (305) 638-5151 FAX. (305) 638-5158


revisions:		no date by description	
date:	03-30-19	scale:	-
dr. by:	TARIQ	chk. by:	
drawing no.	19-30F	sheet	3 of 10

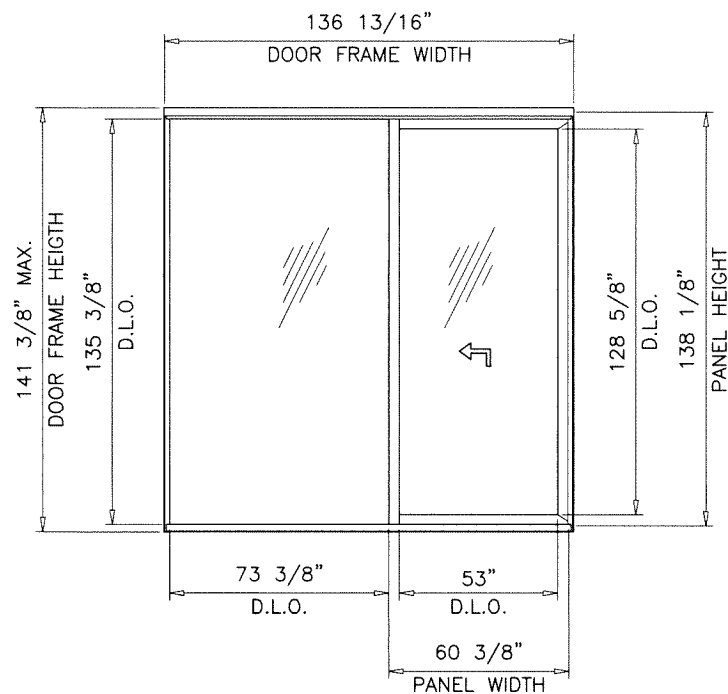


GLASS TYPE 'A1'
 MAXIMUM DESIGN LOAD RATING = + 78.0 PSF
 (FOR SIZES SHOWN ABOVE OR SMALLER) - 78.0 PSF

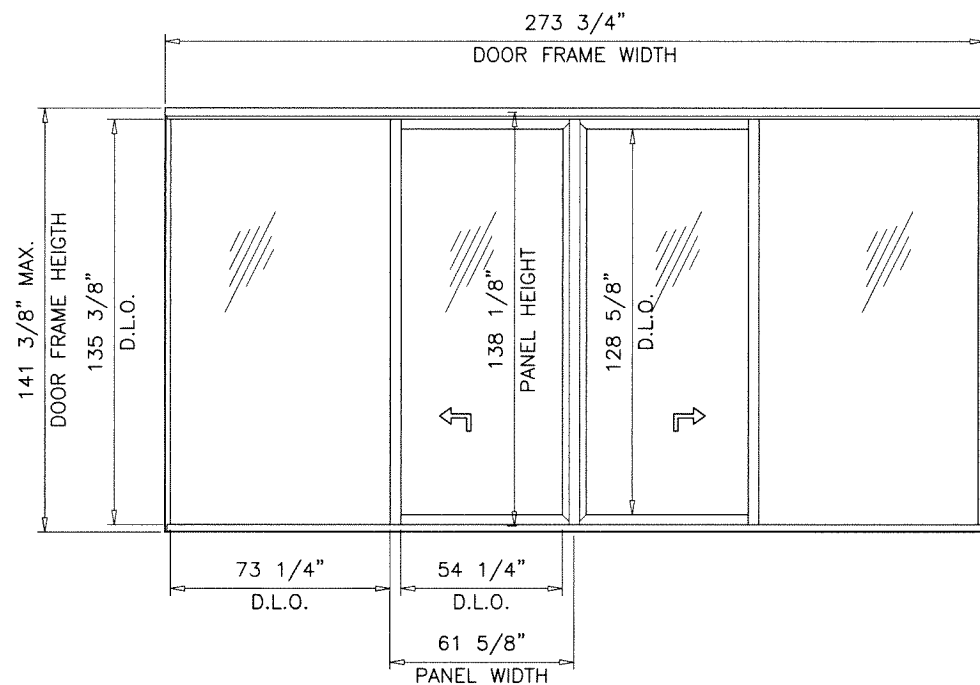

GLASS TYPE 'A1'
 MAXIMUM DESIGN LOAD RATING = + 78.0 PSF
 (FOR SIZES SHOWN ABOVE OR SMALLER) - 78.0 PSF

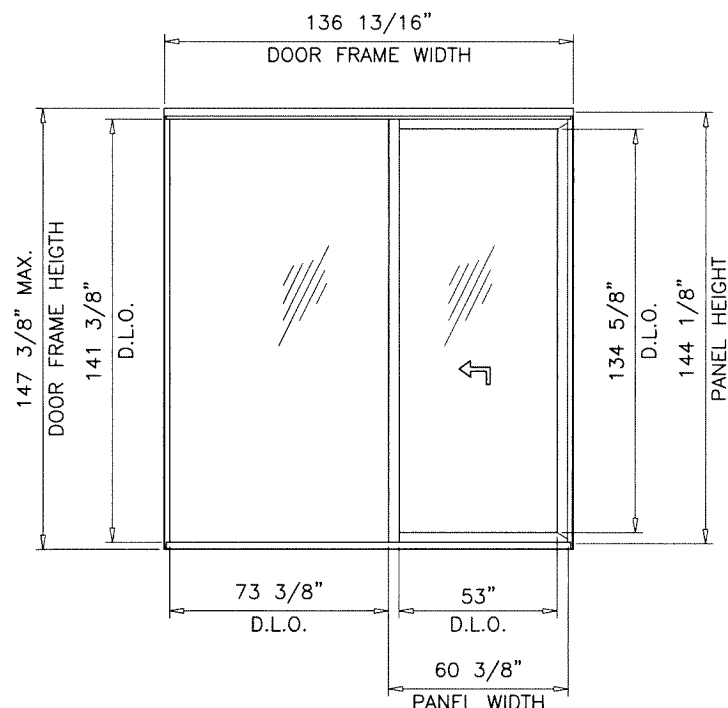

GLASS TYPE 'A1'
 MAXIMUM DESIGN LOAD RATING = + 74.7 PSF
 (FOR SIZES SHOWN ABOVE OR SMALLER) - 74.7 PSF

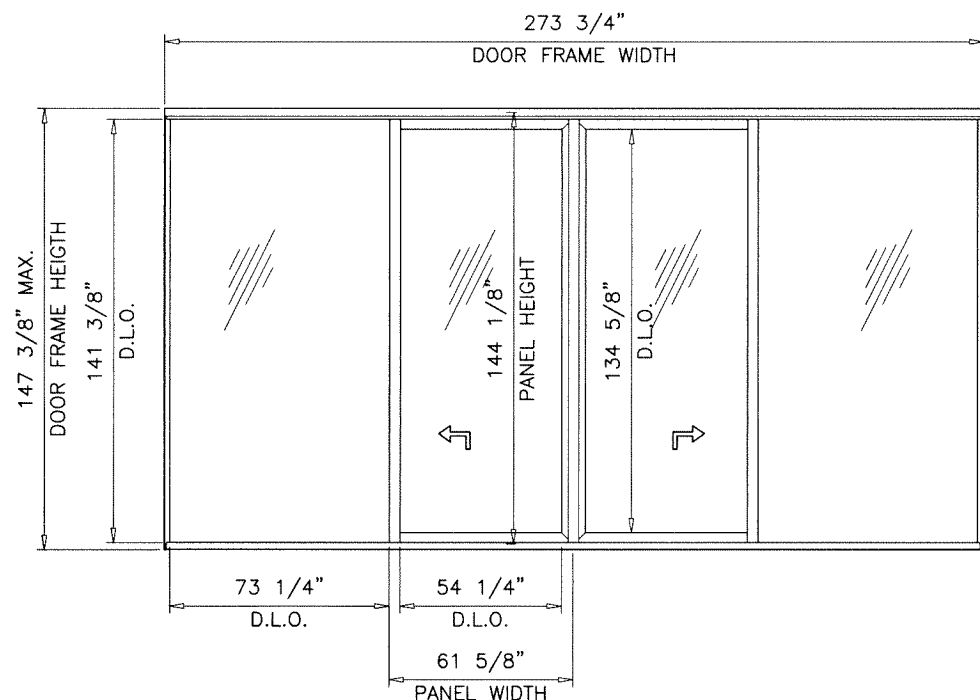


GLASS TYPE 'A1'
 MAXIMUM DESIGN LOAD RATING = + 74.7 PSF
 (FOR SIZES SHOWN ABOVE OR SMALLER) - 74.7 PSF

NOTE:
 GLASS CAPACITIES ON THIS SHEET ARE
 BASED ON ASTM E1300-09 (3 SEC. GUSTS)
 AND FLORIDA BUILDING COMMISSION
 DECLARATORY STATEMENT DCA05-DEC-219

DOOR HEIGHT AND WIDTH SIZE MUST COMPLY
 EGRESS REQUIREMENTS PER FBC AS REQUIRED.

Sealed: 6/20/2025

FL #29516

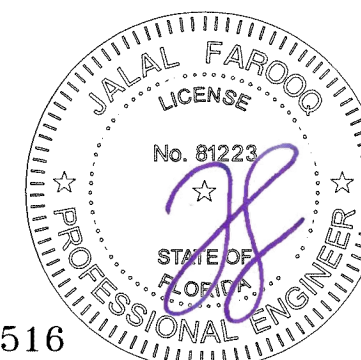

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978
 (C.A.N. 3538)

ES-LS7035 ALUMINUM SLIDING GL. DOOR (S.M.I.)


E.S. WINDOWS, LLC
 3550 N.W. 49 STREET
 MIAMI, FL. 33142
 TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	
no	date by description


date: 03-30-19	scale: -	dr. by: TARIQ	chk. by:
----------------	----------	---------------	----------

drawing no. **19-30F**

sheet **3.1** of **10**

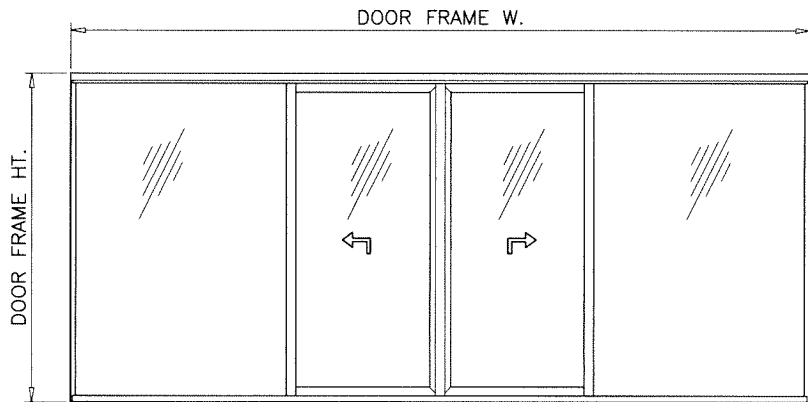


OXXO (SHOWN)

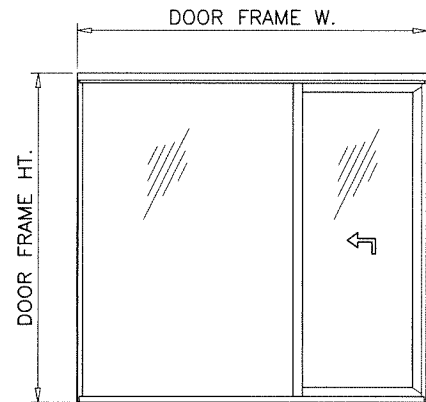


XO (SHOWN)
OX

APPROVED CONFIGURATIONS

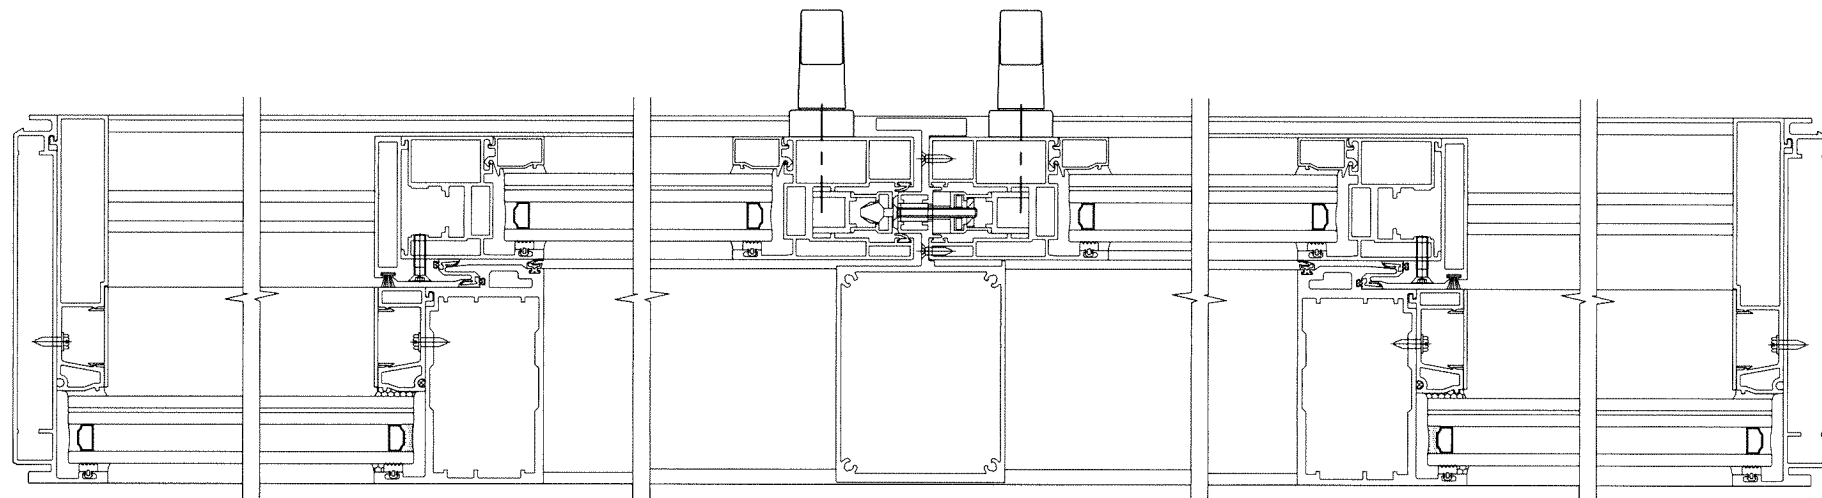


EXTERIOR

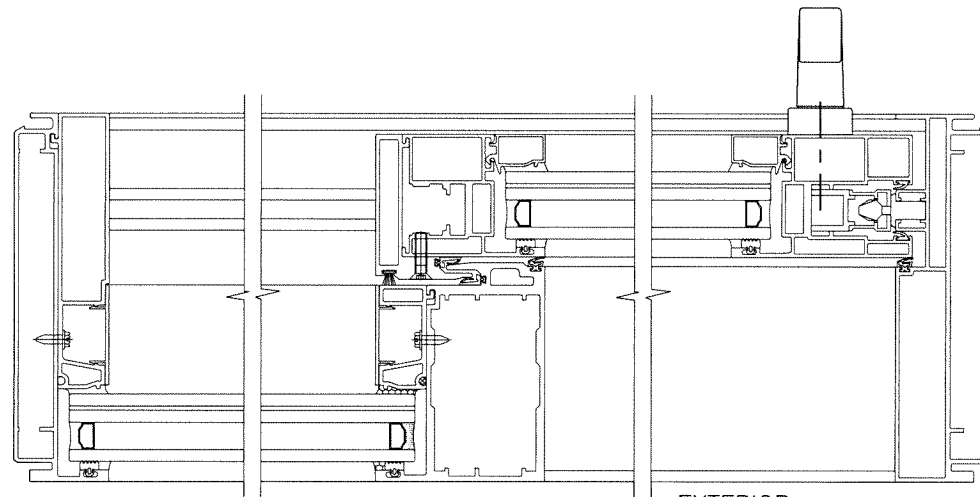

EXTERIOR

Sealed: 6/20/2025

FL #29516

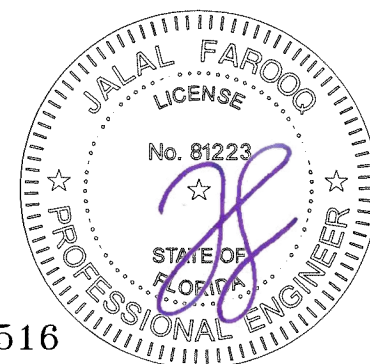

date: 03-30-19	revisions:	no	date	by	description
scale: -					
dr. by: TARIQ					
chk. by:					
drawing no.					
19-30F					
sheet 4 of 10					



ES-LS7035 ALUMINUM SLIDING GL. DOOR (S.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

a f c

COMP-ANL 19-30F-ES

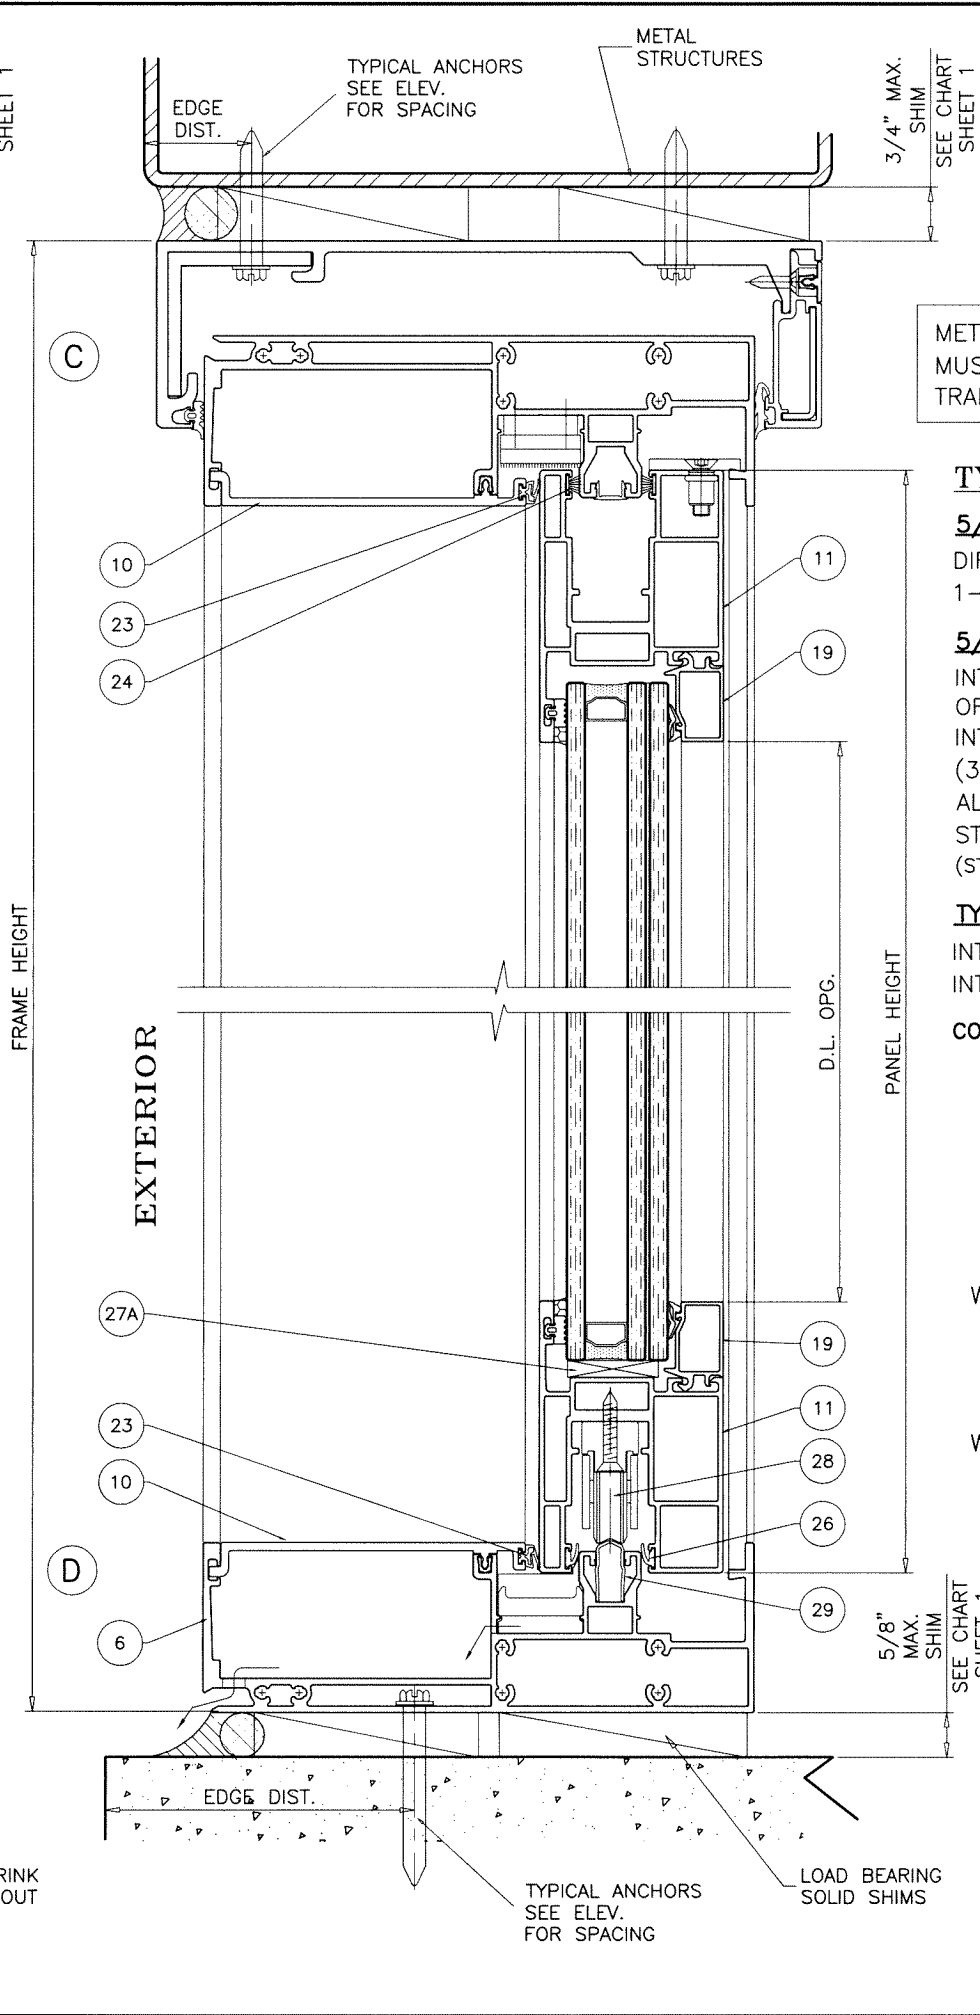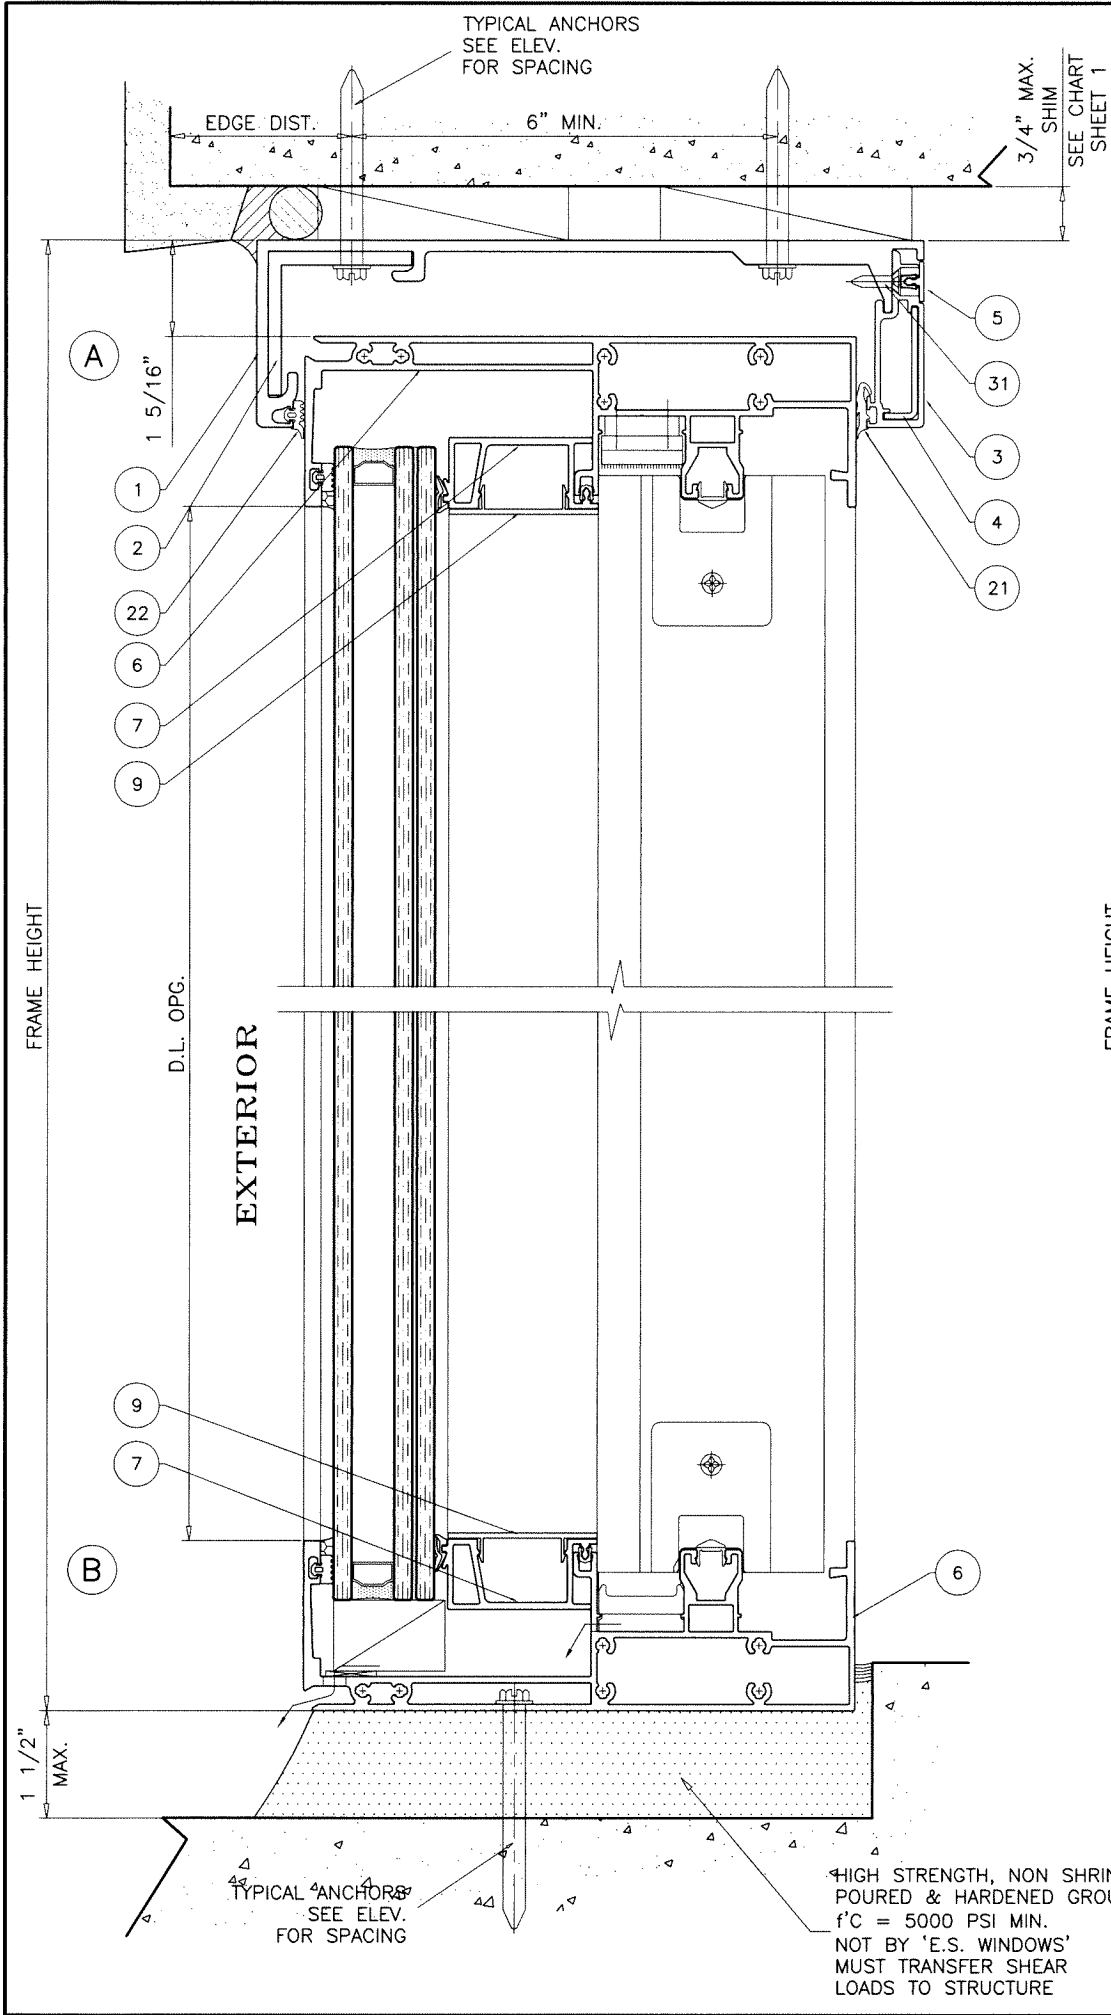

METAL STRUCTURES NOT BY 'E.S. WDW.' MUST SUPPORT LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

5/16" DIA. ULTRACON BY 'DEWALT' (Fu=177 KSI, Fy=155 KSI) DIRECTLY INTO CONCRETE 1-3/4" MIN. EMBED INTO CONCRETE (HEAD/SILL)

5/16" DIA. TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS) INTO F.B.C. APPROVED MULLIONS OR INTO METAL STRUCTURES (HEAD/SILL) (3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS ALUMINUM: 3/16" THK. MIN. (6063-T5 MIN.) STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.) (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE = 2-1/2" MIN.

INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE AT HEAD, SILL f'c = 3000 PSI MIN.

WEEPHOLES:

W1 = 5/16" DIA. WEEP HOLES IN CLUSTERS OF 3 SPACED TOGETHER 1/2" APART. CLUSTERS LOCATED AT 4" FROM EACH END AND 8" TO THE LEFT AND RIGHT OF CENTERLINE.

W2 = 5/16" DIA. WEEP HOLES IN CLUSTERS OF 3 SPACED TOGETHER 1/2" APART. CLUSTERS LOCATED AT 26" FROM EACH END AND 22" O.C.

Sealed: 6/20/2025

FL #29516



AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\19-30F-ES

ES-LS7035 ALUMINUM SLIDING GL. DOOR (S.M.I.)


E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	
no	date by description

date: 03-30-19
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
19-30F
sheet 5 of 10

1/4" X 6-5/8"
ALUMINUM REINF. BAR
REQD. ONLY FOR
DOOR HT. ABOVE 122"
& DESIGN LOAD ABOVE 71.4 PSF

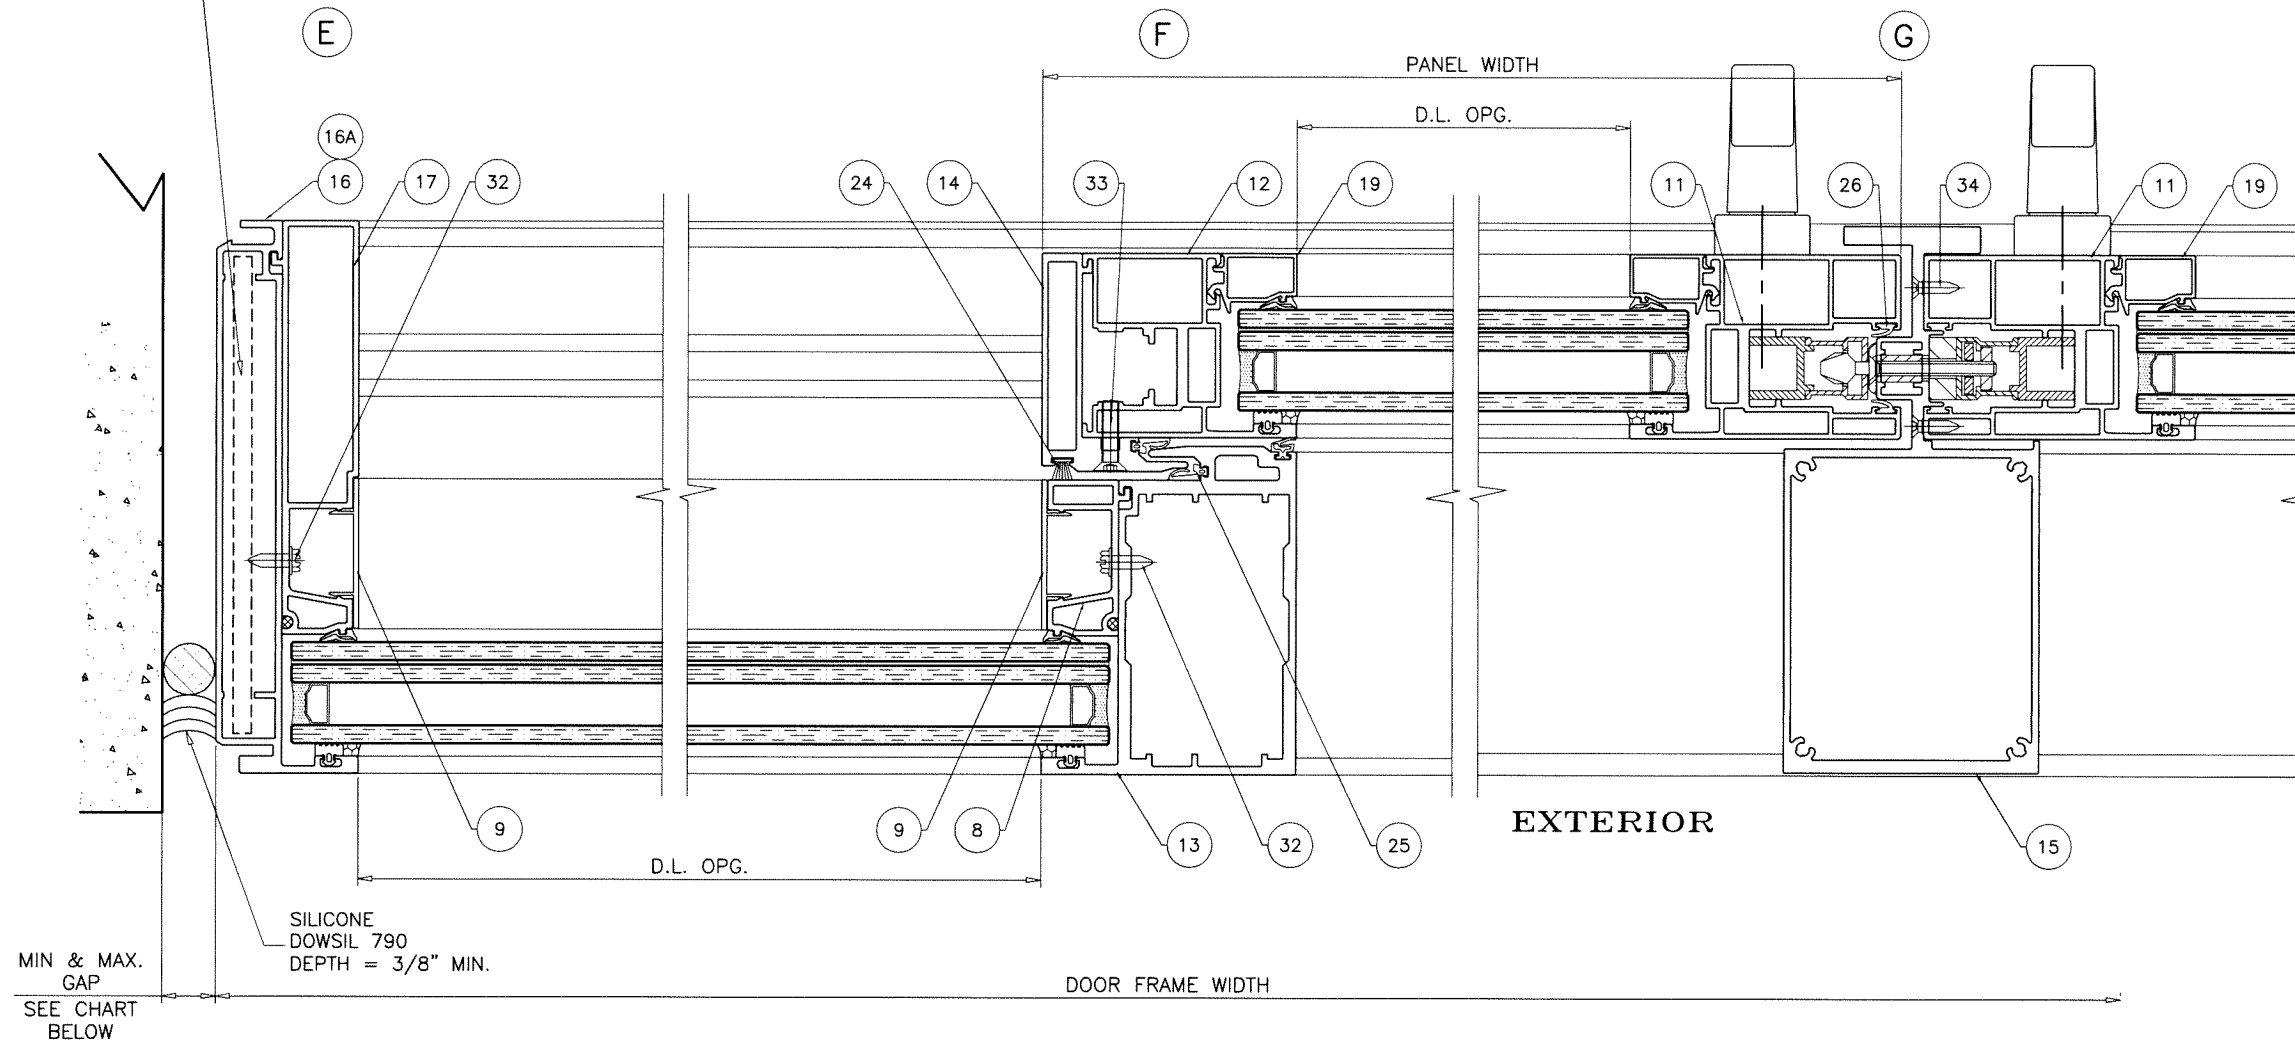


MAX. FRAME HEIGHT	GAP	
	MIN.	MAX.
96"	3/8"	3/4"
122"	7/16"	3/4"
147-3/8"	1/2"	3/4"

NOTE:
MAX. MOVEMENT CONSIDERED=100% STRETCH.
PLEASE REFER TO SEALANT MANUFACTURER'S DATA AND APPLICATION MANUAL FOR COMPATABILITY OF SEALANT TO SUBSTRATE & WINDOWALL MATERIAL/FINISH AND COMPLIANCE FOR WARRANTY.
REFER TO ACI-117-10 FOR CONSTRUCTION TOLERANCES.

ALTERNATE SEALANTS AT JAMB GAPS CAN BE DESIGNED BY ENGINEER OF RECORD BASED ON MANUFACTURER GUIDE LINES.
GAPS LESS THAN 1/4" MAY BE DESIGNED BY ENGINEER OF RECORD BY THE USE OF BOND BREAKER TAPE OR 15% OF GAP ALLOWED MOVEMENT.

Sealed: 6/20/2025


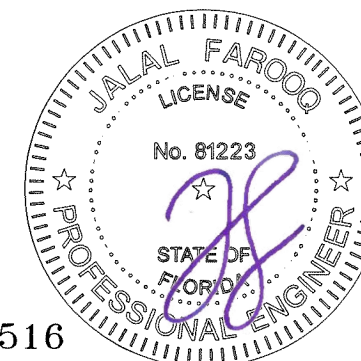


FL #29516

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL \ 19-30F-ES


ES-LS7035 ALUMINUM SLIDING GL. DOOR (S.M.I.)
E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:		no	date	by	description
date:	03-30-19	scale:	3/8" = 1"	dr. by:	TARIQ
chk. by:					
drawing no.	19-30F				
sheet	6 of 10				

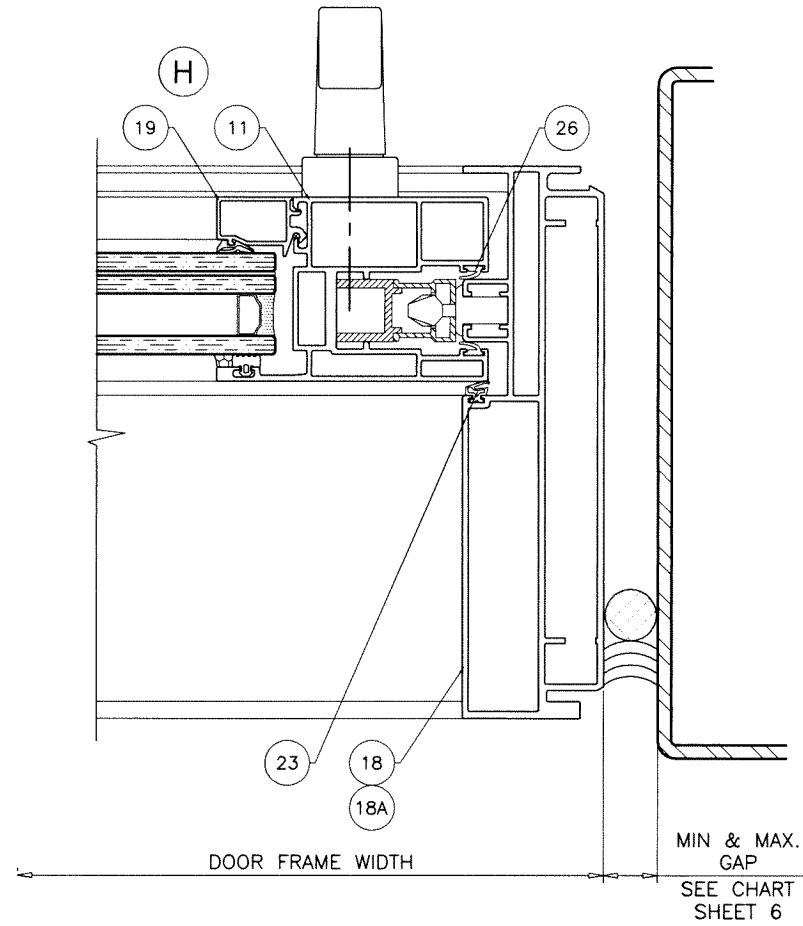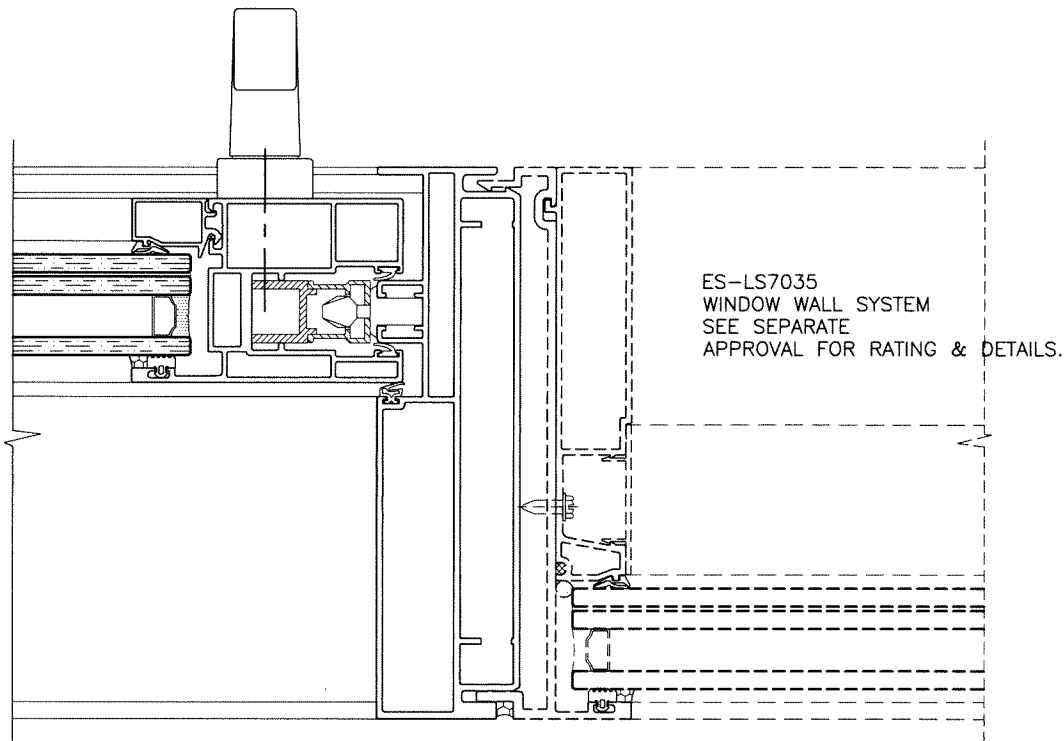

Sealed: 6/20/2025


FL #29516

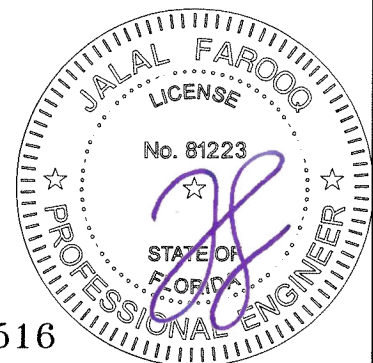

AL-FAROOQ CORPORATION ENGINEERS & PRODUCT DEVELOPMENT 9360 SUNSET DRIVE, SUITE 220 MIAMI, FLORIDA 33173 TEL. (305) 264-8100 FAX. (305) 262-6978 (C.A.N. 3538)		E.S. WINDOWS, LLC 3550 N.W. 49 STREET MIAMI, FL. 33142 TEL. (305) 638-5151 FAX. (305) 638-5158		ES-LS7035 ALUMINUM SLIDING GL. DOOR (S.M.I.)
COMP-ANL \ 19-30F-ES				

revisions:		no.		date		by		description	

date: 03-30-19	scale: 3/8" = 1"	dr. by: TARIQ	chk. by:
drawing no. 19-30F			
sheet 7 of 10			

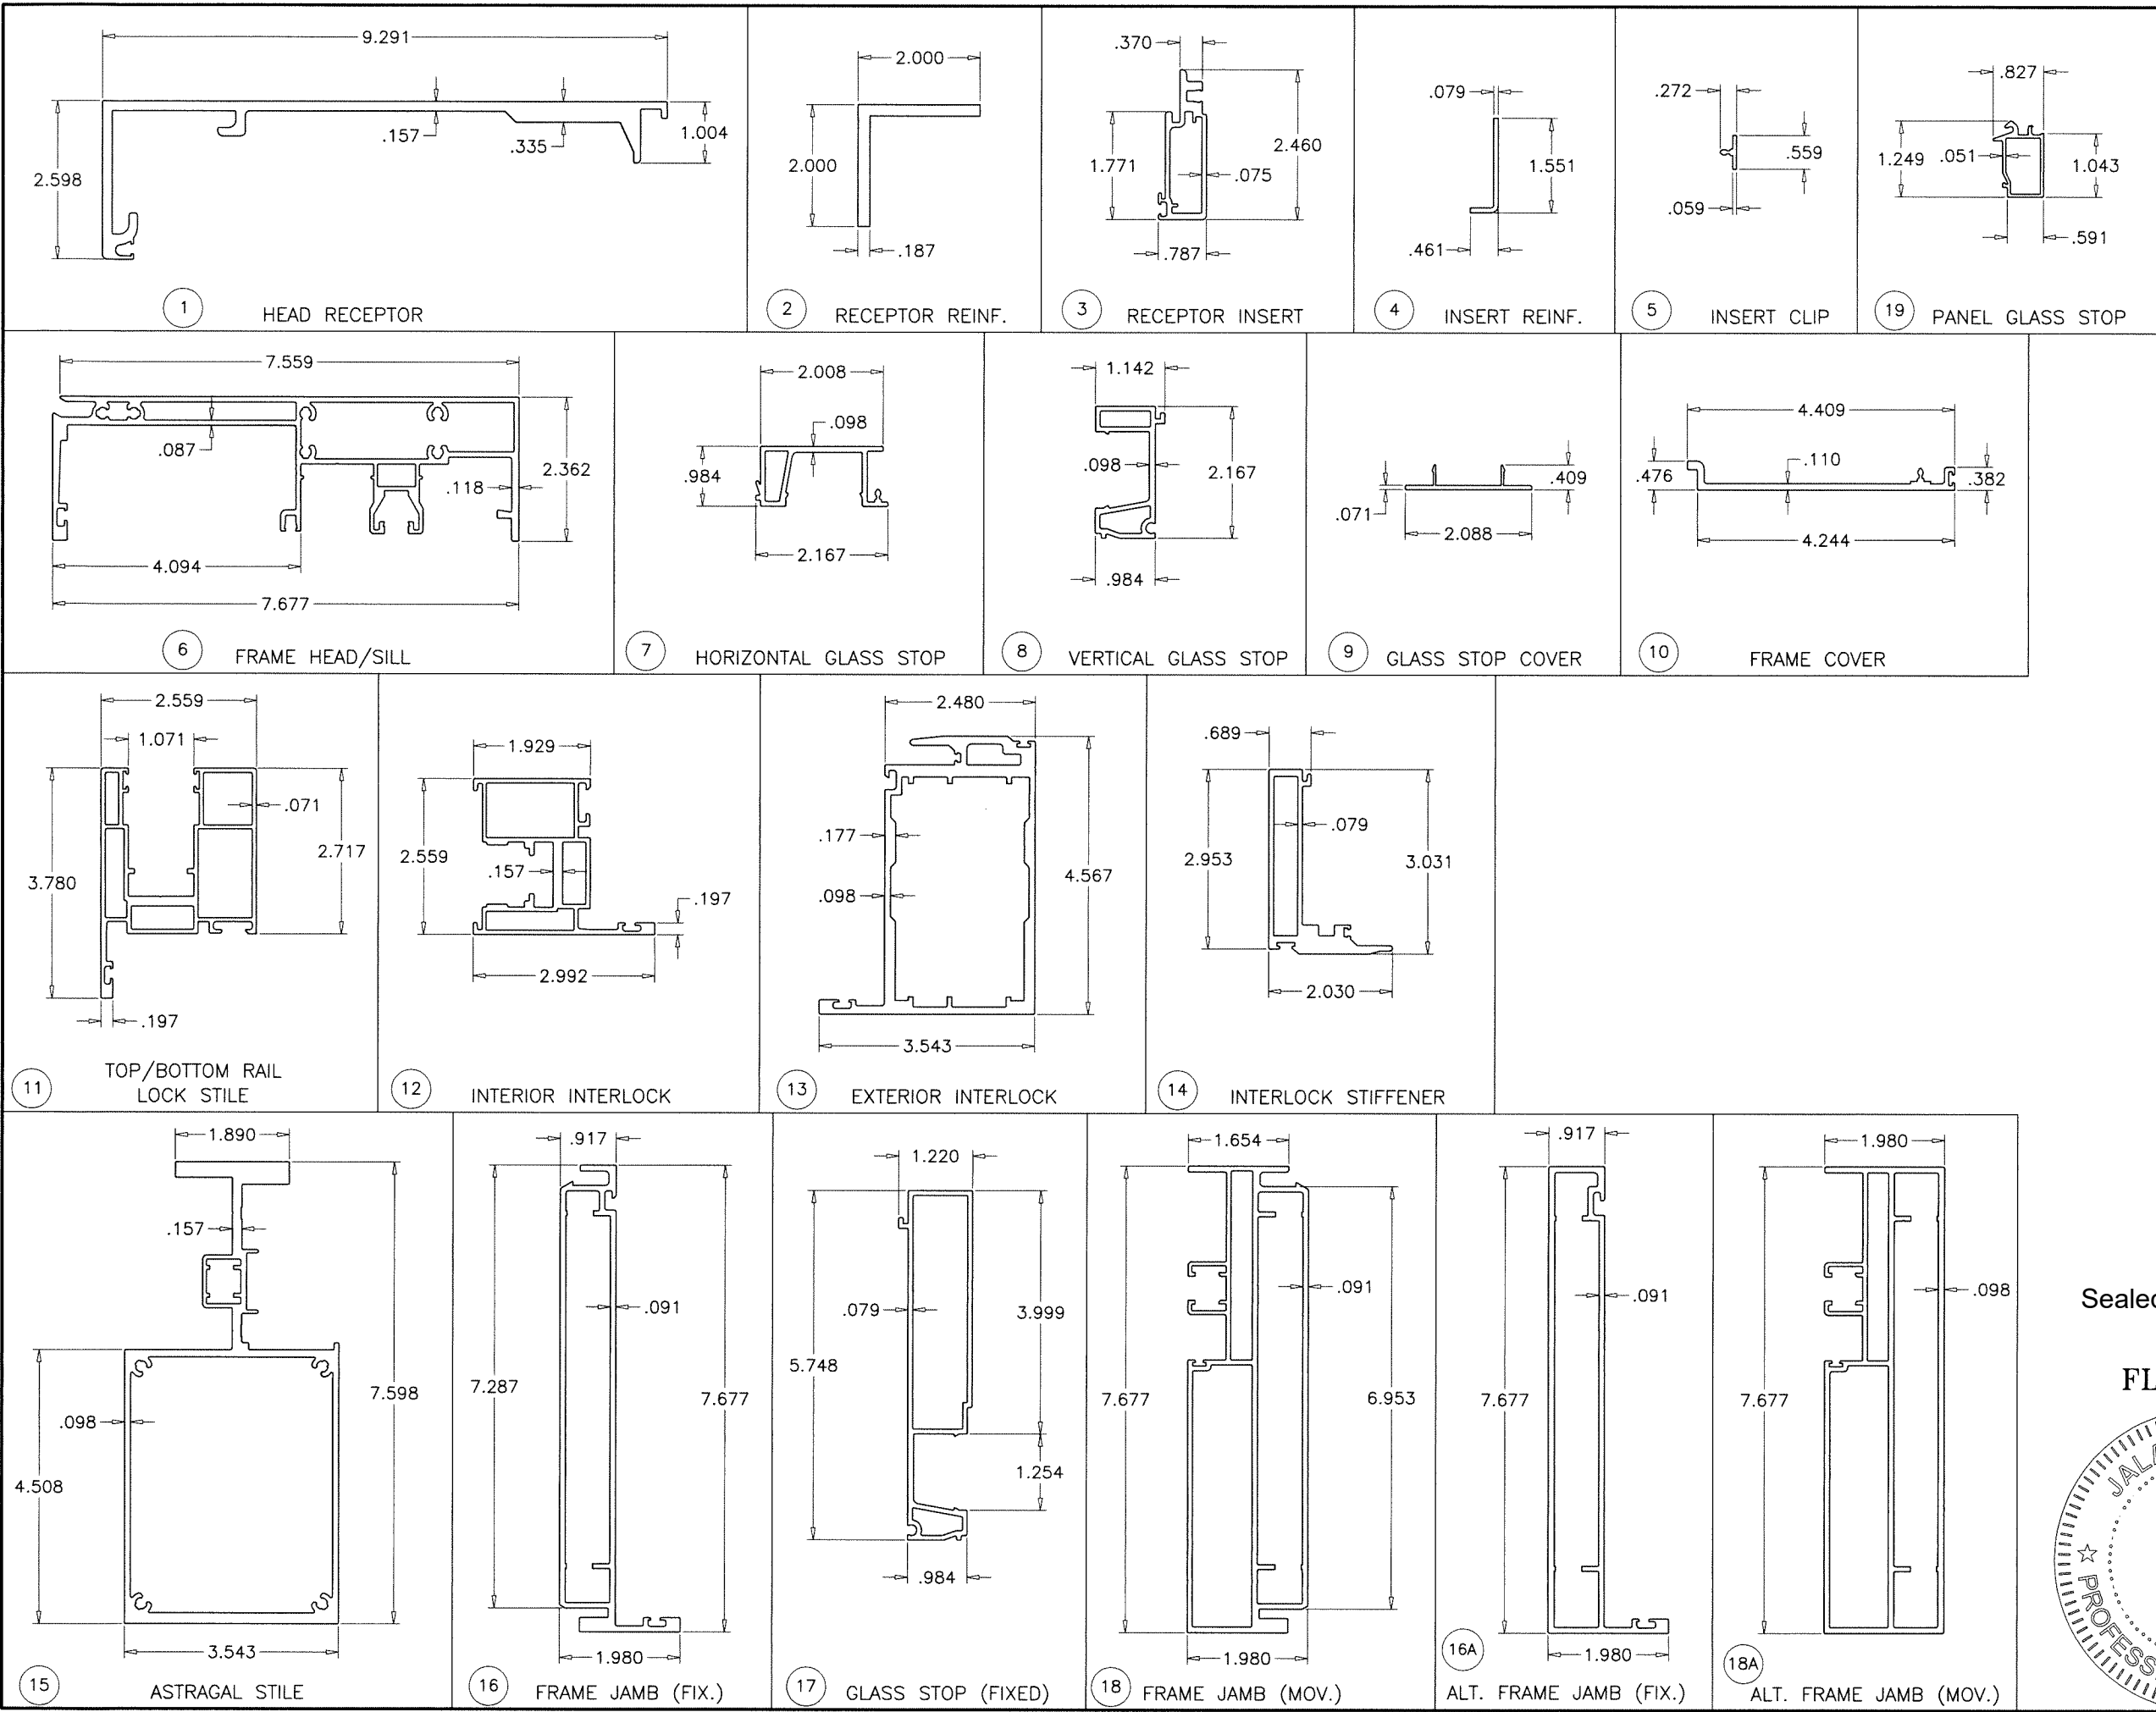

Sealed: 6/20/2025

FL #29516

JALAL FAROOQ
LICENSE
No. 81223
STATE OF FLORIDA
PROFESSIONAL ENGINEER

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 262-6978
FAX. (305) 264-8100

ES-LS7035 ALUMINUM SLIDING GL. DOOR (S.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151
FAX. (305) 638-5158

revisions:	
no	date by description

date: 03-30-19

scale: 3/8" = 1"

dr. by: TARIQ

chk. by:

drawing no.

19-30F

sheet 8 of 10

ITEM NO.	PART NUMBER	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	ES-LS7035-005	AS REQD.	HEAD RECEPTOR	6063-T6	-
2	ALU-A-028	AS REQD.	RECEPTOR REINF. 20" LONG AT MULLION LOCATION	6063-T6	-
3	ES-LS7035-009	AS REQD.	RECEPTOR INSERT	6063-T6	-
4	-	AS REQD.	INSERT REINFORCING	6063-T6	-
5	ES-LS7035-019	AS REQD.	INSERT CLIP	6063-T6	-
6	ES-LS7035-008	AS REQD.	FRAME HEAD/SILL	6063-T6	-
7	ES-LS7035-015	AS REQD.	HORIZONTAL GLASS STOP	6063-T6	-
8	ES-LS7035-014	AS REQD.	VERTICAL GLASS STOP	6063-T6	-
9	ES-LS7035-020	AS REQD.	GLASS STOP COVER	6063-T6	-
10	ES-LS7035-023	AS REQD.	GLASS STOP COVER	6063-T6	-
11	ES-LS7035-018	AS REQD.	TOP/BOTTOM RAIL & LOCK STILE	6063-T6	-
12	ES-LS7035-017	AS REQD.	INTERIOR INTERLOCK	6063-T6	-
13	ES-LS7035-010	AS REQD.	EXTERIOR INTERLOCK	6063-T6	-
14	ES-LS7035-012	AS REQD.	INTERLOCK STIFFENER	6063-T6	-
15	ES-LS7035-022	AS REQD.	ASTRAGAL STILE	6063-T6	-
16	ES-LS7035-001	AS REQD.	FRAME JAMB (FIX.)	6063-T6	-
16A	ES-LS7035-033	AS REQD.	ALT. FRAME JAMB	6063-T6	-
17	ES-LS7035-016	AS REQD.	GLASS STOP (FIXED)	6063-T6	-
18	ES-LS7035-007	AS REQD.	FRAME JAMB (MOV.)	6063-T6	-
18A	ES-LS7035-032	AS REQD.	ALT. FRAME JAMB (MOV.)	6063-T6	-
19	ES-LS7035-021	AS REQD.	PANEL GLASS STOP	6063-T6	-
20	-	AS REQD.	GLAZING GASKET	EPDM	DUROMETER 65±5 SHORE A
21	-	AS REQD.	RECEPTOR INTERIOR GASKET	SILICONE	DUROMETER 65±5 SHORE A
22	-	AS REQD.	RECEPTOR EXTERIOR GASKET	SILICONE	DUROMETER 65±5 SHORE A
23	-	AS REQD.	LEAF W'STRIPPING	VINYL	-
24	-	AS REQD.	FIN SEAL PILE W'STRIPPING	WOOL	-
25	-	AS REQD.	LEAF W'STRIPPING AT INTERLOCK	VINYL	-
26	-	AS REQD.	LEAF W'STRIPPING AT BOTTOM RAIL & LOCK STILE	VINYL	-
27	-	AS REQD.	SETTING BLOCK (FIXED)	EPDM	DUROMETER 80±5 SHORE A
27A	-	AS REQD.	SETTING BLOCK (PANEL)	EPDM	DUROMETER 80±5 SHORE A
28	-	AS REQD.	ROLLER ASSEMBLY	-	-
29	-	AS REQD.	ROLLER TRACK	STEEL	-
30	#12 X 1"	AS REQD.	FRAME ASSEMBLY SCREWS	ST. STEEL	PH SMS
31	#12 X 1"	AS REQD.	RECEPTOR INSERT FASTENERS	ST. STEEL	FH SMS
32	#10 X 1/2"	AS REQD.	GLASS STOP FASTENERS, AT 3" FROM ENDS & 10" O.C.	ST. STEEL	PH SMS
33	#10 X 1/2"	AS REQD.	STIFFENER FASTENERS, AT 3" FROM ENDS & 10" O.C.	ST. STEEL	PH SMS
34	#10 X 1/2"	AS REQD.	ASTRAGAL FASTENERS, AT 3" FROM ENDS & 10" O.C.	ST. STEEL	FH SMS
35	-	AS REQD.	INTERIOR GLAZING GASKET	EPDM	DUROMETER 65±5 SHORE A

SEALANT:

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH WHITE/ALUMINUM COLORED SILICONE.

LOCKS:

OPTION #1

SURFACE MOUNT METALLIC THREE PLY DUAL HOOK LOCK AT 36" FROM BOTTOM
FASTENED TO LOCK STILE WITH
(2) #10 X 1-1/2" FH SELF DRILLING SCREWS

SURFACE MOUNT METALLIC KEEPER FACING LOCK AT 38" FROM BOTTOM
FASTENED WITH
(2) #10 X 1-1/2" FH SMS

OPTION #2

SURFACE MOUNT METALLIC 3 POINT LOCK AT 36" FROM BOTTOM
FASTENED TO LOCK STILE WITH
(2) #10 X 1-1/2" FH SELF DRILLING SCREWS

SURFACE MOUNT METALLIC KEEPER FACING LOCK AT 38" FROM BOTTOM
FASTENED WITH
(2) #10 X 1-1/2" FH SMS

OPTION #3

LOCK (279194) WITH LATCH (241849) AND RETAINING CATCH (241850) AT 36" FROM BOTTOM
SHOOT BOLT (461220) ENGAGING AT SILL



Sealed: 6/20/2025

FL #29516

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 262-6978 FAX. (305) 262-6978
(C.A.N. 3538)

ES-LS7035 ALUMINUM SLIDING GL. DOOR (S.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158


revisions:

no	date	by	description

date: 03-30-19	scale: 3/8" = 1"	dr. by: TARIQ	chk. by:
----------------	------------------	---------------	----------

drawing no.
19-30F


sheet **9** of 10

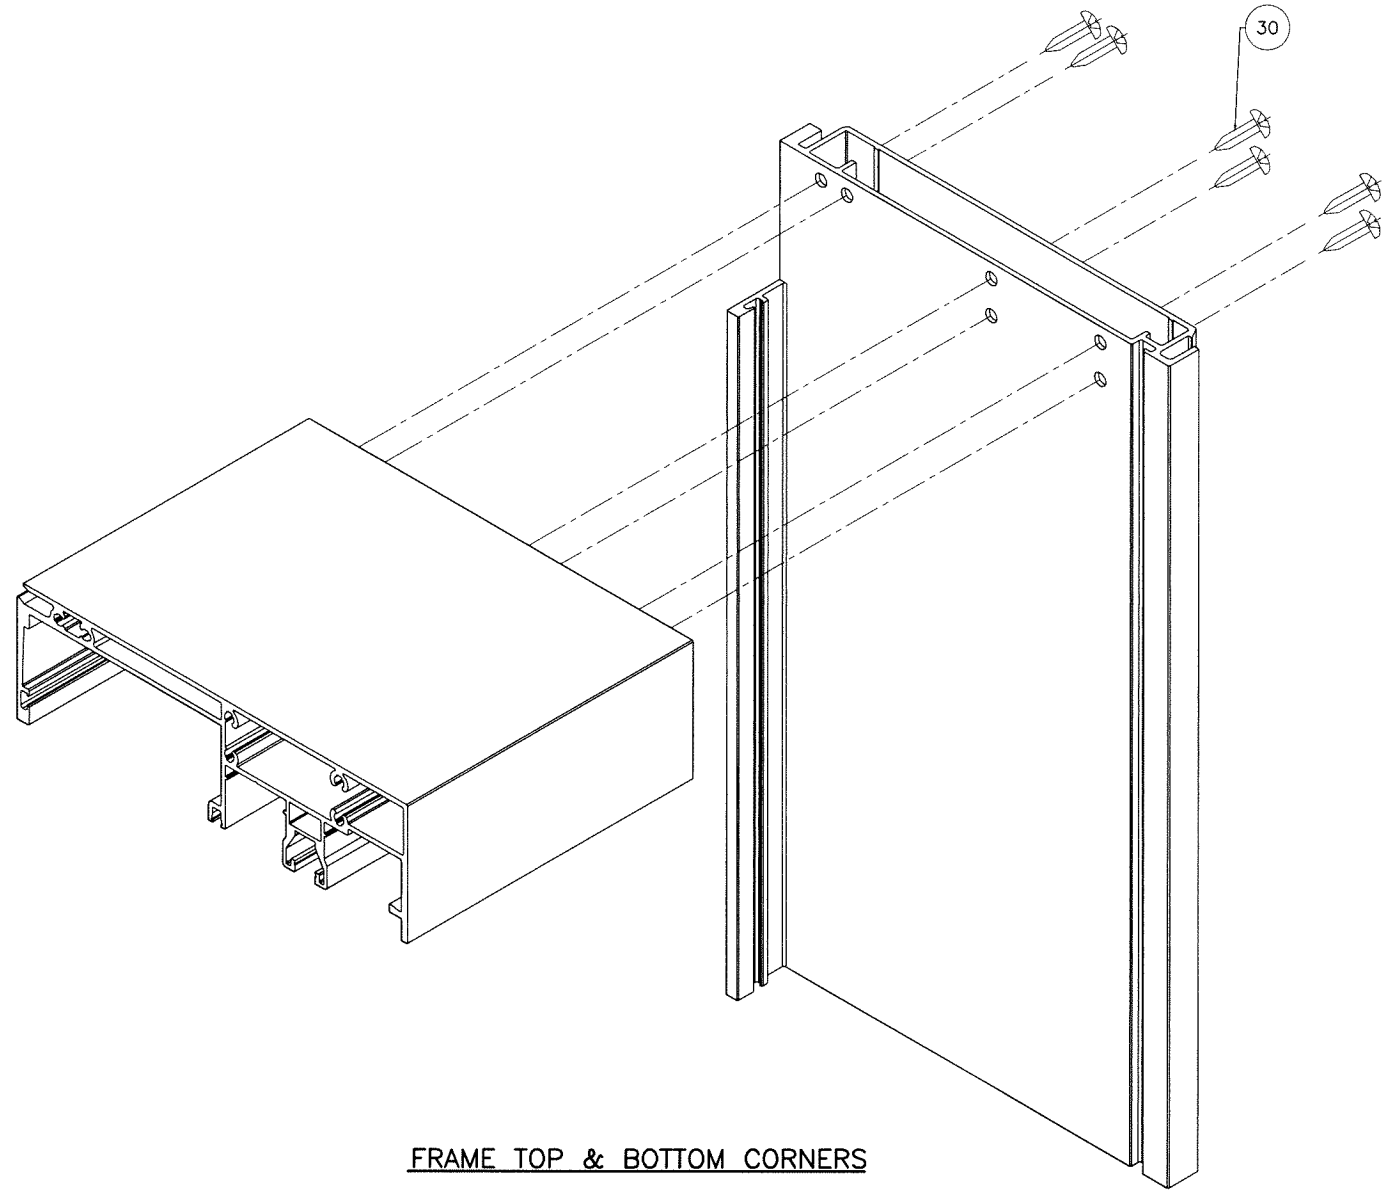

FRAME TOP & BOTTOM CORNERS

Sealed: 6/20/2025

FL #29516

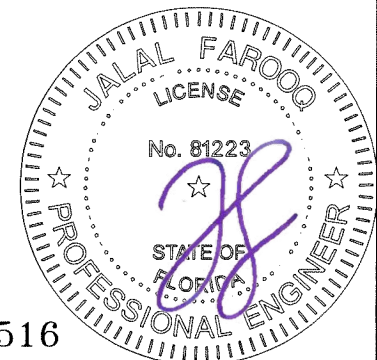

AL-FAROOQ CORPORATION ENGINEERS & PRODUCT DEVELOPMENT 9360 SUNSET DRIVE, SUITE 220 MIAMI, FLORIDA 33173 TEL. (305) 264-8100 FAX. (305) 262-6978 (C.A.N. 3538)		E.S. WINDOWS, LLC 3550 N.W. 49 STREET MIAMI, FL. 33142 TEL. (305) 638-5151 FAX. (305) 638-5158		ES-LS7035 ALUMINUM SLIDING GL. DOOR (S.M.I.)																									
date: 03-30-19 scale: 3/8" = 1" dr. by: TARIQ chk. by:		revisions: <table border="1"> <thead> <tr> <th>no</th> <th>date</th> <th>by</th> <th>description</th> </tr> </thead> <tbody> <tr><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td></tr> </tbody> </table>		no	date	by	description																					drawing no. 19-30F sheet 10 of 10	
no	date	by	description																										

COMP-ANL\19-30F-ES