

THIS SYSTEM IS RATED FOR SMALL MISSILE IMPACT.
F.B.C. APPROVED IMPACT RESISTANT SHUTTERS
REQUIRED FOR INSTALLATIONS UP TO 30 FT. OF GRADE.
SHUTTERS NOT REQD. FOR INSTALLATIONS ABOVE 30 FT. OF GRADE.

GMP-200
SPIDERGLASS WINDOW WALL SYSTEM

THIS SYSTEM MAY BE USED IN CONJUNCTION WITH F.B.C. APPR'D
SMALL MISSILE IMPACT RESISTANT DOORS.

LOWER DESIGN PRESSURE FROM WINDOW WALL OR DOOR APPROVAL
WILL APPLY TO ENTIRE SYSTEM.

CODE REQUIREMENTS FOR SAFEGUARDS MUST BE OBSERVED.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE
REQUIREMENTS OF THE 2020 (7TH EDITION)/2023 (8TH EDITION) FLORIDA
BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS
AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE
MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT
COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE
REQUIREMENTS OF THE 2020/2023 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION
FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY
OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR
WATER INFILTRATION RESISTANCE ETC.
CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY,
AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION
IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE.
LABELING TO COMPLY WITH SECTION 1709.9.2.

INSTRUCTIONS:

USE CHARTS AS FOLLOWS.

- STEP 1** DETERMINE DESIGN WIND PRESSURE REQUIREMENTS BASED
ON WIND VELOCITY, BLDG. HEIGHT, WIND ZONE USING
APPLICABLE ASCE 7 STANDARD.
- STEP 2** SEE CHARTS ON SHEET 3 FOR GLASS DESIGN LOAD
CAPACITY.
- STEP 3** CHECK MULLION DESIGN LOAD CAPACITY FOR A GIVEN
SPACING AND HEIGHT USING CHARTS ON SHEETS 4 & 5
THE CAPACITY SHOULD EXCEED THE DESIGN LOAD.
- STEP 4** THE LOWEST VALUE RESULTING FROM STEPS 3 AND 4
THAT EXCEED THE DESIGN WIND PRESSURES DETERMINED
THRU STEP 1 SHALL APPLY TO ENTIRE SYSTEM.
- STEP 5** FOR UNANCHORED JAMBS, USING SHEET 8, DETERMINE
THE MIN. & MAX. GAP DIMENSIONS.
- STEP 6** WHEN USING THIS SYSTEM WITH DOORS, THE LOWER
VALUE OF THE DESIGN PRESSURE RATING FOR THE
SYSTEM AND THE DOOR SHALL APPLY.

LAMINATED GLASS
SMALL MISSILE IMPACT

Sealed: 9/29/2023

FL #29517

A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND
INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION
PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED
ON THIS DOCUMENT.

B- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF
ALTERED BY ANY MEANS.

C- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED
ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.)
FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER
USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED
ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE
SPECIFIC DRAWINGS FOR REVIEW.

D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF
THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.



revisions:	
no	date
A	12.04.20
B	09.27.23
description	
UPDATED TO 2020 FBC	
UPDATED TO 2023 FBC	
date:	08-03-18
scale:	-
dr. by:	TARIQ
chk. by:	
drawing no.	
19-32F	
sheet 1 of 9	

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

GMP-200 SPIDERGLASS WINDOW WALL SYSTEM (S.M.I.)


E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

af c

STORE\19-32F-ES




FL #29517

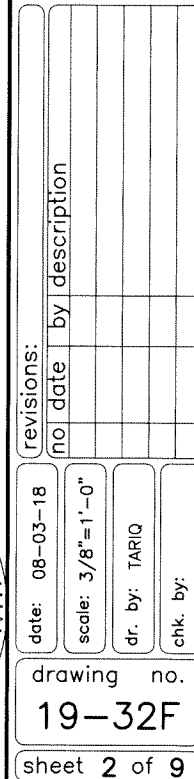


FAX. (305) 638-5158

202-0918 STORE\19-32F-ES

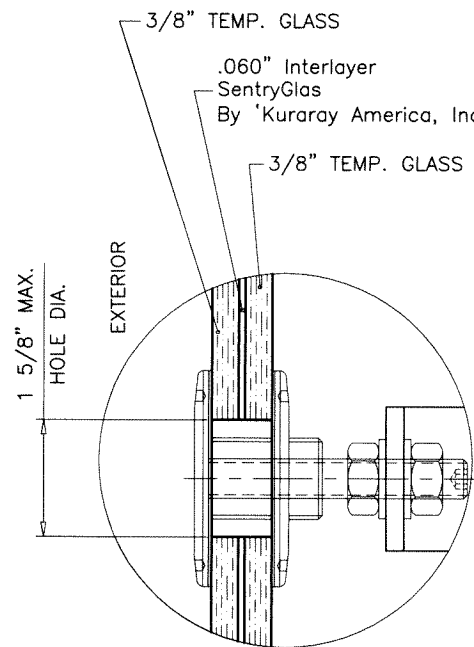

GLASS TYPE 'A'
13/16" OVERALL NOMINAL THK.


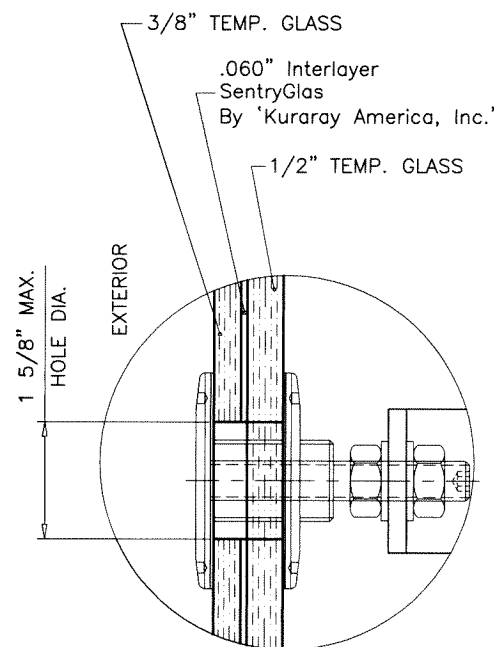


GLASS TYPE 'B'
15/16" OVERALL NOMINAL THK.

GLAZING OPTIONS

DESIGN LOAD CAPACITY (GLASS TYPE 'A')					
GLASS DIMS.		SUPPORT DIMS.		LOADS - PSF	
WIDTH (W1)	HEIGHT (H1)	WIDTH (W2)	HEIGHT (H2)	EXT.(+)	INT.(-)
30"	79"	23"	72-1/2"	130.0	130.0
36"		29"		130.0	130.0
42"		35"		130.0	130.0
48"		41"		130.0	130.0
54"		47"		130.0	130.0
60"	55"	53"	48-1/2"	115.0	115.0
66"		59"		104.0	104.0
72"		65"		96.0	96.0

DESIGN LOAD CAPACITY (GLASS TYPE 'B')					
GLASS DIMS.		SUPPORT DIMS.		LOADS - PSF	
WIDTH (W1)	HEIGHT (H1)	WIDTH (W2)	HEIGHT (H2)	EXT.(+)	INT.(-)
30"	79-1/8"	23"	72-5/8"	170.0	170.0
36"		29"		170.0	170.0
42"		35"		170.0	170.0
48"		41"		170.0	170.0
54"		47"		152.0	152.0
60"	51"	53"	44-7/16"	137.0	137.0
66"		59"		125.0	125.0
72"		65"		114.0	114.0

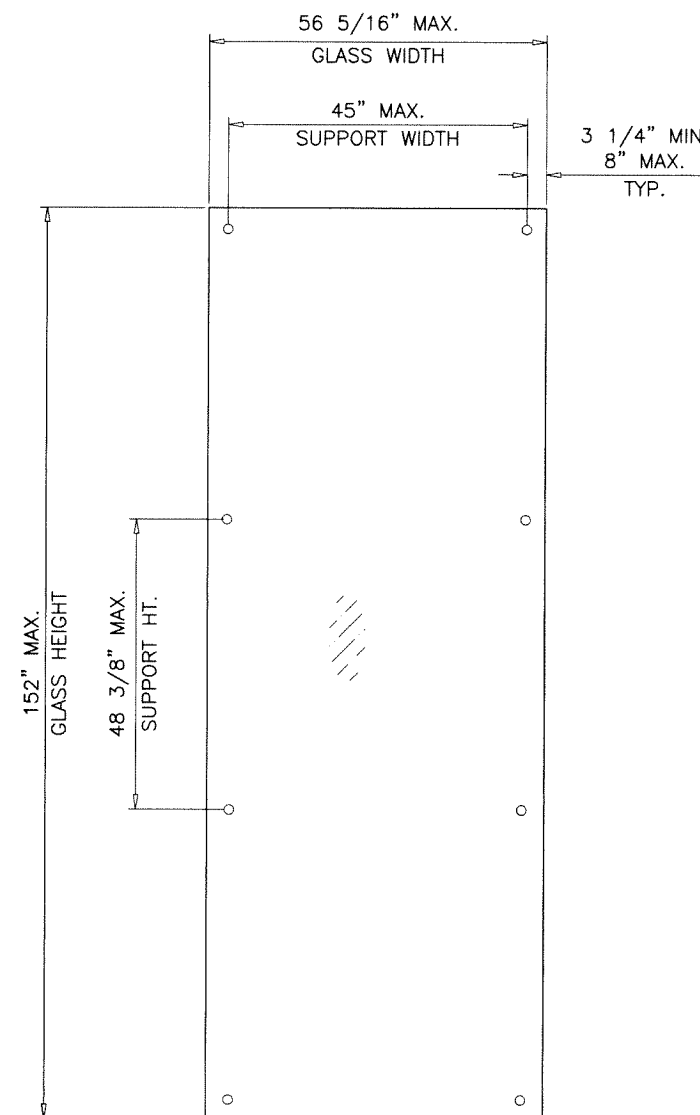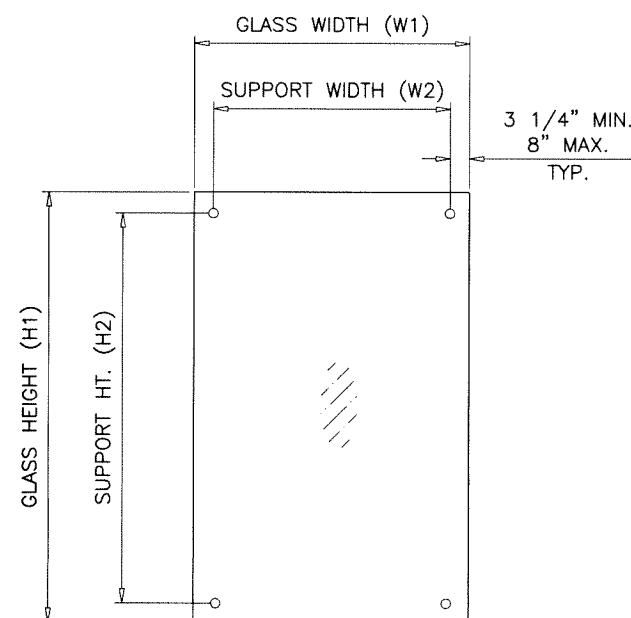

GLASS TYPE 'A'
MAXIMUM DESIGN LOAD RATING = + 135.0 PSF
(FOR SIZES SHOWN ABOVE OR SMALLER) - 135.0 PSF

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS).

Sealed: 9/29/2023



FL #29517

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL: (305) 264-8100 FAX: (305) 262-6978

STORE \ 19-32F-ES



GMP-200 SPIDERGLASS WINDOW WALL SYSTEM (S.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL: (305) 638-5151 FAX: (305) 638-5158

revisions:		no	date	by	description

date: 08-03-18
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
19-32F
sheet 3 of 9

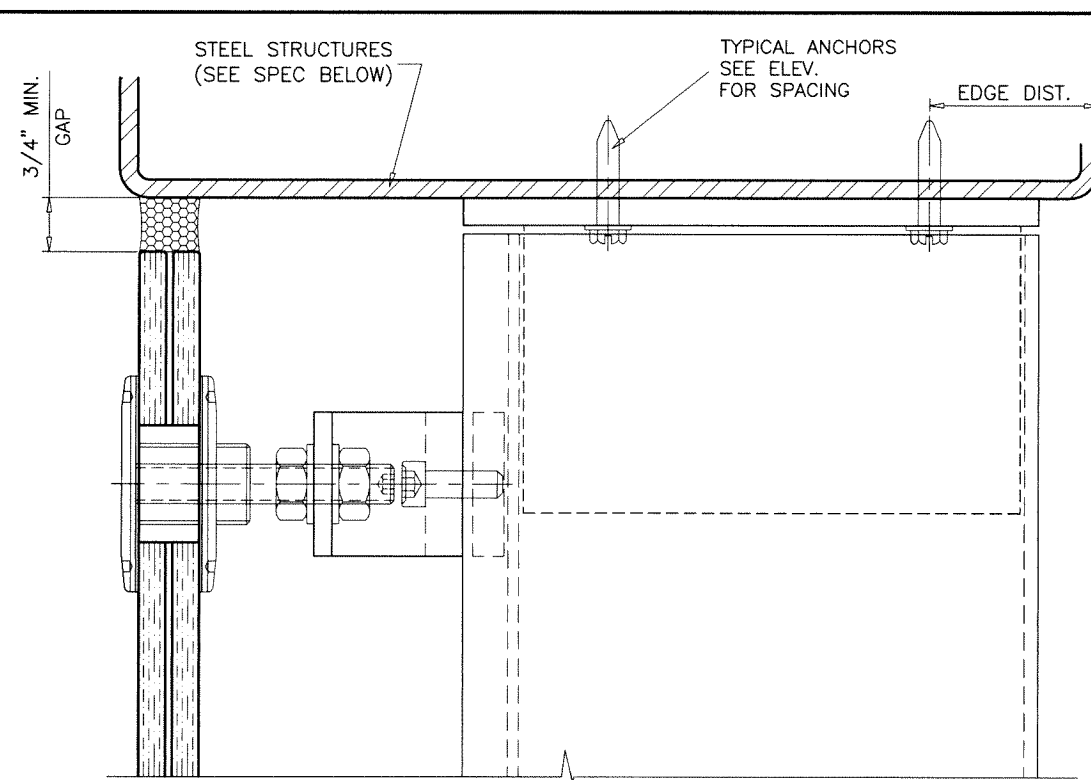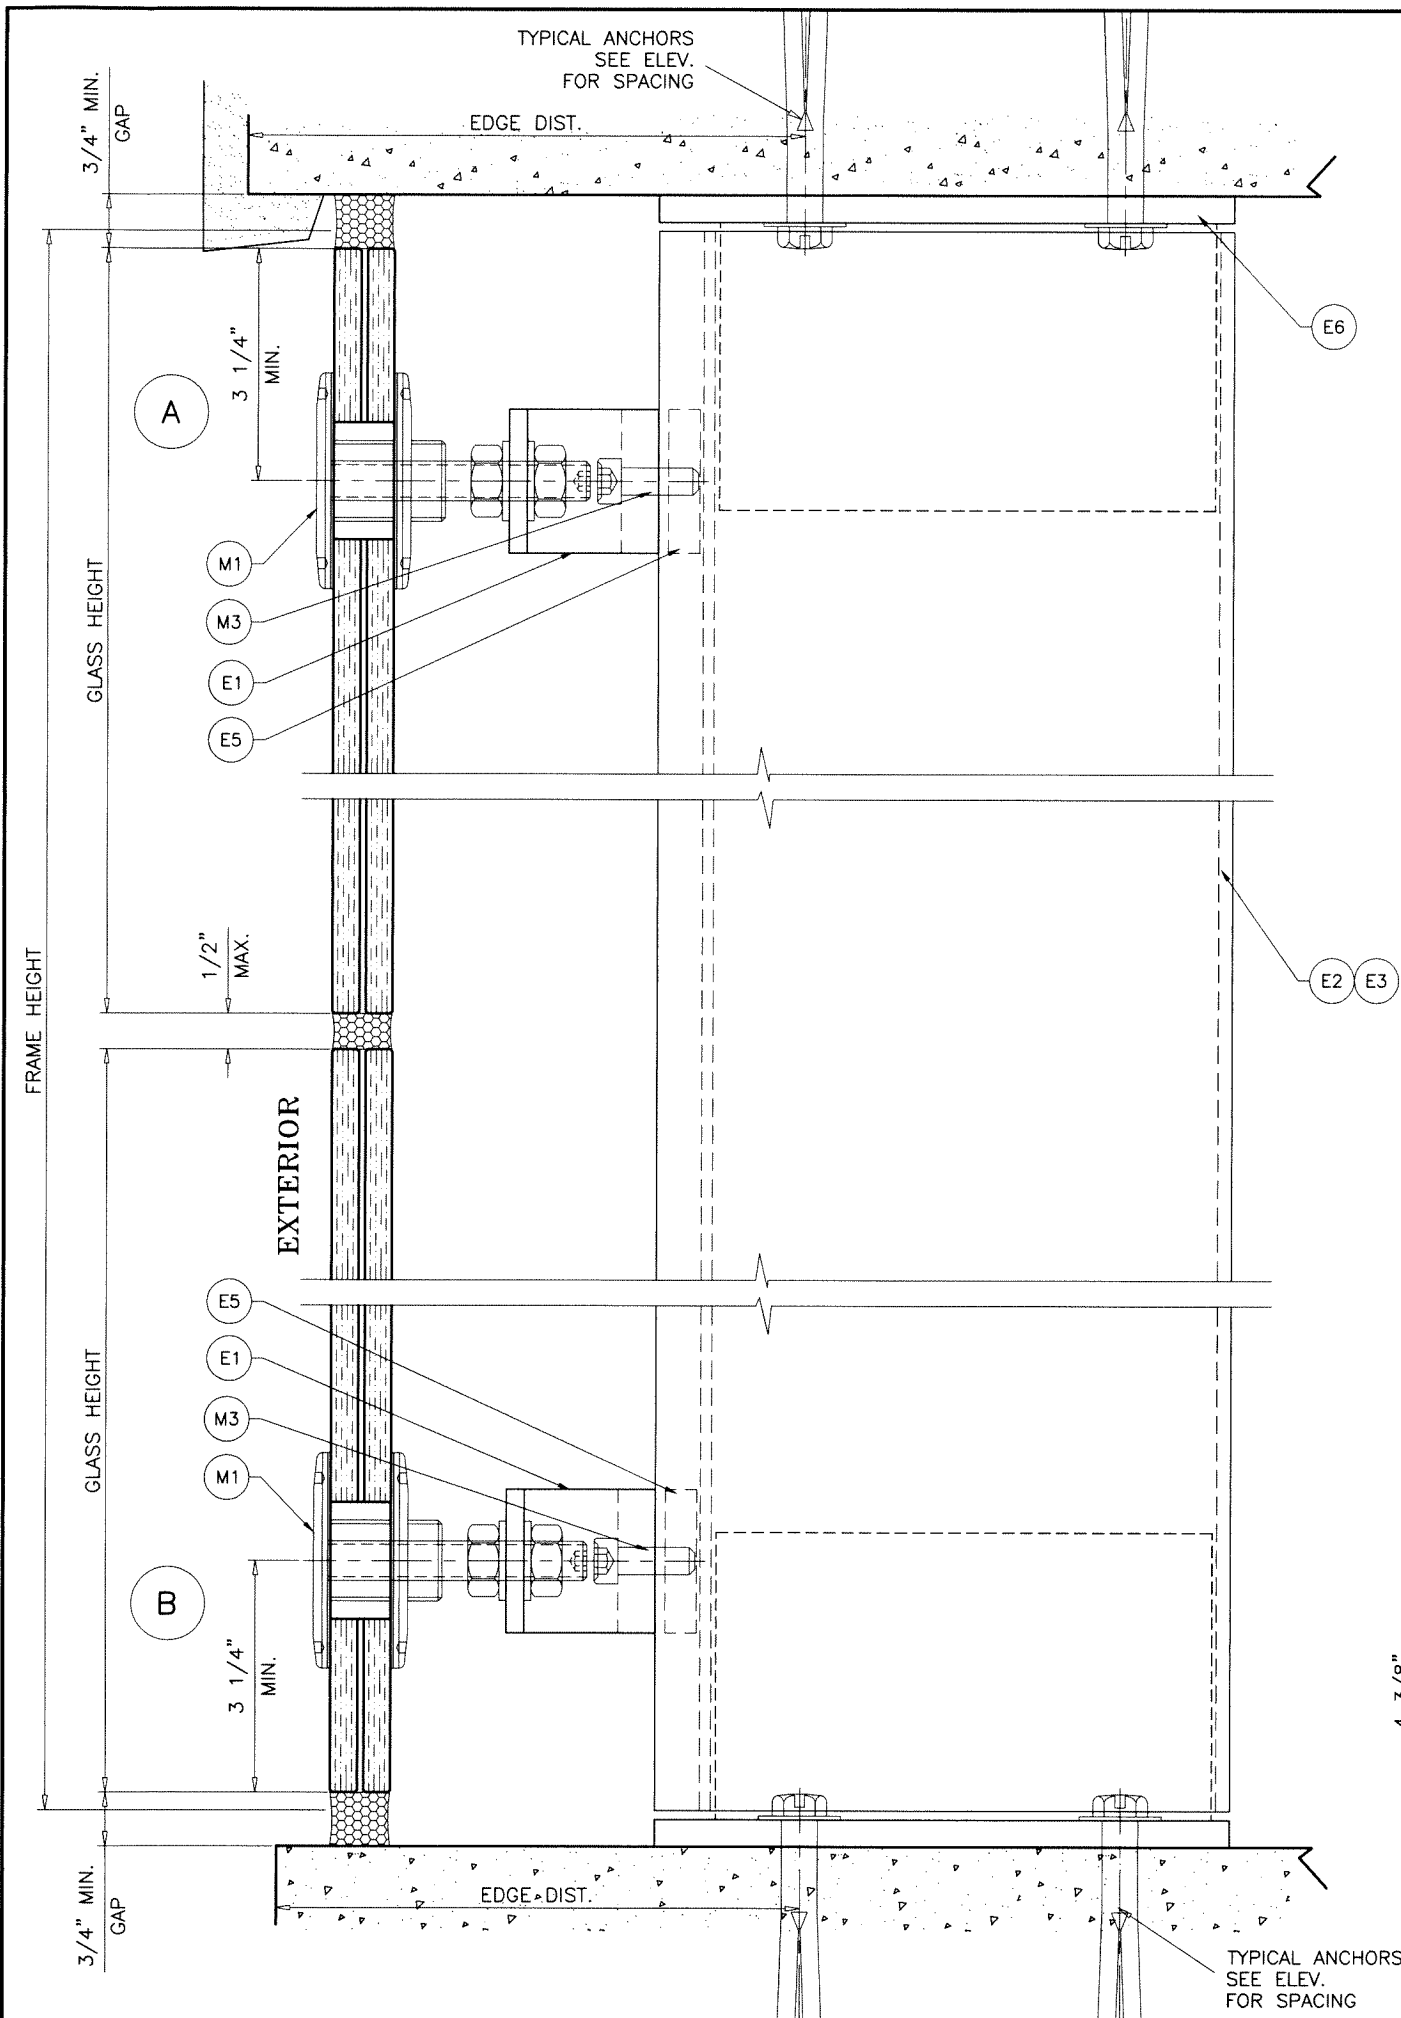

METAL STRUCTURES NOT BY 'E.S. WDW.'
MUST SUPPORT LOADS IMPOSED BY GLAZING SYSTEM AND
TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING


ANCHOR 'A'

DIRECTLY INTO CONCRETE
1/2" DIA. KWIK BOLT-3 EXPANSION ANCHOR
(4) PER PLATE
WITH 2-3/4" MIN. EMBED INTO CONCRETE.
4" MIN. EDGE DIST.
4-1/2" MIN. CENTERLINE-TO-CENTERLINE DISTANCE

ANCHOR 'C'


INTO METAL STRUCTURES (STEEL 1/4" MIN. THICKNESS)
1/2" TAP-FLEX SELF DRILLING SCREWS
(4) PER PLATE
1" MIN. EDGE DIST.
1" MIN. CENTERLINE-TO-CENTERLINE DISTANCE
(3) THREADS TO EXTEND BEYOND METAL THICKNESS

NOTE:
ANCHOR TORQUED AND OTHERWISE INSTALLED AS
PER MANUFACTURER SPECIFICATIONS.

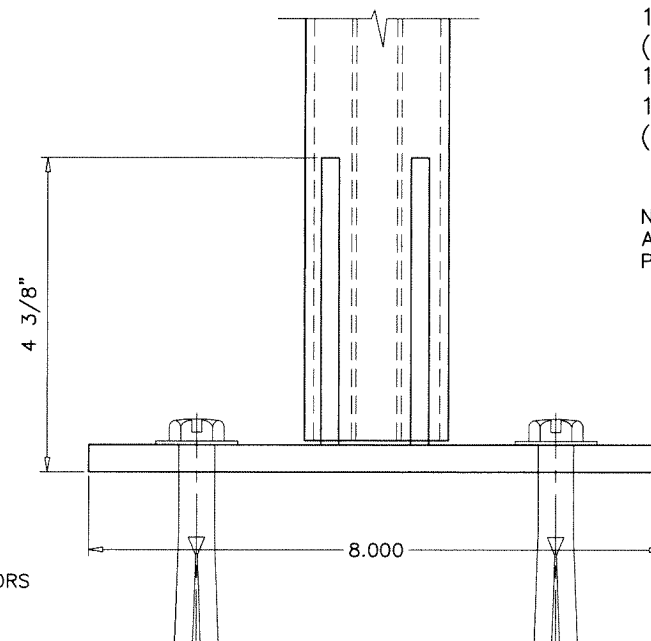

Sealed: 9/29/2023

FL #29517

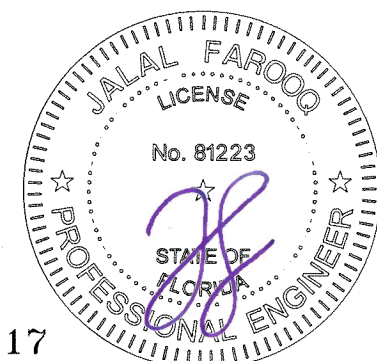

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL: (305) 264-8100 FAX: (305) 262-6978

STORE \ 19-32F-ES


GMP-200 SPIDERGLASS WINDOW WALL SYSTEM (S.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL: (305) 638-5151 FAX: (305) 638-5158

revisions:		by description	
no	date		

date: 08-03-18
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
19-32F
sheet 6 of 9

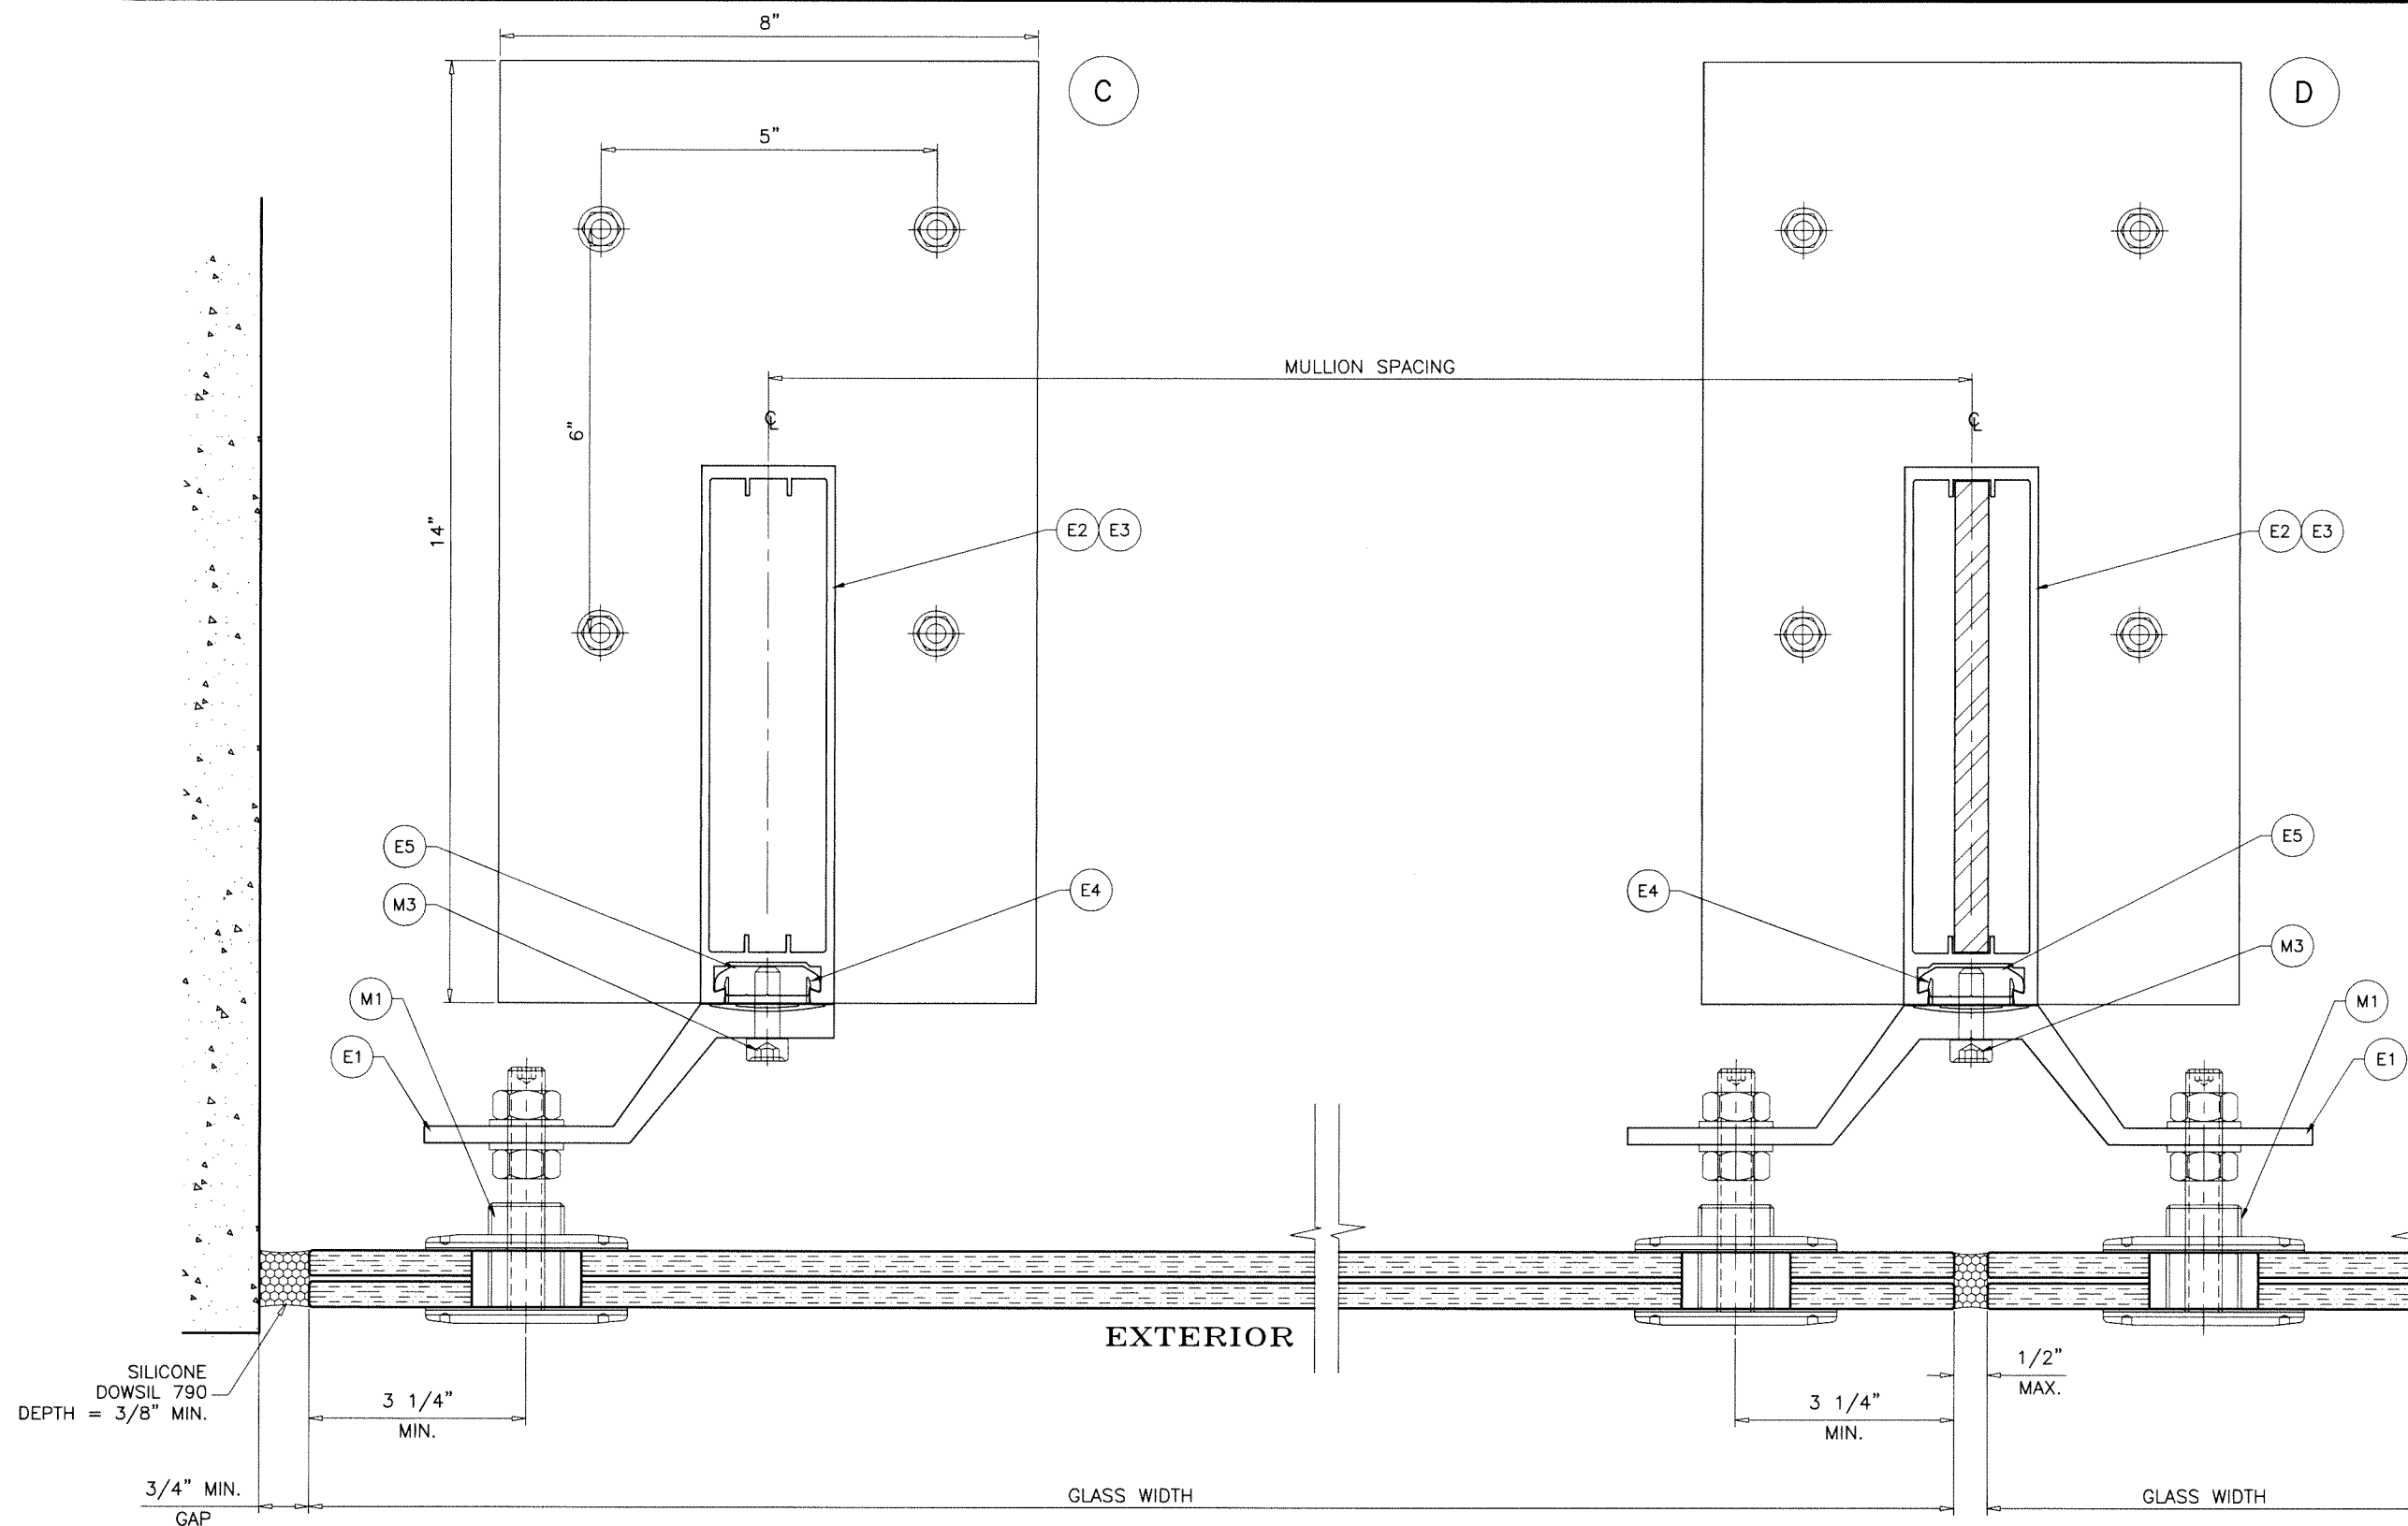


NOTE:
 MAX. MOVEMENT CONSIDERED=100% STRETCH.
 PLEASE REFER TO SEALANT MANUFACTURER'S DATA AND APPLICATION
 MANUAL FOR COMPATABILITY OF SEALANT TO SUBSTRATE & WINDOWALL
 MATERIAL/FINISH AND COMPLIANCE FOR WARRANTY.
 REFER TO ACI-117-10 FOR CONSTRUCTION TOLERANCES.

ALTERNATE SEALANTS AT JAMB GAPS CAN BE DESIGNED BY
 ENGINEER OF RECORD BASED ON MANUFACTURER GUIDE LINES.

GAPS LESS THAN 1/4" MAY BE DESIGNED BY ENGINEER OF RECORD BY
 THE USE OF BOND BREAKER TAPE OR 15% OF GAP ALLOWED MOVEMENT.

Sealed: 9/29/2023

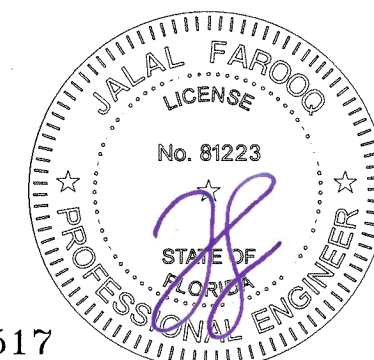

FL #29517

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978

af c
 STORE 19-32F-ES




GMP-200 SPIDERGLASS WINDOW WALL SYSTEM (S.M.I.)

E.S. WINDOWS, LLC
 3550 N.W. 49 STREET
 MIAMI, FL. 33142
 TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:		by description	
no	date		

date: 08-03-18
 scale: 3/8" = 1"
 dr. by: TARIQ
 chk. by:

drawing no.
19-32F
 sheet 7 of 9

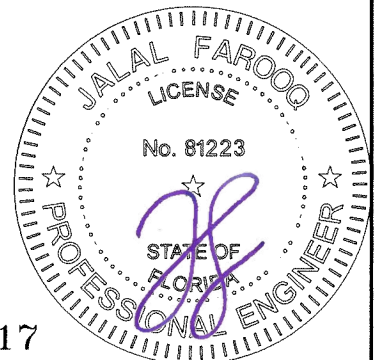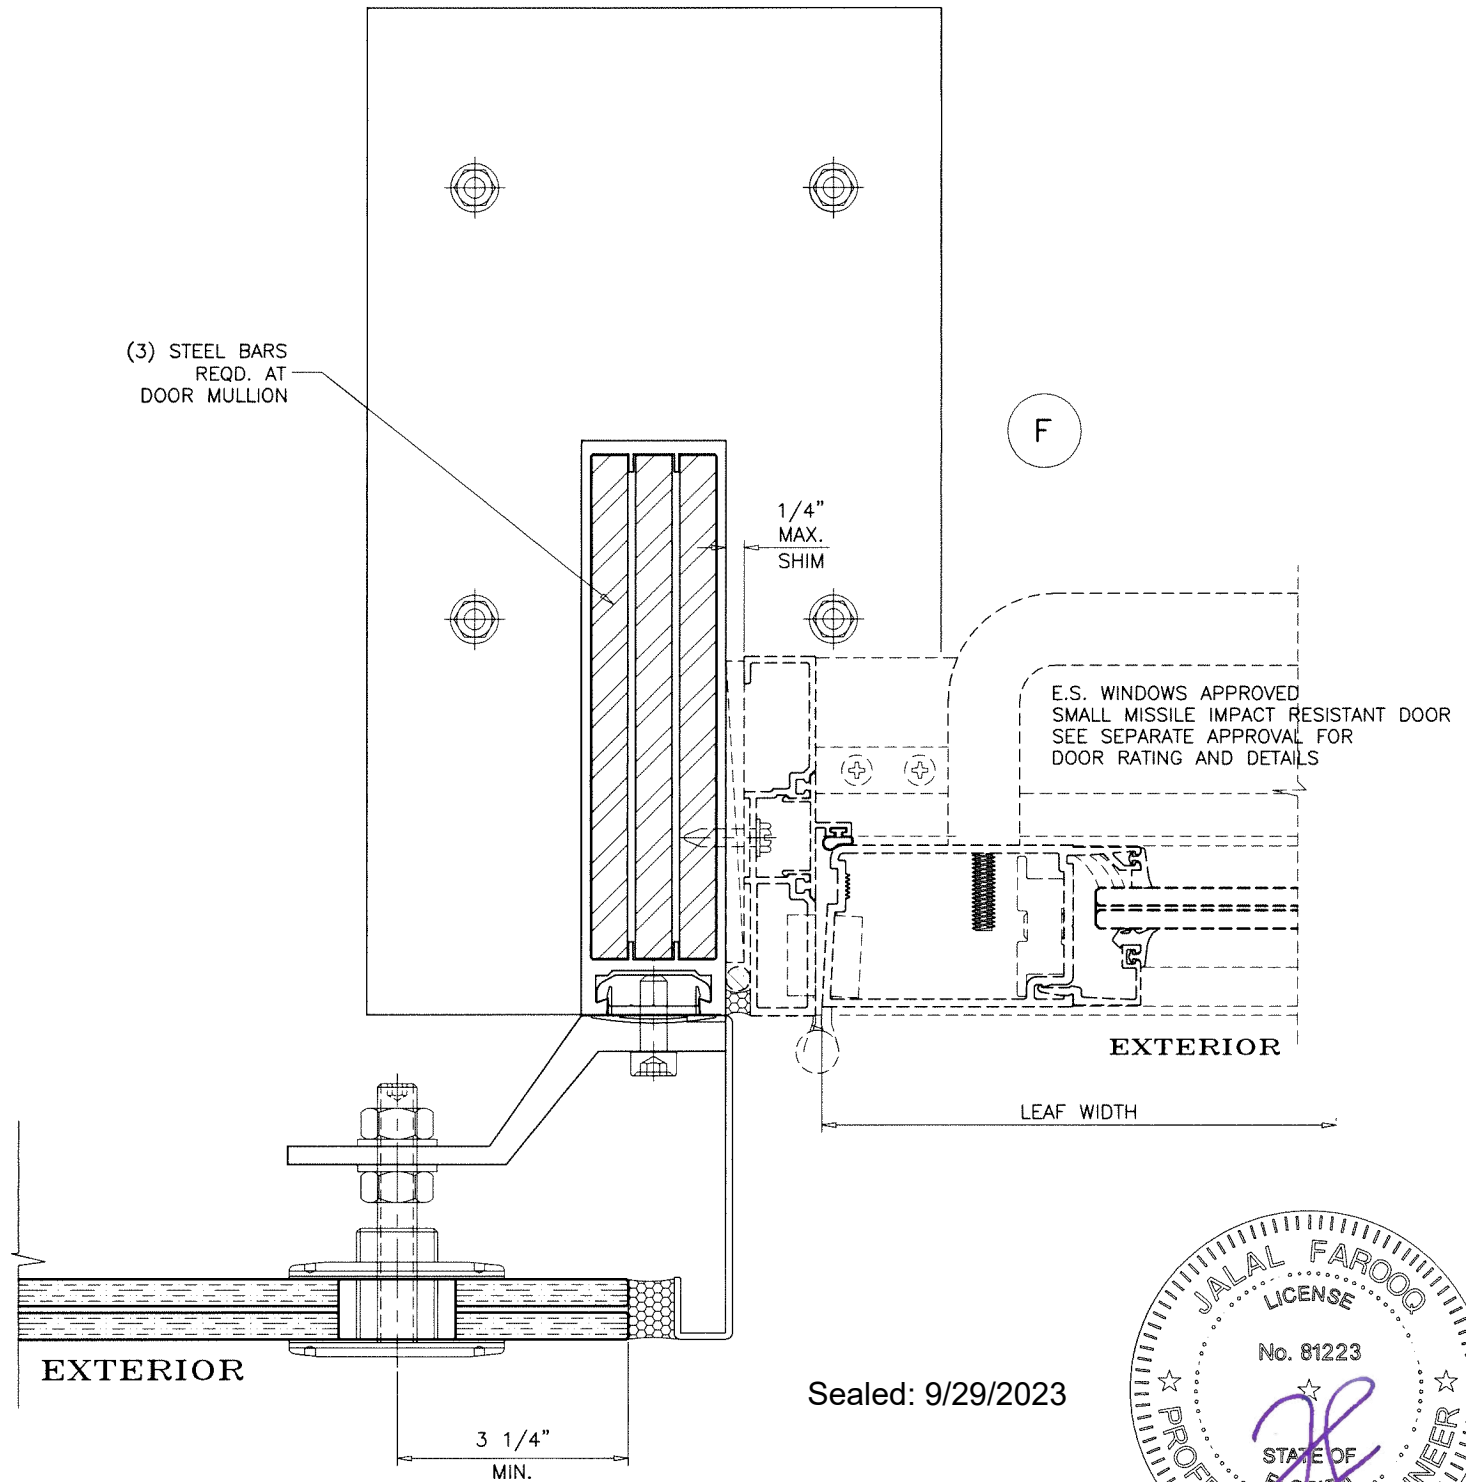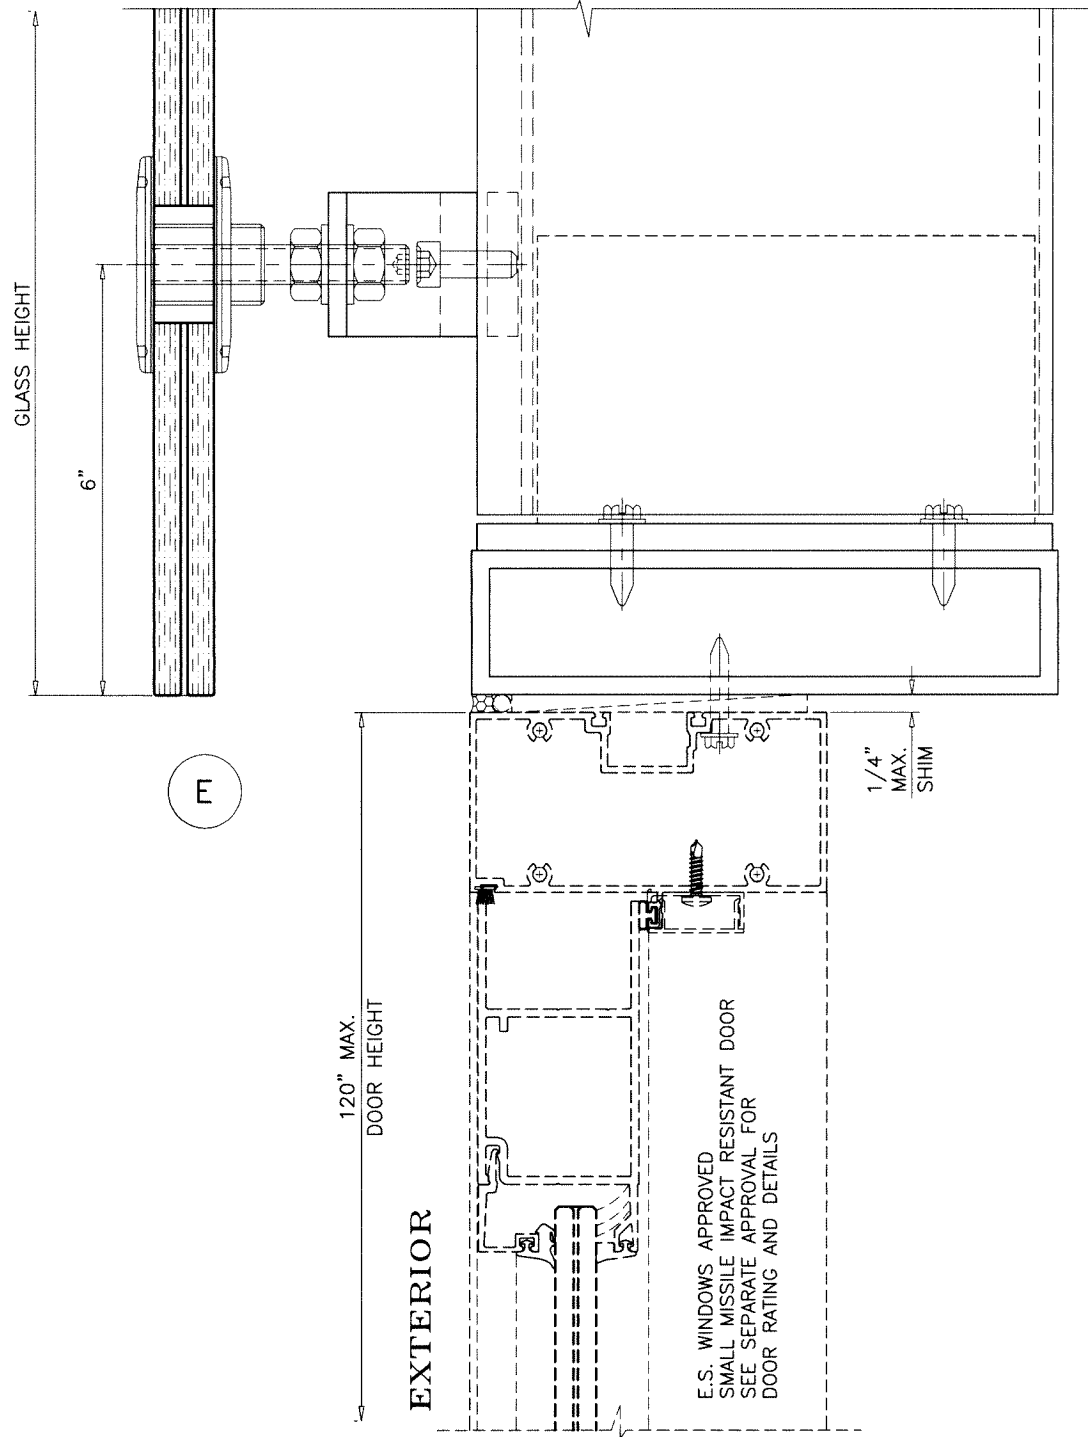

Sealed: 9/29/2023

FL #29517







AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
STORE 19-32F-ES

GMP-200 SPIDERGLASS WINDOW WALL SYSTEM (S.M.I.)
E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	
no	date by description

date: 08-03-18
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
19-32F
sheet 8 of 9

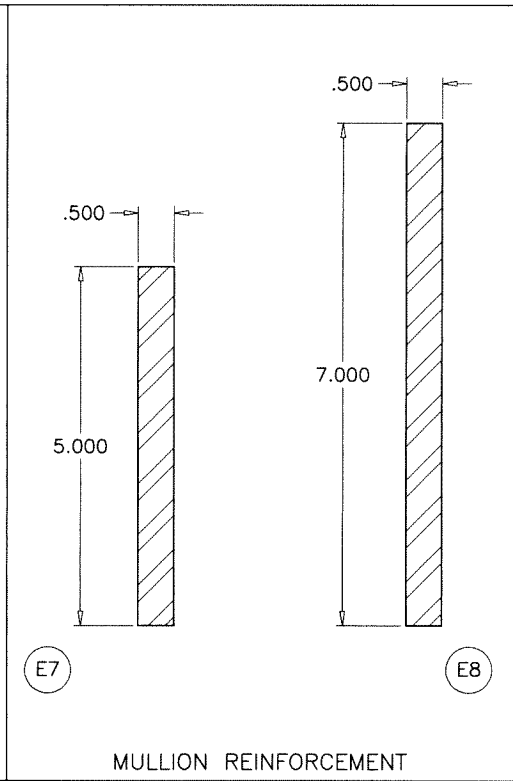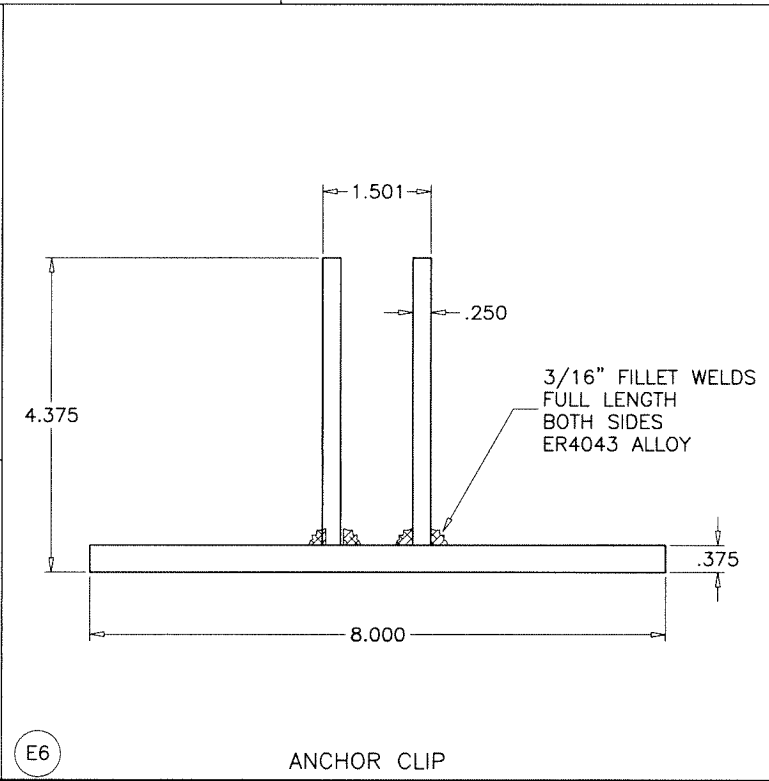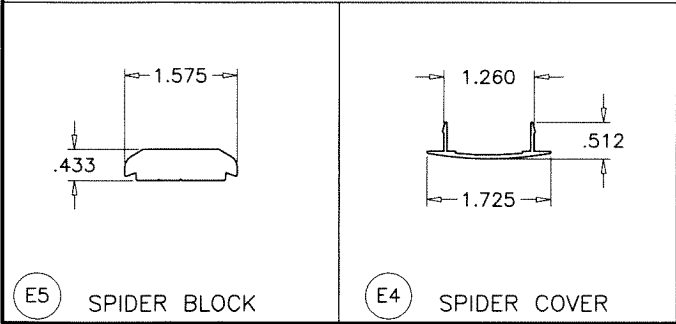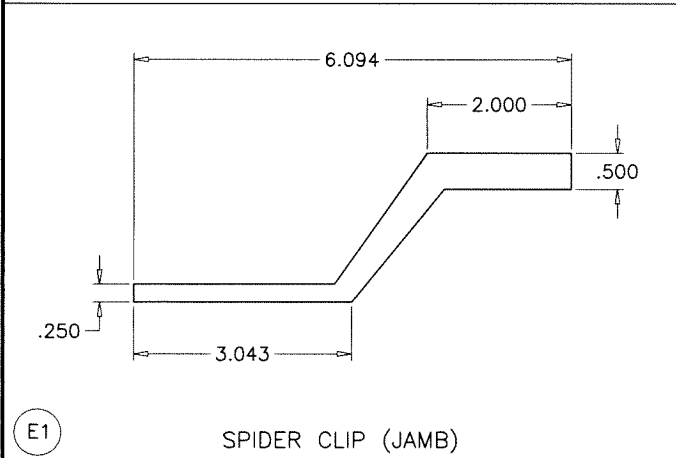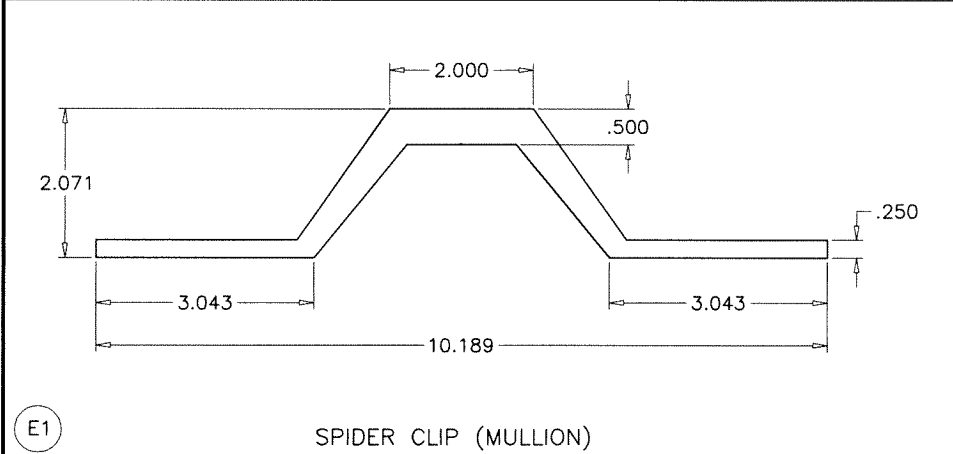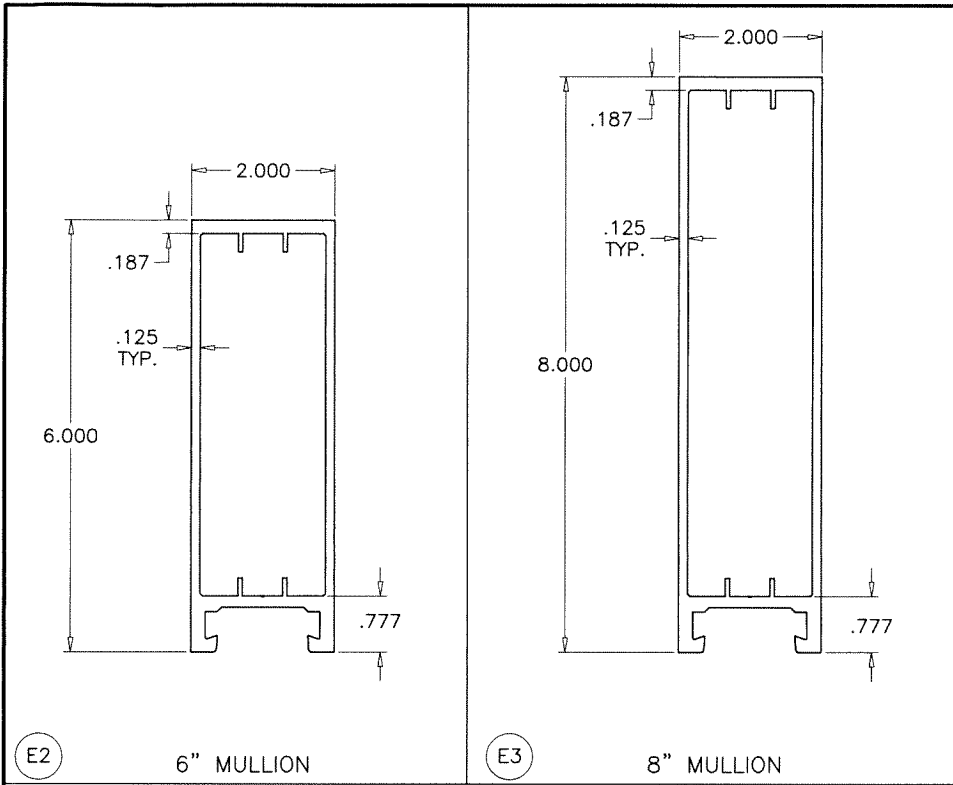


ITEM NO.	PART NUMBER	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
E1	GMP-210	AS REQD.	SPIDER CLIP	6005-T5	-
E2	GMP-216	AS REQD.	6" MULLION	6005-T5	-
E3	GMP-217	AS REQD.	8" MULLION	6005-T5	-
E4	GMP-950-006	AS REQD.	SPIDER SNAP COVER	6063-T6	-
E5	GMP-211	AS REQD.	SPIDER BLOCK	6063-T6	-
E6	GMP-215	AS REQD.	ALUMINUM ANCHOR	6063-T6	-
E7	-	AS REQD.	STEEL BAR (5" X 1/2")	STEEL	A36, Fu = 58 KSI MIN.
E8	-	AS REQD.	REINFORCING BAR (7" X 1/2")	STEEL	A36, Fu = 58 KSI MIN.
M1	-	AS REQD.	3" DIM. ROTULLE W/ 1/2" DIA. BOLT	ST. STEEL	-
M2	1/2" DIM.	AS REQD.	BOLT SCREW	ST. STEEL	-
M3	3/8 DIM-16 X 1-1/4"	AS REQD.	SOCKET HEAD CAP SCREW	ST. STEEL	-
-	-	-	-	-	-

SEALANTS:

ALL FRAME CORNERS, JOINTS, MULLION SEAMS AND PERIMETER OF GLAZING BEAD TO FRAME SEALED WITH SILICONE SEALANT.

Sealed: 9/29/2023

FL #29517

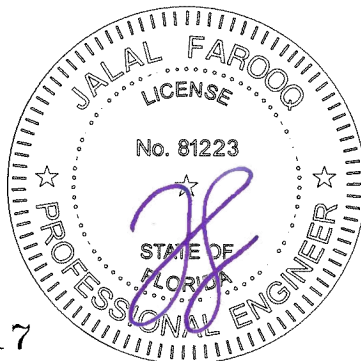

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:
no date by description

date: 08-03-18
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
19-32F
sheet 9 of 9

af c

STORE 19-32F-ES