

ALL DOOR INSTALLATIONS MUST BE IN ACCORDANCE WITH EGS INSTALLATION INSTRUCTIONS.
ALL SEALANTS TO BE TREMCO SPECTREM 2 OR EQUAL. (EQUAL SEALANTS MUST BE TESTED BY SEALANT MANUFACTURER FOR COMPATIBILITY & ADHESION).

APPLICABLE EGRESS REQUIREMENTS TO BE REVIEWED BY AHJ.

DAYLITE OPENINGS:
D.L.O. HEIGHT = PANEL HEIGHT - 8.875"
D.L.O. WIDTH = PANEL WIDTH - 6.313"
PANEL HEIGHT = DOOR HEIGHT - 2"

THESE DOORS ARE RATED FOR SMALL MISSILE IMPACT.
F.B.C. APPROVED IMPACT RESISTANT SHUTTERS
REQUIRED FOR INSTALLATIONS UP TO 30 FT. OF GRADE.
SHUTTERS NOT REQD. FOR INSTALLATIONS ABOVE 30 FT. OF GRADE.

ATLANTIC SERIES SM 130 ALUM SLIDING GLASS DOOR

SEE SHEET 2 FOR DESIGN LOAD CAPACITY OF DESIRED GLASS/REINF.
USING CHART ON SHEET 3 SELECT ANCHOR OPTION WITH DESIGN RATING MORE THAN DESIGN LOADS REQUIRED.
LOWER DESIGN PRESSURES FROM GLASS OR ANCHOR CHARTS WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2023 (8TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.


ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2023 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC.
CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.


DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE.
LABELING TO COMPLY WITH SECTION 1709.9.2.

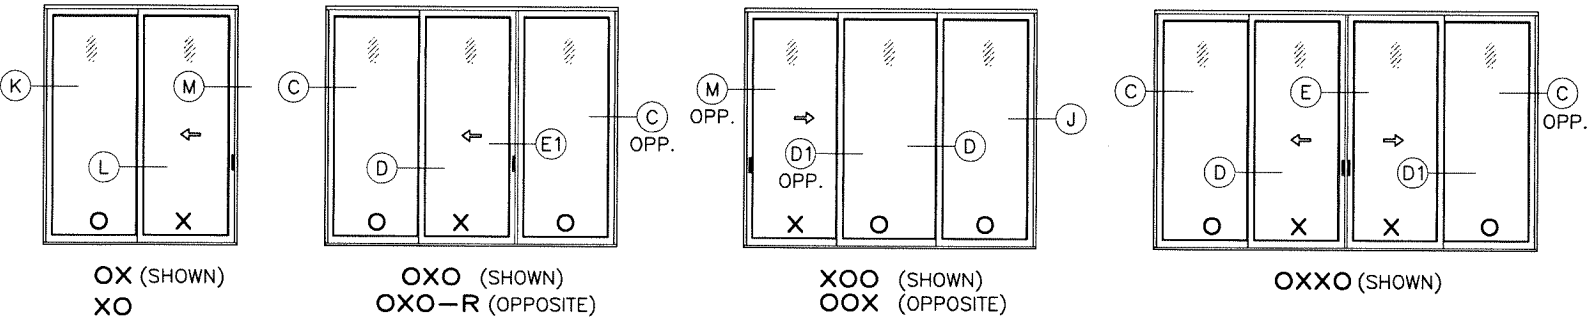


APPROVED CONFIGURATIONS

TWO TRACK FRAME DOOR CONFIGURATIONS OF MORE THAN FOUR PANELS USING STILE COMBINATIONS SHOWN IN THESE DETAILS MAY ALSO BE APPROVED (EXAMPLE OOXOXO).
MAX. OVERALL FRAME AREA NOT TO EXCEED 270.0 SQ. FT.

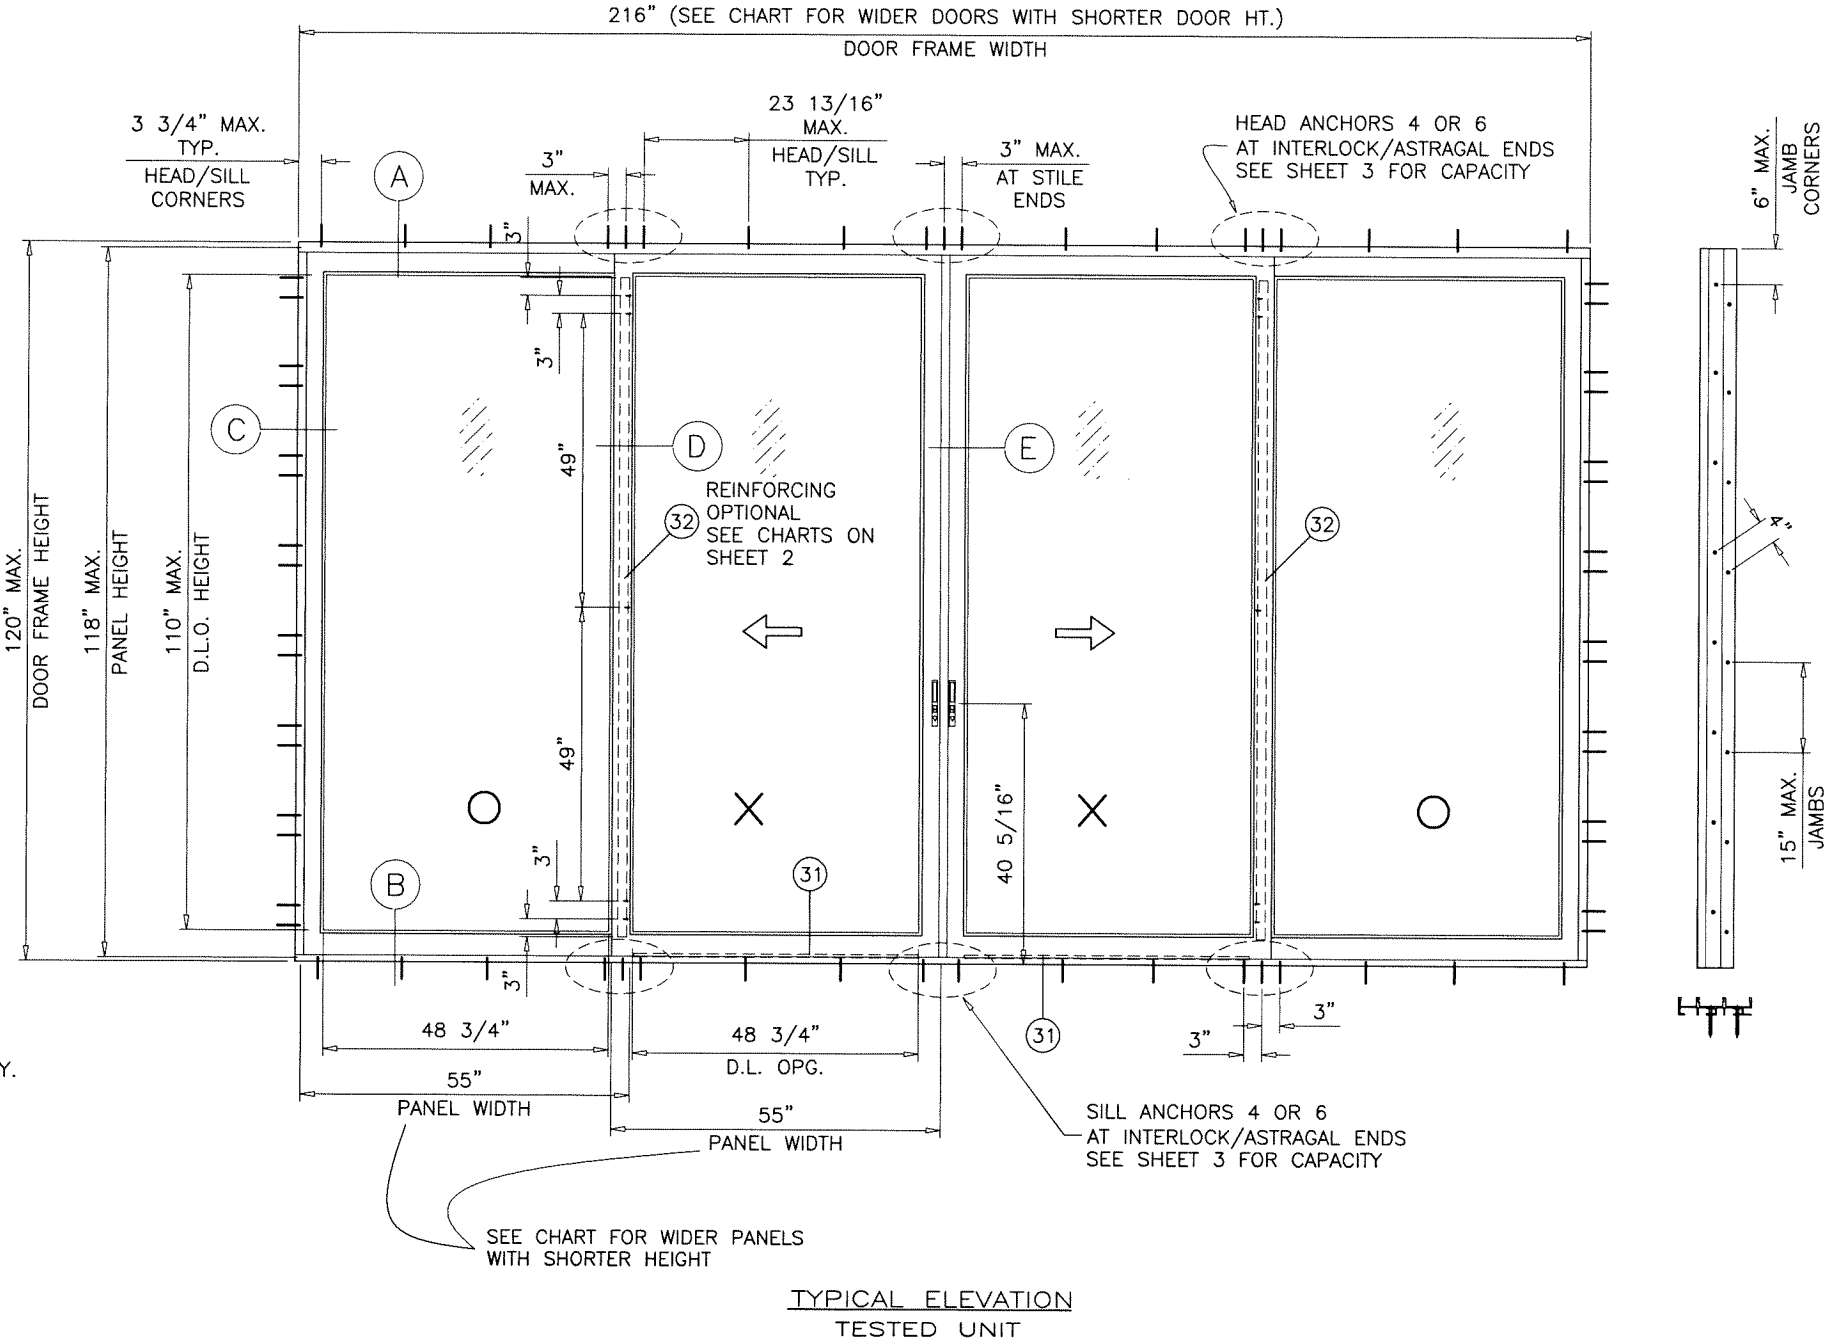

TYPICAL ELEVATION
TESTED UNIT

A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT.
B- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.
C- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC DRAWINGS FOR REVIEW.
D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

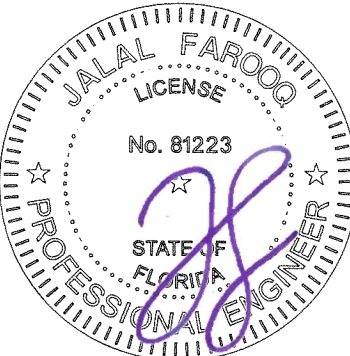

Sealed: 12/12/2025

FL #29677

afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
EGS\SM\19-46F-EGS

ATLANTIC SERIES SM 130 ALUM. SLIDING GLASS DOOR
EGS INTERNATIONAL, LLC
2799 SW 34th Avenue
Pembroke Park, FL 33023
Phone: (954) 519-7536 www.egsinternationalllc.com

no	date	by	description
A	10.30.20		UPDATED TO 2020 FBC
B	07.05.23		UPDATED TO 2023 FBC
C	04.01.25		GENERAL REVISION
D	12.10.25		ALT. FRAME HEAD ADDED

date: 05-28-19
scale: 3/8"=1'-0"
dr. by: TARIQ
chk. by:

drawing no.
19-46F
sheet 1 of 8

ANCHOR LOAD CAPACITY - PSF				
ANCHOR TYPES		'A'	'B' & 'C'	
PANEL WIDTH NOMINAL INCHES	DOOR HEIGHT INCHES	6 ANCHORS AT MTG. STILE ENDS	4 ANCHORS AT MTG. STILE ENDS	6 ANCHORS AT MTG. STILE ENDS
		EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)
24	84	160.0	160.0	160.0
30		160.0	160.0	160.0
36		160.0	160.0	160.0
39-1/4		160.0	160.0	160.0
42		149.5	149.5	149.5
48		130.0	130.0	130.0
50		130.0	130.0	130.0
54		130.0	130.0	130.0
56	90	125.4	125.4	125.4
60		117.0	117.0	117.0
24		160.0	160.0	160.0
30		160.0	160.0	160.0
36		160.0	160.0	160.0
39-1/4		157.2	157.2	160.0
42		149.5	149.5	149.5
48		130.0	130.0	130.0
50		130.0	130.0	130.0
54	96	127.7	127.7	130.0
56		125.1	125.1	125.4
60		117.0	117.0	117.0
24		160.0	160.0	160.0
30		160.0	160.0	160.0
36		154.7	154.7	160.0
39-1/4		144.9	144.9	160.0
42		130.0	130.0	130.0
48	102	125.7	125.7	130.0
50		122.3	122.3	130.0
54		116.6	116.6	130.0
56		114.1	114.1	125.4
60		109.7	109.7	117.0
24		130.0	130.0	130.0
30		130.0	130.0	130.0
36		130.0	130.0	130.0
39-1/4	108	130.0	130.0	130.0
42		127.7	127.7	130.0
48		116.0	116.0	130.0
50		112.8	112.8	130.0
54		107.2	107.2	130.0
56		104.8	104.8	125.4
60		100.5	100.5	117.0
24		130.0	130.0	130.0
30	110	130.0	130.0	130.0
36		130.0	130.0	130.0
39-1/4		130.0	130.0	130.0
42		125.2	125.2	130.0
48		118.9	118.9	130.0
50		107.7	107.7	130.0
54		104.7	104.7	130.0
56		99.3	99.3	130.0
60		96.9	96.9	125.4
60	112	92.8	92.8	117.0

ANCHOR LOAD CAPACITY - PSF				
ANCHOR TYPES		'A'	'B' & 'C'	
PANEL WIDTH NOMINAL INCHES	DOOR HEIGHT INCHES	6 ANCHORS AT MTG. STILE ENDS	4 ANCHORS AT MTG. STILE ENDS	6 ANCHORS AT MTG. STILE ENDS
		EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)
24	114	130.0	130.0	130.0
30		130.0	130.0	130.0
36		125.7	125.7	130.0
39-1/4		117.2	117.2	130.0
42		111.2	111.2	130.0
48		100.5	100.5	130.0
50		97.6	97.6	130.0
54		92.4	92.4	130.0
56	120	90.2	90.2	127.9
60		86.2	86.2	122.7
24		130.0	130.0	130.0
30		130.0	130.0	130.0
36		118.3	118.3	130.0
39-1/4		110.2	110.2	130.0
42		104.5	104.5	130.0
48		94.3	94.3	130.0
50	126	91.4	91.4	130.0
54		86.5	86.5	121.3

ANCHOR TYPES A, B, C APPLICABLE AT HEAD
ANCHOR TYPE B APPLICABLE AT SILL

WOOD BUCKS NOT BY 'EGS INTL.', MUST SUSTAIN
LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER
THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

AT HEAD
TYPE 'A'- 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD
THRU 1BY BUCKS INTO CONCRETE
1-1/4" MIN. EMBED INTO CONCRETE
TYPE 'B'- 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
DIRECTLY INTO CONCRETE
1-3/4" MIN. EMBED
TYPE 'C'- 1/4" DIA. SELF DRILLING SCREWS (GRADE 5 CRS)
INTO F.B.C. APPROVED MULLIONS
OR
INTO METAL STRUCTURES (HEAD/JAMBS)
(3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS
ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

AT SILL
TYPE 'B'- 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
DIRECTLY INTO CONCRETE
1-3/4" MIN. EMBED


AT JAMBS
1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD
THRU 1BY BUCKS INTO CONC. OR BLOCKS
1-1/4" MIN. EMBED INTO CONC. OR BLOCKS
1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
DIRECTLY INTO CONC. OR FILLED BLOCKS
1-3/4" MIN. EMBED INTO CONCRETE
1-1/4" MIN. EMBED INTO BLOCKS
#14 SMS OR SELF DRILLING SCREWS (GRADE 5 CRS)
INTO F.B.C. APPROVED MULLIONS
OR
INTO METAL STRUCTURES (HEAD/JAMBS)
(3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS
ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

ANCHOR EDGE DISTANCES

INTO CONCRETE = 2-1/2" MIN.
INTO WOOD STRUCTURE = 1" MIN.
INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.
CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

ALL JAMB ANCHORS TO BE SPACED AS SHOWN
ON ELEVATION ON SHEET 1

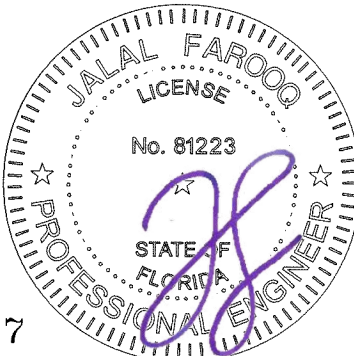

FL #29677

afC

AL-FAROOQ CORPORATION

ENGINEERS & PRODUCT DEVELOPMENT

9360 SUNSET DRIVE, SUITE 220

MIAMI, FLORIDA 33173

TEL. (305) 264-8100

FAX. (305) 262-6978

EGS\SM\19-46F-EGS

ATLANTIC SERIES SM 130 ALUM. SLIDING GLASS DOOR

EGS INTERNATIONAL, LLC

2799 SW 34th Avenue

Pembroke Park, FL 33023

Phone: (954) 519-7536

www.egsinternationalllc.com

Revisions:

no	date	by	description

date: 05-28-19

scale: 1/2"=1'-0"





dr. by: TARIQ

chk. by:

drawing no.

19-46F

sheet 3 of 8

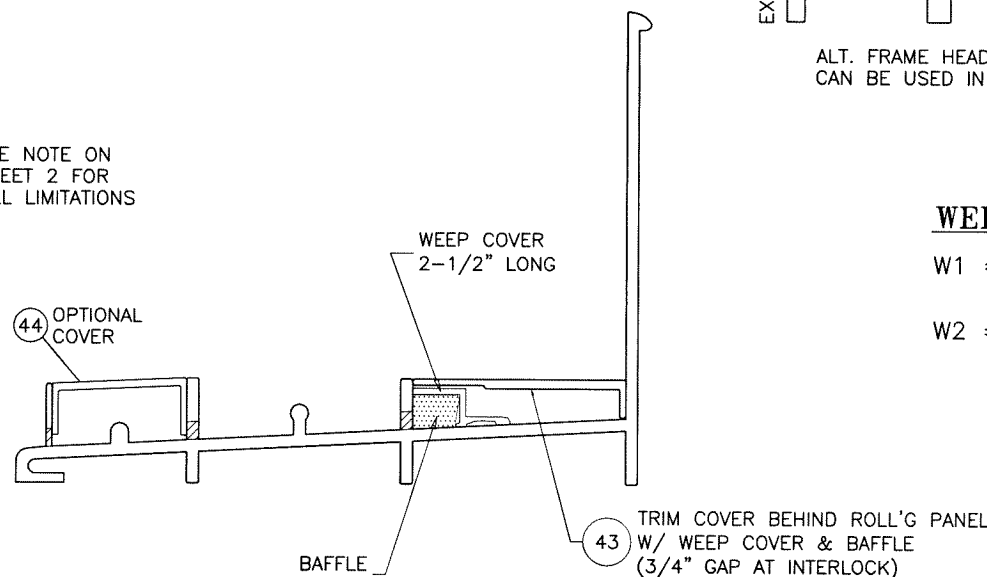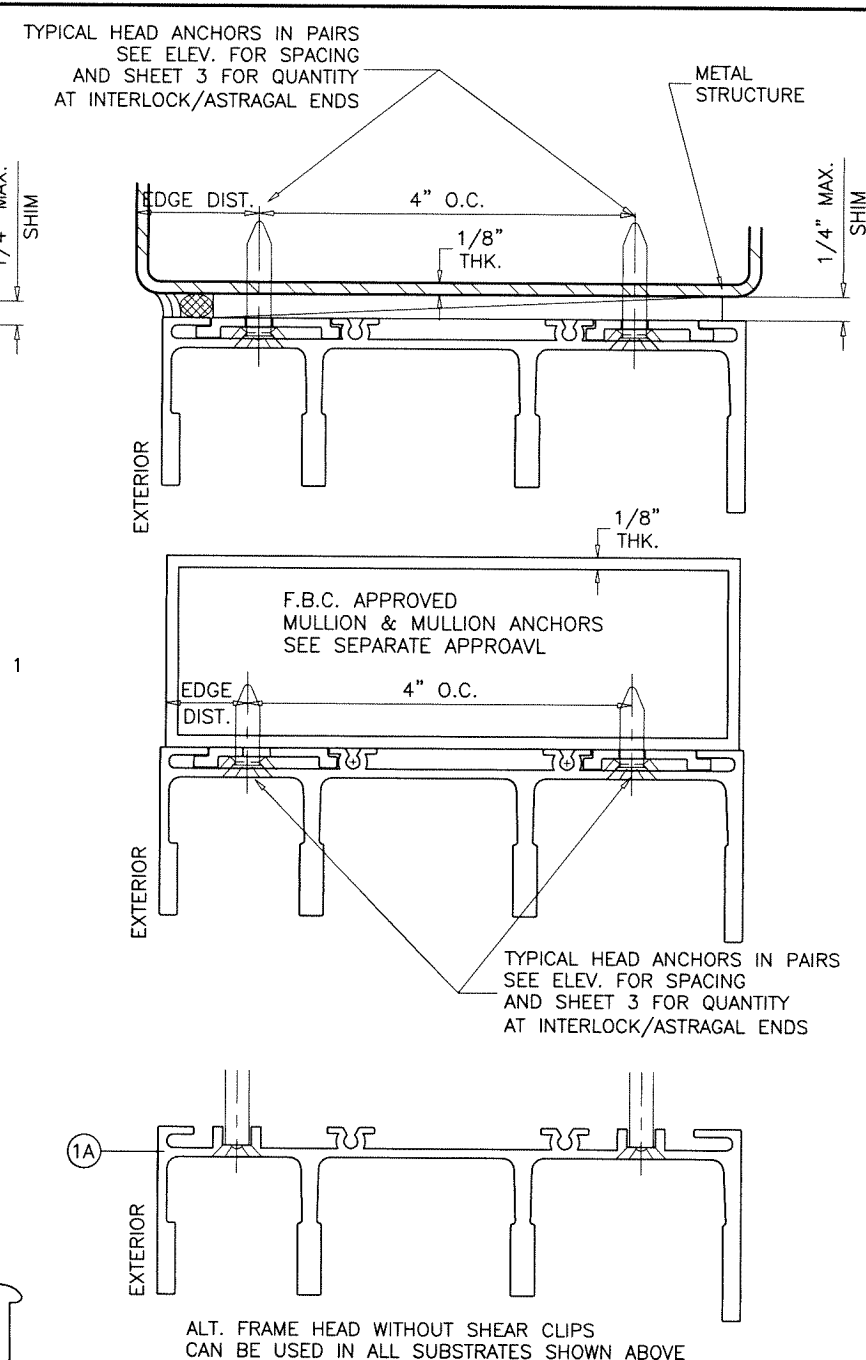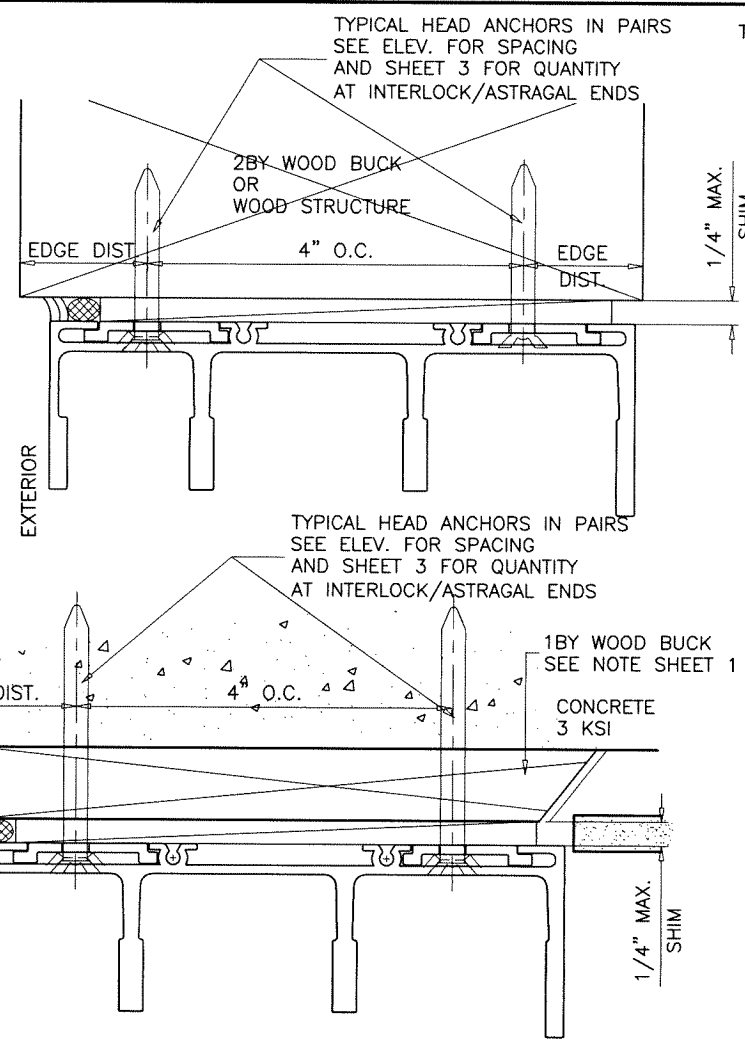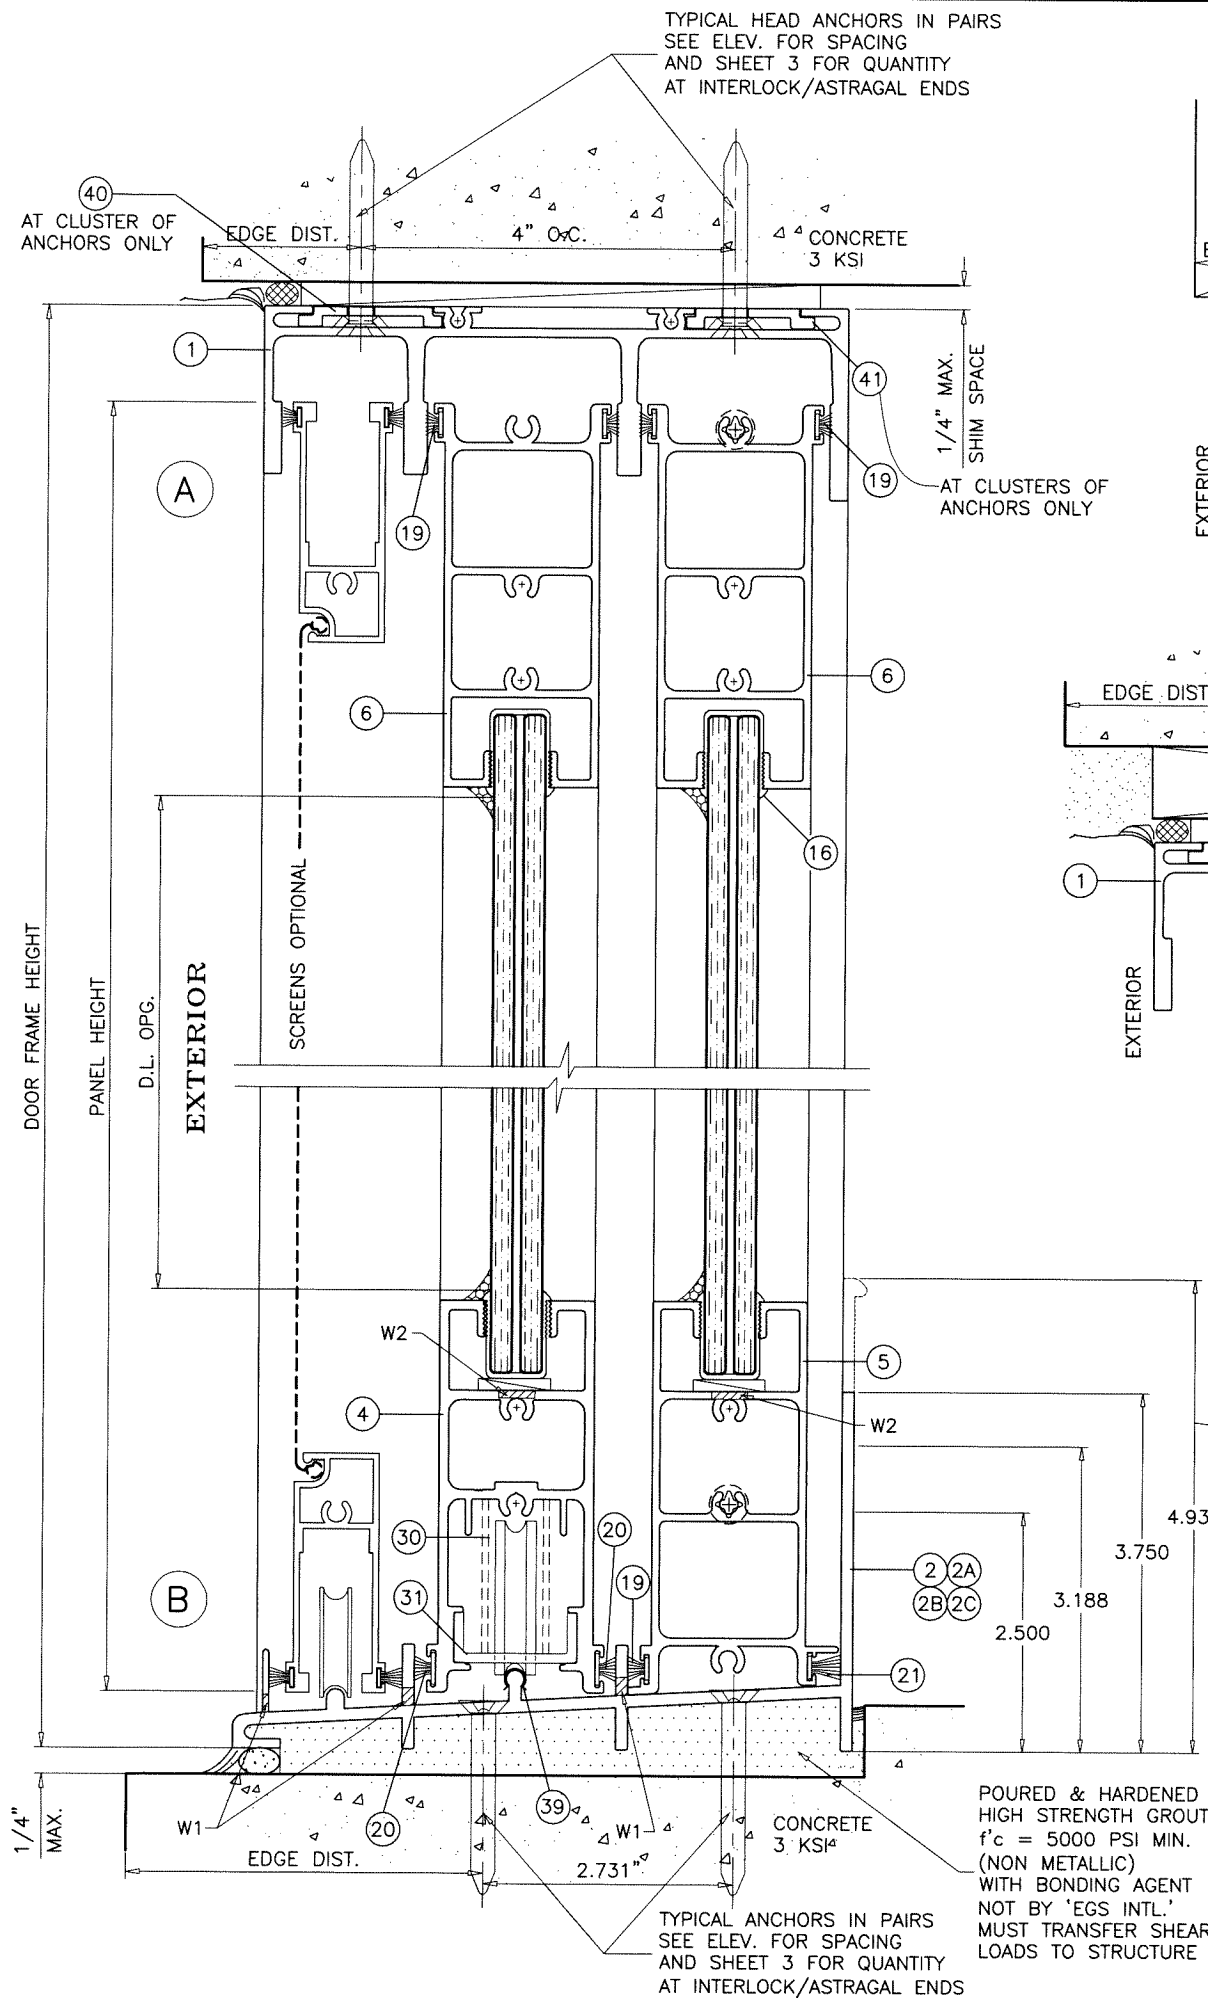


WEEPHOLES:

- W1 = 3/16"H X 3/4"W WEEP SLOTS AT QUARTER POINTS OF EACH PANEL
- W2 = 3/8" WEEP HOLE AT 6" FROM ENDS AND CENTER OF EACH RAIL

Sealed: 12/12/2025

FL #29677

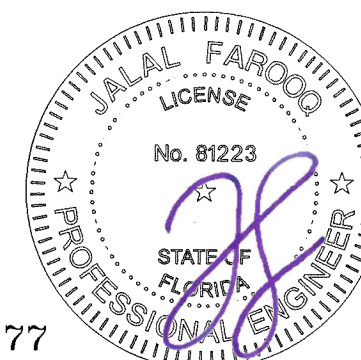

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

EGS\SM\19-46F-EGS

ATLANTIC SERIES SM 130 ALUM. SLIDING GLASS DOOR

EGS INTERNATIONAL, LLC
2799 SW 34th Avenue
Pembroke Park, FL 33023
Phone: (954) 519-7536 www.egsinternationalllc.com

revisions:

no	date	by	description

date: 05-28-19

scale: 1/2" = 1"






dr. by: TARIQ

chk. by:

drawing no.


19-46F

sheet 4 of 8

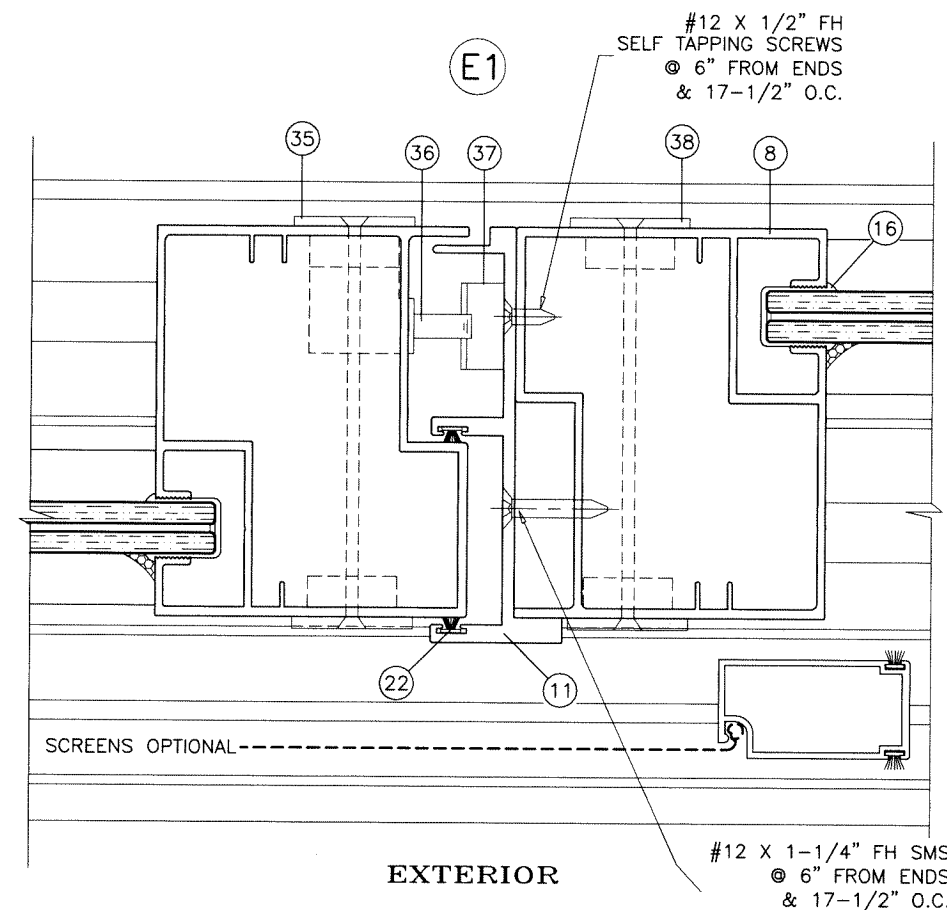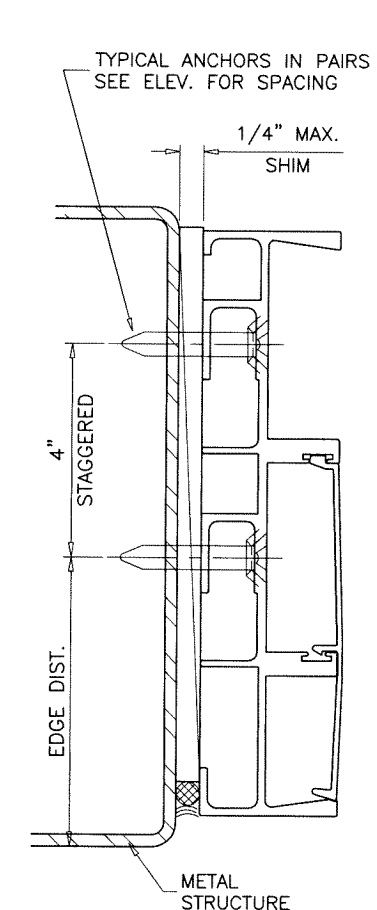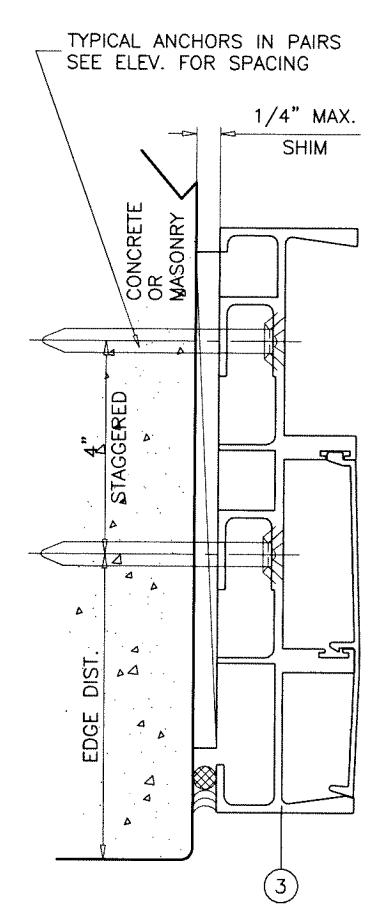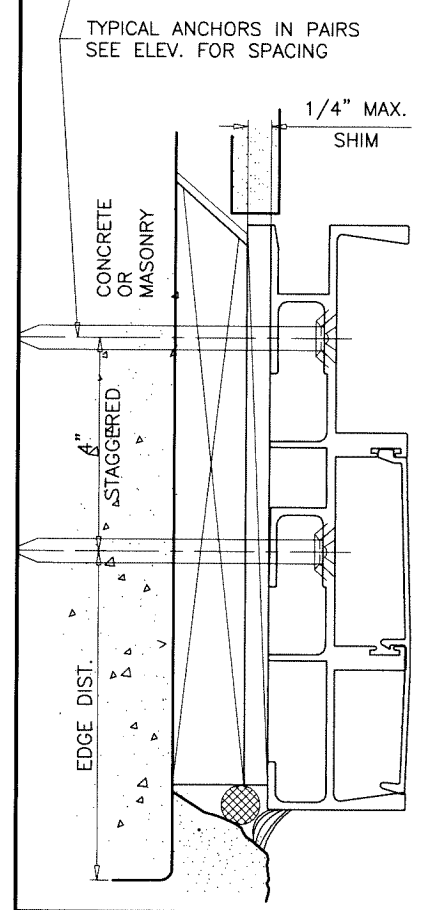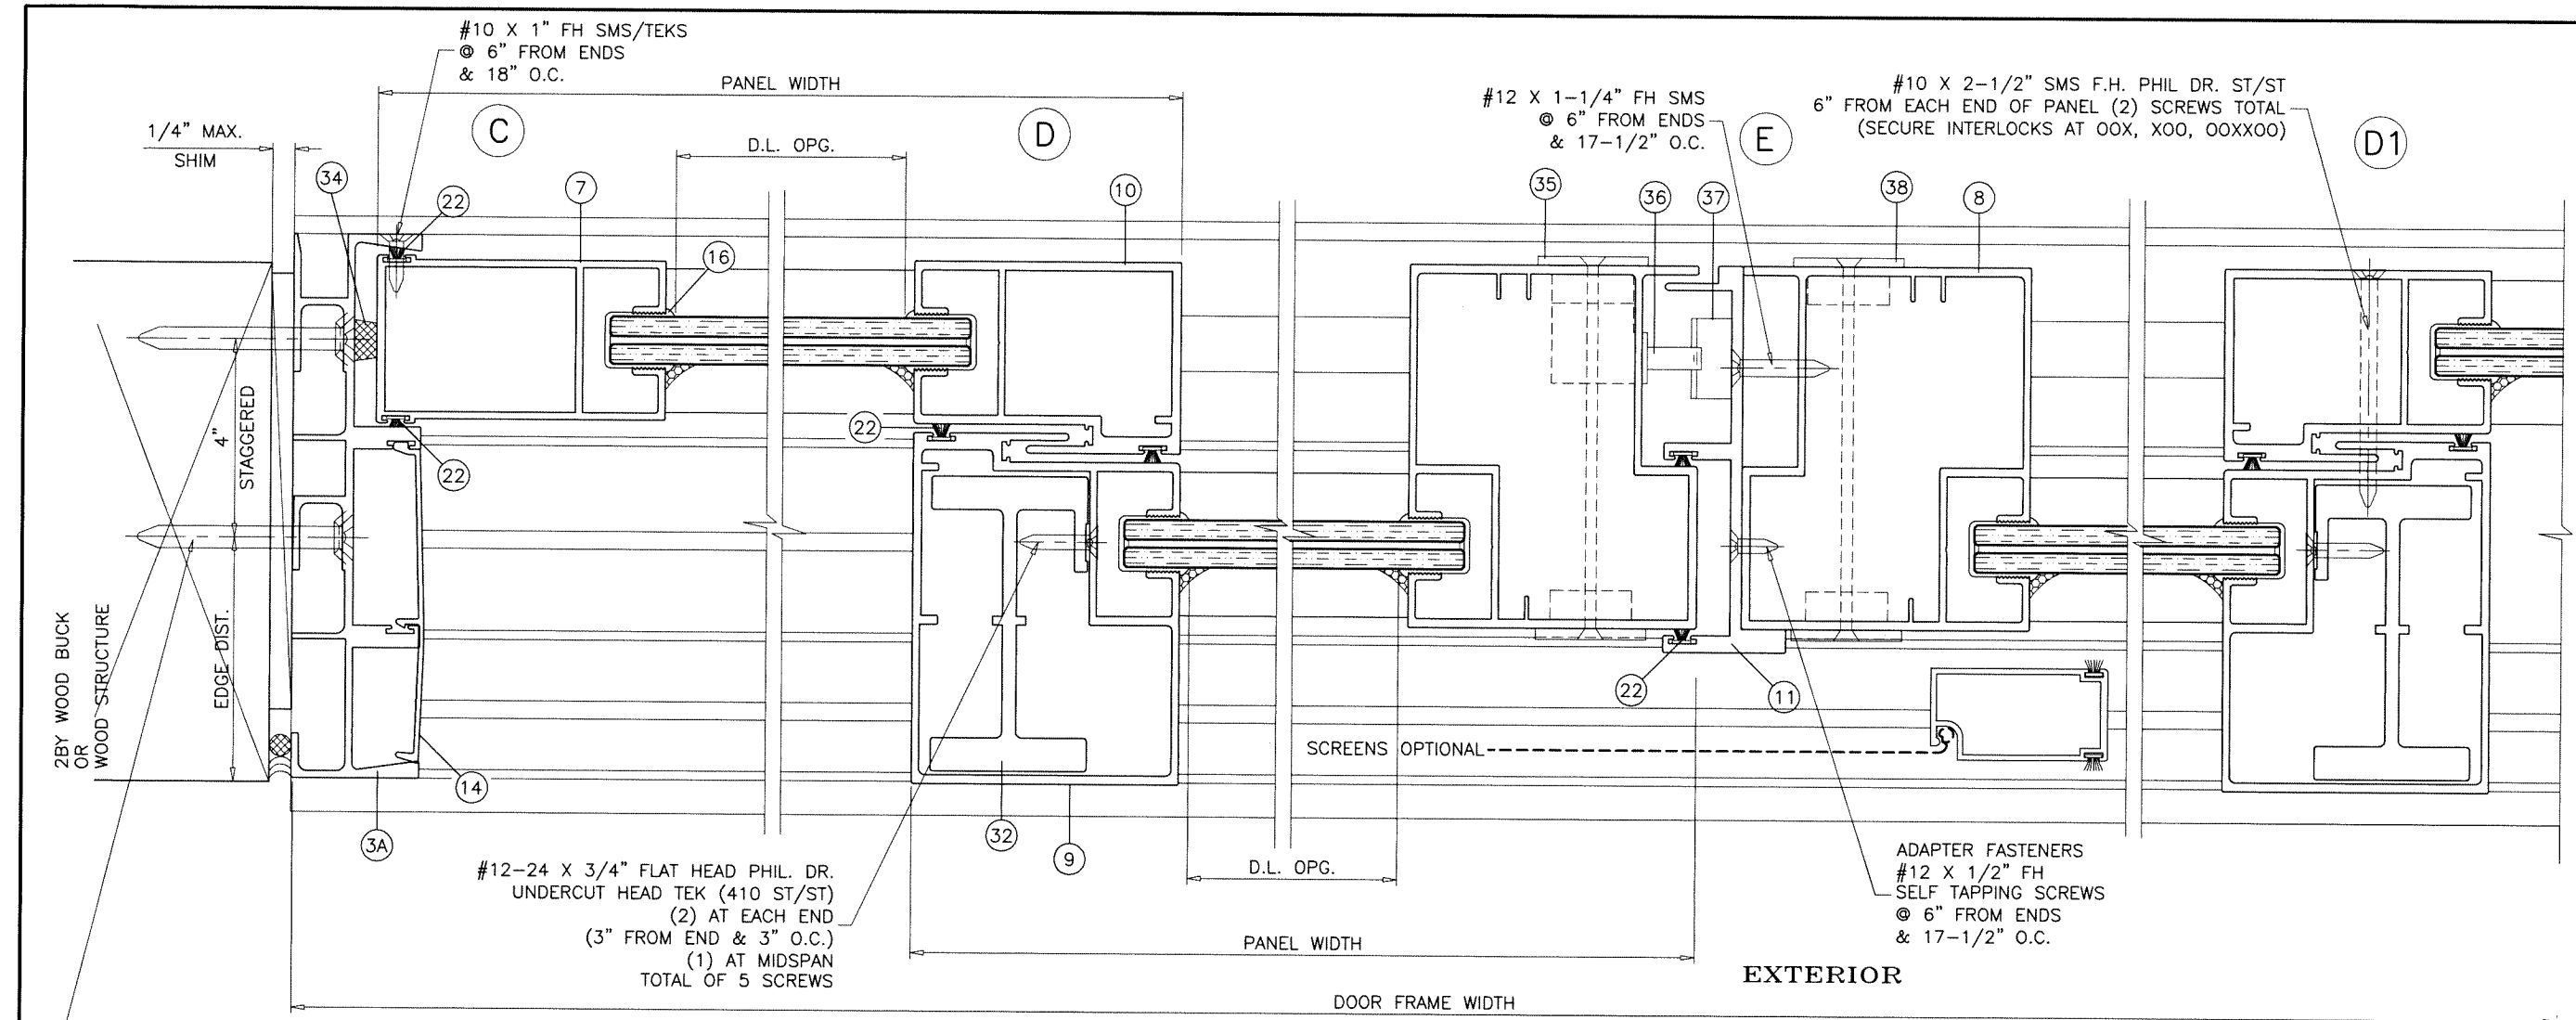

Sealed: 12/12/2025

FL #29677

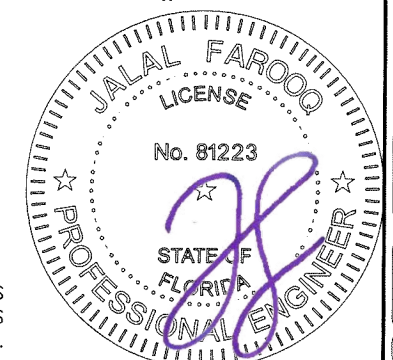

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

af c
EGS\SM\19-46F-EGS

ATLANTIC SERIES SM 130 ALUM. SLIDING GLASS DOOR



EGS INTERNATIONAL, LLC
2799 SW 34th Avenue
Pembroke Park, FL 33023
Phone: (954) 519-7536 www.egsinternationalllc.com

revisions:


no	date	by	description

date: 05-28-19
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:

drawing no.
19-46F
sheet 5 of 8

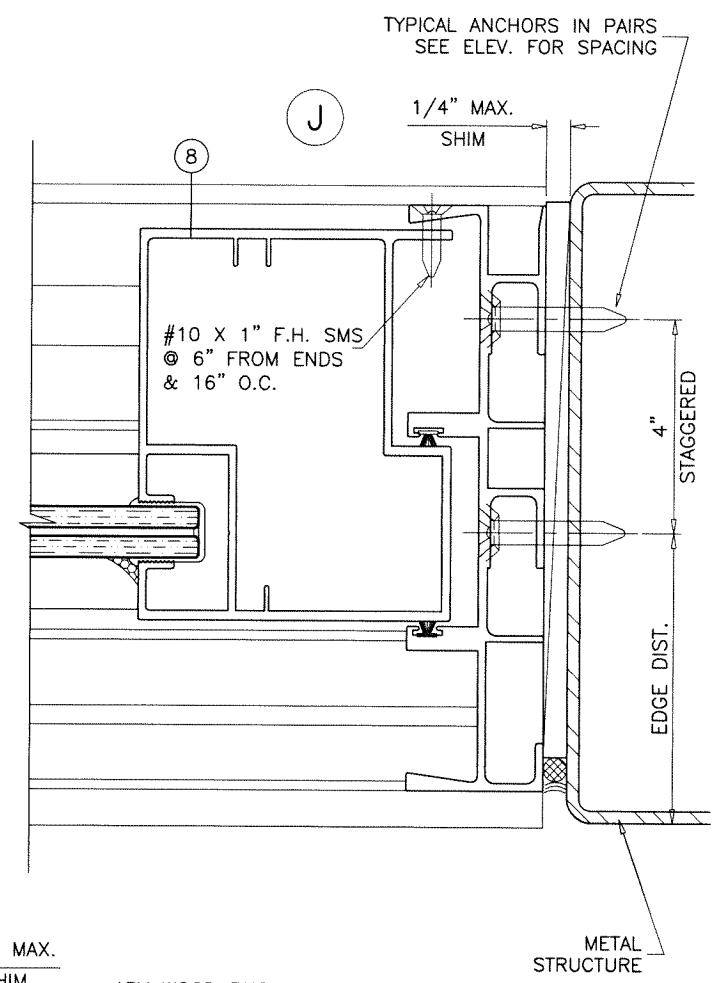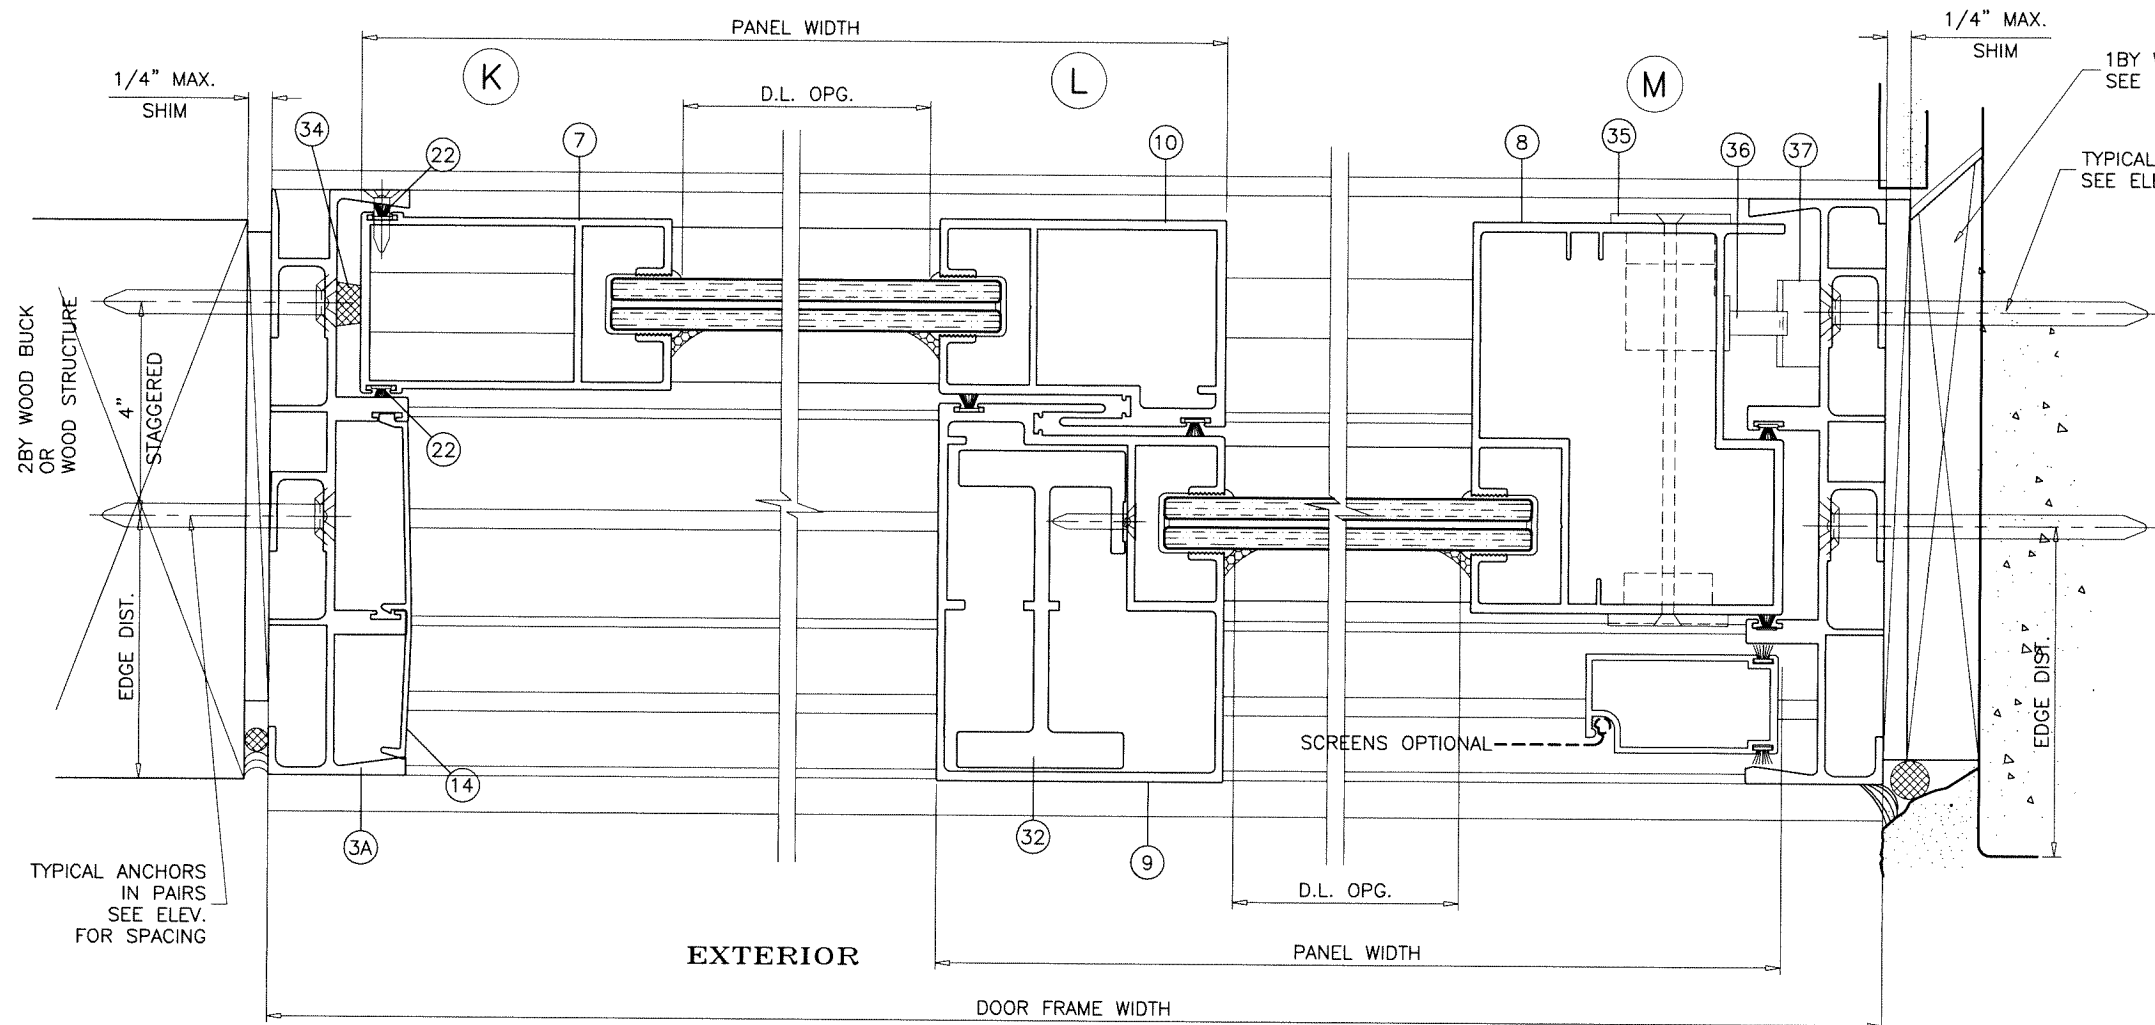

Sealed: 12/12/2025

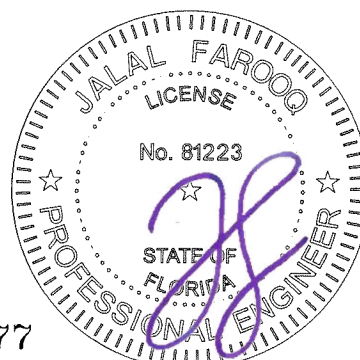

FL #29677

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

af c


















EGS\SM\19-46F-EGS

ATLANTIC SERIES SM 130 ALUM. SLIDING GLASS DOOR

EGS INTERNATIONAL, LLC
2799 SW 34th Avenue
Pembroke Park, FL 33023
Phone: (954) 519-7536 www.egsinternationalllc.com


revisions:	
no	date by description

date: 05-28-19	scale: 1/2" = 1"	dr. by: TARIQ	chk. by:	drawing no.
				19-46F
				sheet 6 of 8

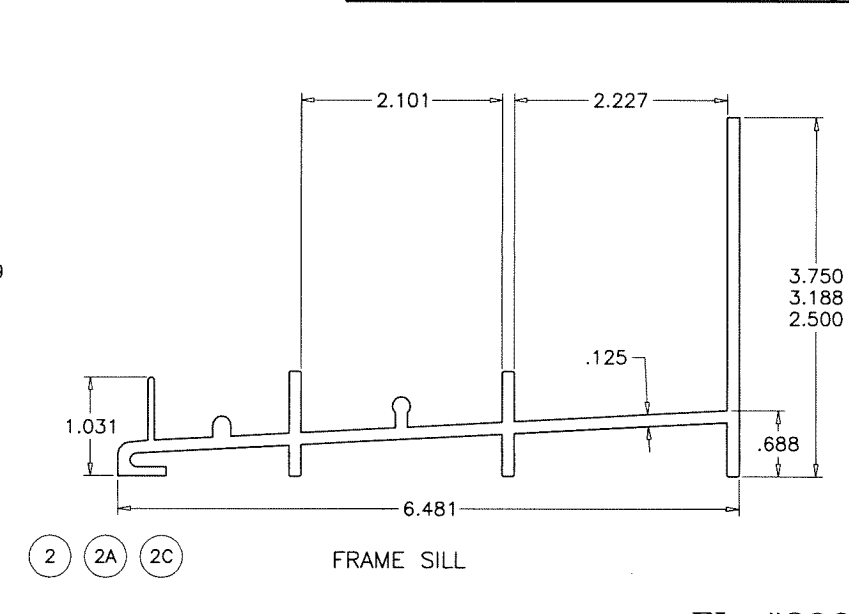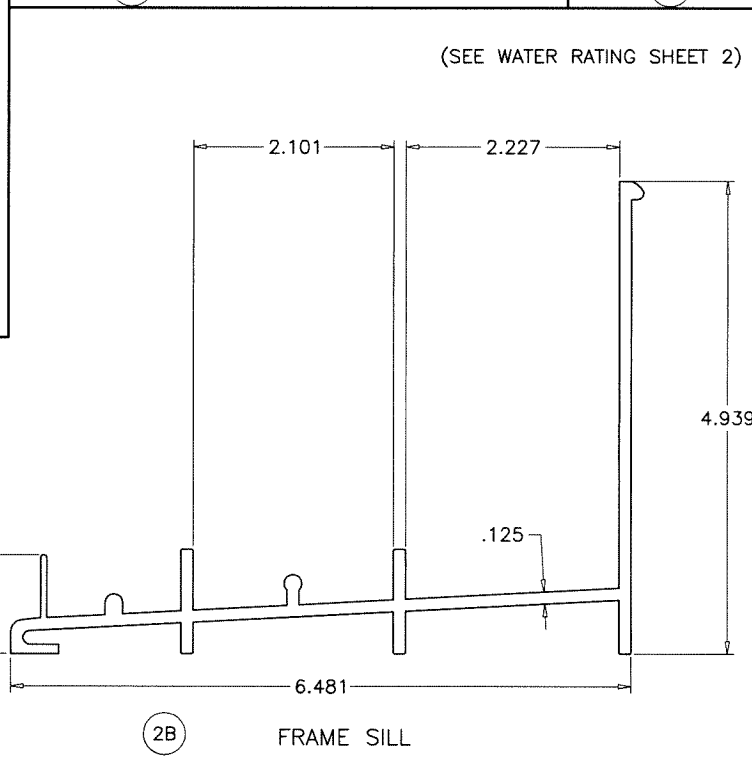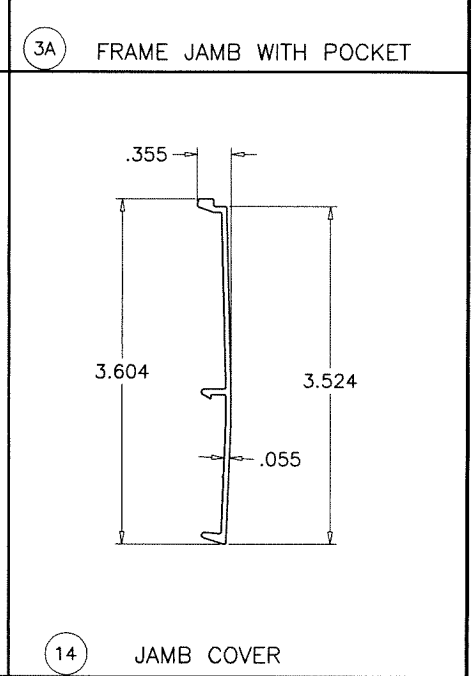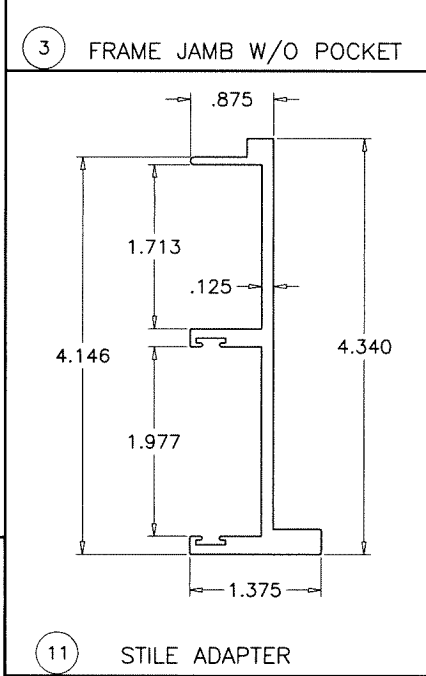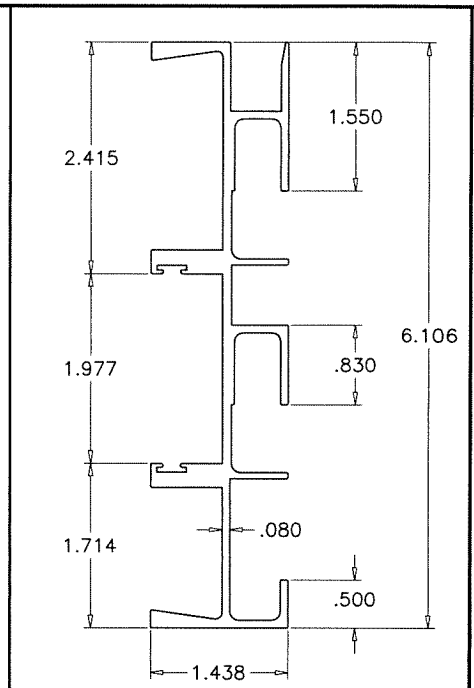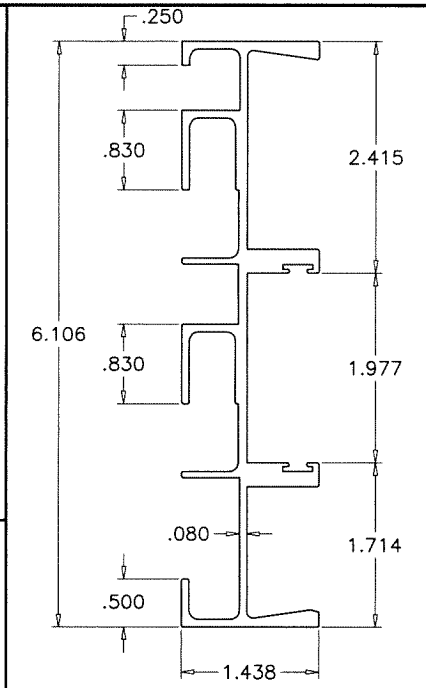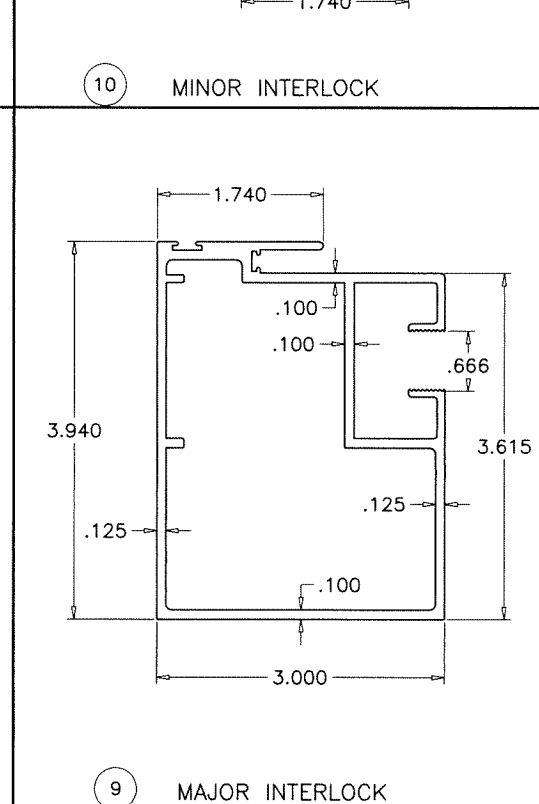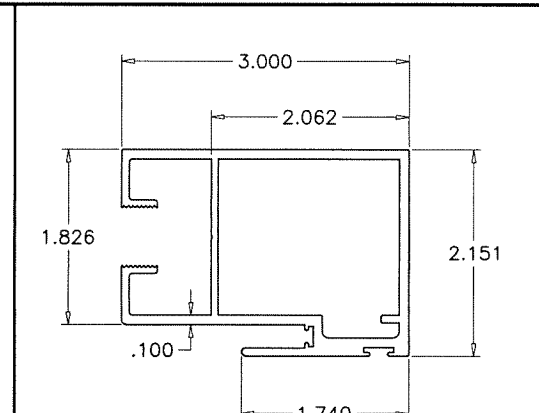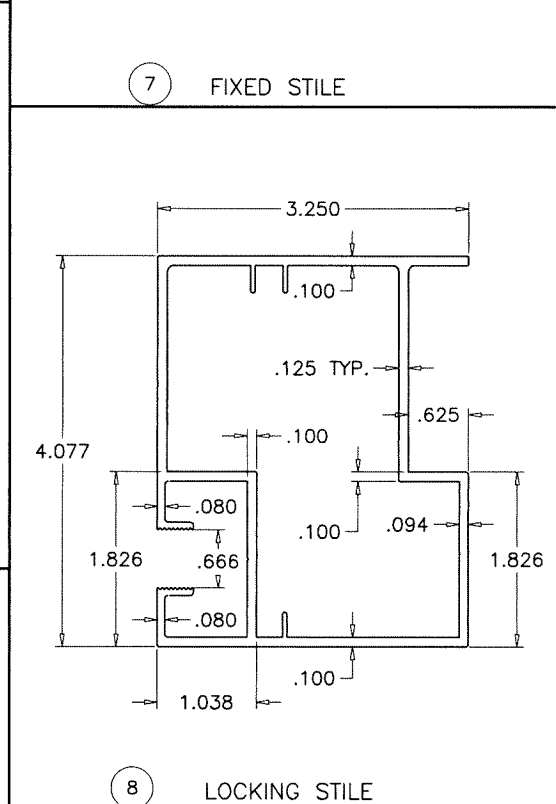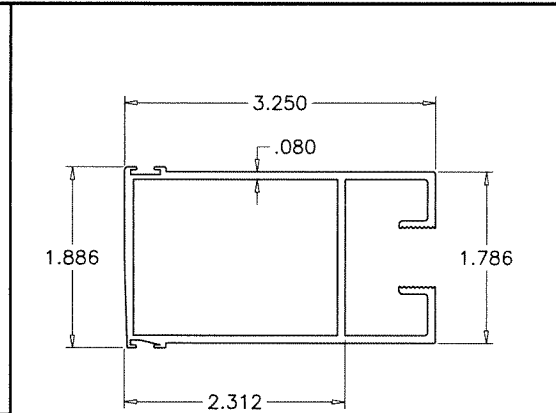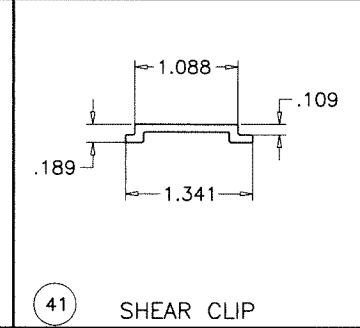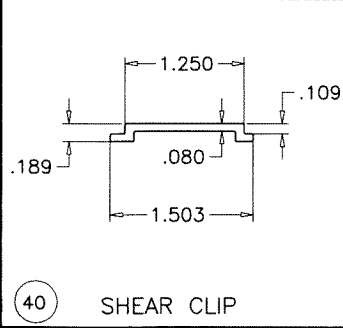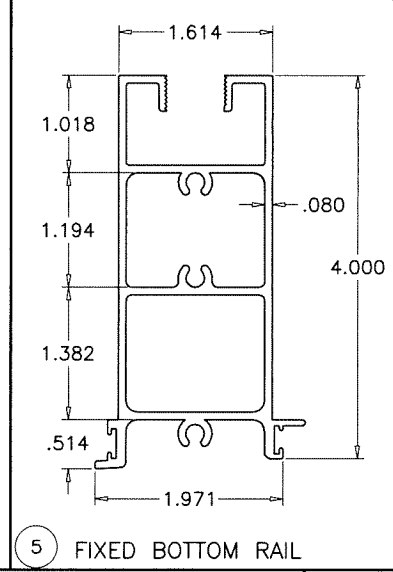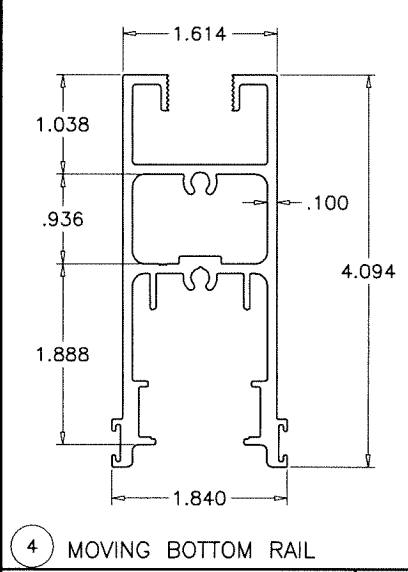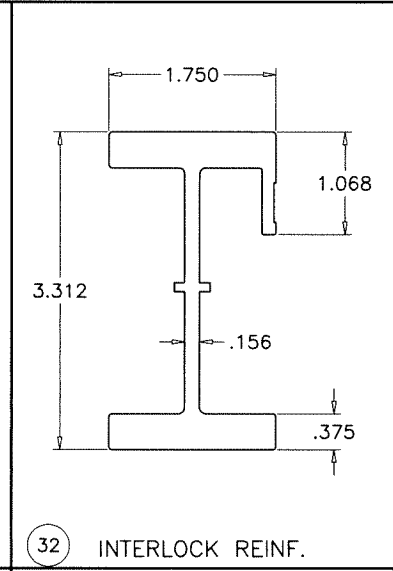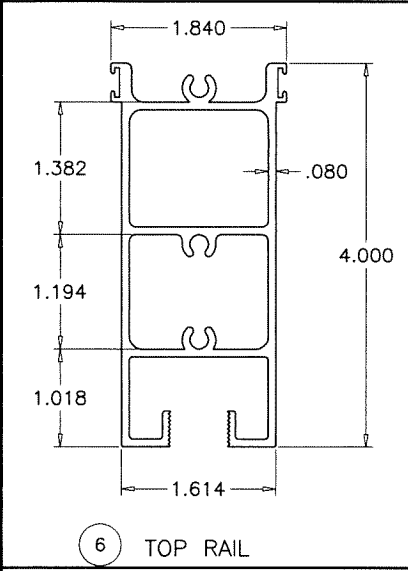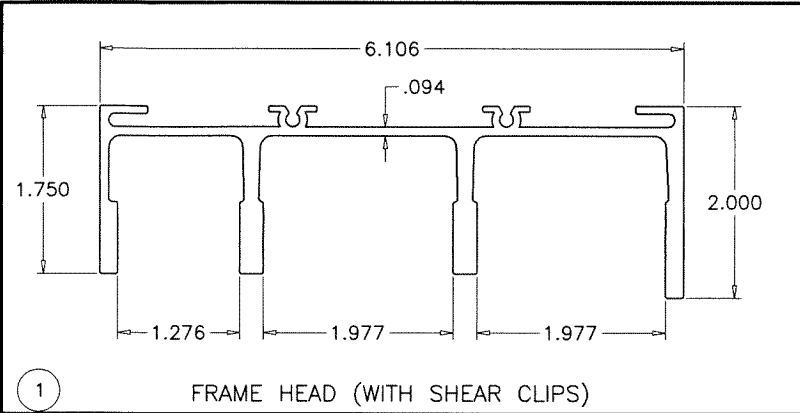

S.M.I. = SMALL MISSILE IMPACT GLASS SHAPES

FL #29677

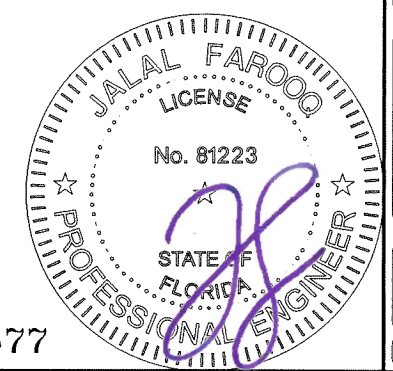

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

ATLANTIC SERIES SM 130 ALUM. SLIDING GLASS DOOR

EGS INTERNATIONAL, LLC
2799 SW 34th Avenue
Pembroke Park, FL 33023
Phone: (954) 519-7536 www.egsinternationalllc.com

revisions:	
no	date by description

date: 05-28-19

scale: 1/2" = 1"

dr. by: TARIQ


chk. by:

drawing no.


19-46F

sheet 7 of 8

Sealed: 12/12/2025

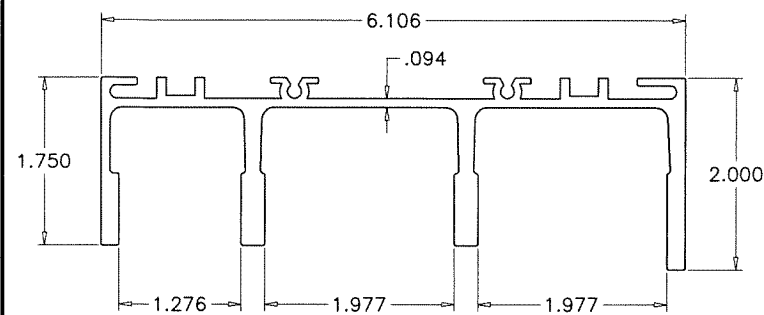


1A FRAME HEAD (WITHOUT SHEAR CLIPS)




HARDNESS = 85 SHORE A


16 GLAZING GASKET
SCALE 1:1




31 MOV. PANEL REINF.

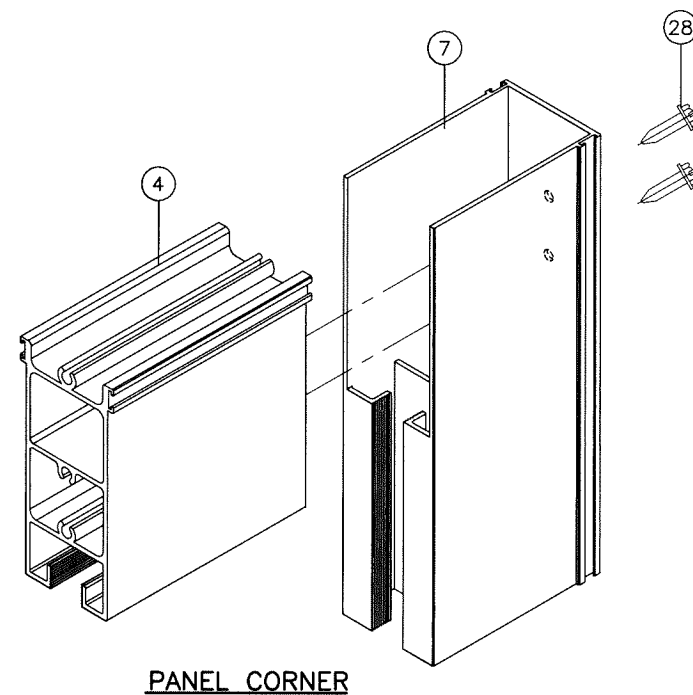

PANEL CORNER

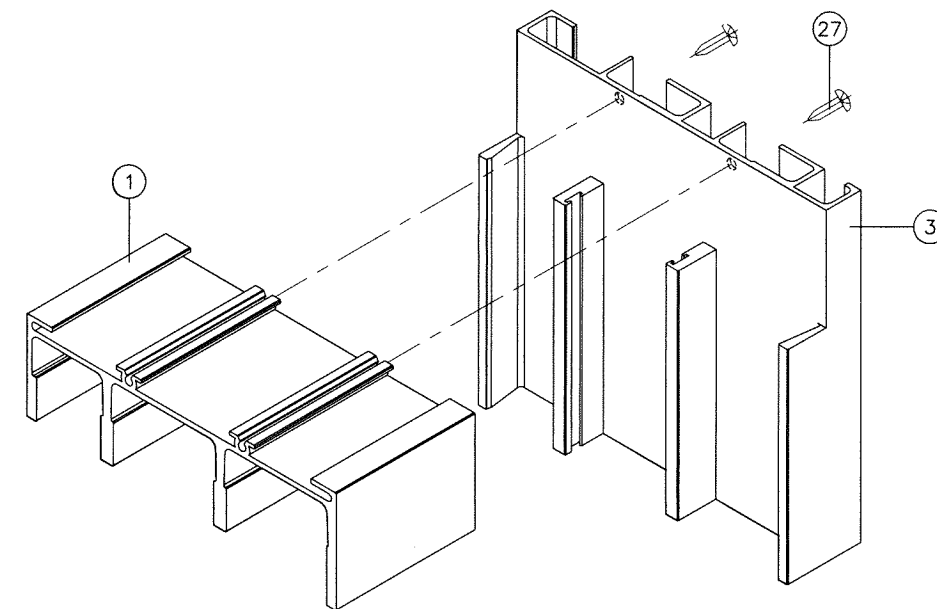

FRAME TOP CORNER

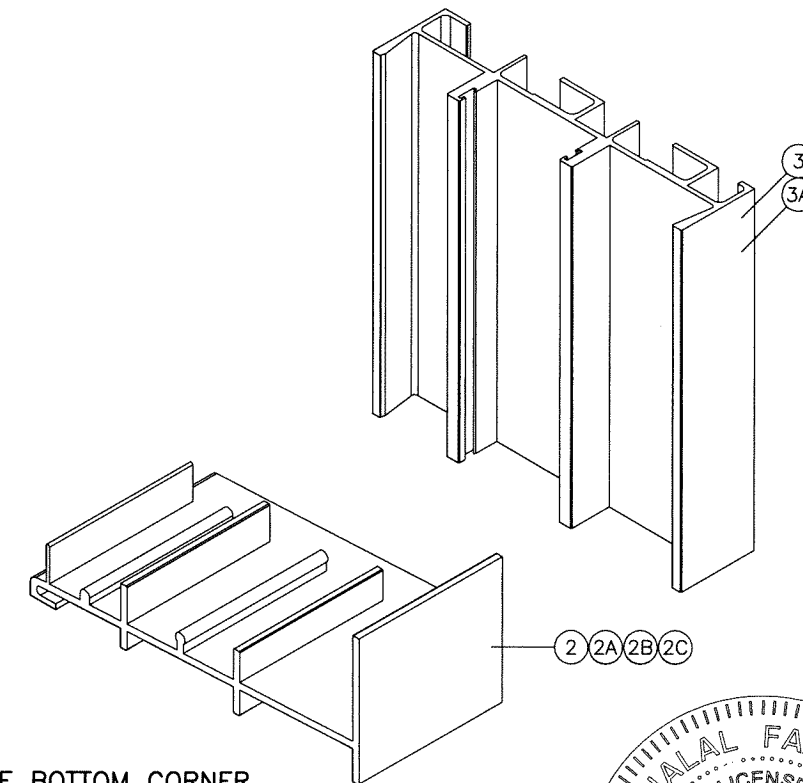

FRAME BOTTOM CORNER



Sealed: 12/12/2025

FL #29677

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220 (C.A.N. 3538)
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
EGS\SM\19-46F-EGS

ATLANTIC SERIES SM 130 ALUM. SLIDING GLASS DOOR
EGS INTERNATIONAL, LLC
2799 SW 34th Avenue
Pembroke Park, FL 33023
Phone: (954) 519-7536 www.egsinternationalllc.com

revisions:	no	date	by	description

date: 05-28-19
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:


drawing no.
19-46F
sheet 8 of 8

ITEM NO.	PART NUMBER	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	EGS-551	1	FRAME HEAD (WITH SHEAR CLIPS)	6005-T5/6105-T5	-
1A	EGS-606	1	FRAME HEAD (WITHOUT SHEAR CLIPS)	6005-T5/6105-T5	-
2	EGS-580	1	FRAME SILL (3-3/16" HIGH)	6005-T5/6105-T5	-
2A	EGS-581	1	FRAME SILL (3-3/4" HIGH)	6005-T5/6105-T5	-
2B	EGS-552	1	FRAME SILL (4-15/16" HIGH)	6005-T5/6105-T5	-
2C	EGS-580	1	FRAME SILL (2-1/2" HIGH)	6005-T5/6105-T5	-
3	EGS-567	2	FRAME JAMB W/O POCKET	6005-T5/6105-T5	-
3A	EGS-553	2	ALT. FRAME JAMB W/ POCKET	6005-T5/6105-T5	-
4	EGS-573	1/MOV. PANEL	MOVING BOT. RAIL (S.M.I.)	6005-T5/6105-T5	-
5	EGS-572	1/FIX. PANEL	FIXED BOT. RAIL (S.M.I.)	6005-T5/6105-T5	-
6	EGS-571	1/PANEL	TOP RAIL (S.M.I.)	6005-T5/6105-T5	-
7	EGS-574	AS REQD.	FIXED STILE (S.M.I.)	6005-T5/6105-T5	-
8	EGS-575	AS REQD.	LOCKING STILE (S.M.I.)	6005-T5/6105-T5	-
9	EGS-576	AS REQD.	MAJOR INTERLOCK (S.M.I.)	6005-T5/6105-T5	-
10	EGS-577	AS REQD.	MINOR INTERLOCK (S.M.I.)	6005-T5/6105-T5	-
11	EGS-561	AS REQD.	STILE ADAPTER	6005-T5/6105-T5	-
12	D5592 AMG (PC)	2/ STILE	FIBER DUST PLUG W/2 FIN SEAL (TOP OF MINOR & MAJOR INTERLOCKS)	-	1/2"(W) X 1-1/8"(L) X 9/16" HT. PILE
14	EGS-570	AS REQD.	JAMB COVER	6063-T5/6105-T5	OPTIONAL
16	EGS-72-1	AS REQD.	3/4" GLAZING GASKET	PVC	TEAMPLASTICS
17	TX11429E	2/ LITE	SETTING BLOCKS, AT 1/4 POINTS	EPDM	1/8" THK. X 1" WIDE X 4" LONG
19	28027045/7527-6011-4	AS REQD.	FINSEAL WOOLPILE AT HORIZ. RAILS	-	AMESBURY
20	T-2836G	AS REQD.	POLYBOND FINSEAL AT MOV. BOTTOM RAIL	-	ULTRAFAB (.280H X .360 BASE)
21	38027045/7537-6011-6	AS REQD.	FINSEAL WOOLPILE AT FIX. BOTTOM RAIL	-	AMESBURY
22	21027045/7420-6011-2	AS REQD.	FINSEAL WOOLPILE AT VERT. STILES & SWEEP	-	AMESBURY
27	#8 X 3/4"	2/ CORNER	FRAME ASSEMBLY SCREWS	ST. STEEL	PH SMS
28	#12 X 1"	2/ CORNER	PANEL ASSEMBLY SCREWS W/ BLACK NYLON ISOLATOR (.031" THK) WASHER	ST. STEEL	TH SMS
30	S583D1DS0A	2/ MOV. PANEL	TANDEM WHEELS IN METALLIC HOUSING	ST. STEEL	ANTHONY INNOVATIONS
31	-	1/ MOV. PANEL	ALUM CHANNEL, FULL WIDTH OF PANEL (BOTH OPTIONS)	6063-T5	-
32	EGS-593	AS REQD.	INTERLOCK REINFORCEMENT (DOOR HT. - 20")	6005-T5	-
34	-	AS REQD.	RUBBER BUMPER SPACER	-	1/2" X 1/2" SQ. X 1/4" HIGH
35	40.70.100.1	1	TRIMSET PULL	-	EVO
36	DL-701-SS	1	DEAD LOCK, MOUNTED W/ (2) #6-32 X 3/8" M.S. FLAT HD PHIL DR.	ST. STEEL	-
37	DK-103-SS	1	STRIKE, MOUNTED W/ (2) #8 X 1/2" SMS TRUSS HD PHIL DR.	ST. STEEL	-
38	40.70.102.1	1	DUMMY TRIMSET PULL	-	EVO
39	TC2	1	TRACK COVER	ST/ST	HYGRADE
40	EGS-583	AS REQD.	SHEAR CLIP AT CLUSTERS ONLY	6005-T5/6105-T5	-
41	EGS-584	AS REQD.	SHEAR CLIP AT CLUSTERS ONLY	6005-T5/6105-T5	-
42	SDB-100	AS REQD.	DOOR BUMPER, AT TOP & BOTTOM OF MINOR INTERLOCK (INT.)	NYLON	THE ENETERPRISES
43	EGS-586	AS REQD.	FLAT TRACK COVER (BEHIND ROLLING PANEL)	6063-T5	-
44	EGS-588	AS REQD.	POCKET COVER AT SCREEN TRACK (OPTIONAL)	6063-T5	-

SEALANT:

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH WHITE/ALUMINUM COLORED SILICONE.
MAJOR INTERLOCK STILES TOP AND BOTTOM ENDS FILLED WITH EXPANDING URETHANE FOAM.

ALL INSTALLATION ANCHOR HEADS TO BE SEALED & EXPOSED ANCHORS TO BE CAPPED WITH ALUM. BUTTON COVERS.

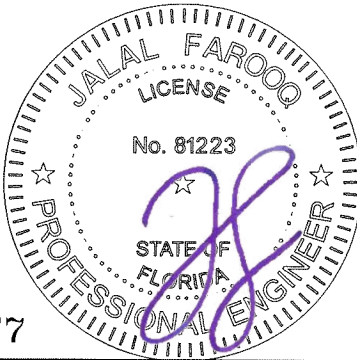

FL #29677

Sealed: 12/12/2025



AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

ATLANTIC SERIES SM 130 ALUM. SLIDING GLASS DOOR

EGS INTERNATIONAL, LLC
2799 SW 34th Avenue
Pembroke Park, FL 33023
Phone: (954) 519-7536 www.egsinternationalllc.com

revisions:	no	date	by	description

date:	05-28-19
scale:	1/2" = 1"
dr. by:	TARIQ
chk. by:	

drawing no.	19-46F
sheet	8.1 of 8