

TUBELITE INC.
MONUMENTAL ENTRANCE SERIES
ALUMINUM OUT-SWING DOOR

THESE DOORS ARE RATED FOR LARGE MISSILE IMPACT.
INSTALLATION OF THIS SYSTEM OUTSIDE THE HVHZ AREA SHALL MEET
THE APPLICABLE REQUIREMENTS FOR WIND BORNE DEBRIS PROTECTION.

MONUMENTAL
ALUMINUM OUT-SWING ENTRANCE DOOR

SEE SHEET 2 FOR DESIGN LOAD CAPACITY OF SINGLE AND
DOUBLE DOORS.

DOORS NOT APPROVED FOR INSTALLATIONS WHERE WATER
INFILTRATION RESISTANCE IS REQUIRED.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE
REQUIREMENTS OF THE 2023 (8TH EDITION) FLORIDA BUILDING CODE FOR
NON HIGH VELOCITY HURRICANE ZONE.

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE
DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT
LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS
AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE
MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT
COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE
REQUIREMENTS OF THE 2023 FLORIDA BLDG. CODE & ADOPTED MONUMENTALS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION
FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY
OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR
WATER INFILTRATION RESISTANCE ETC.

CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY,
AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION
IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE.
LABELING TO COMPLY WITH SECTION 1709.9.2.

A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND
INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION
PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED
ON THIS DOCUMENT.

B- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF
ALTERED BY ANY MEANS.

C- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED
ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.)
FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER
USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED
ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE
SPECIFIC DRAWINGS FOR REVIEW.

D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF
THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

Sealed: 6/25/2024

FL #29696



AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

MONUMENTAL ALUMINUM OUTSWING DOOR (L.M.I.)
TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.



revisions:		no		date		by		description	

date: 06-14-24
scale: -
dr. by: TARIQ
chk. by:

drawing no.
24-37F

sheet 1 of 15

COMP-ANL\24-37F-TLI

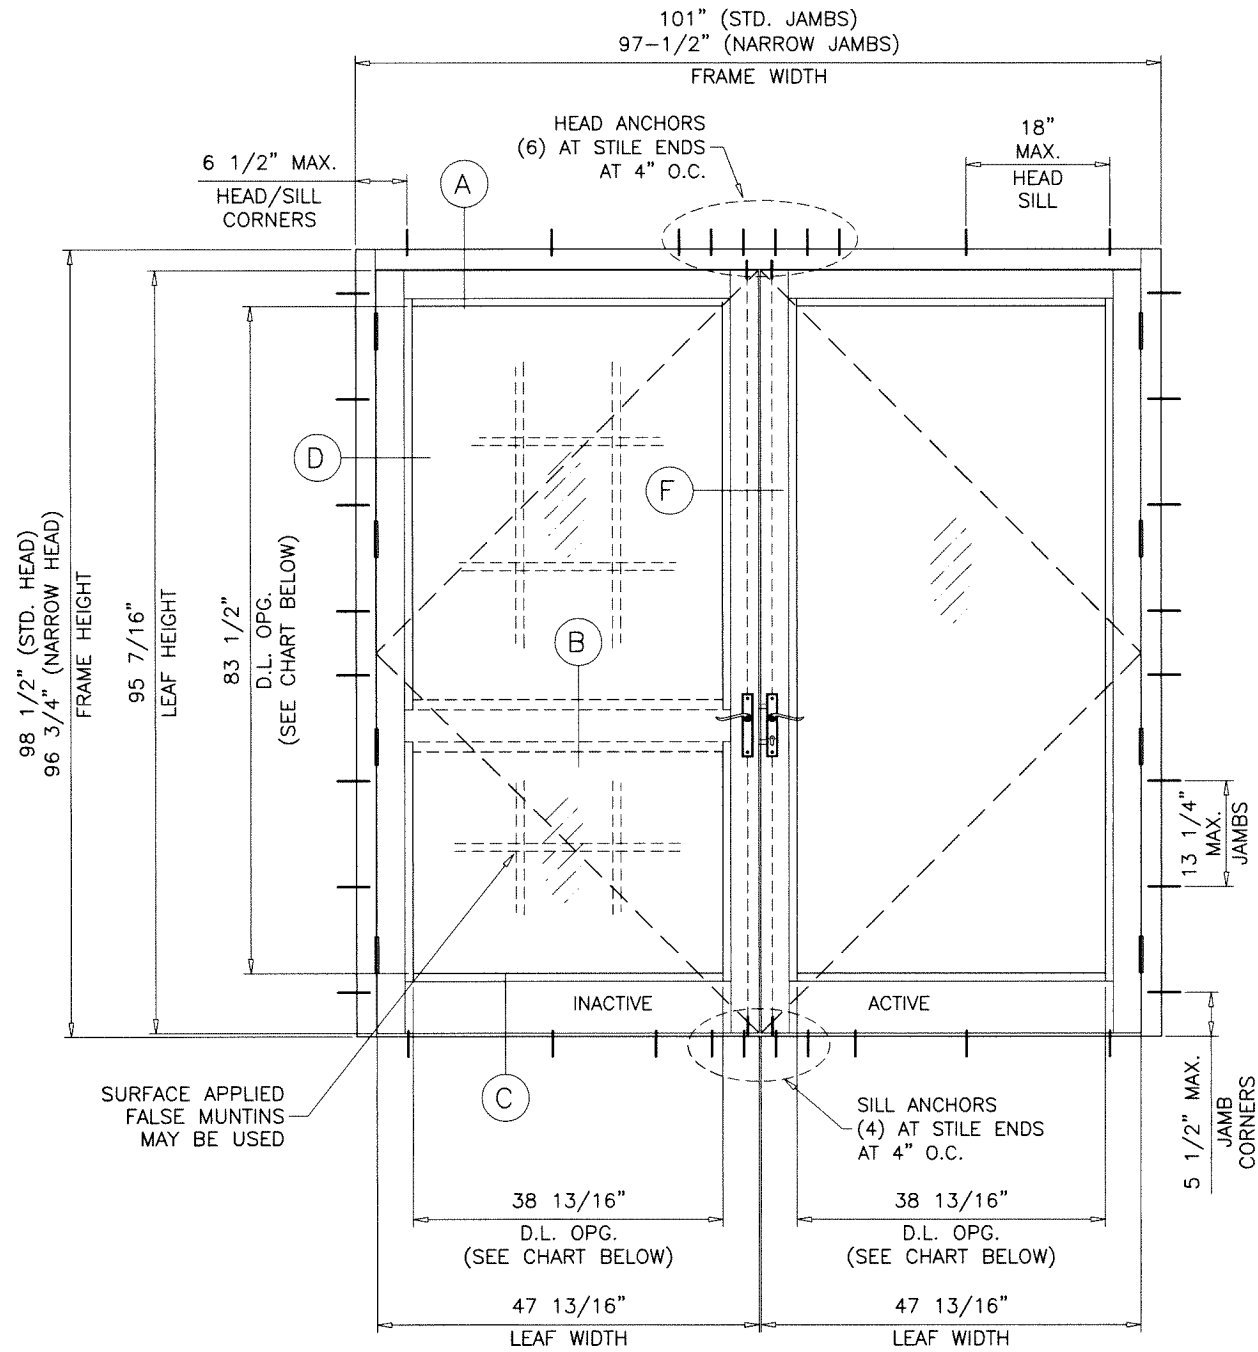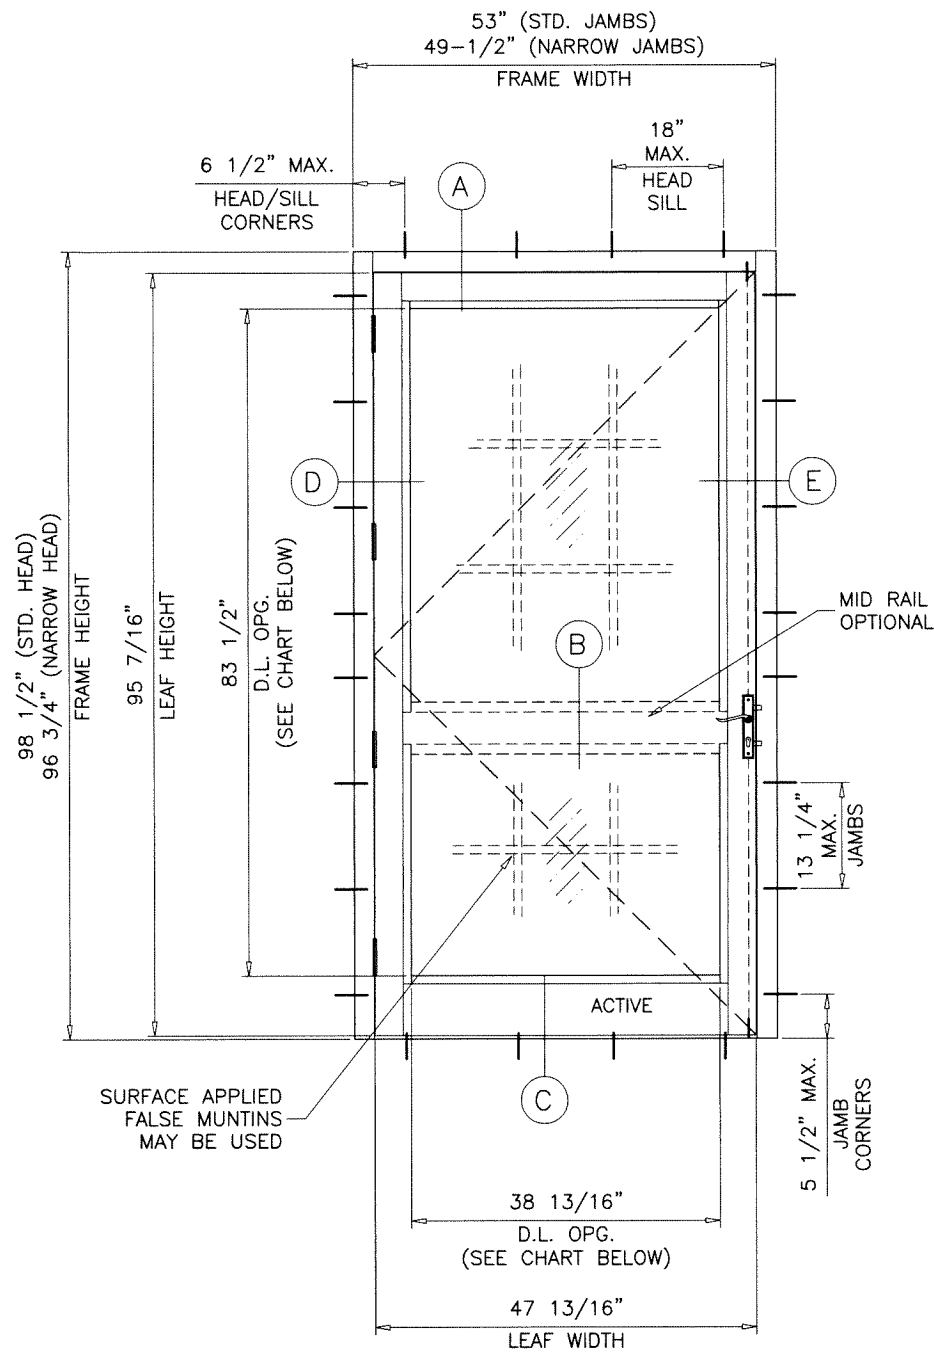

TYPICAL ELEVATIONS

SINGLE DOORS LOAD CAPACITY - PSF							
DOOR OPNG. DIMS.		LEAF DIMS. MAX.		D.L. OPNG. MAX.		EXT.(+)	INT.(-)
WIDTH	HEIGHT	WIDTH	HEIGHT	WIDTH	HEIGHT		
48"	96"	47-13/16"	95-7/16"	38-13/16"	83-1/2"	70.0	70.0
37-1/2"	108" *	37-5/16"	107-7/16"	28-5/16"	95-1/2"	66.0	66.0


DOUBLE DOORS LOAD CAPACITY - PSF							
DOOR OPNG. DIMS.		LEAF DIMS. MAX.		D.L. OPNG. MAX.		EXT.(+)	INT.(-)
WIDTH	HEIGHT	WIDTH	HEIGHT	WIDTH	HEIGHT		
96"	96"	47-13/16"	95-7/16"	38-13/16"	83-1/2"	70.0	70.0
75"	108" *	37-5/16"	107-7/16"	28-5/16"	95-1/2"	66.0	66.0

* LIMIT THESE SIZES TO DOORS GLAZED WITH DOWSIL 995 ONLY.

NOTE:
GLASS CAPACITIES ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

Sealed: 6/25/2024

FL #29696

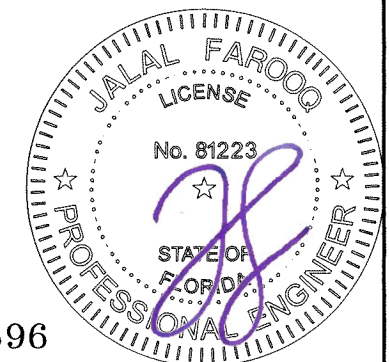


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
C.A.N. 3538


MONUMENTAL ALUMINUM OUTSWING DOOR (L.M.I.)
TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

revisions:		no	date	by	description

date: 06-14-24
scale: 1/2"=1'-0"
dr. by: TARIQ
chk. by:
drawing no.
24-37F
sheet 2 of 15

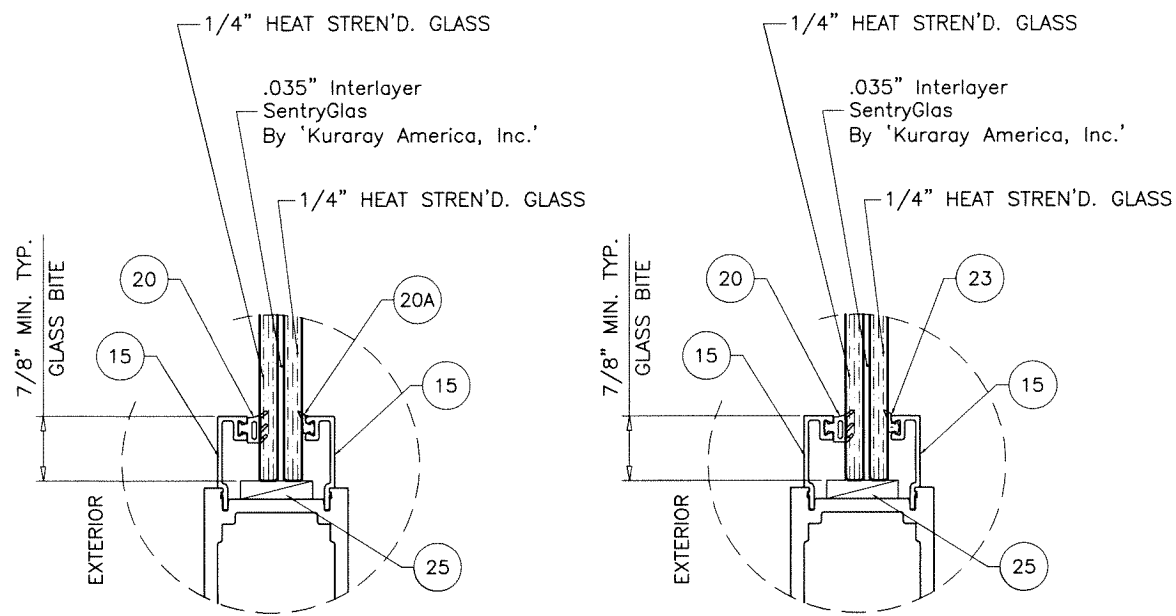

GLASS TYPE 'C'
9/16" OVERALL LAM. GLASS

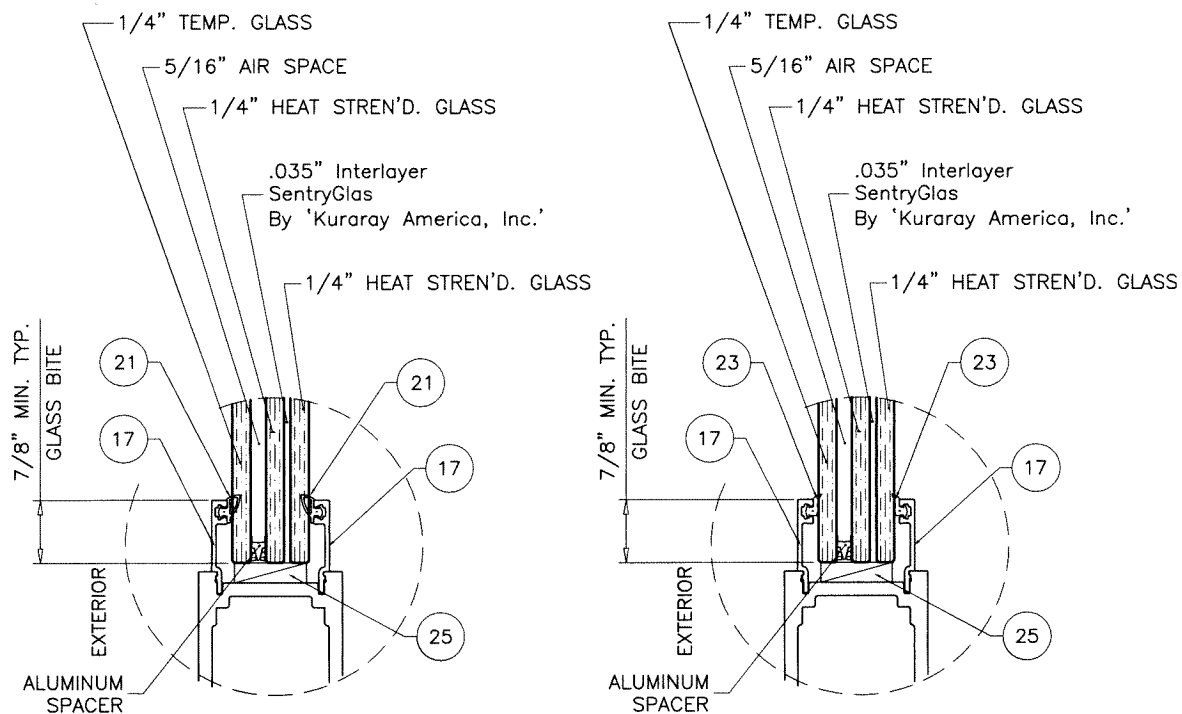


GLASS TYPE 'Ci'
1-1/16" OVERALL INSUL. LAM. GLASS

GLAZING DETAILS
LEVEL 'C' IMPACT

Sealed: 6/25/2024

FL #29696

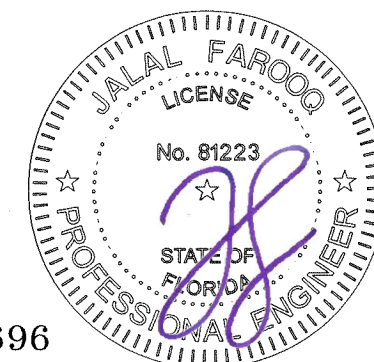

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

a f c
COMP-ANL 24-37F-TLI

MONUMENTAL ALUMINUM OUTSWING DOOR (L.M.I.)

TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

revisions:		date		by description	
no	date	no	date	no	date

date: 06-14-24

scale: 3/8" = 1"


dr. by: TARIQ

chk. by:


drawing no.

24-37F


sheet 3 of 15

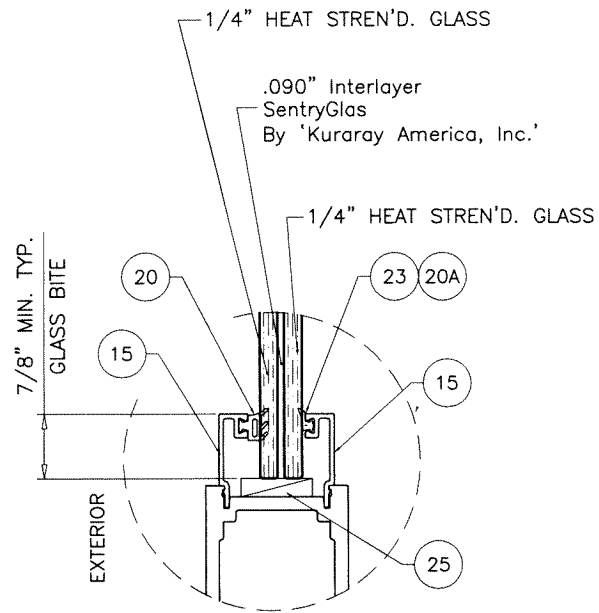


GLASS TYPE 'D'
9/16" OVERALL LAM. GLASS

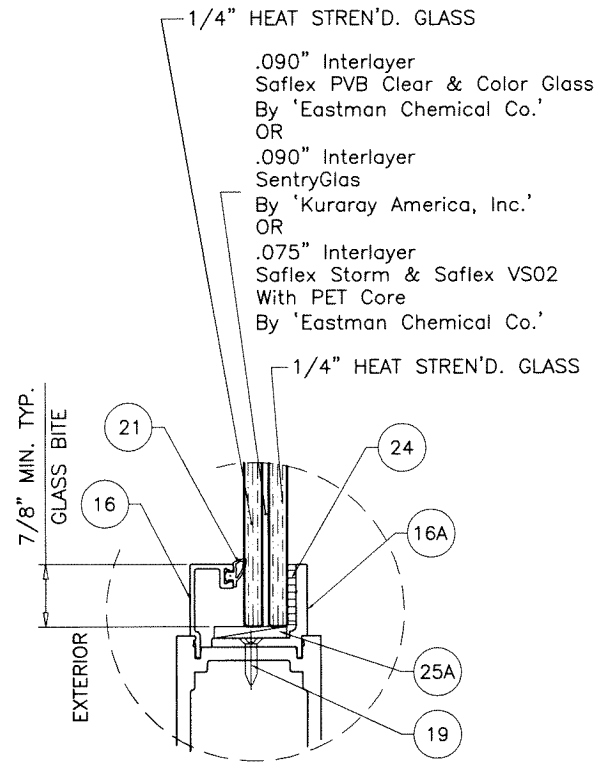


GLASS TYPE 'D1'
9/16" OVERALL LAM. GLASS

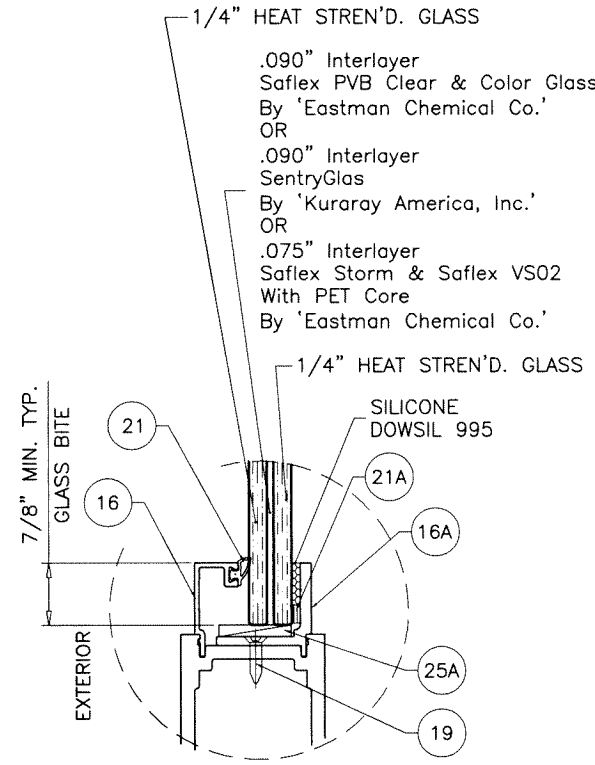


GLASS TYPE 'D2'
9/16" OVERALL LAM. GLASS

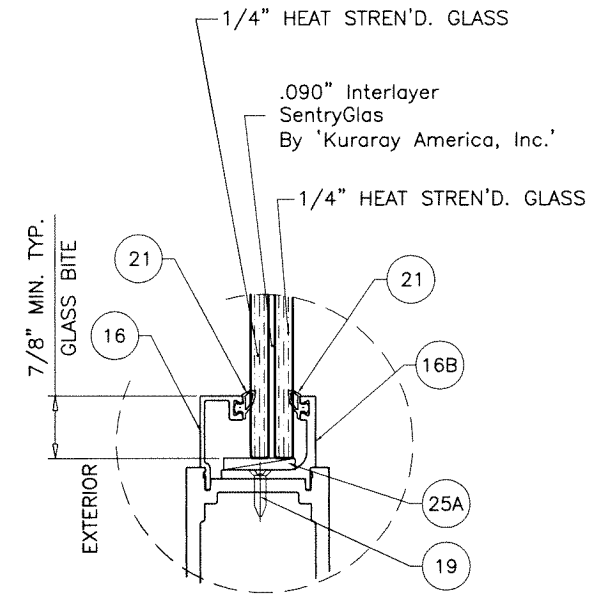


GLASS TYPE 'D3'
9/16" OVERALL LAM. GLASS

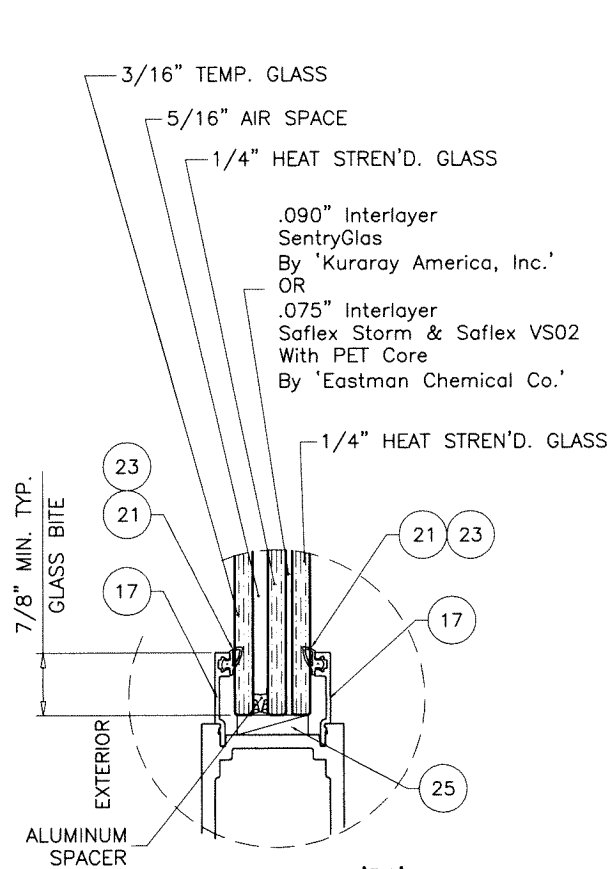


GLASS TYPE 'Di'
1-1/16" OVERALL INSUL. LAM. GLASS

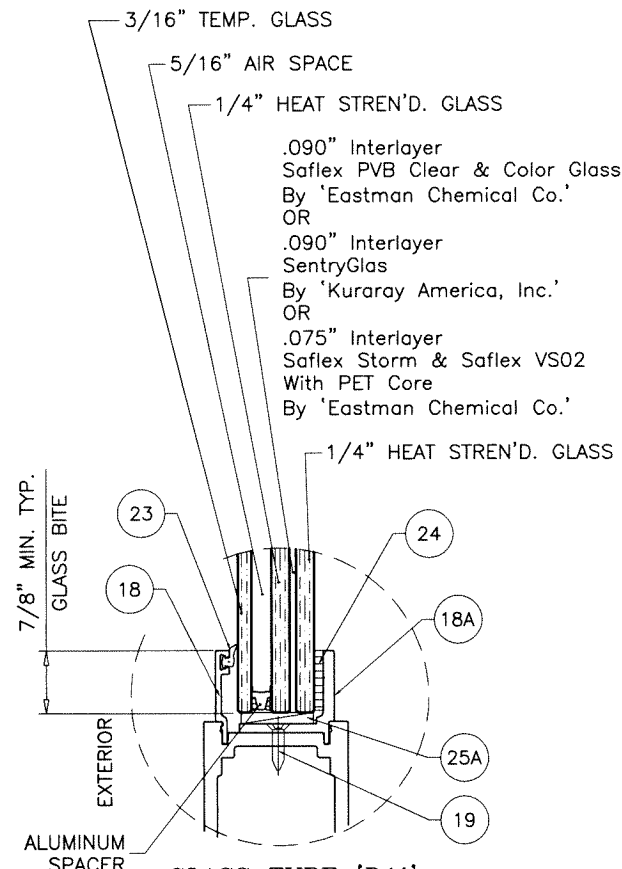

GLASS TYPE 'D1i'
1-1/16" OVERALL INSUL. LAM. GLASS

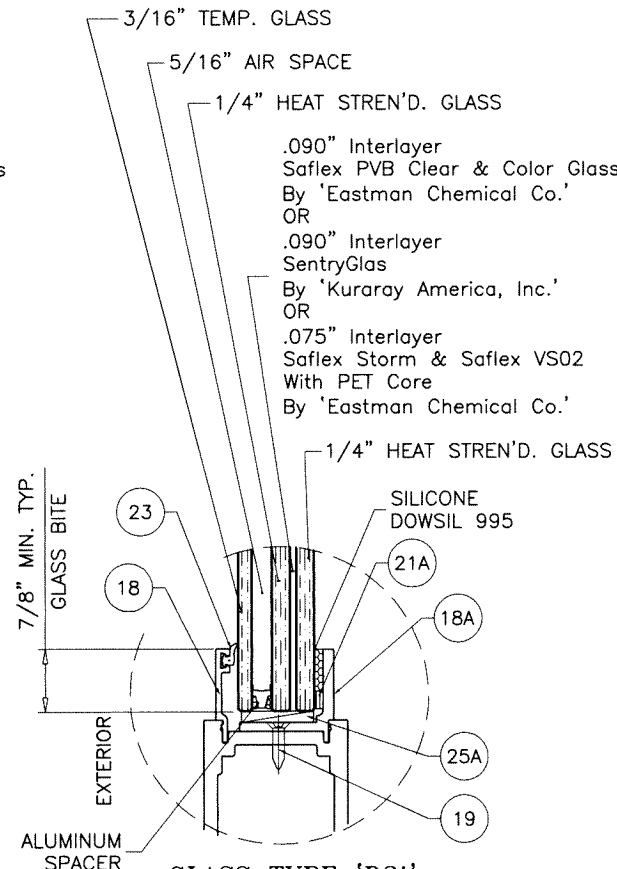

GLASS TYPE 'D2i'
1-1/16" OVERALL INSUL. LAM. GLASS

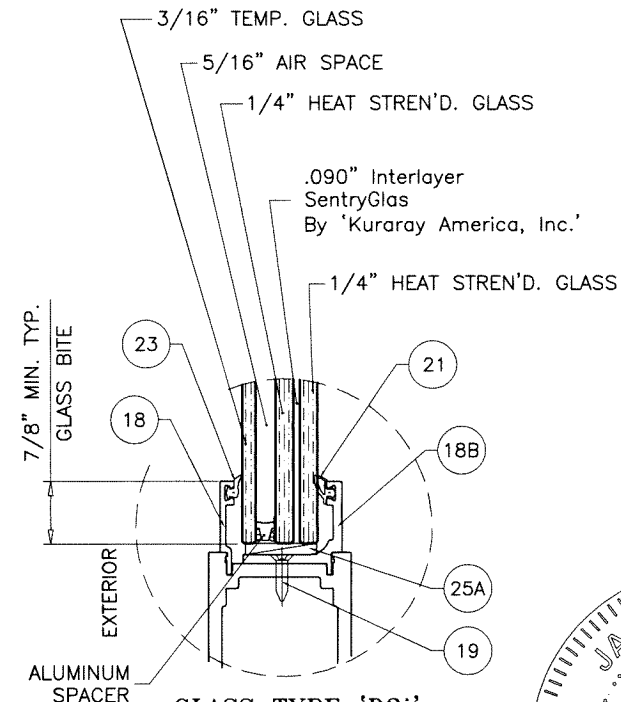

GLASS TYPE 'D3i'
1-1/16" OVERALL INSUL. LAM. GLASS

**GLAZING DETAILS
LEVEL 'D' IMPACT**

Sealed: 6/25/2024


FL #29696




af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220 (C.A.N. 3538)
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\24-37F-TLI

MONUMENTAL ALUMINUM OUTSWING DOOR (L.M.I.)
TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.


revisions:		no date by description	
date:	06-14-24	scale:	3/8" = 1"
dr. by:	TARIQ	chk. by:	
drawing no.		24-37F	
sheet 4 of 15			

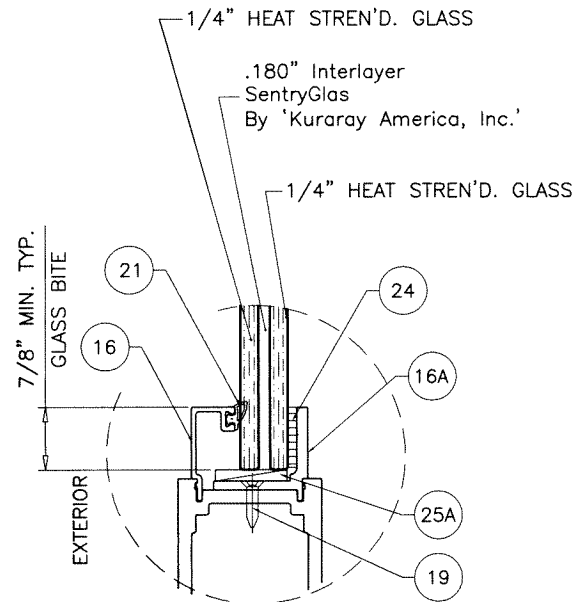


GLASS TYPE 'E1'
11/16" OVERALL LAM. GLASS

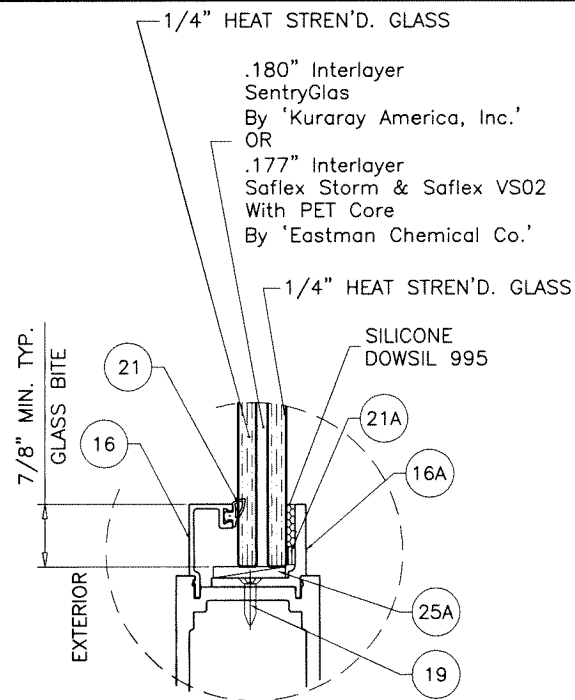


GLASS TYPE 'E2'
11/16" OVERALL LAM. GLASS

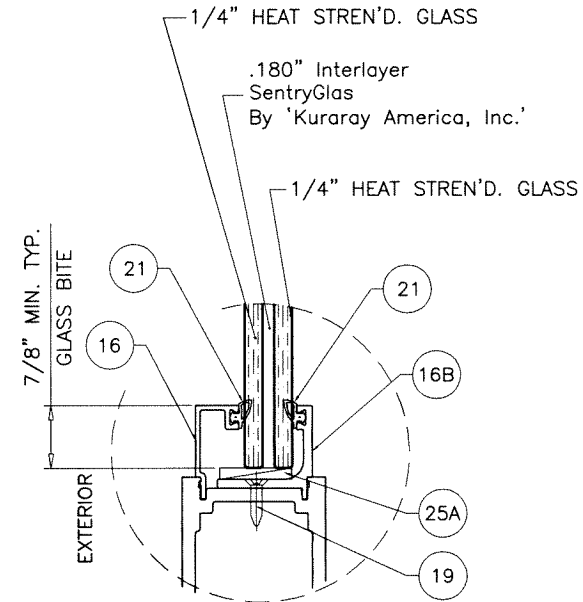


GLASS TYPE 'E3'
11/16" OVERALL LAM. GLASS

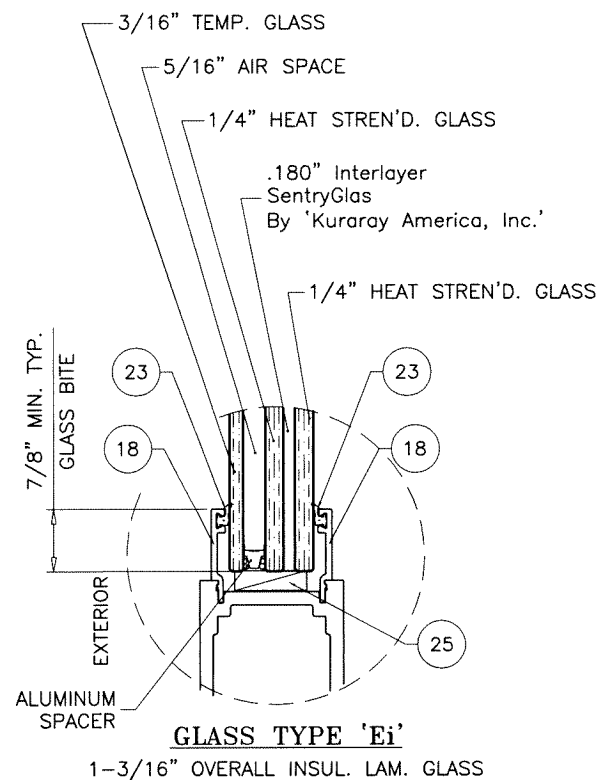


GLASS TYPE 'Ei'
1-3/16" OVERALL INSUL. LAM. GLASS

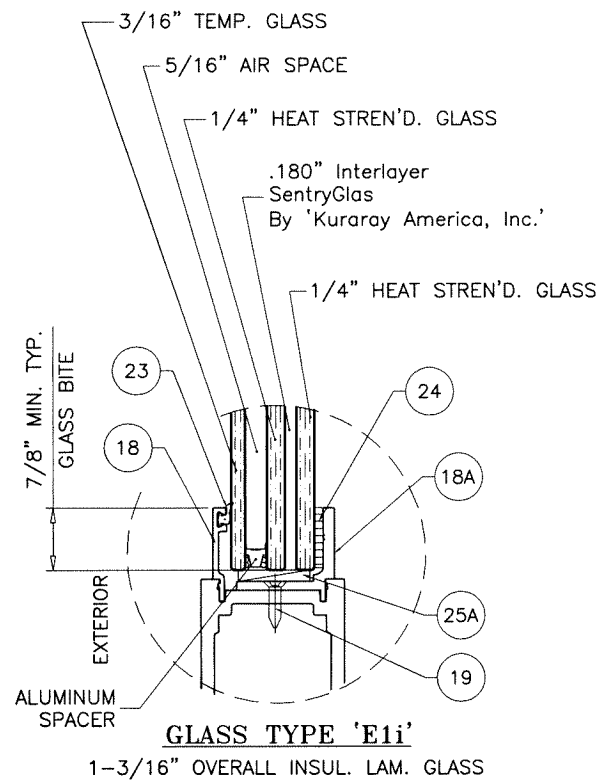

GLASS TYPE 'E1i'
1-3/16" OVERALL INSUL. LAM. GLASS

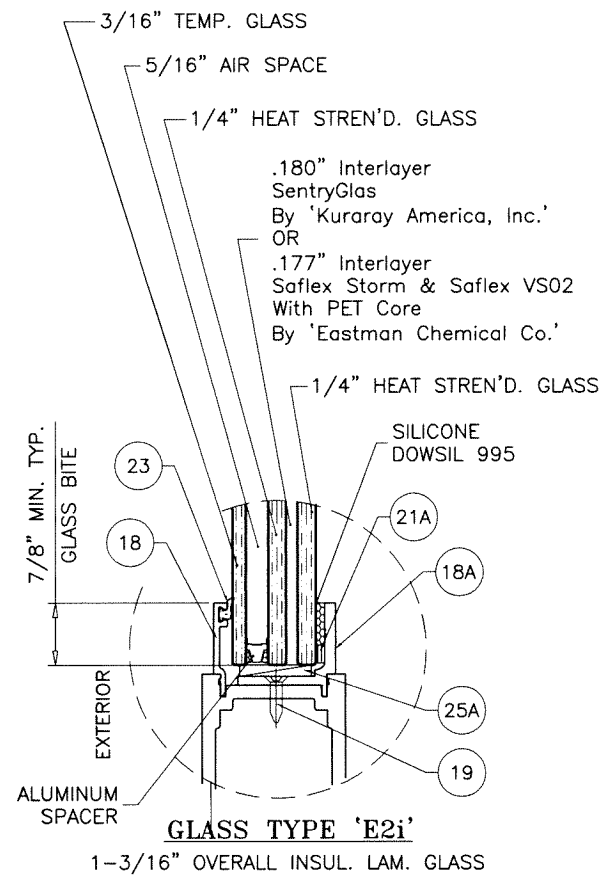

GLASS TYPE 'E2i'
1-3/16" OVERALL INSUL. LAM. GLASS

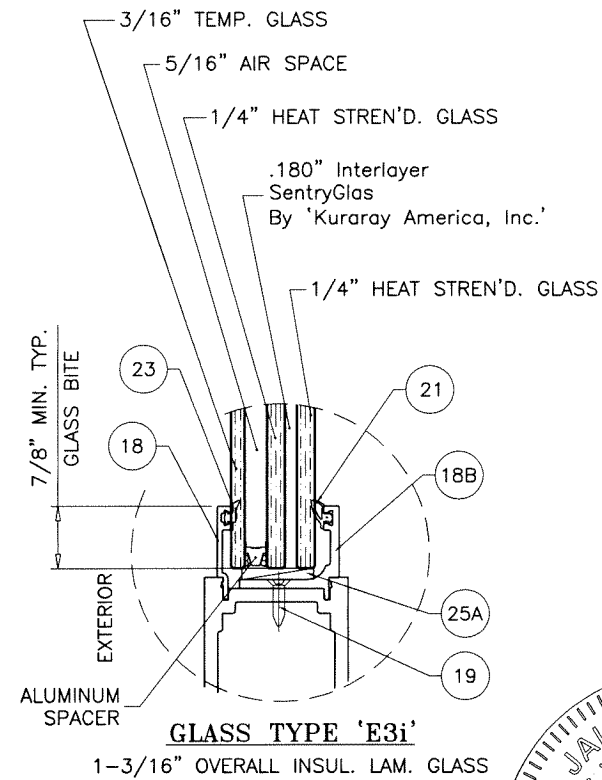

GLASS TYPE 'E3i'
1-3/16" OVERALL INSUL. LAM. GLASS

**GLAZING DETAILS
LEVEL 'E' IMPACT**

Sealed: 6/25/2024





FL #29696



af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL 24-37F-TLI

MONUMENTAL ALUMINUM OUTSWING DOOR (L.M.I.)
TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

revisions:		no	date	by	description
date:	06-14-24	scale:	3/8" = 1"	dr. by:	TARIQ
chk. by:					
drawing no.		24-37F			
sheet		4.1 of 15			

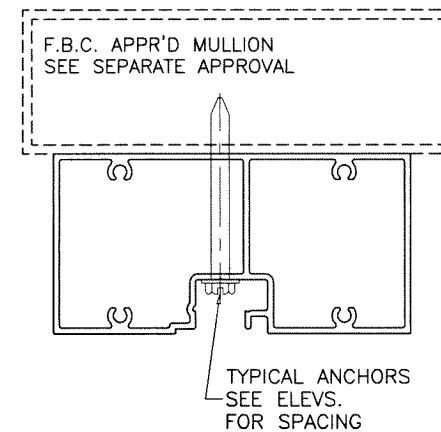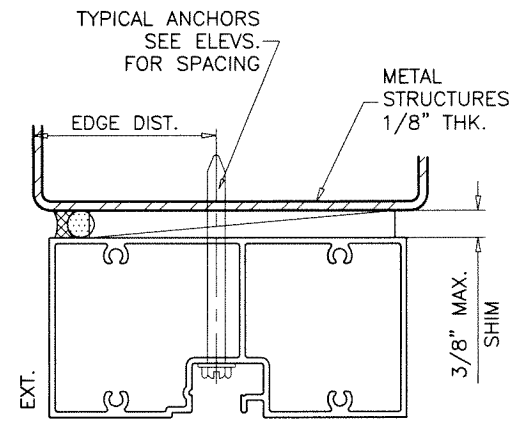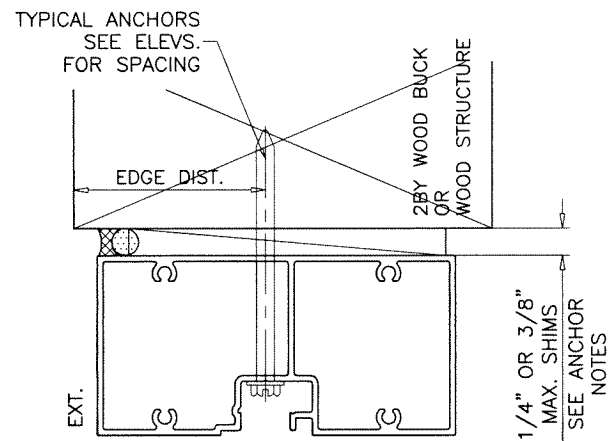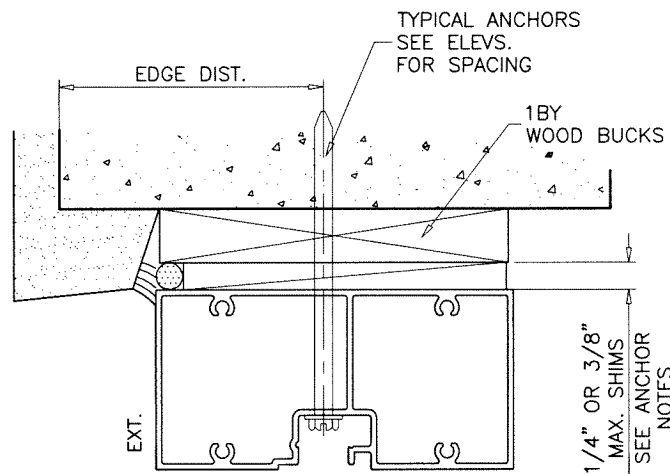

WOOD BUCKS AND METAL STRUCTURE NOT BY 'TUBELITE INC.' MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4" DIA. TAPCON BY 'ITW' ($F_u=125$ KSI, $F_y=100$ KSI)
(1/4" MAX. SHIMS)

1/4" DIA. ULTRACON+ BY 'DEWALT' ($F_u=164$ KSI, $F_y=148$ KSI)
(3/8" MAX. SHIMS)

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD (HEAD/JAMBS)

THRU 1BY BUCKS INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONCRETE (HEAD/JAMBS)
1-1/4" MIN. EMBED INTO MASONRY (JAMBS)

DIRECTLY INTO CONCRETE OR MASONRY
1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
1-1/4" MIN. EMBED INTO MASONRY (JAMBS)

1/4" DIA. TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)
(3/8" MAX. SHIMS)


INTO F.B.C. APPROVED MULLIONS
OR
INTO 18 GA. METAL STUDS ($F_y = 33$ KSI MIN.)
OR
INTO METAL STRUCTURES (HEAD/SILL/JAMBS)
ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
STEEL: 1/8" THK. MIN. ($F_y = 36$ KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 2-1/2" MIN.
INTO WOOD STRUCTURE = 1" MIN.
INTO METAL STRUCTURE = 1/2" MIN.

WOOD AT HEAD OR JAMBS SG = 0.55 MIN.
CONCRETE AT HEAD, SILL OR JAMBS $f'_c = 3000$ PSI MIN.
C-90 HOLLOW/FILLED BLOCK AT JAMBS $f'_m = 2000$ PSI MIN.

Sealed: 6/25/2024

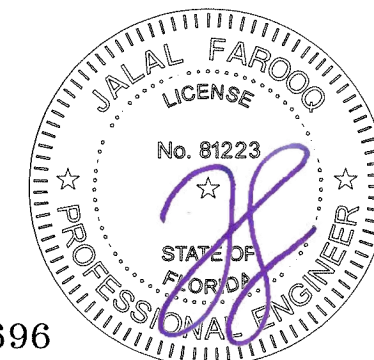

FL #29696

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220 (C.A.N. 3538)
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

MONUMENTAL ALUMINUM OUTSWING DOOR (L.M.I.)

TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

revisions:		no	date	by	description


date: 06-14-24	scale: 3/8" = 1"	dr. by: TARIQ	chk. by:
----------------	------------------	---------------	----------

drawing no.

24-37F

sheet 6 of 15

COMP-ANL\24-37F-TLI

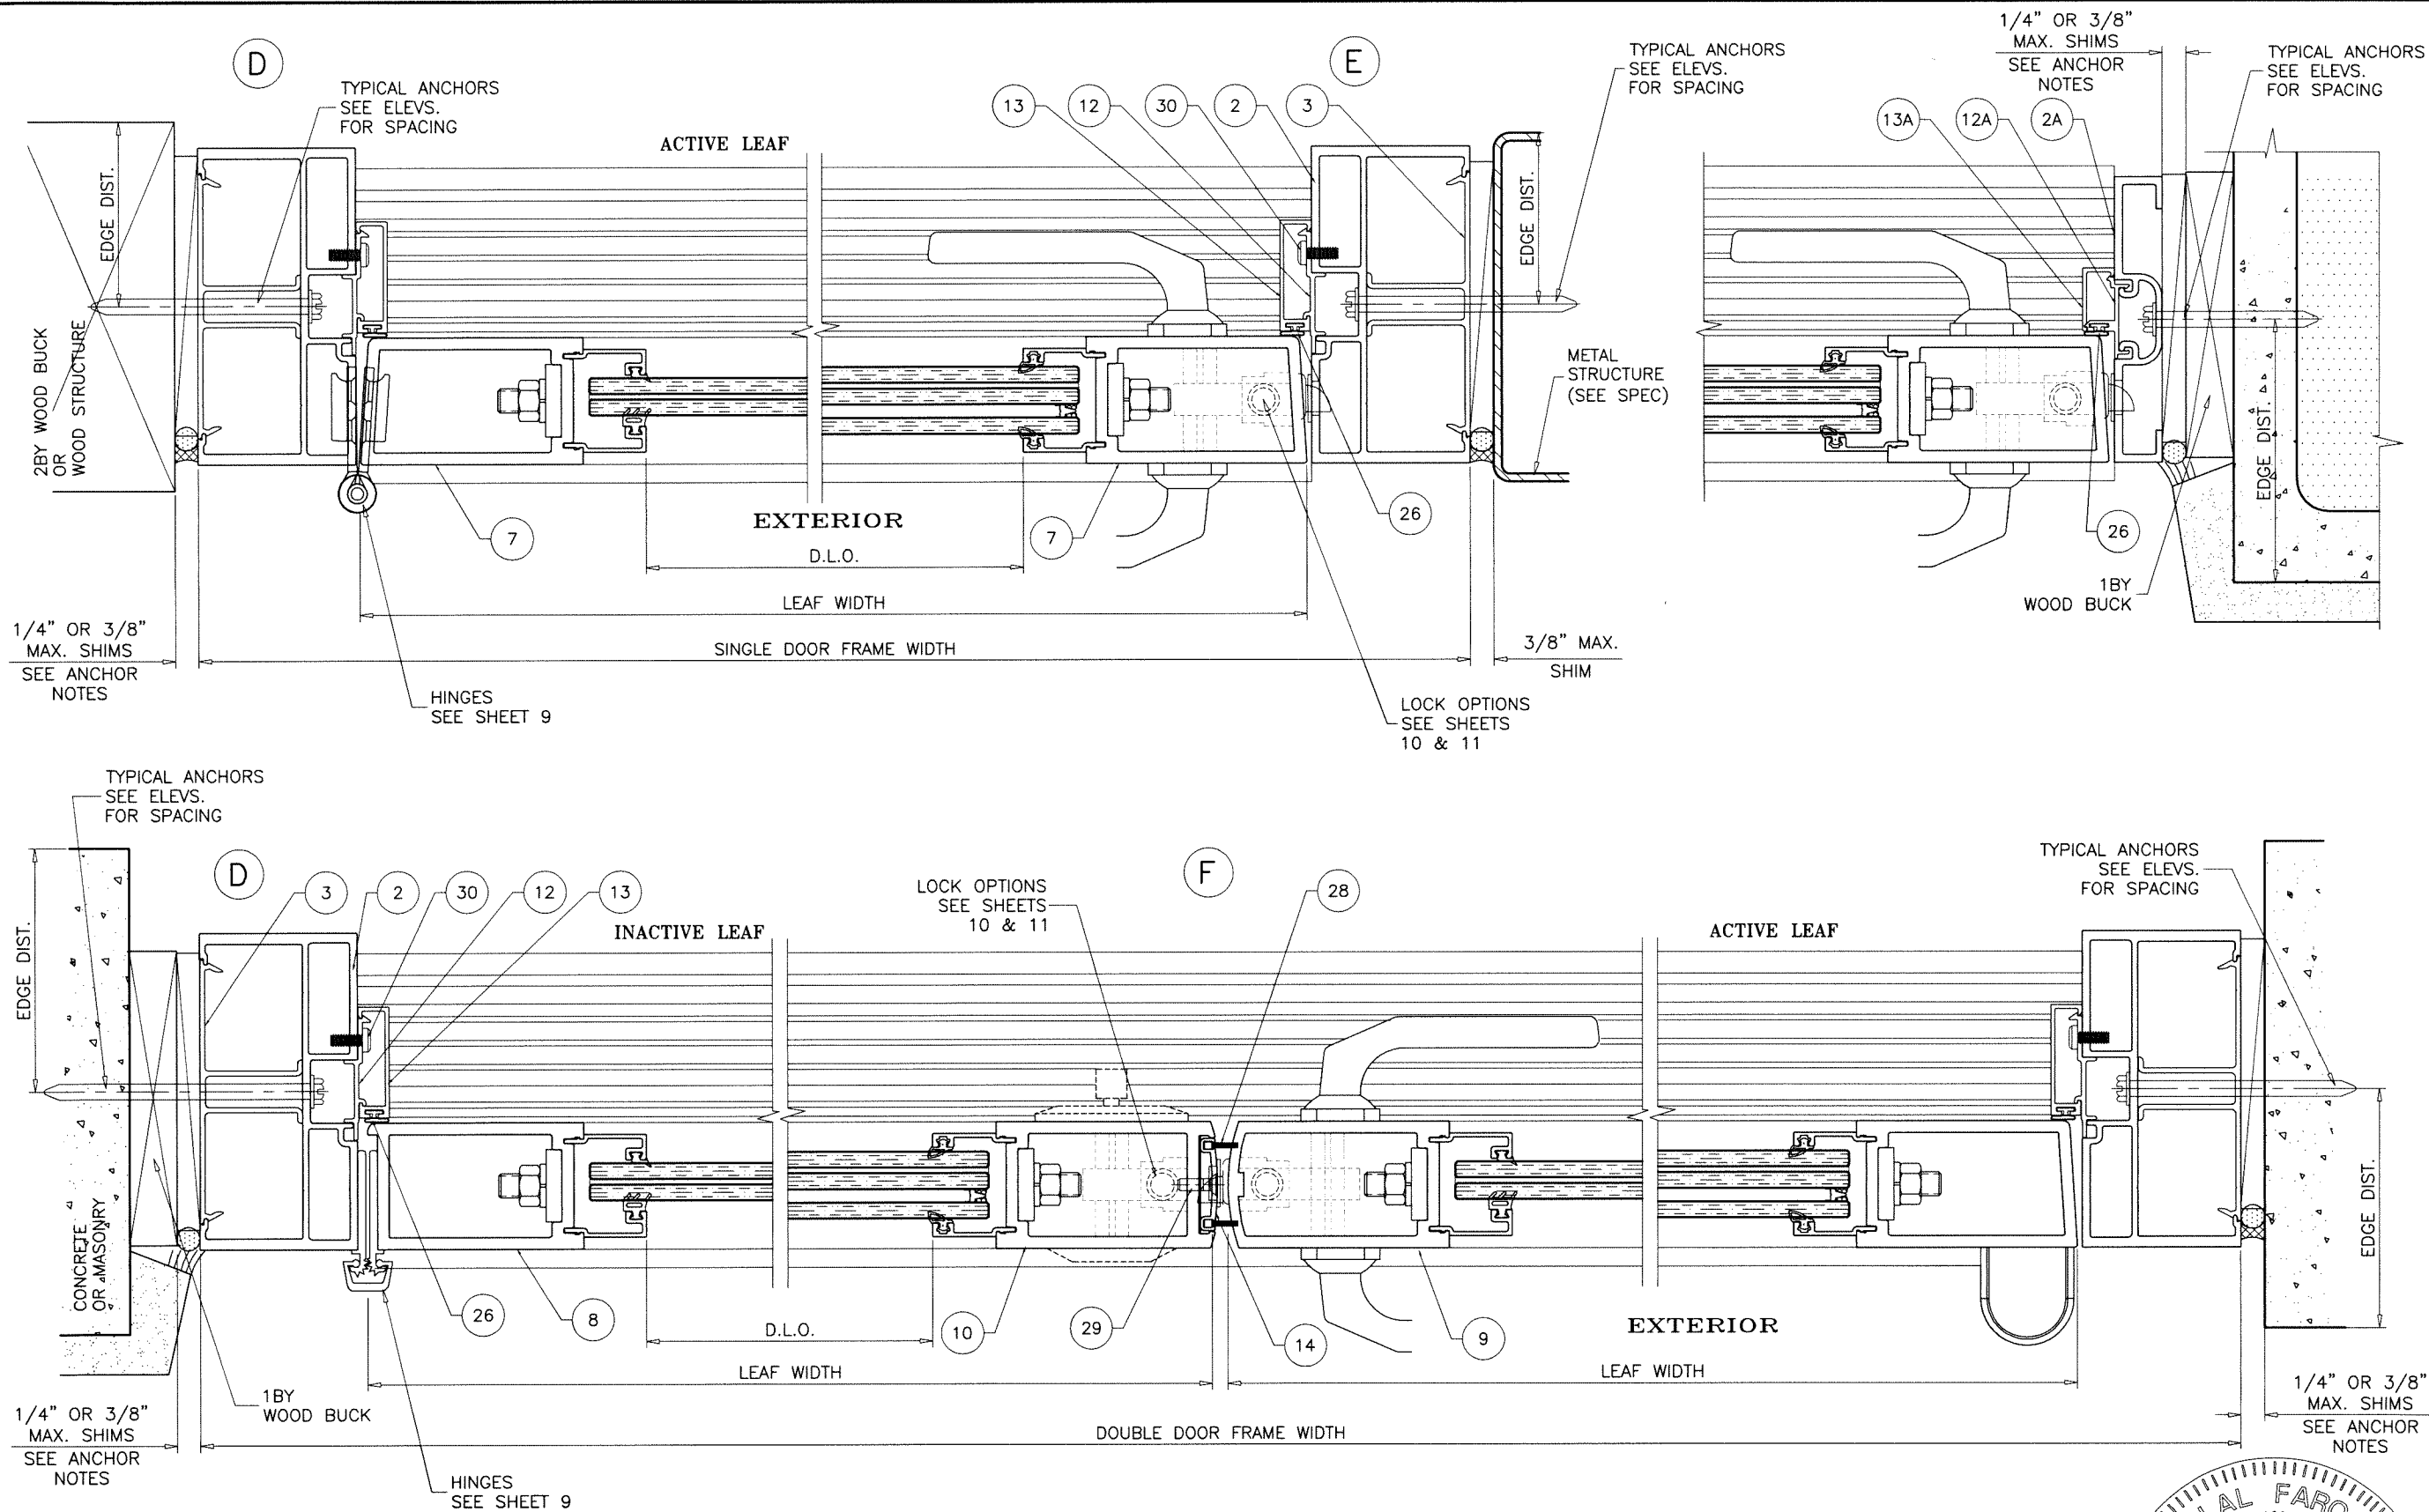

af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL 24-37F-TLI

MONUMENTAL ALUMINUM OUTSWING DOOR (L.M.I.)

TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite C
Walker, MI 49544
Tel. 800-866-2227 Fax.


revisions:	
no	date by description

date: 06-14-24
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
24-37F
sheet 7 of 15

Sealed: 6/25/2024

FL #29696

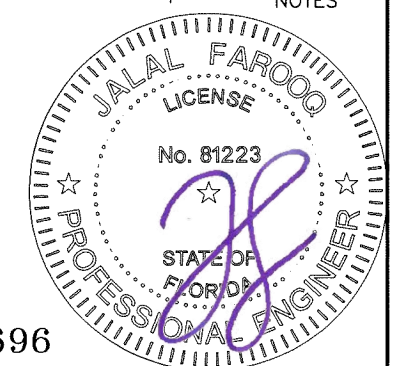


HINGE OPTIONS:

OPTION #1:


4-1/2" LONG FLUSH MOUNT STEEL BUTT HINGES
'BB1191' BY 'HAGER' OR
'ABH-663' BY 'ABH MANUFACTURING INC.'
FASTENED WITH 12-20 X 1/2" FH MACHINE SCREWS
FOUR PER HASP(LEAF).
TOP AND BOTTOM HINGES AT 5-1/2" FROM ENDS
INTERMEDIATE HINGES AT 32" O.C. MAX.

1" X 7-3/8" X 1/4" THK. ALUM BACK PLATE
AT FRAME AND LEAF
FASTENED WITH (4) #12-20 X 1/2" FH MACHINE SCREWS

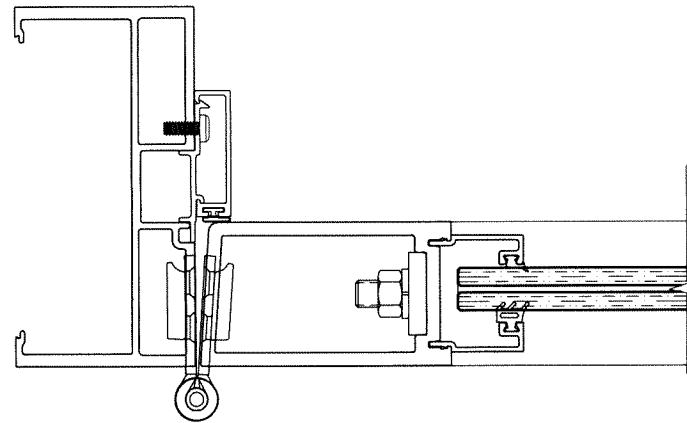

OPTION #2:

CONTINUOUS GEAR ALUMINUM ROTON HINGE
'SL 11HD' BY 'SELECT'
'780' BY 'HAGER'
'KCFM-95HD1' BY 'PEMCO'
'A110HD' BY 'ABH'
FASTENED TO FRAME JAMB AND TO JAMB STILE WITH
#12-24 X 7/16" FH MS SCREWS
IN PAIRS AT 2", 4" AND 6" FROM TOP AND BOTTOM ENDS
AND IN SINGLE ROW AT 10" O.C. THEREAFTER.

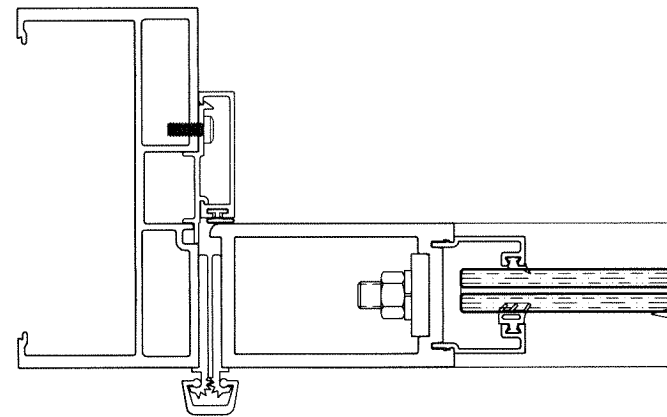

OPTION #3:

OFFSET PIVOT HINGES
'P795DT/IL/DB' BY 'TUBELITE'
'180/M19/147' BY 'RIXON'


TOP AND BOTTOM HINGES
FASTENED TO FRAME AND LEAF WITH
(4) 1/4-20 X 5/8" FH MACHINE SCREWS

TOP SHIM 'C' CHANNEL
(11/16" X 1-1/2" X 6-1/2" LONG X 1/8" FLANGE THK. X 1/4" WEB THK.)
FASTENED WITH (2) 1/4-20 X 1-1/2" FH MACHINE SCREWS

BOTTOM SHIM 'C' CHANNEL
(1-1/4" X 1-1/2" X 9-1/2" LONG X 1/8" FLANGE THK. X 1/4" WEB THK.)
FASTENED WITH (2) 1/4-20 X 1-1/2" FH MACHINE SCREWS

INTERMEDIATE HINGES AT 35" O.C.
FASTENED TO FRAME AND LEAF WITH
(5) 1/4-20 X 5/8" FH MACHINE SCREWS

1" X 7-3/8" X 1/4" THK. ALUM BACK PLATE
AT FRAME AND LEAF
FASTENED WITH (4) #12-20 X 1/2" FH MACHINE SCREWS

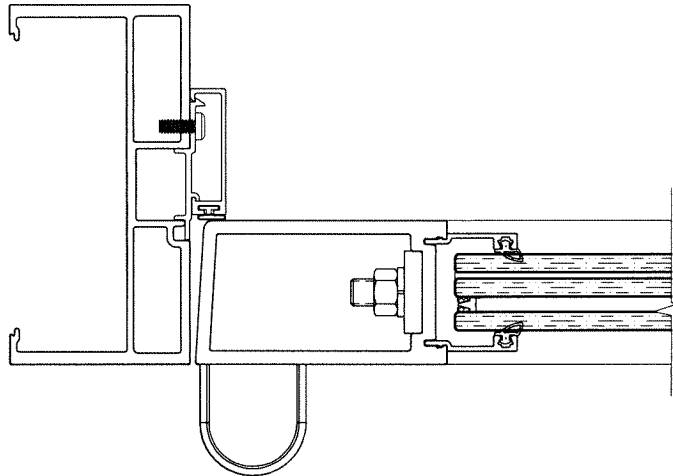

Sealed: 6/25/2024

FL #29696



af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220 (C.A.N. 3538)
MIAMI, FLORIDA 33173 FAX. (305) 262-6978
TEL. (305) 264-8100

COMP-ANL\24-37F-TLI

MONUMENTAL ALUMINUM OUTSWING DOOR (L.M.I.)

TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

revisions:		by description	
no	date	by	description

date: 06-14-24	scale: -	dr. by: TARIQ	chk. by:
drawing no.		24-37F	
sheet 9 of 15			

LOCK OPTIONS:

3 POINT LOCK

MAX. LEAF HEIGHT = 96 IN.
MAX. LEAF WIDTH = 48 IN.
MAX. DESIGN LOAD = 70 PSF



MAX. LEAF HEIGHT = 108 IN.
MAX. LEAF WIDTH = 37-1/2 IN.
MAX. DESIGN LOAD = 66 PSF

ACTIVE LEAF:

KEY OPERATED THREE POINT LOCK SYSTEM
'MS1853A/4015/4016' AND 'MS1850S/4015/4016' BY 'ADAMS RITE'
WITH CONCEALED FLUSH BOLTS AT TOP &
BOTTOM OF LOCK STILE AND A THUMB TURN ON THE
INTERIOR, LOCATED AT 40" FROM BOTTOM OF PANEL
FASTENED WITH
(2) #12-24 X 1/2" FH MACHINE SCREWS

INACTIVE LEAF:

MANUALLY OPERATED TWO POINT LOCK SYSTEM
'MS1881' AND 'MS2180' BY 'ADAMS RITE'
WITH CONCEALED FLUSH BOLTS AT TOP &
BOTTOM OF LOCK STILE AND A THUMB TURN ON THE
INTERIOR, LOCATED AT 40" FROM BOTTOM OF PANEL
FASTENED WITH
(2) #8-32 X 1/4" PH MACHINE SCREWS

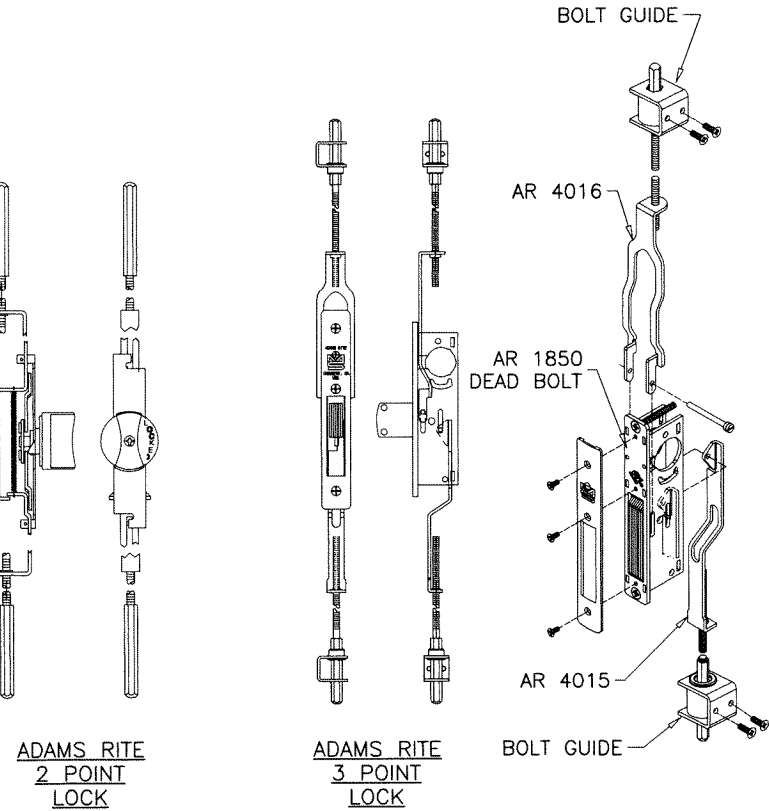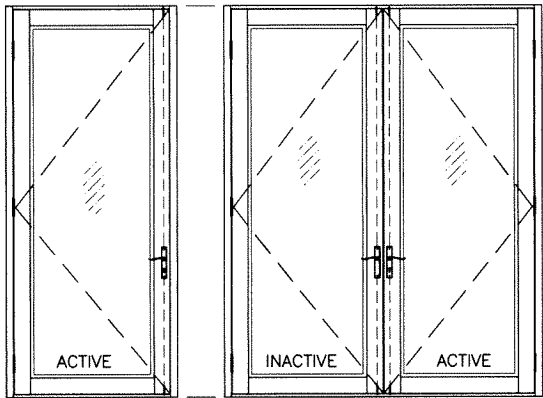


LOCK OPTIONS:

RIM PANIC EXIT DEVICES

PANIC EXIT DEVICE
MAX. LEAF HEIGHT = 96 IN.
MAX. LEAF WIDTH = 42 IN.
MAX. DESIGN LOAD = 50 PSF

ACTIVE LEAF:

RIM PANIC EXIT DEVICE
'98/99XP' BY 'VON DUPRIN'
'33A/35A' BY 'VON DUPRIN'
'FL3790' BY 'FIRST CHOICE'
'WS AD8500' BY 'SARGENT'
LOCATED AT 40" FROM BOTTOM
FASTENED TO ACTIVE LEAF WITH WITH
(6) 10-24 X 1-1/8" PH MS

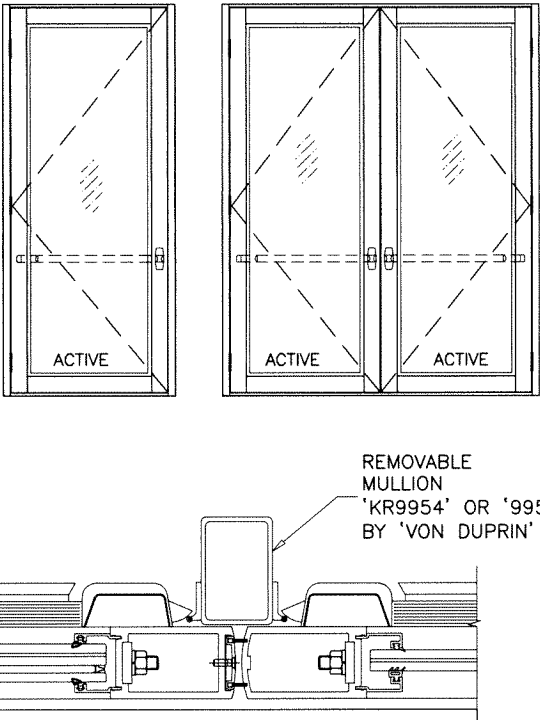

Sealed: 6/25/2024

FL #29696



af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL 24-37F-TLI

MONUMENTAL ALUMINUM OUTSWING DOOR (L.M.I.)

TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

revisions:

no	date	by	description

date: 06-14-24

scale: -

dr. by: TARIQ

chk. by:

drawing no.
24-37F

sheet 10 of 15

LOCK OPTIONS:

CVR PANIC EXIT DEVICES



OPTION #1:

PANIC EXIT DEVICE

MAX. LEAF HEIGHT = 96 IN.
MAX. LEAF WIDTH = 48 IN.
MAX. DESIGN LOAD = 70 PSF

ACTIVE & INACTIVE LEAF:

CONCEALED VERTICAL ROD PANIC EXIT DEVICE
'#2086' BY 'JACKSON PANIC SYSTEM'
'3690FL' BY 'FIRST CHOICE'
LOCATED AT 41" FROM SILL AT EACH LEAF.
FASTENED WITH
(1) #14 X 1" HH SELF DRILLING SCREW AT ONE END AND
(2) #12-24 X 1/2" OH MACHINE SCREWS AT OTHER END

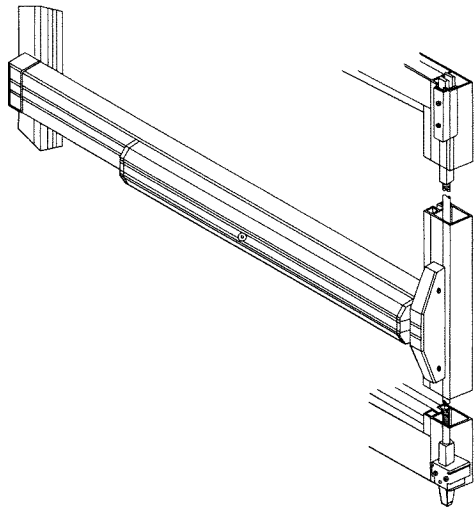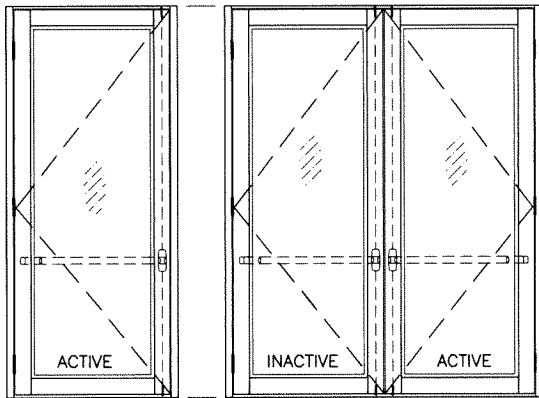



OPTION #2:

PANIC EXIT DEVICE

MAX. LEAF HEIGHT = 96 IN.
MAX. LEAF WIDTH = 48 IN.
MAX. DESIGN LOAD = 70 PSF

ACTIVE & INACTIVE LEAF:

CONCEALED VERTICAL ROD PANIC EXIT DEVICE
'HH9947' BY 'VON DUPRIN'
LOCATED AT 40" FROM SILL AT EACH LEAF.
FASTENED WITH
(2) #10-32 X 3/4" FH MACHINE SCREWS AT ONE END AND
(2) #10-24 X 1/2" FH MACHINE SCREWS AT OTHER END

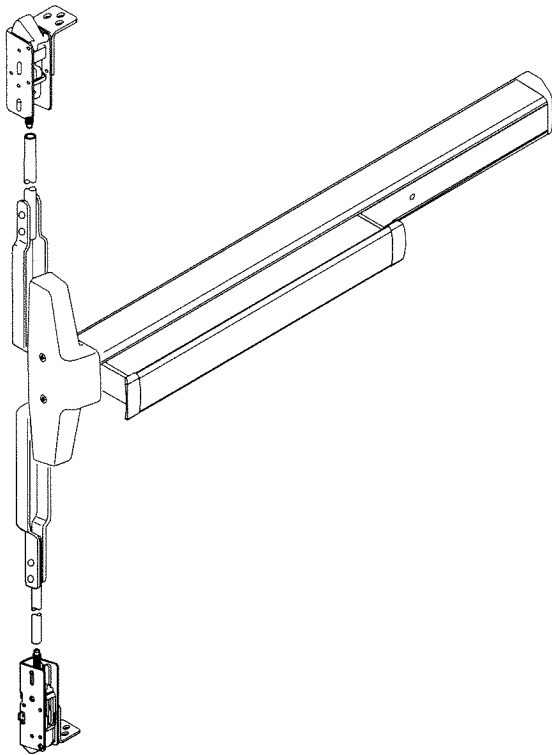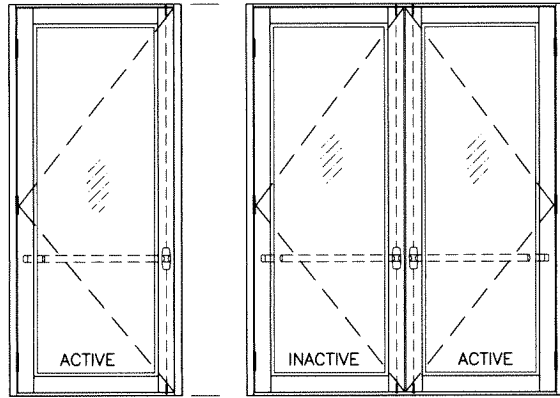

OPTION #3:

PANIC EXIT DEVICE

MAX. LEAF HEIGHT = 96 IN.
MAX. LEAF WIDTH = 48 IN.
MAX. DESIGN LOAD = 70 PSF

ACTIVE & INACTIVE LEAF:

CONCEALED VERTICAL ROD PANIC EXIT DEVICE
'1690HH' BY 'FALCON'
LOCATED AT 41" FROM SILL AT EACH LEAF.
FASTENED WITH
(1) #14 X 1" HH SELF DRILLING SCREW AT ONE END AND
(2) #12-24 X 1/2" OH MACHINE SCREWS AT OTHER END

PANIC EXIT DEVICE

MAX. LEAF HEIGHT = 108 IN.
MAX. LEAF WIDTH = 37-1/2 IN.
MAX. DESIGN LOAD = 66 PSF

Sealed: 6/25/2024

FL #29696



MONUMENTAL ALUMINUM OUTSWING DOOR (L.M.I.)

TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

revisions:
no date by description

date: 06-14-24
scale: -
dr. by: TARIQ
chk. by:

drawing no.

24-37F


sheet 11 of 15

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)
COMP-ANL\24-37F-TLI

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	E34224	1	DOOR FRAME HEAD (MONUMENTAL)	6063-T6	-
1A	E4TB111	1	DOOR FRAME HEAD (NARROW)	6063-T6	-
1B	E34125	1	DOOR FRAME HEAD (CONCEALED CLOSERS)	6063-T6	-
1C	P4441	1	FRAME HEAD (CONCEALED CLOSERS) CORNER KEY	6063-T6	-
1D	E6504	1	HEAD (CONCEALED CLOSERS) DOOR STOP	6063-T6	-
1E	E2298	1	HEAD (CONCEALED CLOSERS) DOOR STOP COVER	6063-T6	-
2	E34144	2	DOOR FRAME JAMB (MONUMENTAL)	6063-T6	-
2A	E4TB11	2	DOOR FRAME JAMB (NARROW)	6063-T6	-
3	E34242	2	JAMB SHEAR CLIP (MONUMENTAL)	6063-T6	-
4	E3550	1	THRESHOLD	6063-T6	-
5	-	1/ LEAF	LEAF TOP RAIL	6063-T6	-
6	-	1/ LEAF	BOTTOM RAIL	6063-T6	-
7	-	1/ LEAF	LEAF HINGE/LOCK STILE	6063-T6	-
8	-	1/ LEAF	LEAF ALT. HINGE STILE	6063-T6	-
9	-	1/ LEAF	LEAF ACTIVE STILE	6063-T6	-
10	-	1/ LEAF	LEAF INACTIVE STILE	6063-T6	-
10A	-	1/ LEAF	ALT. LEAF INACTIVE STILE	6063-T6	-
11	-	AS REQD.	MID RAIL	6063-T6	OPTIONAL
12	E6510	AS REQD.	DOOR STOP BASE (MONUMENTAL)	6063-T6	-
12A	E6500	AS REQD.	DOOR STOP BASE (NARROW)	6063-T6	-
13	E6505	AS REQD.	DOOR STOP (MONUMENTAL)	6063-T6	-
13A	E6501	AS REQD.	DOOR STOP (NARROW)	6063-T6	-
14	E1152	AS REQD.	ASTRAGAL W'STRIP ADAPTER	6063-T6	-
15	E7926	8/ LEAF	GLASS STOP (9/16" LAM. GLASS)	6063-T6	-
16	E6586	4/ LEAF	GLASS STOP (11/16" LAM. GLASS)	6063-T6	-
16A	E6577	4/ LEAF	INT. GLASS STOP (11/16" LAM. GLASS)	6063-T6	-
16B	E6584	4/ LEAF	INT. GLASS STOP (11/16" LAM. GLASS)	6063-T6	-
17	E6422	4/ LEAF	GLASS STOP (1-1/16" INSUL. LAM. GLASS)	6063-T6	-
18	E6585	4/ LEAF	GLASS STOP (1-3/16" INSUL. LAM. GLASS)	6063-T6	-
18A	E6578	4/ LEAF	INT. GLASS STOP (1-3/16" INSUL. LAM. GLASS)	6063-T6	-
18B	E6579	4/ LEAF	INT. GLASS STOP (1-3/16" INSUL. LAM. GLASS)	6063-T6	-
19	#10 X 1/2"	AS REQD.	INT. GLASS STOP FASTENERS, AT 4" FROM ENDS & 14" O.C.	ST. STEEL	FH SELF DRILLING SCREWS
20	P912	4/ LEAF	EXTERIOR GLAZING GASKET (9/16" GLASS)	EPDM	-
20A	P1477	4/ LEAF	INTERIOR GLAZING GASKET (9/16" GLASS)	EPDM	-
21	P0017	4/ LEAF	EXTERIOR GLAZING GASKET (11/16" GLASS)	EPDM	-
21A	P6552	4/ LEAF	INTERIOR SPACER TAPE (9/16", 11/16" GLASS)	FOAM	-
22	P0017	4/ LEAF	EXTERIOR & INTERIOR GLAZING GASKET (1-1/16" GLASS)	EPDM	-
23	P1431	4/ LEAF	EXTERIOR GLAZING GASKET (1-3/16" GLASS)	EPDM	-
23A	P6552	4/ LEAF	INTERIOR SPACER TAPE (1-3/16" GLASS)	FOAM	-
24	3M VHB	4/ LEAF	INTERIOR GLAZING TAPE (.090" X .812") (9/16" GLASS)	FOAM	-
25	91929A	2/ LITE	SETTING BLOCK AT 6" FROM ENDS	EPDM	DUROMETER 80±5 SHORE A
25A	91929D	2/ LITE	SETTING BLOCK AT 6" FROM ENDS	EPDM	DUROMETER 80±5 SHORE A
26	P6296	AS REQD.	FRAME HEAD/JAMB BULB W'STRIPPING	VINYL	-
27	P3450	AS REQD.	FRAME SILL BULB W'STRIPPING	VINYL	-
28	P938	AS REQD.	ASTRAGAL PILE W'STRIPPING	WOOL	ULTRAFAB
29	#10 X 5/8"	AS REQD.	ASTRAGAL ADAPTER FASTENERS, AT 12" O.C.	ST. STEEL	FH SELF DRILLING SCREWS
30	#10 X 1/2"	AS REQD.	GLASS STOP FASTENERS, AT 2" FROM ENDS & 12" O.C.	ST. STEEL	FH SELF DRILLING SCREWS
31	#12 X 1-1/2"	AS REQD.	FRAME ASSEMBLY FASTENERS	ST. STEEL	HH SELF DRILLING SCREWS

Sealed: 6/25/2024

FL #29696

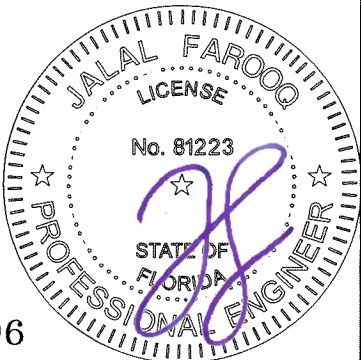

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\24-37F-TLI

MONUMENTAL ALUMINUM OUTSWING DOOR (L.M.I.)

TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

revisions:

no	date	by	description

date: 06-14-24


scale: 3/8" = 1"

dr. by: TARIQ

chk. by:

drawing no.
24-37F

sheet 12 of 15

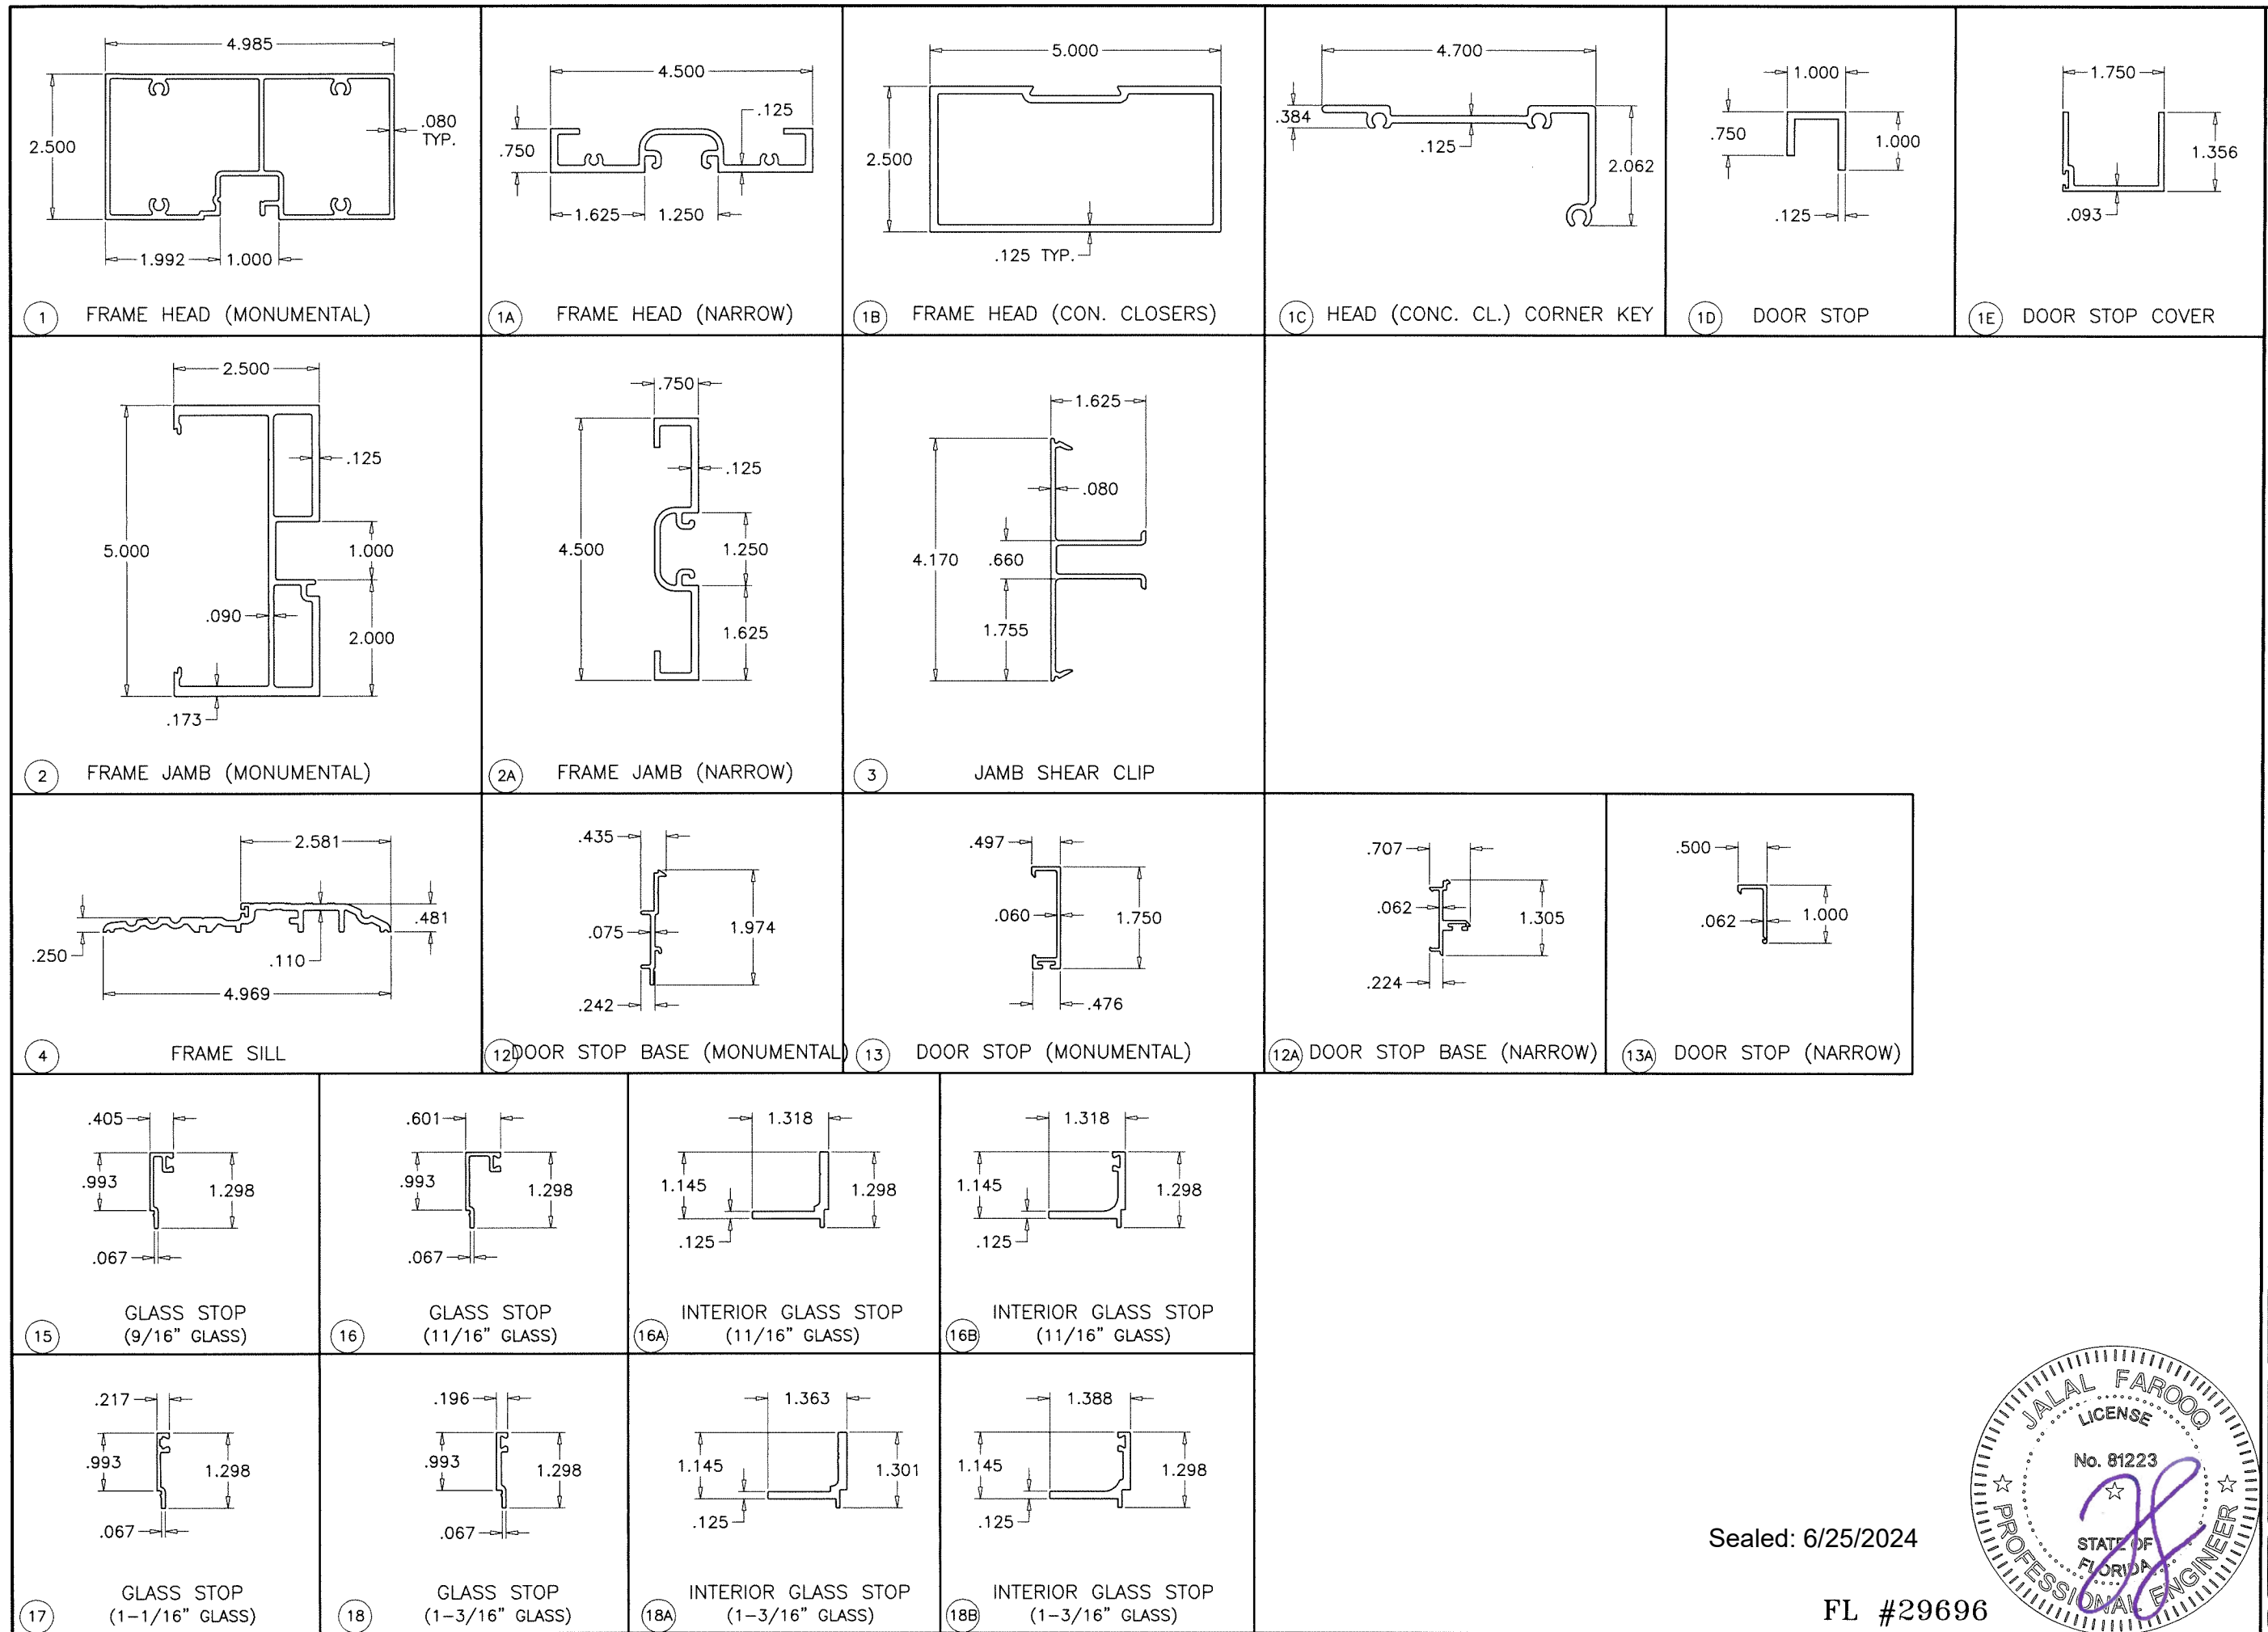

Sealed: 6/25/2024

FL #29696



AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\24-37F-TLI

MONUMENTAL ALUMINUM OUTSWING DOOR (L.M.I.)

TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

revisions:	
no	date by description

date: 06-14-24

scale: 3/8" = 1"










dr. by: TARIQ

chk. by:

drawing no.


24-37F

sheet 13 of 15

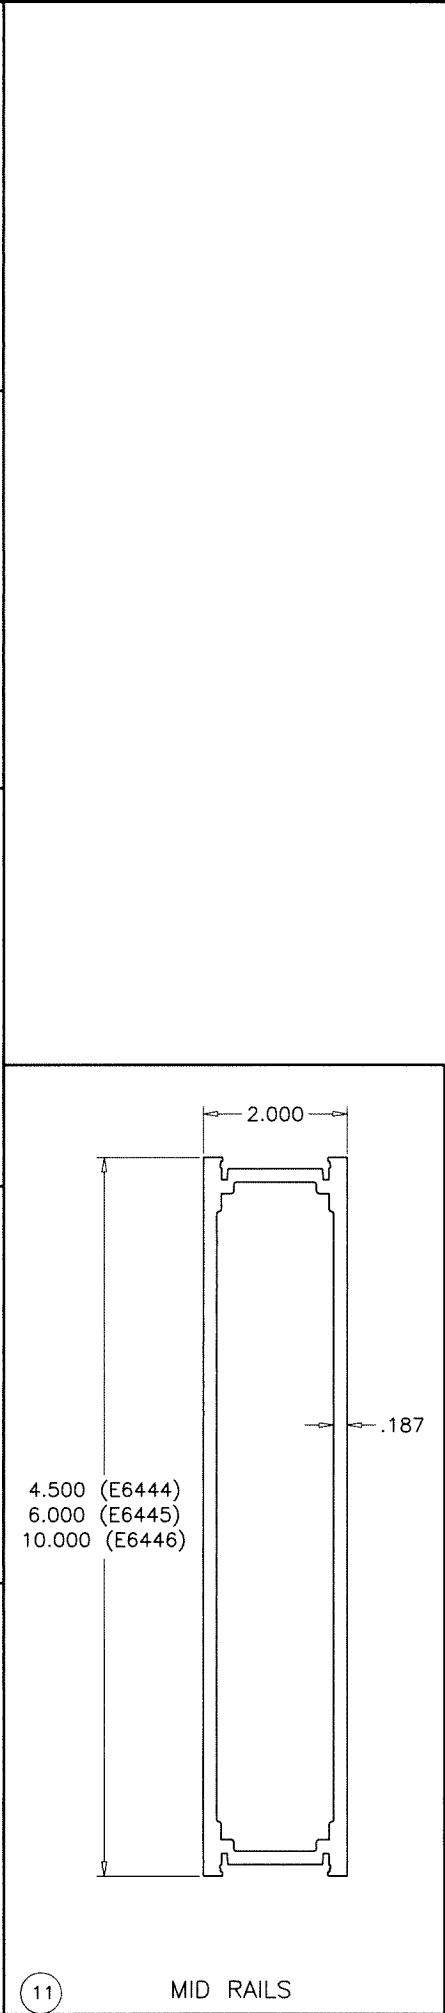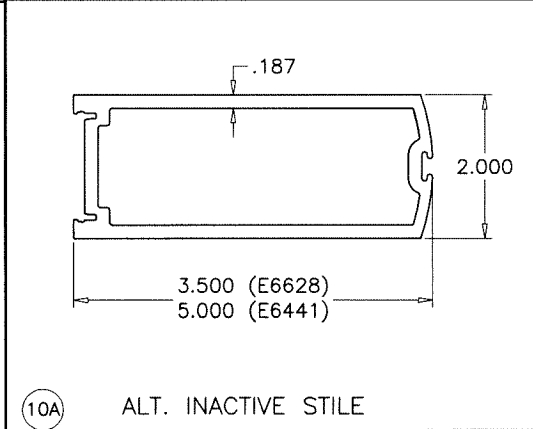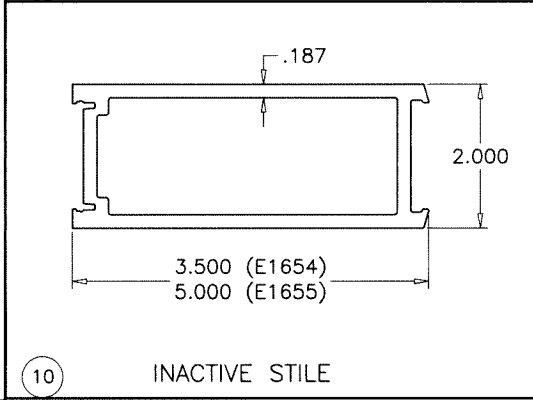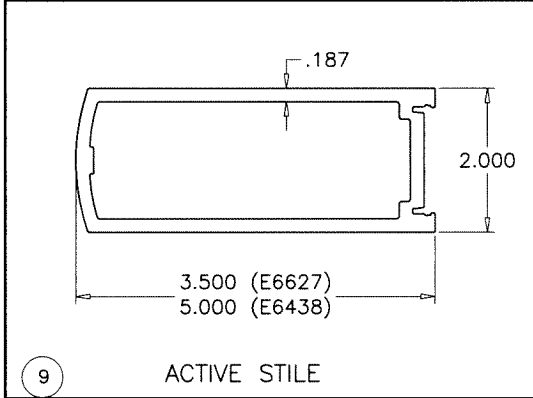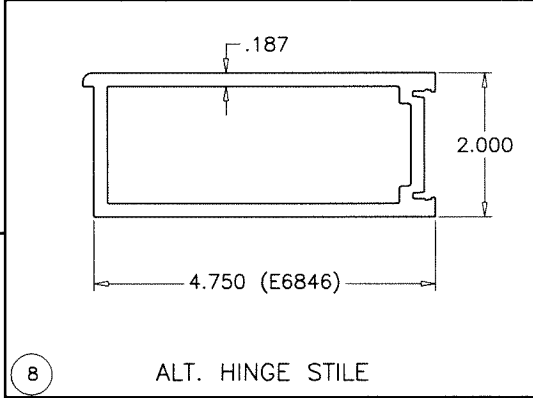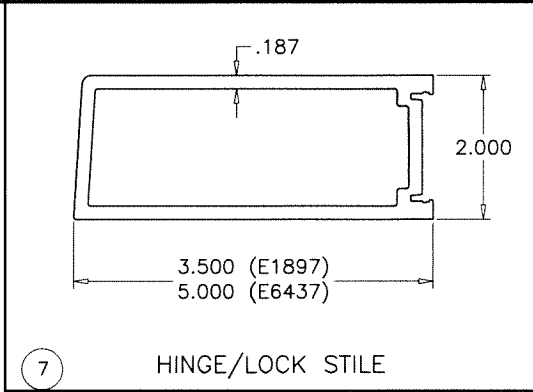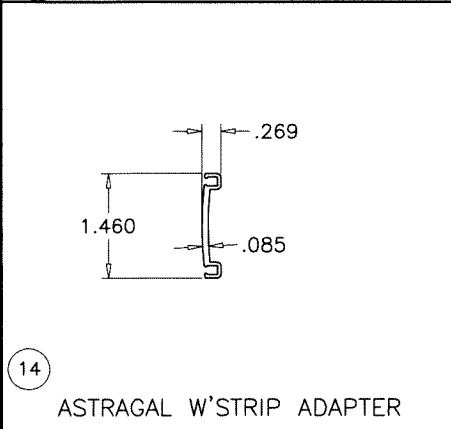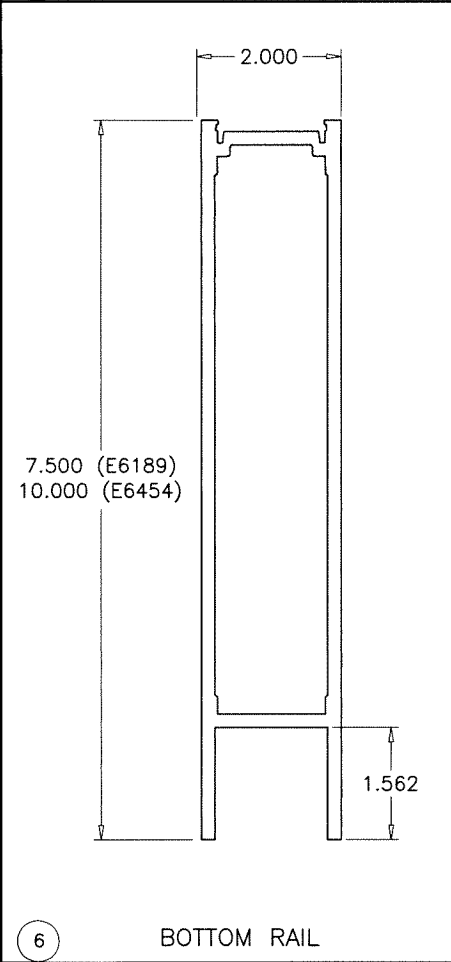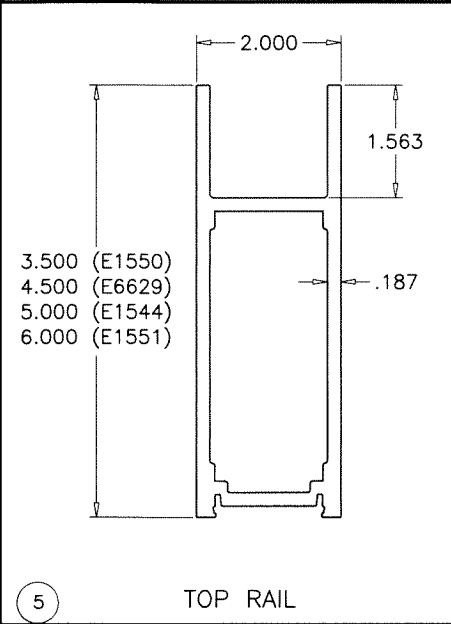

Sealed: 6/25/2024

FL #29696

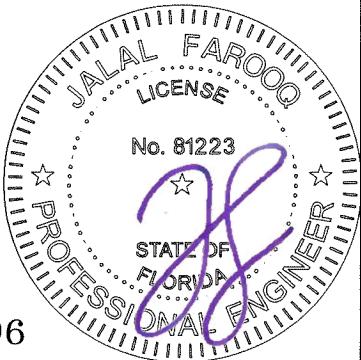

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978






MONUMENTAL ALUMINUM OUTSWING DOOR (L.M.I.)

TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

revisions:	
no	date


date:	06-14-24
scale:	3/8" = 1"
dr. by:	TARIQ
chk. by:	

drawing no.	24-37F
sheet 14 of 15	



Sealed: 6/25/2024

FL #29696

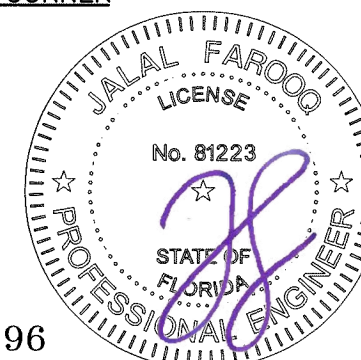

a f c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANI \ 24- 37E-TII

MONUMENTAL ALUMINUM OUTSWING DOOR (L.M.I.)

TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G

Tel. 800-866-2227 Fax.

date: 06-14-24	revisions:	
scale: 1/4" = 1"	no	date by description
dr. by: TARIQ		
chk. by:		

drawing no.

24-37F

sheet 15 of 15