

TUBELITE INC.
STANDARD ENTRANCE SERIES
ALUMINUM OUT-SWING DOOR

THESE DOORS ARE RATED FOR LARGE MISSILE IMPACT.
INSTALLATION OF THIS SYSTEM OUTSIDE THE HVHZ AREA SHALL MEET
THE APPLICABLE REQUIREMENTS FOR WIND BORNE DEBRIS PROTECTION.

STANDARD
ALUMINUM OUT-SWING ENTRANCE DOOR

SEE SHEET 2 FOR DESIGN LOAD CAPACITY OF SINGLE AND
DOUBLE DOORS.

DOORS NOT APPROVED FOR INSTALLATIONS WHERE WATER
INFILTRATION RESISTANCE IS REQUIRED.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE
REQUIREMENTS OF THE 2023 (8TH EDITION) FLORIDA BUILDING CODE FOR
NON HIGH VELOCITY HURRICANE ZONE.

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE
DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT
LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS
AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE
MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.
ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT
COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE
REQUIREMENTS OF THE 2023 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION
FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY
OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR
WATER INFILTRATION RESISTANCE ETC.
CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY,
AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.
MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION
IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE.
LABELING TO COMPLY WITH SECTION 1709.9.2.

NOTE:
GLASS CAPACITIES ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND
INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION
PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED
ON THIS DOCUMENT.
B- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF
ALTERED BY ANY MEANS.
C- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED
ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.)
FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER
USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED
ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE
SPECIFIC DRAWINGS FOR REVIEW.
D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF
THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.



Sealed: 6/25/2024

FL #29696

STANDARD ALUMINUM OUTSWING DOOR (L.M.I.)

TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\24-36F-TLI

revisions:
no date by description

date: 06-13-24

scale: -



dr. by: TARIQ

chk. by:

drawing no.

24-36F

sheet 1 of 15

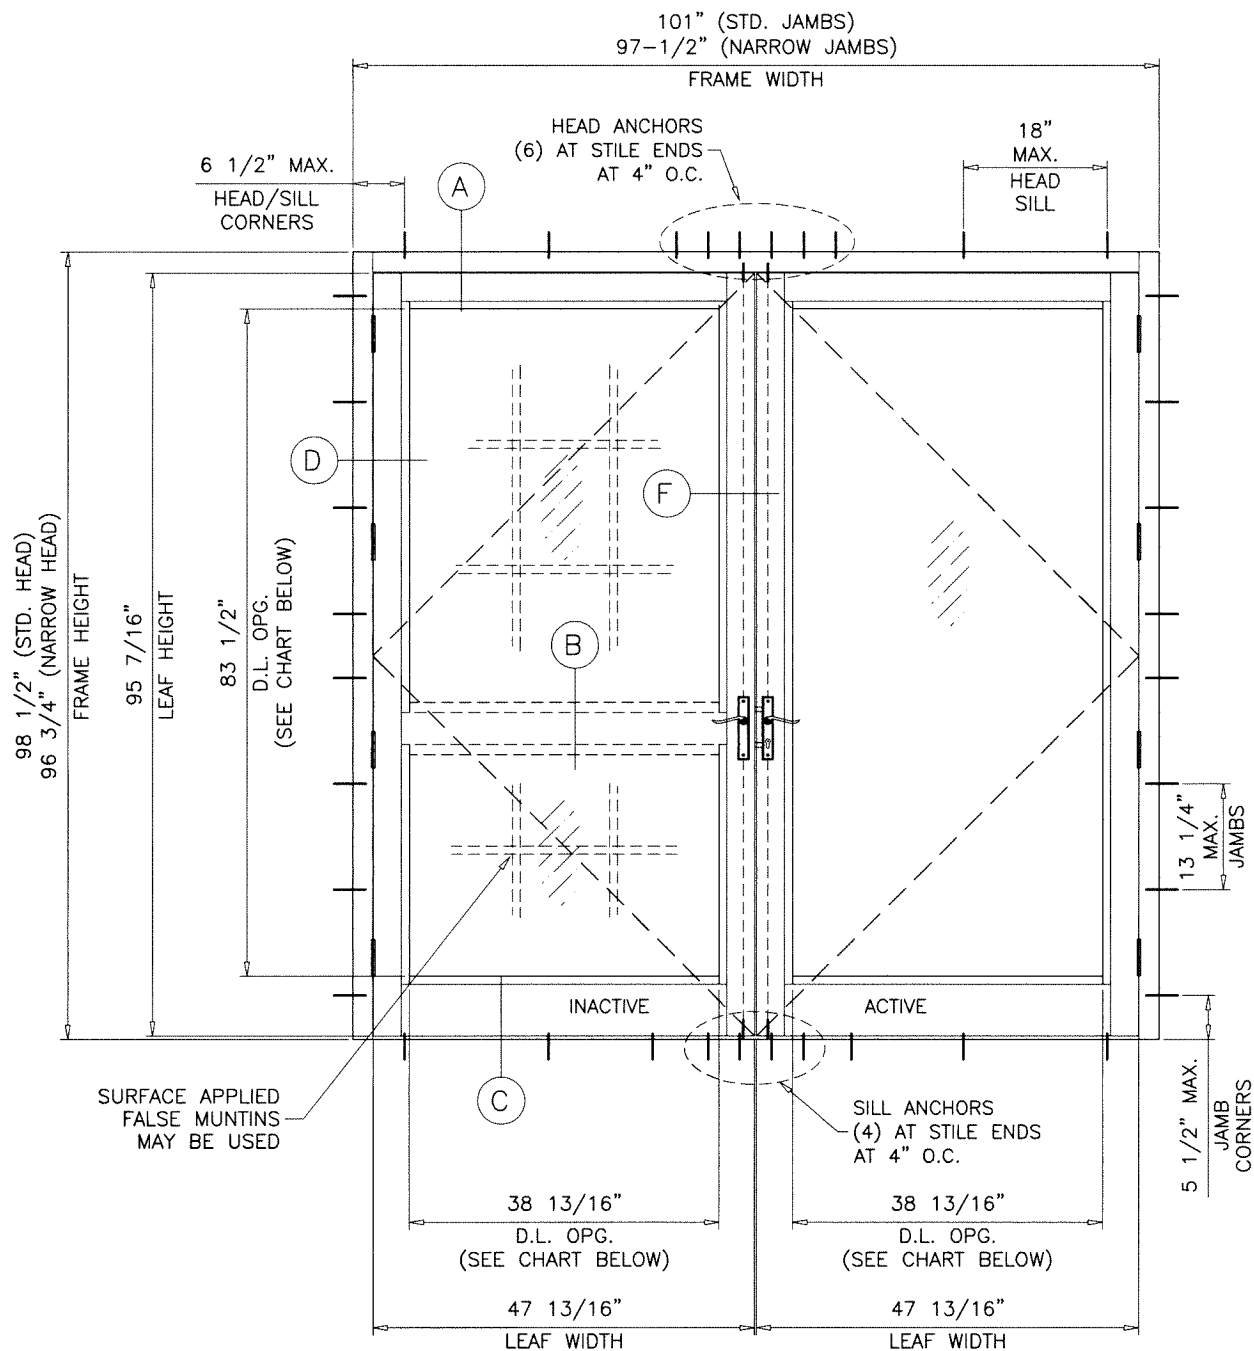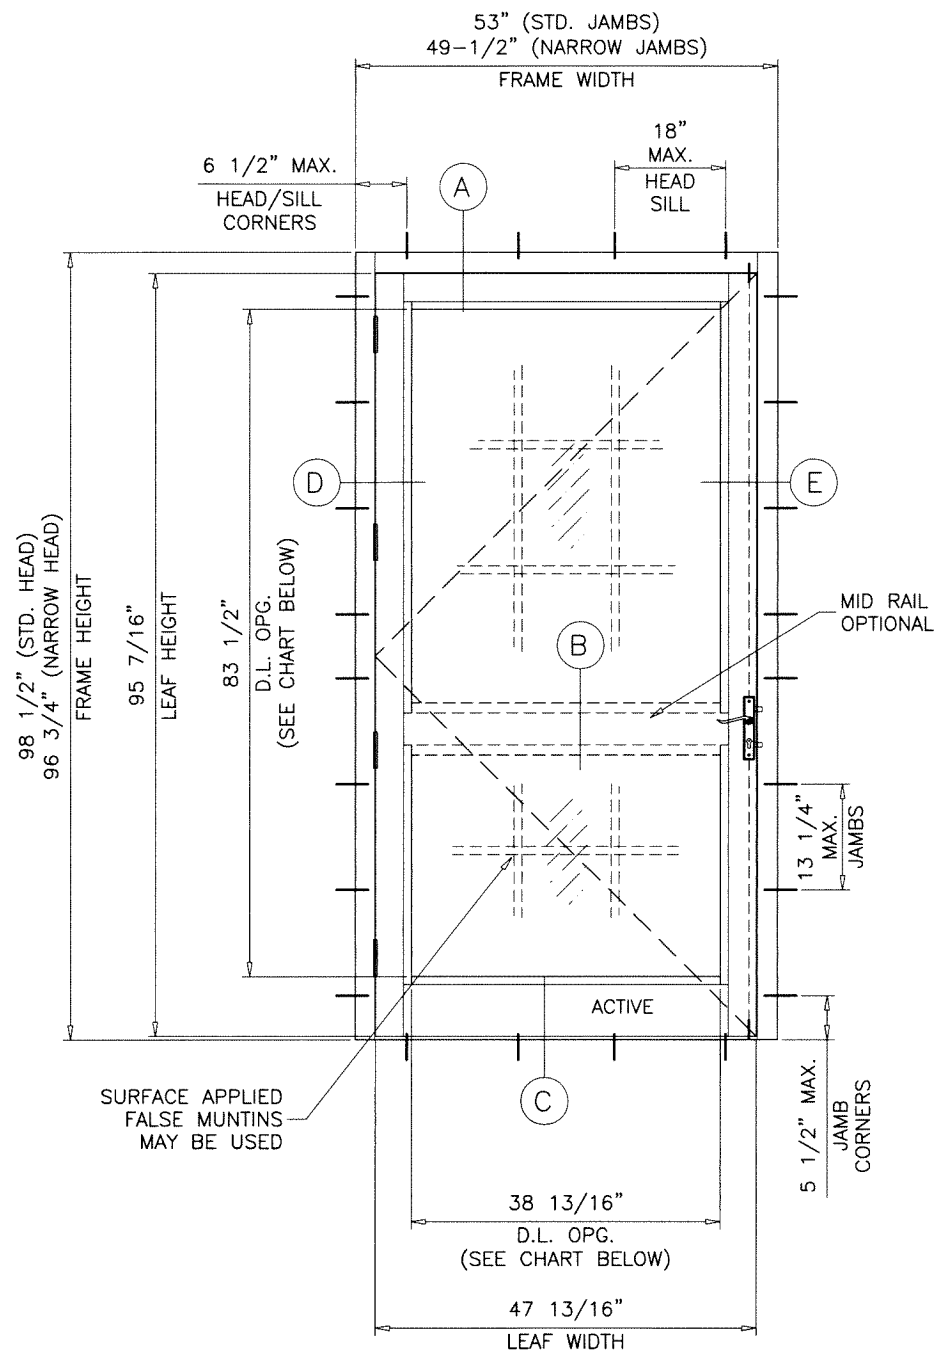

TYPICAL ELEVATIONS

SINGLE DOORS LOAD CAPACITY - PSF							
DOOR OPNG. DIMS.		LEAF DIMS. MAX.		D.L. OPG. MAX.		EXT.(+)	INT.(-)
WIDTH	HEIGHT	WIDTH	HEIGHT	WIDTH	HEIGHT		
48"	96"	47-13/16"	95-7/16"	38-13/16"	83-1/2"	70.0	70.0
37-1/2"	108" *	37-5/16"	107-7/16"	28-5/16"	95-1/2"	66.0	66.0


* LIMIT THESE SIZES TO DOORS GLAZED WITH DOWSIL 995 ONLY.

DOUBLE DOORS LOAD CAPACITY - PSF							
DOOR OPNG. DIMS.		LEAF DIMS. MAX.		D.L. OPG. MAX.		EXT.(+)	INT.(-)
WIDTH	HEIGHT	WIDTH	HEIGHT	WIDTH	HEIGHT		
96"	96"	47-13/16"	95-7/16"	38-13/16"	83-1/2"	70.0	70.0
75"	108" *	37-5/16"	107-7/16"	28-5/16"	95-1/2"	66.0	66.0

NOTE:
GLASS CAPACITIES ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

Sealed: 6/25/2024

FL #29696

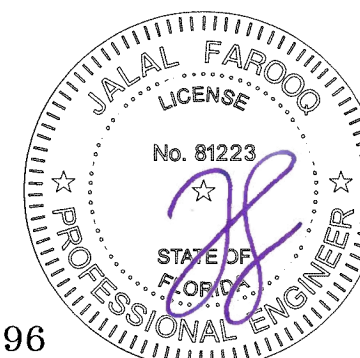

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\24-36F-TL

TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

STANDARD ALUMINUM OUTSWING DOOR (L.M.I.)

revisions:	no	date	by	description

date: 06-13-24


scale: 1/2"=1'-0"

dr. by: TARIQ


chk. by:

drawing no.
24-36F

sheet 2 of 15

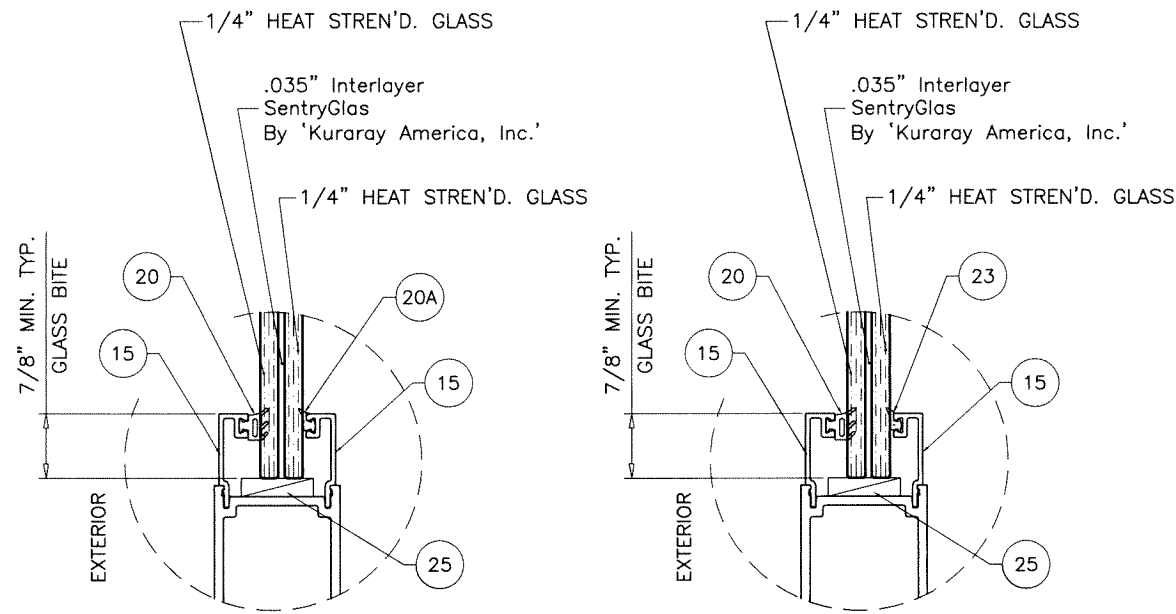

GLASS TYPE 'C'
9/16" OVERALL LAM. GLASS

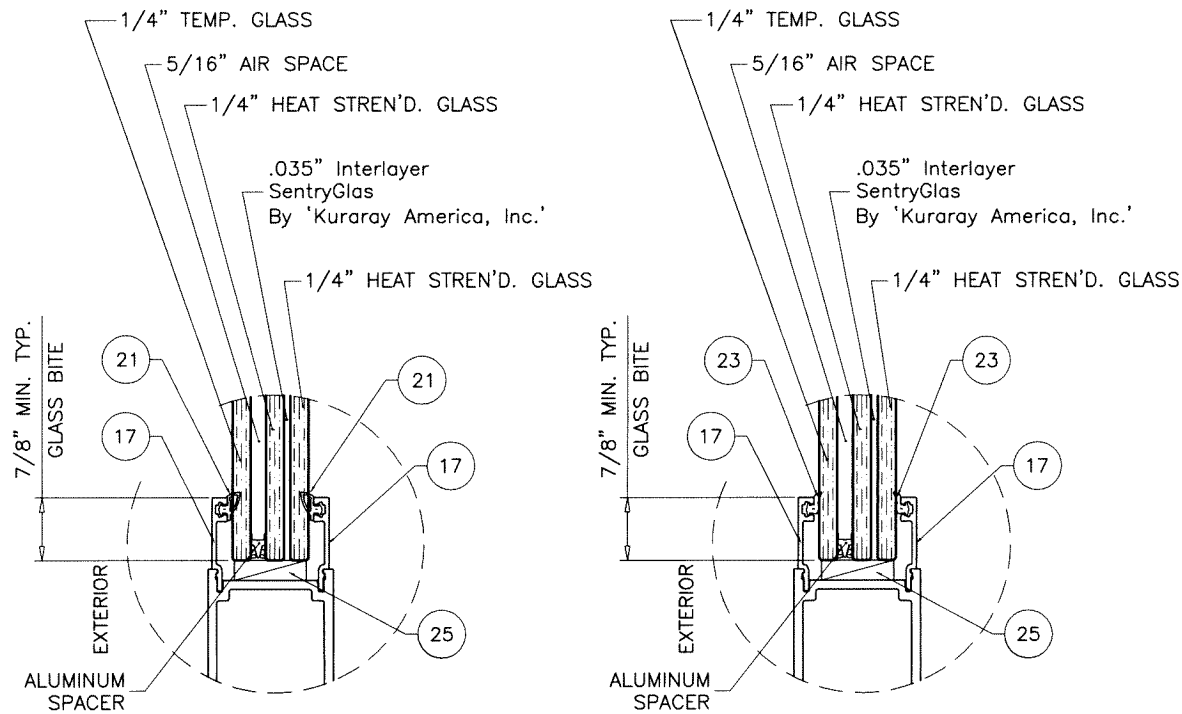


GLASS TYPE 'Ci'
1-1/16" OVERALL INSUL. LAM. GLASS

GLAZING DETAILS
LEVEL 'C' IMPACT

Sealed: 6/25/2024

FL #29696

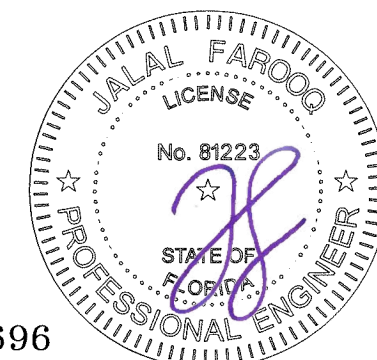

STANDARD ALUMINUM OUTSWING DOOR (L.M.I.)

TUBELITE INC.

3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

revisions:	
no	date by description

date: 06-13-24	scale: 3/8" = 1"	dr. by: TARIQ	chk. by:
----------------	------------------	---------------	----------


drawing no.

24-36F


sheet 3 of 15

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978


COMP-ANL\24-36F-TLI

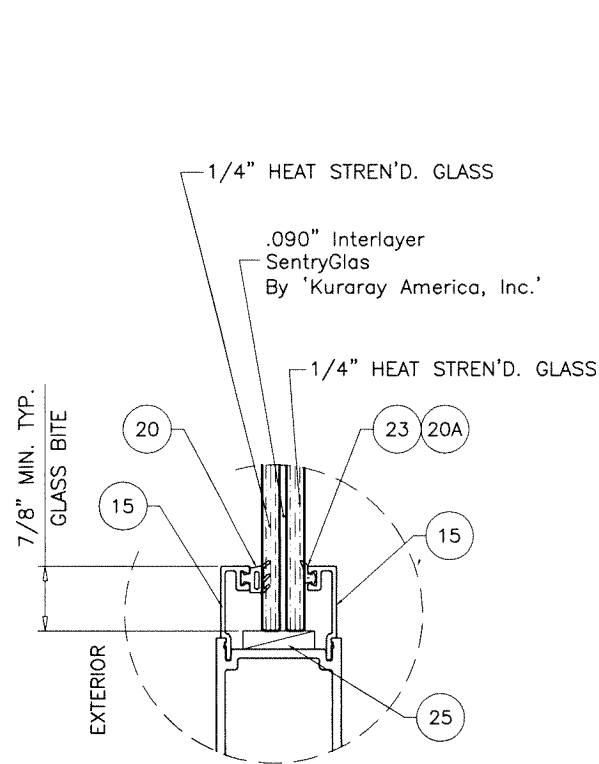


GLASS TYPE 'D'
9/16" OVERALL LAM. GLASS

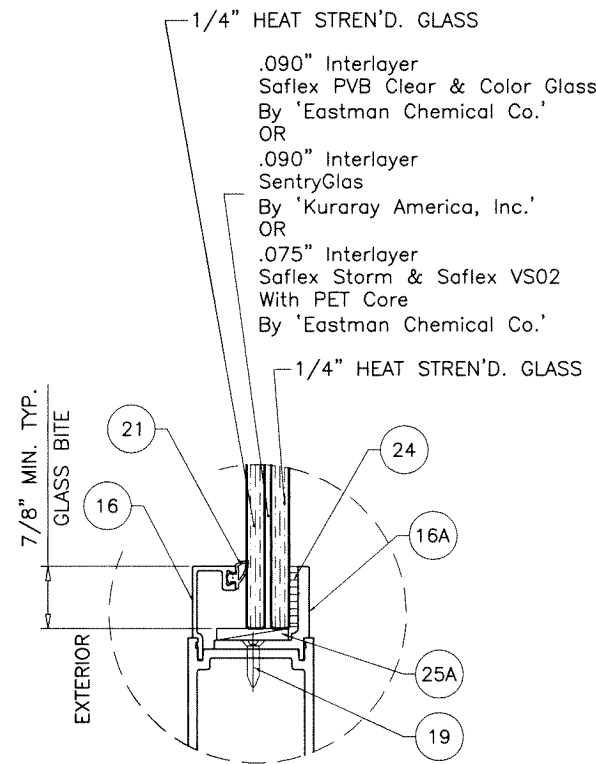


GLASS TYPE 'D1'
9/16" OVERALL LAM. GLASS

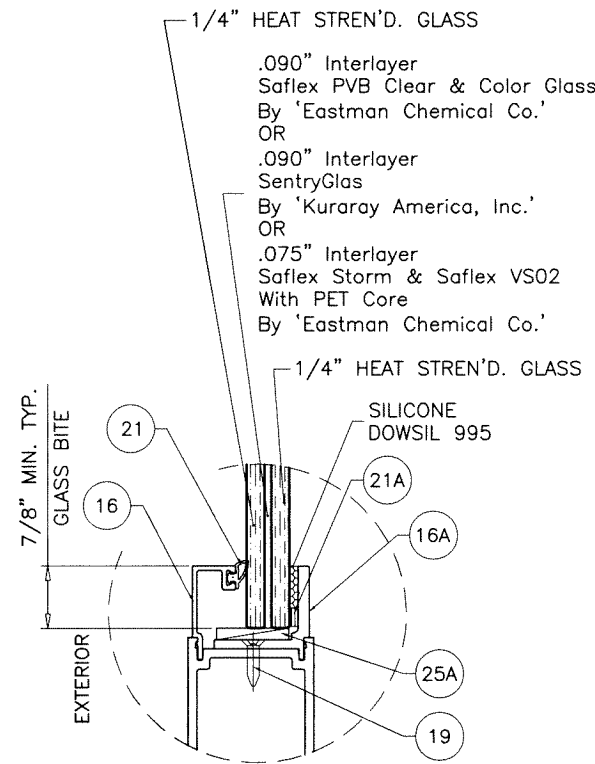


GLASS TYPE 'D2'
9/16" OVERALL LAM. GLASS

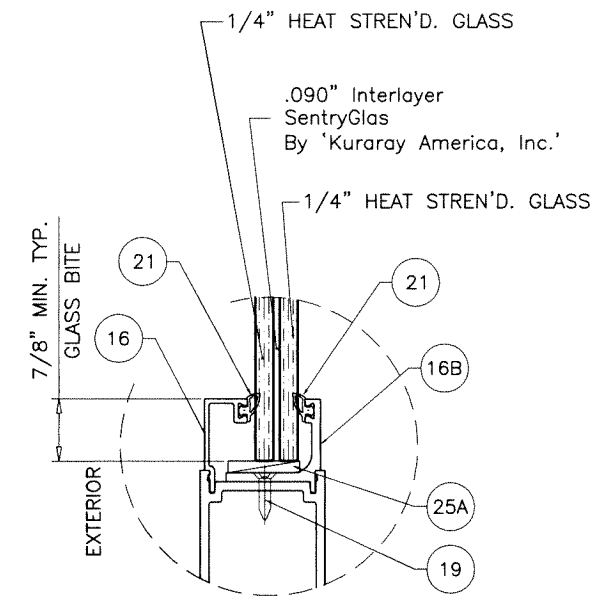


GLASS TYPE 'D3'
9/16" OVERALL LAM. GLASS

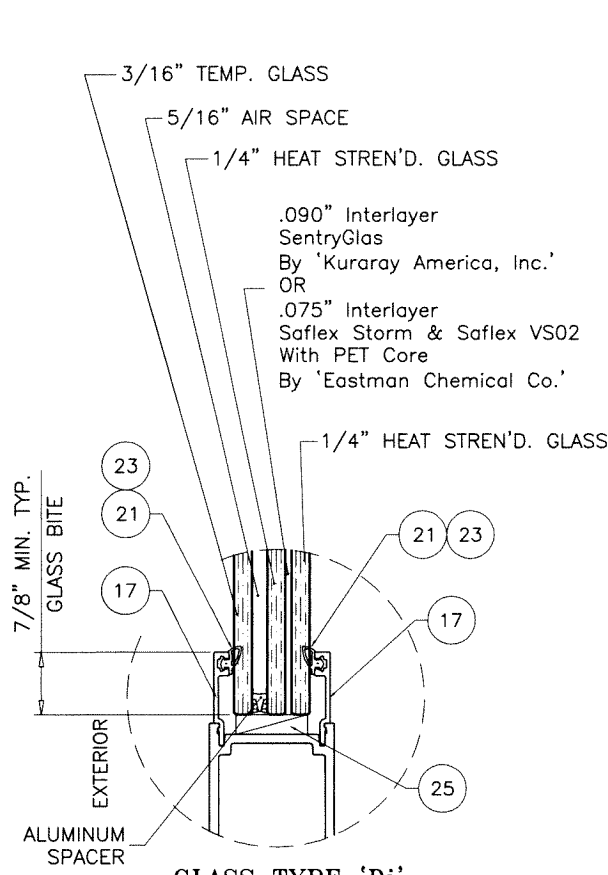


GLASS TYPE 'Di'
1-1/16" OVERALL INSUL. LAM. GLASS

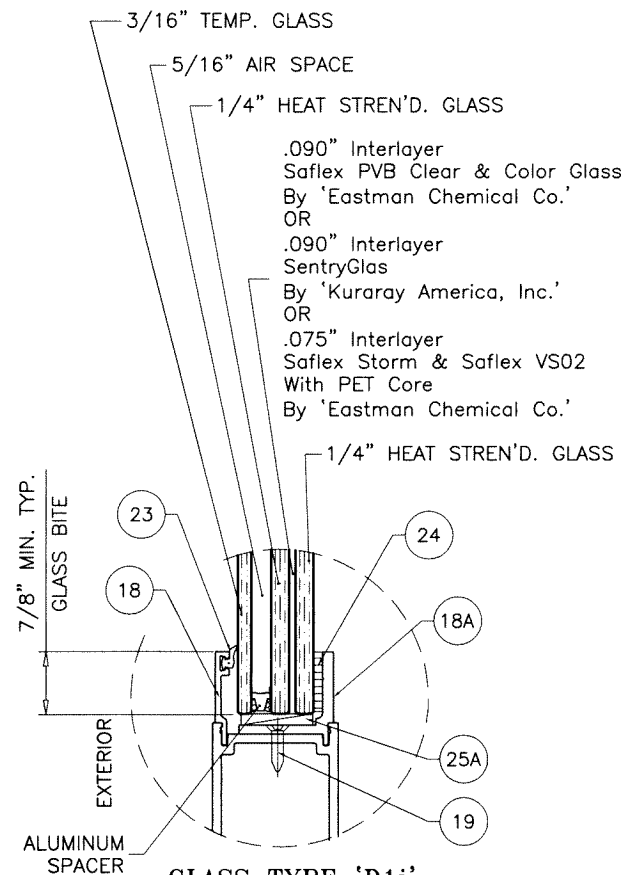

GLASS TYPE 'D1i'
1-1/16" OVERALL INSUL. LAM. GLASS

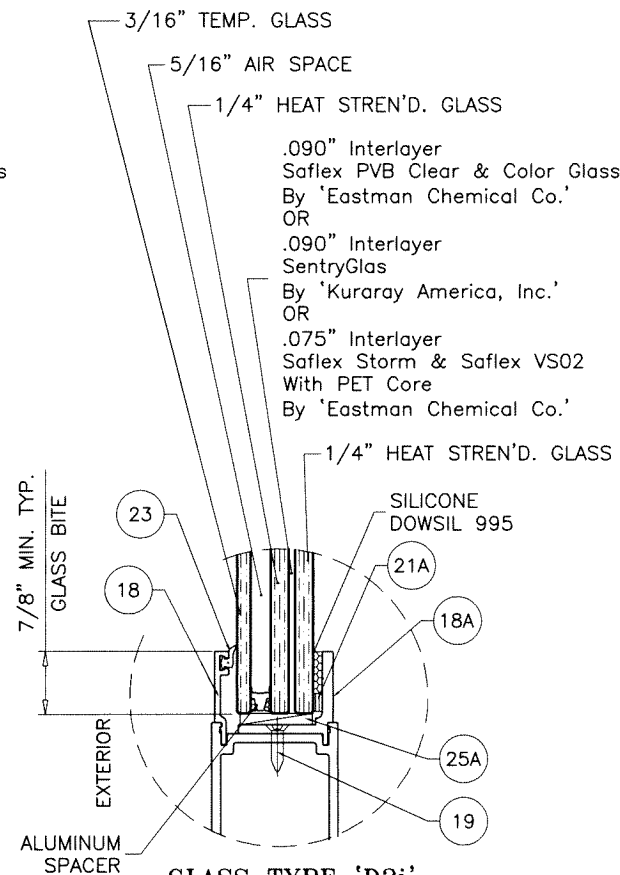

GLASS TYPE 'D2i'
1-1/16" OVERALL INSUL. LAM. GLASS

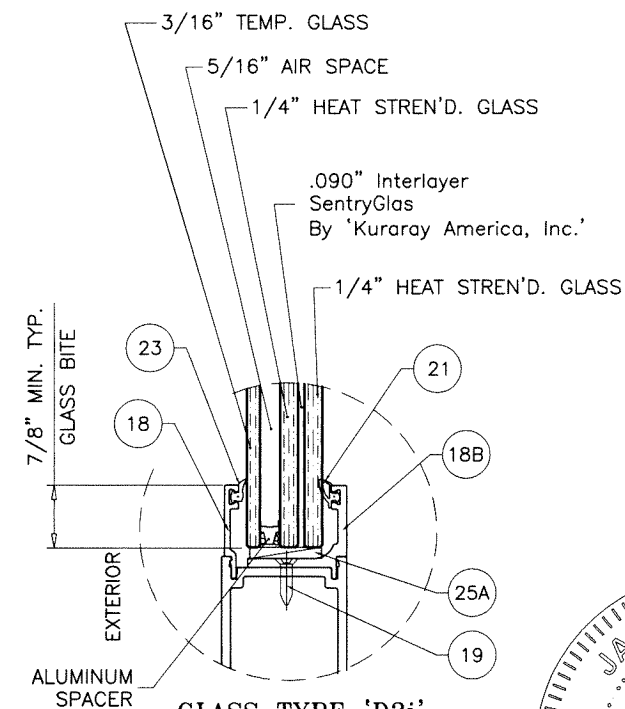


GLASS TYPE 'D3i'
1-1/16" OVERALL INSUL. LAM. GLASS

**GLAZING DETAILS
LEVEL 'D' IMPACT**

Sealed: 6/25/2024

FL #29696







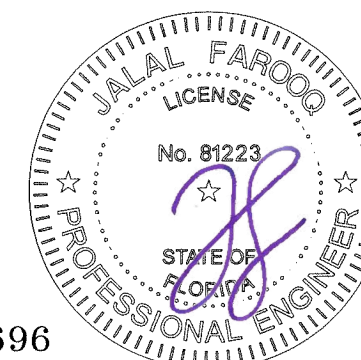


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
C.O.A.N. 3538

STANDARD ALUMINUM OUTSWING DOOR (L.M.I.)
TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

revisions:		no date by description	
date:	06-13-24	scale:	3/8" = 1"
dr. by:	TARIQ	chk. by:	
drawing no.	24-36F		
sheet	4 of 15		


COMP-ANL\24-36F-TLI

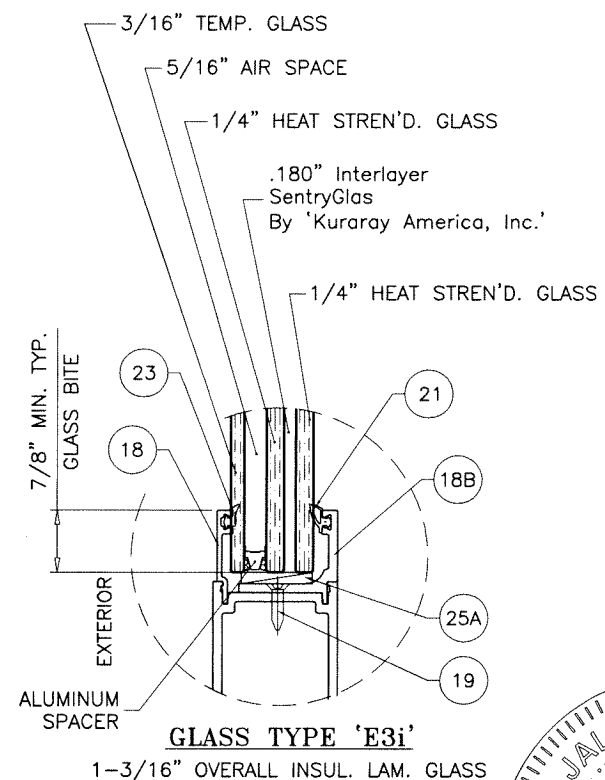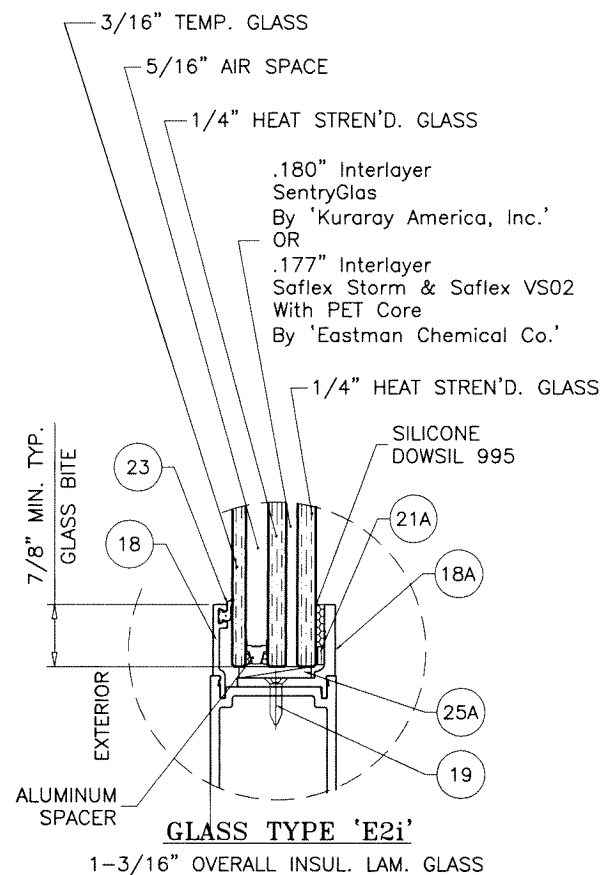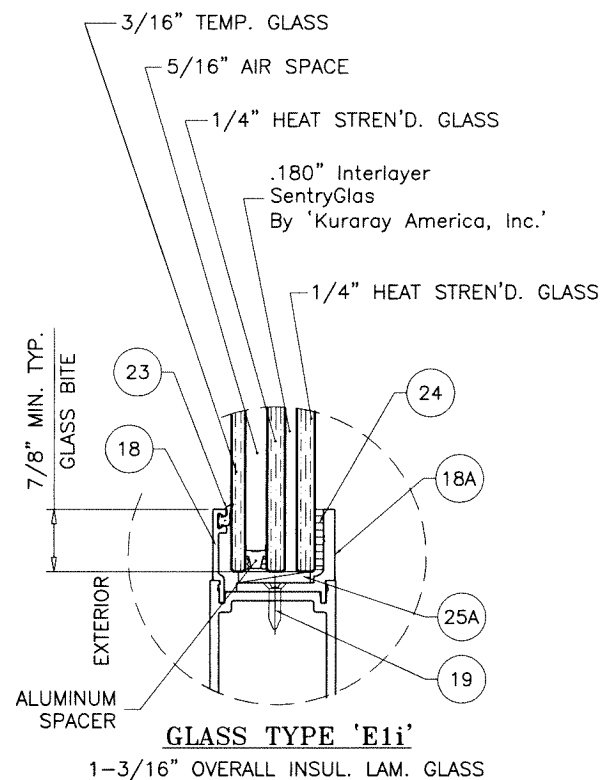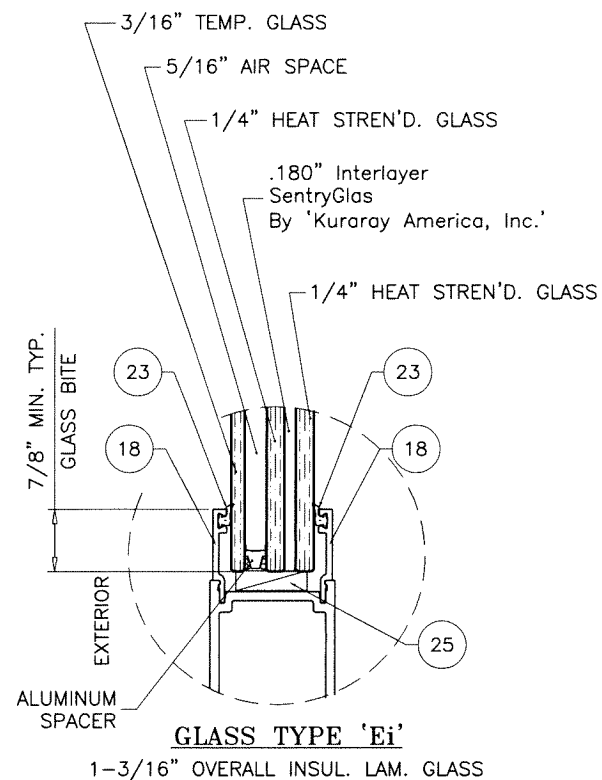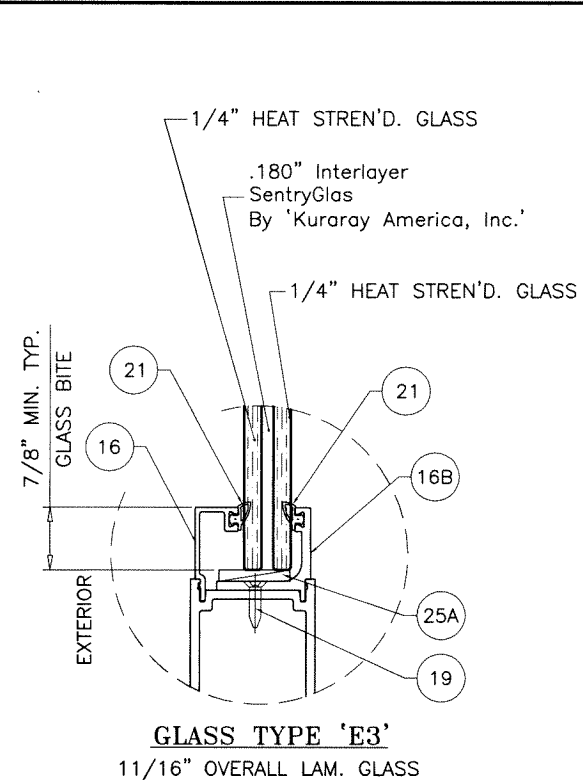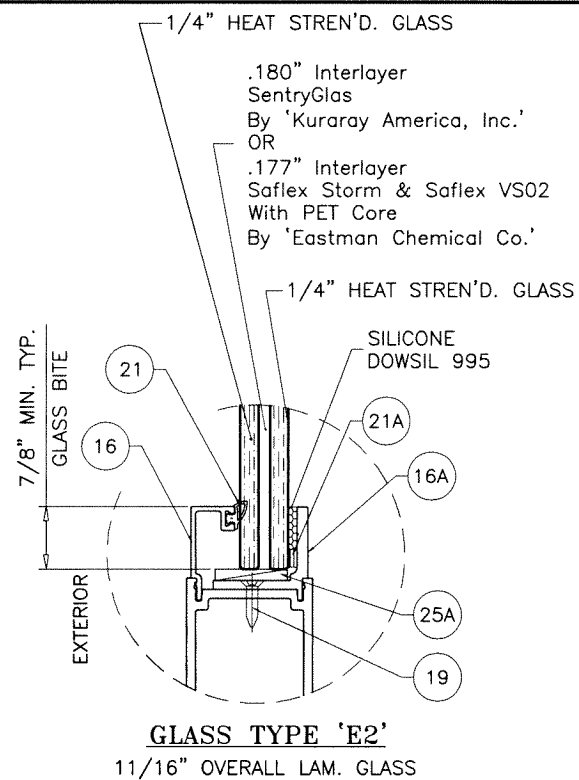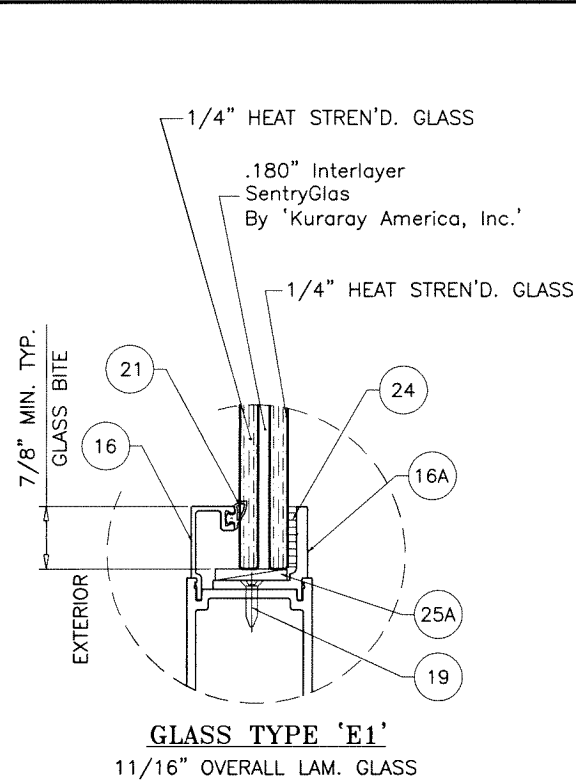

GLAZING DETAILS LEVEL 'E' IMPACT

Sealed: 6/25/2024

FL #29696

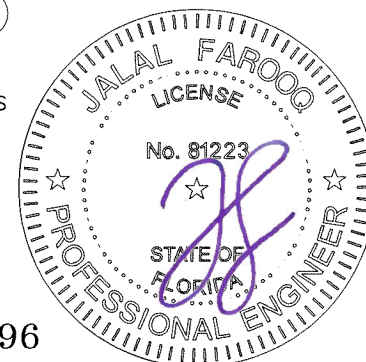

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL 24-36F-TLI





STANDARD ALUMINUM OUTSWING DOOR (L.M.I.)

TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

revisions:	no	date	by	description

date: 06-13-24
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
24-36F
sheet 4.1 of 15

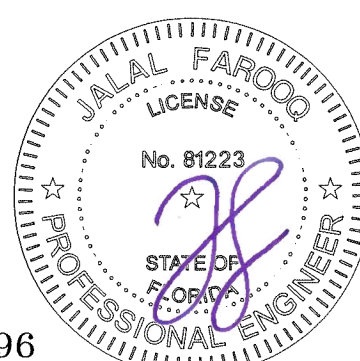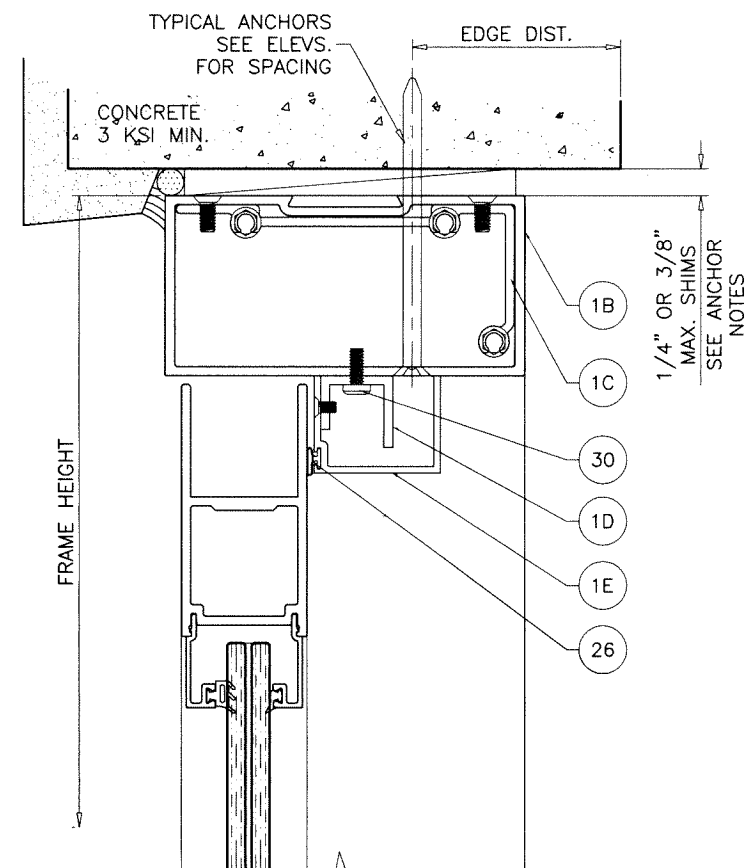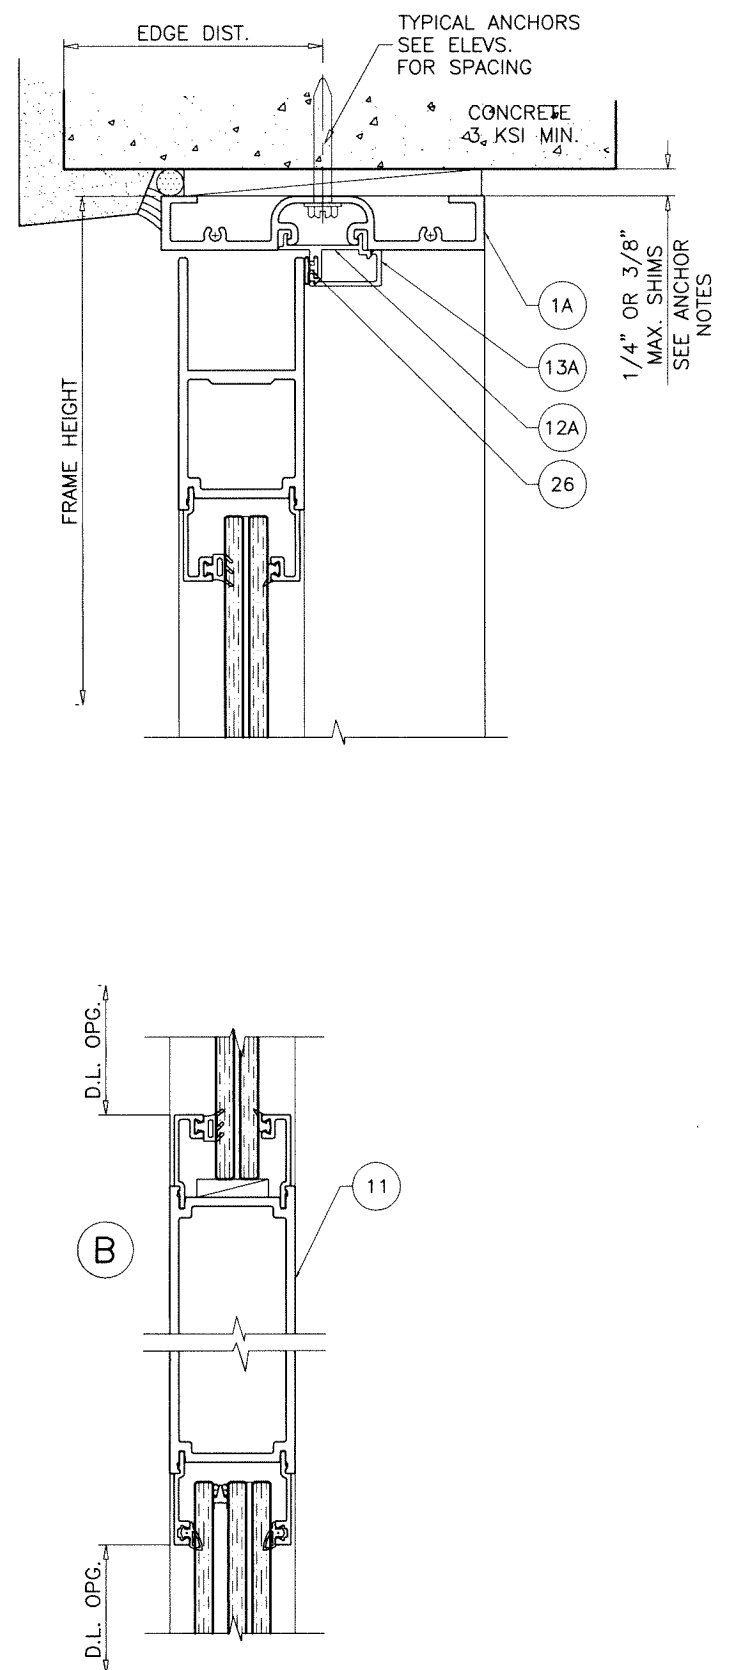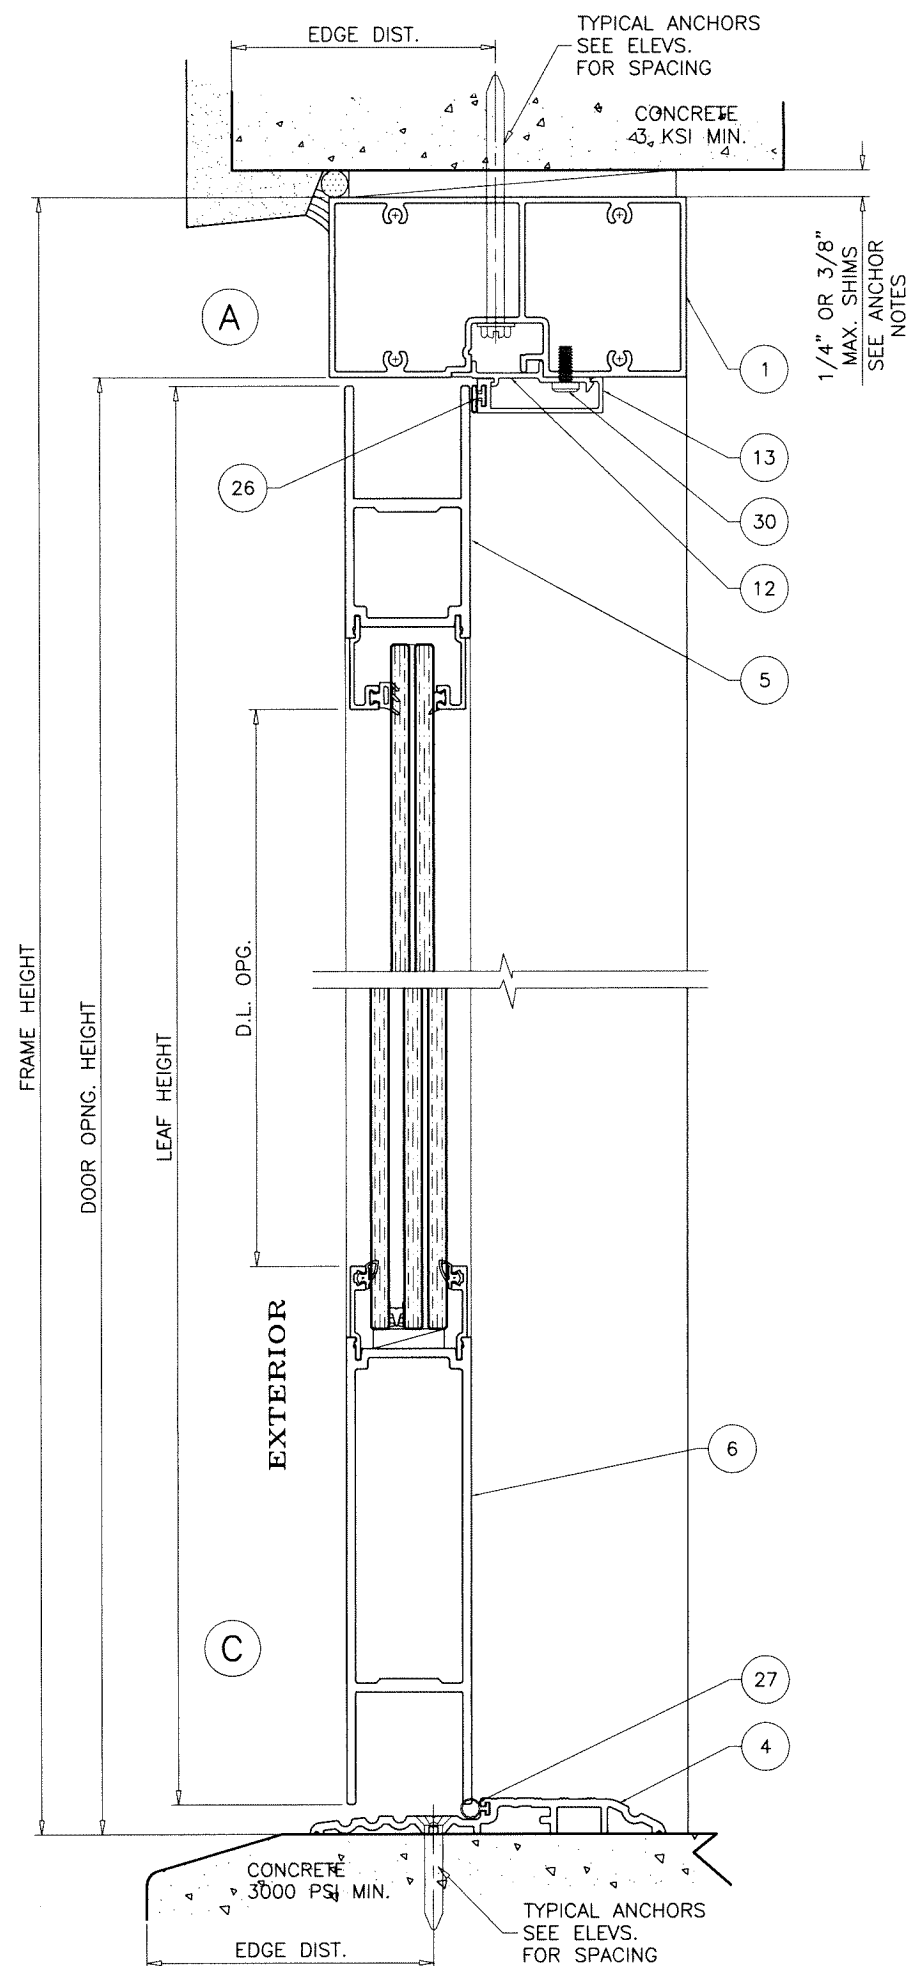

Sealed: 6/25/2024
FL #29696

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\24-36F-TLJ

STANDARD ALUMINUM OUTSWING DOOR (L.M.I.)





TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

date: 06-13-24
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

revisions:

no	date	by	description

drawing no.
24-36F
sheet 5 of 15

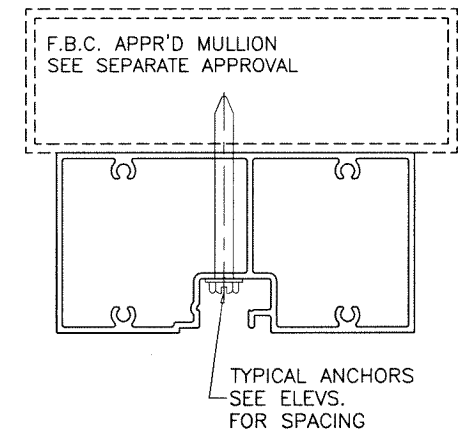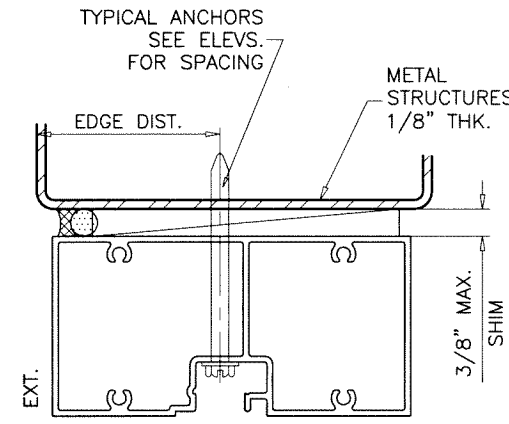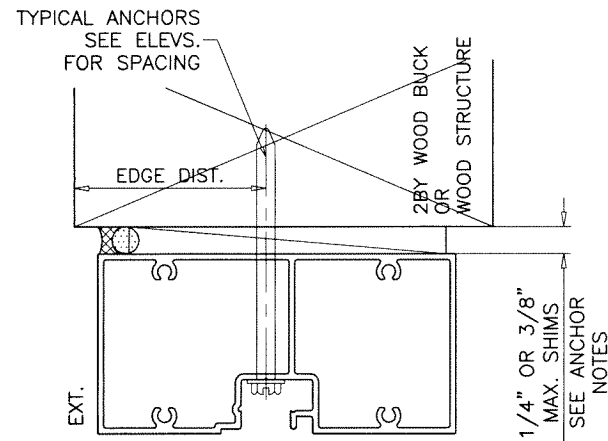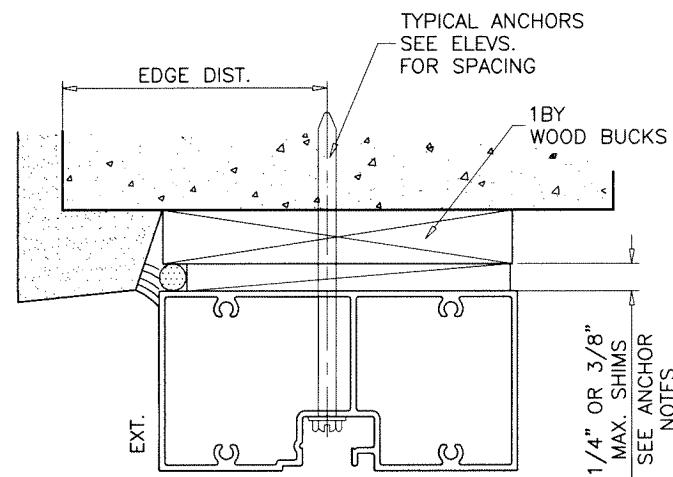

WOOD BUCKS AND METAL STRUCTURE NOT BY 'TUBELITE INC.'
MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM
AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4" DIA. TAPCON BY 'ITW' (Fu=125 KSI, Fy=100 KSI)
(1/4" MAX. SHIMS)

1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
(3/8" MAX. SHIMS)

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD (HEAD/JAMBS)

THRU 1BY BUCKS INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONCRETE (HEAD/JAMBS)
1-1/4" MIN. EMBED INTO MASONRY (JAMBS)

DIRECTLY INTO CONCRETE OR MASONRY
1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
1-1/4" MIN. EMBED INTO MASONRY (JAMBS)


1/4" DIA. TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)
(3/8" MAX. SHIMS)

INTO F.B.C. APPROVED MULLIONS
OR
INTO 18 GA. METAL STUDS (Fy = 33 KSI MIN.)
OR
INTO METAL STRUCTURES (HEAD/SILL/JAMBS)
ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 2-1/2" MIN.
INTO WOOD STRUCTURE = 1" MIN.
INTO METAL STRUCTURE = 1/2" MIN.

WOOD AT HEAD OR JAMBS SG = 0.55 MIN.
CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

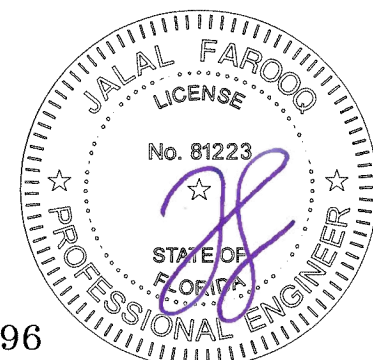

Sealed: 6/25/2024

FL #29696


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\24-36F-TLI

STANDARD ALUMINUM OUTSWING DOOR (L.M.I.)

TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

revisions:		no		date		by		description	

date: 06-13-24
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:
drawing no.
24-36F
sheet 6 of 15

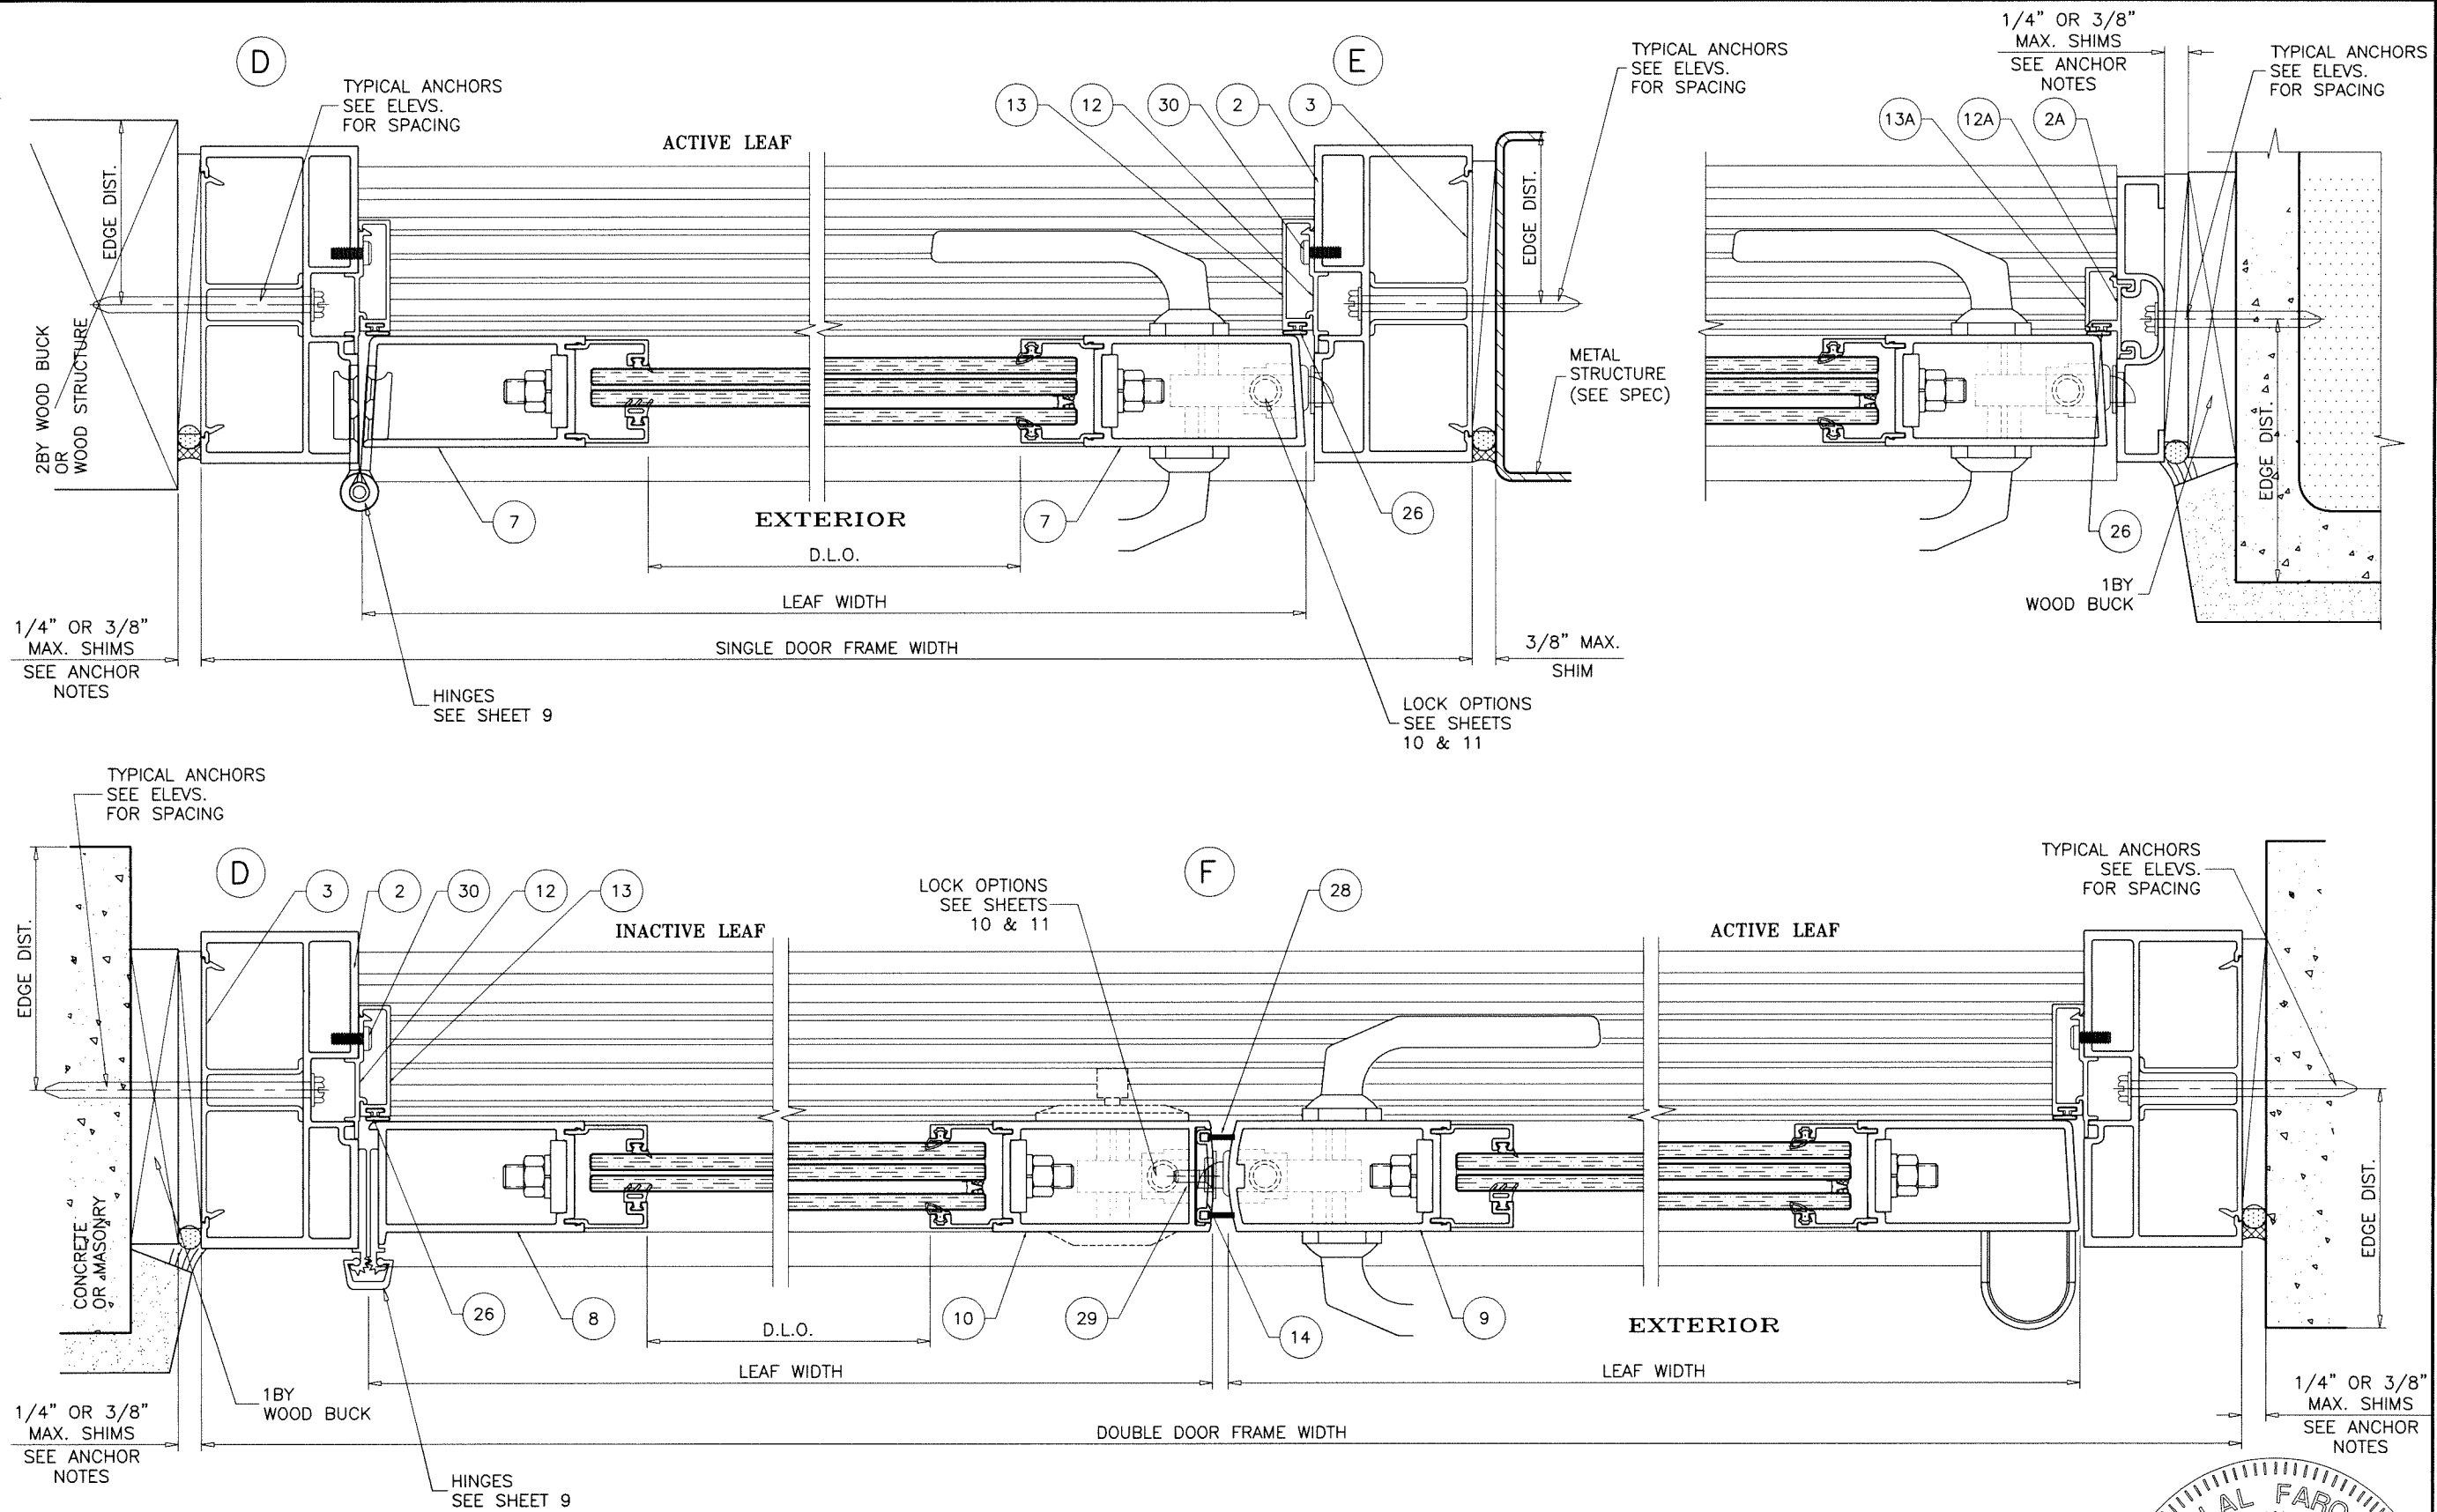

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\24-36F-TLI

TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

revisions:		no		date		by		description	

date: 06-13-24


scale: 3/8" = 1"

dr. by: TARIQ



chk. by:

drawing no.
24-36F




sheet 7 of 15

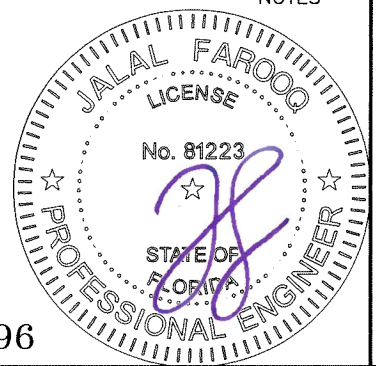

Sealed: 6/25/2024
FL #29696

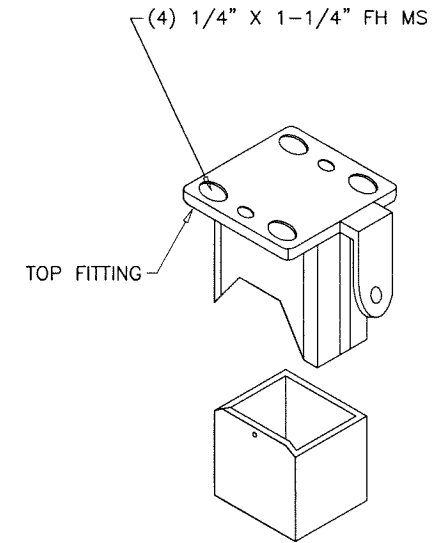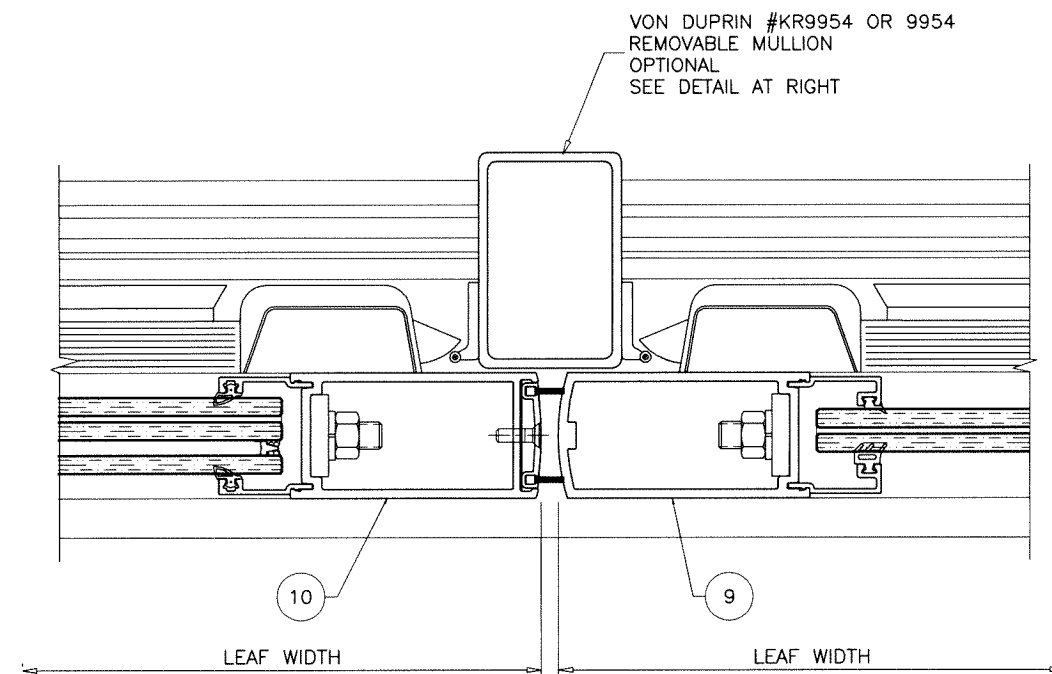

VON DUPRIN #KR9954
REMOVABLE MULLION
OPTIONAL
(USE ONLY WITH RIM EXIT DEVICE)

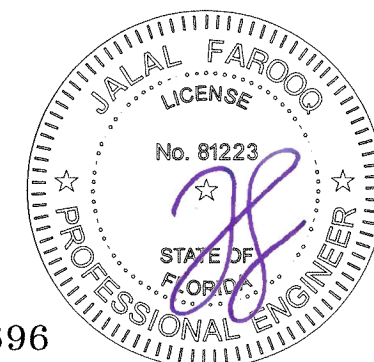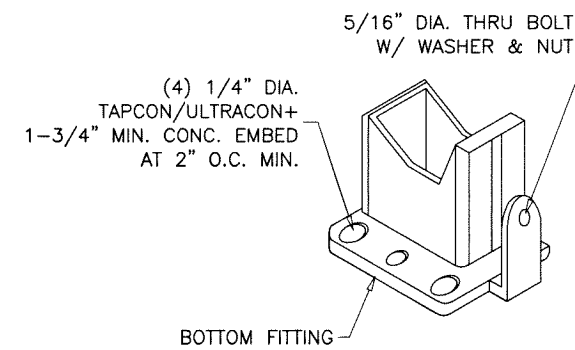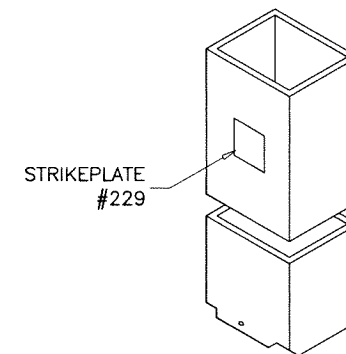

Sealed: 6/25/2024

FL #29696

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

a f c

(C.A.N. 3538)
COMP-ANL\24-36F-TLI

STANDARD ALUMINUM OUTSWING DOOR (L.M.I.)

TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

revisions:

no	date	by	description

date: 06-13-24

scale: 3/8" = 1"

dr. by: TARIQ

chk. by:

drawing no.
24-36F


sheet **8** of 15

HINGE OPTIONS:

OPTION #1:


4-1/2" LONG FLUSH MOUNT STEEL BUTT HINGES
'BB1191' BY 'HAGER' OR
'ABH-663' BY 'ABH MANUFACTURING INC.'
FASTENED WITH 12-20 X 1/2" FH MACHINE SCREWS
FOUR PER HASP(LEAF).
TOP AND BOTTOM HINGES AT 5-1/2" FROM ENDS
INTERMEDIATE HINGES AT 32" O.C. MAX.

1" X 7-3/8" X 1/4" THK. ALUM BACK PLATE
AT FRAME AND LEAF
FASTENED WITH (4) #12-20 X 1/2" FH MACHINE SCREWS

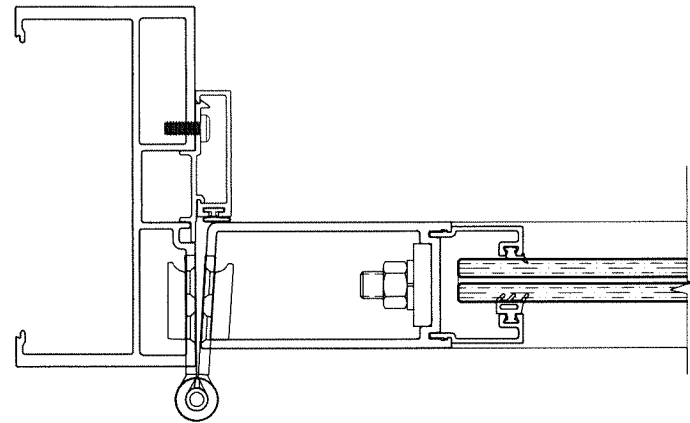

OPTION #2:

CONTINUOUS GEAR ALUMINUM ROTON HINGE
'SL 11HD' BY 'SELECT'
'780' BY 'HAGER'
'KCFM-95HD1' BY 'PEMKO'
'A110HD' BY 'ABH'
FASTENED TO FRAME JAMB AND TO JAMB STILE WITH
#12-24 X 7/16" FH MS SCREWS
IN PAIRS AT 2", 4" AND 6" FROM TOP AND BOTTOM ENDS
AND IN SINGLE ROW AT 10" O.C. THEREAFTER.

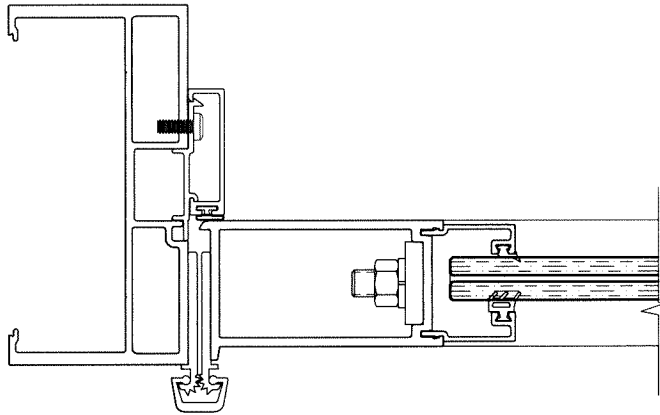

OPTION #3:

OFFSET PIVOT HINGES
'P795DT/IL/DB' BY 'TUBELITE'
'180/M19/147' BY 'RIXON'



TOP AND BOTTOM HINGES
FASTENED TO FRAME AND LEAF WITH
(4) 1/4-20 X 5/8" FH MACHINE SCREWS

TOP SHIM 'C' CHANNEL
(11/16" X 1-1/2" X 6-1/2" LONG X 1/8" FLANGE THK. X 1/4" WEB THK.)
FASTENED WITH (2) 1/4-20 X 1-1/2" FH MACHINE SCREWS

BOTTOM SHIM 'C' CHANNEL
(1-1/4" X 1-1/2" X 9-1/2" LONG X 1/8" FLANGE THK. X 1/4" WEB THK.)
FASTENED WITH (2) 1/4-20 X 1-1/2" FH MACHINE SCREWS

INTERMEDIATE HINGES AT 35" O.C.
FASTENED TO FRAME AND LEAF WITH
(5) 1/4-20 X 5/8" FH MACHINE SCREWS

1" X 7-3/8" X 1/4" THK. ALUM BACK PLATE
AT FRAME AND LEAF
FASTENED WITH (4) #12-20 X 1/2" FH MACHINE SCREWS

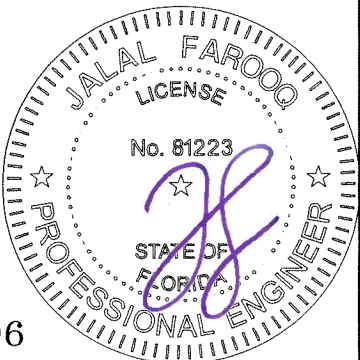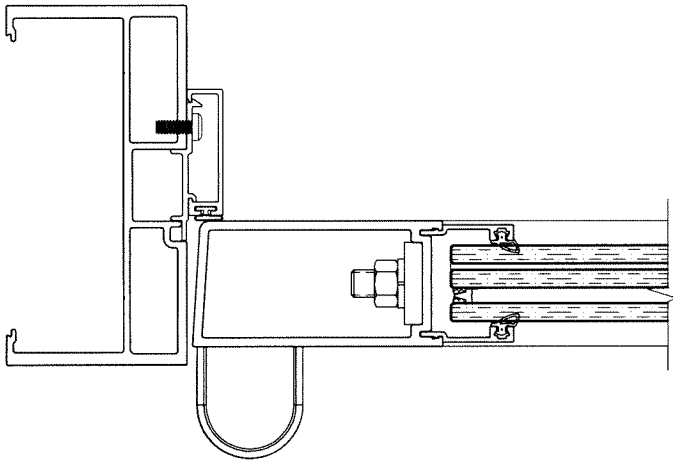

Sealed: 6/25/2024

FL #29696

af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

COMP-ANL\24-36F-TLI

STANDARD ALUMINUM OUTSWING DOOR (L.M.I.)

TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

revisions:	
no	date by description

date: 06-13-24

scale: -

dr. by: TARIQ

chk. by:

drawing no.

24-36F

sheet 9 of 15

LOCK OPTIONS:

3 POINT LOCK

MAX. LEAF HEIGHT = 96 IN.
MAX. LEAF WIDTH = 48 IN.
MAX. DESIGN LOAD = 70 PSF



MAX. LEAF HEIGHT = 108 IN.
MAX. LEAF WIDTH = 37-1/2 IN.
MAX. DESIGN LOAD = 66 PSF

ACTIVE LEAF:

KEY OPERATED THREE POINT LOCK SYSTEM
'MS1853A/4015/4016' AND 'MS1850S/4015/4016' BY 'ADAMS RITE'
WITH CONCEALED FLUSH BOLTS AT TOP &
BOTTOM OF LOCK STILE AND A THUMB TURN ON THE
INTERIOR, LOCATED AT 40" FROM BOTTOM OF PANEL
FASTENED WITH
(2) #12-24 X 1/2" FH MACHINE SCREWS

INACTIVE LEAF:

MANUALLY OPERATED TWO POINT LOCK SYSTEM
'MS1881' AND 'MS2180' BY 'ADAMS RITE'
WITH CONCEALED FLUSH BOLTS AT TOP &
BOTTOM OF LOCK STILE AND A THUMB TURN ON THE
INTERIOR, LOCATED AT 40" FROM BOTTOM OF PANEL
FASTENED WITH
(2) #8-32 X 1/4" PH MACHINE SCREWS

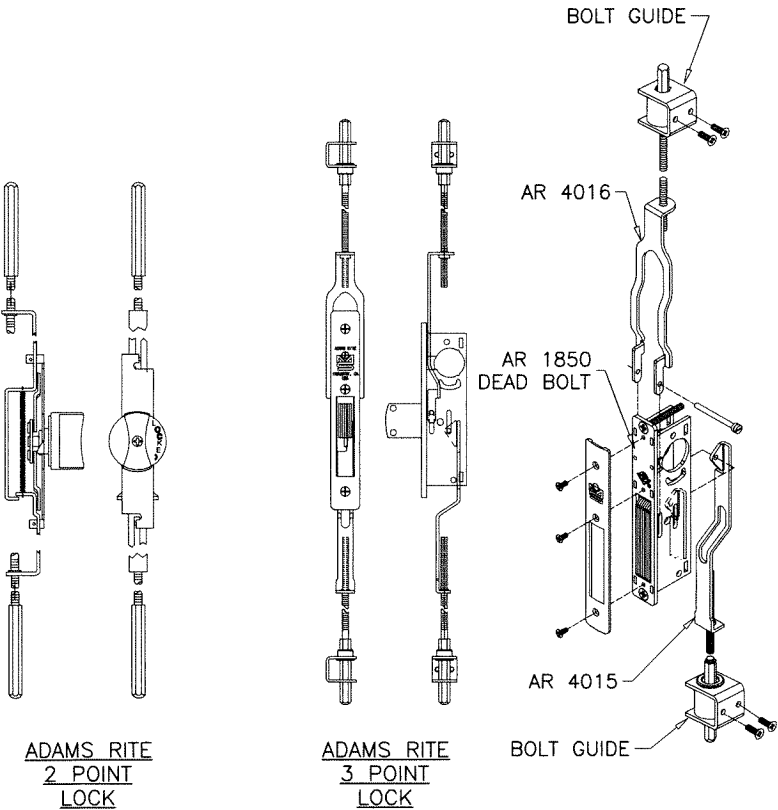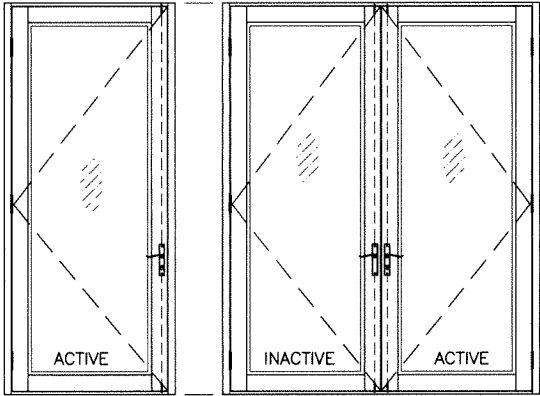



LOCK OPTIONS:

RIM PANIC EXIT DEVICES

PANIC EXIT DEVICE
MAX. LEAF HEIGHT = 96 IN.
MAX. LEAF WIDTH = 42 IN.
MAX. DESIGN LOAD = 50 PSF

ACTIVE LEAF:

RIM PANIC EXIT DEVICE
'98/99XP' BY 'VON DUPRIN'
'33A/35A' BY 'VON DUPRIN'
'FL3790' BY 'FIRST CHOICE'
'WS AD8500' BY 'SARGENT'
LOCATED AT 40" FROM BOTTOM
FASTENED TO ACTIVE LEAF WITH WITH
(6) 10-24 X 1-1/8" PH MS

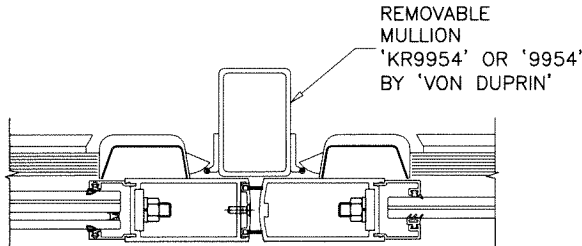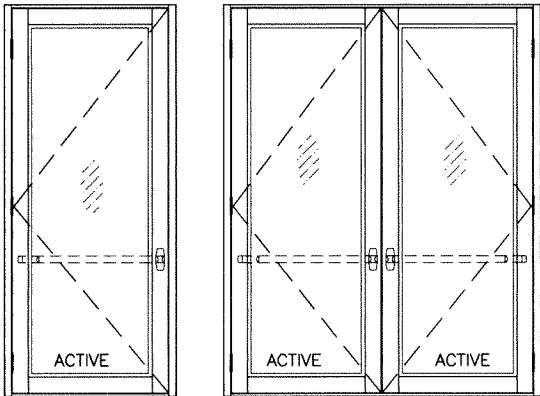

Sealed: 6/25/2024

FL #29696



AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

STANDARD ALUMINUM OUTSWING DOOR (L.M.I.)

revisions:
no date by description

date: 06-13-24
scale: -
dr. by: TARIQ
chk. by:

drawing no.
24-36F

sheet 10 of 15

a f c

COMP-ANI\24-36F-TLI

LOCK OPTIONS:



CVR PANIC EXIT DEVICES

OPTION #1:

PANIC EXIT DEVICE
MAX. LEAF HEIGHT = 96 IN.
MAX. LEAF WIDTH = 48 IN.
MAX. DESIGN LOAD = 70 PSF

ACTIVE & INACTIVE LEAF:

CONCEALED VERTICAL ROD PANIC EXIT DEVICE
'#2086' BY 'JACKSON PANIC SYSTEM'
'3690FL' BY 'FIRST CHOICE'
LOCATED AT 41" FROM SILL AT EACH LEAF.
FASTENED WITH
(1) #14 X 1" HH SELF DRILLING SCREW AT ONE END AND
(2) #12-24 X 1/2" OH MACHINE SCREWS AT OTHER END

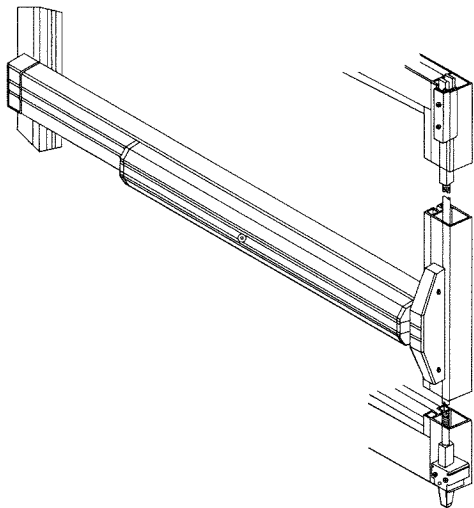
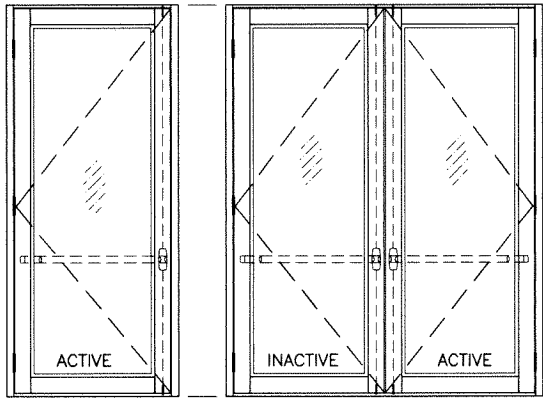


OPTION #2:

PANIC EXIT DEVICE
MAX. LEAF HEIGHT = 96 IN.
MAX. LEAF WIDTH = 48 IN.
MAX. DESIGN LOAD = 70 PSF

ACTIVE & INACTIVE LEAF:

CONCEALED VERTICAL ROD PANIC EXIT DEVICE
'HH9947' BY 'VON DUPRIN'
LOCATED AT 40" FROM SILL AT EACH LEAF.
FASTENED WITH
(2) #10-32 X 3/4" FH MACHINE SCREWS AT ONE END AND
(2) #10-24 X 1/2" FH MACHINE SCREWS AT OTHER END

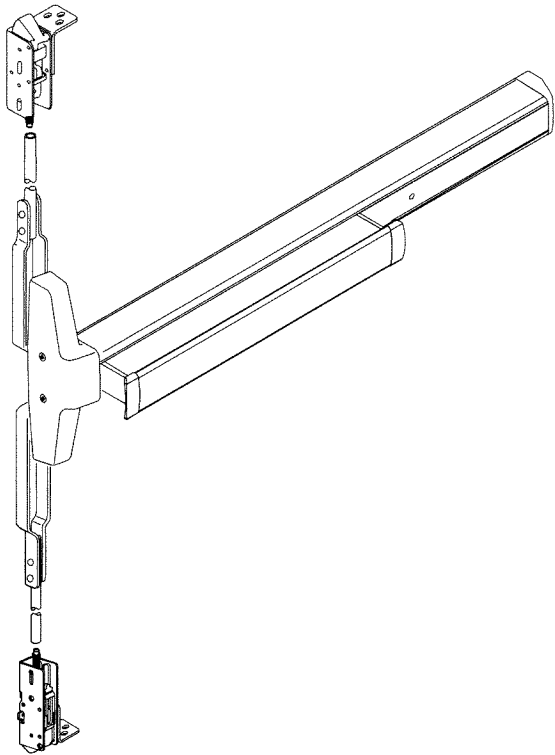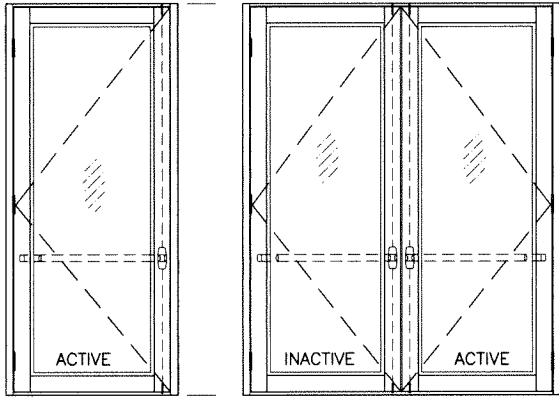

OPTION #3:

PANIC EXIT DEVICE
MAX. LEAF HEIGHT = 96 IN.
MAX. LEAF WIDTH = 48 IN.
MAX. DESIGN LOAD = 70 PSF

PANIC EXIT DEVICE
MAX. LEAF HEIGHT = 108 IN.
MAX. LEAF WIDTH = 37-1/2 IN.
MAX. DESIGN LOAD = 66 PSF

ACTIVE & INACTIVE LEAF:

CONCEALED VERTICAL ROD PANIC EXIT DEVICE
'1690HH' BY 'FALCON'
LOCATED AT 41" FROM SILL AT EACH LEAF.
FASTENED WITH
(1) #14 X 1" HH SELF DRILLING SCREW AT ONE END AND
(2) #12-24 X 1/2" OH MACHINE SCREWS AT OTHER END



Sealed: 6/25/2024

FL #29696


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220 (C.A.N. 3538)
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\24-36F-TLI

STANDARD ALUMINUM OUTSWING DOOR (L.M.I.)

TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

revisions:		no		date		by		description	
date:	06-13-24	no	date	by	description	no	date	by	description
scale:	-								
dr. by:	TARIQ								
chk. by:									
drawing no.	24-36F								
sheet	11 of 15								

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	E34224	1	DOOR FRAME HEAD (STANDARD)	6063-T6	-
1A	E4TB111	1	DOOR FRAME HEAD (NARROW)	6063-T6	-
1B	E34125	1	DOOR FRAME HEAD (CONCEALED CLOSERS)	6063-T6	-
1C	P4441	1	FRAME HEAD (CONCEALED CLOSERS) CORNER KEY	6063-T6	-
1D	E6504	1	HEAD (CONCEALED CLOSERS) DOOR STOP	6063-T6	-
1E	E2298	1	HEAD (CONCEALED CLOSERS) DOOR STOP COVER	6063-T6	-
2	E34144	2	DOOR FRAME JAMB (STANDARD)	6063-T6	-
2A	E4TB11	2	DOOR FRAME JAMB (NARROW)	6063-T6	-
3	E34242	2	JAMB SHEAR CLIP (STANDARD)	6063-T6	-
4	E3550	1	THRESHOLD	6063-T6	-
5	-	1/ LEAF	LEAF TOP RAIL	6063-T6	-
6	-	1/ LEAF	BOTTOM RAIL	6063-T6	-
7	-	1/ LEAF	LEAF HINGE/LOCK STILE	6063-T6	-
8	-	1/ LEAF	LEAF ALT. HINGE STILE	6063-T6	-
9	-	1/ LEAF	LEAF ACTIVE STILE	6063-T6	-
10	-	1/ LEAF	LEAF INACTIVE STILE	6063-T6	-
10A	-	1/ LEAF	ALT. LEAF INACTIVE STILE	6063-T6	-
11	-	AS REQD.	MID RAIL	6063-T6	OPTIONAL
12	E6510	AS REQD.	DOOR STOP BASE (STANDARD)	6063-T6	-
12A	E6500	AS REQD.	DOOR STOP BASE (NARROW)	6063-T6	-
13	E6505	AS REQD.	DOOR STOP (STANDARD)	6063-T6	-
13A	E6501	AS REQD.	DOOR STOP (NARROW)	6063-T6	-
14	E1152	AS REQD.	ASTRAGAL W'STRIP ADAPTER	6063-T6	-
15	E7926	8/ LEAF	GLASS STOP (9/16" LAM. GLASS)	6063-T6	-
16	E6586	4/ LEAF	GLASS STOP (11/16" LAM. GLASS)	6063-T6	-
16A	E6577	4/ LEAF	INT. GLASS STOP (11/16" LAM. GLASS)	6063-T6	-
16B	E6584	4/ LEAF	INT. GLASS STOP (11/16" LAM. GLASS)	6063-T6	-
17	E6422	4/ LEAF	GLASS STOP (1-1/16" INSUL. LAM. GLASS)	6063-T6	-
18	E6585	4/ LEAF	GLASS STOP (1-3/16" INSUL. LAM. GLASS)	6063-T6	-
18A	E6578	4/ LEAF	INT. GLASS STOP (1-3/16" INSUL. LAM. GLASS)	6063-T6	-
18B	E6579	4/ LEAF	INT. GLASS STOP (1-3/16" INSUL. LAM. GLASS)	6063-T6	-
19	#10 X 1/2"	AS REQD.	INT. GLASS STOP FASTENERS, AT 4" FROM ENDS & 14" O.C.	ST. STEEL	FH SELF DRILLING SCREWS
20	P912	4/ LEAF	EXTERIOR GLAZING GASKET (9/16" GLASS)	EPDM	-
20A	P1477	4/ LEAF	INTERIOR GLAZING GASKET (9/16" GLASS)	EPDM	-
21	P0017	4/ LEAF	EXTERIOR GLAZING GASKET (11/16" GLASS)	EPDM	-
21A	P6552	4/ LEAF	INTERIOR SPACER TAPE (9/16", 11/16" GLASS)	FOAM	-
23	P1431	4/ LEAF	EXTERIOR GLAZING GASKET (1-3/16" GLASS)	EPDM	-
23A	P6552	4/ LEAF	INTERIOR SPACER TAPE (1-3/16" GLASS)	FOAM	-
24	3M VHB	4/ LEAF	INTERIOR GLAZING TAPE (.090" X .812") (9/16" GLASS)	FOAM	-
25	91929A	2/ LITE	SETTING BLOCK AT 6" FROM ENDS	EPDM	DUROMETER 80±5 SHORE A
25A	91929D	2/ LITE	SETTING BLOCK AT 6" FROM ENDS	EPDM	DUROMETER 80±5 SHORE A
26	P6296	AS REQD.	FRAME HEAD/JAMB BULB W'STRIPPING	VINYL	-
27	P3450	AS REQD.	FRAME SILL BULB W'STRIPPING	VINYL	-
28	P938	AS REQD.	ASTRAGAL PILE W'STRIPPING	WOOL	ULTRAFAB
29	#10 X 5/8"	AS REQD.	ASTRAGAL ADAPTER FASTENERS, AT 12" O.C.	ST. STEEL	FH SELF DRILLING SCREWS
30	#10 X 1/2"	AS REQD.	GLASS STOP FASTENERS, AT 2" FROM ENDS & 12" O.C.	ST. STEEL	FH SELF DRILLING SCREWS
31	#12 X 1-1/2"	AS REQD.	FRAME ASSEMBLY FASTENERS	ST. STEEL	HH SELF DRILLING SCREWS

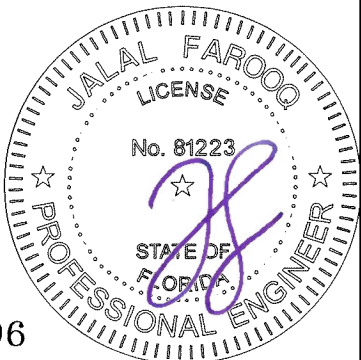

Sealed: 6/25/2024

FL #29696

**AL-FAROOQ CORPORATION**
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

STANDARD ALUMINUM OUTSWING DOOR (L.M.I.)

TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

revisions:

no	date	by	description

date: 06-13-24

scale: 3/8" = 1"


dr. by: TARIQ

chk. by:

drawing no.
24-36F

sheet 12 of 15

COMP-ANL\24-36F-TLI

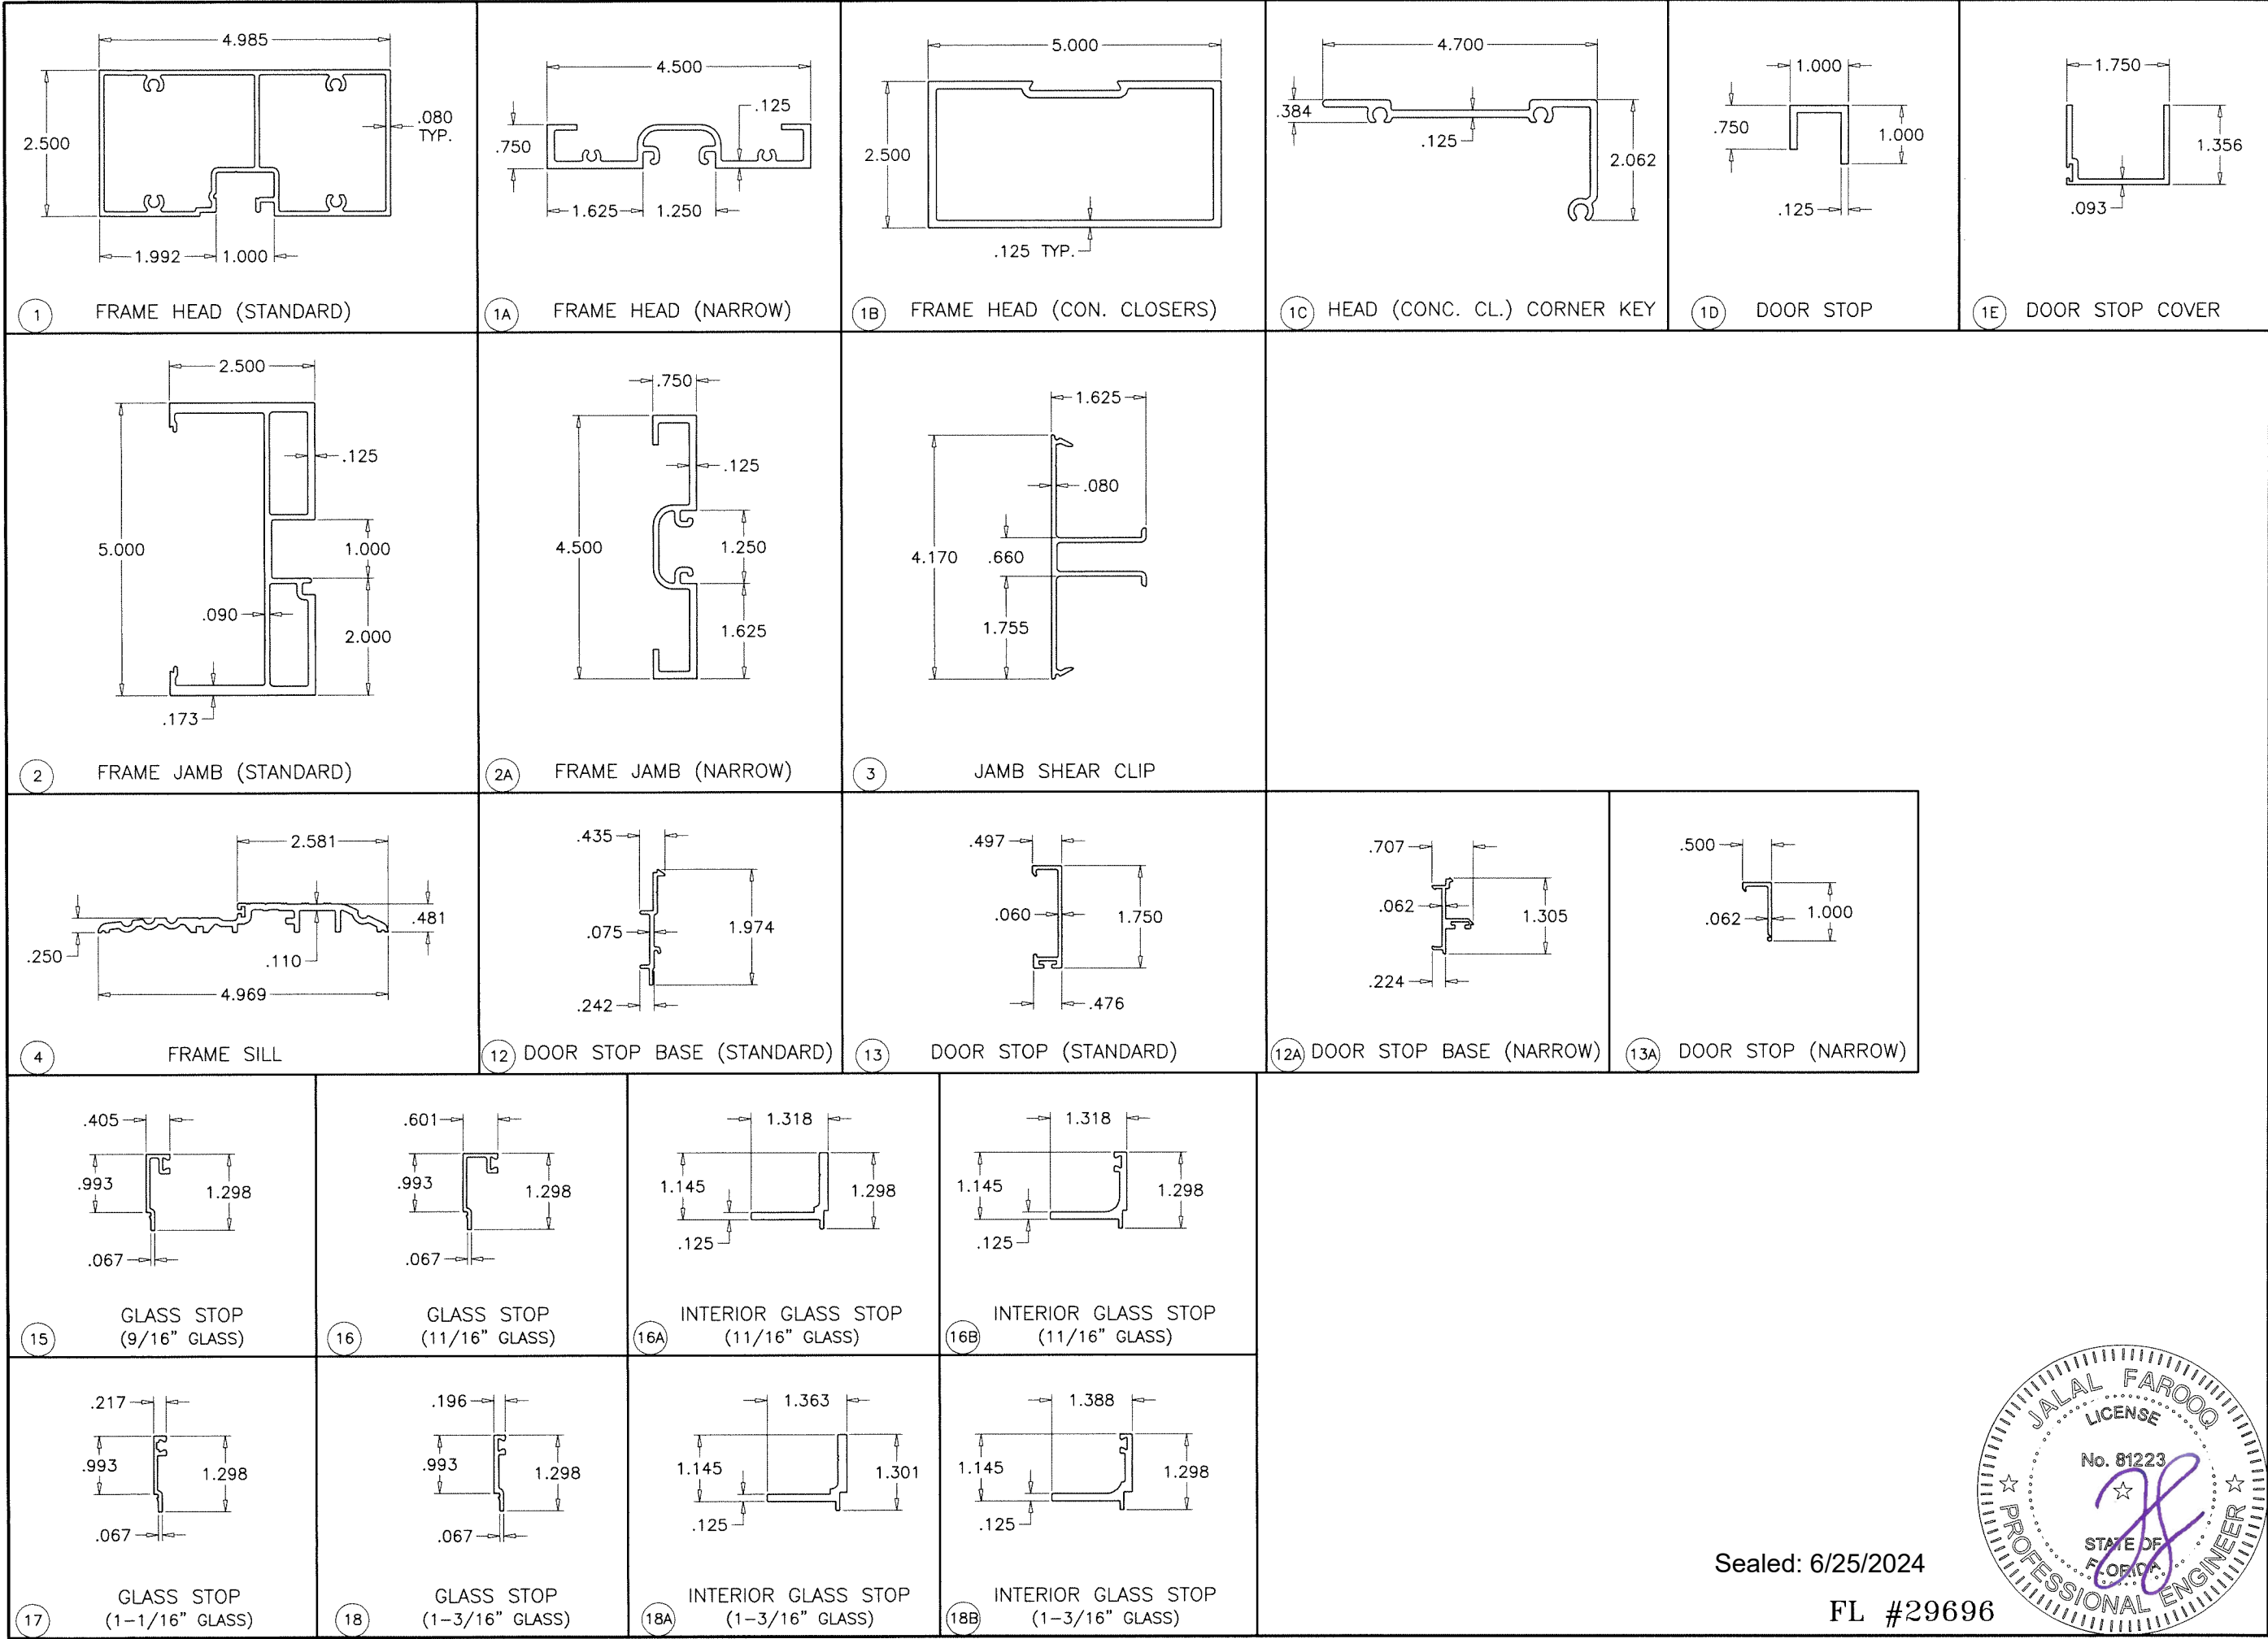


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 262-6978
FAX. (305) 264-8100
COMP-ANL\24-36F-TLI










STANDARD ALUMINUM OUTSWING DOOR (L.M.I.)
TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

revisions:
no date by description
date: 06-13-24
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:
drawing no.
24-36F
sheet 13 of 15

Sealed: 6/25/2024


FL #29696

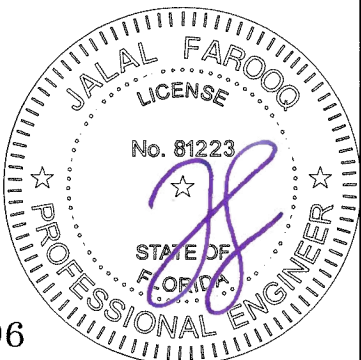

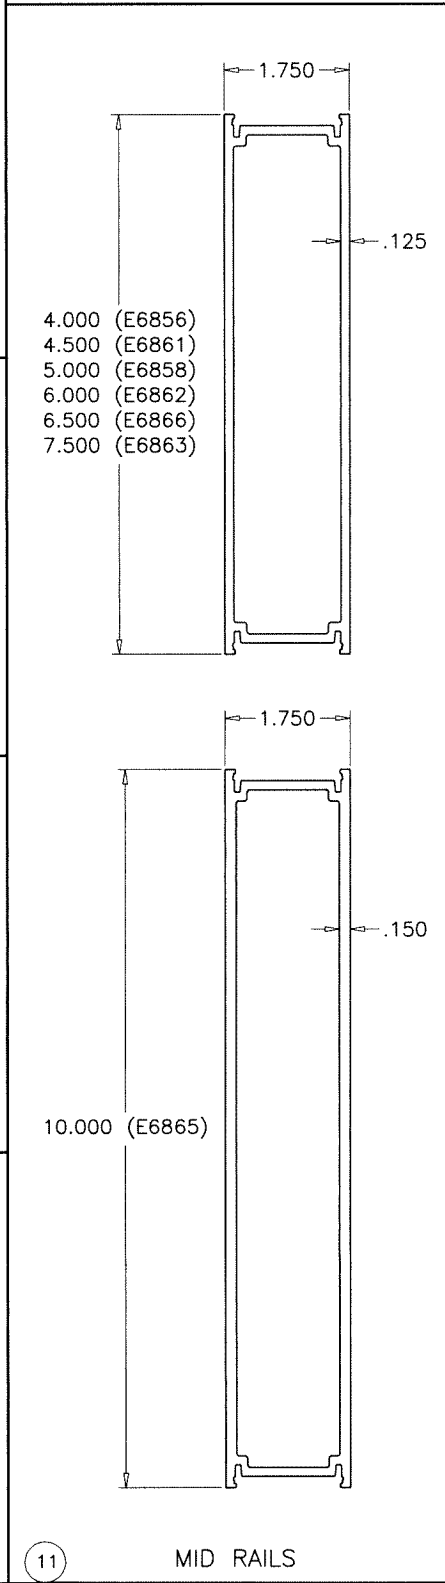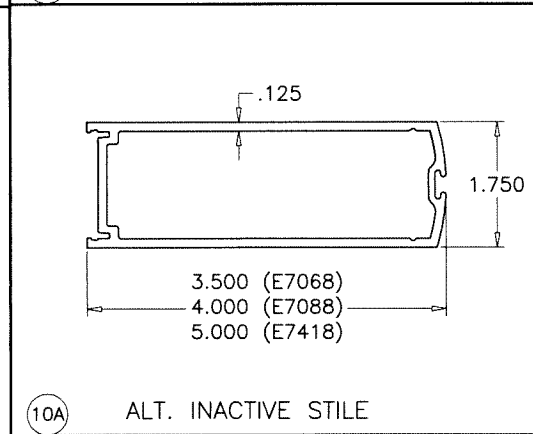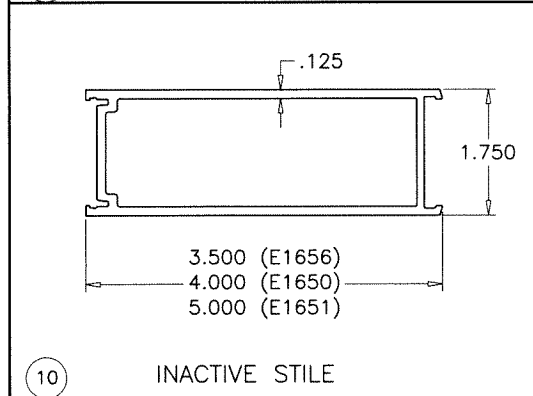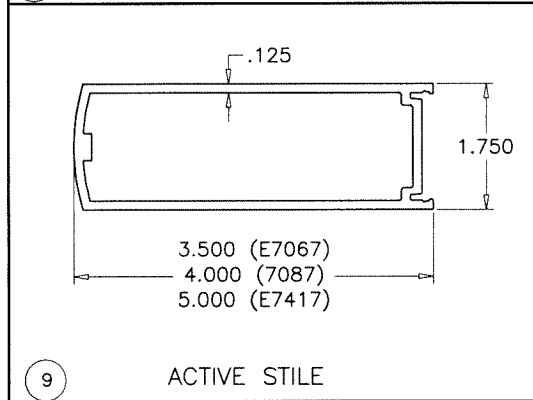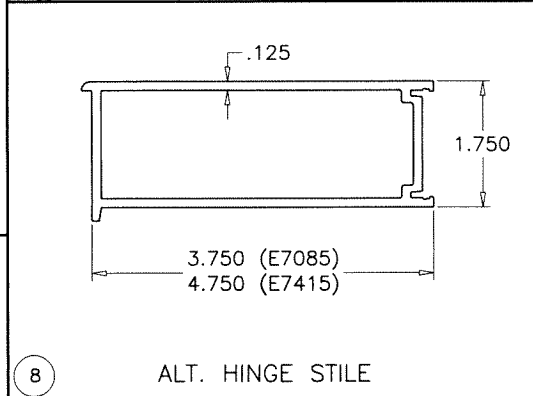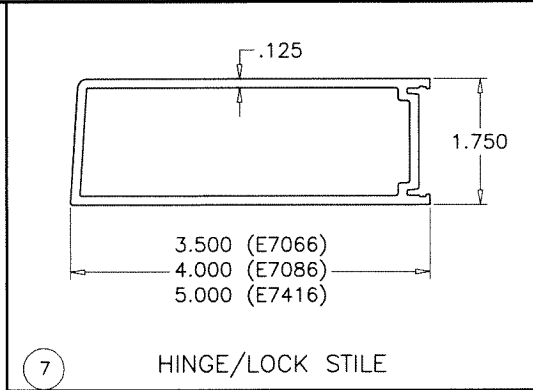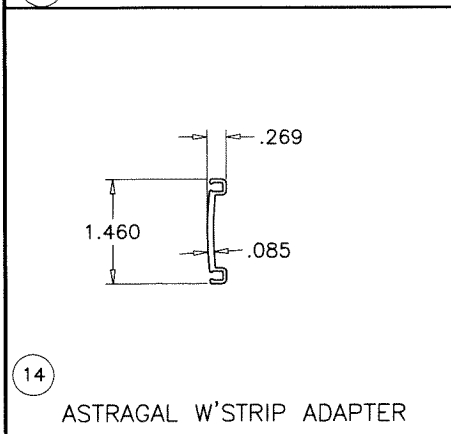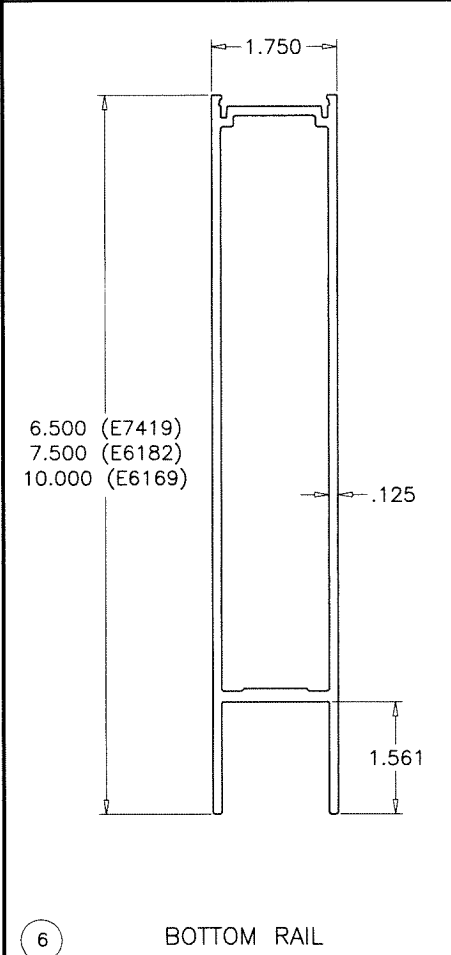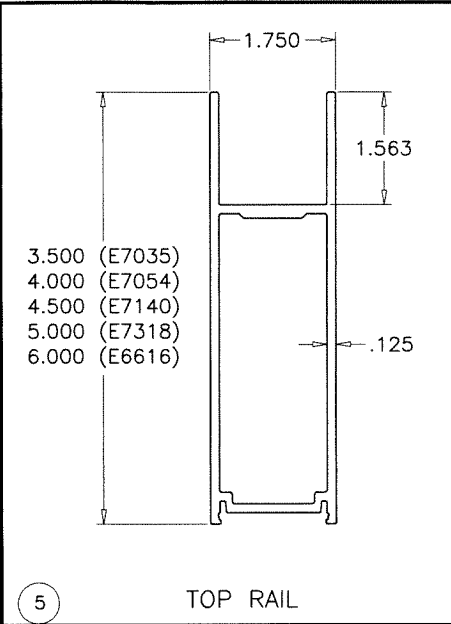

Sealed: 6/25/2024

FL #29696

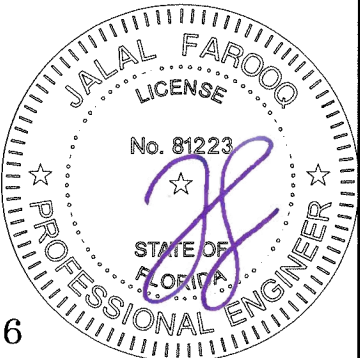

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\24-36F-TLI


STANDARD ALUMINUM OUTSWING DOOR (L.M.I.)

TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.


revisions:		by description	
no	date		

date: 06-13-24
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:


drawing no.
24-36F
sheet 14 of 15

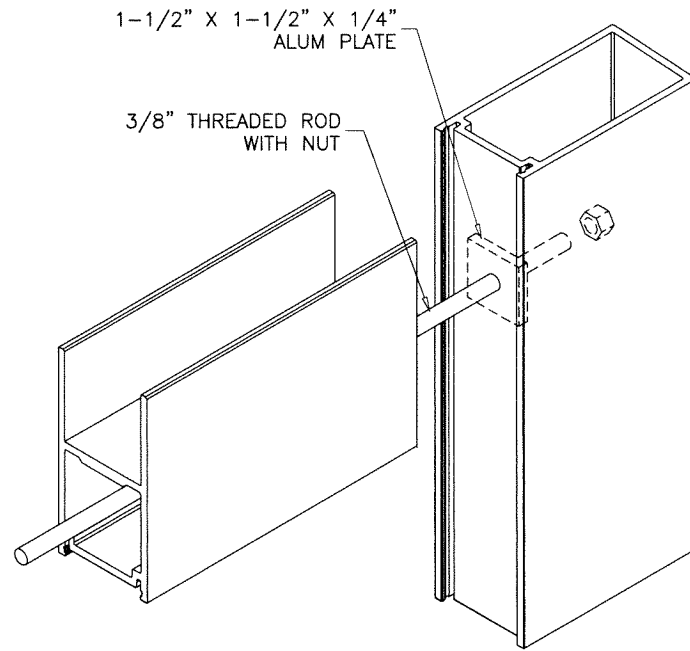


LEAF TOP CORNER

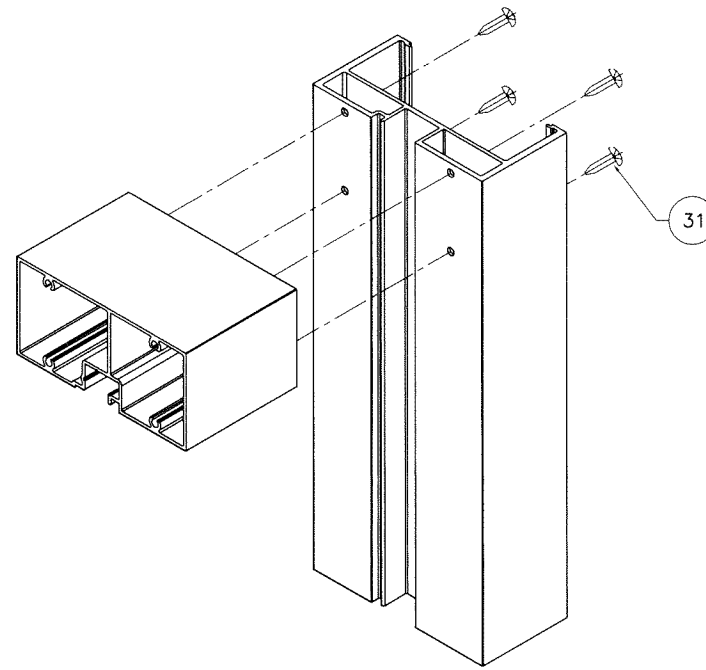


FRAME (STD.) TOP CORNER

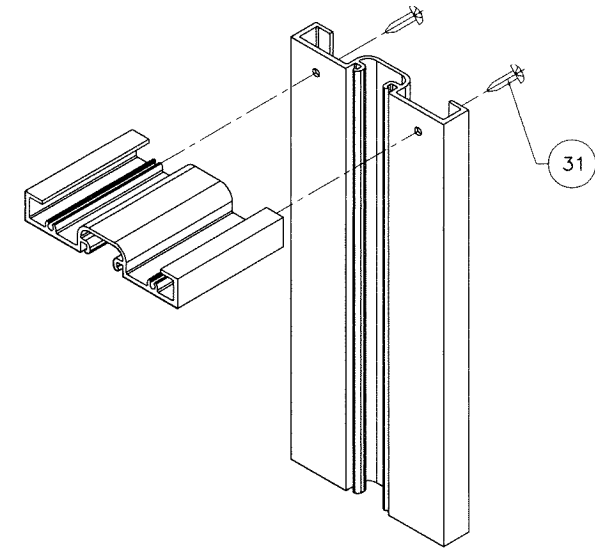


FRAME (NARROW) TOP CORNER

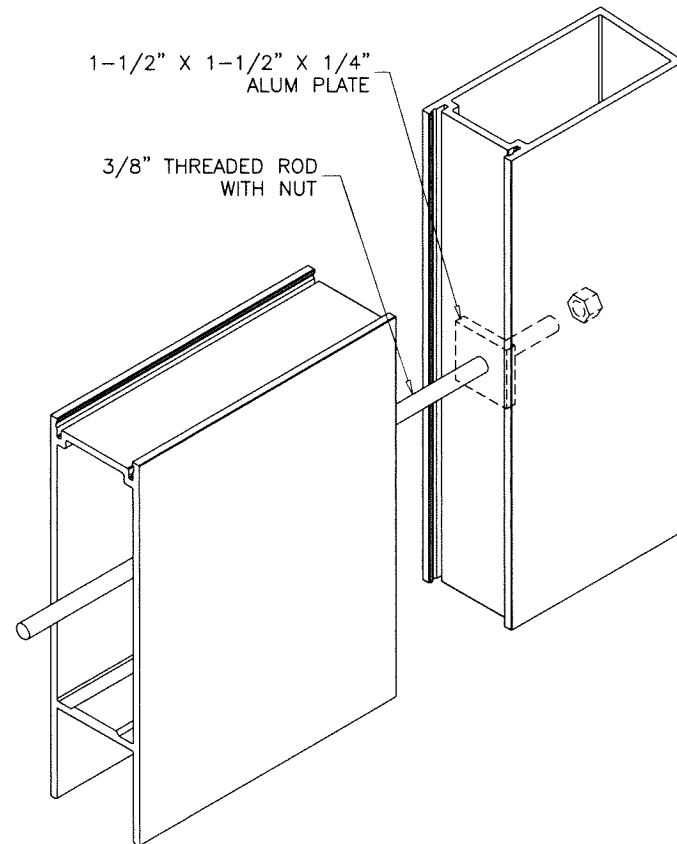

LEAF BOTTOM CORNER

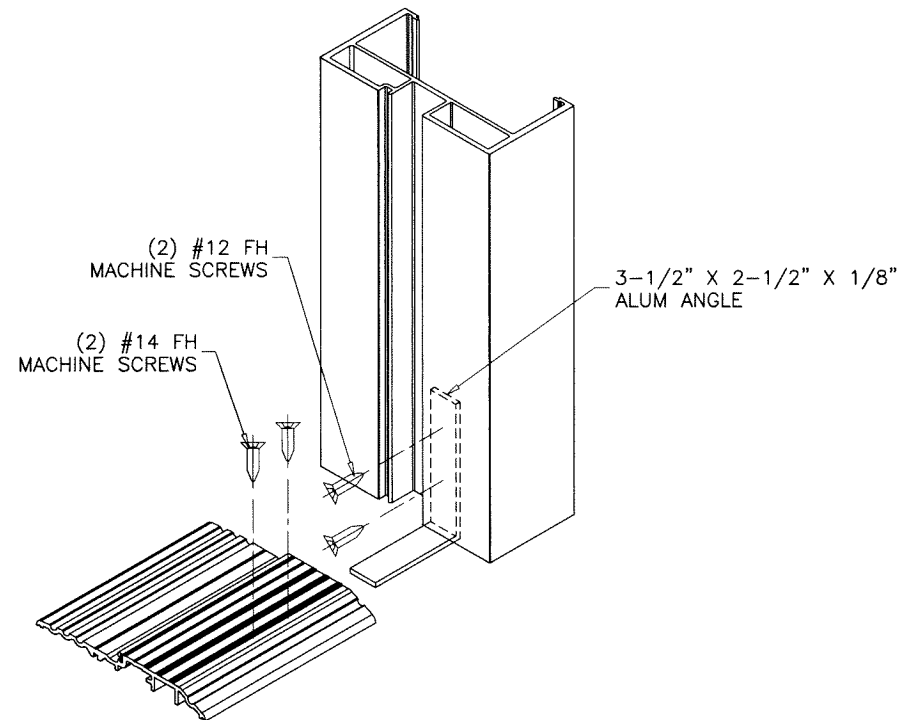


FRAME (STD.) BOTTOM CORNER

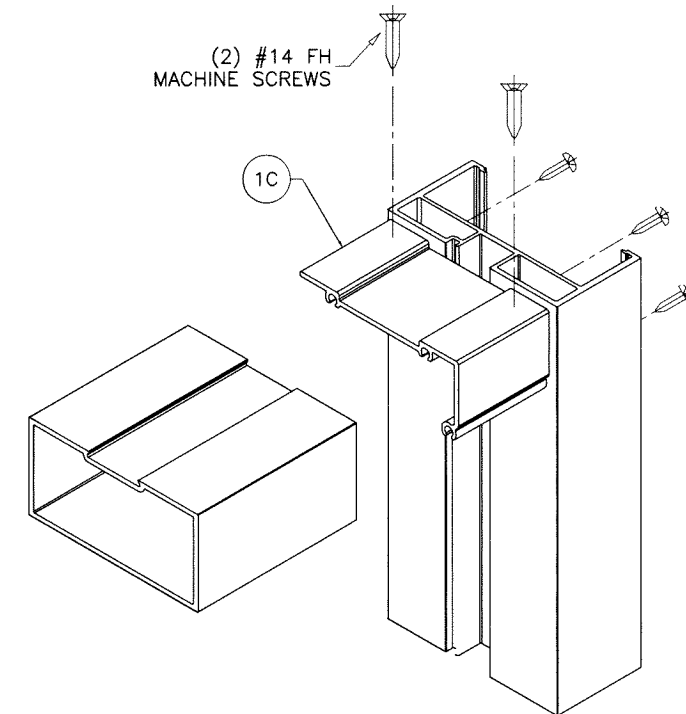

FRAME (CON. CL.) TOP CORNER

Sealed: 6/25/2024

FL #29696

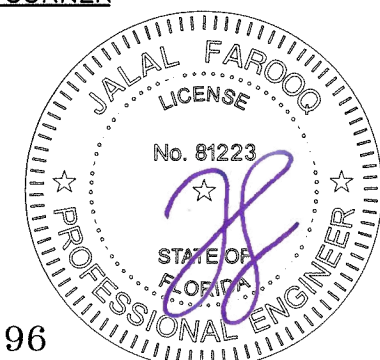

afc

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\24-36F-TLI

STANDARD ALUMINUM OUTSWING DOOR (L.M.I.)

TUBELITE INC.
3056 Walker Ridge Dr. N.W., Suite G
Walker, MI 49544
Tel. 800-866-2227 Fax.

revisions:
no date by description

date: 06-13-24
scale: 1/4" = 1"

dr. by: TARIQ

chk. by:

drawing no.

24-36F

sheet 15 of 15