
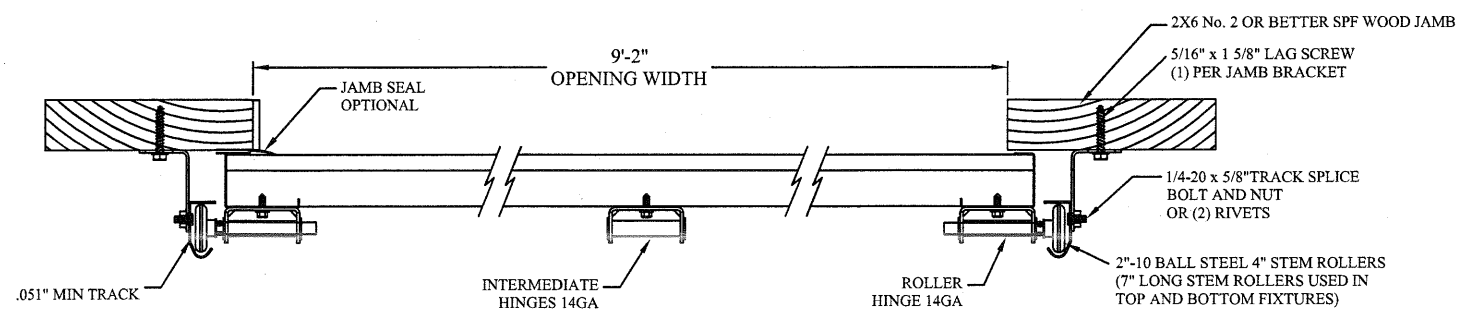
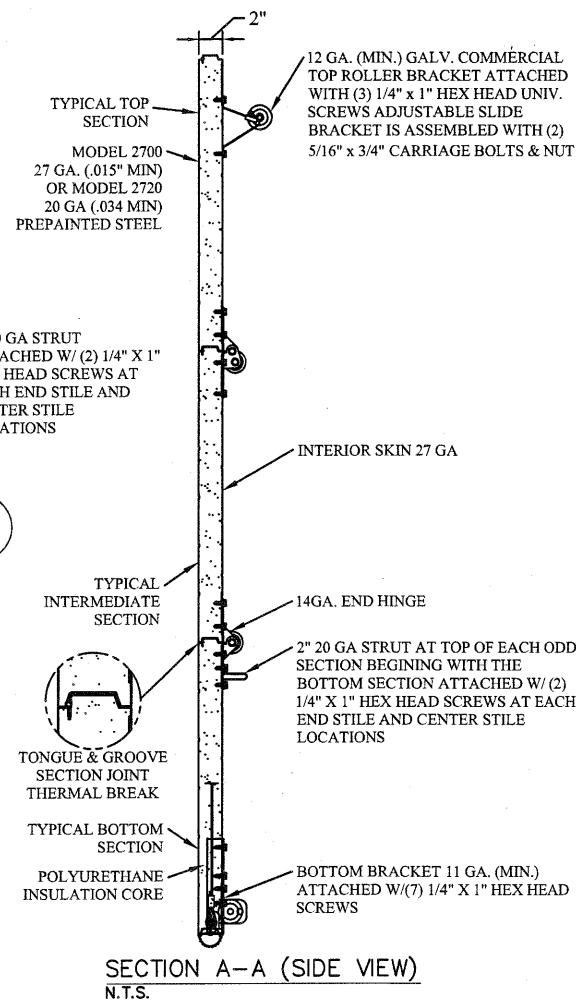
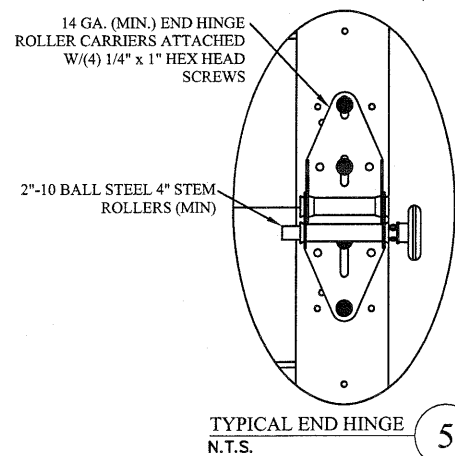
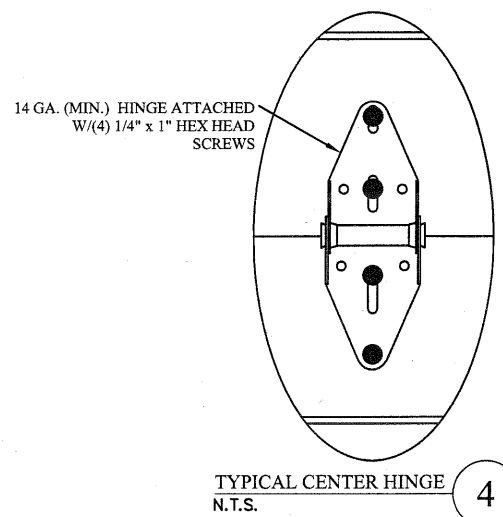
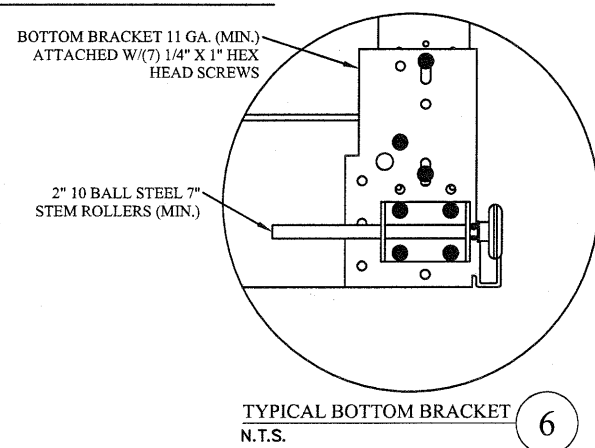


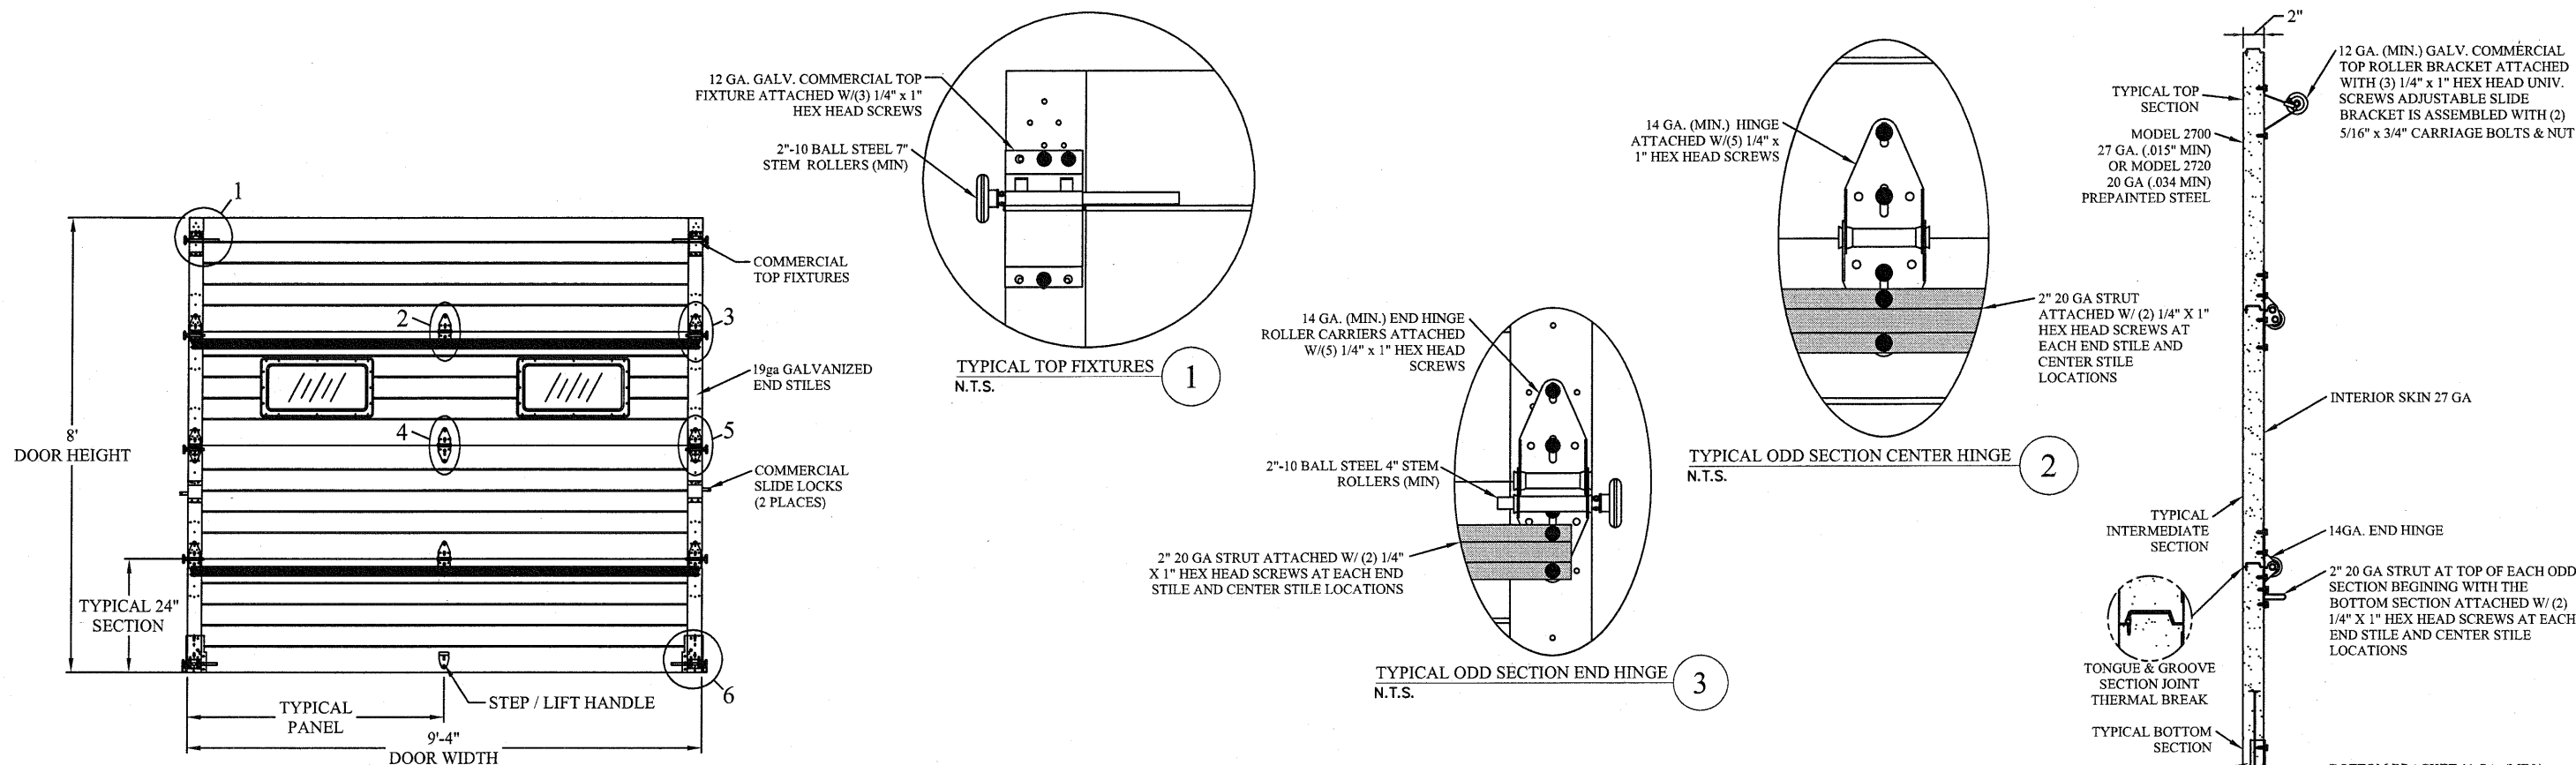

EDGE OF DOOR 1" OVERLAP ON EACH SIDE

THE METHOD OF TESTING WAS IN SUBSTANTIAL CONFORMANCE WITH THE PROCEDURES DESCRIBED IN DASHA 108. THE PRESSURES SHOWN ON THE DRAWINGS WERE CALCULATED USING ASCE 7-16 WITH THE FOLLOWING PARAMETERS (5 FEET OF DOOR WIDTH IN END ZONE, ROOF SLOPE 10° OR LESS):

WIND SPEED (MPH)	168	152	145	138	133
EXPOSURE LEVEL	B	C	C	D	D
MEAN ROOF HEIGHT	30'	15'	25'	15'	25'


REV	DESCRIPTION OF REVISIONS	DATE	BY

MAX SIZE
9'4" x 24'

DESIGN LOADS
+24.2 PSF
-28.4 PSF

TEST LOADS
+36.3 PSF
-42.6 PSF

Thomas L. Shelmerdine, PE (FL PE #0048579)
Structural Solutions, PA (FL Firm #20412)

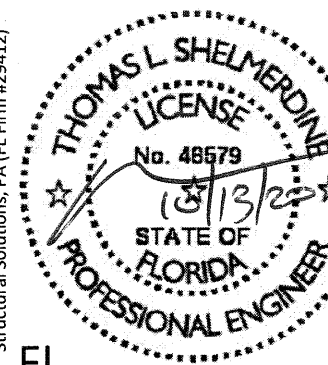


dba Structural Solutions of North Carolina, Inc.

Amar

MODEL 2700	AMARR 2742
MODEL 2720	AMARR 2042

SIZE	DRAWN BY DRD	DATE 1/16/19	DRAWING NUMBER IBC-2709-130-11-
B	CHECKED BY DLJ	DATE 5/30/19	
ENTREMATIC 165 CARRIAGE COURT WINSTON-SALEM, N.C. 27105			SHEET 1 OF 4


TRACK CONNECTION DIRECTLY TO STRUCTURE OPTIONS

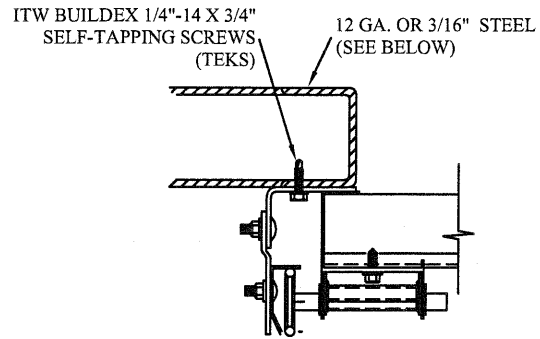

CLIP STYLE REVERSE ANGLE MOUNT SHOWN
BRACKET, CONTINUOUS AND TAPERED ANGLE
MOUNT AVAILABLE


12 GA. STEEL FRAMING
232 LBS./SCREW ALLOWABLE LOAD - 6" FROM ENDS
AND 24" O.C.
REFER TO NOTES: 1, 2 AND 5

3/16" STEEL FRAMING
569 LBS./SCREW ALLOWABLE LOAD - 6" FROM ENDS
AND 24" O.C.
REFER TO NOTES: 1, 2 AND 5

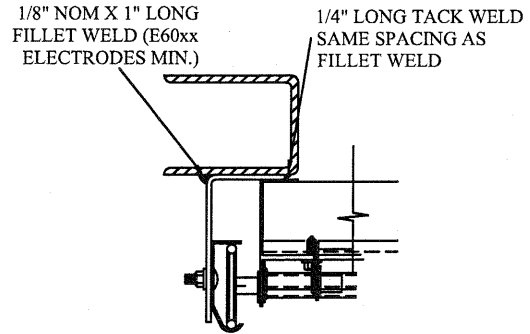


REVERSE ANGLE MOUNT SHOWN
BRACKET, CONTINUOUS AND TAPERED
ANGLE MOUNT AVAILABLE

STEEL FRAMING 12GA OR BETTER
1590 LBS./TN. ALLOWABLE LOAD - 6"
FROM ENDS AND 24" O.C.
REFER TO NOTES: 1, 2, 5, 6, 7, 8 AND 9

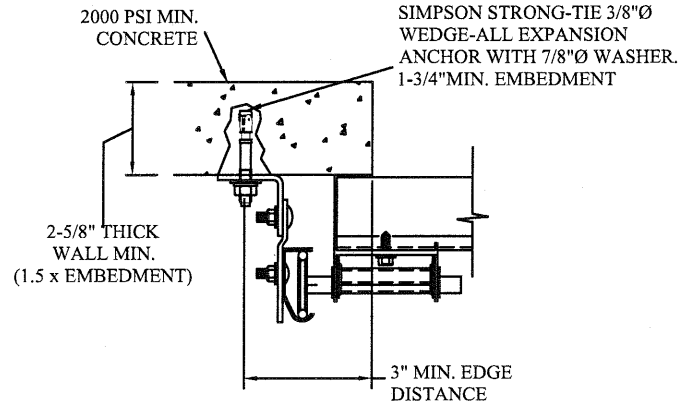

CLIP STYLE CONTINUOUS ANGLE MOUNT SHOWN
BRACKET, REVERSE AND TAPERED ANGLE MOUNT
AVAILABLE

2000 PSI CONCRETE OR GREATER
351 LBS./EXPANSION ANCHOR ALLOWABLE LOAD - 6"
FROM ENDS AND 24" O.C.
REFER TO NOTES: 1, 2, 3, 4 AND 5

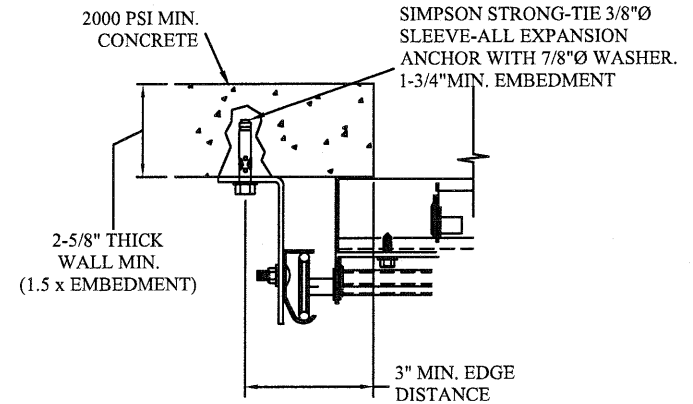

CONTINUOUS ANGLE MOUNT SHOWN
BRACKET, CONTINUOUS AND TAPERED ANGLE
MOUNT AVAILABLE

2000 PSI CONCRETE OR GREATER
336 LBS./EXPANSION ANCHOR ALLOWABLE LOAD - 6"
FROM ENDS AND 24" O.C.
REFER TO NOTES: 1, 2, 3, 4 AND 5

SPECIFICATIONS AND NOTES

1. ALL THE LOAD FROM THE DOOR IS TRANSFERRED TO THE VERTICAL TRACK, FROM THE TRACK THE LOAD IS TRANSFERRED TO THE VERTICAL JAMBS. THE HORIZONTAL JAMB OR HEADER RECEIVES NO PORTION OF THE LOAD TRANSFERRED FROM THE DOOR.
2. EACH VERTICAL JAMBS RECEIVES MAXIMUM DESIGN LOADS OF:
+112.9 LBS/FT & -132.5 LBS/FT
3. DOOR AND HARDWARE WILL BE DESIGNED, MANUFACTURED AND INSTALLED WITH STANDARDS AS SET FORTH BY DASMA.
4. DOOR SECTIONS SHALL BE 27 GA. (.015) MIN. EXTERIOR SKIN ROLLED FORMED, W/ BAKED ON POLYESTER FINISH
5. SUPPORTING STRUCTURAL ELEMENTS SHALL BE DESIGNED BY A REGISTERED PROFESSIONAL ENGINEER FOR WIND LOADS INDICATED ON THIS DRAWING IN ADDITION TO OTHER LOADINGS.

WOOD JAMB ATTACHMENT TO STRUCTURE (OPTIONAL)

2 X 6 VERTICAL JAMB ATTACHMENT TO WOOD FRAME STRUCTURE

5/16" X 3" LAG SCREWS STARTING 6" FROM ENDS
THEN 24" O.C. (1 1/2" EMBEDMENT)

2 X 6 VERTICAL JAMB ATTACHMENT TO 2,000 PSI CONCRETE

HILTI KWIK BOLT 3/8" X 4" STARTING 6" FROM ENDS
THEN 24" O.C. (2 1/2" EMBEDMENT)

HILTI SLEEVE ANCHOR 3/8" X 2-3/4" STARTING 6" FROM ENDS
THEN 24" O.C. (1 1/4" EMBEDMENT)

ITW/RAMSET REDHEAD (TRU-BOLT) 3/8" X 4" STARTING 6" FROM ENDS
THEN 24" O.C. (2 1/2" EMBEDMENT)

2 X 6 VERTICAL JAMB ATTACHMENT TO HOLLOW C-90 BLOCK

SIMPSON 1/4" X 3" TITEN SCREWS STARTING 6" FROM ENDS,
USE PAIRS OF FASTENERS (3" APART)

AT 24" O.C. (1 1/2" EMBEDMENT)
HILTI 1/4" X 2-3/4" KWIK-CON II+ SCREWS STARTING 6" FROM ENDS,


USE PAIRS OF FASTENERS (3" APART) AT 24" O.C. (1 1/4" EMBEDMENT)
2 X 6 VERTICAL JAMB ATTACHMENT TO GROUTED C-90 BLOCK (2000 PSI GROUT)

HILTI SLEEVE ANCHOR 3/8" X 2-3/4" STARTING 6" FROM ENDS
THEN 24" O.C. (1 1/4" EMBEDMENT)

(OR, USE FASTENERS FOR HOLLOW C-90 BLOCK)


*LAGS AND BOLTS CAN BE COUNTERSUNK TO PROVIDE A FLUSH MOUNTING SURFACE.

*PREPARATION OF WOOD JAMBS BY OTHERS

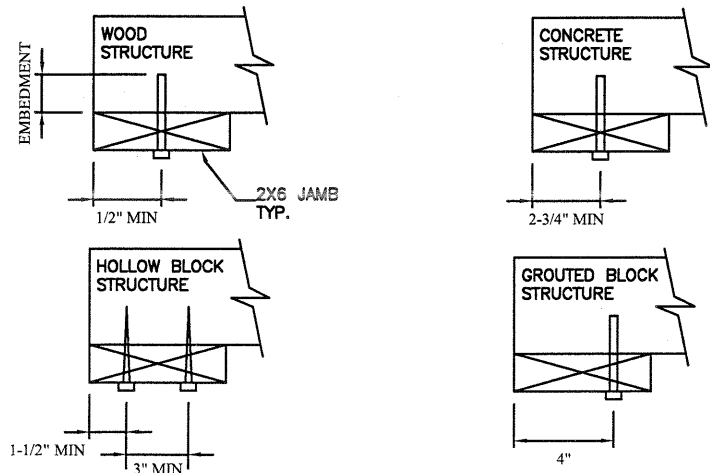


TRACK CONNECTION TO WOOD JAMB OPTIONS


FOR LAG SCREWS & BRACKET SPACING SEE PAGE 3 FOR TRACK CONFIGURATION DETAIL

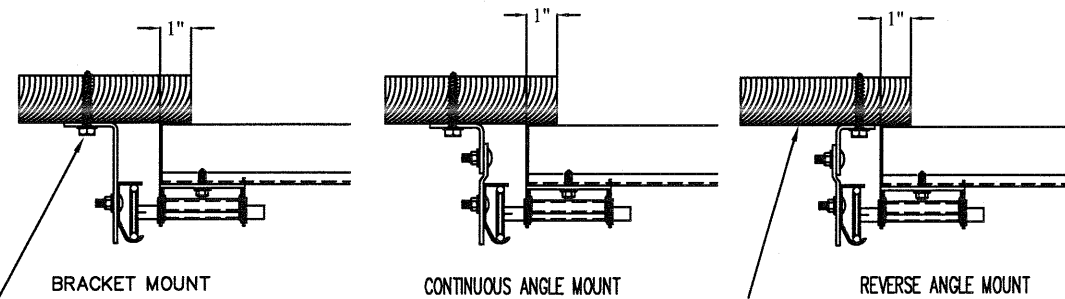


5/16" x 1 5/8" LAG SCREW (1) PER
JAMB BRACKET (1-1/2" EMBEDMENT
MINIMUM) (TYP.)

2x6 WOOD JAMB SYP OR SPF
(NO.2) OR BETTER (TYP.)

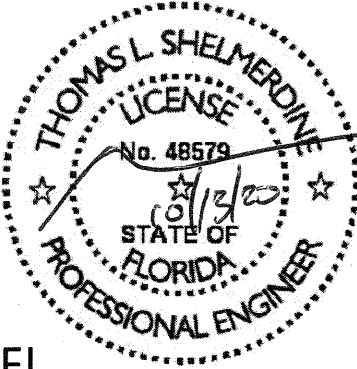
REV	DESCRIPTION OF REVISIONS	DATE	BY
MAX SIZE 9'4" x 24' DESIGN LOADS +24.2 PSF -28.4 PSF TEST LOADS +36.3 PSF -42.6 PSF		Thomas L. Shelmerdine, PE (FL PE #0048579) Structural Solutions, PA (FL Firm #29412) FL  dba Structural Solutions of North Carolina, Inc. 5921-G.W. Friendly Ave., Greensboro, NC 27410	
			
MODEL 2700 AMARR 2742 MODEL 2720 AMARR 2042			
SIZE	DRAWN BY	DRD	DATE 1/16/19
B	CHECKED BY	DLJ	DATE 5/30/19
			DRAWING NUMBER
			IBC-2709-130-11-R
ENTREMATICS 165 CARRIAGE COURT WINSTON-SALEM, N.C. 27105			SHEET 2 OF 4

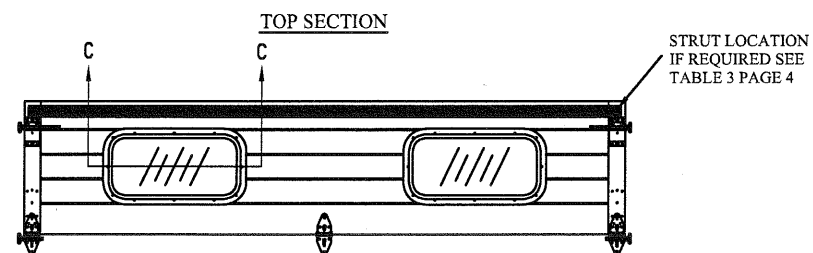


OPTIONAL GLAZED SECTION W/ 26" X 13" WINDOWS
N.T.S.

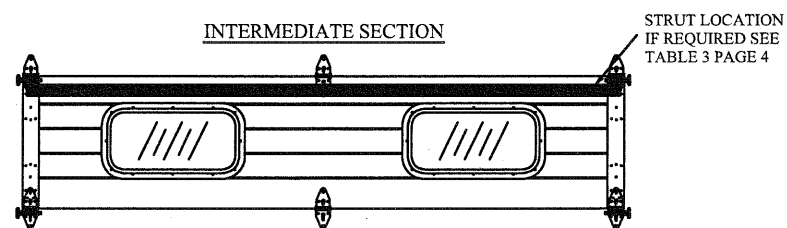


OPTIONAL GLAZED SECTION W/ 26" X 13" WINDOWS
N.T.S.

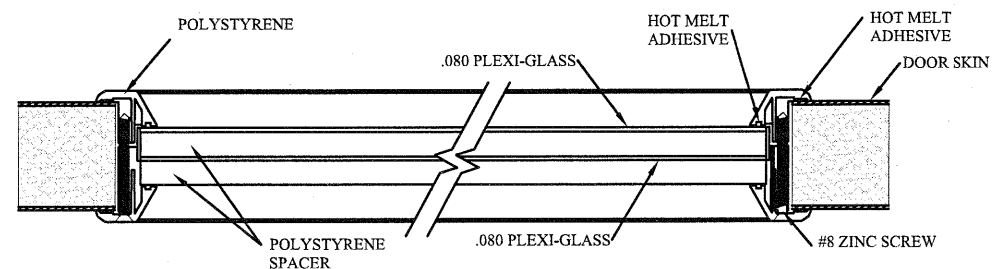


SECTION C-C 26" X 13" WINDOW DETAIL W/ INSULATED PLEXI-GLASS
N.T.S.

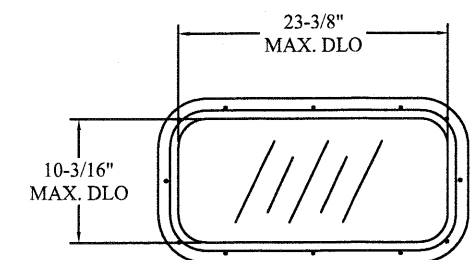


26" X 13" DAY LIGHT OPENING AND FASTENER DETAIL
N.T.S.

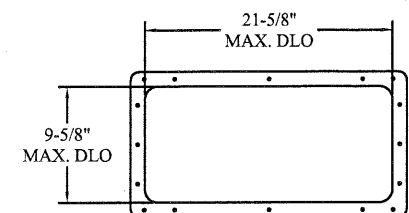


24" X 12" DAY LIGHT OPENING AND FASTENER DETAIL
N.T.S.

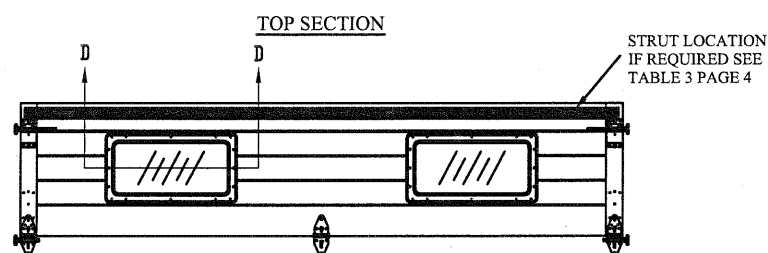

OPTIONAL GLAZED SECTION W/ 24" X 12" WINDOWS
N.T.S.

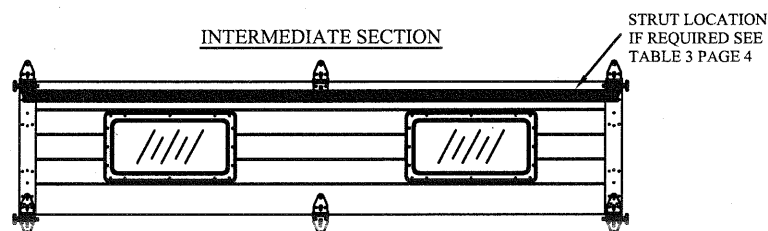

OPTIONAL GLAZED SECTION W/ 24" X 12" WINDOWS
N.T.S.

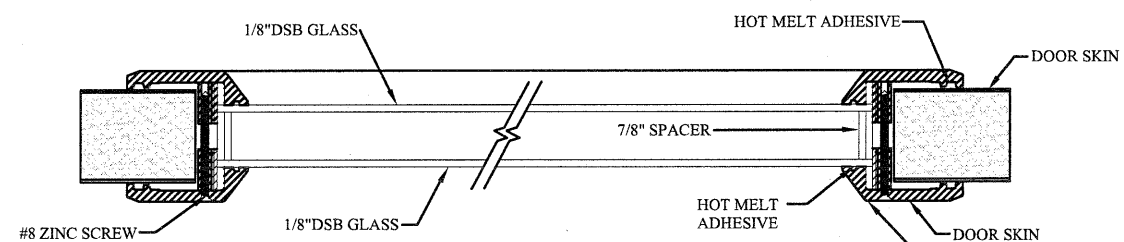

SECTION D-D 24" X 12" WINDOW DETAIL W/ 1-1/8" INSULATED GLASS
N.T.S.



REV	DESCRIPTION OF REVISIONS	DATE	BY
MAX SIZE 9'4" x 24' DESIGN LOADS +24.2 PSF -28.4 PSF TEST LOADS +36.3 PSF -42.6 PSF		Thomas L. Shelmerdine, PE (FL PE #0048579) Structural Solutions, PA (FL Firm #29412)  FL dba Structural Solutions of North Carolina, Inc. 5921-G W. Friendly Ave., Greensboro, NC 27410	
			
MODEL 2700 AMARR 2742 MODEL 2720 AMARR 2042			
SIZE	DRAWN BY	DRD	DATE 1/16/19
B	CHECKED BY	DLW	DATE 5/30/19
ENTREMATICA 165 CARRIAGE COURT WINSTON-SALEM, N.C. 27105			DRAWING NUMBER IBC-2709-130-11-R SHEET 3 OF 4

TABLE 1


Section	Center	Max Design	
	Stile	Loads Allowed	
Width	1st	Positive	Negative
(ft)	(in)	(PSF)	(PSF)
6' 0	36"	37.4	43.9
6' 2	37"	36.4	42.7
6' 4	38"	35.4	41.6
6' 6	39"	34.5	40.5
6' 8	40"	33.6	39.5
6' 10	41"	32.8	38.5
7' 0	42"	32.0	37.6
7' 2	43"	31.3	36.7
7' 4	44"	30.6	35.9
7' 6	45"	29.9	35.1
7' 8	46"	29.3	34.3
7' 10	47"	28.7	33.6
8' 0	48"	28.1	32.9
8' 2	49"	27.5	32.2
8' 4	50"	27.0	31.6
8' 6	51"	26.4	30.9
8' 8	52"	25.9	30.3
8' 10	53"	25.4	29.9
9' 0	54"	24.9	29.3
9' 2	55"	24.5	28.8
9' 4	56"	24.2	28.4

TABLE 3

SECTION	STRUT SIZE
12TH	
11TH	2"
10TH	
9TH	2"
8TH	
7TH	2"
6TH	
5TH	2"
4TH	
3RD	2"
2ND	
BOTTOM	2"

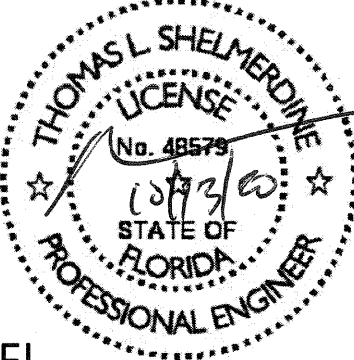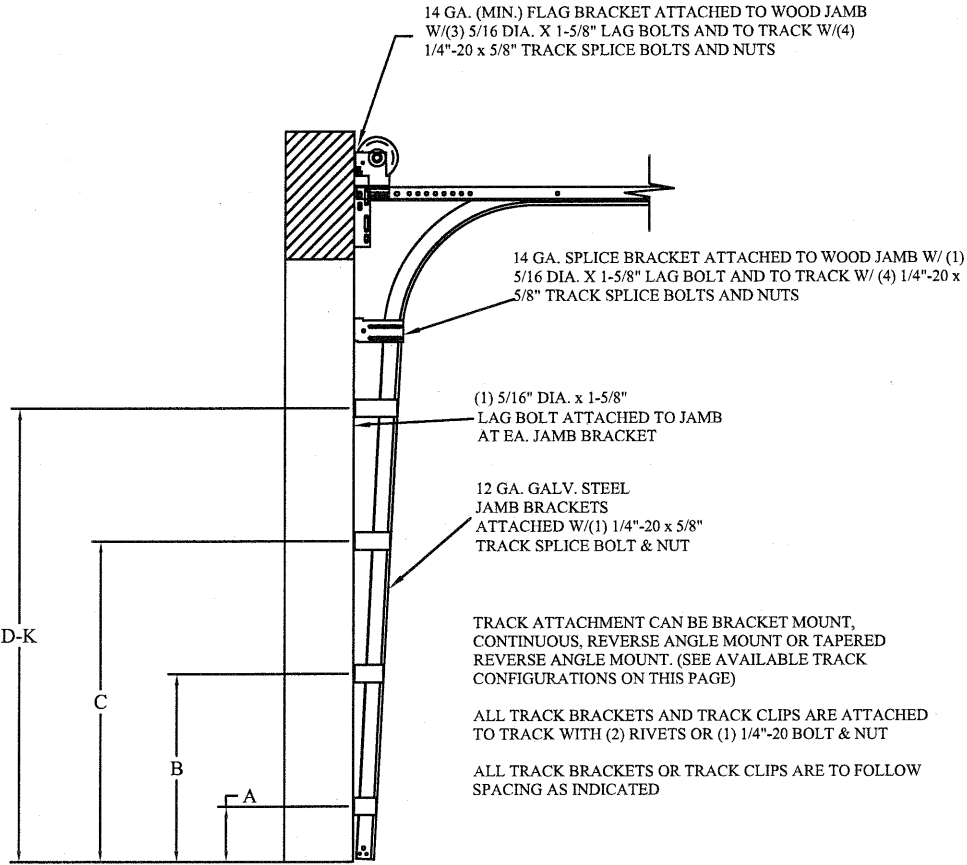

TRACK CONFIGURATION FOR UP TO 24' TALL DOORS
SEE TABLE 2

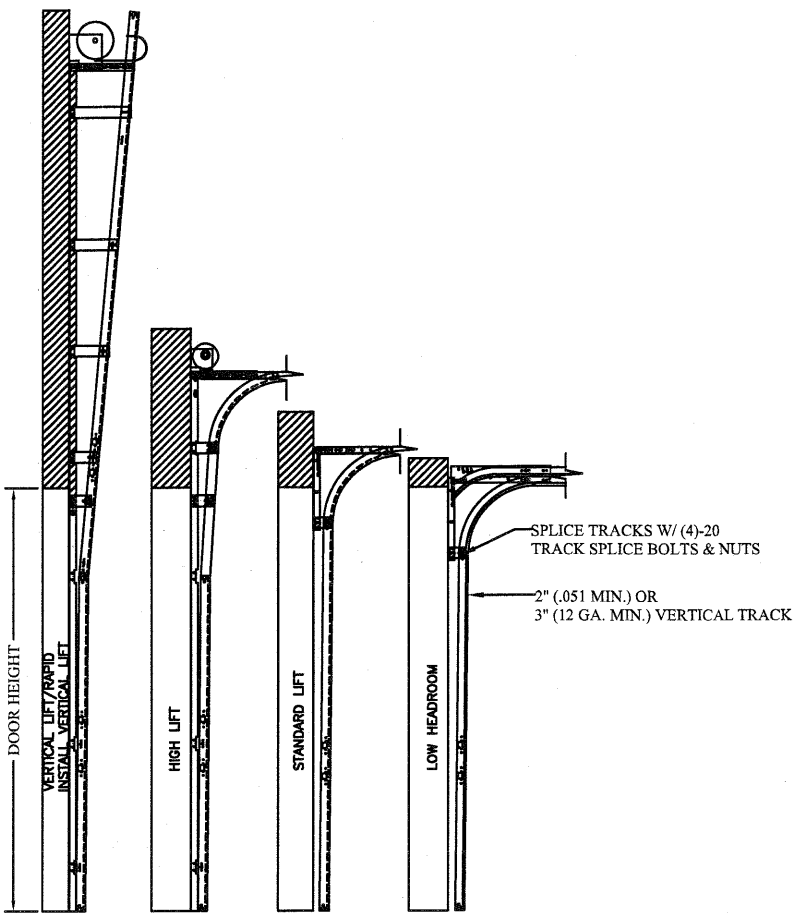

AVAILABLE TRACK CONFIGURATIONS
N.T.S.

TABLE 2

DOOR HEIGHT		TRACK ATTACHMENT										TYPICAL SPLICE	
		A	B	C	D	E	F	G	H	I	J		K
7'	0"	10.0"	34"	58"									76"
7'	6"	10.0"	34"	58"									82"
8'	0"	10.0"	34"	58"									88"
8'	6"	10.0"	34"	58"	82"								94"
9'	0"	10.0"	34"	58"	82"								100"
9'	6"	10.0"	34"	58"	82"								106"
10'	0"	10.0"	34"	58"	82"								112"
11'	0"	10.0"	34"	58"	82"	106"							124"
12'	0"	10.0"	34"	58"	82"	106"							136"
13'	0"	10.0"	34"	58"	82"	106"	130"						148"
14'	0"	10.0"	34"	58"	82"	106"	130"						160"
15'	0"	10.0"	34"	58"	82"	106"	130"	154"					172"
16'	0"	10.0"	34"	58"	82"	106"	130"	154"					184"
17'	0"	10.0"	34"	58"	82"	106"	130"	154"	178"				196"
18'	0"	10.0"	34"	58"	82"	106"	130"	154"	178"				208"
19'	0"	10.0"	34"	58"	82"	106"	130"	154"	178"	202"			220"
20'	0"	10.0"	34"	58"	82"	106"	130"	154"	178"	202"			232"
21	0"	10.0"	34"	58"	82"	106"	130"	154"	178"	202"	226"		244"
22	0"	10.0"	34"	58"	82"	106"	130"	154"	178"	202"	226"		256"
23	0"	10.0"	34"	58"	82"	106"	130"	154"	178"	202"	226"	250"	268"
24	0"	10.0"	34"	58"	82"	106"	130"	154"	178"	202"	226"	250"	280"

ALL TRACK ATTACHMENTS +/- 2" ALLOWED USING SYP OR SPF NO.2 OR BETTER ONLY

REVDESCRIPTION OF REVISIONSDATEBY

MAX SIZE
9'4" x 24'

DESIGN LOADS
+24.2 PSF
-28.4 PSF

TEST LOADS
+36.3 PSF
-42.6 PSF

Thomas L. Shelmerdine, PE (FL PE #0048579)
Structural Solutions, PA (FL Firm #29412)

THOMAS L. SHELMERDINE
LICENSE
No. 48579
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
FL

dba Structural Solutions of North Carolina, Inc.
5921-G W. Friendly Ave., Greensboro, NC 27410

Amarr

MODEL 2700 AMARR 2742
MODEL 2720 AMARR 2042

SIZE
B

DRAWN BY
DLJ

DRD
DLJ

DATE
1/16/19

DATE
5/30/19

DRAWING NUMBER
IBC-2709-130-11-R

ENTREMATIC
165 CARRIAGE COURT WINSTON-SALEM, N.C. 27105

SHEET 4 OF 4