


SHWINCO ARCHITECTURAL PRODUCTS, LLC

9000 SERIES ALUMINUM MULLION


(WZ3)(IMPACT)

GENERAL NOTES:


1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
- AAMA/WDMA/CSA 101/I.S.2/A440-11/17
 - ASTM E1886-13a
 - ASTM E1996-17
 - SECTION 1709.8
2. MULLION INSTALLATION DETAILS APPLY TO SHWINCO 9000 SERIES ALUMINUM MULLION WITH ALUMINUM ANCHOR CLIP WHEN USED TO MULL WINDOWS SIDE BY SIDE AND STACKED.
3. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE IN WIND ZONE 3 OR LESS. ADJOINING WINDOW AND DOORS SHALL BE EQUALLY RATED OR PROVIDED WITH AN IMPACT RESISTANT COVERING.
4. APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE IN WIND ZONE 4.
5. 1X AND 2X WOOD BUCKS TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE AND IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
6. SEE CHARTS & NOTES ON SHEETS 4-7 FOR DESIGN PRESSURE AND ANCHORING REQUIREMENTS.
7. THIS MULLION IS ONLY VALID WHEN USED IN CONJUNCTION WITH APPLICABLE SHWINCO WINDOW AND DOOR PRODUCTS.
8. ALL WINDOWS AND/OR DOORS USED WITH THIS MULLION SHALL BE QUALIFIED UNDER SEPARATE APPROVAL. WINDOWS AND DOORS SHALL FOLLOW ANCHORING REQUIREMENTS PER SEPARATE APPROVAL. TYPICAL ELEVATIONS SHOW SINGLE HUNG AND FIXED WINDOWS, MULLION IS QUALIFIED FOR USE WITH ALL OPERATOR TYPES AND COMPATIBLE SERIES AVAILABLE FROM SHWINCO. WHEN ADJACENT WINDOWS DO NOT USE SILL ANCHORS, TWO-WAY DESIGN PRESSURES MUST BE USED.
9. MULLION MATERIAL: 6005-T5 ALUMINUM
10. CLIP MATERIAL: 304 STAINLESS STEEL
11. DISSIMILAR METALS INCLUDING FASTENERS THAT MAY COME INTO CONTACT WITH ALUMINUM UNIT FRAMING SHALL BE PROTECTED IN ACCORDANCE WITH THE CURRENT FBC.

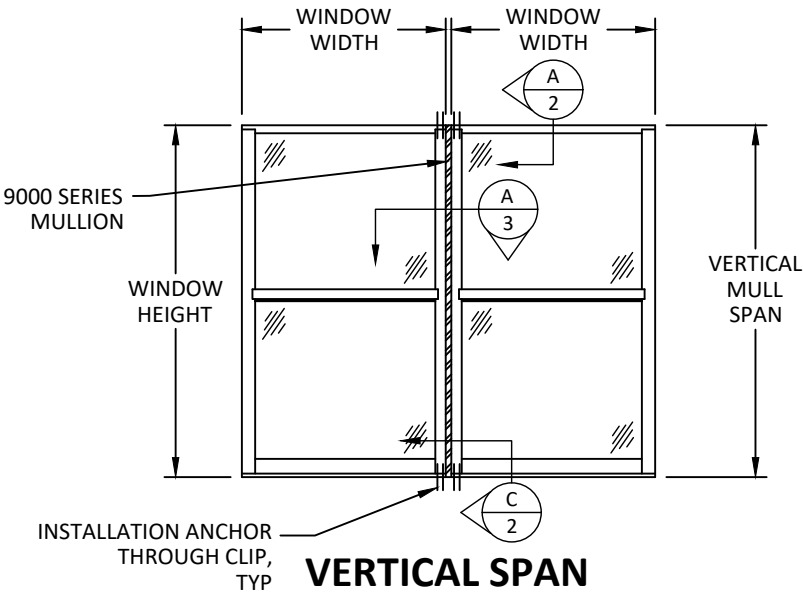

VERTICAL SPAN
TWIN WINDOWS

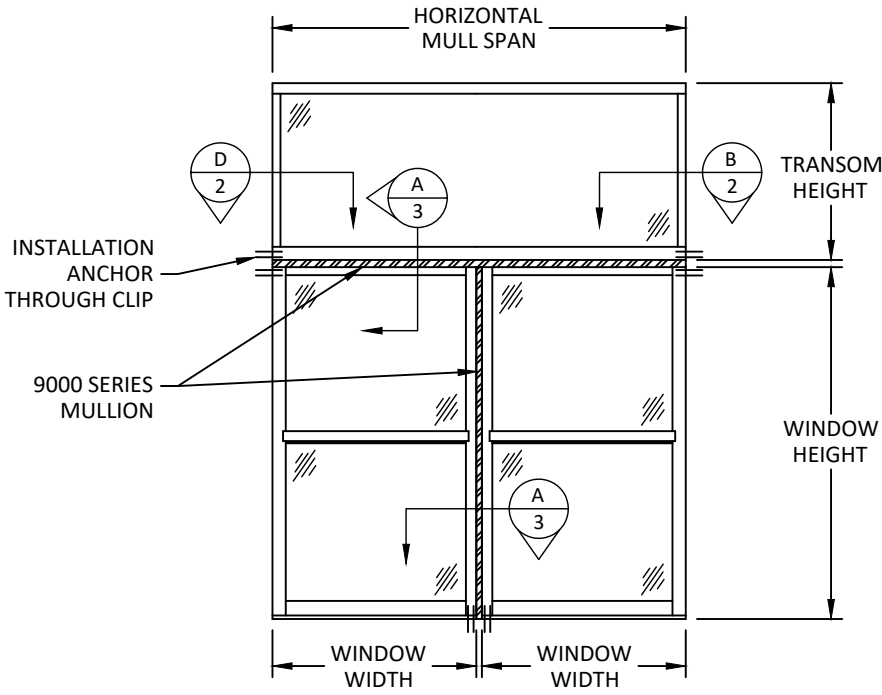

HORIZONTAL "T" MULL SPAN
TWIN W/ TRANSOM

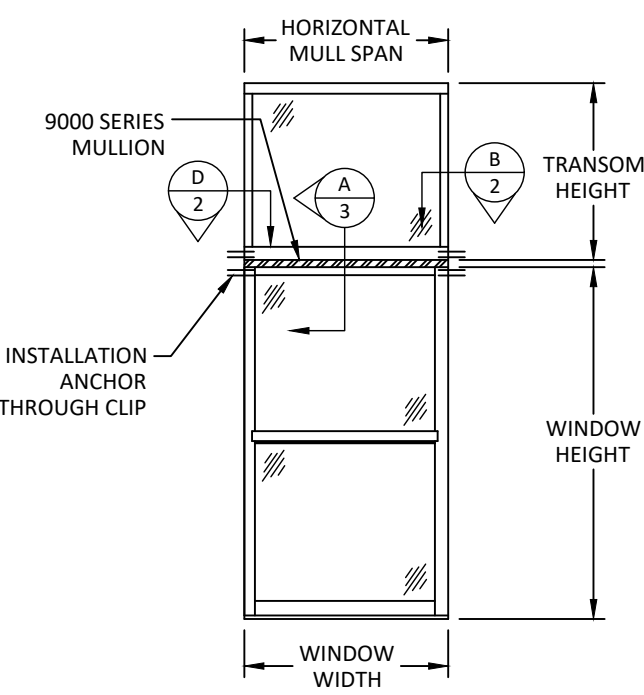

HORIZONTAL SPAN
SINGLE W/ TRANSOM

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES AND TYPICAL ELEVATIONS
2	INSTALLATION DETAILS
3	MULLION AND CLIP DETAILS
4	ONE WAY DESIGN PRESSURE TABLES - WOOD, STEEL, ALUM. CONC.
5	ONE WAY DESIGN PRESSURE TABLES - CMU
6	TWO WAY DESIGN PRESSURE TABLES - WOOD, STEEL, ALUM. CONC.
7	TWO WAY DESIGN PRESSURE TABLES - CMU
8	EXAMPLES OF ONE-WAY AND TWO-WAY ASSEMBLIES



171 JET SERVICES WAY
DOTHAN, AL 36303
PH: (855) 611-8889
EMAIL: INFO@SHWINCO.COM

TITLE:
9000 SERIES ALUMINUM MULLION
(WZ3)(IMPACT)

GENERAL NOTES AND
TYPICAL ELEVATIONS

PREPARED BY:

BUILDING DROPS, INC.


1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	DB	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.08.10 10:11:25 -02'00'

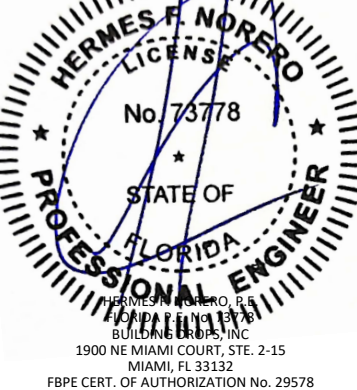

FL #:

FL29827

DATE: 03.14.2019

DWG. BY: SM

CHK. BY: HFN

SCALE: NTS


DWG. #: SWD049

SHEET: 1


REV. A

OF 8


c:\users\daniel\buildit\rago\building drops, inc\building drops landing - common\projects\2026 code change projects\shwinco architectural products\cc-26-0209.1 - 2026 code change projects\dwgs\729827 - series 9000 mullion\swd049 - a.dwg 7/9/2026 4:15 PM

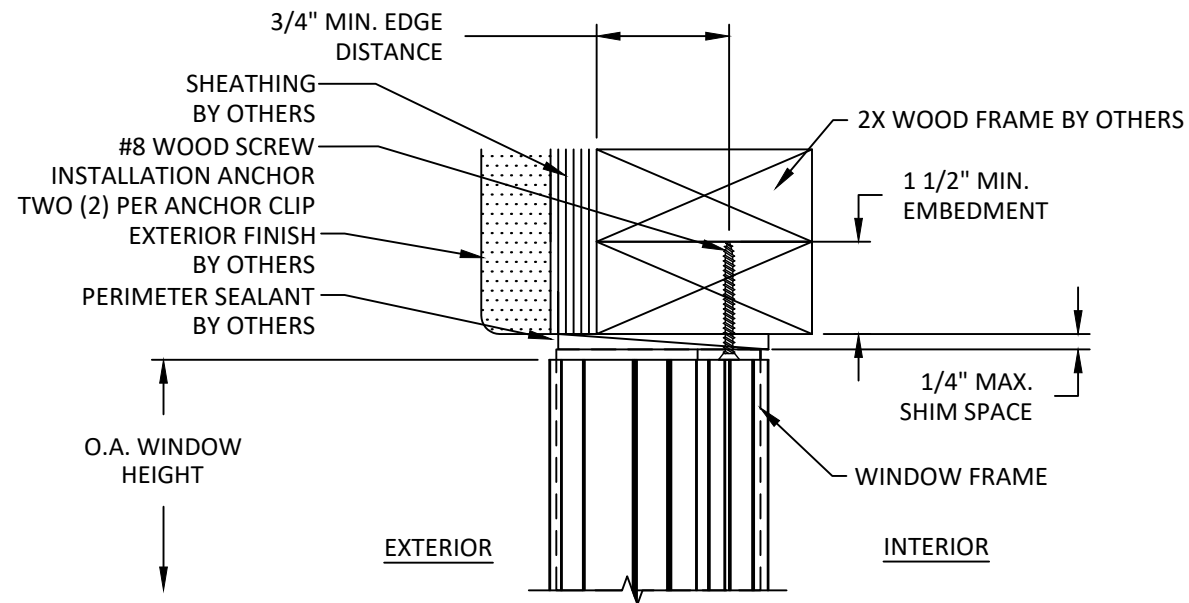


A
2 **VERTICAL SECTION**
HEAD - 2X WOOD FRAME

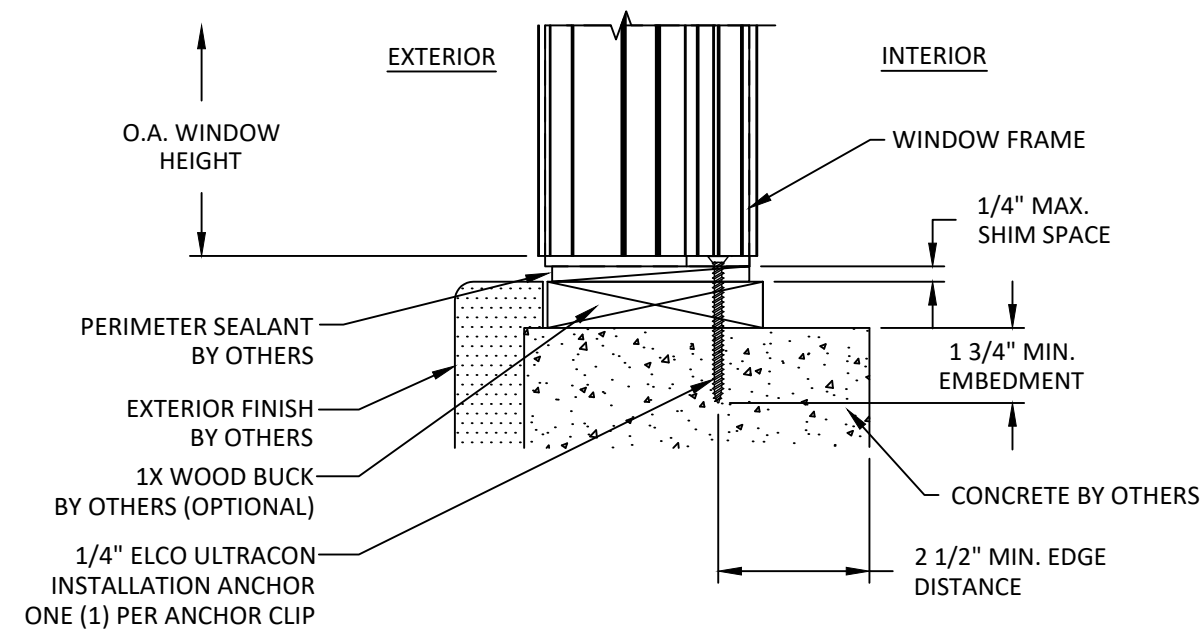

C
2 **VERTICAL SECTION**
SILL - CONCRETE

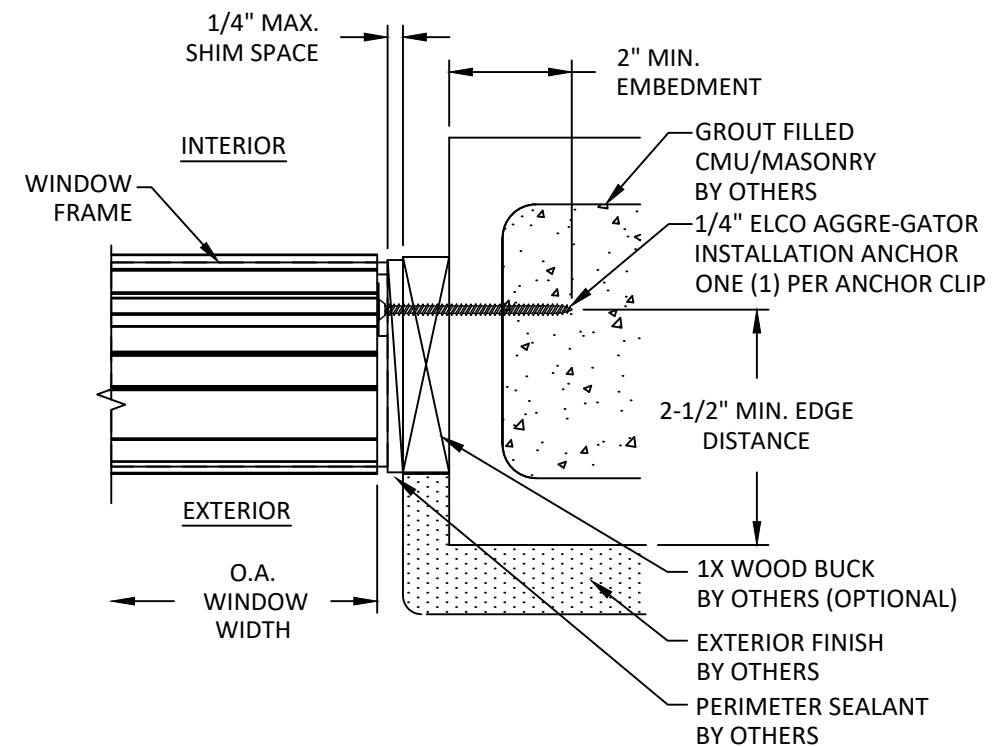

B
2 **HORIZONTAL SECTION**
JAMB - CMU/MASONRY

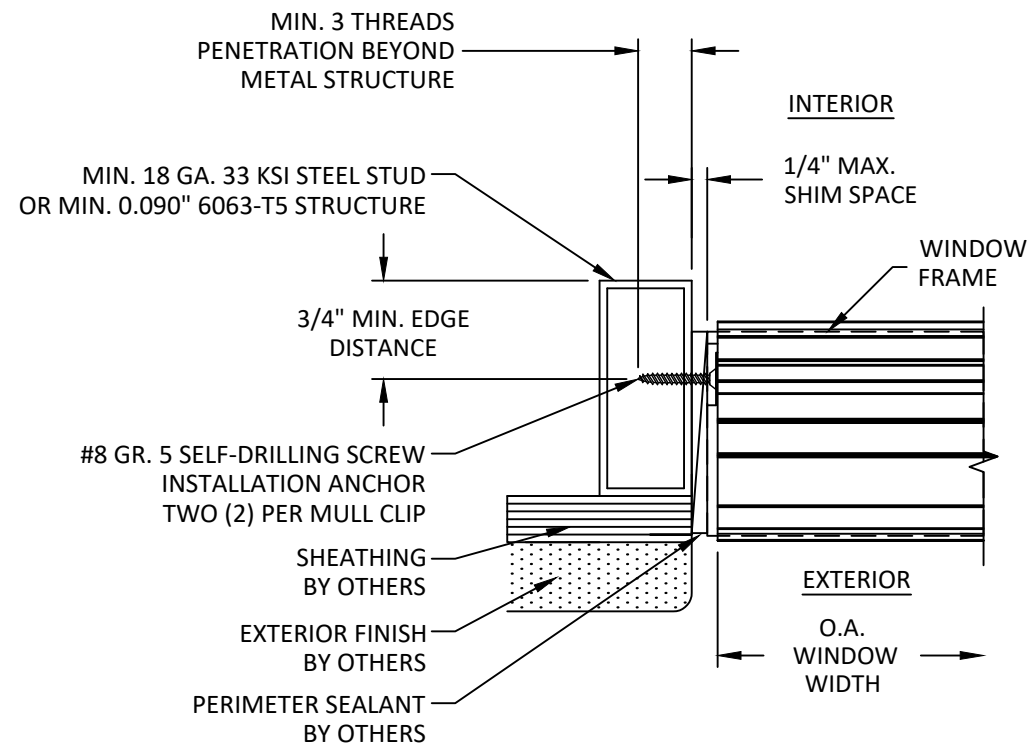

D
2 **HORIZONTAL SECTION**
JAMB - METAL SUBSTRATE



171 JET SERVICES WAY
DOTHAN, AL 36303
PH: (855) 611-8889
EMAIL: INFO@SHWINCO.COM

TITLE:
9000 SERIES ALUMINUM MULLION
(WZ3)(IMPACT)

INSTALLATION DETAILS

PREPARED BY:
BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	DB	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:
FL29827

DATE: **03.14.2019**


DWG. BY: **SM** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **SWD049**

SHEET: **2** REV. **A**

c:\users\danielbuitrago\building drops, inc\building drops landing - common\projects\2026 code change projects\shwinco architectural products\cc-26-0209.1 - 2026 code change\dwgs\9000 mullion\swd049 - a.dwg
7/9/2026 4:15 PM

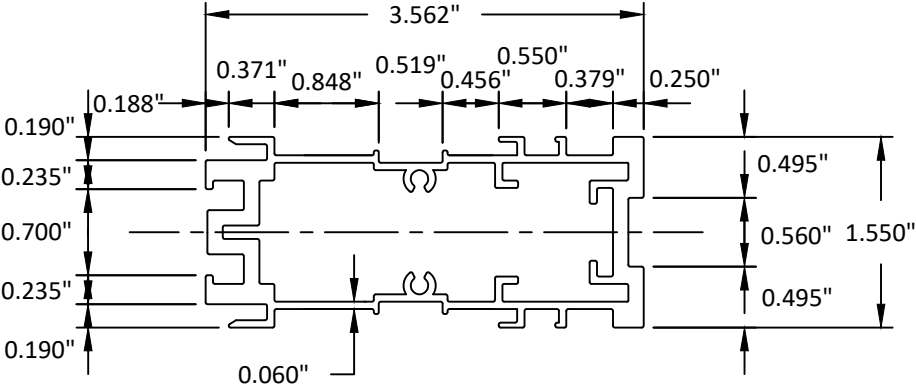


9000 SERIES MULLION
6005-T5

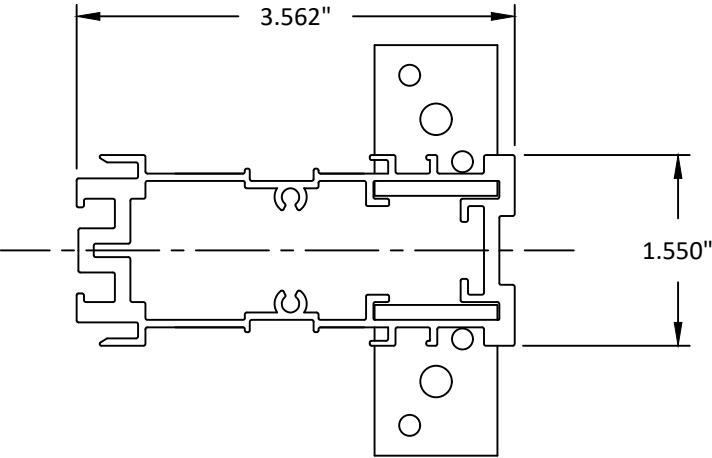

A
3 **SECTION**
ASSEMBLED MULLION AND CLIP
VERTICAL AND/OR HORIZONTAL ORIENTATION


INSTALLATION NOTES:

- FOR INSTALLATION TO WOOD, STEEL, OR ALUMINUM, USE TWO (2) #8 DIAMETER SCREWS PER CLIP, THROUGH OUTER HOLES WITH 0.170" DIAMETER.
- FOR INSTALLATION TO CONCRETE, USE ONE (1) 1/4" ELCO ULTRACON PER CLIP, THROUGH CENTER HOLE WITH 0.255" DIAMETER.
- FOR INSTALLATION TO CMU, USE ONE (1) 1/4" ELCO AGGRE-GATOR PER CLIP, THROUGH CENTER HOLE WITH 0.255" DIAMETER.
- WINDOW FRAMES SHALL BE ATTACHED TO MULLION USING MINIMUM #8FH X 1-1/4" SCREWS AT MAXIMUM 3" FROM CORNERS AND 8" O.C.
- FASTENERS USED WITHIN 3000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).
- CONNECTORS AND METAL PLATES USED WITHIN 3000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).

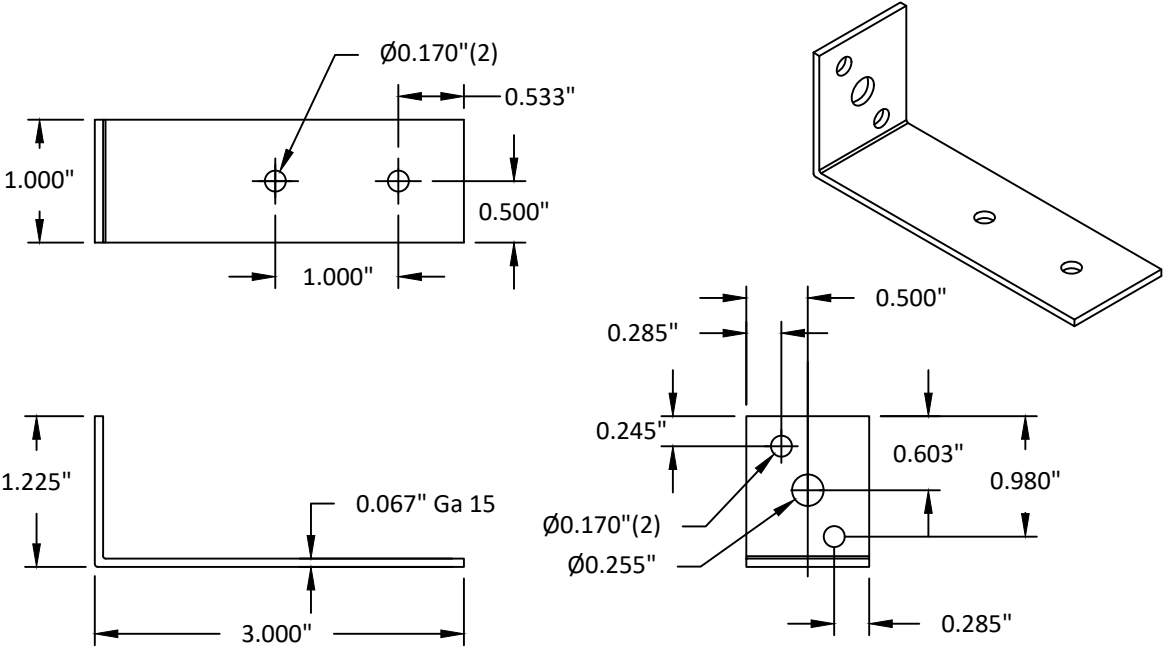

ANCHOR CLIP
304 STAINLESS STEEL

FOLLOW INSTALLATION
NOTES REQUIREMENTS

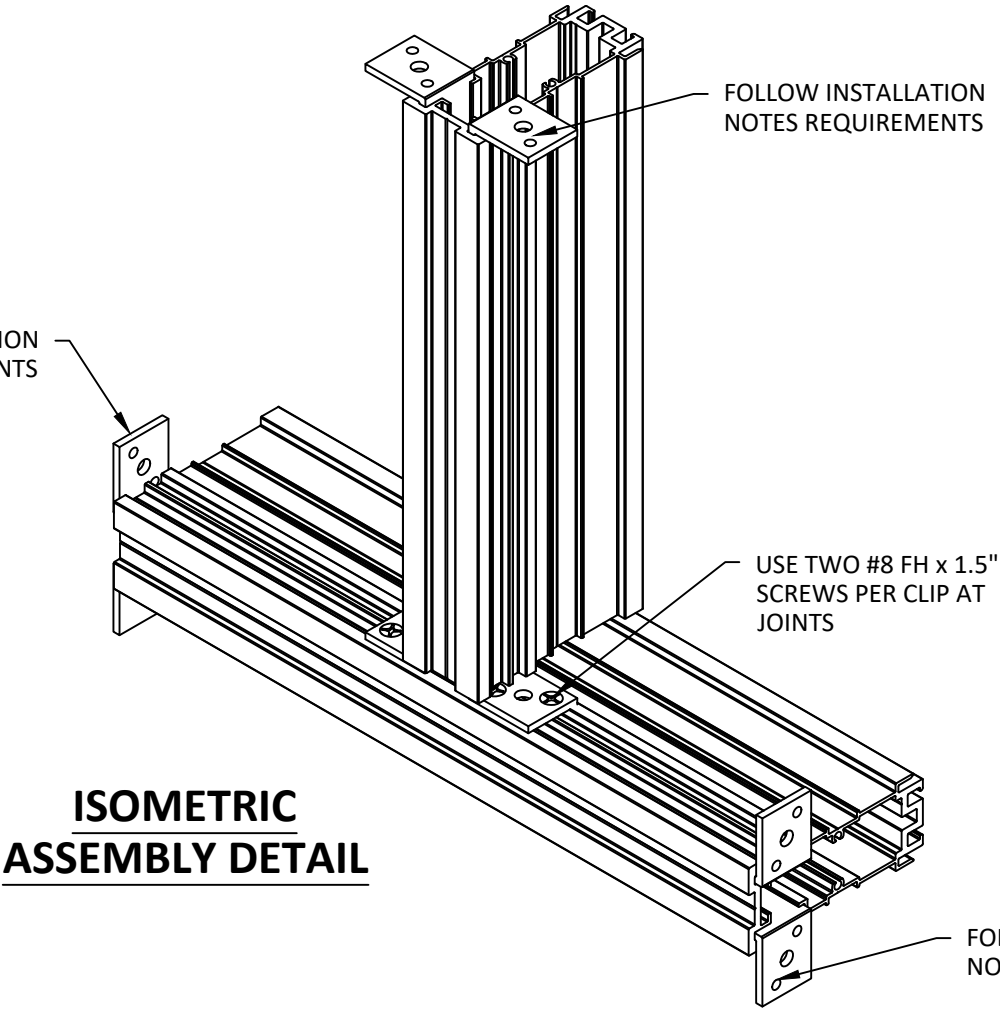

ISOMETRIC
ASSEMBLY DETAIL

FOLLOW INSTALLATION
NOTES REQUIREMENTS

USE TWO #8 FH x 1.5"
SCREWS PER CLIP AT
JOINTS

FOLLOW INSTALLATION
NOTES REQUIREMENTS



171 JET SERVICES WAY
DOTHAN, AL 36303
PH: (855) 611-8889
EMAIL: INFO@SHWINCO.COM

TITLE:
9000 SERIES ALUMINUM MULLION
(WZ3)(IMPACT)

MULLION AND CLIP DETAILS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15

MIAMI, FL 33132

PH: (954) 399-8478


FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	DB	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

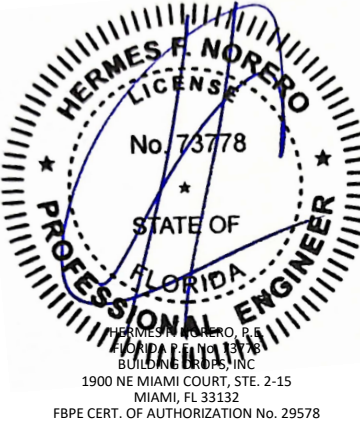

FL #:	FL29827
DATE:	03.14.2019
DWG. BY:	CHK. BY:
SM	HFN
SCALE:	NTS
DWG. #:	SWD049
SHEET:	REV.
3	A
OF 8	

c:\Users\danielbuitrago\building drops, inc\building drops landing - common\projects\2026 code change projects\shwinco architectural products\cc-26-0209.1 - 2026 code change\dwgs\1729827 - series 9000 mullion\swd049 - a.dwg 7/9/2026 4:15 PM

MAXIMUM DESIGN PRESSURE CAPACITY CHART (PSF): 9000 SERIES MULLION - ONE WAY - INSTALLATION TO WOOD, STEEL, ALUMINUM OR CONCRETE																							
L - MULL LENGTH (IN)	W - TRIBUTARY WIDTH (IN)																						
	30.0	33.0	36.0	39.0	42.0	45.0	48.0	51.0	54.0	57.0	60.0	63.0	66.625	69.0	72.0	75.0	78.0	81.0	84.0	87.0	90.0	93.0	96.0
48.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0
51.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0
54.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0
57.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0
60.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0
63.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0
66.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0
69.0	100.0	100.0	100.0	100.0	100.0	100.0	99.9	96.4	93.6	91.4	89.7	88.5	87.7	87.5	87.5	87.5	87.5	87.5	87.5	87.5	87.5	87.5	87.5
72.0	100.0	100.0	100.0	100.0	99.2	94.4	90.3	87.0	84.2	81.9	80.1	78.8	77.7	77.2	77.0	77.0	77.0	77.0	77.0	77.0	77.0	77.0	77.0
75.0	100.0	100.0	100.0	96.0	90.5	86.0	82.1	78.9	76.2	74.0	72.2	70.7	69.4	68.8	68.3	68.1	68.1	68.1	68.1	68.1	68.1	68.1	68.1
78.0	100.0	100.0	94.1	88.1	83.0	78.7	75.0	72.0	69.4	67.2	65.4	63.9	62.5	61.8	61.1	60.7	60.6	60.6	60.6	60.6	60.6	60.6	60.6
81.0	100.0	93.7	86.8	81.1	76.3	72.3	68.9	65.9	63.5	61.3	59.5	58.0	56.6	55.8	55.1	54.5	54.2	54.1	54.1	54.1	54.1	54.1	54.1
84.0	94.5	86.7	80.3	75.0	70.5	66.7	63.5	60.7	58.3	56.2	54.5	53.0	51.6	50.8	49.9	49.3	48.9	48.6	48.5	48.5	48.5	48.5	48.5
87.0	87.9	80.6	74.6	69.6	65.3	61.7	58.7	56.0	53.8	51.8	50.1	48.7	47.2	46.4	45.6	44.9	44.3	44.0	43.7	43.6	43.6	43.6	43.6
90.0	81.9	75.0	69.4	64.7	60.7	57.3	54.4	51.9	49.8	47.9	46.3	44.9	43.4	42.6	41.8	41.0	40.5	40.0	39.7	39.5	39.4	39.4	39.4
93.0	76.5	70.1	64.8	60.3	56.6	53.4	50.6	48.3	46.2	44.4	42.8	41.5	40.1	39.3	38.4	37.7	37.1	36.6	36.2	36.0	35.8	35.7	35.7
96.0	71.6	65.6	60.6	56.4	52.9	49.8	47.2	45.0	43.0	41.3	39.8	38.5	37.2	36.4	35.5	34.8	34.2	33.7	33.2	32.9	32.7	32.5	32.5
97.92	68.8	62.9	58.1	54.1	50.7	47.8	45.2	43.1	41.2	39.5	38.0	36.8	35.4	34.7	33.8	33.1	32.5	32.0	31.5	31.2	30.9	30.7	30.6
99.0	67.2	61.5	56.8	52.9	49.5	46.6	44.2	42.0	40.2	38.5	37.1	35.9	34.5	33.8	32.9	32.2	31.6	31.1	30.6	30.3	30.0	29.8	29.7
102.0	63.2	57.8	53.4	49.6	46.5	43.8	41.4	39.4	37.6	36.0	34.7	33.5	32.2	31.5	30.7	29.9	29.3	28.8	28.3	27.9	27.6	27.4	27.2
105.0	59.6	54.5	50.3	46.7	43.7	41.1	38.9	37.0	35.3	33.8	32.5	31.3	30.1	29.4	28.6	27.9	27.3	26.8	26.3	25.9	25.6	25.3	25.1
108.0	56.2	51.4	47.4	44.0	41.2	38.7	36.6	34.8	33.2	31.8	30.5	29.4	28.2	27.5	26.8	26.1	25.5	25.0	24.5	24.1	23.7	23.5	23.2
111.0	52.1	47.7	44.0	40.9	38.3	36.1	34.1	32.4	31.0	29.7	28.5	27.5	26.4	25.8	25.1	24.4	23.9	23.3	22.9	22.5	22.1	21.8	21.6
114.0	48.0	43.9	40.5	37.7	35.2	33.2	31.4	29.8	28.4	27.2	26.2	25.2	24.2	23.6	23.0	22.4	21.8	21.4	21.0	20.6	20.3	20.0	19.8
117.0	44.3	40.5	37.4	34.8	32.5	30.6	28.9	27.5	26.2	25.1	24.1	23.2	22.2	21.7	21.1	20.5	20.0	19.6	19.2	18.8	18.5	18.3	18.0
120.0	41.0	37.5	34.6	32.1	30.1	28.3	26.7	25.4	24.2	23.1	22.2	21.3	20.5	19.9	19.4	18.8	18.4	17.9	17.6	17.2	16.9	16.7	16.4

TABLE NOTES:

1. SEE SHEET 1 FOR INSTRUCTIONS ON USING TABLES. SEE SHEETS 2 AND 3 FOR TYPICAL INSTALLATION METHODS & CLIP DETAILS.
2. FOR DIMENSIONS INTERMEDIATE ON THE VALUES SHOWN IN THE TABLES REFER TO THE LARGER VALUE.
3. ANCHOR AND SUBSTRATE REQUIREMENTS:

• WOOD: #8 WOOD SCREWS


• WOOD ANCHORS SHALL HAVE A MIN. EMBEDMENT OF 1.5" & EDGE DISTANCE OF 0.75". WOOD SHALL BE MIN. S.G.=0.55.

• CONCRETE: 1/4" ELCO ULTRACON

• CONCRETE ANCHORS SHALL HAVE A MIN. EMBEDMENT OF 1.75" & EDGE DISTANCE OF 2.5". CONCRETE SHALL BE MIN. 3000 PSI.

• METAL: #8 SELF-DRILLING SCREWS (GRADE 5)

• METAL ANCHORS SHALL HAVE A MIN. (.3) THREADS PENETRATION BEYOND METAL STRUCTURE. STEEL SHALL BE MIN. 18 GA. (0.045" THICK) 33 KSI YIELD & ALUMINUM SHALL BE MIN. 0.090" THICK ALUMINUM 6063-T5. WITH MIN. EDGE DISTANCE OF 0.75" FOR BOTH ALUM. AND STEEL.
4. READ WINDOW WIDTH AND MULL SPAN IN INCHES. DESIGN PRESSURE VALUES ON THIS CHART ARE POSITIVE AND NEGATIVE PSF.
5. CHART IS NOT LIMITED TO TWO WINDOW UNITS IN A SINGLE OPENING, DESIGN LOAD CAPACITIES APPLY TO ANY NUMBER OF WINDOW UNITS OF SIZES LISTED ON CHART IN A SINGLE OPENING.
6. ALLOWABLE PRESSURES & SIZES ON MULLED ASSEMBLIES SHALL BE LIMITED TO THE LESSER DESIGN PRESSURE AND SIZES OF THE APPROVED MULLION AND INDIVIDUAL UNIT INSTALLATION.
7. WHEN ADJACENT WINDOWS DO NOT USE SILL ANCHORS TWO WAY DESIGN PRESSURES MUST BE USED.

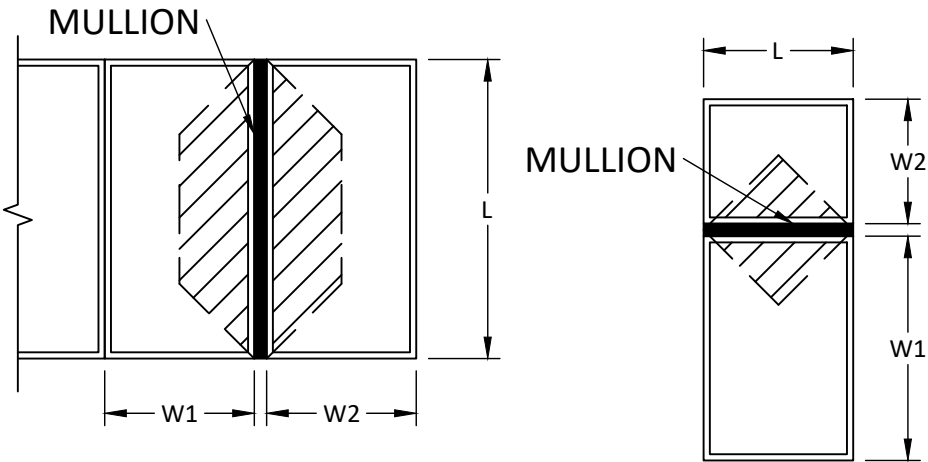

ONE-WAY MULLION DIAGRAMS

TRIBUTARY WIDTH = $\frac{W1+W2}{2}$



171 JET SERVICES WAY
DOTHAN, AL 36303
PH: (855) 611-8889
EMAIL: INFO@SHWINCO.COM

TITLE:
9000 SERIES ALUMINUM MULLION
(WZ3)(IMPACT)

ONE WAY DESIGN PRESSURE TABLE
WOOD, STEEL, ALUM., CONC.

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15

MIAMI, FL 33132

PH: (954) 399-8478


FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	DB	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

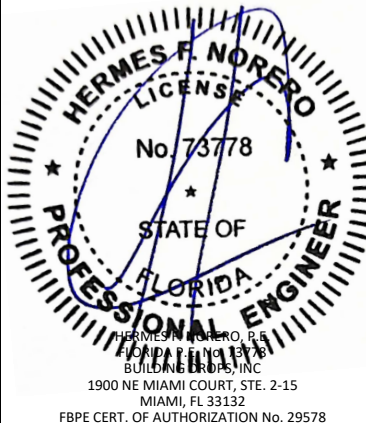

FL #:	FL29827	
DATE:	03.14.2019	
DWG. BY:	SM	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	SWD049	
SHEET:	4	REV. A
OF 8		

171 JET SERVICES WAY
DOTHAN, AL 36303
PH: (855) 611-8889
EMAIL: INFO@SHWINCO.COM



REMARKS	BY	DATE
2026 FBC UPDATE	DB	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.




FL #:		FL29827	
DATE:		03.14.2019	
DWG. BY:	SM	CHK. BY:	HFN
SCALE:		NTS	
DWG. #:		SWD049	
SHEET:	5	REV.	A
		OF 8	

MAXIMUM DESIGN PRESSURE CAPACITY CHART (PSF): 9000 SERIES MULLION - ONE WAY - INSTALLATION TO CMU

L - MULL LENGTH (IN)	W - TRIBUTARY WIDTH (IN)																						
	30.0	33.0	36.0	39.0	42.0	45.0	48.0	51.0	54.0	57.0	60.0	63.0	66.625	69.0	72.0	75.0	78.0	81.0	84.0	87.0	90.0	93.0	96.0
48.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0
51.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0
54.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	99.1	98.8	98.8	98.8	98.8	98.8	98.8	98.8	98.8	98.8	98.8	98.8	98.8	98.8	98.8	98.8
57.0	100.0	100.0	100.0	98.5	95.2	92.8	90.9	89.6	88.9	88.6	88.6	88.6	88.6	88.6	88.6	88.6	88.6	88.6	88.6	88.6	88.6	88.6	88.6
60.0	100.0	100.0	95.2	91.2	87.9	85.3	83.3	81.8	80.8	80.2	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
63.0	100.0	93.8	88.9	84.9	81.6	79.0	76.9	75.3	74.1	73.2	72.7	72.6	72.6	72.6	72.6	72.6	72.6	72.6	72.6	72.6	72.6	72.6	72.6
66.0	94.1	88.2	83.3	79.4	76.2	73.6	71.4	69.7	68.4	67.4	66.7	66.3	66.1	66.1	66.1	66.1	66.1	66.1	66.1	66.1	66.1	66.1	66.1
69.0	88.9	83.1	78.4	74.6	71.4	68.8	66.7	64.9	63.5	62.4	61.5	61.0	60.6	60.5	60.5	60.5	60.5	60.5	60.5	60.5	60.5	60.5	60.5
72.0	84.2	78.6	74.1	70.3	67.2	64.6	62.5	60.7	59.3	58.1	57.1	56.4	55.9	55.7	55.6	55.6	55.6	55.6	55.6	55.6	55.6	55.6	55.6
75.0	80.0	74.6	70.2	66.5	63.5	61.0	58.8	57.0	55.6	54.3	53.3	52.5	51.8	51.5	51.3	51.2	51.2	51.2	51.2	51.2	51.2	51.2	51.2
78.0	76.2	71.0	66.7	63.1	60.2	57.7	55.6	53.8	52.3	51.0	50.0	49.2	48.4	48.0	47.6	47.4	47.3	47.3	47.3	47.3	47.3	47.3	47.3
81.0	72.7	67.7	63.5	60.0	57.1	54.7	52.6	50.9	49.4	48.1	47.1	46.2	45.3	44.9	44.4	44.1	44.0	43.9	43.9	43.9	43.9	43.9	43.9
84.0	69.6	64.6	60.6	57.2	54.4	52.0	50.0	48.3	46.8	45.5	44.4	43.5	42.6	42.2	41.7	41.3	41.0	40.9	40.8	40.8	40.8	40.8	40.8
87.0	66.7	61.9	58.0	54.7	51.9	49.6	47.6	45.9	44.4	43.2	42.1	41.2	40.3	39.8	39.2	38.8	38.5	38.2	38.1	38.0	38.0	38.0	38.0
90.0	64.0	59.4	55.6	52.4	49.7	47.4	45.5	43.8	42.3	41.1	40.0	39.1	38.1	37.6	37.0	36.6	36.2	35.9	35.7	35.6	35.6	35.6	35.6
93.0	61.5	57.0	53.3	50.2	47.6	45.4	43.5	41.8	40.4	39.2	38.1	37.2	36.2	35.7	35.1	34.6	34.2	33.9	33.6	33.4	33.3	33.3	33.3
96.0	59.3	54.9	51.3	48.3	45.7	43.5	41.7	40.1	38.6	37.4	36.4	35.4	34.5	33.9	33.3	32.8	32.4	32.0	31.7	31.5	31.4	31.3	31.3
97.92	57.9	53.6	50.1	47.1	44.6	42.4	40.6	39.0	37.6	36.4	35.3	34.4	33.5	32.9	32.3	31.8	31.3	31.0	30.7	30.4	30.2	30.1	30.0
99.0	57.1	52.9	49.4	46.4	44.0	41.8	40.0	38.4	37.0	35.8	34.8	33.9	32.9	32.4	31.7	31.2	30.8	30.4	30.1	29.8	29.6	29.5	29.4
102.0	55.2	51.0	47.6	44.8	42.3	40.3	38.5	36.9	35.6	34.4	33.3	32.4	31.5	30.9	30.3	29.8	29.3	28.8	28.3	27.9	27.6	27.4	27.2
105.0	53.3	49.3	46.0	43.2	40.8	38.8	37.0	35.5	34.2	33.0	32.0	31.1	30.1	29.4	28.6	27.9	27.3	26.8	26.3	25.9	25.6	25.3	25.1
108.0	51.6	47.7	44.4	41.7	39.4	37.4	35.7	34.2	32.9	31.8	30.5	29.4	28.2	27.5	26.8	26.1	25.5	25.0	24.5	24.1	23.7	23.5	23.2
111.0	50.0	46.2	43.0	40.4	38.1	36.1	34.1	32.4	31.0	29.7	28.5	27.5	26.4	25.8	25.1	24.4	23.9	23.3	22.9	22.5	22.1	21.8	21.6
114.0	48.0	43.9	40.5	37.7	35.2	33.2	31.4	29.8	28.4	27.2	26.2	25.2	24.2	23.6	23.0	22.4	21.8	21.4	21.0	20.6	20.3	20.0	19.8
117.0	44.3	40.5	37.4	34.8	32.5	30.6	28.9	27.5	26.2	25.1	24.1	23.2	22.2	21.7	21.1	20.5	20.0	19.6	19.2	18.8	18.5	18.3	18.0
120.0	41.0	37.5	34.6	32.1	30.1	28.3	26.7	25.4	24.2	23.1	22.2	21.3	20.5	19.9	19.4	18.8	18.4	17.9	17.6	17.2	16.9	16.7	16.4

TABLE NOTES:

1. SEE SHEET 1 FOR INSTRUCTIONS ON USING TABLES. SEE SHEETS 2 AND 3 FOR TYPICAL INSTALLATION METHODS & CLIP DETAILS.
2. FOR DIMENSIONS INTERMEDIATE ON THE VALUES SHOWN IN THE TABLES REFER TO THE LARGER VALUE.
3. ANCHOR AND SUBSTRATE REQUIREMENTS:
 - CMU: 1/4" ELCO AGGRE-GATOR
 - CMU ANCHORS SHALL HAVE A MIN. EMBEDMENT OF 2" & EDGE DISTANCE OF 2.5". GROUT FILLED CMU SHALL BE MEDIUM WEIGHT CONFORMING TO ASTM C 90.
4. READ WINDOW WIDTH AND MULL SPAN IN INCHES. DESIGN PRESSURE VALUES ON THIS CHART ARE POSITIVE AND NEGATIVE PSF.
5. CHART IS NOT LIMITED TO TWO WINDOW UNITS IN A SINGLE OPENING, DESIGN LOAD CAPACITIES APPLY TO ANY NUMBER OF WINDOW UNITS OF SIZES LISTED ON CHART IN A SINGLE OPENING.
6. ALLOWABLE PRESSURES & SIZES ON MULLED ASSEMBLIES SHALL BE LIMITED TO THE LESSER DESIGN PRESSURE AND SIZES OF THE APPROVED MULLION AND INDIVIDUAL UNIT INSTALLATION.
7. WHEN ADJACENT WINDOWS DO NOT USE SILL ANCHORS TWO WAY DESIGN PRESSURES MUST BE USED.

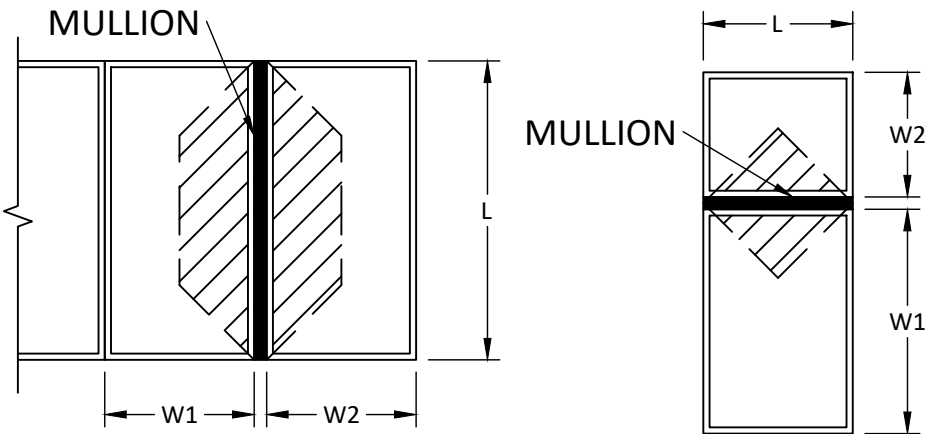

ONE-WAY MULLION DIAGRAMS

$$\text{TRIBUTARY WIDTH} = \frac{W1+W2}{2}$$

c:\users\daniel\trago\building drops, inc\building drops landing - common\projects\2026 code change projects\shwinco architectural products\cc-26-0209.1 - 2026 code change\dwg\1729827 - series 9000 mullion\swd049 - a.dwg 7/9/2026 4:15 PM

MAXIMUM DESIGN PRESSURE CAPACITY CHART (PSF): 9000 SERIES MULLION - TWO WAY - INSTALLATION TO WOOD, STEEL, ALUMINUM OR CONCRETE																							
L - MULL LENGTH (IN)	W - TRIBUTARY WIDTH (IN)																						
	30.0	33.0	36.0	39.0	42.0	45.0	48.0	51.0	54.0	57.0	60.0	63.0	66.625	69.0	72.0	75.0	78.0	81.0	84.0	87.0	90.0	93.0	96.0
48.0	100.0	100.0	100.0	100.0	97.2	90.8	85.1	80.1	75.6	71.6	68.1	64.8	61.3	59.2	56.7	54.5	52.4	50.4	48.6	46.9	45.4	43.9	42.5
51.0	100.0	100.0	100.0	98.6	91.5	85.4	80.1	75.4	71.2	67.4	64.1	61.0	57.7	55.7	53.4	51.2	49.3	47.5	45.8	44.2	42.7	41.3	40.0
54.0	100.0	100.0	100.0	93.1	86.4	80.7	75.6	71.2	67.2	63.7	60.5	57.6	54.5	52.6	50.4	48.4	46.5	44.8	43.2	41.7	40.3	39.0	37.8
57.0	100.0	100.0	95.5	88.2	81.9	76.4	71.6	67.4	63.7	60.3	57.3	54.6	51.6	49.8	47.8	45.9	44.1	42.5	40.9	39.5	38.2	37.0	35.8
60.0	100.0	99.0	90.8	83.8	77.8	72.6	68.1	64.1	60.5	57.3	54.5	51.9	49.0	47.3	45.4	43.6	41.9	40.3	38.9	37.6	36.3	35.1	34.0
63.0	100.0	94.3	86.4	79.8	74.1	69.1	64.8	61.0	57.6	54.6	51.9	49.4	46.7	45.1	43.2	41.5	39.9	38.4	37.0	35.8	34.6	33.5	32.4
66.0	99.0	90.0	82.5	76.2	70.7	66.0	61.9	58.2	55.0	52.1	49.5	47.1	44.6	43.0	41.3	39.6	38.1	36.7	35.4	34.1	33.0	31.9	30.9
69.0	94.7	86.1	78.9	72.8	67.6	63.1	59.2	55.7	52.6	49.8	47.3	45.1	42.6	41.2	39.5	37.9	36.4	35.1	33.8	32.7	31.6	30.5	29.6
72.0	90.8	82.5	75.6	69.8	64.8	60.5	56.7	53.4	50.4	47.8	45.4	43.2	40.9	39.5	37.8	36.3	34.9	33.6	32.4	31.3	30.3	29.3	28.4
75.0	87.1	79.2	72.6	67.0	62.2	58.1	54.5	51.2	48.4	45.9	43.6	41.5	39.2	37.9	36.3	34.8	33.5	32.3	31.1	30.0	29.0	28.1	27.2
78.0	83.8	76.2	69.8	64.4	59.8	55.8	52.4	49.3	46.5	44.1	41.9	39.9	37.7	36.4	34.9	33.5	32.2	31.0	29.9	28.9	27.9	27.0	26.2
81.0	80.7	73.3	67.2	62.1	57.6	53.8	50.4	47.5	44.8	42.5	40.3	38.4	36.3	35.1	33.6	32.3	31.0	29.9	28.8	27.8	26.9	26.0	25.2
84.0	77.8	70.7	64.8	59.8	55.6	51.9	48.6	45.8	43.2	40.9	38.9	37.0	35.0	33.8	32.4	31.1	29.9	28.8	27.8	26.8	25.9	25.1	24.3
87.0	75.1	68.3	62.6	57.8	53.6	50.1	46.9	44.2	41.7	39.5	37.6	35.8	33.8	32.7	31.3	30.0	28.9	27.8	26.8	25.9	25.0	24.2	23.5
90.0	72.6	66.0	60.5	55.8	51.9	48.4	45.4	42.7	40.3	38.2	36.3	34.6	32.7	31.6	30.3	29.0	27.9	26.9	25.9	25.0	24.2	23.4	22.7
93.0	70.3	63.9	58.5	54.0	50.2	46.8	43.9	41.3	39.0	37.0	35.1	33.5	31.6	30.5	29.3	28.1	27.0	26.0	25.1	24.2	23.4	22.7	22.0
96.0	68.1	61.9	56.7	52.4	48.6	45.4	42.5	40.0	37.8	35.8	34.0	32.4	30.6	29.6	28.4	27.2	26.2	25.2	24.3	23.5	22.7	22.0	21.3
97.92	66.6	60.6	55.5	51.2	47.6	44.4	41.6	39.2	37.0	35.1	33.3	31.7	30.0	29.0	27.8	26.6	25.6	24.7	23.8	23.0	22.2	21.5	20.8
99.0	64.5	58.6	53.7	49.6	46.0	43.0	40.3	37.9	35.8	33.9	32.2	30.7	29.0	28.0	26.9	25.8	24.8	23.9	23.0	22.2	21.5	20.8	20.1
102.0	58.9	53.6	49.1	45.3	42.1	39.3	36.8	34.7	32.7	31.0	29.5	28.1	26.5	25.6	24.6	23.6	22.7	21.8	21.1	20.3	19.6	19.0	18.4
105.0	54.0	49.1	45.0	41.6	38.6	36.0	33.8	31.8	30.0	28.4	27.0	25.7	24.3	23.5	22.5	21.6	20.8	20.0	19.3	18.6	18.0	17.4	16.9
108.0	49.7	45.1	41.4	38.2	35.5	33.1	31.0	29.2	27.6	26.1	24.8	23.6	22.4	21.6	20.7	19.9	19.1	18.4	17.7	17.1	16.6	16.0	15.5
111.0	45.7	41.6	38.1	35.2	32.7	30.5	28.6	26.9	25.4	24.1	22.9	21.8	20.6	19.9	19.1	18.3	17.6	16.9	16.3	15.8	15.2	14.8	14.3
114.0	42.2	38.4	35.2	32.5	30.2	28.1	26.4	24.8	23.5	22.2	21.1	20.1	19.0	18.4	17.6	16.9	16.2	15.6	15.1	14.6	14.1	13.6	13.2
117.0	39.1	35.5	32.5	30.0	27.9	26.0	24.4	23.0	21.7	20.6	19.5	18.6	17.6	17.0	16.3	15.6	15.0	14.5	13.9	13.5	13.0	12.6	12.2
120.0	36.2	32.9	30.2	27.8	25.9	24.1	22.6	21.3	20.1	19.1	18.1	17.2	16.3	15.7	15.1	14.5	13.9	13.4	12.9	12.5	12.1	11.7	11.3

TABLE NOTES:

1. SEE SHEET 1 FOR INSTRUCTIONS ON USING TABLES. SEE SHEETS 2 AND 3 FOR TYPICAL INSTALLATION METHODS & CLIP DETAILS.
2. FOR DIMENSIONS INTERMEDIATE ON THE VALUES SHOWN IN THE TABLES REFER TO THE LARGER VALUE.
3. ANCHOR AND SUBSTRATE REQUIREMENTS:

• WOOD: #8 WOOD SCREWS

• WOOD ANCHORS SHALL HAVE A MIN. EMBEDMENT OF 1.5" & EDGE DISTANCE OF 0.75". WOOD SHALL BE MIN. S.G.=0.55.


• CONCRETE: 1/4" ELCO ULTRACON

• CONCRETE ANCHORS SHALL HAVE A MIN. EMBEDMENT OF 1.75" & EDGE DISTANCE OF 2.5". CONCRETE SHALL BE MIN. 3000 PSI.

• METAL: #8 SELF-DRILLING SCREWS (GRADE 5)

• METAL ANCHORS SHALL HAVE A MIN. (3) THREADS PENETRATION BEYOND METAL STRUCTURE. STEEL SHALL BE MIN. 18 GA. (0.045" THICK) 33 KSI YIELD & ALUMINUM SHALL BE MIN. 0.090" THICK ALUMINUM 6063-T5. WITH MIN. EDGE DISTANCE OF 0.75" FOR BOTH ALUM. AND STEEL.

• FOR T AND X JOINTS, REFER TO SHEET 3 FOR ASSEMBLY REQUIREMENTS.
4. READ WINDOW WIDTH AND MULL SPAN IN INCHES. DESIGN PRESSURE VALUES ON THIS CHART ARE POSITIVE AND NEGATIVE PSF.
5. CHART IS NOT LIMITED TO TWO WINDOW UNITS IN A SINGLE OPENING, DESIGN LOAD CAPACITIES APPLY TO ANY NUMBER OF WINDOW UNITS OF SIZES LISTED ON CHART IN A SINGLE OPENING.
6. ALLOWABLE PRESSURES & SIZES ON MULLED ASSEMBLIES SHALL BE LIMITED TO THE LESSER DESIGN PRESSURE AND SIZES OF THE APPROVED MULLION AND INDIVIDUAL UNIT INSTALLATION.
7. DESIGN PRESSURES SHOWN IN TABLE ARE APPLICABLE TO THE CONTINUOUS MULLION SHOWN AS A SOLID LINE IN THE DIAGRAMS TO THE RIGHT. MULLIONS SHOWN AS DASHED LINES IN DIAGRAMS AT RIGHT SHALL BE REVIEWED AND RATED USING ONE WAY LOAD DISTRIBUTION TABLES.
8. WHEN ADJACENT WINDOWS DO NOT USE SILL ANCHORS TWO WAY DESIGN PRESSURES MUST BE USED.

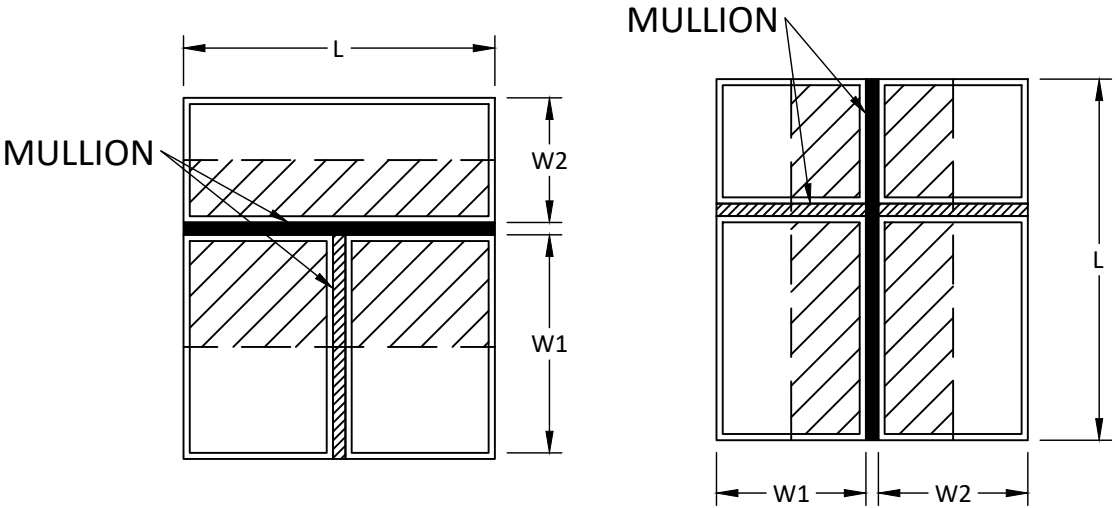

TWO-WAY MULLION DIAGRAMS

TRIBUTARY WIDTH = $\frac{W1+W2}{2}$



171 JET SERVICES WAY
DOTHAN, AL 36303
PH: (855) 611-8889
EMAIL: INFO@SHWINCO.COM

TITLE:
9000 SERIES ALUMINUM MULLION
(WZ3)(IMPACT)

TWO WAY DESIGN PRESSURE TABLE
WOOD, STEEL, ALUM., CONC.

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15

MIAMI, FL 33132

PH: (954) 399-8478

FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	DB	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:
FL29827

DATE: **03.14.2019**

DWG. BY: **SM**CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **SWD049**

SHEET: **6**REV. **A**

OF 8

c:\users\danielbuitrago\building drops, inc\building drops landing - common\projects\2026 code change projects\shwinco architectural products\cc-2026\0209.1 - 2026 code change\dwgs\129827 - series 9000 mullion\swd049 - a.dwg 7/9/2026 4:15 PM


MAXIMUM DESIGN PRESSURE CAPACITY CHART (PSF): 9000 SERIES MULLION - TWO WAY - INSTALLATION TO CMU																							
L - MULL LENGTH (IN)	W - TRIBUTARY WIDTH (IN)																						
	30.0	33.0	36.0	39.0	42.0	45.0	48.0	51.0	54.0	57.0	60.0	63.0	66.625	69.0	72.0	75.0	78.0	81.0	84.0	87.0	90.0	93.0	96.0
48.0	100.0	100.0	99.4	91.7	85.2	79.5	74.5	70.1	66.3	62.8	59.6	56.8	53.7	51.8	49.7	47.7	45.9	44.2	42.6	41.1	39.8	38.5	37.3
51.0	100.0	100.0	93.5	86.3	80.2	74.8	70.1	66.0	62.4	59.1	56.1	53.4	50.5	48.8	46.8	44.9	43.2	41.6	40.1	38.7	37.4	36.2	35.1
54.0	100.0	96.4	88.3	81.5	75.7	70.7	66.3	62.4	58.9	55.8	53.0	50.5	47.7	46.1	44.2	42.4	40.8	39.3	37.9	36.6	35.3	34.2	33.1
57.0	100.0	91.3	83.7	77.2	71.7	66.9	62.8	59.1	55.8	52.9	50.2	47.8	45.2	43.7	41.8	40.2	38.6	37.2	35.9	34.6	33.5	32.4	31.4
60.0	95.4	86.7	79.5	73.4	68.1	63.6	59.6	56.1	53.0	50.2	47.7	45.4	43.0	41.5	39.8	38.2	36.7	35.3	34.1	32.9	31.8	30.8	29.8
63.0	90.9	82.6	75.7	69.9	64.9	60.6	56.8	53.4	50.5	47.8	45.4	43.3	40.9	39.5	37.9	36.3	34.9	33.7	32.4	31.3	30.3	29.3	28.4
66.0	86.7	78.8	72.3	66.7	61.9	57.8	54.2	51.0	48.2	45.6	43.4	41.3	39.1	37.7	36.1	34.7	33.4	32.1	31.0	29.9	28.9	28.0	27.1
69.0	83.0	75.4	69.1	63.8	59.3	55.3	51.8	48.8	46.1	43.7	41.5	39.5	37.4	36.1	34.6	33.2	31.9	30.7	29.6	28.6	27.7	26.8	25.9
72.0	79.5	72.3	66.3	61.2	56.8	53.0	49.7	46.8	44.2	41.8	39.8	37.9	35.8	34.6	33.1	31.8	30.6	29.4	28.4	27.4	26.5	25.6	24.8
75.0	76.3	69.4	63.6	58.7	54.5	50.9	47.7	44.9	42.4	40.2	38.2	36.3	34.4	33.2	31.8	30.5	29.4	28.3	27.3	26.3	25.4	24.6	23.9
78.0	73.4	66.7	61.2	56.4	52.4	48.9	45.9	43.2	40.8	38.6	36.7	34.9	33.0	31.9	30.6	29.4	28.2	27.2	26.2	25.3	24.5	23.7	22.9
81.0	70.7	64.2	58.9	54.4	50.5	47.1	44.2	41.6	39.3	37.2	35.3	33.7	31.8	30.7	29.4	28.3	27.2	26.2	25.2	24.4	23.6	22.8	22.1
84.0	68.1	61.9	56.8	52.4	48.7	45.4	42.6	40.1	37.9	35.9	34.1	32.4	30.7	29.6	28.4	27.3	26.2	25.2	24.3	23.5	22.7	22.0	21.3
87.0	65.8	59.8	54.8	50.6	47.0	43.9	41.1	38.7	36.6	34.6	32.9	31.3	29.6	28.6	27.4	26.3	25.3	24.4	23.5	22.7	21.9	21.2	20.6
90.0	63.6	57.8	53.0	48.9	45.4	42.4	39.8	37.4	35.3	33.5	31.8	30.3	28.6	27.7	26.5	25.4	24.5	23.6	22.7	21.9	21.2	20.5	19.9
93.0	61.5	56.0	51.3	47.3	44.0	41.0	38.5	36.2	34.2	32.4	30.8	29.3	27.7	26.8	25.6	24.6	23.7	22.8	22.0	21.2	20.5	19.9	19.2
96.0	59.6	54.2	49.7	45.9	42.6	39.8	37.3	35.1	33.1	31.4	29.8	28.4	26.8	25.9	24.8	23.9	22.9	22.1	21.3	20.6	19.9	19.2	18.6
97.92	58.5	53.1	48.7	45.0	41.8	39.0	36.5	34.4	32.5	30.8	29.2	27.8	26.3	25.4	24.4	23.4	22.5	21.7	20.9	20.2	19.5	18.9	18.3
99.0	57.8	52.6	48.2	44.5	41.3	38.5	36.1	34.0	32.1	30.4	28.9	27.5	26.0	25.1	24.1	23.1	22.2	21.4	20.6	19.9	19.3	18.7	18.1
102.0	56.1	51.0	46.8	43.2	40.1	37.4	35.1	33.0	31.2	29.5	28.1	26.7	25.3	24.4	23.4	22.4	21.6	20.8	20.0	19.4	18.7	18.1	17.5
105.0	54.0	49.1	45.0	41.6	38.6	36.0	33.8	31.8	30.0	28.4	27.0	25.7	24.3	23.5	22.5	21.6	20.8	20.0	19.3	18.6	18.0	17.4	16.9
108.0	49.7	45.1	41.4	38.2	35.5	33.1	31.0	29.2	27.6	26.1	24.8	23.6	22.4	21.6	20.7	19.9	19.1	18.4	17.7	17.1	16.6	16.0	15.5
111.0	45.7	41.6	38.1	35.2	32.7	30.5	28.6	26.9	25.4	24.1	22.9	21.8	20.6	19.9	19.1	18.3	17.6	16.9	16.3	15.8	15.2	14.8	14.3
114.0	42.2	38.4	35.2	32.5	30.2	28.1	26.4	24.8	23.5	22.2	21.1	20.1	19.0	18.4	17.6	16.9	16.2	15.6	15.1	14.6	14.1	13.6	13.2
117.0	39.1	35.5	32.5	30.0	27.9	26.0	24.4	23.0	21.7	20.6	19.5	18.6	17.6	17.0	16.3	15.6	15.0	14.5	13.9	13.5	13.0	12.6	12.2
120.0	36.2	32.9	30.2	27.8	25.9	24.1	22.6	21.3	20.1	19.1	18.1	17.2	16.3	15.7	15.1	14.5	13.9	13.4	12.9	12.5	12.1	11.7	11.3

TABLE NOTES:

1. SEE SHEET 1 FOR INSTRUCTIONS ON USING TABLES. SEE SHEETS 2 AND 3 FOR TYPICAL INSTALLATION METHODS & CLIP DETAILS.
2. FOR DIMENSIONS INTERMEDIATE ON THE VALUES SHOWN IN THE TABLES REFER TO THE LARGER VALUE.
3. ANCHOR AND SUBSTRATE REQUIREMENTS:

• CMU: 1/4" ELCO AGGRE-GATOR

• CMU ANCHORS SHALL HAVE A MIN. EMBEDMENT OF 2" & EDGE DISTANCE OF 2.5". GROUT FILLED CMU SHALL BE MEDIUM WEIGHT CONFORMING TO ASTM C 90.
4. READ WINDOW WIDTH AND MULL SPAN IN INCHES. DESIGN PRESSURE VALUES ON THIS CHART ARE POSITIVE AND NEGATIVE PSF.
5. CHART IS NOT LIMITED TO TWO WINDOW UNITS IN A SINGLE OPENING, DESIGN LOAD CAPACITIES APPLY TO ANY NUMBER OF WINDOW UNITS OF SIZES LISTED ON CHART IN A SINGLE OPENING.
6. ALLOWABLE PRESSURES & SIZES ON MULLED ASSEMBLIES SHALL BE LIMITED TO THE LESSER DESIGN PRESSURE AND SIZES OF THE APPROVED MULLION AND INDIVIDUAL UNIT INSTALLATION.
7. DESIGN PRESSURES SHOWN IN TABLE ARE APPLICABLE TO THE CONTINUOUS MULLION SHOWN AS A SOLID LINE IN THE DIAGRAMS TO THE RIGHT. MULLIONS SHOWN AS DASHED LINES IN DIAGRAMS AT RIGHT SHALL BE REVIEWED AND RATED USING ONE WAY LOAD DISTRIBUTION TABLES.
8. WHEN ADJACENT WINDOWS DO NOT USE SILL ANCHORS TWO WAY DESIGN PRESSURES MUST BE USED.

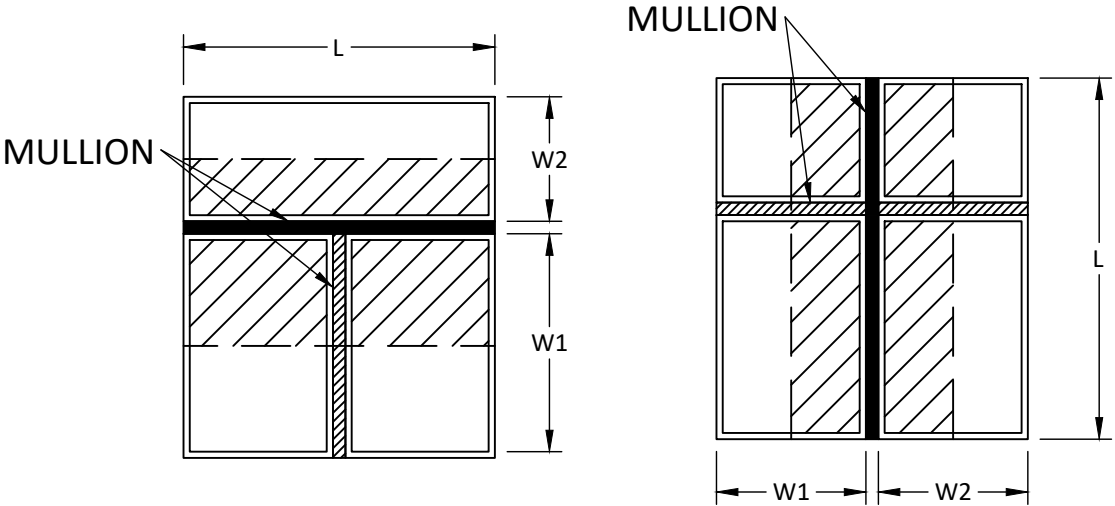

TWO-WAY MULLION DIAGRAMS

TRIBUTARY WIDTH = $\frac{W1+W2}{2}$



171 JET SERVICES WAY
DOTHAN, AL 36303
PH: (855) 611-8889
EMAIL: INFO@SHWINCO.COM

TITLE:
9000 SERIES ALUMINUM MULLION
(WZ3)(IMPACT)


TWO WAY DESIGN PRESSURE TABLE
CMU

PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 FBC UPDATE	DB	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

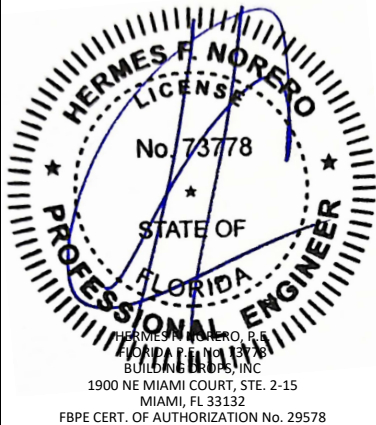

FL #:
FL29827

DATE: **03.14.2019**

DWG. BY: **SM**

CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **SWD049**



SHEET:
7

REV. **A**



OF 8

c:\users\danielbuitrago\building drops, inc\building drops landing - common\projects\2026 code change projects\shwinco architectural products\cc-26-0209.1 - 2026 code change\dwgs\1729827 - series 9000 mullion\swd049 - a.dwg 7/9/2026 4:15 PM

EXAMPLES OF ONE-WAY MULLION ASSEMBLIES

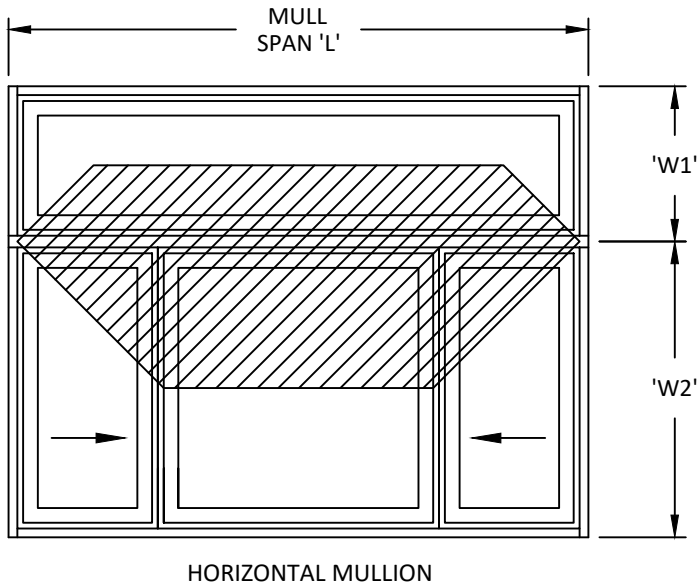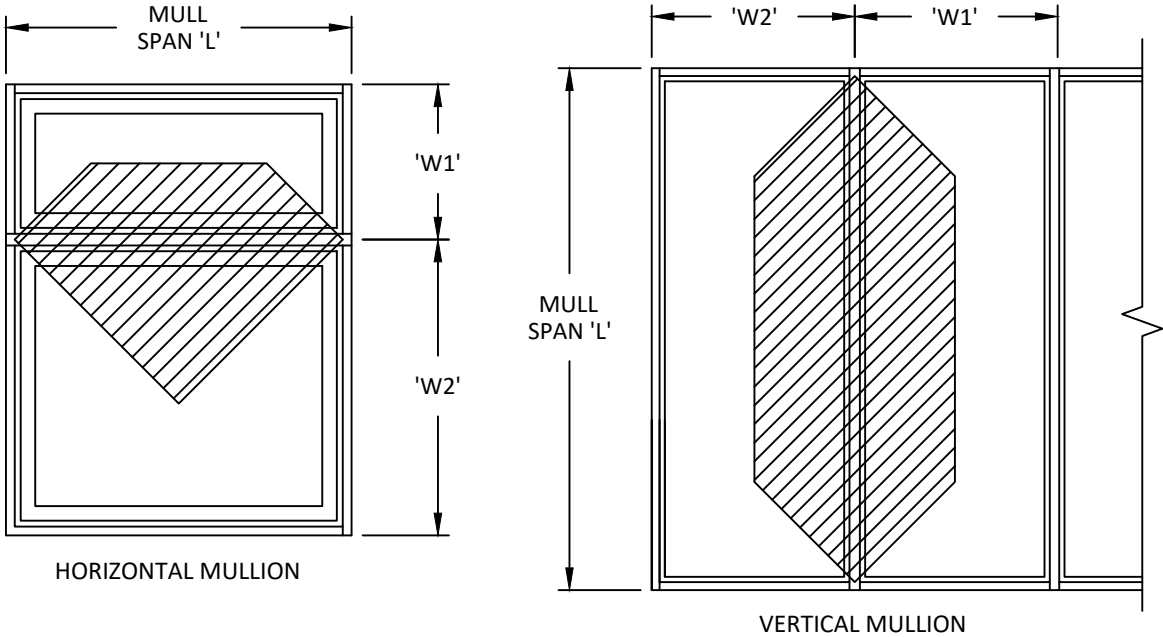

EXAMPLES OF TWO-WAY MULLION ASSEMBLIES

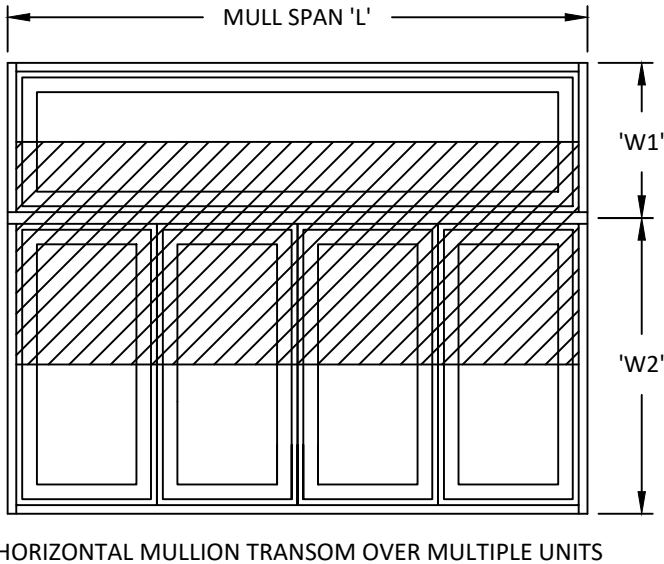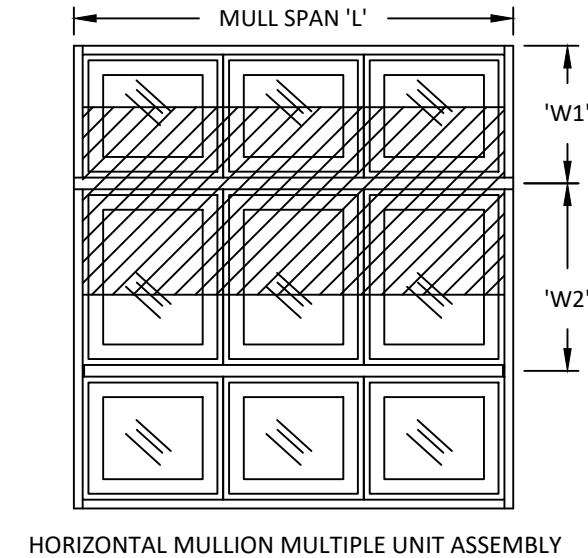

- NOTES:
1. WINDOWS AND DOORS SHALL HAVE SEPARATE FBC APPROVAL.
 2. WINDOWS AND DOORS SHALL BE ANCHORED TO ALUMINUM AT 3" FROM CORNERS AND 3" FROM CORNERS 8" O.C. USING #8FH X 1-1/4" SCREWS OF SUFFICIENT LENGTH TO ACHIEVE THREE THREADS PENETRATION BEYOND ALUMINUM WALL.
 3. MULLION DETAILS SHOWN HEREIN ILLUSTRATE MULLION ONLY, AS-TESTED. THE ADDITION OF ANY ACCESSORY COVERS OR TRIMS SHALL BE ALLOWED.
 4. WHEN ADJACENT WINDOWS DO NOT USE SILL ANCHORS, TWO-WAY DESIGN PRESSURES MUST BE USED.



171 JET SERVICES WAY
DOTHAN, AL 36303
PH: (855) 611-8889
EMAIL: INFO@SHWINCO.COM

TITLE:
9000 SERIES ALUMINUM MULLION
(WZ3)(IMPACT)

EXAMPLES OF ONE-WAY AND
TWO-WAY ASSEMBLIES

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15

MIAMI, FL 33132

PH: (954) 399-8478


FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	DB	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

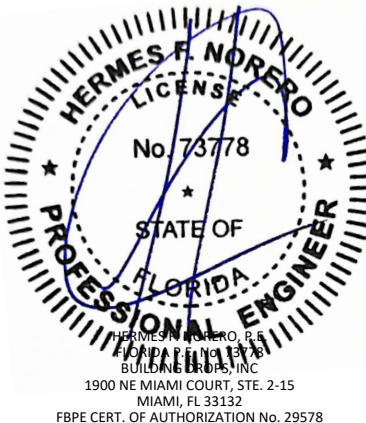

FL #:

FL29827

DATE: 03.14.2019

DWG. BY:	CHK. BY:
SM	HFN

SCALE: NTS

DWG. #: SWD049

SHEET:	REV.
8	A

OF 8