





250 Staunton Turnpike, Parkersburg, WV 26104

GLAZED FIBERGLASS DOORS
DOUBLES
w/ or w/o SIDELITES
INSWING / OUTSWING
"IMPACT"


GENERAL NOTES

1. This product has been evaluated and is in compliance with the 9th Edition (2026) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E1996.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.


TABLE OF CONTENTS	
SHEET#	DESCRIPTION
1	Typical elevations, design pressures & general notes
2	Door & Sidelite panel details
3	Lite frame glazing details
4	Elevations
5	Horizontal & Vertical Cross Sections (2X Buck)
6	Horizontal & Vertical Cross Sections (1X Buck)
7	Horizontal & Vertical Cross Sections (Direct to Masonry)
8	Vertical Cross Sections (Thresholds)
9	Horizontal & Vertical Cross Sections (Direct to Masonry)
10	Buck anchoring
11	Frame anchoring & hardware details
12	Bill of materials and components

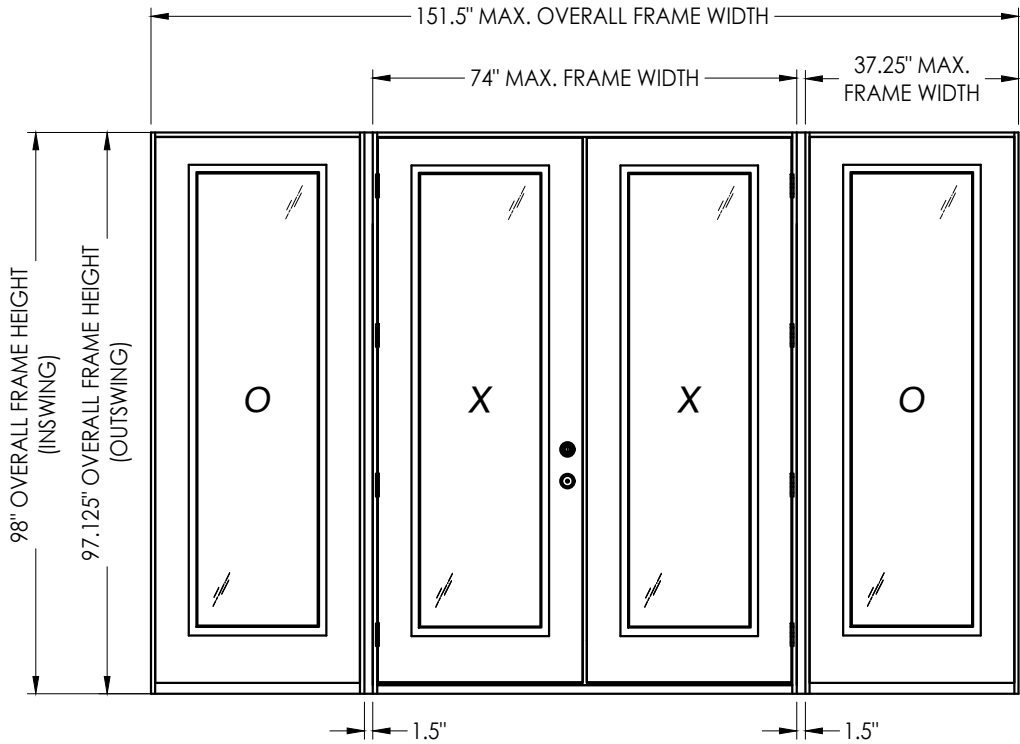

XX

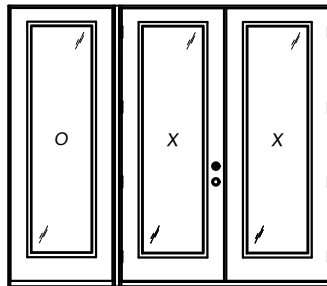


OXX

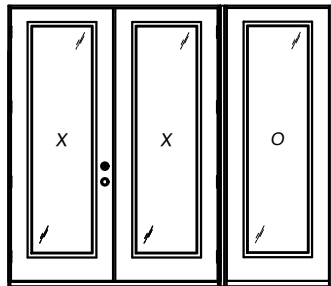

XXO

CONFIGURATION	MAX. FRAME DIMENSION	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
		POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
XX	74" x 98"	+40.0	-45.0	+45.0	-45.0
OXX, XXO	112.75" x 98"	+40.0	-45.0	+45.0	-45.0
OXXO	151.5" x 98"	+40.0	-45.0	+45.0	-45.0

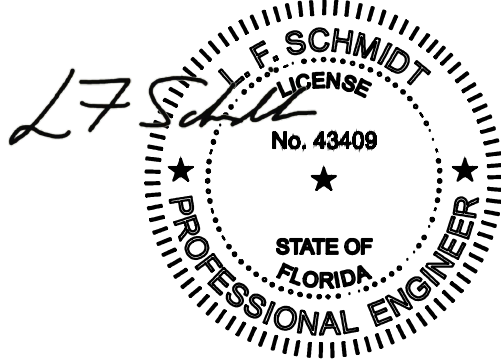

Digitally signed by Lyndon F Schmidt
Date: 2026.07.30 08:13:49 -04'00'

This item has been digitally signed and sealed by L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID ONLY FOR THE STATE OF FLORIDA

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

WINCORE
FIBERGLASS ENTRY DOOR
"Impact"

PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES

4	7/01/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
3	7/06/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
2	10/14/20	UPDATE TO 7TH ED. (2020)	FBC	LFS
1	7/14/20	REVISE DESIGN PRESSURE TABLE & ULT. HURRICANE ASTRAGAL	TABLE	RW
NO.	DATE	REVISIONS		

DATE: 8/20/19

SCALE: N.T.S.

DWG. BY: RW

CHK. BY: LFS

DRAWING NO.: FL-30037.8


SHEET 1 OF 12

© 2019 R.W. BUILDING CONSULTANTS INC.


RWBUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Building Consultants, Inc.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\Wincore Window Company\FL-30037 R5\FL-30037.8.dwg

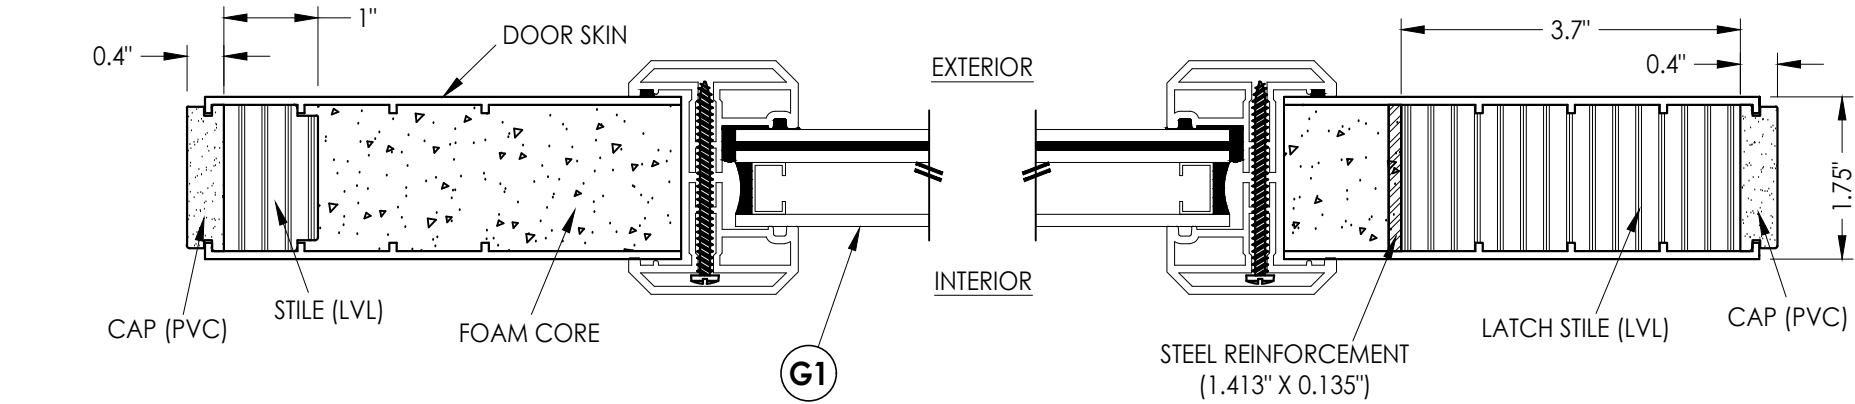

1
2 **HORIZONTAL CROSS SECTION**

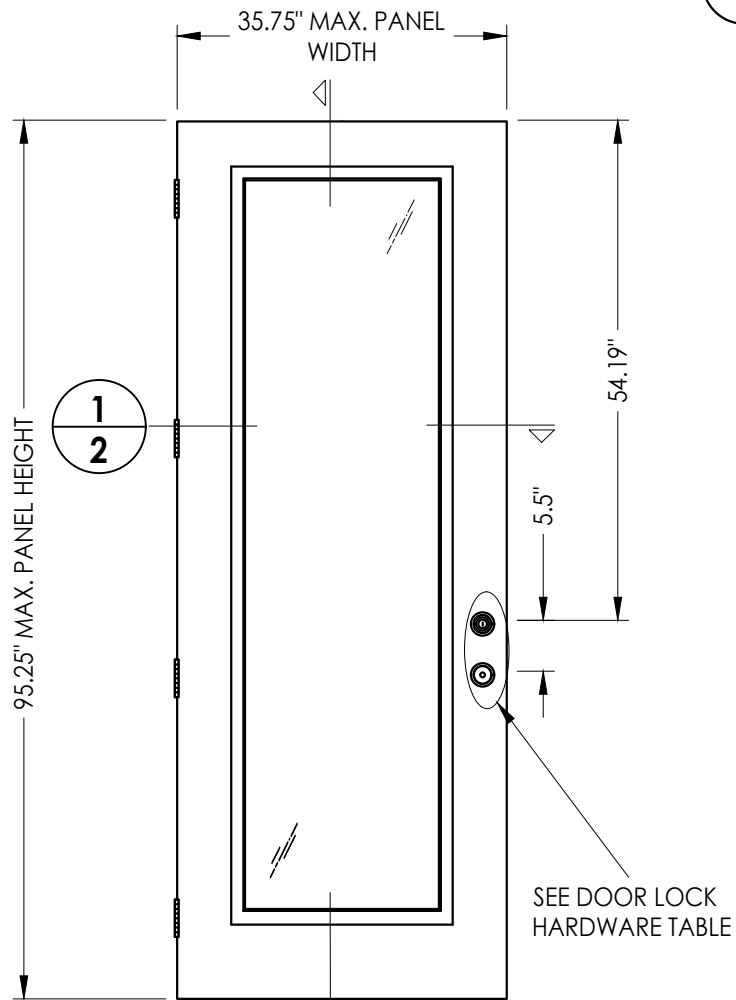


2
2

40 **PLASTPRO DOOR PANEL**

50 **PLASTPRO SIDELITE PANEL**

FIBERGLASS SKIN: 0.075" MIN. THK.
FOAM CORE: POLYURETHANE - 1.9 PCF MIN.)

DOOR LOCK HARDWARE TABLE		
MANUFACTURER	MODEL	
ENDURA	TRILENNIUM 3000 SERIES MULTI-POINT LOCK (3 pt.)	
SCHLAGE	HANDLE SET: "F" SERIES (F60)	DEADBOLT: "B" SERIES (B60/62)
KWSIKSET	KNOB: SIGNATURE SERIES	DEADBOLT: SIGNATURE SERIES (980)

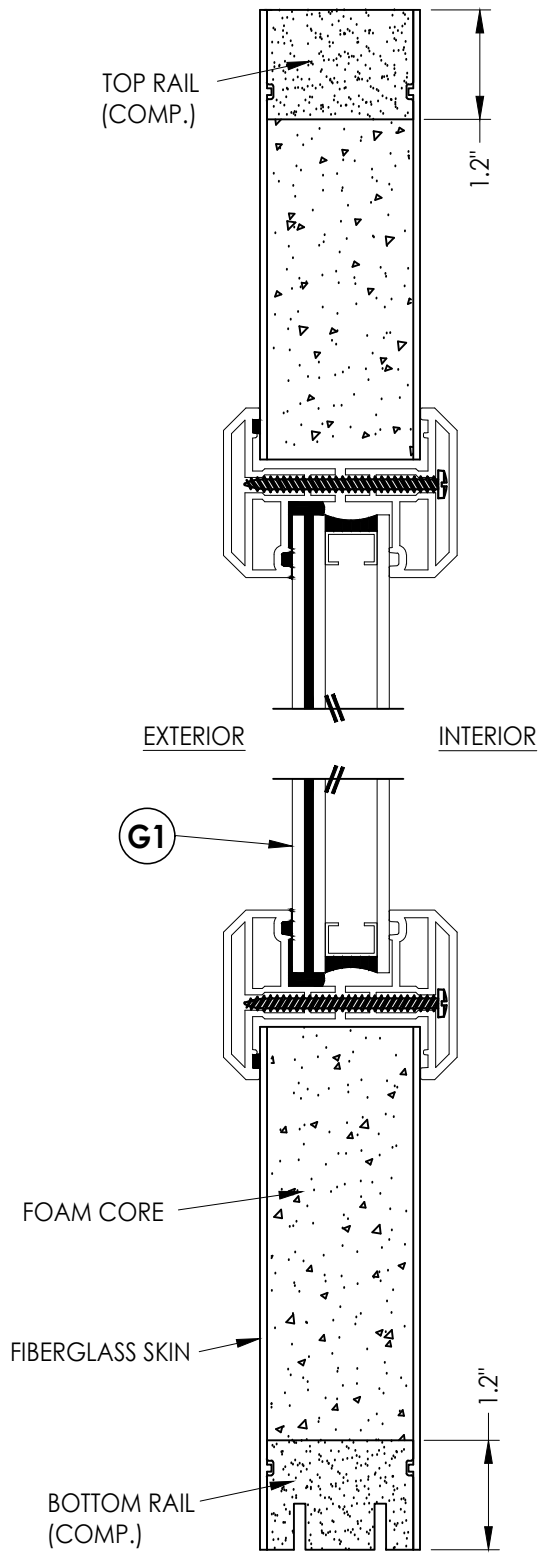

2
2 **VERTICAL CROSS SECTION**

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: WINCORE
FIBERGLASS ENTRY DOOR
"Impact"

PART OR ASSEMBLY:
DOOR & SIDELITE
PANEL DETAILS

	LFS	FBC	UPDATE TO 9TH ED. (2026)		
	LFS	FBC	UPDATE TO 8TH ED. (2023)		
	LFS	FBC	UPDATE TO 7TH ED. (2020)		
	RW	TABLE	REVISE DESIGN PRESSURE		
		ASTRAGAL	& ULT. HURRICANE		
	BY				
	NO.	DATE			
	REVISIONS				

DATE: 8/20/19

SCALE: N.T.S.


DWG. BY: RW

CHK. BY: LFS



DRAWING NO.:

FL-30037.8

SHEET 2 OF 12

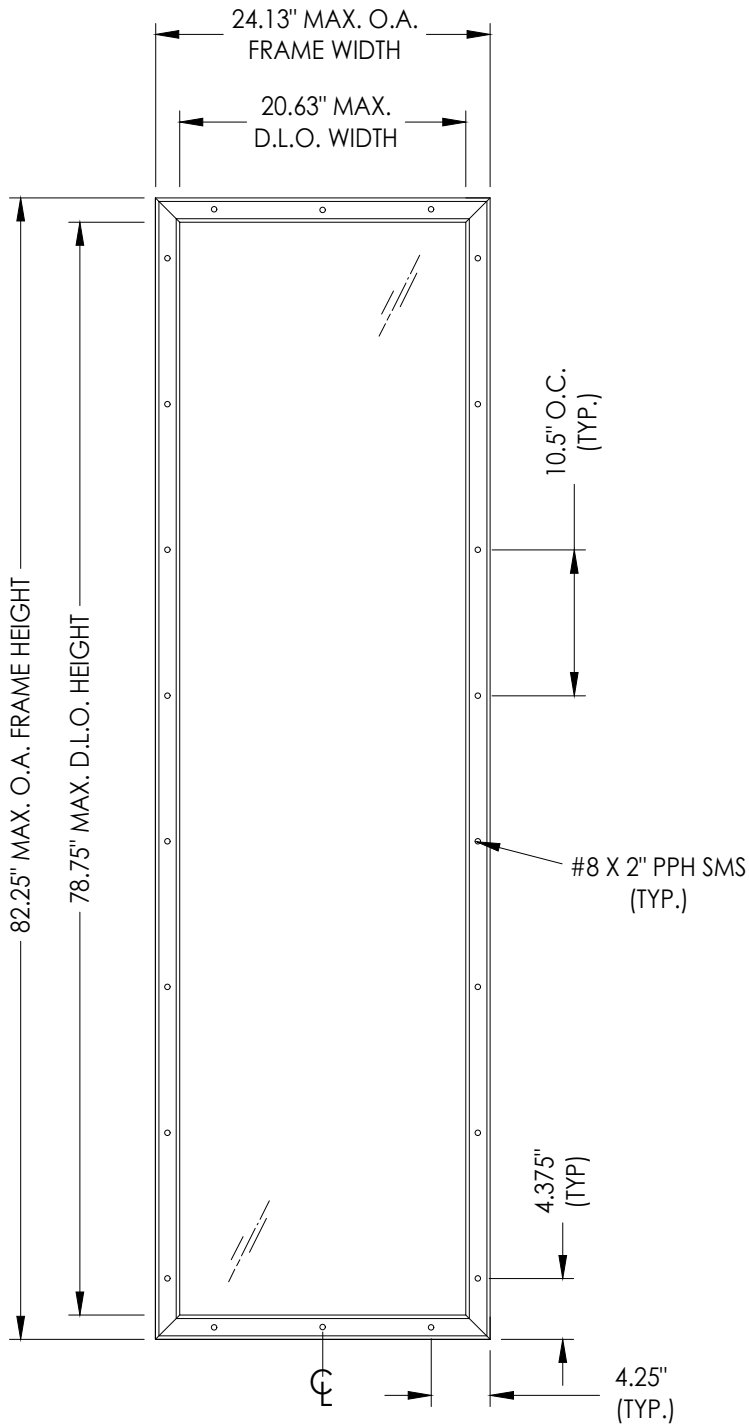

ODL LITE FRAME DETAIL
"FLAT FRAME" PROFILE

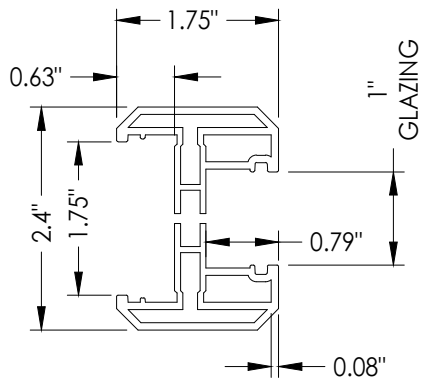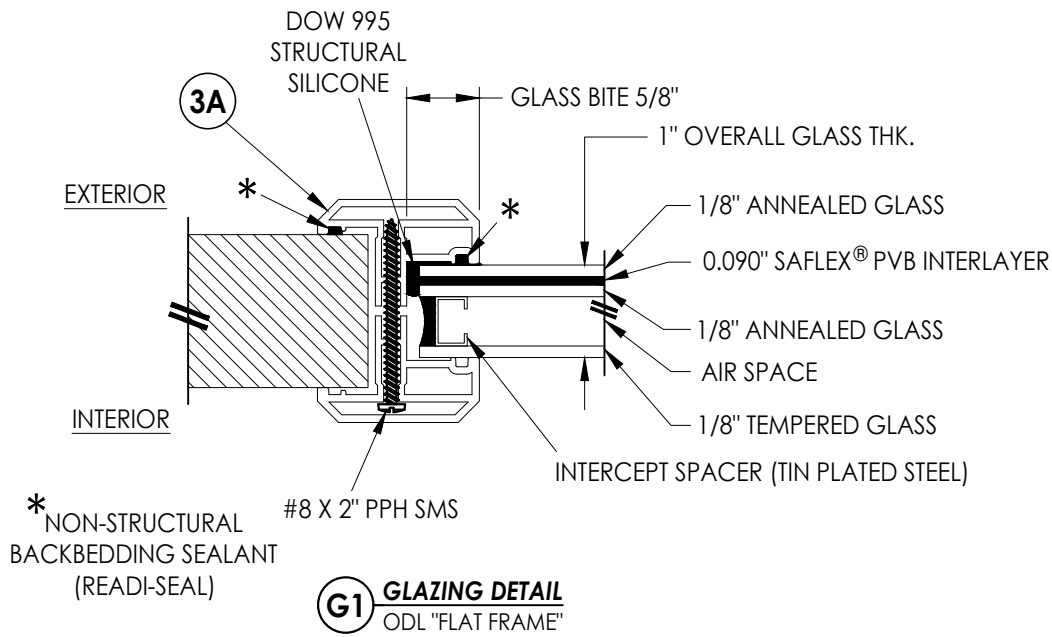




3A ODL LITE FRAME
"FLAT FRAME" PROFILE
(6063-T5 ALUM)

	4	7/01/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
	3	7/06/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
	2	10/14/20	UPDATE TO 7TH ED. (2020)	FBC	LFS
	1	7/14/20	REVISE DESIGN PRESSURE TABLE & ULT. HURRICANE ASTRAGAL		RW
	NO.	DATE	REVISIONS		
DATE: 8/20/19					
SCALE: N.T.S.					
DWG. BY: RW					
CHK. BY: LFS					
DRAWING NO.: FL-30037.8					
SHEET 3 OF 12					

PRODUCT:	WINCORE FIBERGLASS ENTRY DOOR "Impact"
PART OR ASSEMBLY:	LITE FRAME GLAZING DETAILS


Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409	RW BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813
---	---

Z:\2023 FBC Drawings\Wincore Window Company\FL-30037 R5\FL-30037.8.dwg

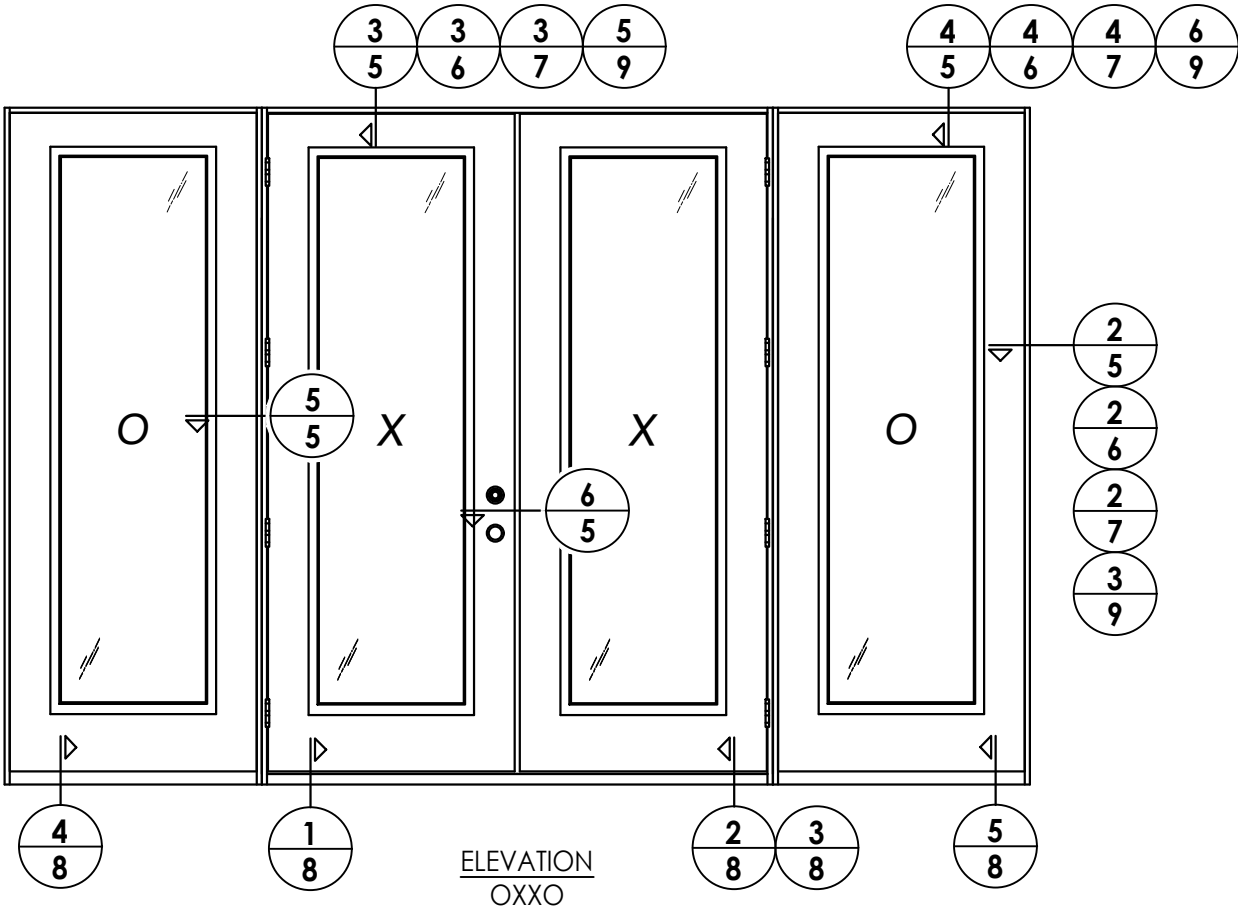
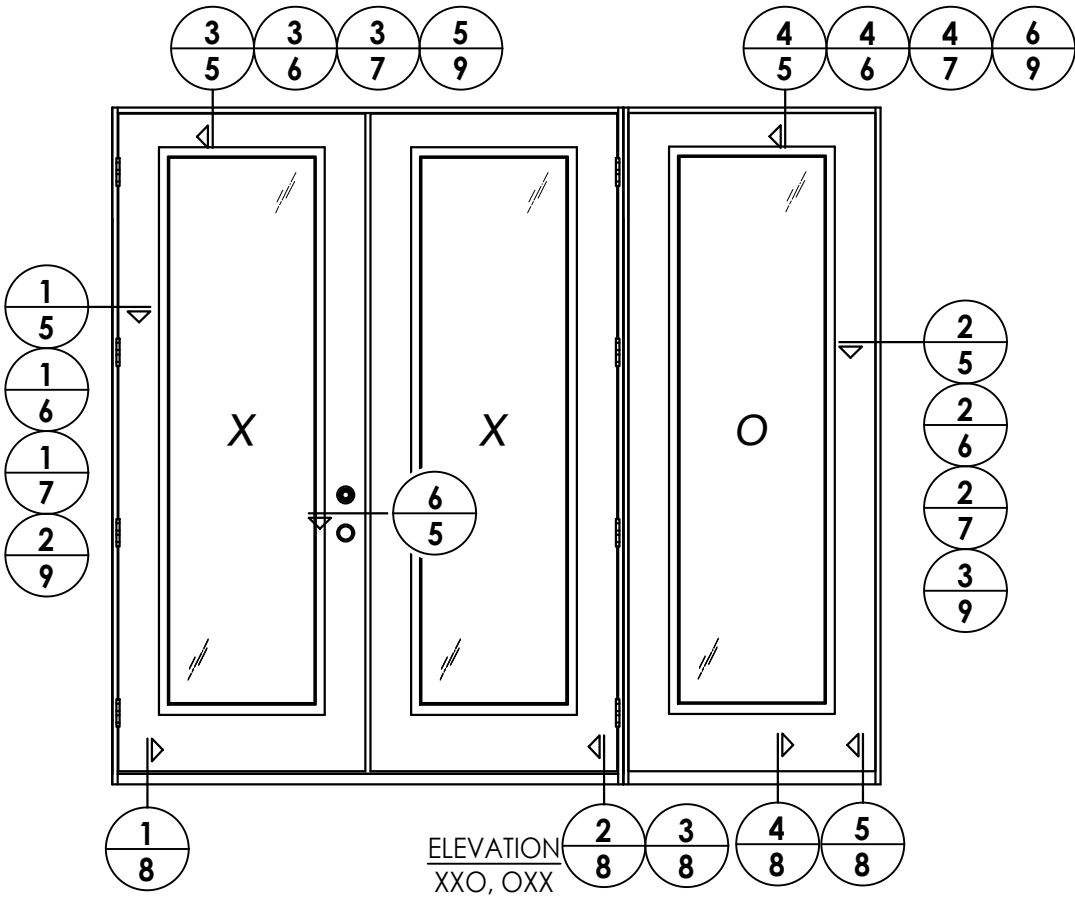
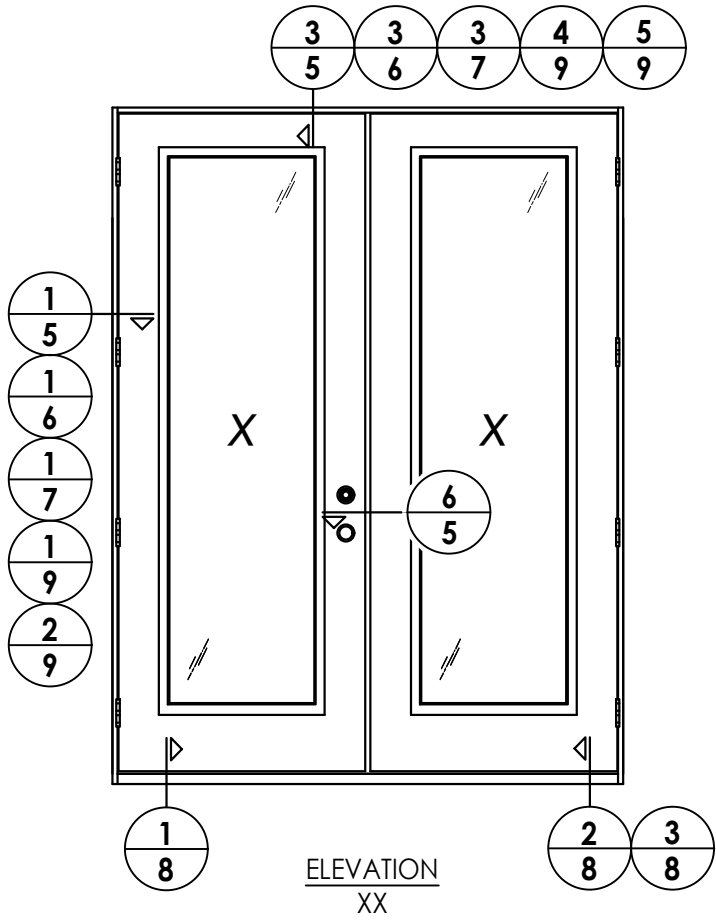


Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409					<i>RW</i> BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813				
PRODUCT: WINCORE FIBERGLASS ENTRY DOOR "Impact"					PART OR ASSEMBLY: ELEVATIONS				
4	7/01/26	UPDATE TO 9TH ED. (2026)	FBC	LFS	REVISIONS				
3	7/06/23	UPDATE TO 8TH ED. (2023)	FBC	LFS					
2	10/14/20	UPDATE TO 7TH ED. (2020)	FBC	LFS					
1	7/14/20	REVISE DESIGN PRESSURE TABLE & ULT. HURRICANE ASTRAGAL	RW						
NO.	DATE			BY					
DATE: 8/20/19									
SCALE: N.T.S.									
DWG. BY: RW									
CHK. BY: LFS									
DRAWING NO.: FL-30037.8									
SHEET 4 OF 12									


Z:\2023 FBC Drawings\Wincore Window Company\FL-30037 R5\FL-30037.8.dwg

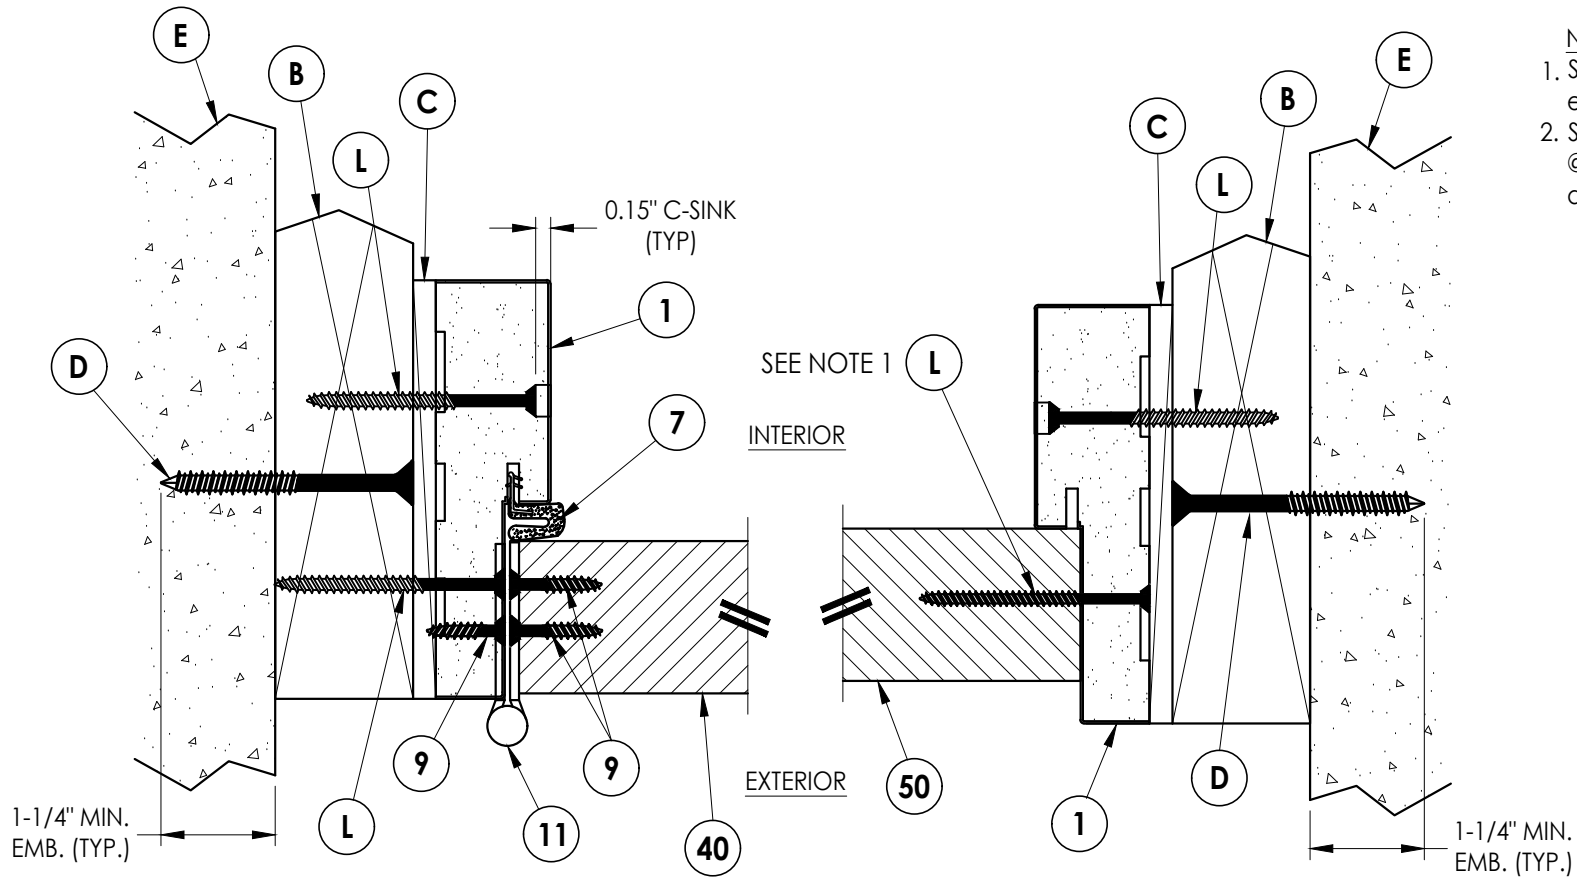


- NOTES:
1. Spacing for item L: 6" from each end and 5 more equally spaced along sidelite jamb (7 total).
 2. Spacing for item L @ head & sill: 6" from each end, 1 @ centerline, 2 additional at 3" & 4.5" from end adjacent to door.

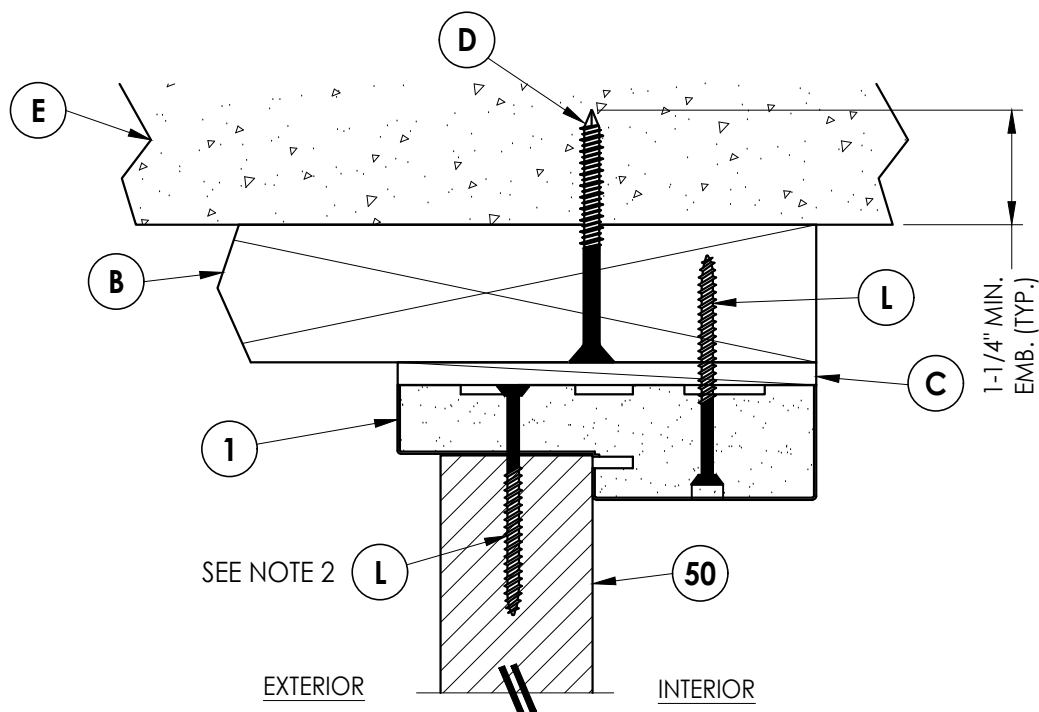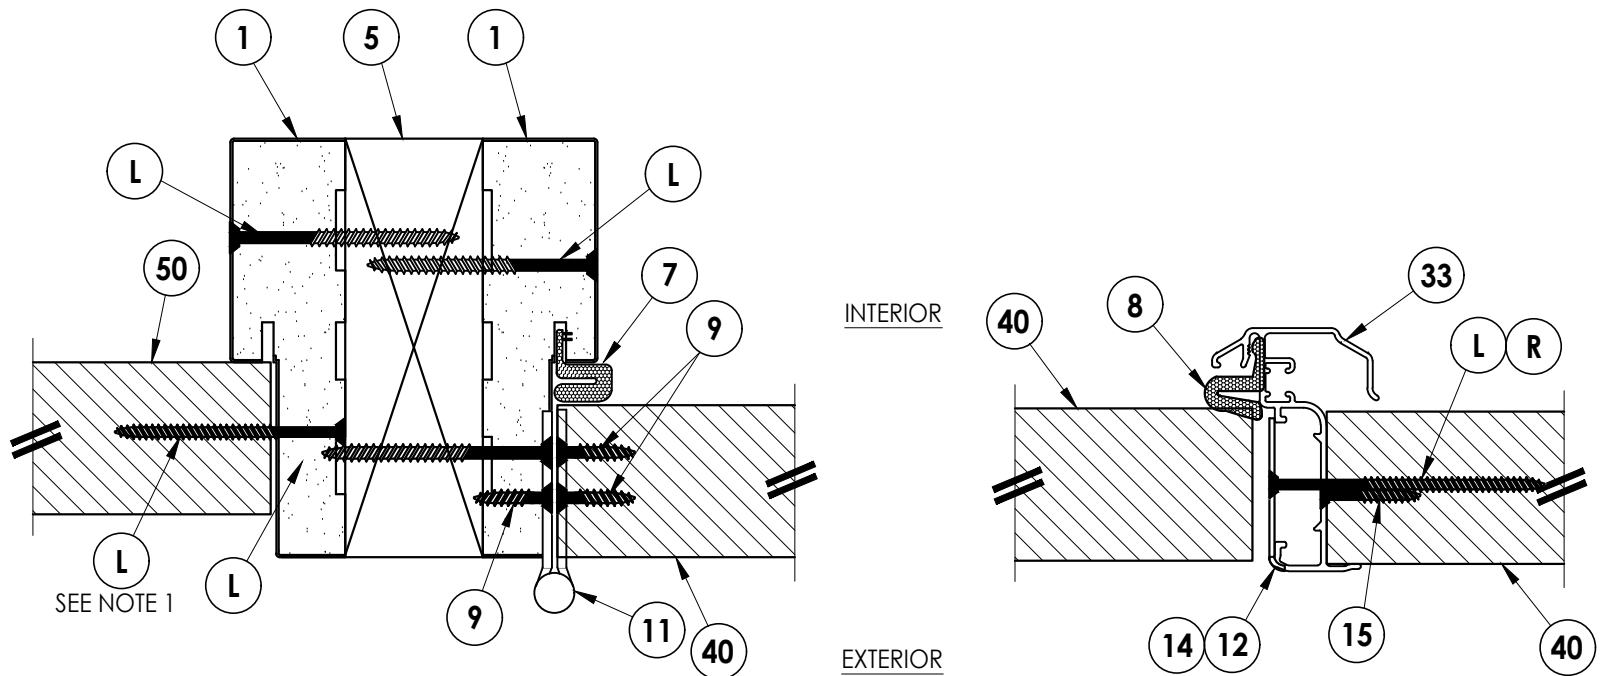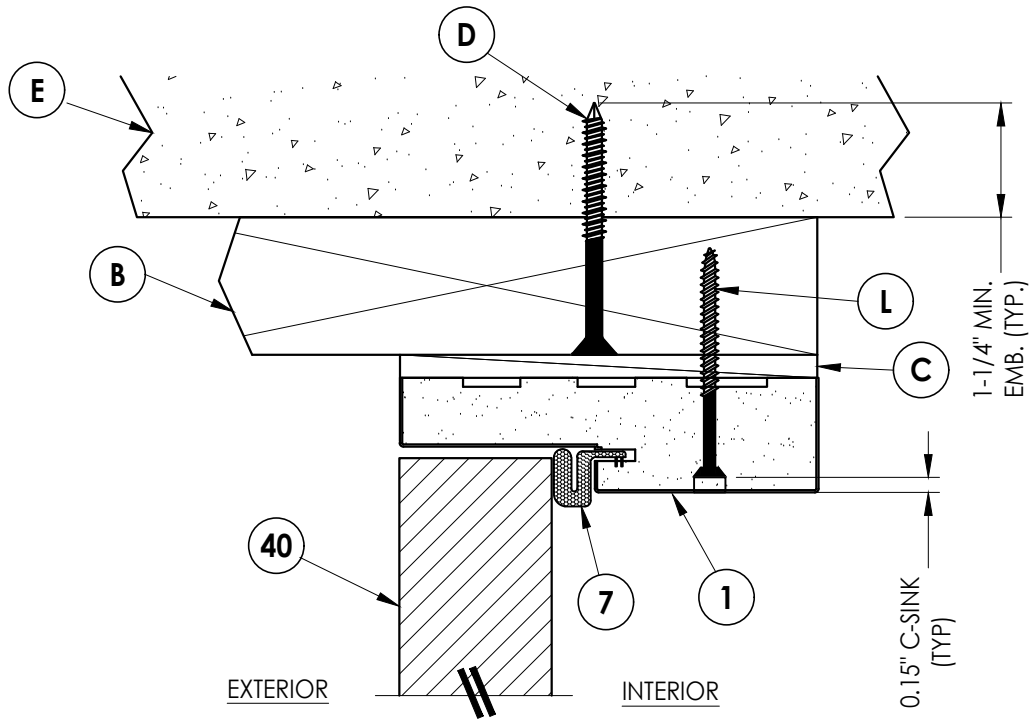


Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: WINCORE FIBERGLASS ENTRY DOOR "Impact"		PART OR ASSEMBLY: HORIZONTAL & VERTICAL CROSS SECTIONS (2X BUCK)	
4	7/01/26	UPDATE TO 9TH ED. (2026) FBC	LFS
3	7/06/23	UPDATE TO 8TH ED. (2023) FBC	LFS
2	10/14/20	UPDATE TO 7TH ED. (2020) FBC	LFS
1	7/14/20	REVISE DESIGN PRESSURE TABLE & ULT. HURRICANE ASTRAGAL	RW
NO.	DATE	REVISIONS	
DATE:	8/20/19		
SCALE:	N.T.S.		
DWG. BY:	RW		
CHK. BY:	LFS		
DRAWING NO.:	FL-30037.8		
SHEET	5	OF 12	

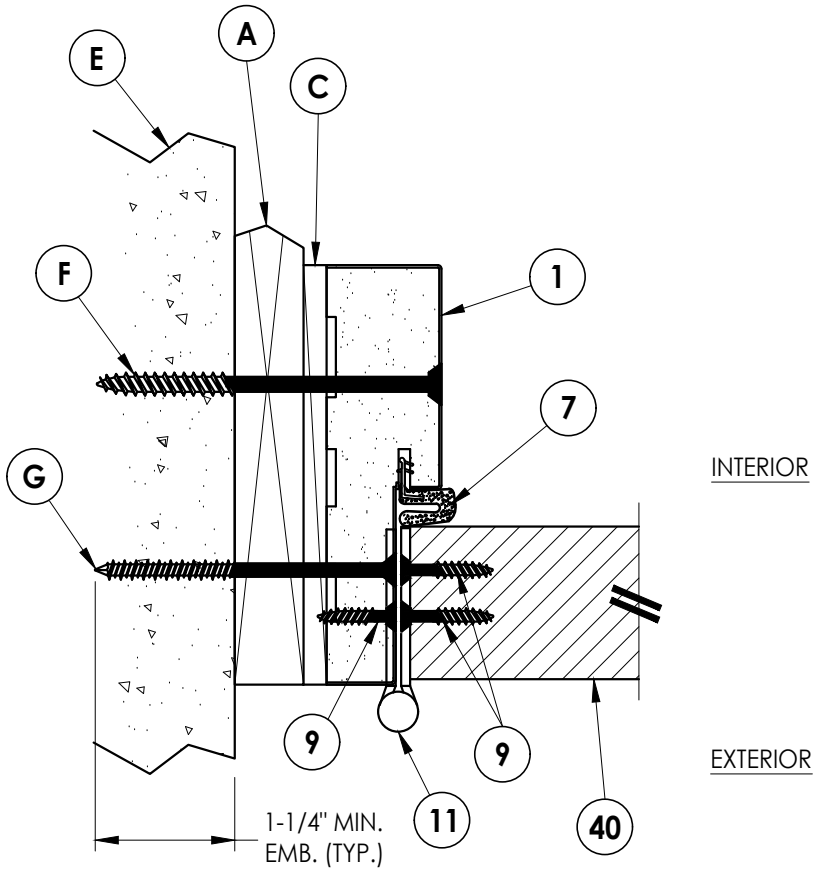


1
6 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

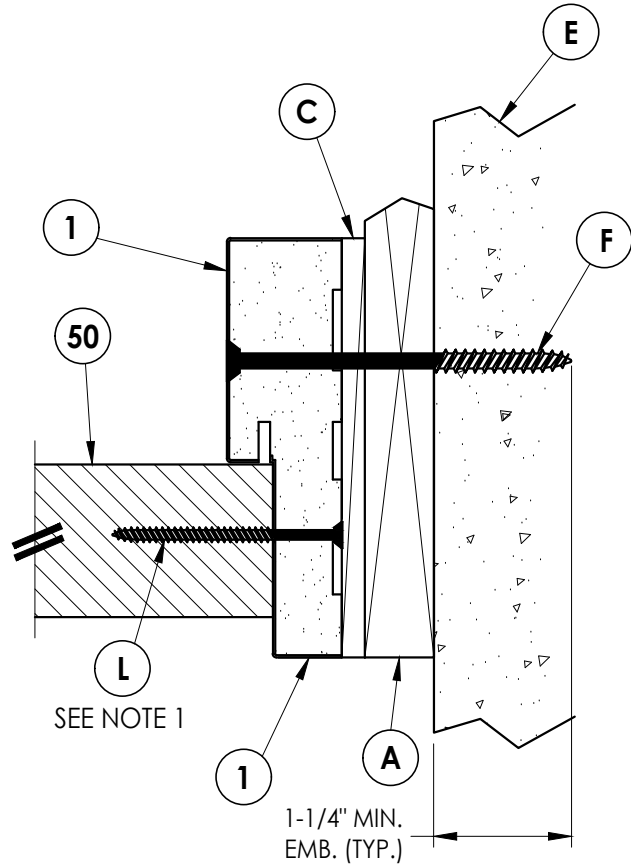

2
6 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

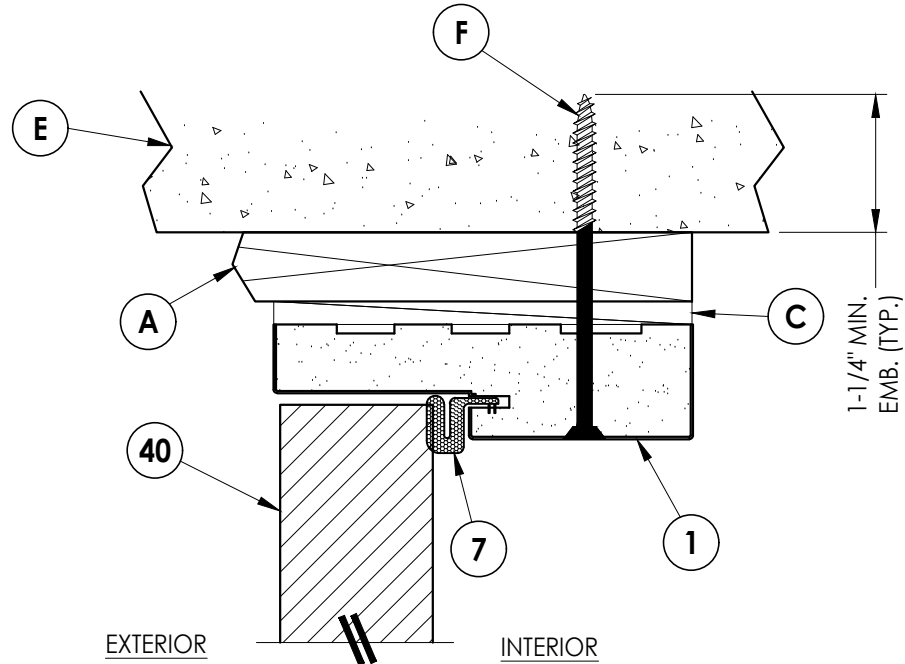

3
6 **VERTICAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

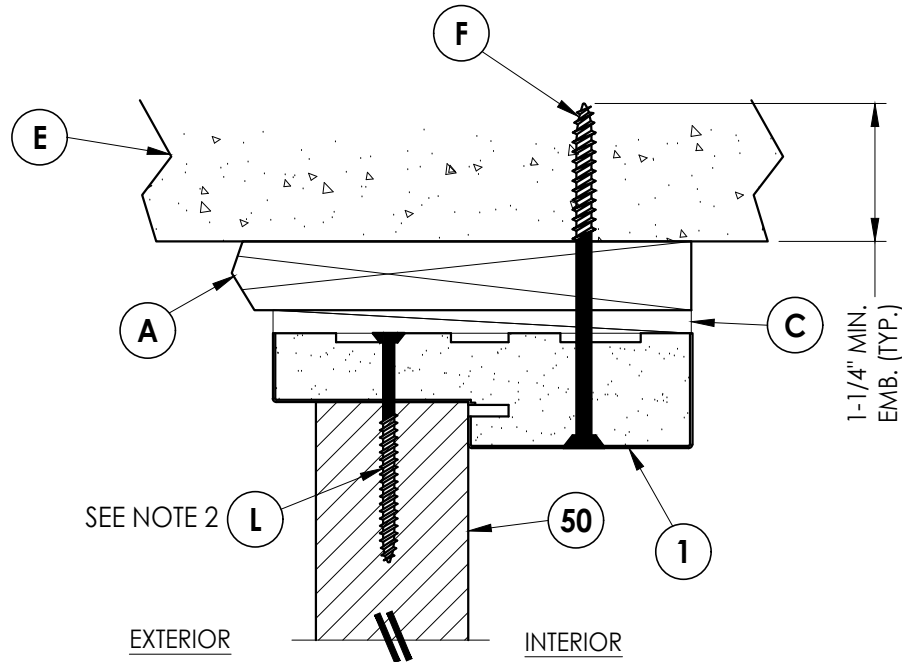

4
6 **VERTICAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

NOTES:

1. Spacing for item L: 6" from each end and 5 more equally spaced along sidelite jamb (7 total).
2. Spacing for item L @ head & sill: 6" from each end, 1 @ centerline, 2 additional at 3" & 4.5" from end adjacent to door.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: WINCORE
FIBERGLASS ENTRY DOOR
"Impact"

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (1X BUCK)

NO.	DATE	REVISIONS			
		BY	DATE	DESCRIPTION	REVISIONS
4	7/01/26	LFS		UPDATE TO 9TH ED. (2026) FBC	
3	7/06/23	LFS		UPDATE TO 8TH ED. (2023) FBC	
2	10/14/20	LFS		UPDATE TO 7TH ED. (2020) FBC	
1	7/14/20	RW		REVISE DESIGN PRESSURE TABLE & ULT. HURRICANE ASTRAGAL	

DATE: 8/20/19

SCALE: N.T.S.


DWG. BY: RW

CHK. BY: LFS

DRAWING NO.:


FL-30037.8

SHEET 6 OF 12

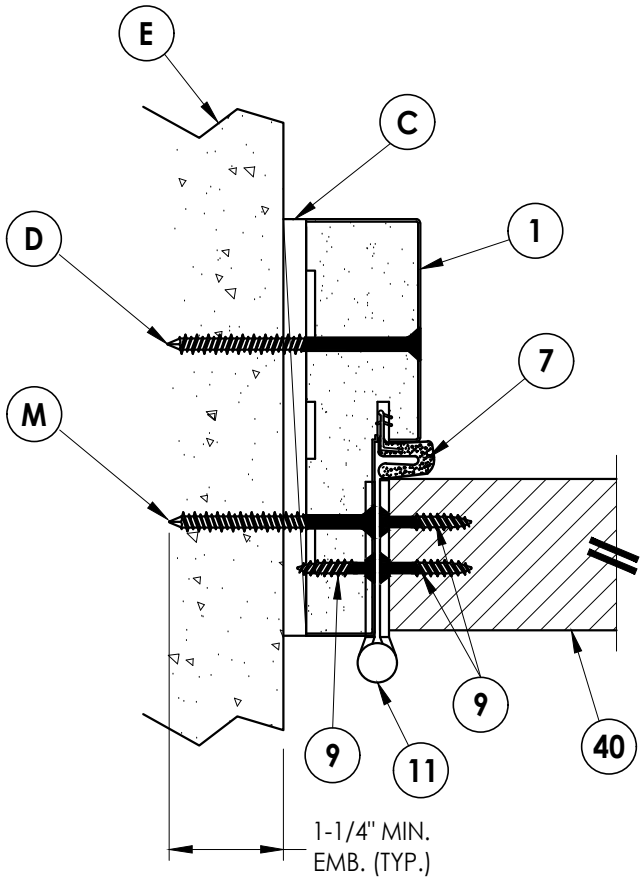


1
7 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing shown (Inswing similar)

INTERIOR
EXTERIOR

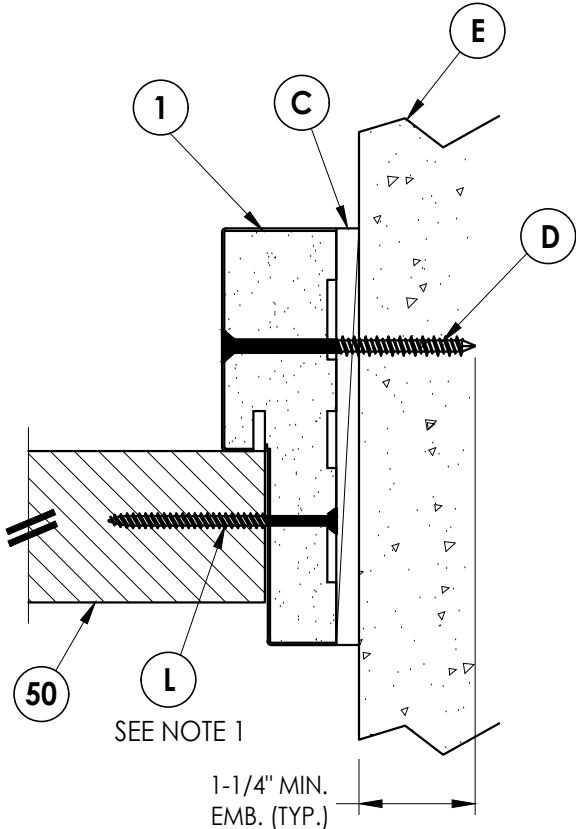


2
7 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing shown (Inswing similar)

SEE NOTE 1

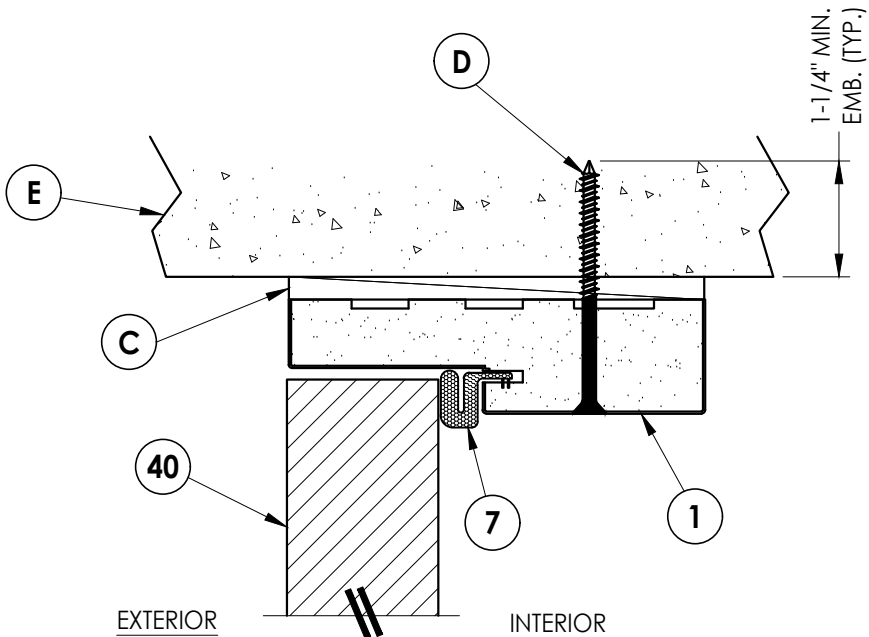

3
7 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing shown (Inswing similar)

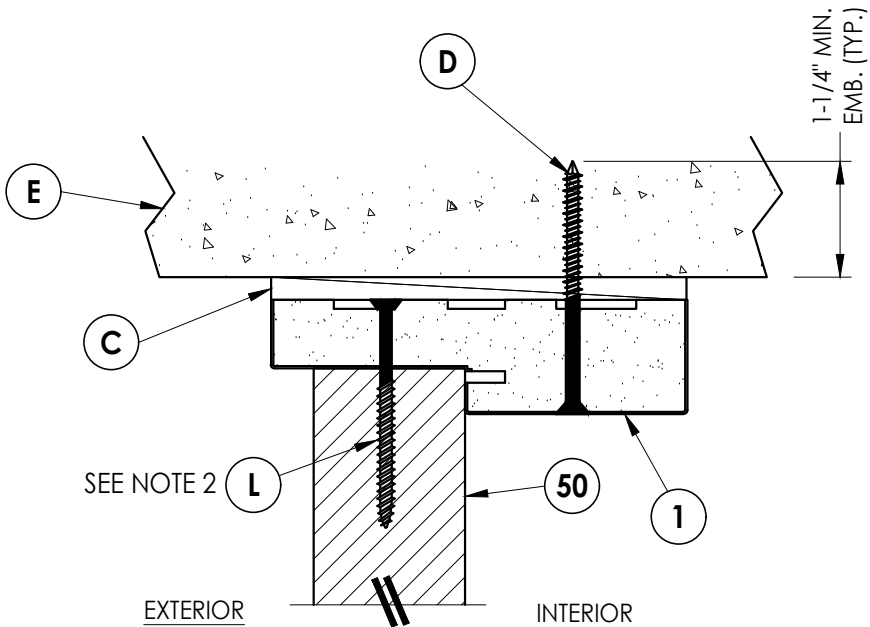


4
7 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing shown (Inswing similar)

NOTES:


1. Spacing for item L: 6" from each end and 5 more equally spaced along sidelite jamb (7 total).
2. Spacing for item L @ head & sill: 6" from each end, 1 @ centerline, 2 additional at 3" & 4.5" from end adjacent to door.

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: WINCORE FIBERGLASS ENTRY DOOR "Impact"		PART OR ASSEMBLY: HORIZONTAL & VERTICAL CROSS SECTIONS (DIRECT TO MASONRY)	
4	7/01/26	UPDATE TO 9TH ED. (2026)	FBC
3	7/06/23	UPDATE TO 8TH ED. (2023)	FBC
2	10/14/20	UPDATE TO 7TH ED. (2020)	FBC
1	7/14/20	REVISE DESIGN PRESSURE TABLE & ULT. HURRICANE ASTRALG	RW
NO.	DATE	REVISIONS	
DATE: 8/20/19			
SCALE: N.T.S.			
DWG. BY: RW			
CHK. BY: LFS			
DRAWING NO.: FL-30037.8			
SHEET 7 OF 12			


Z:\2023 FBC Drawings\Wincore Window Company\FL-30037 R5\FL-30037.8.dwg

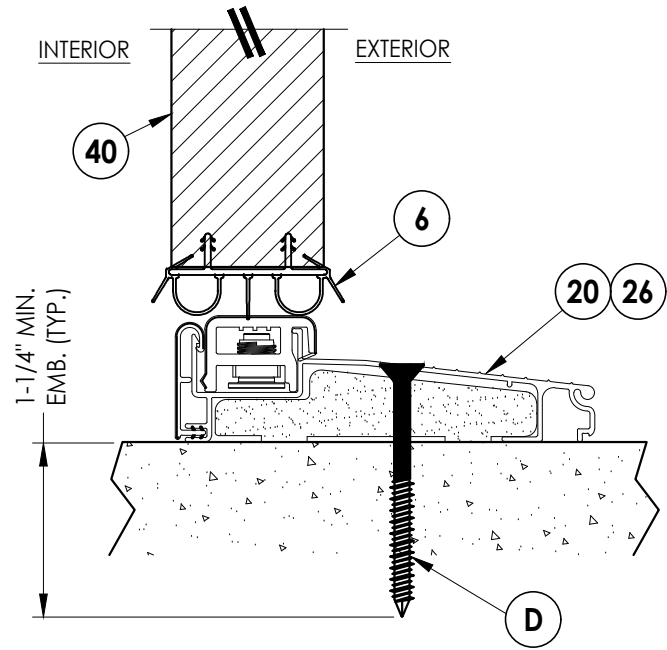


1
8 VERTICAL CROSS SECTION
Inswing sill

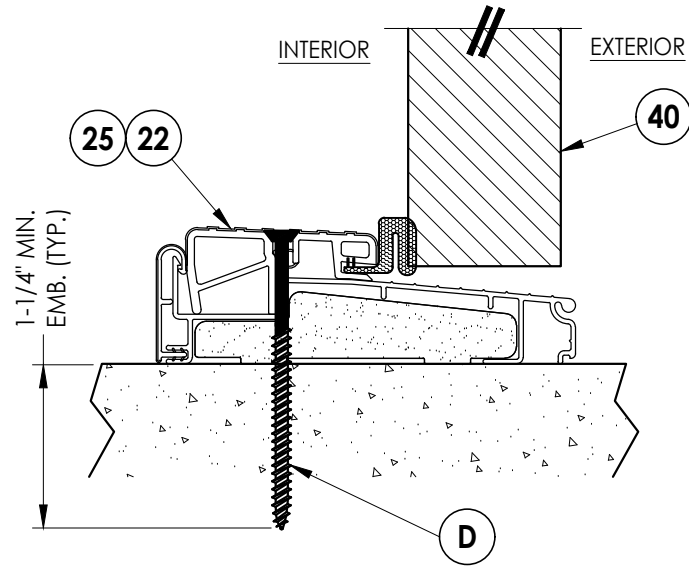


2
8 VERTICAL CROSS SECTION
Outswing sill

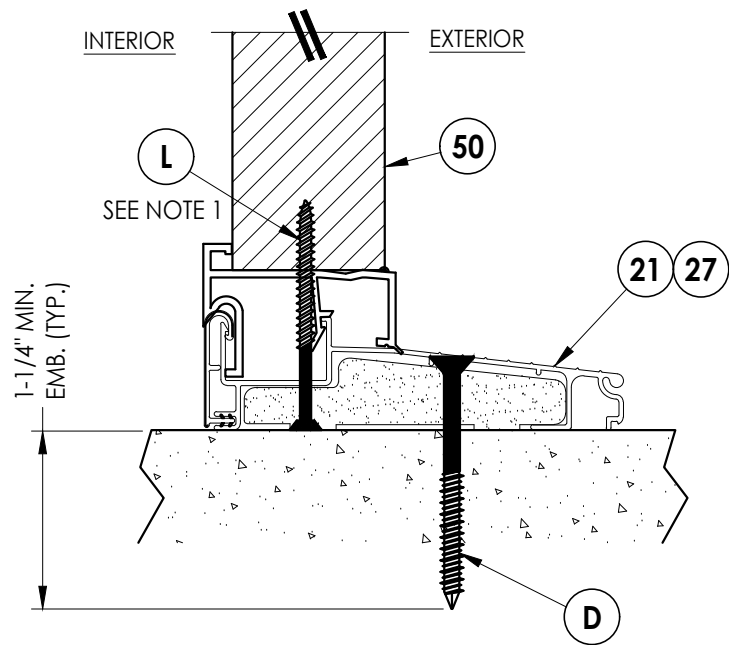

4
8 VERTICAL CROSS SECTION
Inswing sill

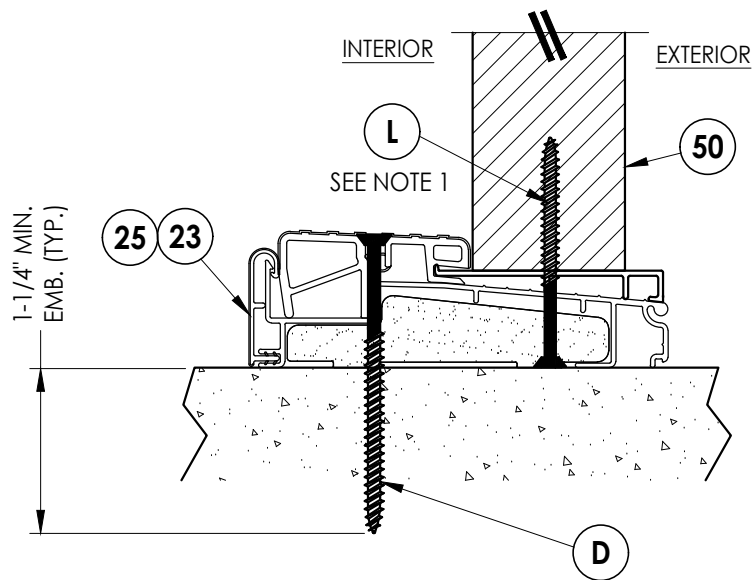

5
8 VERTICAL CROSS SECTION
Inswing sill

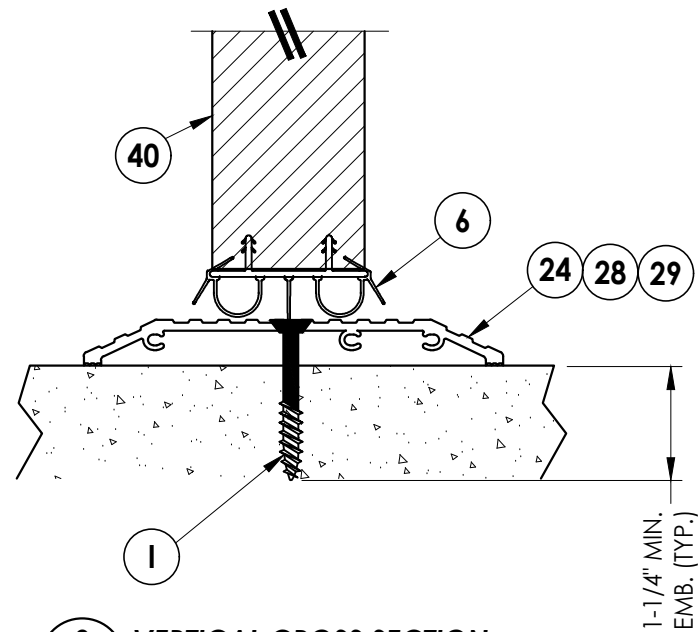


3
8 VERTICAL CROSS SECTION
ADA Sill


NOTE:
1. Spacing for item L @ head & sill: 6" from each end,
1 @ centerline, 2 additional at 3" & 4.5" from end
adjacent to door.

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		RWBUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: WINCORE FIBERGLASS ENTRY DOOR Impact		PART OR ASSEMBLY: VERTICAL CROSS SECTIONS (THRESHOLDS)	
4	7/01/26	UPDATE TO 9TH ED. (2026) FBC	LFS
3	7/06/23	UPDATE TO 8TH ED. (2023) FBC	LFS
2	10/14/20	UPDATE TO 7TH ED. (2020) FBC	LFS
1	7/14/20	REVISE DESIGN PRESSURE TABLE & ULT. HURRICANE ASTRAGAL	RW
NO.	DATE	REVISIONS	
DATE: 8/20/19			
SCALE: N.T.S.			
DWG. BY: RW			
CHK. BY: LFS			
DRAWING NO.: FL-30037.8			
SHEET 8 OF 12			


Z:\2023 FBC Drawings\Wincore Window Company\FL-30037 R5\FL-30037.8.dwg

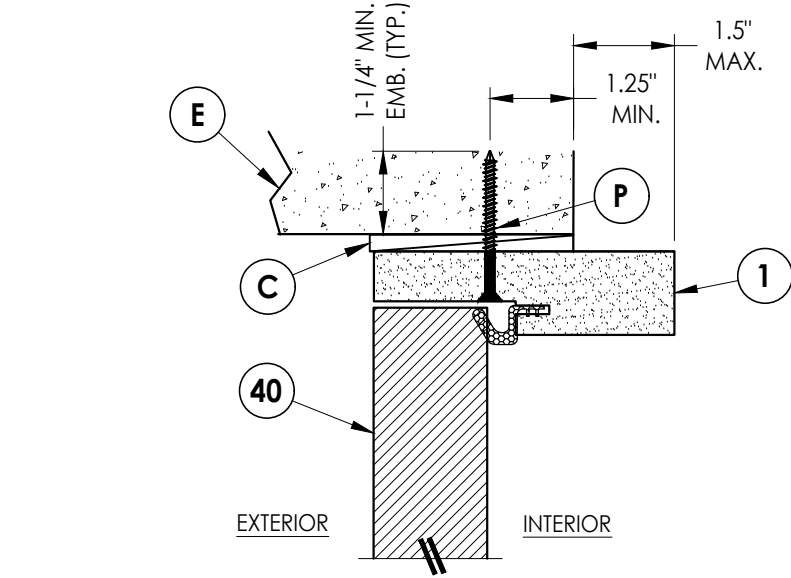

4
9 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb
Double Door Only (N/A w/ Sidelites)

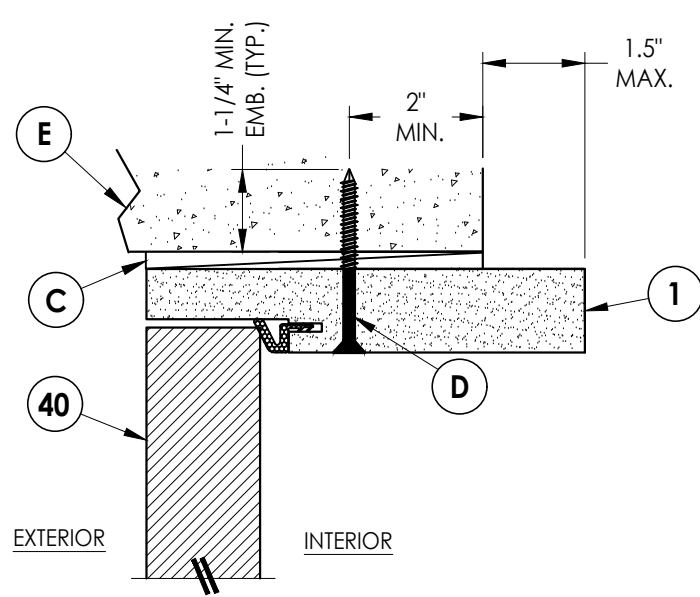


5
9 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

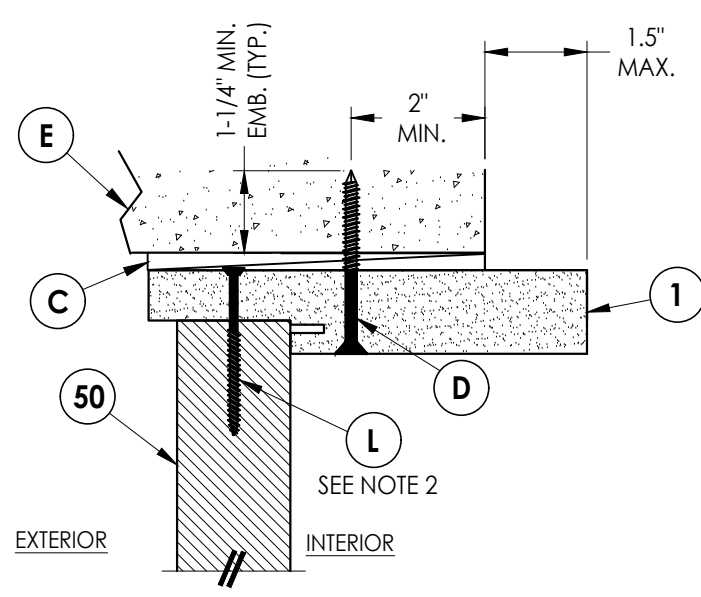


6
9 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb


- NOTES:
1. Sidelite assembly screws located 6" from top and bottom then 5 more equally spaced (7 total).
 2. Spacing for item L: 3" from each end and @ center line (3 total).

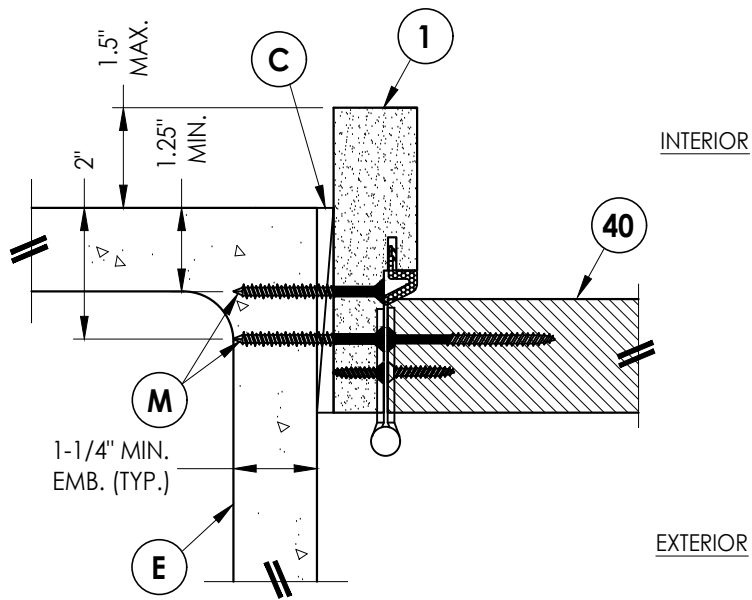

1
9 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb
Double Door Only (N/A w/ Sidelites)

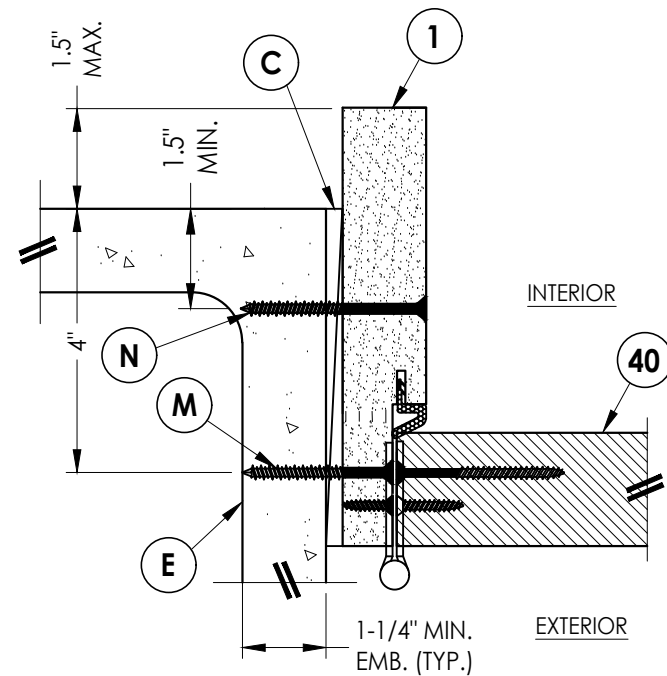

2
9 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

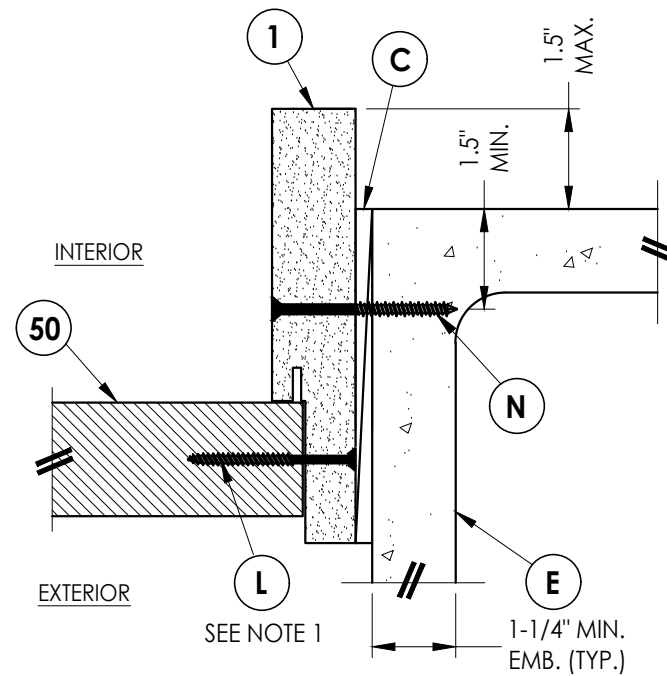

3
9 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
WINCORE
FIBERGLASS ENTRY DOOR
"Impact"

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
SECTIONS (DIRECT TO MASONRY)

NO.	DATE	BY	REVISIONS
4	7/01/26	UPDATE TO 9TH ED. (2026)	FBC LFS
3	7/06/23	UPDATE TO 8TH ED. (2023)	FBC LFS
2	10/14/20	UPDATE TO 7TH ED. (2020)	FBC LFS
1	7/14/20	REVISE DESIGN PRESSURE TABLE & ULT. HURRICANE ASTRAGAL	RW

DATE: 8/20/19

SCALE: N.T.S.

DWG. BY: RW


CHK. BY: LFS

DRAWING NO.:


FL-30037.8

SHEET 9 OF 12

Z:\2023 FBC Drawings\Wincore Window Company\FL-30037 R5\FL-30037.8.dwg

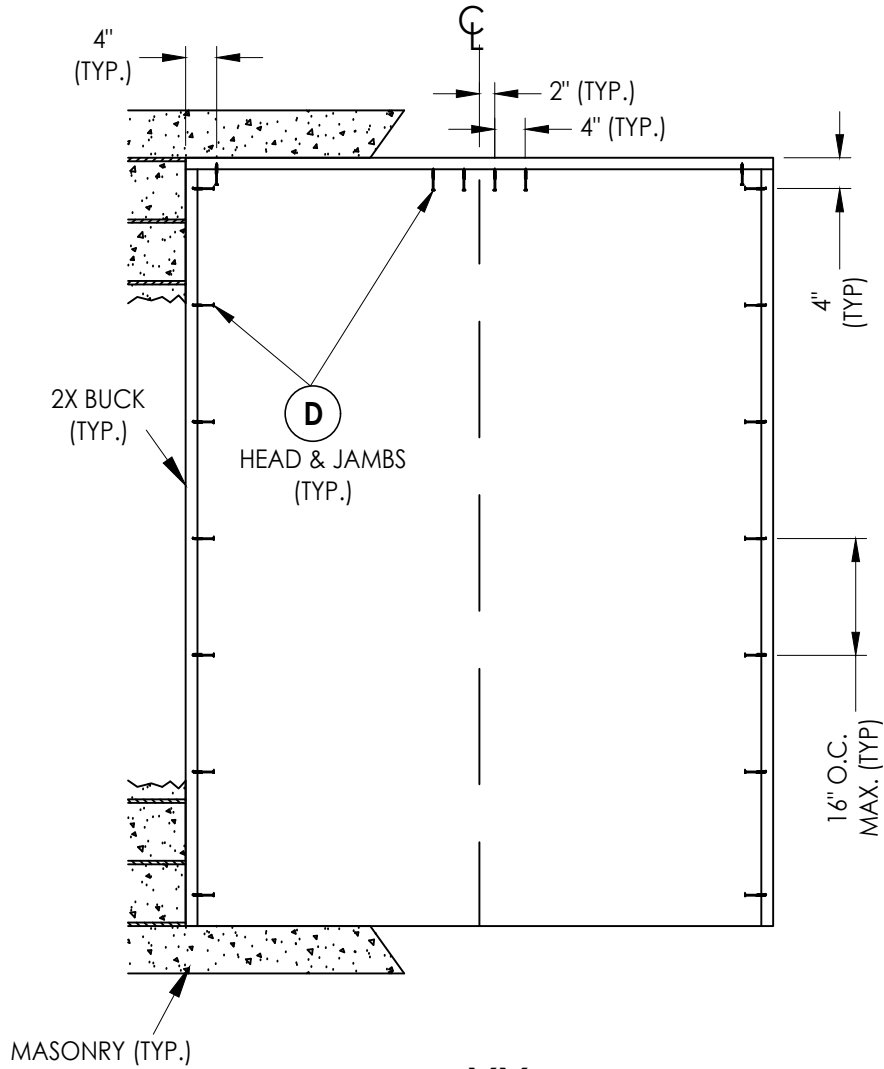



XX

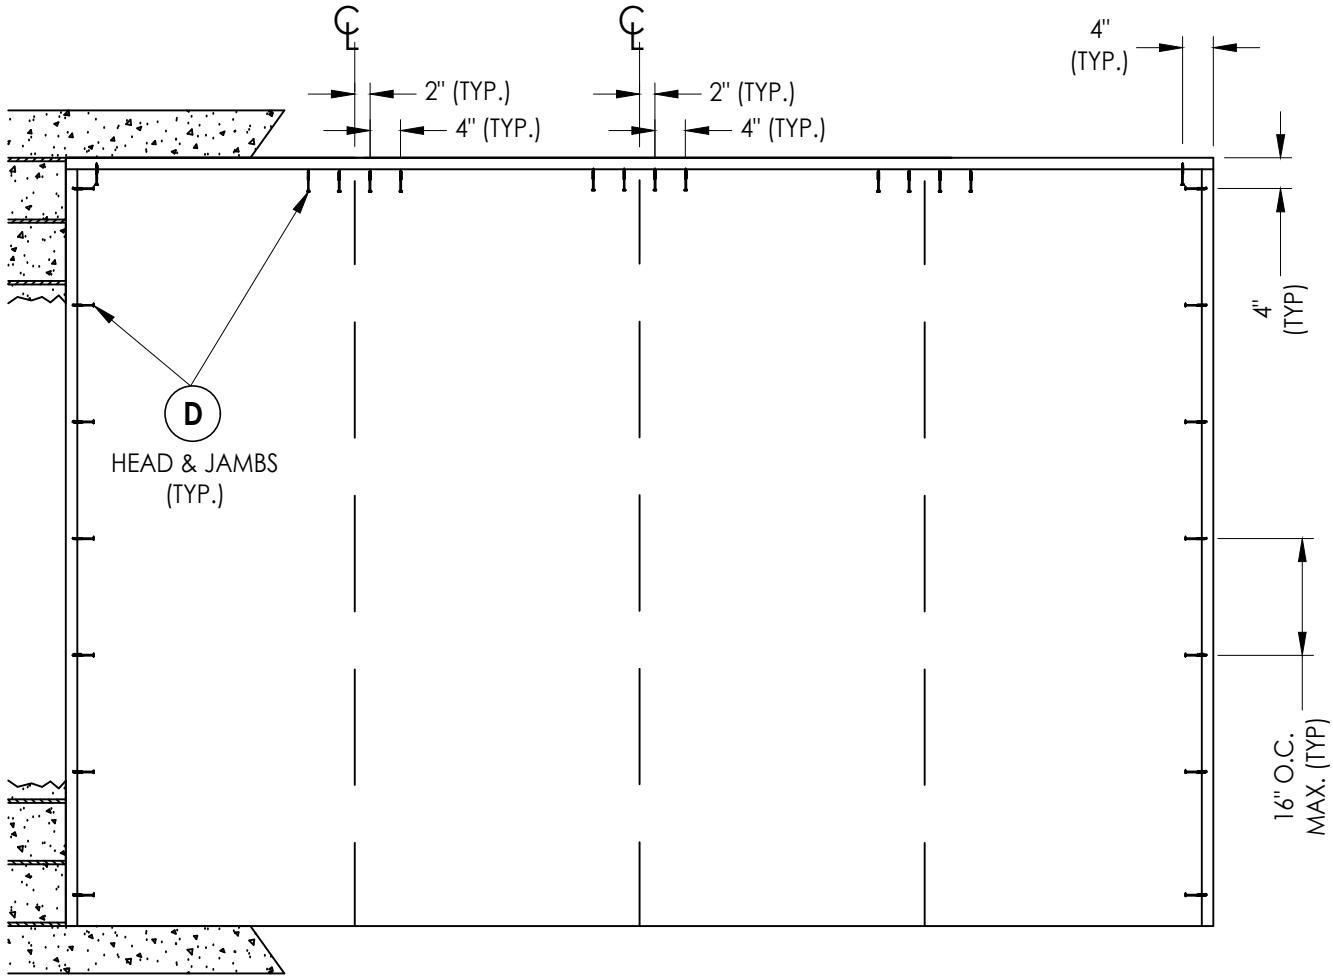


OXXO (Shown)
XXO, OOX (Similar)

2X BUCK ANCHORING


Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409				RW BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813			
PRODUCT:		WINCORE FIBERGLASS ENTRY DOOR "Impact"		PART OR ASSEMBLY:		BUCK ANCHORING	
4	7/01/26	UPDATE TO 9TH ED. (2026)	FBC	LFS			
3	7/06/23	UPDATE TO 8TH ED. (2023)	FBC	LFS			
2	10/14/20	UPDATE TO 7TH ED. (2020)	FBC	LFS			
1	7/14/20	REVISE DESIGN PRESSURE TABLE & ULT. HURRICANE ASTRAGAL	TABLE	RW			
	NO.	DATE					
REVISIONS							
DATE: 8/20/19							
SCALE: N.T.S.							
DWG. BY: RW							
CHK. BY: LFS							
DRAWING NO.: FL-30037.8							
SHEET 10 OF 12							

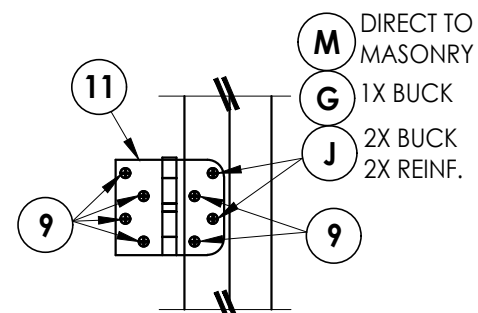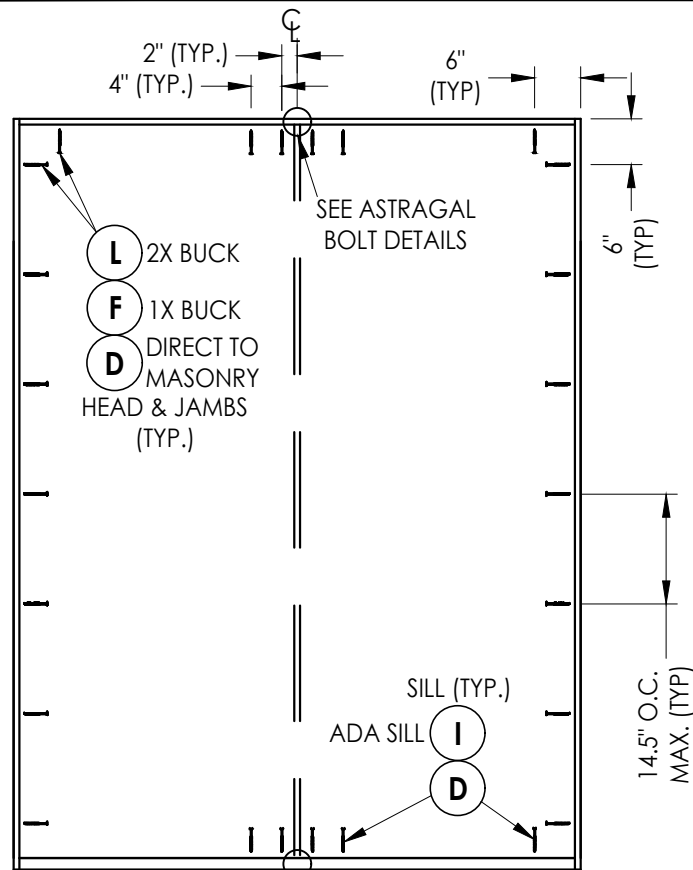


HINGE DETAIL 1

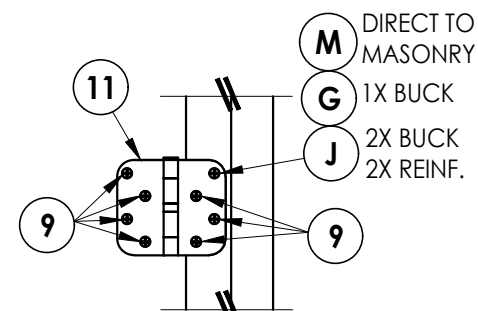



HINGE DETAIL 2

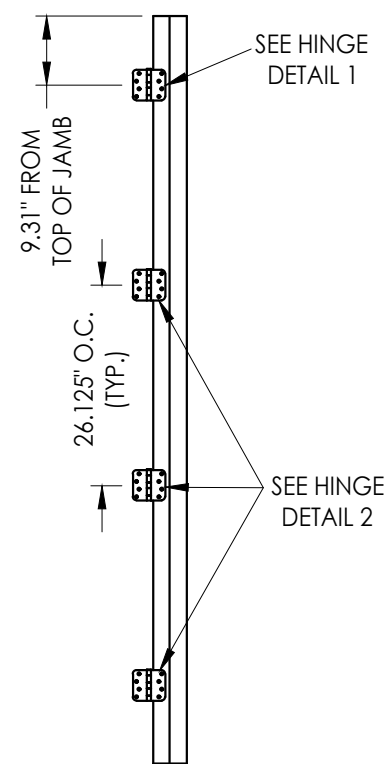

HINGE JAMB

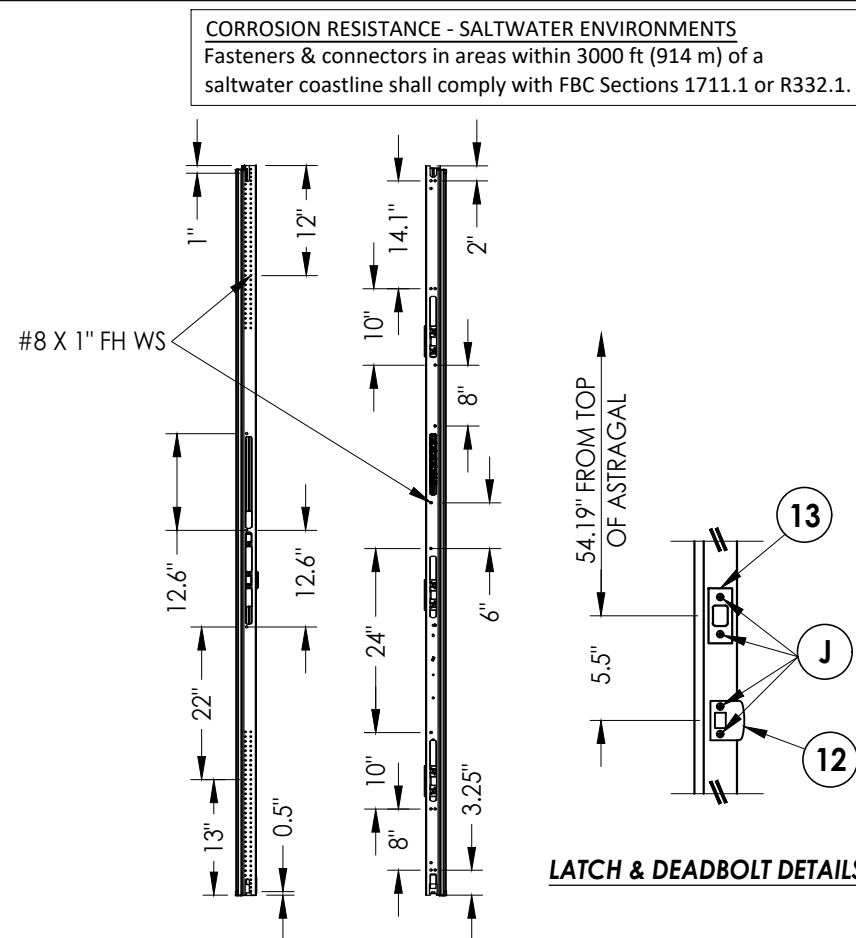


LATCH & DEADBOLT DETAILS

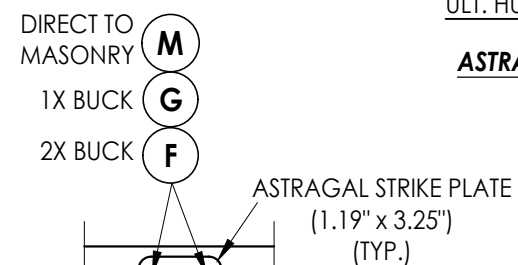


ASTRAGAL BOLT DETAIL

Strike Plate @ Head





ASTRAGAL BOLT DETAIL


Strike Plate @ Sill
Outswing Threshold

ASTRAGAL BOLT DETAIL

Strike Plate @ Sill
Inswing Threshold

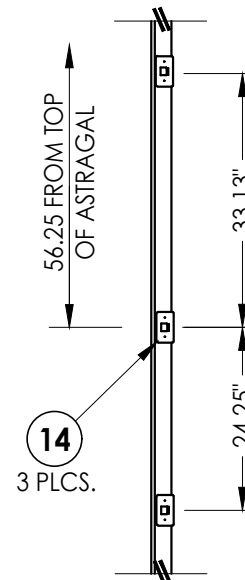

MULTI-POINT STRIKE DETAILS

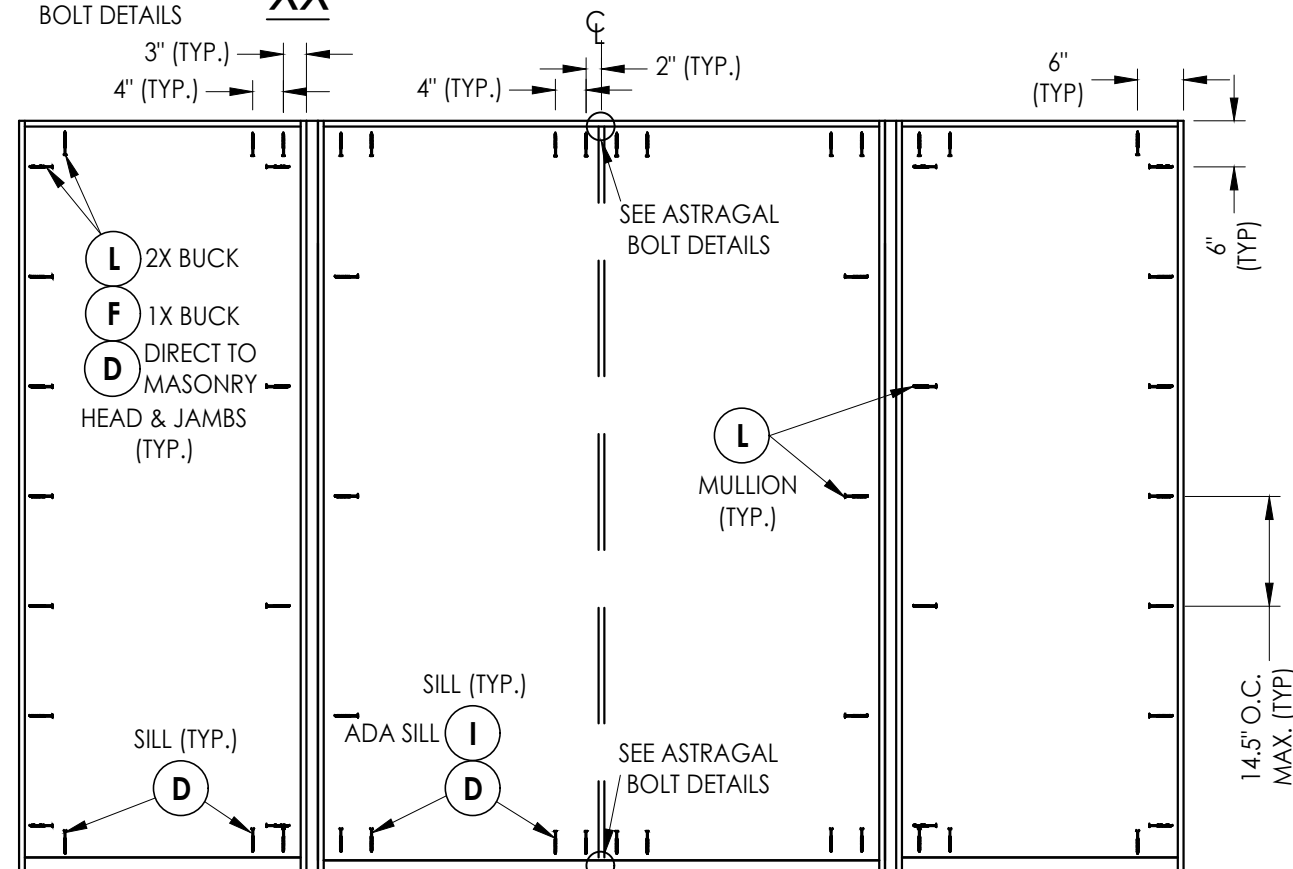

OXXO (Shown)

XXO, OXX (Similar - Use jamb anchoring from XX above)

FRAME ANCHORING

HARDWARE DETAILS

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409					WINCORE FIBERGLASS ENTRY DOOR "Impact" PART OR ASSEMBLY: FRAME ANCHORING & HARDWARE DETAILS 4 7/01/26 UPDATE TO 9TH ED. (2026) FBC LFS 3 7/06/23 UPDATE TO 8TH ED. (2023) FBC LFS 2 10/14/20 UPDATE TO 7TH ED. (2020) FBC LFS 1 7/14/20 REVISE DESIGN PRESSURE TABLE & ULT. HURRICANE ASTRAGAL RW NO. DATE REVISIONS				
DATE: 8/20/19 SCALE: N.T.S. DWG. BY: RW CHK. BY: LFS DRAWING NO.: FL-30037.8									
SHEET 11 OF 12									

Z:\2023 FBC Drawings\Wincore Window Company\FL-30037 R5\FL-30037.8.dwg

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (G >= 0.42)	WOOD
B	2X BUCK (G >= 0.42)	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" PFH CONCRETE SCREW (1-1/4" MIN. EMB.)	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
G	3/16" x 3-1/4" PFH ITW CONCRETE SCREW	STEEL
I	1/4" X 1-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMB.)	STEEL
M	3/16" X 2-1/4" ITW CONCRETE SCREW	STEEL
N	3/16" X 2-3/4" ITW CONCRETE SCREW	STEEL
P	1/4" X 2-1/4" PFH DeWALT CONCRETE SCREW	STEEL
R	#8 X 2-1/2" PFH WOOD SCREW	STEEL
1	POLY FIBER JAMB	COMP.
5	2X REINFORCEMENT (G >= 0.55)	WOOD
6	DOOR SWEEP	PVC
7	WEATHERSTRIP (ENDURA FORCE 5)	FOAM
8	WEATHERSTRIP (Q-LON)	FOAM
9	#9 X 3/4" PFH WOOD SCREW	STEEL
11	4" X 4" HINGE (SQUARE OR RADIUS)	STEEL
12	LATCH STRIKE PLATE	STEEL
13	DEADBOLT STRIKE PLATE	STEEL
14	TRILENNIUM MULTI-POINT STRIKE PLATE	STEEL
20	INSWING THRESHOLD	ALUM/COMP
21	INSWING THRESHOLD w/ SIDELITE ADAPTER	ALUM/COMP
22	OUTSWING THRESHOLD	ALUM/COMP
23	OUTSWING THRESHOLD w/ SIDELITE ADAPTER	ALUM/COMP
24	ADA THRESHOLD	ALUM
25	OUTSWING THRESHOLD	ALUM/WOOD
26	INSWING THRESHOLD	ALUM/WOOD
27	INSWING THRESHOLD w/ SIDELITE ADAPTER	ALUM/WOOD
28	INSWING ADA THRESHOLD	ALUM
29	OUTSWING ADA THRESHOLD	ALUM
33	ASTRAGAL (ENDURA)	ALUM
40	DOOR PANEL	-
50	SIDELITE PANEL	-


CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:


ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW BUILDEX TAPCON®	3/16"	1-1/4"	3"	1-1/2"
	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:


- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

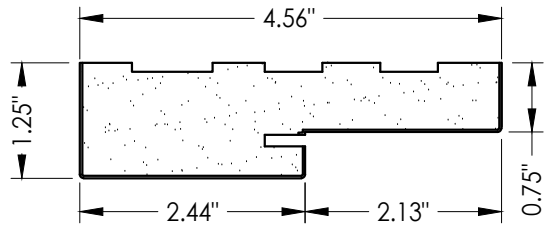


1 POLY FIBER JAMB

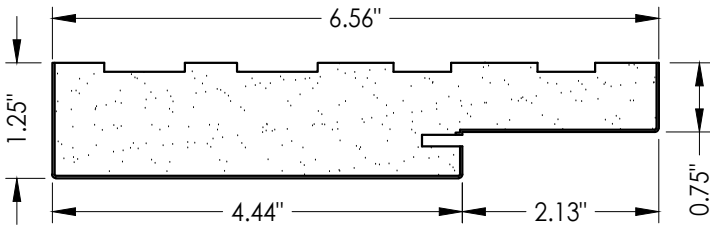


20 INSWING THRESHOLD
Endura (Z-Series)

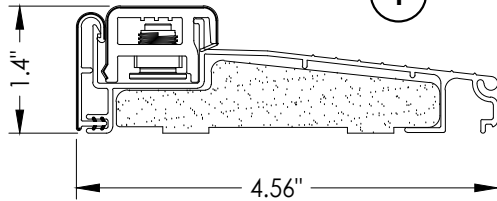


21 INSWING THRESHOLD w/ SIDELITE ADAPTER
Endura (Z-Series)

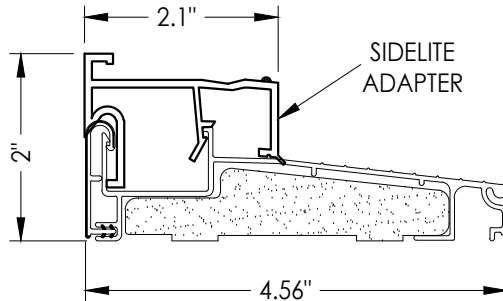



25 OUTSWING THRESHOLD
DLP

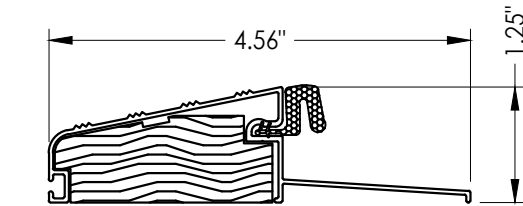


26 INSWING THRESHOLD
DLP

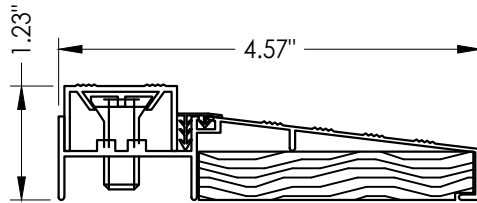


28 INSWING ADA THRESHOLD
Endura (Z-Series)

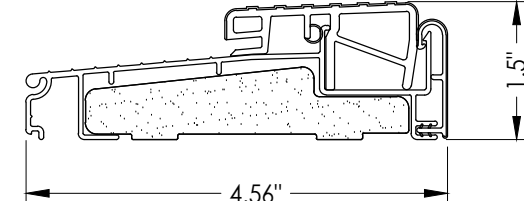


22 OUTSWING THRESHOLD
Endura (Z-Series)

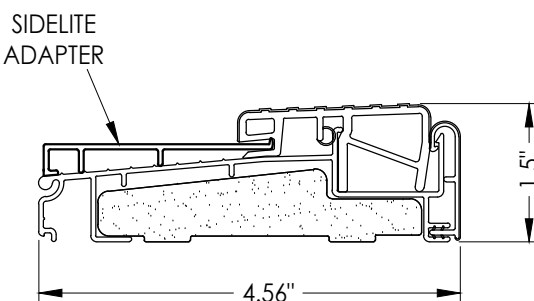


23 OUTSWING THRESHOLD w/ SIDELITE ADAPTER
Endura (Z-Series)

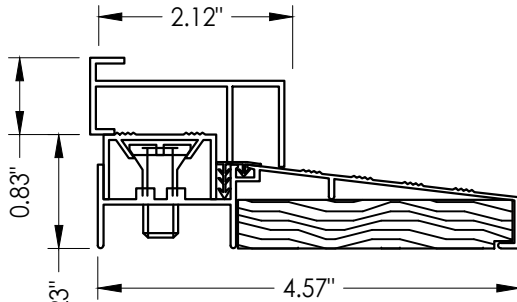


27 INSWING THRESHOLD w/ SIDELITE ADAPTER
DLP

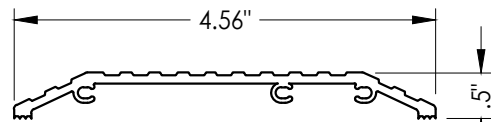

24 ADA THRESHOLD
DLP

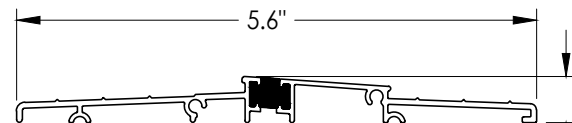

29 OUTSWING ADA THRESHOLD
Endura (Z-Series)

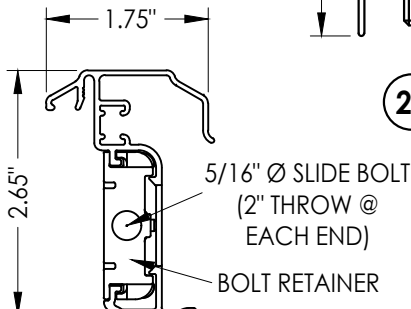

33 ENDURA ASTRAGAL
Ultimate Hurricane
Ultimate Trilennium

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: WINCORE
FIBERGLASS ENTRY DOOR
"Impact"

PART OR ASSEMBLY:
BILL OF MATERIALS
& COMPONENTS

	LFS	FBC	FBC	FBC	RW	BY
4	7/01/26	UPDATE TO 9TH ED. (2026)	7/06/23	UPDATE TO 8TH ED. (2023)	10/14/20	UPDATE TO 7TH ED. (2020)
3	7/06/23	UPDATE TO 8TH ED. (2023)	10/14/20	UPDATE TO 7TH ED. (2020)	7/14/20	REVISE DESIGN PRESSURE TABLE & ULT. HURRICANE ASTRAGAL
2	10/14/20	UPDATE TO 7TH ED. (2020)	7/14/20	REVISE DESIGN PRESSURE TABLE & ULT. HURRICANE ASTRAGAL		
1	7/14/20	REVISE DESIGN PRESSURE TABLE & ULT. HURRICANE ASTRAGAL				
NO.	DATE	REVISIONS				

DATE: 8/20/19

SCALE: N.T.S.

DWG. BY: RW

CHK. BY: LFS

DRAWING NO.: FL-30037.8

SHEET 12 OF 12