

THESE WINDOWS ARE RATED FOR SMALL MISSILE IMPACT.
F.B.C. APPROVED IMPACT RESISTANT SHUTTERS
REQUIRED FOR INSTALLATIONS UP TO 30 FT. OF GRADE.
SHUTTERS NOT REQD. FOR INSTALLATIONS ABOVE 30 FT. OF GRADE.

SERIES-100SH
ALUMINUM SINGLE HUNG WINDOW

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEET 3.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE
COMBINATIONS OF S.H./S.H. OR SINGLE HUNG WITH OTHER
WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING
F.B.C. APPROVED MULLIONS IN BETWEEN.

LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL
WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2020 (7TH EDITION)/2023 (8TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.


ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2020/2023 FLORIDA BLDG. CODE & ADOPTED STANDARDS.


THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, I.E. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC.
CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION
IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE.
LABELING TO COMPLY WITH SECTION 1709.9.2.

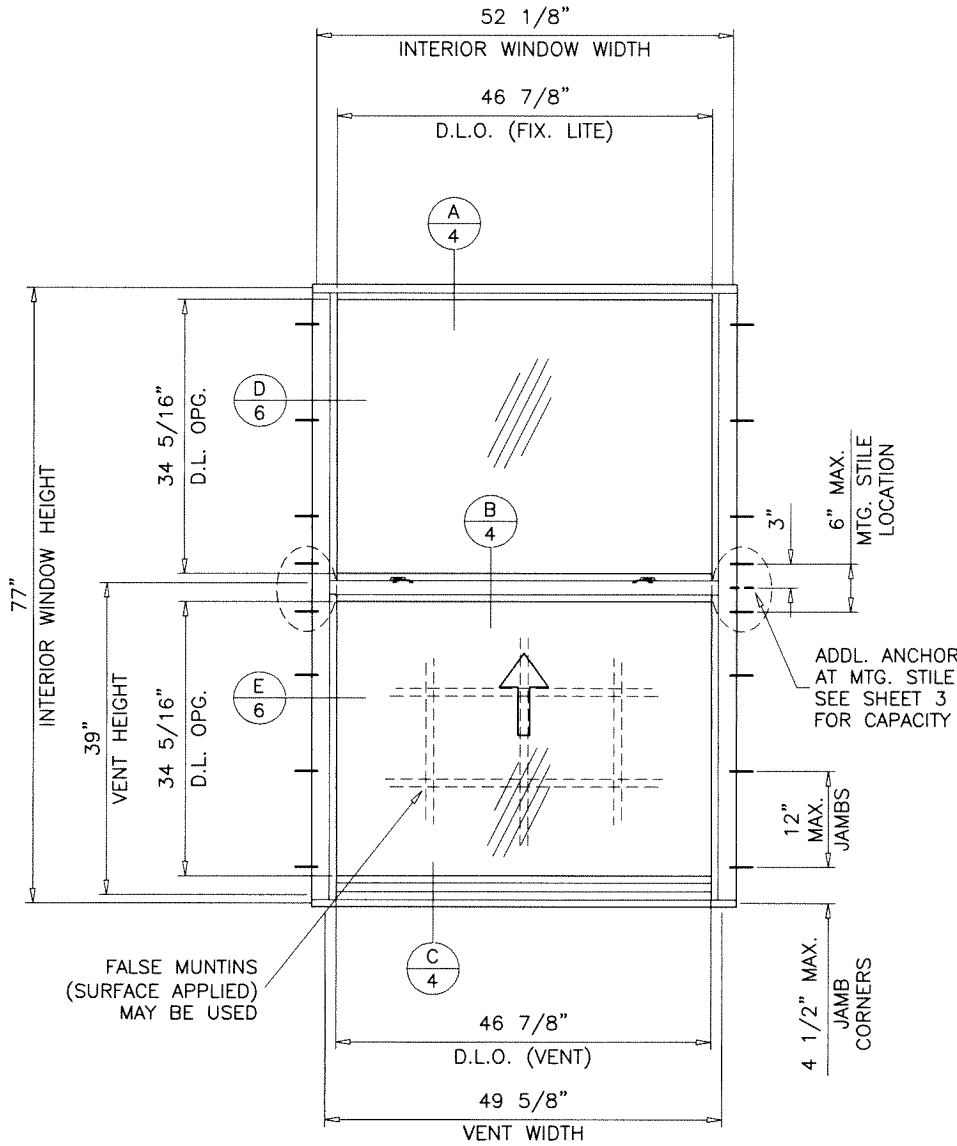

TYPICAL ELEVATION
EQUAL LITES

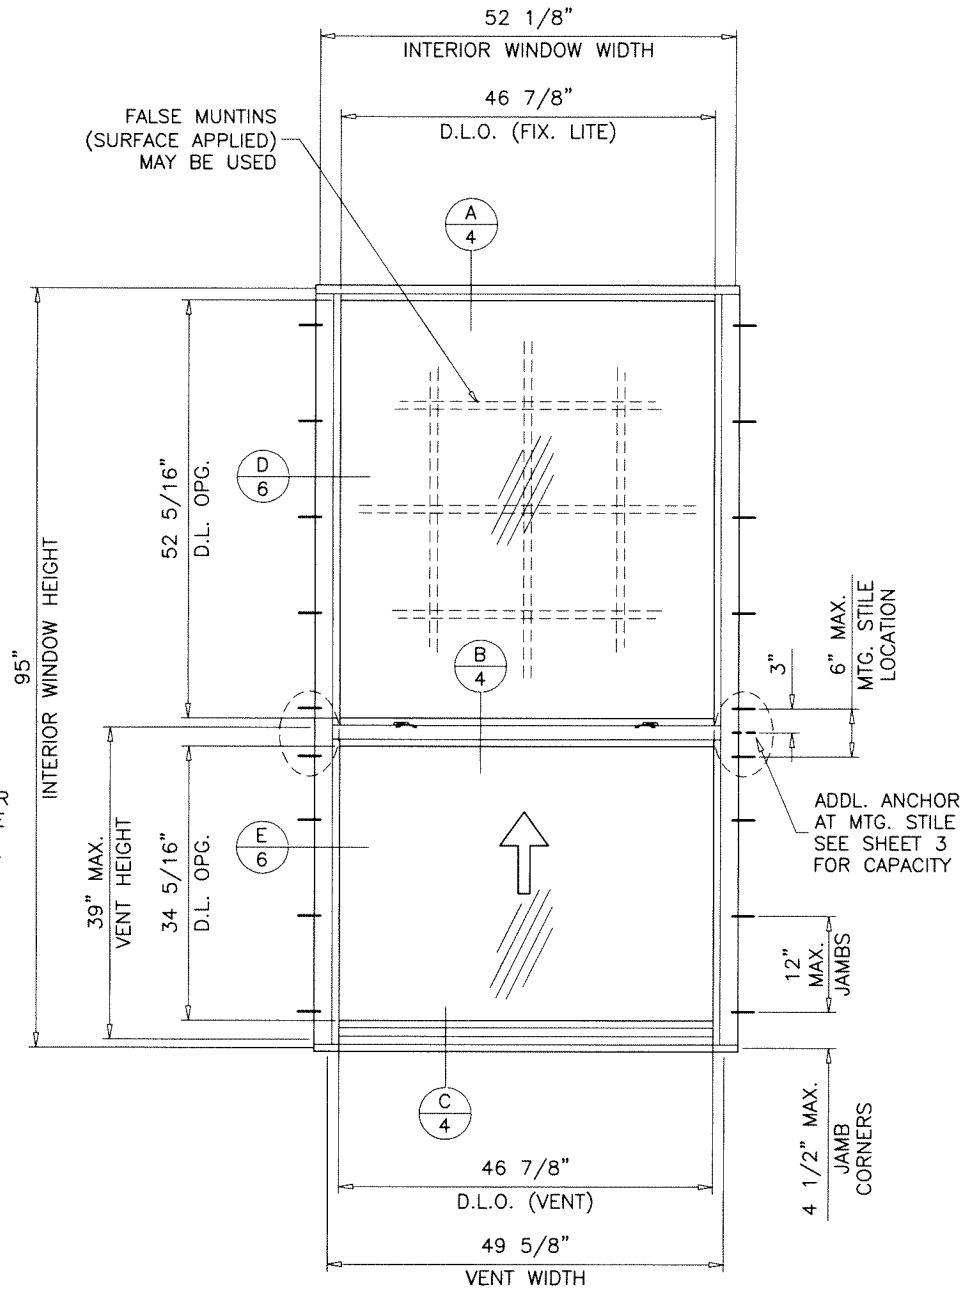


TYPICAL ELEVATION
UNEQUAL LITES (ORIEL TYPE)
TESTED UNIT

Sealed: 9/22/2023

FL #30350

- A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT.
- B- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.
- C- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC DRAWINGS FOR REVIEW.
- D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

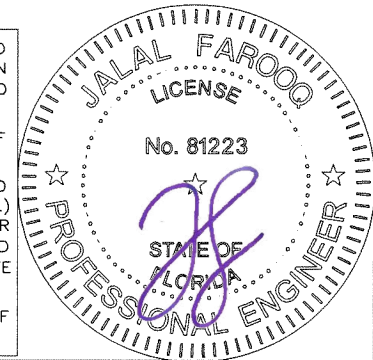

SERIES-100SH ALUM SINGLE HUNG WDW. (S.M.I.)

Alcon Windows And Doors Corp.

7240 N.W. 46th Street
Miami, FL. 33166

Tel. (305) 553-0229 Fax. (786) 363-8141


Tel. (305) 553-0229 Fax. (786) 363-8141

Tel. (305) 553-0229 Fax. (786) 363-8141


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANI\19-74F-AWC


date: 08-14-19		revisions:	
drawing no. 19-74F		no date	by description
sheet 1 of 8		A 09.19.23	UPDATED TO 2023 FBC
scale: 1/2"=1'-0"			
dr. by: TARIQ			
chk. by:			

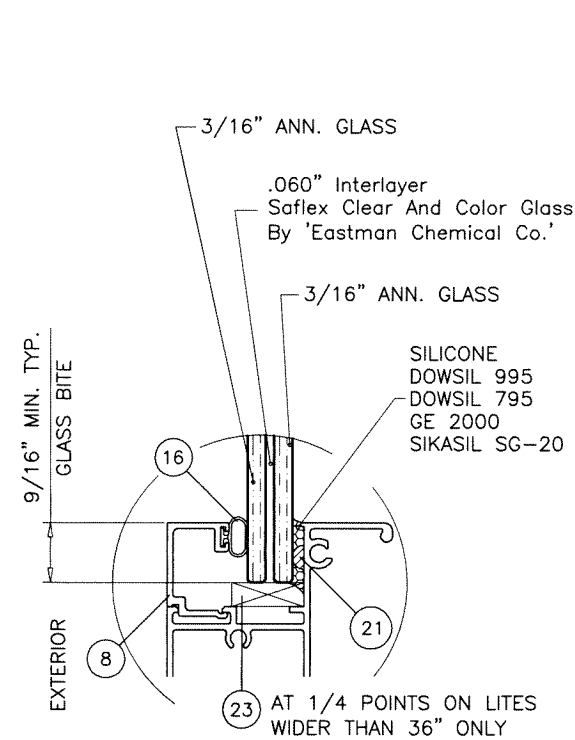


GLASS TYPE 'A'
7/16" OVERALL LAM. GLASS

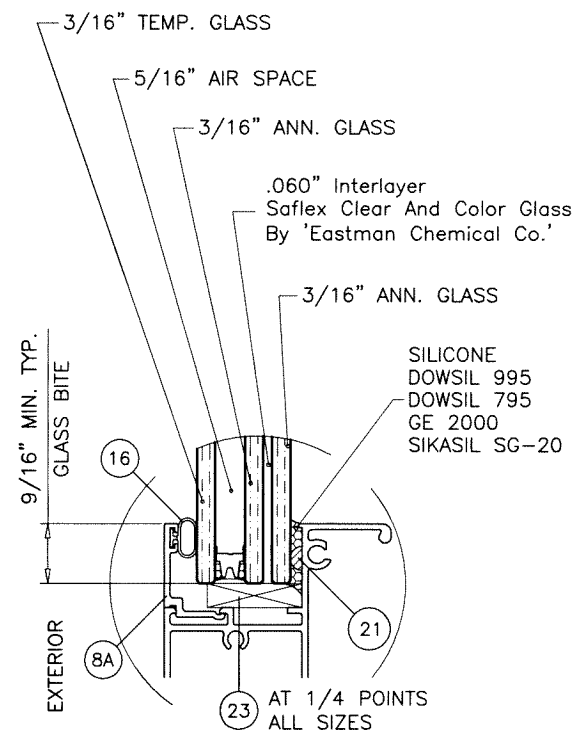

GLASS TYPE 'Ai'
15/16" OVERALL INSUL. LAM. GLASS

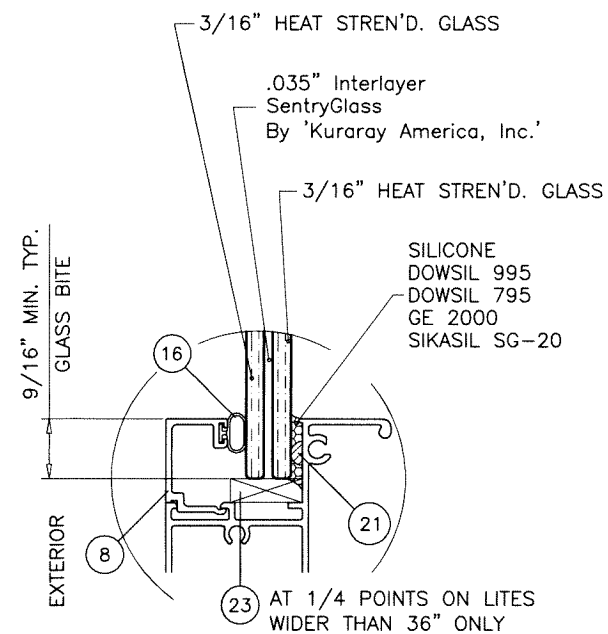


GLASS TYPE 'B'
7/16" OVERALL LAM. GLASS

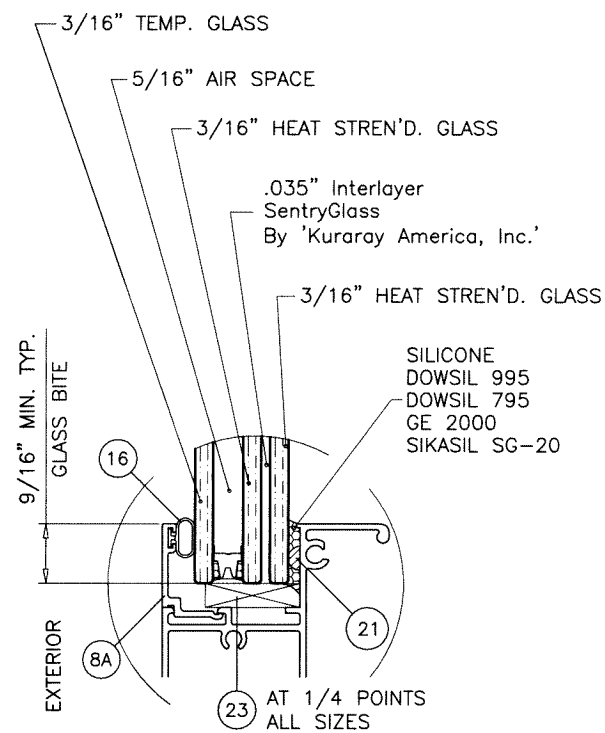

GLASS TYPE 'Bi'
15/16" OVERALL INSUL. LAM. GLASS

Sealed: 9/22/2023

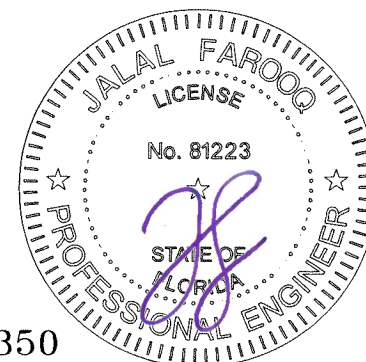

FL #30350

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES-100SH ALUM SINGLE HUNG WDW. (S.M.I.)

Alcon Windows And Doors Corp.
7240 N.W. 46th Street
Miami, FL 33166
Tel. (305) 553-0229 Fax. (786) 363-8141


date: 08-14-19		revisions:	
scale: -	no	date	by
dr. by: TARIQ			
chk. by:			
drawing no. 19-74F		description	
sheet 2 of 8			

EQUAL LITES WINDOWS DESIGN LOAD CAPACITY - PSF				
INTERIOR FRAME DIMS.		GLASS TYPES 'A', 'Ai', 'B', 'Bi'		
WIDTH	HEIGHT	EXT.(+)	1NT.(-)	
18-1/8"	25"	80.0	95.0	
25-1/2"		80.0	95.0	
36"		80.0	95.0	
52-1/8"		80.0	95.0	
18-1/8"	37-3/8"	80.0	95.0	
25-1/2"		80.0	95.0	
36"		80.0	95.0	
52-1/8"		80.0	95.0	
18-1/8"	49-5/8"	80.0	95.0	
25-1/2"		80.0	95.0	
36"		80.0	95.0	
52-1/8"		80.0	95.0	
18-1/8"	55"	80.0	95.0	
25-1/2"		80.0	95.0	
36"		80.0	95.0	
52-1/8"		80.0	95.0	
18-1/8"	62"	80.0	95.0	
25-1/2"		80.0	95.0	
36"		80.0	95.0	
52-1/8"		80.0	95.0	
18-1/8"	71"	80.0	95.0	
25-1/2"		80.0	95.0	
36"		80.0	95.0	
52-1/8"		80.0	93.1	80.0 95.0 *
18-1/8"	77"	80.0	95.0	
25-1/2"		80.0	95.0	
36"		80.0	95.0	
52-1/8"		80.0	90.2	80.0 95.0 *

EQUAL LITES WINDOWS DESIGN LOAD CAPACITY - PSF				
INTERIOR FRAME DIMS.		GLASS TYPES 'A', 'Ai', 'B', 'Bi'		
WIDTH	HEIGHT	EXT.(+)	1NT.(-)	
23"	47"	80.0	95.0	
29"		80.0	95.0	
31"		80.0	95.0	
35"		80.0	95.0	
41"		80.0	95.0	
47"		80.0	95.0	
23"	59"	80.0	95.0	
29"		80.0	95.0	
31"		80.0	95.0	
35"		80.0	95.0	
41"		80.0	95.0	
47"		80.0	95.0	
23"	71"	80.0	95.0	
29"		80.0	95.0	
31"		80.0	95.0	
35"		80.0	95.0	
41"		80.0	95.0	
47"		80.0	95.0	
23"	83"	80.0	95.0	
29"		80.0	95.0	
31"		80.0	95.0	
35"		80.0	95.0	
41"		80.0	95.0	
47"		80.0	95.0	
23"	93"	80.0	95.0	
29"		80.0	95.0	
31"		80.0	95.0	
35"		80.0	95.0	
41"		80.0	95.0	
47"		80.0	95.0	


UNEQUAL LITES WINDOWS DESIGN LOAD CAPACITY - PSF				
INTERIOR FRAME DIMS.		MIN. VENT HEIGHT	GLASS TYPES 'A', 'Ai', 'B', 'Bi'	
WIDTH	HEIGHT		EXT.(+)	1NT.(-)
18-1/8"	37-3/8"	16"	80.0	95.0
25-1/2"			80.0	95.0
36"			80.0	95.0
52-1/8"			80.0	95.0
18-1/8"			80.0	95.0
25-1/2"	49-5/8"	16"	80.0	95.0
36"			80.0	95.0
52-1/8"			80.0	95.0
18-1/8"			80.0	95.0
25-1/2"			80.0	95.0
36"	55"	16"	80.0	95.0
52-1/8"			80.0	95.0
18-1/8"			80.0	95.0
25-1/2"			80.0	95.0
36"			80.0	95.0
52-1/8"	62"	16"	80.0	95.0
18-1/8"			80.0	95.0
25-1/2"			80.0	95.0
36"			80.0	95.0
52-1/8"			80.0	95.0
18-1/8"	71"	16"	80.0	95.0
25-1/2"			80.0	95.0
36"			80.0	95.0
52-1/8"			80.0	95.0
18-1/8"			80.0	95.0
25-1/2"	75"	20"	80.0	95.0
36"			80.0	95.0
52-1/8"			80.0	95.0
18-1/8"			80.0	95.0
25-1/2"			80.0	95.0
36"	95"	39"	80.0	95.0
52-1/8"			80.0	95.0
18-1/8"			80.0	95.0
25-1/2"			80.0	95.0
36"			80.0	95.0
52-1/8"			80.0	88.1 80.0 95.0 *

UNEQUAL LITES WINDOWS DESIGN LOAD CAPACITY - PSF				
INTERIOR FRAME DIMS.		MIN. VENT HEIGHT	GLASS TYPES 'A', 'Ai', 'B', 'Bi'	
WIDTH	HEIGHT		EXT.(+)	1NT.(-)
23"	47"	16"	80.0	95.0
29"			80.0	95.0
31"			80.0	95.0
35"			80.0	95.0
41"			80.0	95.0
47"			80.0	95.0
23"	59"	16"	80.0	95.0
29"			80.0	95.0
31"			80.0	95.0
35"			80.0	95.0
41"			80.0	95.0
47"			80.0	95.0
23"	71"	16"	80.0	95.0
29"			80.0	95.0
31"			80.0	95.0
35"			80.0	95.0
41"			80.0	95.0
47"			80.0	95.0
23"	83"	22"	80.0	95.0
29"			80.0	95.0
31"			80.0	95.0
35"			80.0	95.0
41"			80.0	95.0
47"			80.0	95.0
23"	93"	32"	80.0	95.0
29"			80.0	95.0
31"			80.0	95.0
35"			80.0	95.0
41"			80.0	95.0
47"			80.0	95.0
23"	95"	39"	80.0	95.0
29"			80.0	95.0
31"			80.0	95.0
35"			80.0	95.0
41"			80.0	95.0
47"			80.0	95.0

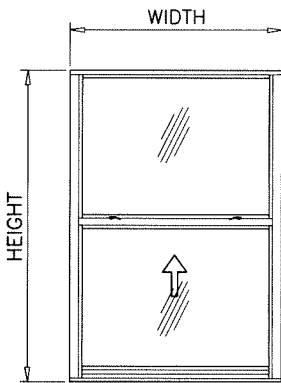

EQUAL LITES

*
DESIGN LOADS WITH ADDL. ANCHOR AT
MTG. STILE LOCATION

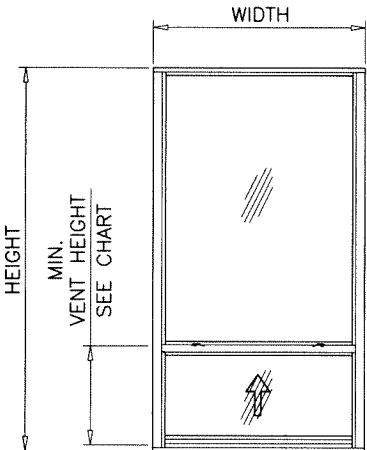


UNEQUAL LITES (ORIEL TYPE)

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

Sealed: 9/22/2023

FL #30350

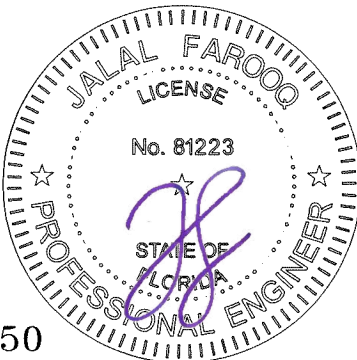

afC

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
FAX. (305) 262-6978
COMP - ANL 19-74F-AWC



SERIES-100SH ALUM SINGLE HUNG WDW. (S.M.I.)

Alcon Windows And Doors Corp.
7240 N.W. 46th Street
Miami, FL 33166
Tel. (305) 553-0229 Fax. (786) 363-8141

revisions:
no date by description


date: 08-14-19
scale: -
dr. by: TARIQ
chk. by:

drawing no.
19-74F
sheet 3 of 8

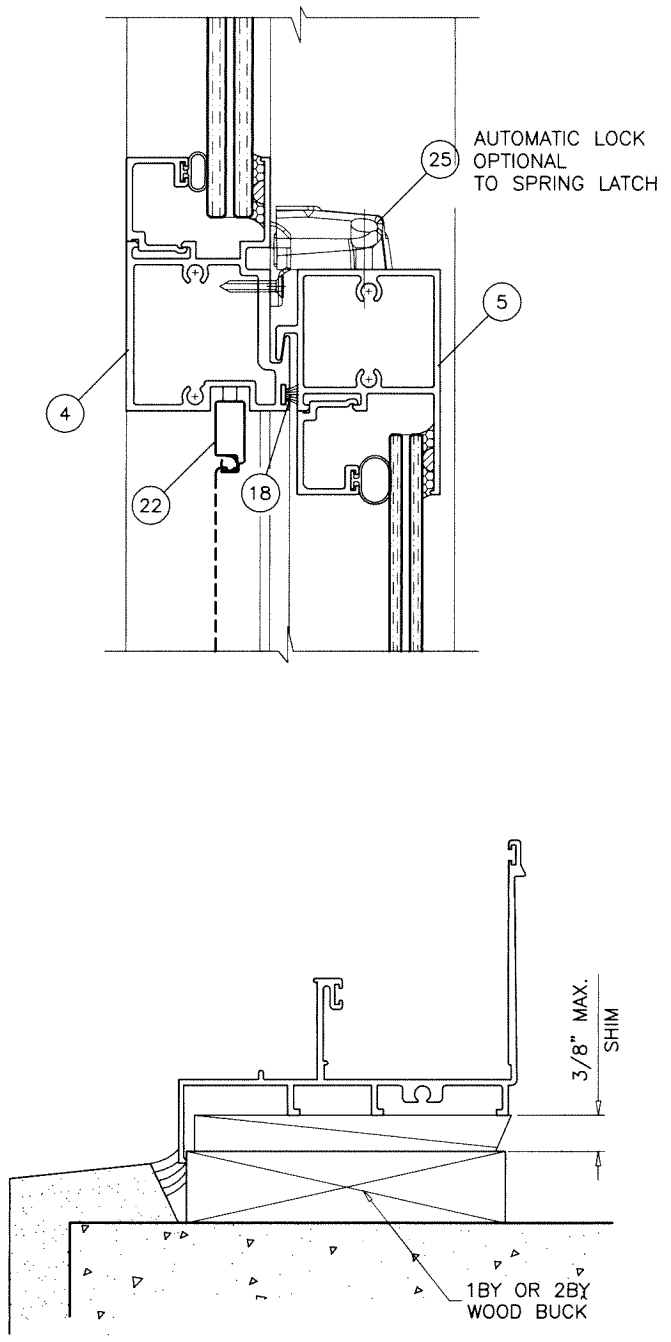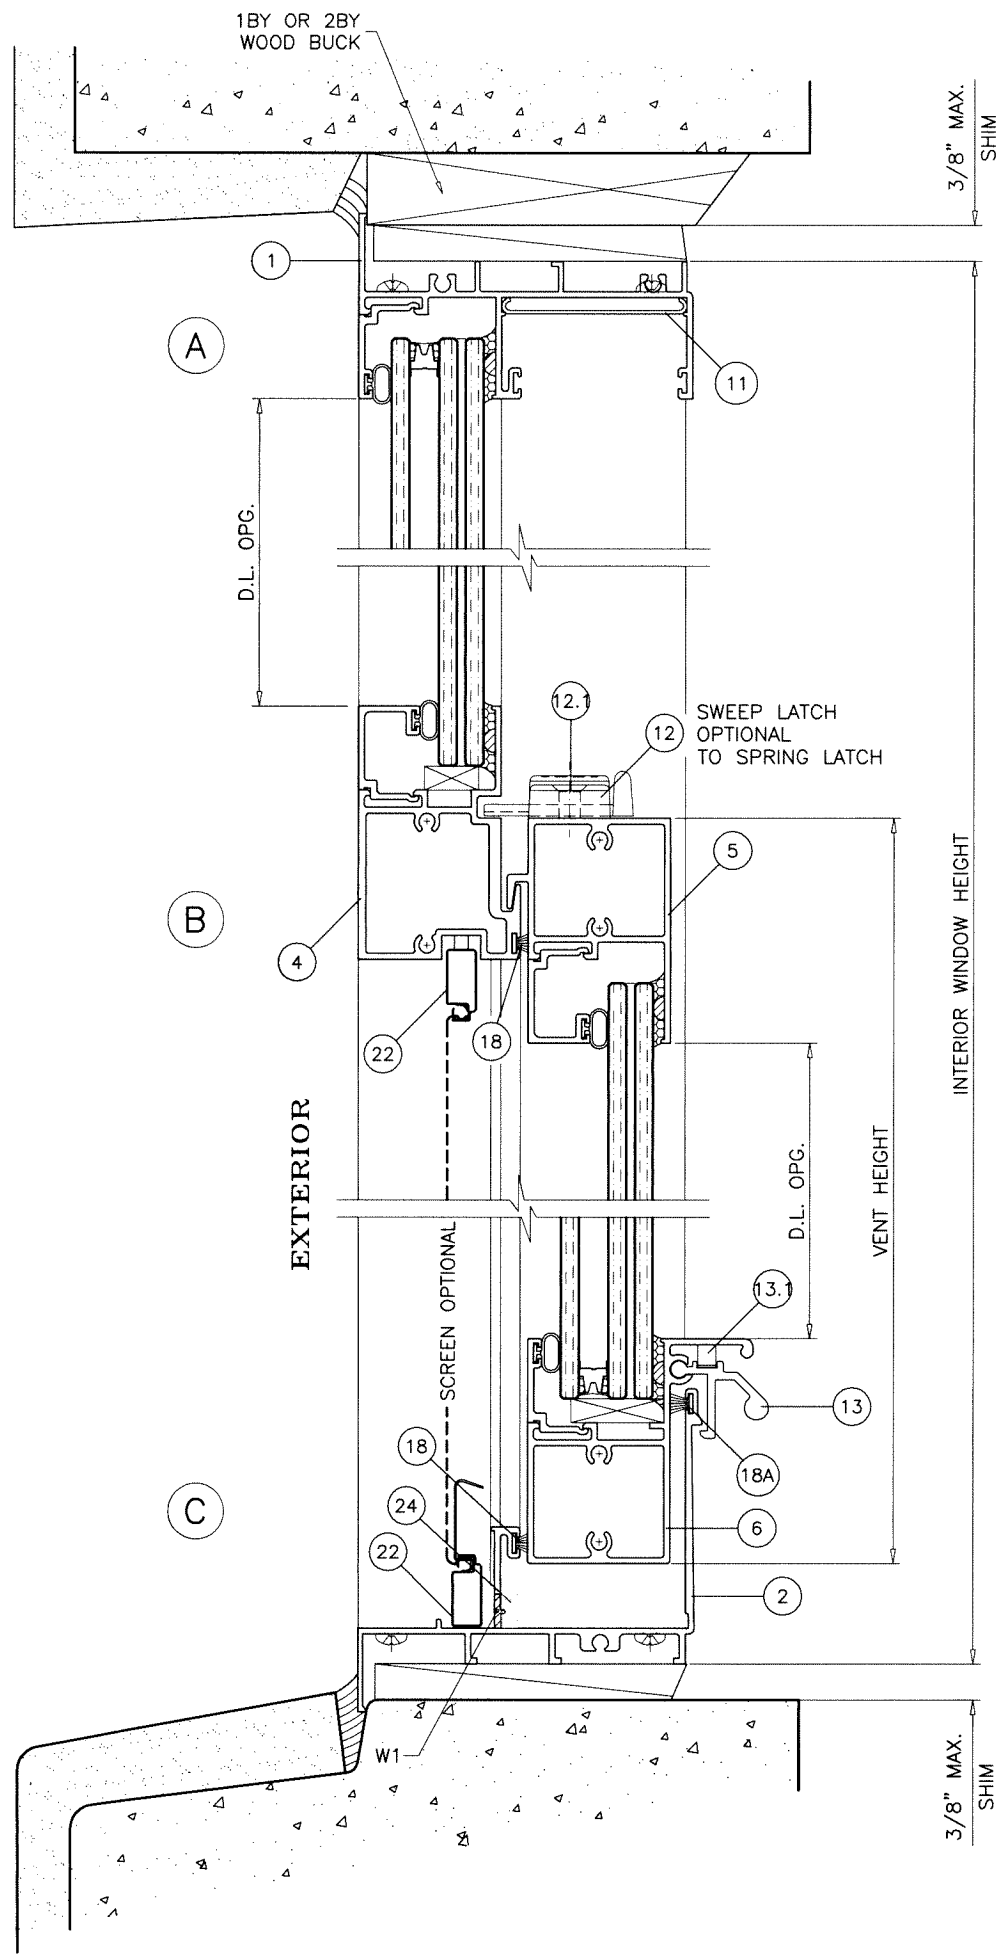

WEEPHOLES:
W1 = 1/4" X 2" WEEP NOTCHES AT EACH END.

Sealed: 9/22/2023

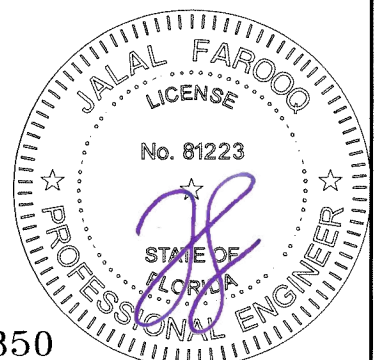

FL #30350

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL 19-74F-AWC



SERIES-100SH ALUM SINGLE HUNG WDW. (S.M.I.)

Alcon Windows And Doors Corp.
7240 N.W. 46th Street
Miami, FL. 33166
Tel. (305) 553-0229 Fax. (786) 363-8141

19-74F

revisions:		no		date		by description	
1							
2							
3							
4							

date:	08-14-19	scale:	1/2" = 1"	dr. by:	TARIQ	chk. by:	
drawing no.		19-74F					
sheet		4 of 8					

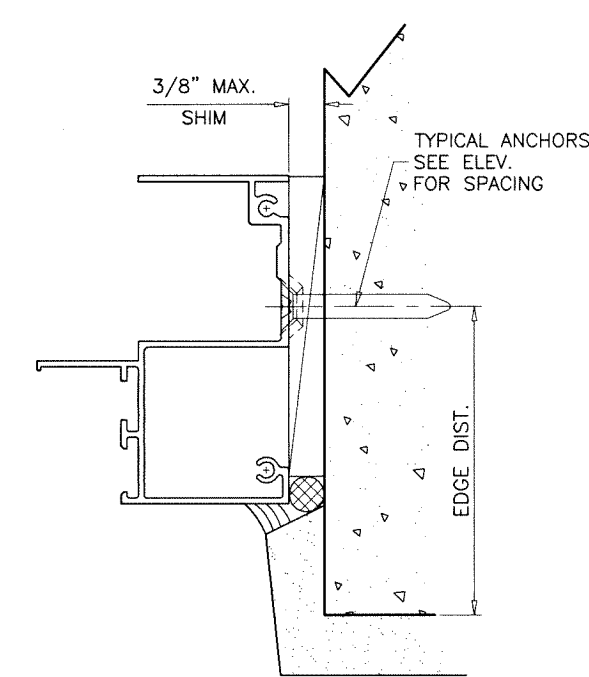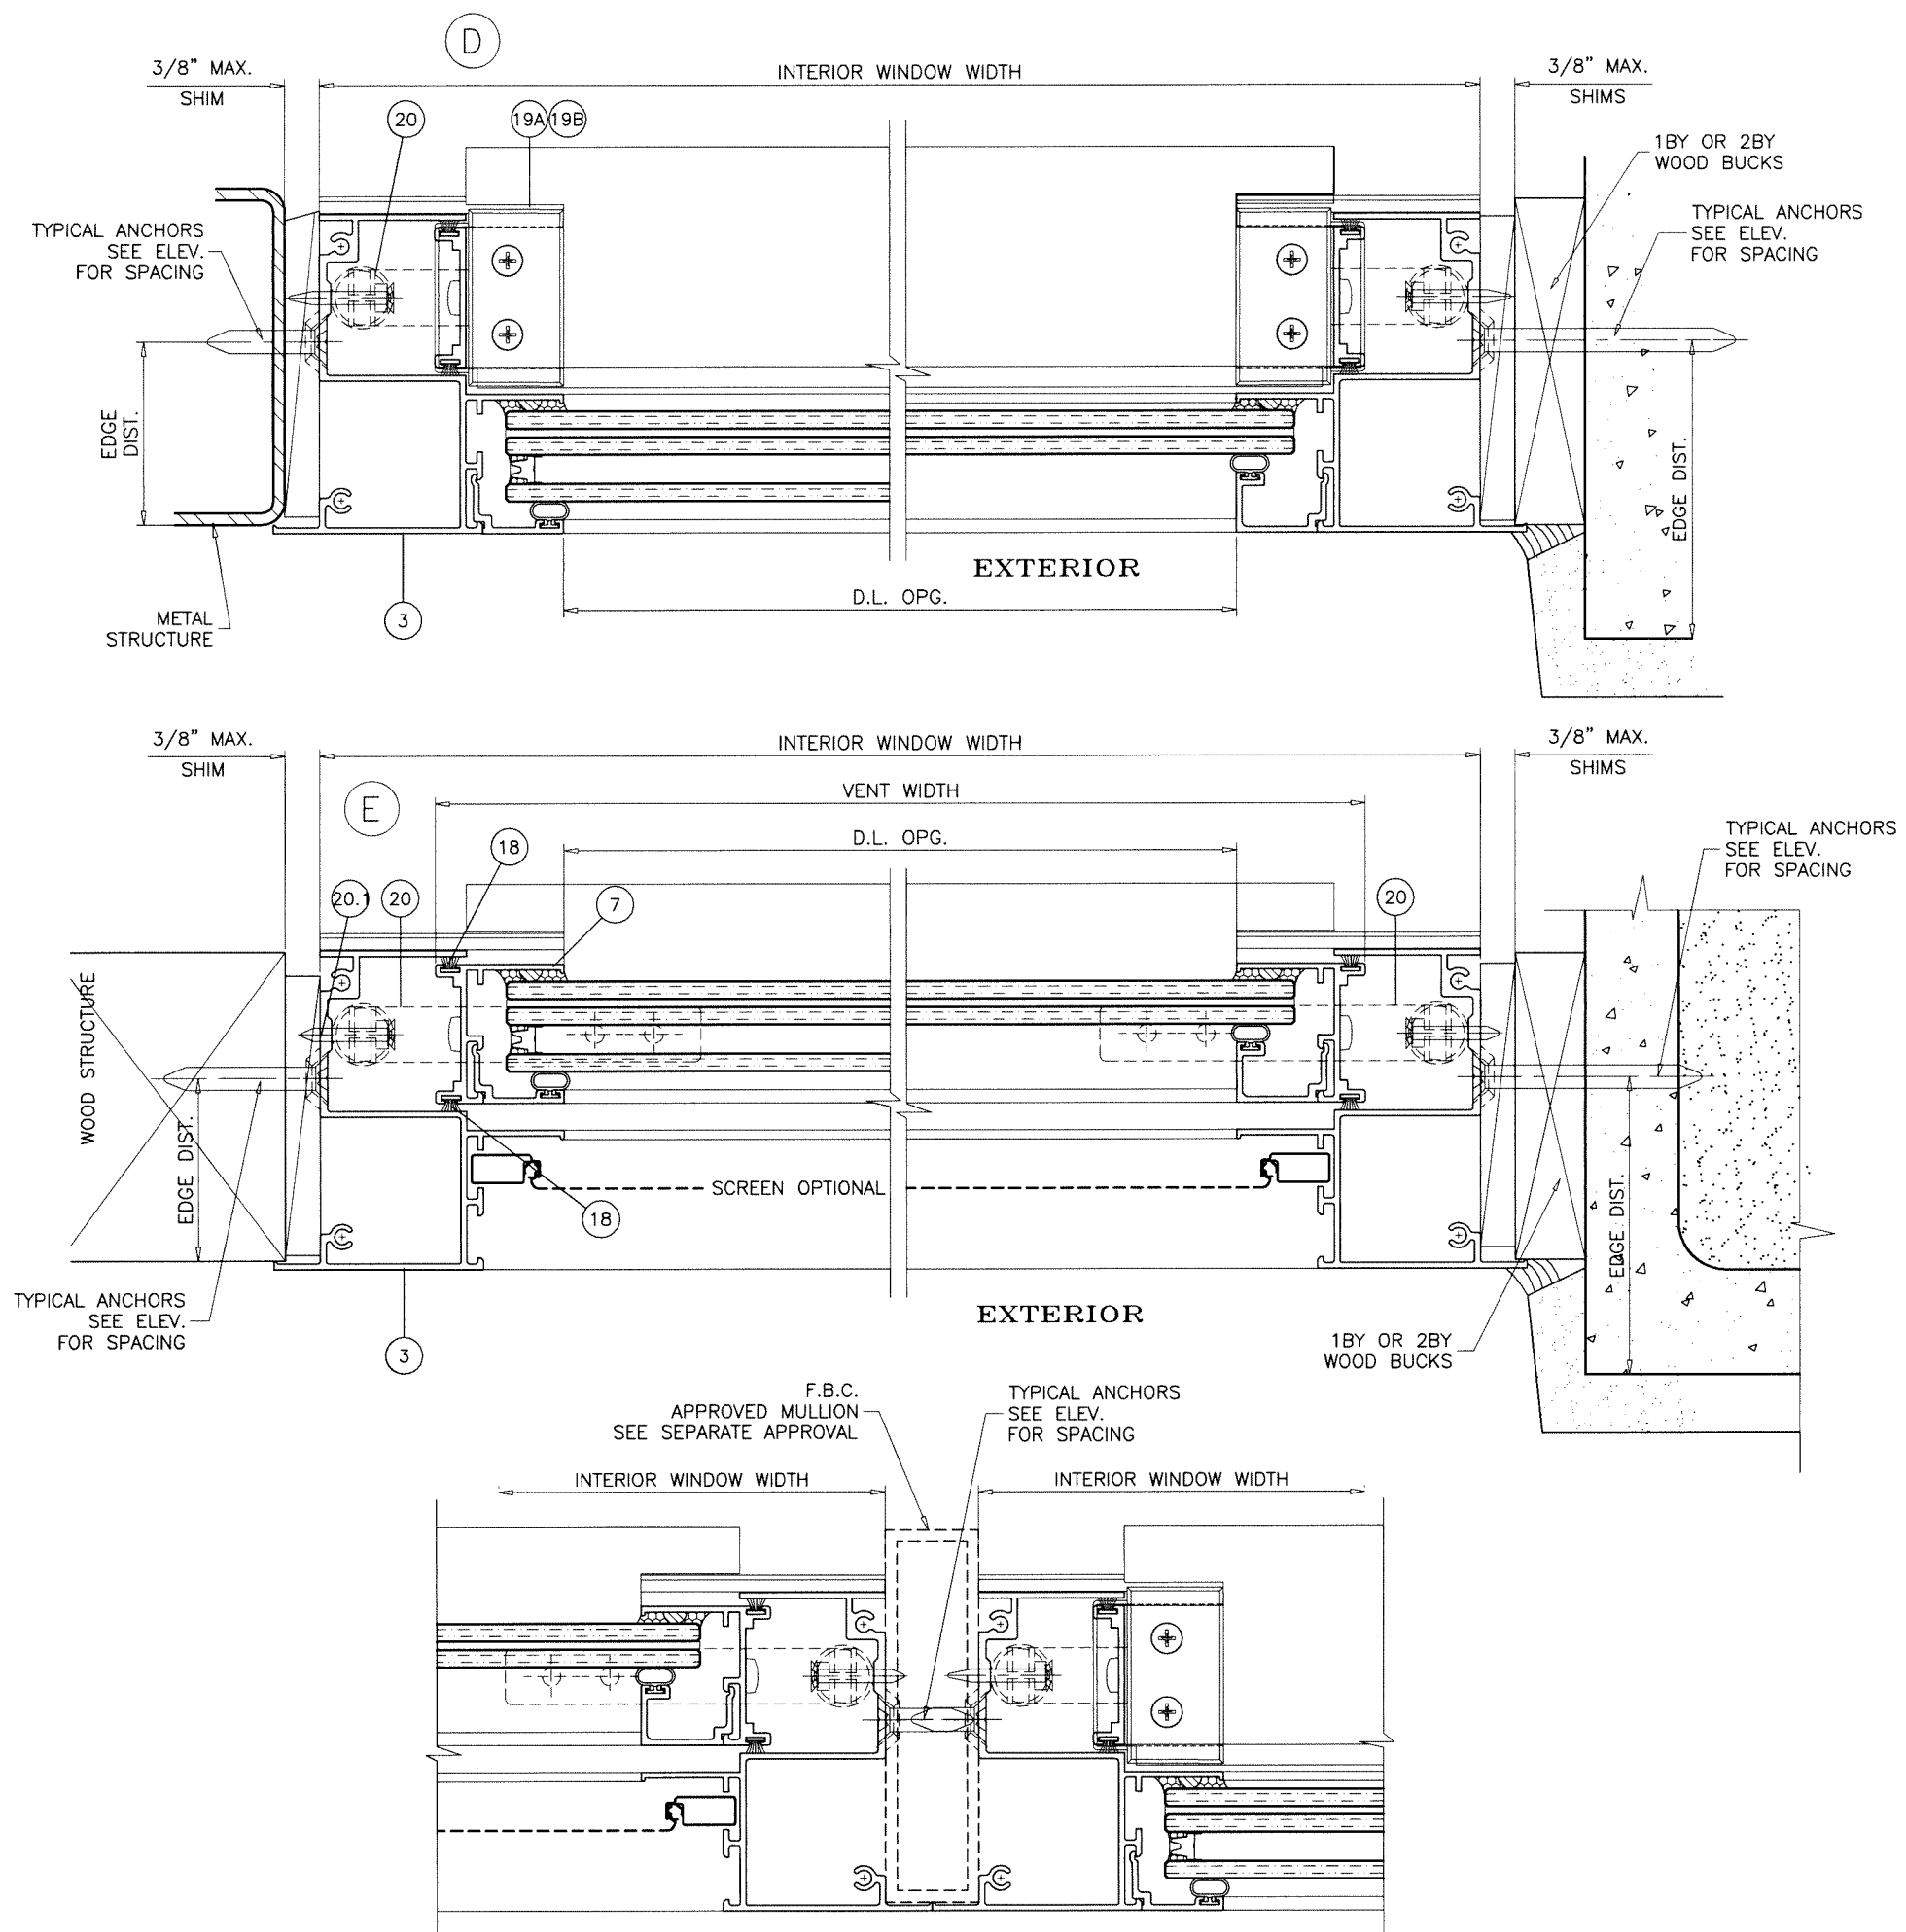

FLUSH FRAME WITH TRIMMED EXTERIOR FLANGE

Sealed: 9/22/2023



FL #30350

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL 19-74F-AWC










SERIES-100SH ALUM SINGLE HUNG WDW. (S.M.I.)

Alcon Windows And Doors Corp.
7240 N.W. 46th Street
Miami, FL. 33166
Tel. (305) 553-0229 Fax. (786) 363-8141



19-74F

revisions:		no		date		by		description	

date:	08-14-19	scale:	1/2" = 1"	dr. by:	TARIQ	chk. by:	
drawing no.		19-74F					
sheet		6 of 8					

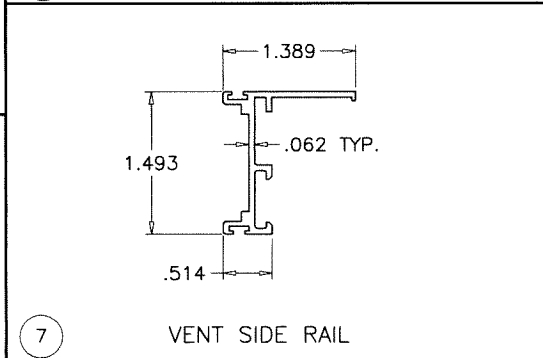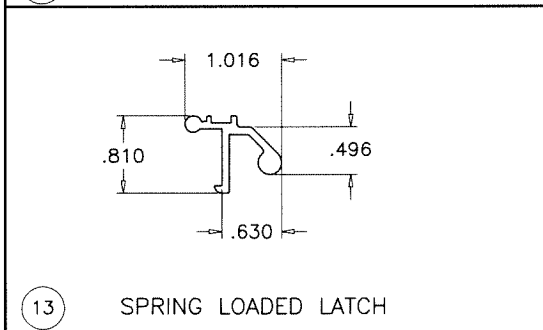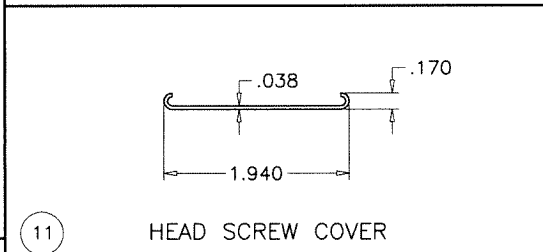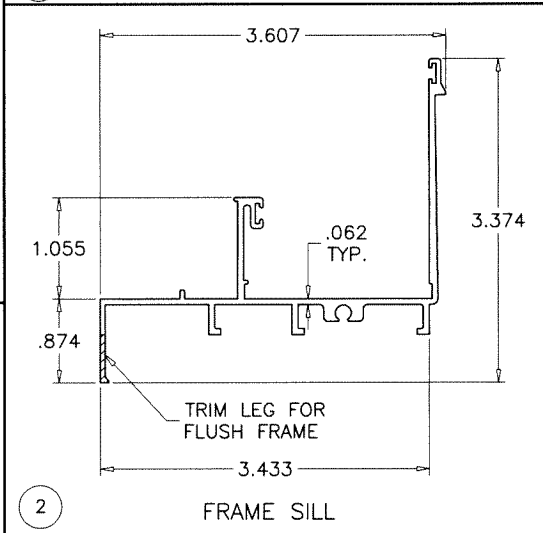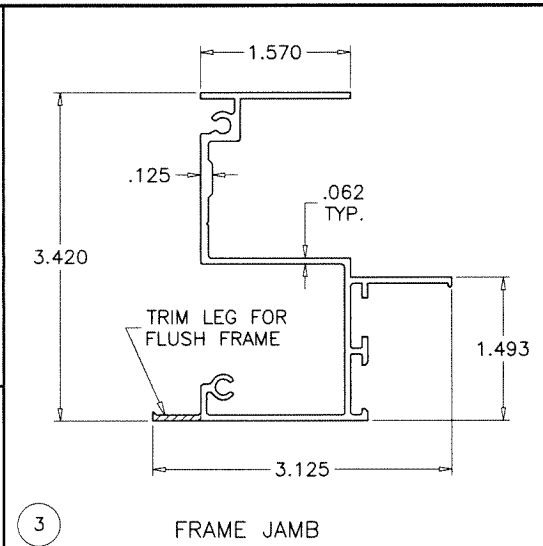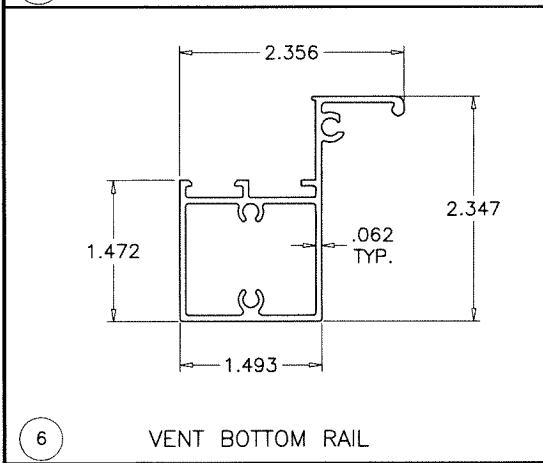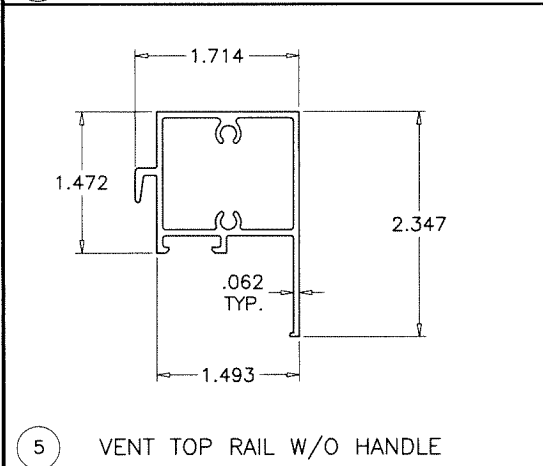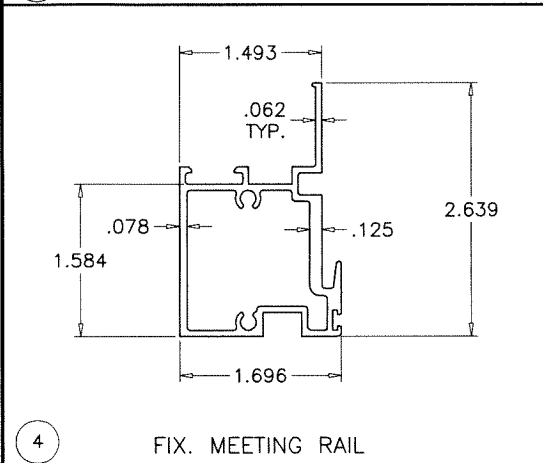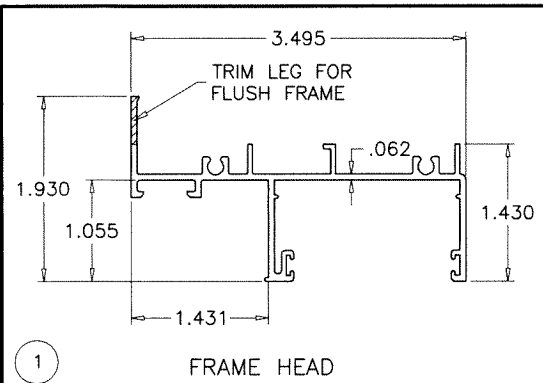

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	105	1	FRAME HEAD	6063-T6	-
2	104	1	FRAME SILL	6063-T6	-
3	113	2	FRAME JAMB	6063-T6	-
4	108	1	FIXED MTG. RAIL	6063-T6	-
5	107	1	VENT TOP RAIL W/O HANDLE	6063-T6	-
5A	107	1	VENT TOP RAIL W/ HANDLE	6063-T6	-
6	106	1	VENT BOTTOM RAIL	6063-T6	-
7	102	2	VENT SIDE RAIL	6063-T6	-
8	115	AS RQD.	GLAZING BEAD (7/16" LAM. GLASS)	6063-T6	-
8A	103	AS RQD.	GLAZING BEAD (INSUL. LAM. GLASS)	6063-T6	-
8B	119	AS RQD.	GLAZING BEAD (5/16" LAM. GLASS)	6063-T6	-
9	-	2/VENT	SASH STOP	6063-T6	-
11	-	-	HEAD SCREW COVER	-	-
12	SL203P	2/ VENT	SWEEP LATCH	ZAMAK	SULLIVAN & ASSOC.
12.1	#8 X 1/2"	2/ LATCH	LATCH INST. SCREWS	ST. STEEL	OH SMS
13	-	2/ VENT	SPRING LOADED LATCH	6063-T6	ALTERNATE TO SWEEP LATCH
13.1	-	2/ LATCH	LATCH SPRING	ST. STEEL	SULLIVAN & ASSOC.
14	#10 X 1-3/4"	AS REQD.	FRAME & VENT ASSEMBLY SCREWS	CRS	PH SMS
16	E202	AS REQD.	GLAZING BEAD BULB	NEOPRENE	ULTRAFAB
18	W71221NK	AS REQD.	FIN SEAL W'STRIPPING	-	ULTRAFAB
18A	W71321NK	AS REQD.	FIN SEAL W'STRIPPING	-	ULTRAFAB
19A	-	4/ VENT	VENT GUIDE	CELCON	M&M PLASTICS
19B	-	2/ VENT	VENT TOP CAP	CELCON	M&M PLASTICS
19.1	#6 X 3/8"	1/ GUIDE	SASH GUIDE INST. SCREW	CRS	OH SMS TYPE B
20	-	2/VENT	SPIRAL BALANCE	-	-
20.1	#10 X 1-1/4"	1/ BALANCE	BALANCE INST. SCREW	-	OH SMS TYPE B
21	-	AS REQD.	GLASS SPACER	SILICONE	FRANK LOWE
22	-	1	5/16" BOX SCREEN	-	OPTIONAL
23	-	2/ LITE	SETTING BLOCK AT 1/4 POINTS	EPDM	DUROMETER 80±5 SHORE A
24	-	2	RETICULATED FOAM BAFFLE 30 PPI	-	-
25	WLO2	AS REQD.	AUTOMATIC LOCK	-	ROTO HARDWARE

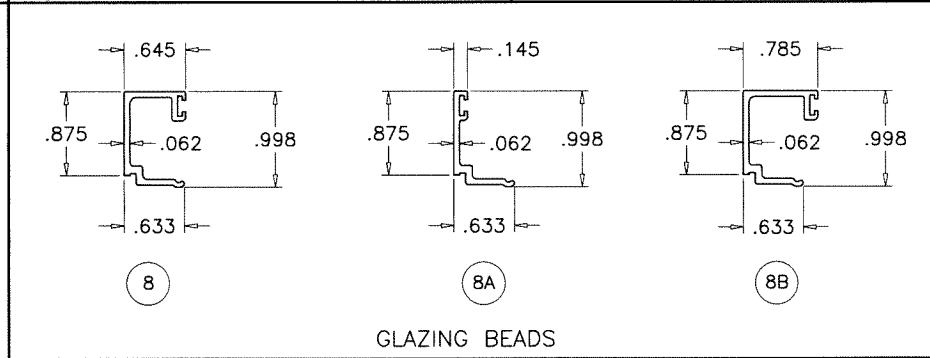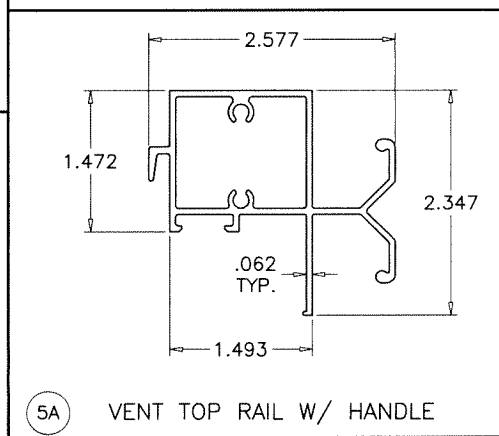


SEALANT:

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH WHITE/ALUMINUM COLORED GENERAL PURPOSE SILICONE.

Sealed: 9/22/2023

FL #30350

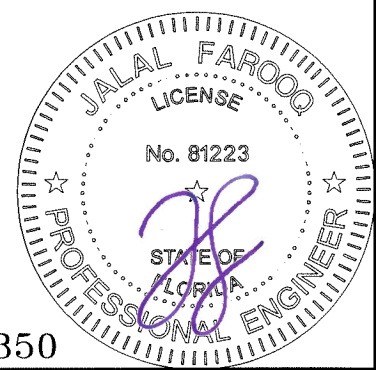

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES-100SH ALUM SINGLE HUNG WDW. (S.M.I.)

Alcon Windows And Doors Corp.
7240 N.W. 46th Street
Miami, FL. 33166
Tel. (305) 553-0229 Fax. (786) 363-8141

revisions:

no	date	by	description

date: 08-14-19

scale: 1/2" = 1"


dr. by: TARIQ

chk. by:


drawing no. 19-74F

sheet 7 of 8


COMP-ANL\19-74F-AWC

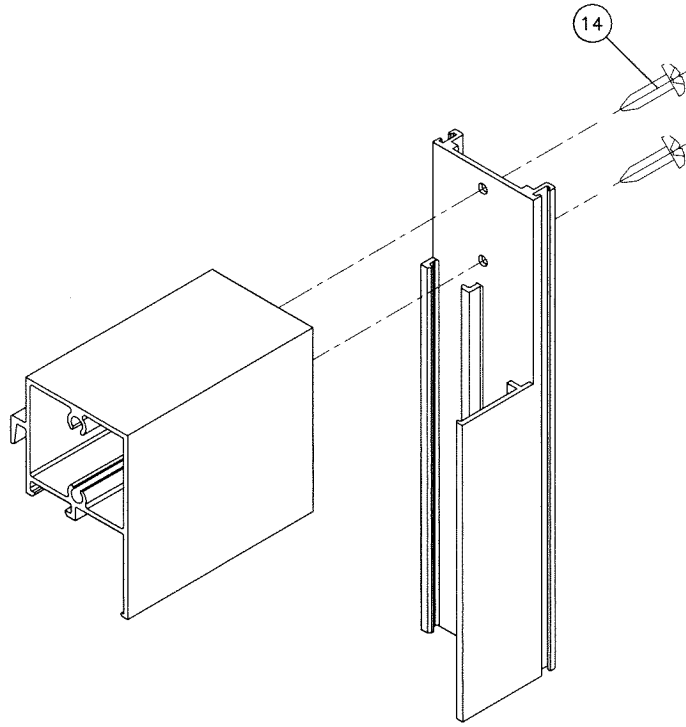


VENT TOP CORNER

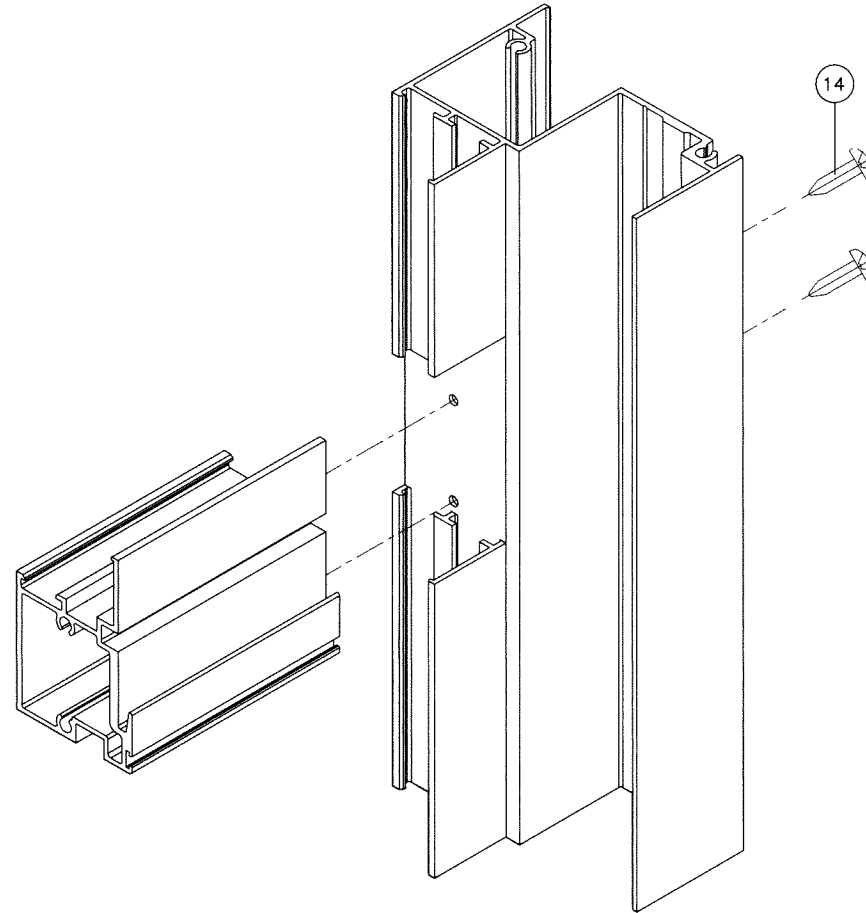


FIXED RAIL CORNER

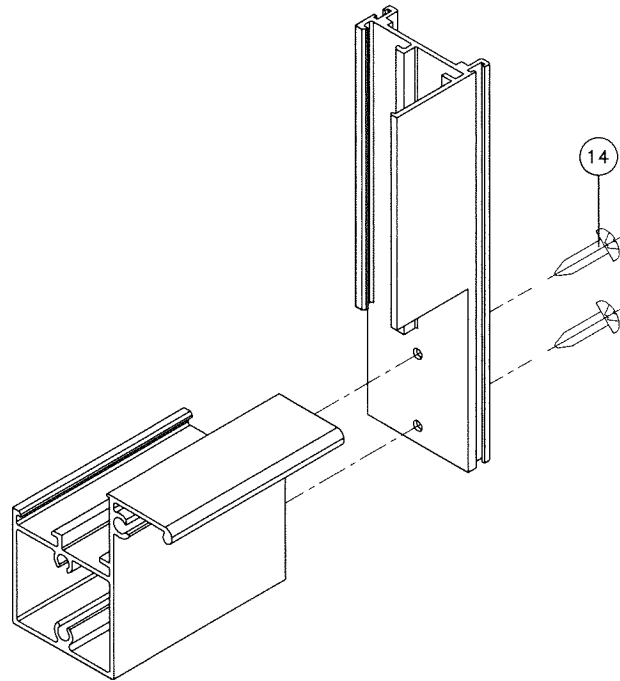

VENT BOTTOM CORNER

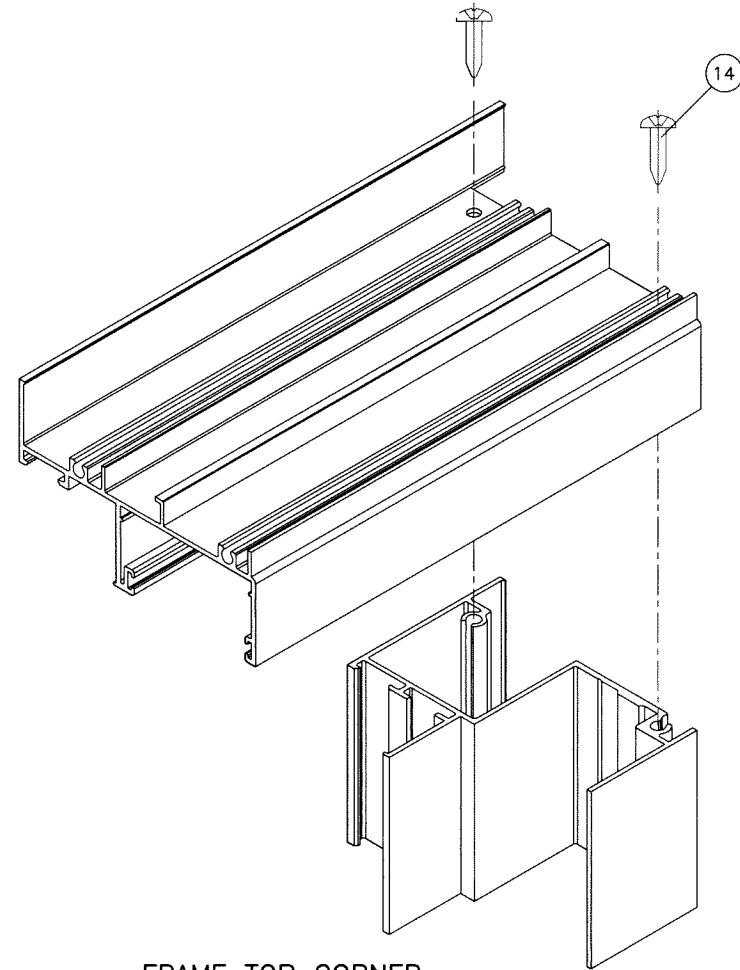

FRAME TOP CORNER

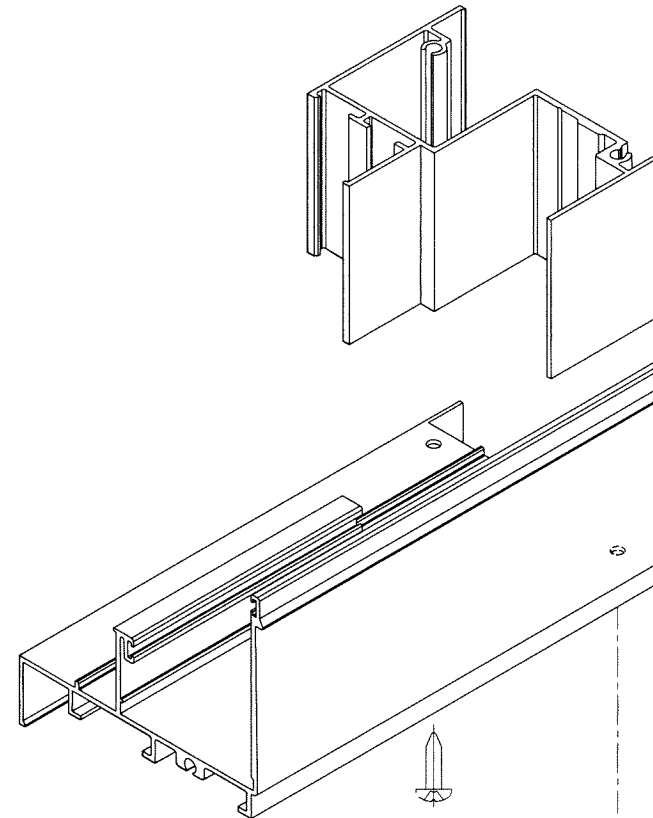

FRAME BOTTOM CORNER

FL #30350



Sealed: 9/22/2023

SERIES-100SH ALUM SINGLE HUNG WDW. (S.M.I.)

Alcon Windows And Doors Corp.

7240 N.W. 46th Street
Miami, FL. 33166

Tel. (305) 553-0229 Fax. (786) 363-8141

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

COMP-ANL 19-74F-AWC

revisions:
no date by description

date: 08-14-19
scale: 1/2" = 1"

dr. by: TARIQ

chk. by:

drawing no.

19-74F

sheet 8 of 8