






1. EVALUATED FOR USE IN LOCATIONS ADHERING TO THE FLORIDA BUILDING CODE, EXCLUDING THE HIGH VELOCITY HURRICANE ZONE (HVHZ), AND WHERE PRESSURE REQUIREMENTS AS DETERMINED BY ASCE 7, MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES, DOES NOT EXCEED THE DESIGN PRESSURES LISTED.
2. WHEN INSTALLED IN THE WIND-BORNE DEBRIS REGION, HURRICANE PROTECTIVE SYSTEM (SHUTTERS) IS REQUIRED.
3. MAXIMUM DOOR D.L.O. AREA NOT TO EXCEED 1,470 SQ IN.
INDIVIDUAL LITE D.L.O. WIDTH NOT TO EXCEED 21"
INDIVIDUAL LITE D.L.O. HEIGHT NOT TO EXCEED 35".

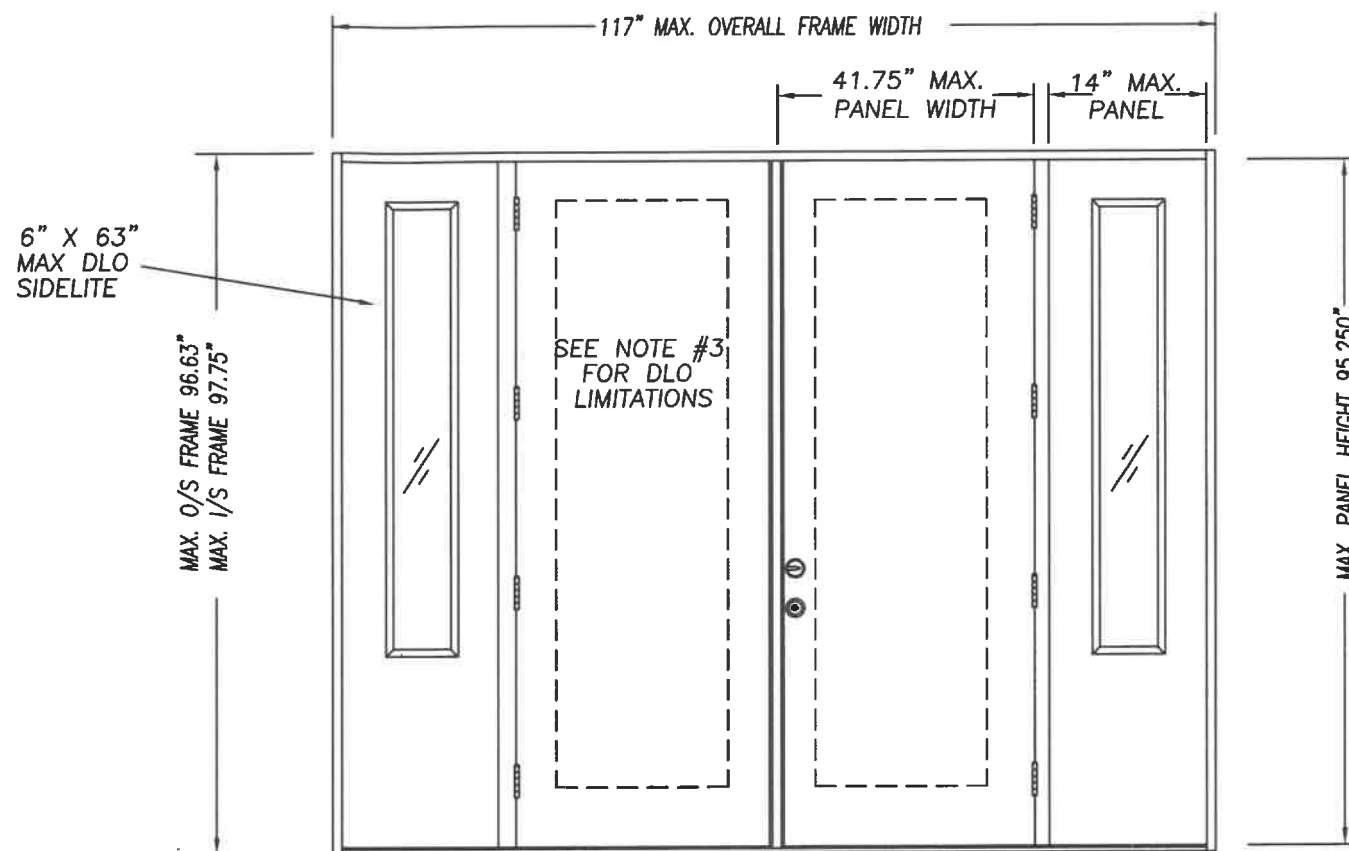


DOUBLE DOOR UNIT W/SIDELITES

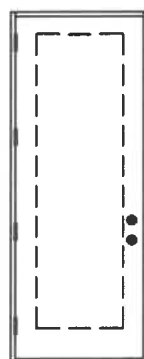


SINGLE DOOR UNIT

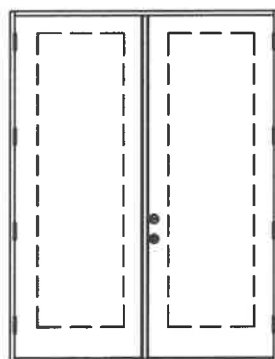


DOUBLE DOOR UNIT

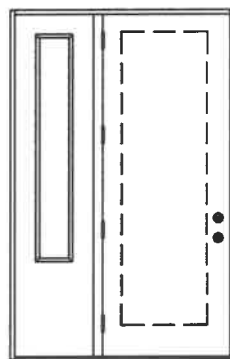


SINGLE DOOR UNIT
WITH SIDELITE

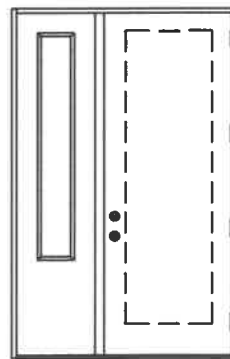

SINGLE DOOR UNIT
WITH SIDELITE

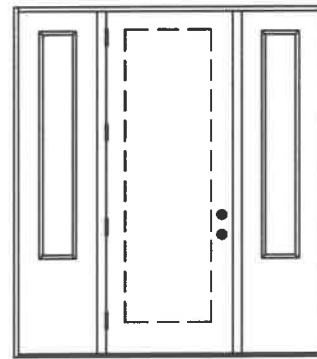

SINGLE DOOR UNIT W/SIDELITES

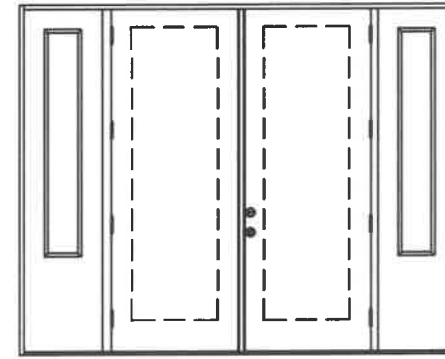

DOUBLE DOOR UNIT W/SIDELITES

		DESIGN PRESSURE RATING	
CONFIG	MAX WIDTH	INSWING	OUTSWING
X	43.5"	+35.0 / -40.0	+40.0 / -40.0
XX	86"	+35.0 / -40.0	+40.0 / -40.0
OX or XO	59.25"	+35.0 / -40.0	+40.0 / -40.0
OXO	75"	+35.0 / -40.0	+40.0 / -40.0
QXXO	117"	+35.0 / -40.0	+40.0 / -40.0



KURT BALTHAZOR
FLORIDA P.E.
#56533

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	TYPICAL ELEVATIONS & GENERAL NOTES
2	ANCHORING LOCATIONS & DETAILS
3	ANCHORING LOCATIONS & DETAILS
4	ANCHORING LOCATIONS & DETAILS

DATE:	3/23/20
SCALE:	N.T.S.
DWG. BY:	SWS
CHK. BY:	
DRAWING NO.:	
DWG-MA-FLO241-2	
SHEET	1 OF 4

