

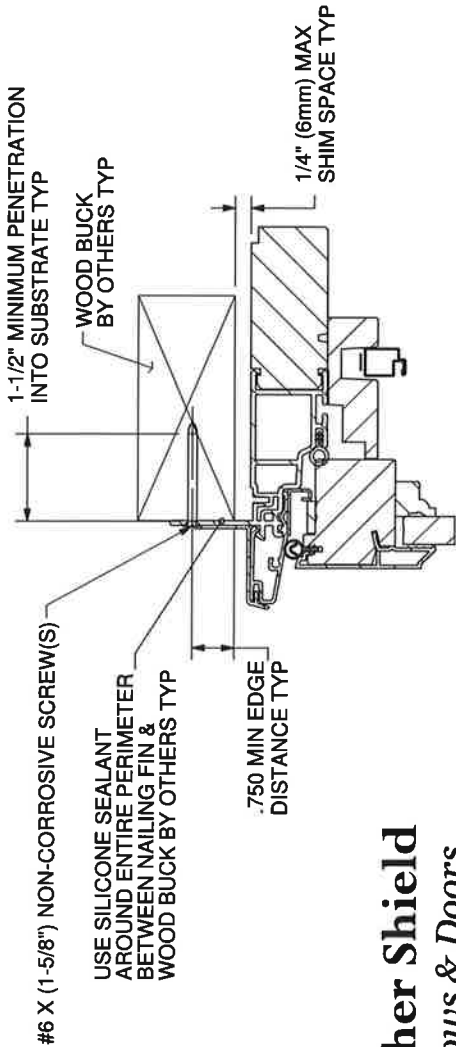


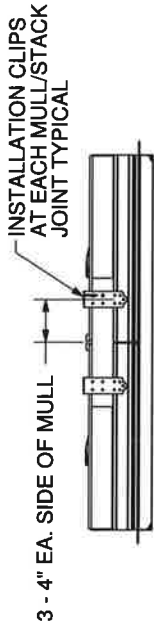


Weather Shield Windows & Doors

1210 Casement NAILING FIN INSTALLATION

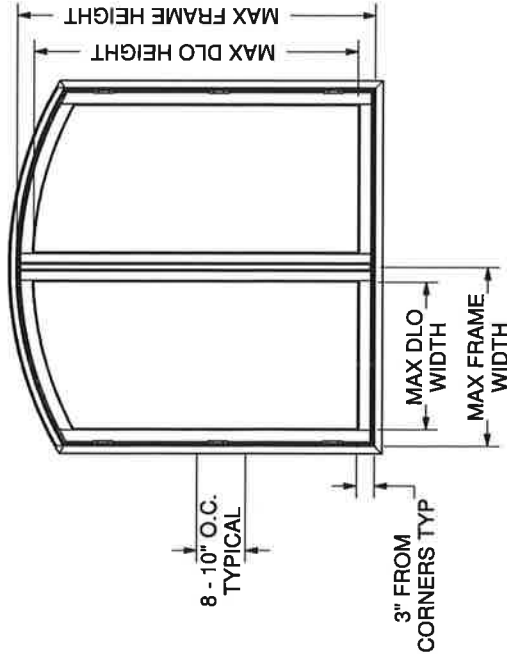



DESC.	MAX FRAME SIZE		MAX DAYLIGHT OPENING		DESIGN PRESSURE (psf)	FRAME MATERIAL
	WIDTH (IN.)	HEIGHT (IN.)	WIDTH (IN.)	HEIGHT (IN.)		
1210 CSMT EYEBROW 2 WIDE	35.5	83.5	29.75	77.75	+55/-70	WOOD, VINYL, ALUMINUM

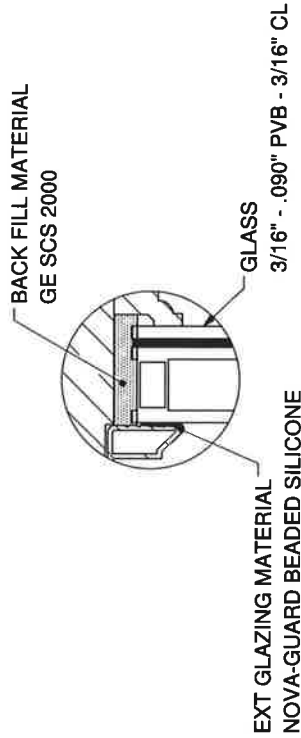



- GENERAL NOTE(S):**
1. THESE UNITS HAVE BEEN TESTED, ANALYZED, HALLMARK CERTIFIED AND FBC APPROVED.
 2. GLASS MEETS THE REQUIREMENTS OF ASTM E1300.
 3. SETTING BLOCK SHOULD BE 70-90 DUROMETER AS PER 2411.3.3.1 OF THE CURRENT FBC.
 4. GLASS LITES THAT EXCEED 36" IN WIDTH SHALL USE SETTING BLOCKS AT 1/4 SPAN FROM CORNERS AS PER 2411.3.3.1 OF THE CURRENT FBC.
 5. LARGE AND SMALL MISSILE IMPACT RESISTANT. WINDOW AND DOOR UNITS REQUIRED TO MEET SMALL MISSILE IMPACT WIND-BORNE DEBRIS PROTECTION REQUIRE THE EXTERIOR LITE OF AN INSULATED UNIT TO BE TEMPERED PER FBC, SECTION 2411.3.3.7.

WEATHER SHIELD.	
WINDOWS & DOORS	
TOLERANCES UNLESS SPECIFIED:	
INCHES	ANGLE
x ± .1"	xx ± 1°
.xx ± .03"	xx.x ± .5° (1/2°)
.xxx ± .015"	xx.xx ± .25° (1/4°)
PRODUCTS:	
1210 EYEBROW	
DRAWN BY: JLK/CJA	DATE: 06/13/2019
TITLE: INSTALLATION INSTRUCTIONS	
AREA:	DWG NO: 45-22388
FINISH:	REV
PCR NO. ENG	SCALE: 1:12 SHEET NAME: Sheet1
DESCRIPTION	SHEET 1 OF 2

HEAD, SILL & SIDE ANCHORAGE TYPICAL

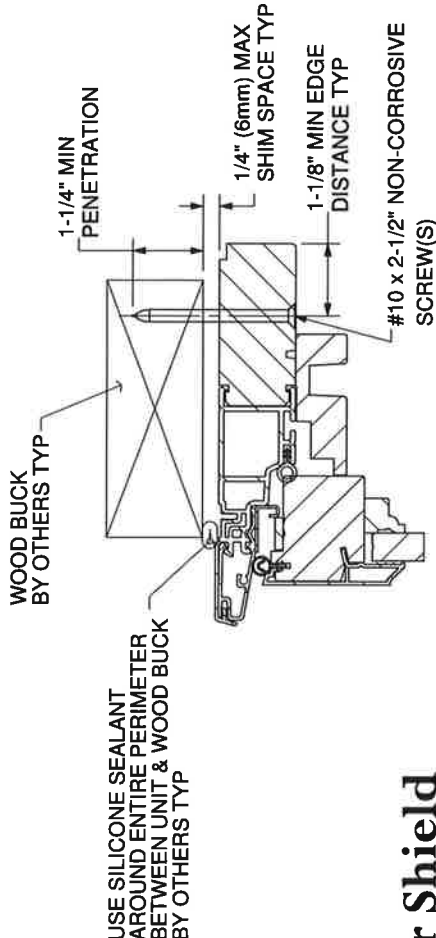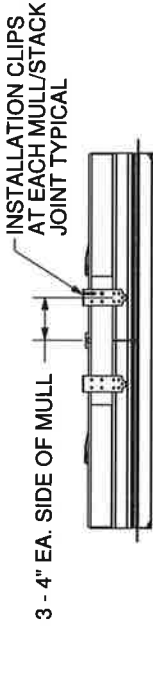

Weather Shield
Windows & Doors
1210 Casement
THROUGH JAMB INSTALLATION

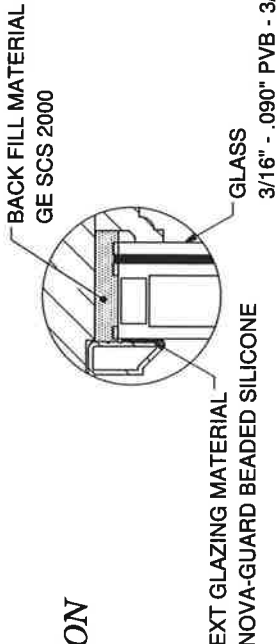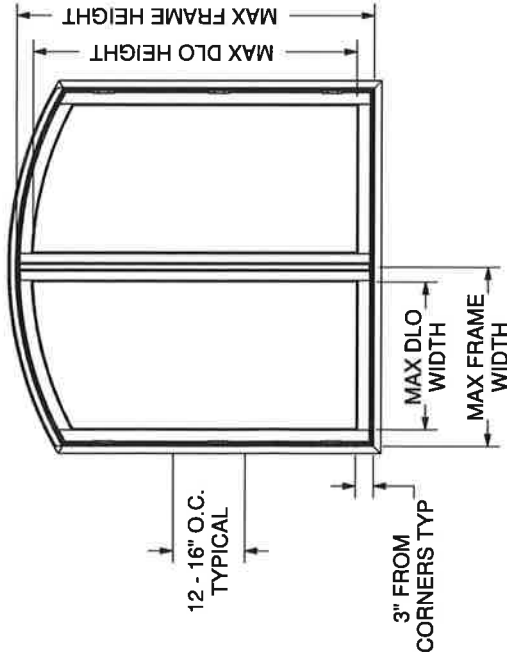

DESC.	MAX FRAME SIZE		MAX DAYLIGHT OPENING		DESIGN PRESSURE (psf)	FRAME MATERIAL
	WIDTH (IN.)	HEIGHT (IN.)	WIDTH (IN.)	HEIGHT (IN.)		
1210 CSMT EYEBROW 2 WIDE	35.5	83.5	29.75	77.75	+55/-70	WOOD, VINYL, ALUMINUM

GENERAL NOTE(S):


1. THESE UNITS HAVE BEEN TESTED, ANALYZED, HALLMARK CERTIFIED AND FBC APPROVED.
2. GLASS MEETS THE REQUIREMENTS OF ASTM E1300.
3. SETTING BLOCK SHOULD BE 70-90 DUROMETER AS PER 2411.3.3.1 OF THE CURRENT FBC.
4. GLASS LITES THAT EXCEED 36" IN WIDTH SHALL USE SETTING BLOCKS AT 1/4 SPAN FROM CORNERS AS PER 2411.3.3.1 OF THE CURRENT FBC.
5. LARGE AND SMALL MISSILE IMPACT RESISTANT. WINDOW AND DOOR UNITS REQUIRED TO MEET SMALL MISSILE IMPACT WIND-BORNE DEBRIS PROTECTION REQUIRE THE EXTERIOR LITE OF AN INSULATED UNIT TO BE TEMPERED PER FBC, SECTION 2411.3.3.7.

TOLERANCES UNLESS SPECIFIED:		
INCHES	ANGLE	
.X ± .1"	XX ± 1°	
.XX ± .03"	XX.X ± .5° (1/2°)	
.XXX ± .015"	XX.XX ± .25° (1/4°)	

PRODUCTS:
1210 EYEBROW

WEATHER SHIELD.
WINDOWS & DOORS

REV	DATE	DESCRIPTION	PCR NO.	ENG	PDR #	TYP. WALL THICKNESS:			INSTALLATION INSTRUCTIONS		
						WT/FT	AREA	FINISH	DWG NO.	REV	SCALE
									45-22391		1:12
									45-22391		1:12
									45-22391		1:12

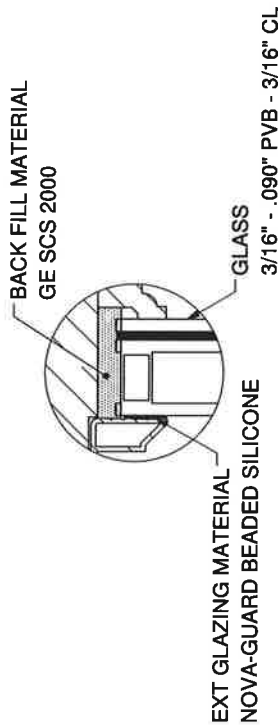

1210 Casement INSTALLATION CLIP METHOD



1. THESE UNITS HAVE BEEN TESTED, ANALYZED, HALLMARK CERTIFIED AND FBC APPROVED.
2. GLASS MEETS THE REQUIREMENTS OF ASTM E1300.
3. SETTING BLOCK SHOULD BE 70-90 DUROMETER AS PER 2411.3.3.1 OF THE CURRENT FBC.
4. GLASS LITES THAT EXCEED 36" IN WIDTH SHALL USE SETTING BLOCKS AT ¼ SPAN FROM CORNERS AS PER 2411.3.3.1 OF THE CURRENT FBC.
5. LARGE AND SMALL MISSILE IMPACT RESISTANT. WINDOW AND DOOR UNITS REQUIRED TO MEET SMALL MISSILE IMPACT WIND-BORNE DEBRIS PROTECTION REQUIRE THE EXTERIOR LITE OF AN INSULATED UNIT TO BE TEMPERED PER FBC. SECTION 2411.3.3.7.

PRODUCTS:	1210 EYEBROW
-----------	--------------

WEATHER SHIELD.
WINDOWS & DOORS

[illegible]