



Product Evaluation Report
McELROY METAL, INC.

24" 238T 24 Ga. Roof Panel over open framing

Florida Product Approval # 30738.2 R3

Florida Building Code 2023

Per Rule 61G20-3

Method: 1 -D

Category: Structural Components

Subcategory: Roof Deck

Compliance Method: 61G20-3.005(1)(d)

NON HVHZ

Product Manufacturer:

McElroy Metal, Inc.

1500 Hamilton Road

Bossier City, LA 71111

Engineer Evaluator:


Johnathan Green, P.E. #88223

Florida Evaluation ANE ID: 12901

Contents:

Evaluation Report: Page 1 - 4

Installation Detail: Page 5, 6

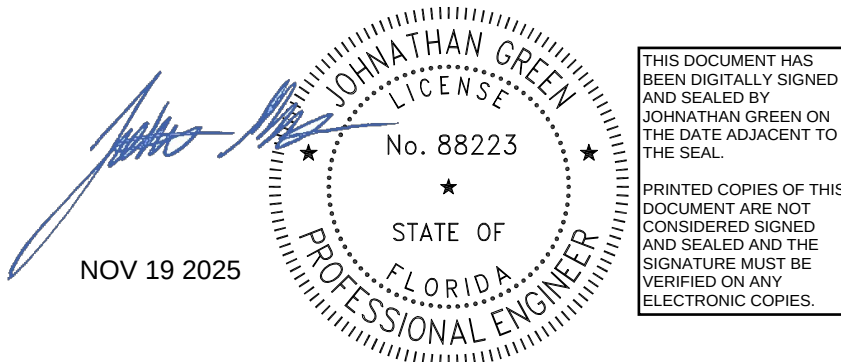

THIS DOCUMENT HAS
BEEN DIGITALLY SIGNED
AND SEALED BY
JOHNATHAN GREEN ON
THE DATE ADJACENT TO
THE SEAL.

PRINTED COPIES OF THIS
DOCUMENT ARE NOT
CONSIDERED SIGNED
AND SEALED AND THE
SIGNATURE MUST BE
VERIFIED ON ANY
ELECTRONIC COPIES.



Compliance Statement:	The product as described in this report has demonstrated compliance with the Florida Building Code 2023, Sections 1504.3.2, 1504.7.
Product Description:	238T 24 Ga. Steel Roof Panel, 24" Coverage, standing seam structural roof panel. Structural Application.
Panel Material/Standards:	Material: 24 Ga. Steel, conforming to Florida Building Code 2023 Section 1507.4.3. Yield Strength: Min. 50.0 ksi Corrosion Resistance: Panel Material shall comply with Florida Building Code 2023, Section 1507.4.3.
Panel Dimension(s):	Thickness: 0.024" nominal Coverage: 24" nominal coverage Rib: 2 3/8" tall T Rib Panel Seam: Mechanically sealed Panel Seam Cap: 24 Ga. Steel with (2) beads of factory applied sealant.
Panel Clips:	Product Name: Standard Clip Type: Fixed, 16 Ga. steel, 6" long, 2 5/8" tall Product Name: Retro Clip Type: Fixed, 16 Ga. steel, 8" long, 4" tall Product Name: 24 Ga. Multi-Span Clip, 2 5/8" tall Type: Fixed, 24 Ga. painted steel ASTM A792 50 ksi Product Name: 22 Ga. Multi-Span Clip, 2 5/8" tall Type: Fixed, 22 Ga. painted steel ASTM A792 50 ksi Corrosion Resistance: Per Florida Building Code 2023 Section 1506.7
Panel Clip Fastener:	(2) ¼-14 x 1 ¼" HWH SD no washer per clip Corrosion Resistance: Per Florida Building Code 2023, Section 1517.6
Substrate Description:	Min. 16 Ga. Steel Framing. Must be designed in accordance w/ Florida Building Code.



Allowable Design Uplift Pressures:

Panel System:	24" 238T 24 Ga. with Standard Clip				
Clip Spacing (O.C.):	5'-0"	4'-0"	3'-0"	2'-0"	1'-0"
Maximum Design Pressure (PSF):	-28.6	-45.5	-62.5	-79.4	-96.3

Panel System:	24" 238T 24 Ga. with Retro Clip				
Clip Spacing (O.C.):	5'-0"	4'-0"	3'-0"	2'-0"	1'-0"
Maximum Design Pressure (PSF):	-26.0	-44.9	-63.8	-82.6	-101.5

Panel System:	24" 238T 24 Ga. with 24 Ga. Multi-Span Clip				
Fastener Spacing (O.C.):	5'-0"				
Maximum Design Pressure (PSF):	-83.3				

Panel System:	24" 238T 24 Ga. with 22 Ga. Multi-Span Clip				
Fastener Spacing (O.C.):	5'-0"				
Maximum Design Pressure (PSF):	-85.9				

*Design Pressure includes a Safety Factor = 2.0.

Code Compliance:

The product described herein has demonstrated compliance with The Florida Building Code 2023, Section 1504.3.2, 1504.7.

Evaluation Report Scope:

The product evaluation is limited to compliance with the structural wind load requirements of the Florida Building Code 2023, as relates to Rule 61G20-3.

Performance Standards:

The product described herein has demonstrated compliance with:


- ASTM E 1592-05 (2017) Test method for structural performance of sheet metal roof and siding systems by uniform static air pressure difference.
- FM 4471-92, Foot Traffic Resistance Test

Reference Data:

1. ASTM E 1592-05 (2012)
Force Engineering & Testing, Inc. (FBC Organization # TST-5328)
Report No. 90-0106T-19A-F
2. FM 4471-95, Foot Traffic Resistance Test
Force Engineering & Testing, Inc. (FBC Organization # TST-5328)
Report No. 90-0106T-19G
3. Certificate of Independence
By Johnathan Green, P.E. (No. 88223) @ Force Engineering & Testing
(FBC Organization # ANE ID: 12901)




Test Standard Equivalency:	The FM 4471-95 test standard is equivalent to the FM 4471-92 test standard. The ASTM E1592-05(2012) test standard is equivalent to the ASTM E1592-05(2017) test standard.
Quality Assurance Entity:	The manufacturer has established compliance of roof panel products in accordance with the Florida Building Code and Rule 61G20-3.005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity.
Minimum Slope Range:	Minimum Slope shall comply with Florida Building Code 2023, including Section 1507.4.2 and in accordance with Manufacturers recommendations.
Installation:	Install per manufacturer's recommended details.
Insulation:	Manufacturer's approved product (Optional)
Roof Panel Fire Classification:	Fire classification is not part of this evaluation.
Shear Diaphragm:	Shear diaphragm values are outside the scope of this report.
Design Procedure:	Based on the dimensions of the structure, appropriate wind loads are determined using Chapter 16 of the Florida Building Code 2023 for roof cladding wind loads. These component wind loads for roof cladding are compared to the allowable pressure listed above. The design professional shall select the appropriate erection details to reference in his drawings for proper fastener attachment to his structure and analyze the panel fasteners for pullout and pullover. Support framing must be in compliance with Florida Building Code 2023 Chapter 22 for steel, Chapter 23 for wood and Chapter 16 for structural loading.

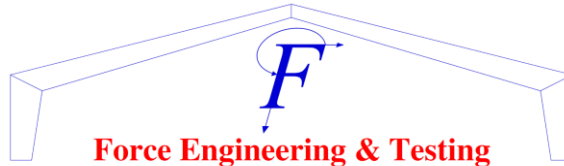

Force Engineering & Testing

19530 Ramblewood Drive
Humble, Texas 77338

Phone: (281) 540-6603 FAX: (281) 540-9966
Website: www.forceengineeringtesting.com

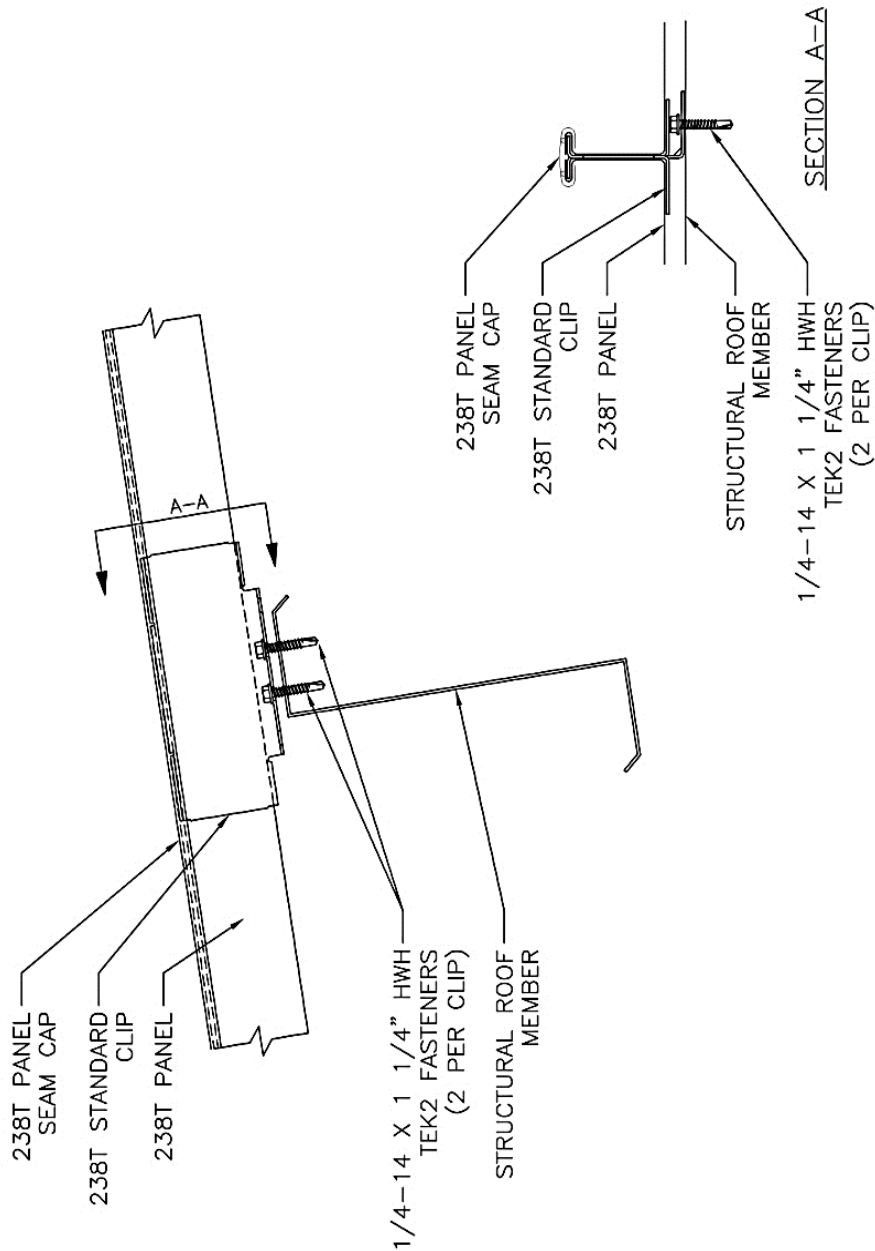

ISSUE/REVISION DATE:

06/06/2018


STANDARD CLIP TO PURLIN CONNECTION

ROOF PANEL: 3007

SUBSTRATE: 1111 IN

SCALE: 1/4" = 1'-0"




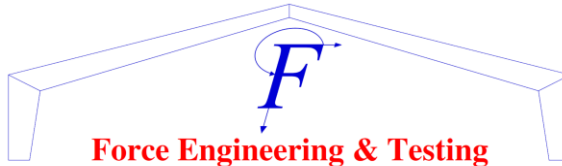

Force Engineering & Testing

19530 Ramblewood Drive
Humble, Texas 77338

Phone: (281) 540-6603 FAX: (281) 540-9966
Website: www.forceengineeringtesting.com

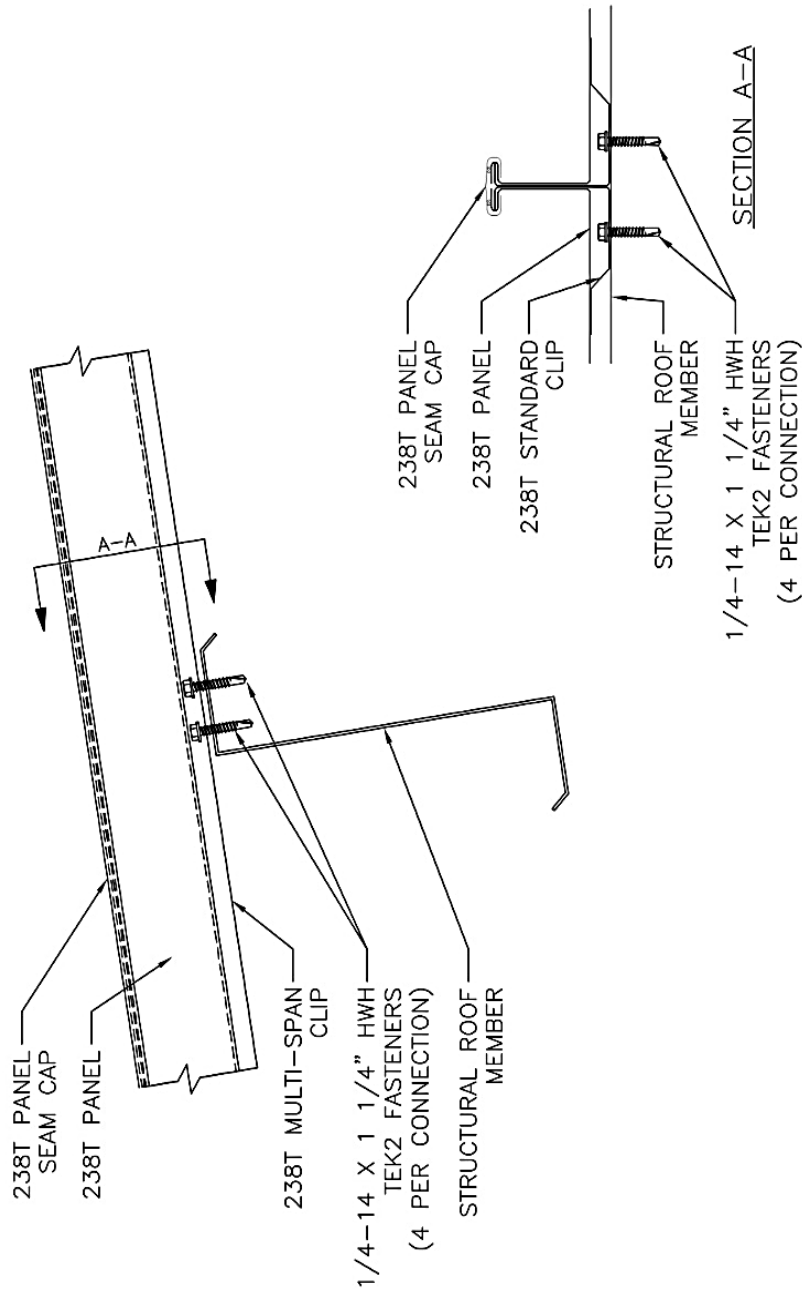

ISSUE/REVISION DATE:

06/06/2018

MULTI-SPAN CLIP TO PURLIN CONNECTION

SCALE: N T C

SUBSTRATE: PU 101 IN

ROOF PANEL: 920T

