

WINTECH - WINDOW TECHNOLOGY, INC.

SERIES 225 SINGLE HUNG WINDOW

NON IMPACT


INSTALLATION NOTES:

1. *ONE (1)* INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN, UNLESS OTHERWISE STATED.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
4. NAILING FIN: FOR INSTALLATION THROUGH 2X WOOD FRAME USE ONE (1) #8 WOOD SCREW PER LOCATION OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
5. NAILING FIN: FOR INSTALLATION THROUGH METAL STUD USE ONE (1) #8 SELF-TAPPING SCREW OF SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM PENETRATION BEYOND METAL STRUCTURE.
6. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
7. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
8. FOR GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
9. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
10. INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - A. WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - B. STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM WALL THICKNESS OF 33 MILS. (20 GAUGE)
 - C. ALUMINUM - 1/18" MINIMUM THICKNESS (6063-T5).


GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), EXCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-11
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
5. APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED TO PROTECT THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. WINDOW FRAME MATERIAL: ALUMINUM 6063-T6.
7. GLASS SHALL MEET THE REQUIREMENTS OF ASTM E1300-04 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAILS.
8. DESIGNATIONS "X" AND "O" STAND FOR THE FOLLOWING:
X: OPERABLE PANEL
O: FIXED PANEL
9. CUSTOM SIZES AVAILABLE UPON REQUEST.

TABLE OF CONTENTS		
SHEET	REVISION	SHEET DESCRIPTION
1	-	GENERAL NOTES, INSTALLATION NOTES & GLAZING DETAIL
2	-	ELEVATIONS & ANCHOR LAYOUTS
3	-	VERTICAL SECTIONS
4	-	HORIZONTAL SECTIONS
5	-	COMPONENTS & BILL OF MATERIALS

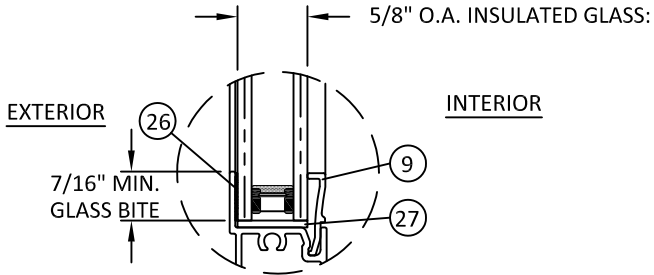

GLAZING DETAIL 1
FOR UNITS ABOVE 30 PSF

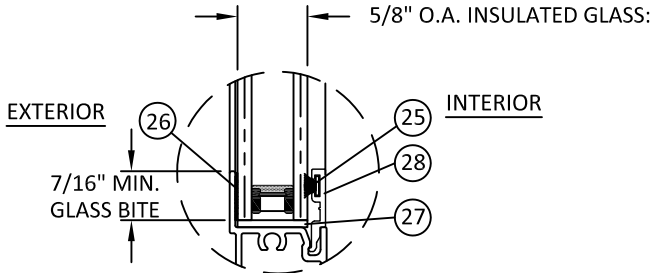

GLAZING DETAIL 2

- GLAZING NOTES:
1. GLASS TYPE SHALL COMPLY WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
 2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
 3. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.

WINTECH

WINDOW TECHNOLOGY, INC.

201 INDUSTRIAL DRIVE
MONETT, MO 65708
WWW.WINTECHINC.COM

PH: (417) 235-7821 FX: (417) 737-7140

SERIES 225 SINGLE HUNG
WINDOW (NON IMPACT)
GENERAL, INSTALLATION NOTES
AND GLAZING DETAILS


PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 999-5478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by **Hermes F. Norero**
Reason: I am approving this document
Date: 2019.10.16 15:12:13 -0400

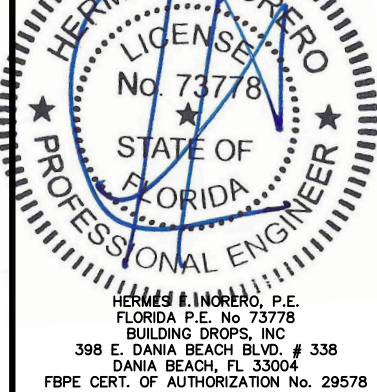

FL #:

FL30750

DATE: **10.16.2019**

DWG. BY: RV	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**

DWG. #: **WNT001**

SHEET:

1

OF 5

TITLE: SERIES 225 SINGLE HUNG
WINDOW (NON IMPACT)

ELEVATIONS AND ANCHORS LAYOUT

PREPARED BY:

BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-5478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS

BY

DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL30750

DATE: 10.16.2019

DWG. BY:
RV

CHK. BY:
HFN


SCALE: NTS

DWG. #: WNT001


SHEET:

2

OF 5

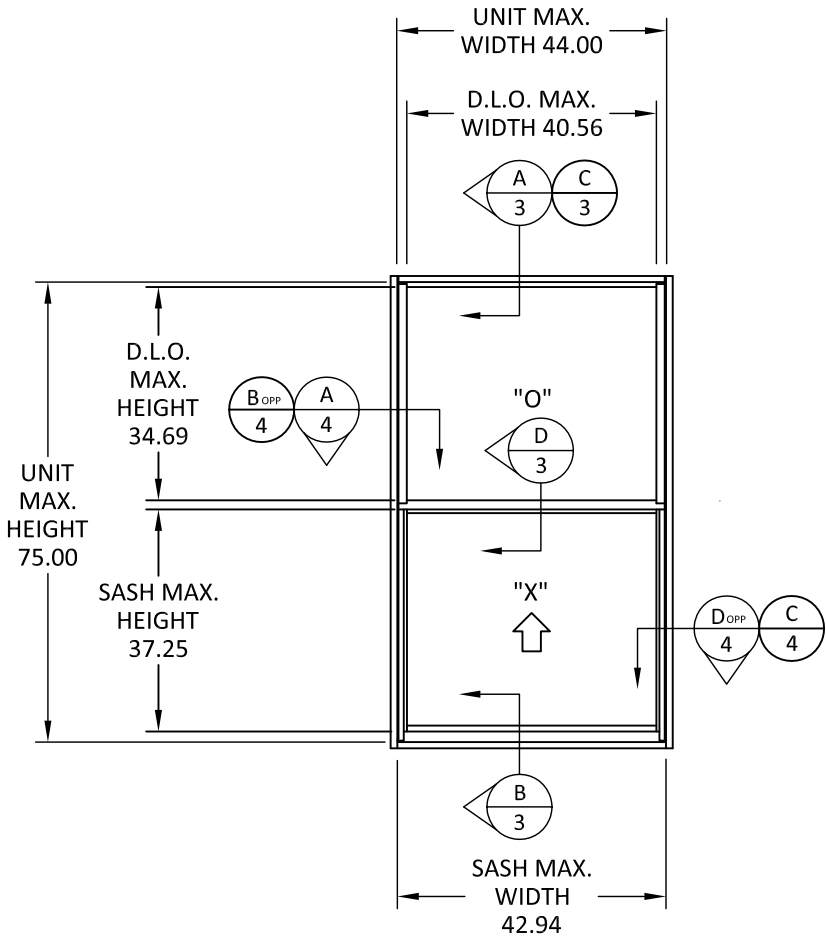

ELEVATION
AS TESTED

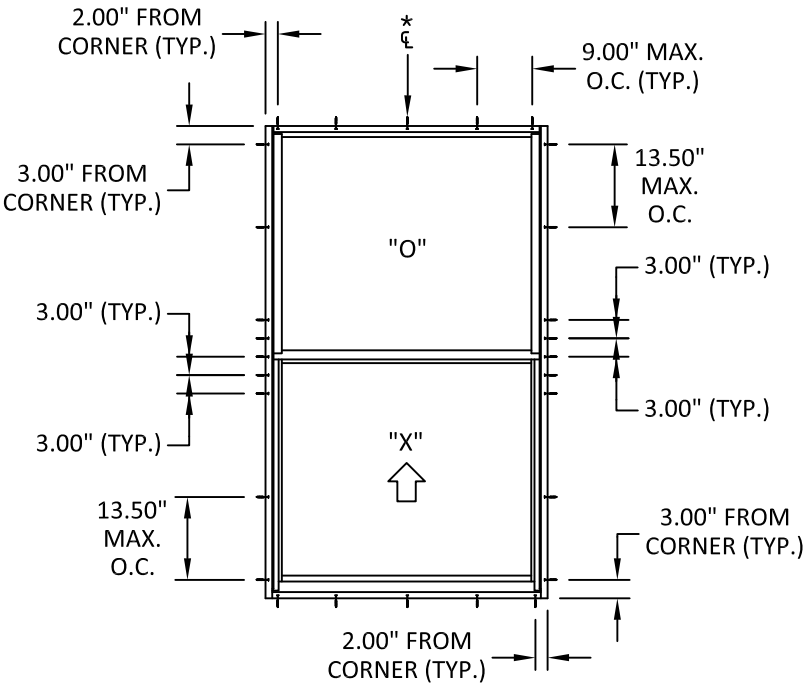

ANCHOR LAYOUT
FIN INSTALLATION

NOTE:
* USE ANCHORS AT 6 OF HEAD
AND SILL OF WINDOWS WIDER
THAN 31".

ALLOWABLE ALTERNATE SIZES DESIGN PRESSURE TABLE (PSF)								
WINDOW WIDTH (INCHES)								
WINDOW HEIGHT (INCHES)		24	30	36	42	48	54	60
	24	50.0	50.0	50.0	50.0	50.0	50.0	43.2
	36	50.0	50.0	50.0	50.0	50.0	44.6	31.3
	42	50.0	50.0	50.0	50.0	50.0	41.0	28.4
	48	50.0	50.0	50.0	50.0	50.0	39.1	26.6
	54	50.0	50.0	50.0	50.0	48.8	38.5	25.6
	60	50.0	50.0	50.0	49.2	39.5	31.2	25.3
	66	50.0	50.0	47.5	40.7	32.6	25.8	20.9
	72	50.0	47.9	39.9	34.2	27.4	21.7	17.6
	78	50.0	40.8	34.0	29.1	23.4	18.5	15.0
	84	44.0	35.2	29.3	25.1	20.1	15.9	-
	90	38.3	30.6	25.5	21.9	17.6	-	-
	96	33.7	26.9	22.4	19.2	15.4	-	-

SERIES 225 SINGLE HUNG
WINDOW (NON IMPACT)

VERTICAL SECTIONS

BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 999-5478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




PREPARED BY:

TITLE:

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

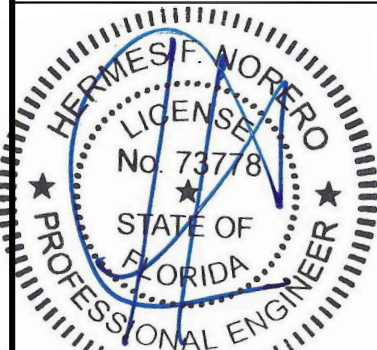

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL30750

DATE: 10.16.2019

DWG. BY:
RV

CHK. BY:
HFN


SCALE: NTS

DWG. #: WNT001

SHEET:

3


OF 5

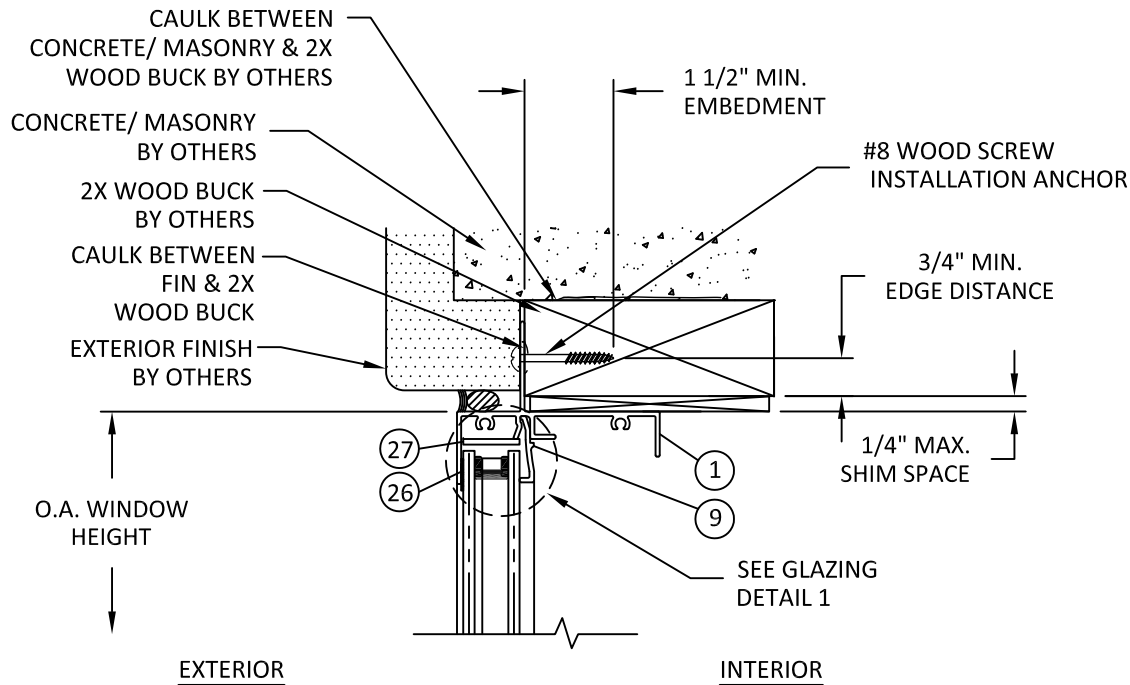

A
3

VERTICAL SECTION


HEAD - 2X WOOD BUCK
NAIL FIN INSTALLATION

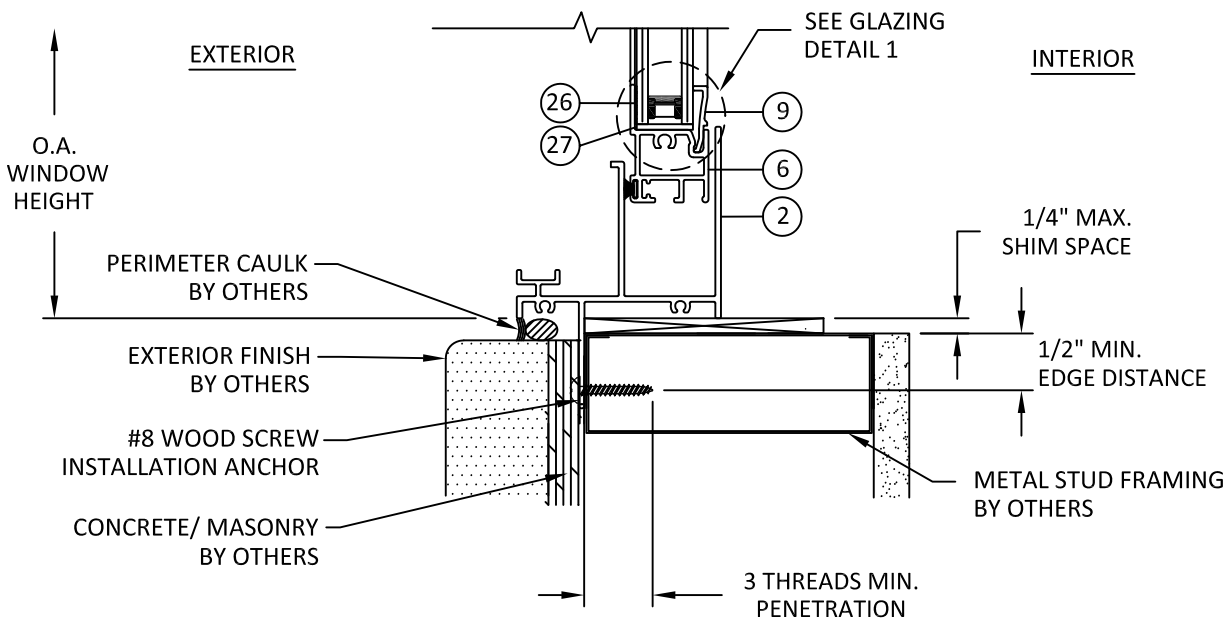

B
3

VERTICAL SECTION


SILL - METAL STUD FRAME
NAIL FIN INSTALLATION

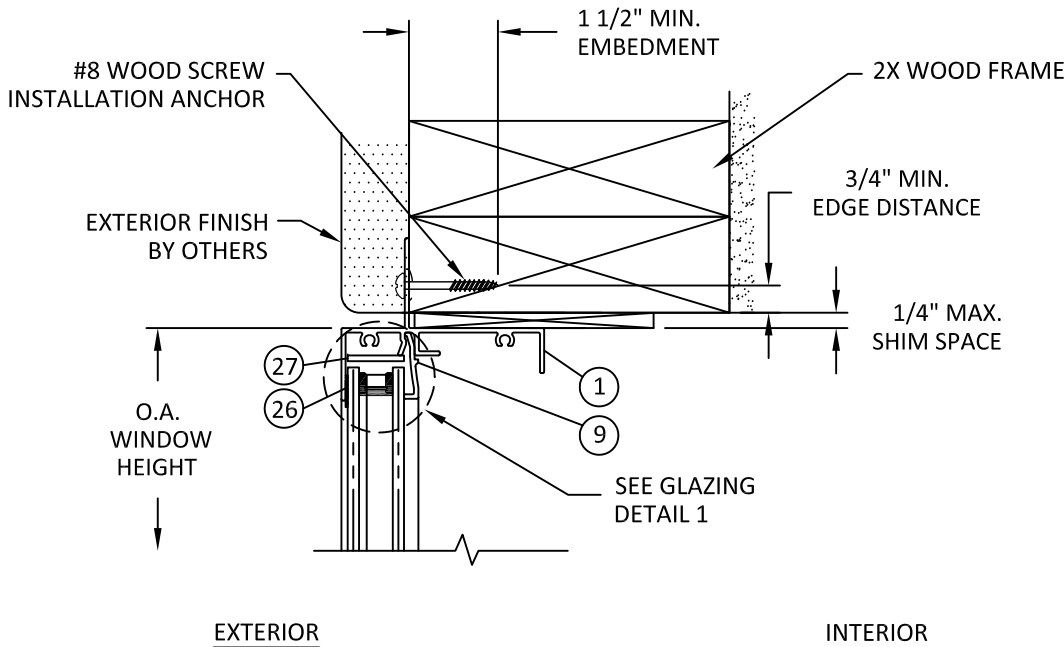

C
3

VERTICAL SECTION

HEAD - 2X WOOD FRAME
NAIL FIN INSTALLATION

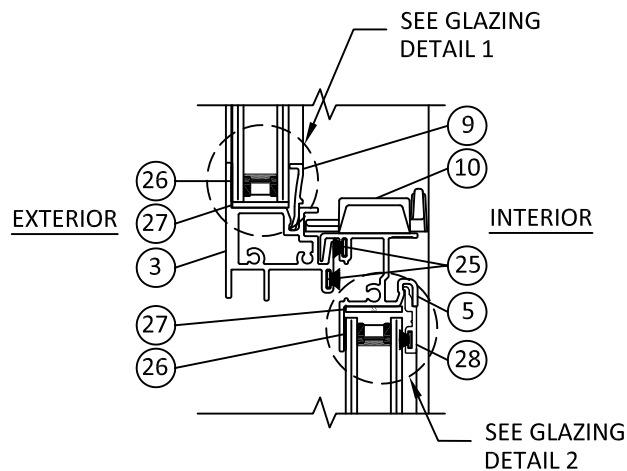

D
3

VERTICAL SECTION

MEETING RAIL

SERIES 225 SINGLE HUNG
WINDOW (NON IMPACT)

HORIZONTAL SECTIONS

BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 999-5478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




PREPARED BY:

TITLE:

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

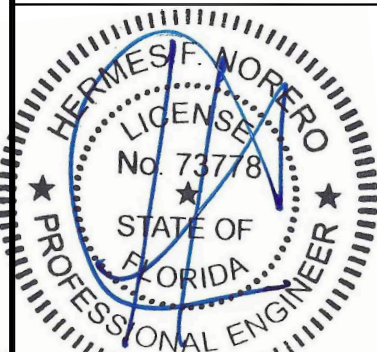

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL30750

DATE: 10.16.2019

DWG. BY:
RV

CHK. BY:
HFN


SCALE: NTS

DWG. #: WNT001


SHEET:

4


OF 5

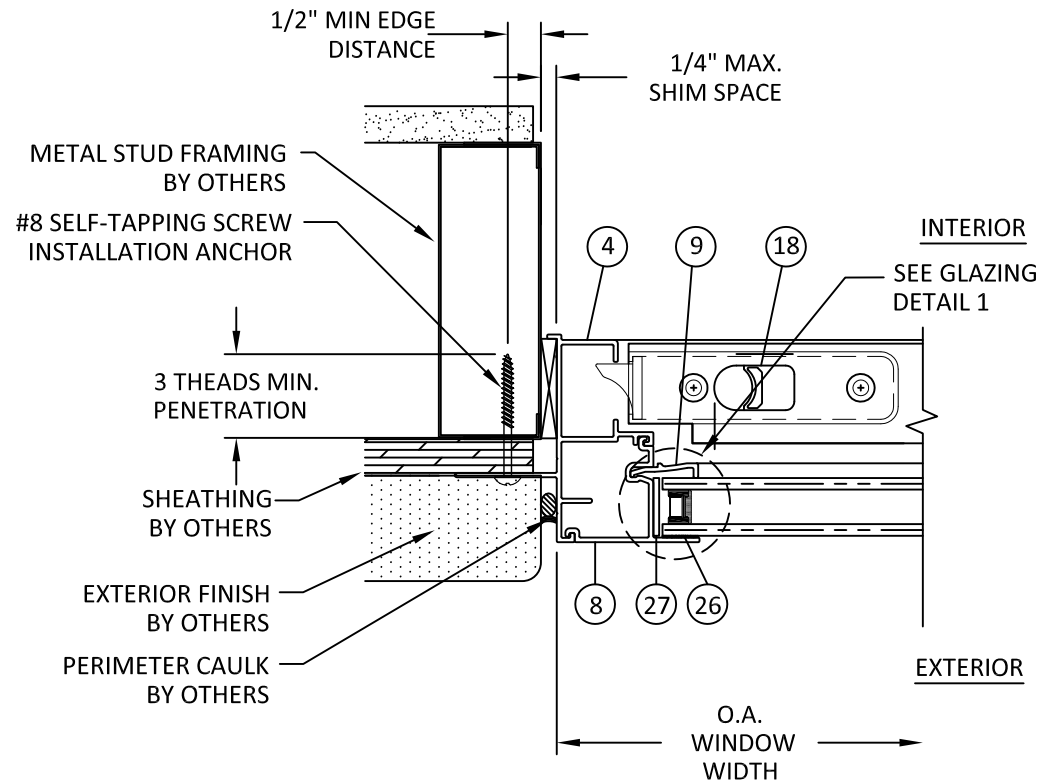


A
4 HORIZONTAL SECTION
FX JAMB - METAL STUD FRAME
NAIL FIN INSTALLATION

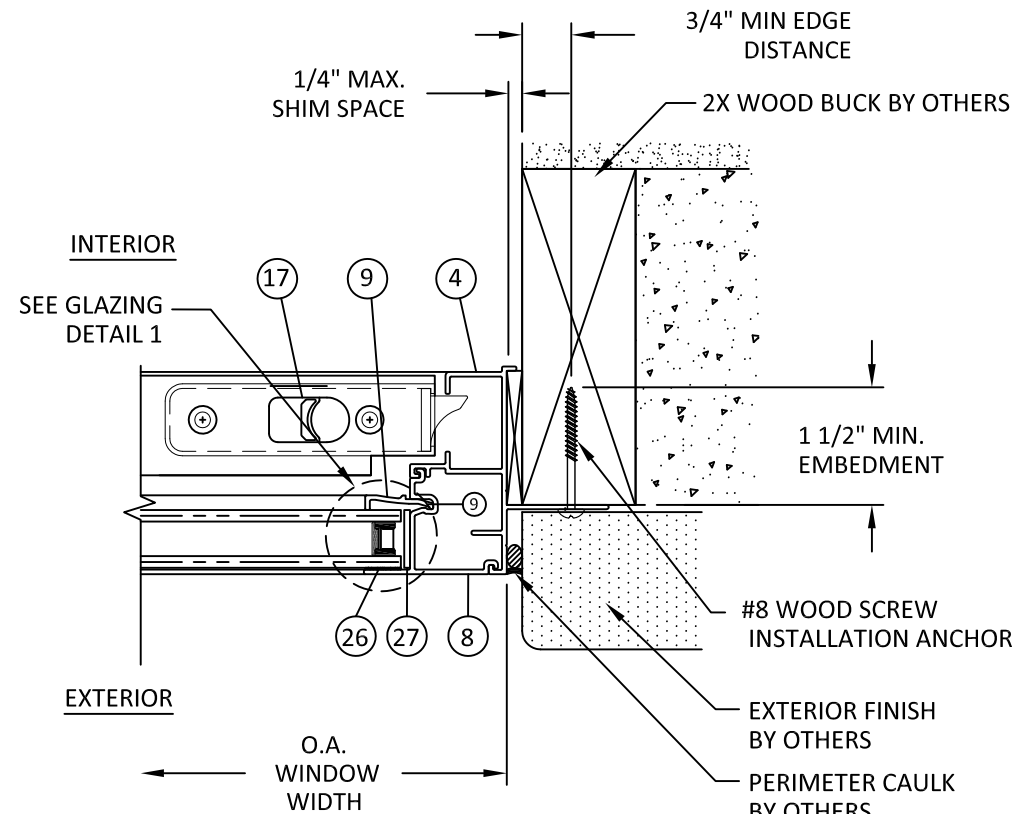

B
4 HORIZONTAL SECTION
2X WOOD BUCK
NAIL FIN INSTALLATION

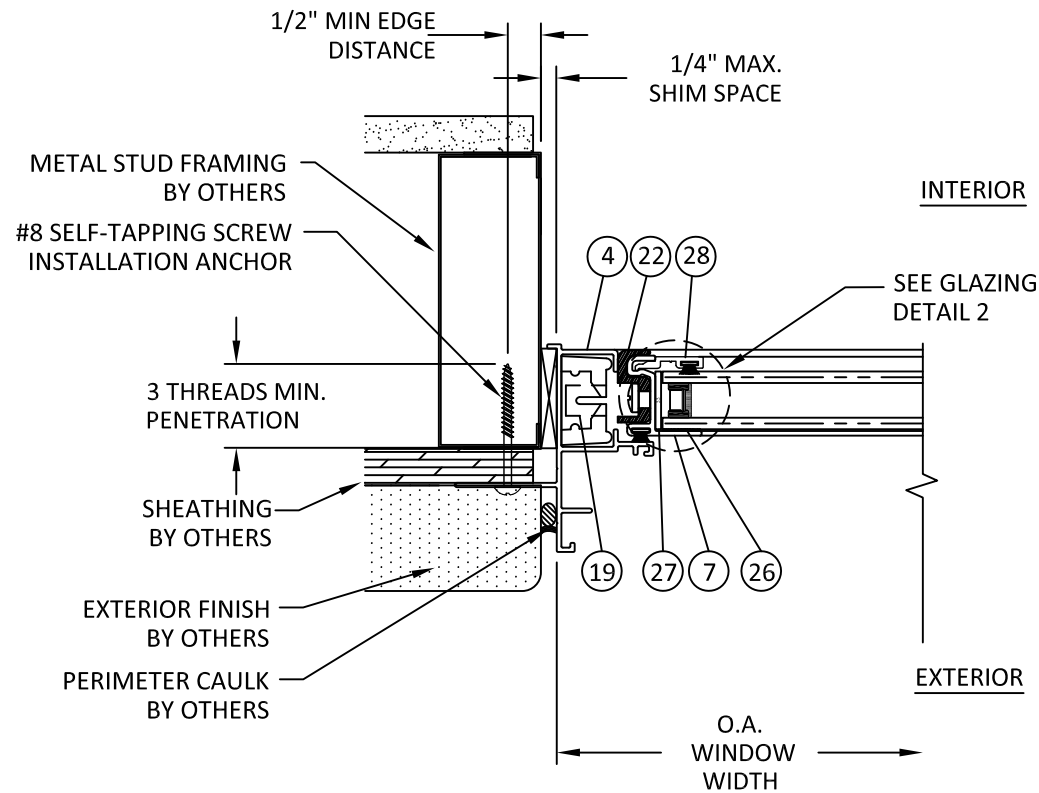

C
4 HORIZONTAL SECTION
OP JAMB - METAL STUD FRAME
NAIL FIN INSTALLATION

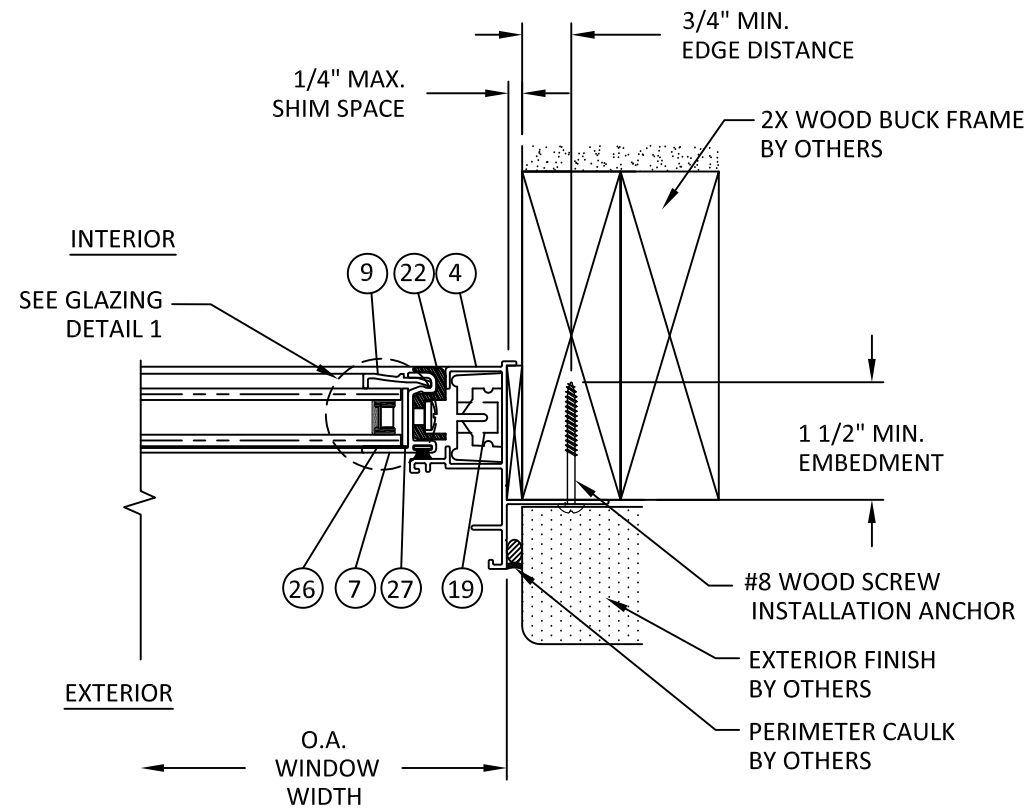


D
4 HORIZONTAL SECTION
OP JAMB - 2X WOOD FRAME
NAIL FIN INSTALLATION

s:\projects\wintech\fb-19-1020 - fbc submittal - single hung window\dwg\wnt001 - 225.sh.dwg


10/17/2019 4:46 PM

BILL OF MATERIAL			
NO.	PART NUMBER	DESCRIPTION	MANUFACTURER
1	E186	FRAME HEAD	PLY GEM / ALENCO
2	E756	FRAME SILL	PLY GEM / ALENCO
3	E787	FIXED MTG RAIL	PLY GEM / ALENCO
4	E788	FRAME JAMB	PLY GEM / ALENCO
5	E103	SASH HANDLE RAIL	PLY GEM / ALENCO
6	E125	SASH BOTTOM RAIL	PLY GEM / ALENCO
7	E102	SASH RAIL	PLY GEM / ALENCO
8	E100	UPPER FRAME ADAPTOR	PLY GEM / ALENCO
9	V01	VINYL GLAZING BEAD	QUALPRO
10	610	SWEEP LOCK	ROYAL
11	SL02	SASH ASSEMBLY SCREW	ALLOY
12	SL01	FRAME ASSEMBLY SCREW	ALLOY
13	95	TILT LATCH SCREW	ALLOY
14	96	LOCK SCREW	ALLOY
15	AT27-R	SASH BALANCE	CALDWELL
16	796	BALANCE SCREW	ALLOY
17	67805	LH TILT LATCH	HILL
18	67806	RH TILT LATCH	HILL
19	16T225	PIVOT SHOES	CALDWELL
20	16T19	PIVOT BAR W/SCREWS	CALDWELL
21	797	HEAD AND SILL GASKET	SECON
22	877	SASH GUIDES	FOSHAN
23	SMSL007	SEAM SEALANT	PECORA
24	613	SASH STOPS	WINTech
25	72	SASH WEATHERSTRIP	AMESTEX
26	8FT	GLAZING SEALANT	PECORA
27	33	EDGE BLOCK	SECON
28	E519	SASH ALUM. GLAZING BEAD	GATEWAY


1 FRAME HEAD

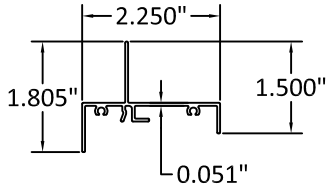


2 FRAME SILL

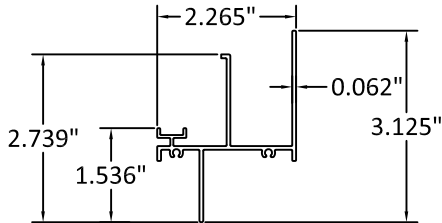


3 FIXED MTG RAIL




4 FRAME JAMB




5 SASH HANDLE RAIL




6 SASH BOTTOM RAIL




7 SASH RAIL




8 UPPER FRAME ADAPTOR




9 VINYL GLAZING BEAD




10 SWEEP LOCK




17 LH TILT LATCH

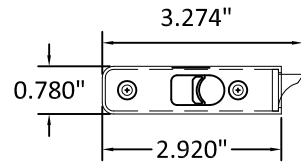


18 RH TILT LATCH

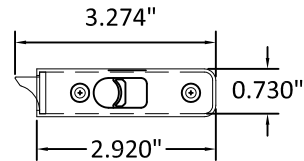


19 PIVOT SHOES




22 SASH GUIDES



27 EDGE BLOCK



28 SASH ALUMINUM GLAZING BEAD



WINTech

WINDOW TECHNOLOGY, INC.

201 INDUSTRIAL DRIVE
MONETT, MO 65708
WWW.WINTeCHINC.COM

PH: (417) 235-7821 FX: (417) 737-7140

TITLE: SERIES 225 SINGLE HUNG WINDOW (NON IMPACT)

COMPONENTS AND BILL OF MATERIALS

PREPARED BY: BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-5478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS

BY

DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

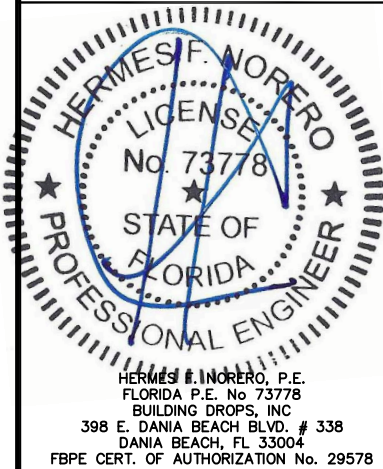

FL #:

FL30750

DATE: 10.16.2019

DWG. BY: RV

CHK. BY: HFN

SCALE: NTS

DWG. #: WNT001

SHEET:

5

OF 5