

RENAISSANCE WINDOWS AND DOORS

SERIES 8500 VINYL XOx HORIZONTAL SLIDING WINDOW

INSTALLATION ANCHORAGE DETAILS

GENERAL NOTES:

1. THIS PRODUCT HAS BEEN TESTED, EVALUATED AND DESIGNED TO THE 9th EDITION (2026) FLORIDA BUILDING CODE. TESTING WAS CONDUCTED IN ACCORDANCE WITH AAMA/WDMA/CSA 101/I.S.2/A440-08/11.
2. THE PRODUCT DETAILS CONTAINED HEREIN ARE BASED UPON SIGNED AND SEALED TEST REPORT NCTL-210-4105-03 AND ASSOCIATED LABORATORY DRAWINGS BY NATIONAL CERTIFIED TESTING LABORATORIES. GATEWAY SIZE TESTING BASED ON TEST REPORT NO. 02-51846.01 BY ARCHITECTURAL TESTING INC.
3. THIS PRODUCT EVALUATION DOCUMENT IS NOT FOR USE IN THE HIGH VELOCITY HURRICANE ZONE (HVHZ).
4. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE / MASONRY AND 2X FRAMING FRAMING SUBSTRATES AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE LICENSED PROFESSIONAL ENGINEER OR REGISTERED ARCHITECT ACTING AS THE DESIGN PROFESSIONAL OF RECORD FOR THE PROJECT OF INSTALLATION.
5. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE LICENSED PROFESSIONAL ENGINEER OR REGISTERED ARCHITECT ACTING AS THE DESIGN PROFESSIONAL OF RECORD FOR THE PROJECT OF INSTALLATION.
6. WHEN INSTALLED IN LOCATIONS WHERE WINDBORNE DEBRIS PROTECTION REQUIREMENTS EXIST,THIS PRODUCT REQUIRES OPENING PROTECTION IN ACCORDANCE WITH THE 9th EDITION (2026) FLORIDA BUILDING CODE USING AN APPROVED IMPACT PROTECTION DEVICE.
7. SITE CONDITIONS NOT COVERED IN THIS PRODUCT EVALUATION DOCUMENT ARE SUBJECT TO ADDITIONAL ENGINEERING ANALYSIS BY A LICENSED PROFESSIONAL ENGINEER OR REGISTERED ARCHITECT AS REQUIRED BY THE AUTHORITY HAVING JURISDICTION.
8. WINDOW FRAME MATERIAL: VINYL (PVC).
9. GLASS MEETS THE REQUIREMENTS OF ASTM E1300-24.
10. DESIGNATION "O" STANDS FOR FIXED LITE AND "X" STANDS FOR OPERABLE VENT/SASH LITE.
11. THESE DRAWINGS CERTIFY THE FENESTRATION ANCHORAGE INSTALLATION ONLY. WATER-RESISTIVE BARRIER DETAILING OF THE WINDOW IS NOT PART OF THIS INSTALLATION CERTIFICATION. DETAILS SHOWN ARE FOR ILLUSTRATIVE PURPOSES ONLY. WATER-RESISTIVE BARRIER DETAILING SHALL BE THE RESPONSIBILITY OF THE INSTALLER. REFER TO THE REQUIREMENTS OF THE FLORIDA BUILDING CODE SECTION 1405.4 AND FLORIDA RESIDENTIAL CODE SECTION R703.4 FOR RECOMMENDATIONS. PER FBC SECTION 1405.4.1.4 AND FRC SECTION R703.4, FMA/AAMA 100-12 AND FMA/AAMA 200-12 CAN BE USED FOR GUIDANCE. ADDITIONALLY, ASTM E2112 CAN BE USED FOR GUIDANCE.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES, INSTALLATION NOTES, TABLE OF CONTENTS
2	ANCHOR SCHEDULE - EMBEDMENT AND EDGE DISTANCE
3	NOMINAL 108" x 60" XOx WINDOW ELEVATION
4	NOMINAL 108" x 60" FIN FRAME ANCHORING LAYOUT ELEVATION
5	NOMINAL 108" x 60" THROUGH FRAME ANCHORING LAYOUT ELEVATION
6	VERTICAL CROSS SECTIONS
7	HORIZONTAL CROSS SECTION
8	FIN FRAME AND THROUGH FRAME HEAD & JAMB ANCHORING CROSS SECTIONS
9	THROUGH FRAME SILL ANCHORING CROSS SECTIONS
10	GLAZING DETAIL AND GLAZING NOTES /BILL OR MATERIALS

INSTALLATION NOTES:

1. PRODUCT ANCHORS SHALL BE AS DESIGNATED AND LOCATED AS SHOWN IN THIS PRODUCT EVALUATION DOCUMENT. ANCHOR EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER AND SIDING.
2. SEE *INSTALLATION ANCHOR SCHEDULE* ON SHEET 2 FOR TYPE AND GRADE OF ANCHOR, AND/OR MANUFACTURER'S ANCHOR SPECIFICATIONS, INCLUDING MINIMUM NOMINAL SIZE, MINIMUM EMBEDMENT INTO SUBSTRATE AND MINIMUM EDGE DISTANCES.

2.1. EDGE DISTANCES SHALL BE MEASURED FROM CENTERLINE OF ANCHOR TO EDGE OF STRUCTURAL SUBSTRATE EITHER TO THE INTERIOR OR EXTERIOR OF THE FENESTRATION PRODUCT.

2.2. MINIMUM EMBEDMENT SHALL BE BASED ON PENETRATION INTO MAIN WIND FORCE RESISTING SYSTEM SUBSTRATE.
3. SEE SHEET 8 AND 9 FOR SPECIFIC ANCHOR INSTALLATION DETAILS.
4. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
5. ANCHOR QUANTITIES AND SPACING / EMBEDMENT AND EDGE DISTANCE

5.1. THE NUMBER OF INSTALLATION ANCHORS IS BASED ON THE MAXIMUM END DISTANCE (ED) AND THE MAXIMUM ON CENTER (O.C.) SPACING PLACEMENT OF ANCHORS IN ACCORDANCE WITH ELEVATIONS ON SHEETS 3 AND 4.

5.2. END DISTANCES AND O.C. SPACINGS LESS THAN THAT SHOWN IN THE ELEVATIONS ON SHEETS 3 AND 4 ARE ACCEPTABLE.

5.3. FOR WINDOW SIZES SMALLER THAN THOSE SHOWN, ANCHOR QUANTITIES CAN BE REDUCED WHILE MAINTAINING EDGE DISTANCE AND O.C. SPACING REQUIREMENTS.

5.4. ANCHOR QUANTITIES AND SPACINGS SHOWN ARE BASED ON THE LOWER OF ANCHOR SPACING USED IN TESTING OR REQUIRED BY LOADING AT DESIGN PRESSURE.

5.5. SEE EMBEDMENT AND EDGE DISTANCE DESCRIPTION ON SHEET 2.
6. MAXIMUM ALLOWABLE SHIM THICKNESS IS 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF WOOD COMPOSITE, HIGH DENSITY PLASTIC OR SIMILAR LOAD BEARING MATERIAL.
7. FOR CONCRETE BLOCK APPLICATIONS DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS.
8. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED IN THE *INSTALLATION ANCHOR SCHEDULE* ON SHEET 2.
9. ALL FASTENERS TO BE CORROSION RESISTANT, AND/OR HAVE A CORROSION RESISTANT COATING, OR WHEN EXPOSED TO SALTWATER ENVIRONMENTS WITHIN 3,000 FEET OF A SALTWATER COASTLINE MEET THE REQUIREMENTS OF SECTION 1711, 9TH EDITION (2026) FBC AND SECTION R332, 9TH EDITION (2026) FRC WHEN APPLICABLE.

PERFORMANCE RATING				
MAXIMUM WINDOW SIZE	ELEVATION	GLAZING DETAIL (SEE SHEET 10)	DESIGN PRESSURE (PSF)	IMPACT RATING
NOMINAL 109" x 60" (108-3/4" x 60")	SHEET 3	A	+/- 30	NONE SEE GENERAL NOTE 6


PROJECT # ACE-2025-127				RJA	BY
				8/4/26	DATE
			UPDATE TO THE 9TH EDITION (2026) FBC	A	DESCRIPTION
RENAISSANCE WINDOWS AND DOORS 13340 INTERNATIONAL PARKWAY JACKSONVILLE, FL 32218	TITLE: SERIES 8500 VINYL XOx HORIZONTAL SLIDING WINDOW GENERAL NOTES, INSTALLATION NOTES & TABLE OF CONTENTS	DRAWN BY: RJA	DATE: 12/11/19	DRAWING NO: RWD0017	SHEET: 1 OF 10
		SCALE: N.T.S.		REV: A	
		PREPARED BY: AMORUSO CONSULTING ENG., LLC FBPE REGISTRATION NO. 38327 226 N NOVA RD, NO. 142 ORMOND BEACH, FL 32174 RJAENGPE@GMAIL.COM			

Robert J. Amoruso, P.E.
Florida P.E. No. 49752




SIGNED/SEALED: 8/4/26


INSTALLATION ANCHOR SCHEDULE									
INSTALLATION TYPE	SECTION VIEW	FASTENER HEAD TYPE	FASTENER SIZE	SUBSTRATE	MANUFACTURER AND/OR SPECIFICATION	MIN. EMBEDMENT (IN)	MIN. EDGE DISTANCE (IN)	MIN. SPACING (IN) BETWEEN FRAME ANCHORS	ANCHOR CAPACITIES BASED ON
THROUGH FRAME ANCHOR	SECTION B (SHEET 8) ----- SECTION E (SHEET 9)	HEX HEAD	3/16"	CONCRETE	ITW TAPCONS (1)	1	1-1/8	3	MIN. 2500 PSI CONCRETE
				MASONRY (BLOCK/CMU)	ITW TAPCONS (1)	1	2	3	STRENGTH CONFORMANCE TO ASTM C-90, MEDIUM WEIGHT
	PAN HEAD	No. 10	WOOD	ANSI B18.6.1 (WOOD SCREW) (2) GRADE 2 EQUIVALENT	1-3/8	3/4	2 1/2	WOOD WITH A MINIMUM SPECIFIC GRAVITY OF 0.42.	
				ASME B18.6.4 (TAPPING SCREW) (2) GRADE 2 EQUIVALENT					
SNAP-ON FLANGE WITH THROUGH FRAME ANCHOR	SECTION C (SHEET 8) ----- SECTION D (SHEET 9)	HEX HEAD	3/16"	CONCRETE	ITW TAPCONS (1)	1	1-1/8	3	MIN. 2500 PSI CONCRETE
				MASONRY (BLOCK/CMU)	ITW TAPCONS (1)	1	2	3	STRENGTH CONFORMANCE TO ASTM C-90, MEDIUM WEIGHT
	PAN HEAD	No. 10	WOOD	ANSI B18.6.1 (WOOD SCREW) (2) GRADE 2 EQUIVALENT	1-3/8	3/4	2 1/2	WOOD WITH A MINIMUM SPECIFIC GRAVITY OF 0.42.	
				ASME B18.6.4 (TAPPING SCREW) (2) GRADE 2 EQUIVALENT					
NAILING FIN ANCHOR	SECTION A (SHEET 8)	PAN HEAD	No. 8	WOOD	ANSI B18.6.1 (WOOD SCREW) (3) GRADE 2 EQUIVALENT	1-5/8	1/4	1	WOOD WITH A MINIMUM SPECIFIC GRAVITY OF 0.42.
					ASME B18.6.4 (TAPPING SCREW) (3) GRADE 2 EQUIVALENT				
NOTES: 1) WHEN ITW TAPCONS ARE USED FOR CONCRETE/MASONRY INSTALLATION, THEY SHALL BE THE ADVANCED THREADFORM TECHNOLOGY TYPE. 2) FOR WOOD SCREW INSTALLATION INTO WOOD SUBSTRATE; IF SPLITTING IS A CONCERN, DRILL 0.090" PILOT HOLE (DRILL SIZE 43). FOR TAPPING SCREW INSTALLATION INTO WOOD SUBSTRATE; IF SPLITTING IS A CONCERN, DRILL 0.121" PILOT HOLE (DRILL SIZE 31). 3) FOR WOOD OR TAPPING SCREW INSTALLATION INTO WOOD SUBSTRATE; IF SPLITTING IS A CONCERN, DRILL 0.082" PILOT HOLE (DRILL SIZE 45).									

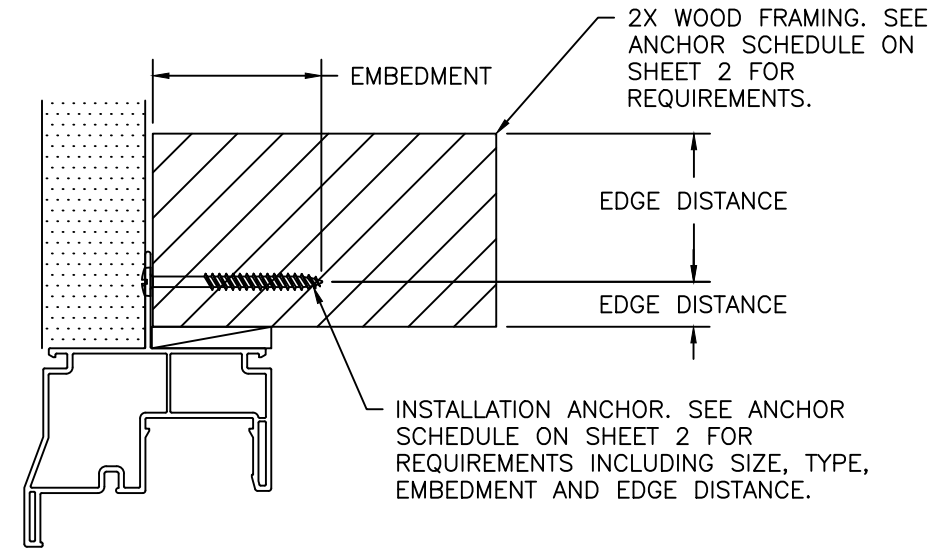

EMBEDMENT AND EDGE DISTANCE
NAILING FIN FRAME INSTALLATION

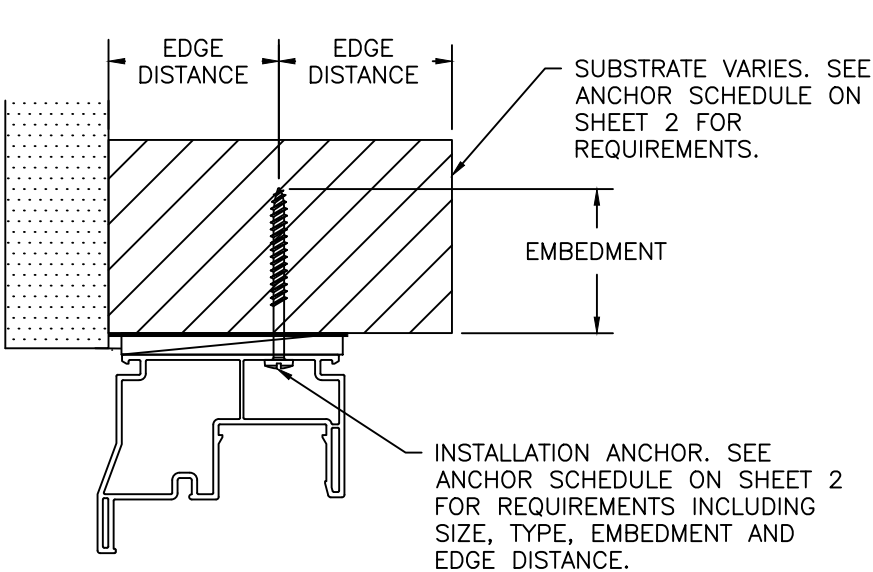

EMBEDMENT AND EDGE DISTANCE
THROUGH-FRAME INSTALLATION

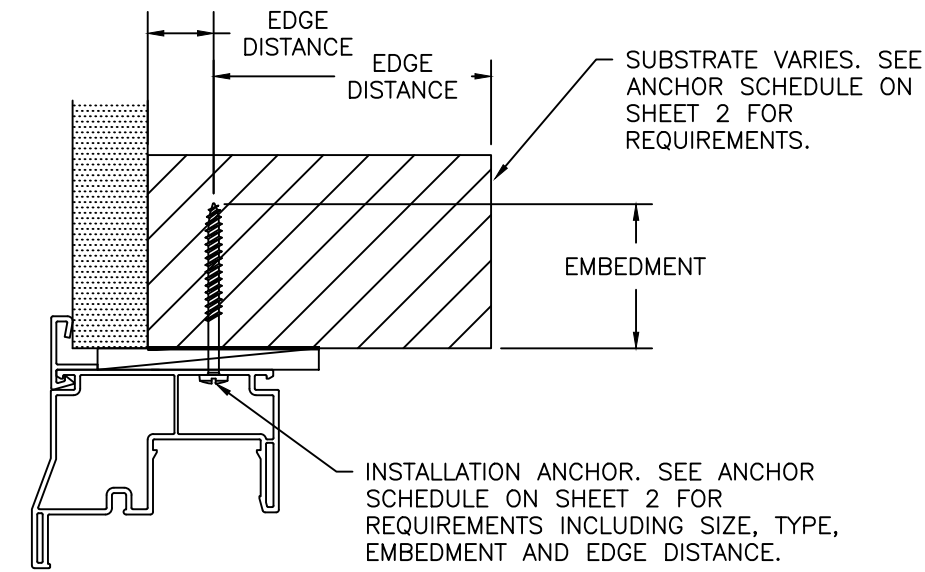


EMBEDMENT AND EDGE DISTANCE
SNAP-ON FLANGE THROUGH-FRAME INSTALLATION

PROJECT # ACE-2025-127				RJA	BY
				8/4/26	DATE
			UPDATE TO THE 9TH EDITION (2026) FBC	A	DESCRIPTION
				REV	REV
RENAISSANCE WINDOWS AND DOORS 13340 INTERNATIONAL PARKWAY JACKSONVILLE, FL 32218	TITLE: SERIES 8500 VINYL XXO HORIZONTAL SLIDING WINDOW ANCHOR SCHEDULE - EMBEDMENT & EDGE DISTANCE	DRAWN BY:	RJA	DATE:	12/11/19
		SCALE:	N.T.S.	DRAWING NO:	RWD0017
		REV:	A	SHEET:	2 OF 10
		PREPARED BY:	AMORUSO CONSULTING ENG., LLC FBPE REGISTRATION NO. 38327 226 N NOVA RD, NO. 142 ORMOND BEACH, FL 32174 RIAENGPE@GMAIL.COM		

Robert J. Amoruso, P.E.
Florida P.E. No. 49752



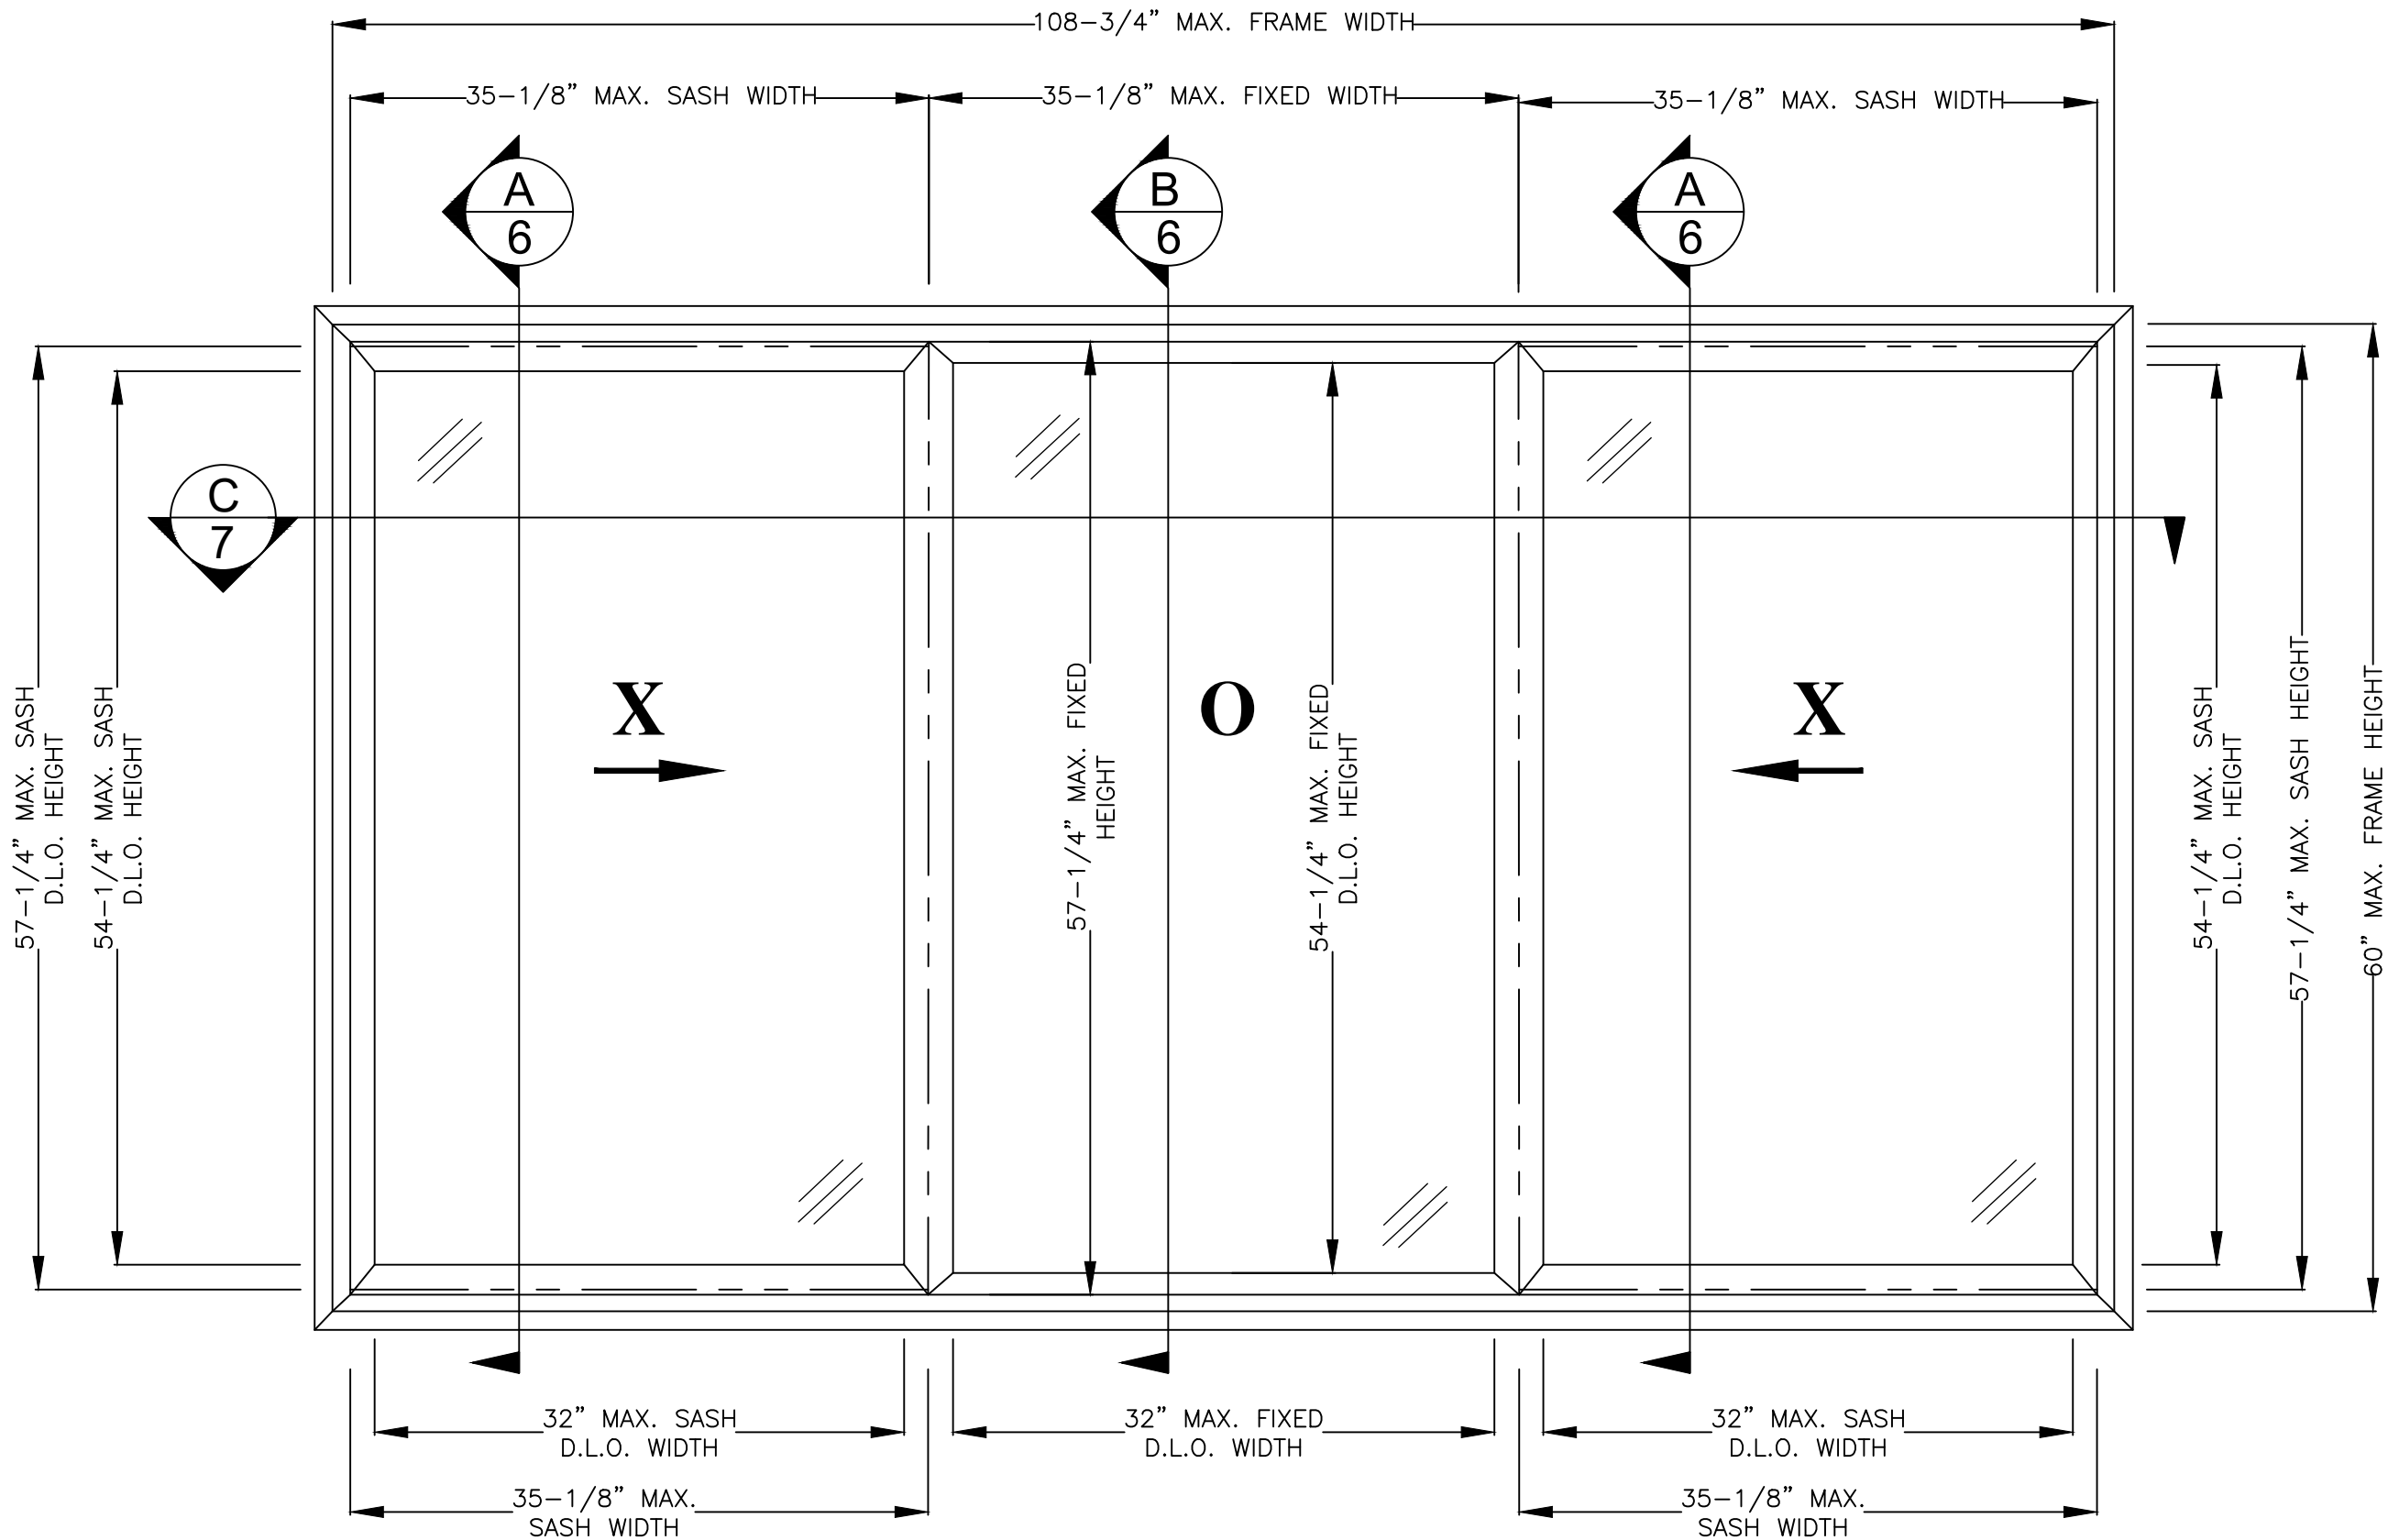


SERIES 8500 VINYL HORIZONTAL SLIDING WINDOW
EXTERIOR VIEW - FIN FRAME SHOWN (FOR THROUGH FRAME ANCHORING, FIN IS REMOVED)
108" X 60" NOMINAL SIZE SHOWN
XOX SHOWN

Robert J. Amoruso, P.E.
Florida P.E. No. 49752



SIGNED/SEALED: 8/4/26

RENAISSANCE WINDOWS AND DOORS 13340 INTERNATIONAL PARKWAY JACKSONVILLE, FL 32218				PROJECT # ACE-2025-127			
TITLE: SERIES 8500 VINYL XOX HORIZONTAL SLIDING WINDOW NOMINAL 108" x 60" XOX WINDOW ELEVATION							
PREPARED BY: AMORUSO CONSULTING ENG., LLC FBPE REGISTRATION NO. 38327 226 N NOVA RD, NO. 142 ORMOND BEACH, FL 32174 RIAENGPE@GMAIL.COM				UPDATE TO THE 9TH EDITION (2026) FBC			
DRAWN BY: RJA				A			
SCALE: N.T.S.				8/4/26			
REV: A				REV			
DATE: 12/11/19				DESCRIPTION			
SHEET: 3 OF 10				DATE			
				BY			

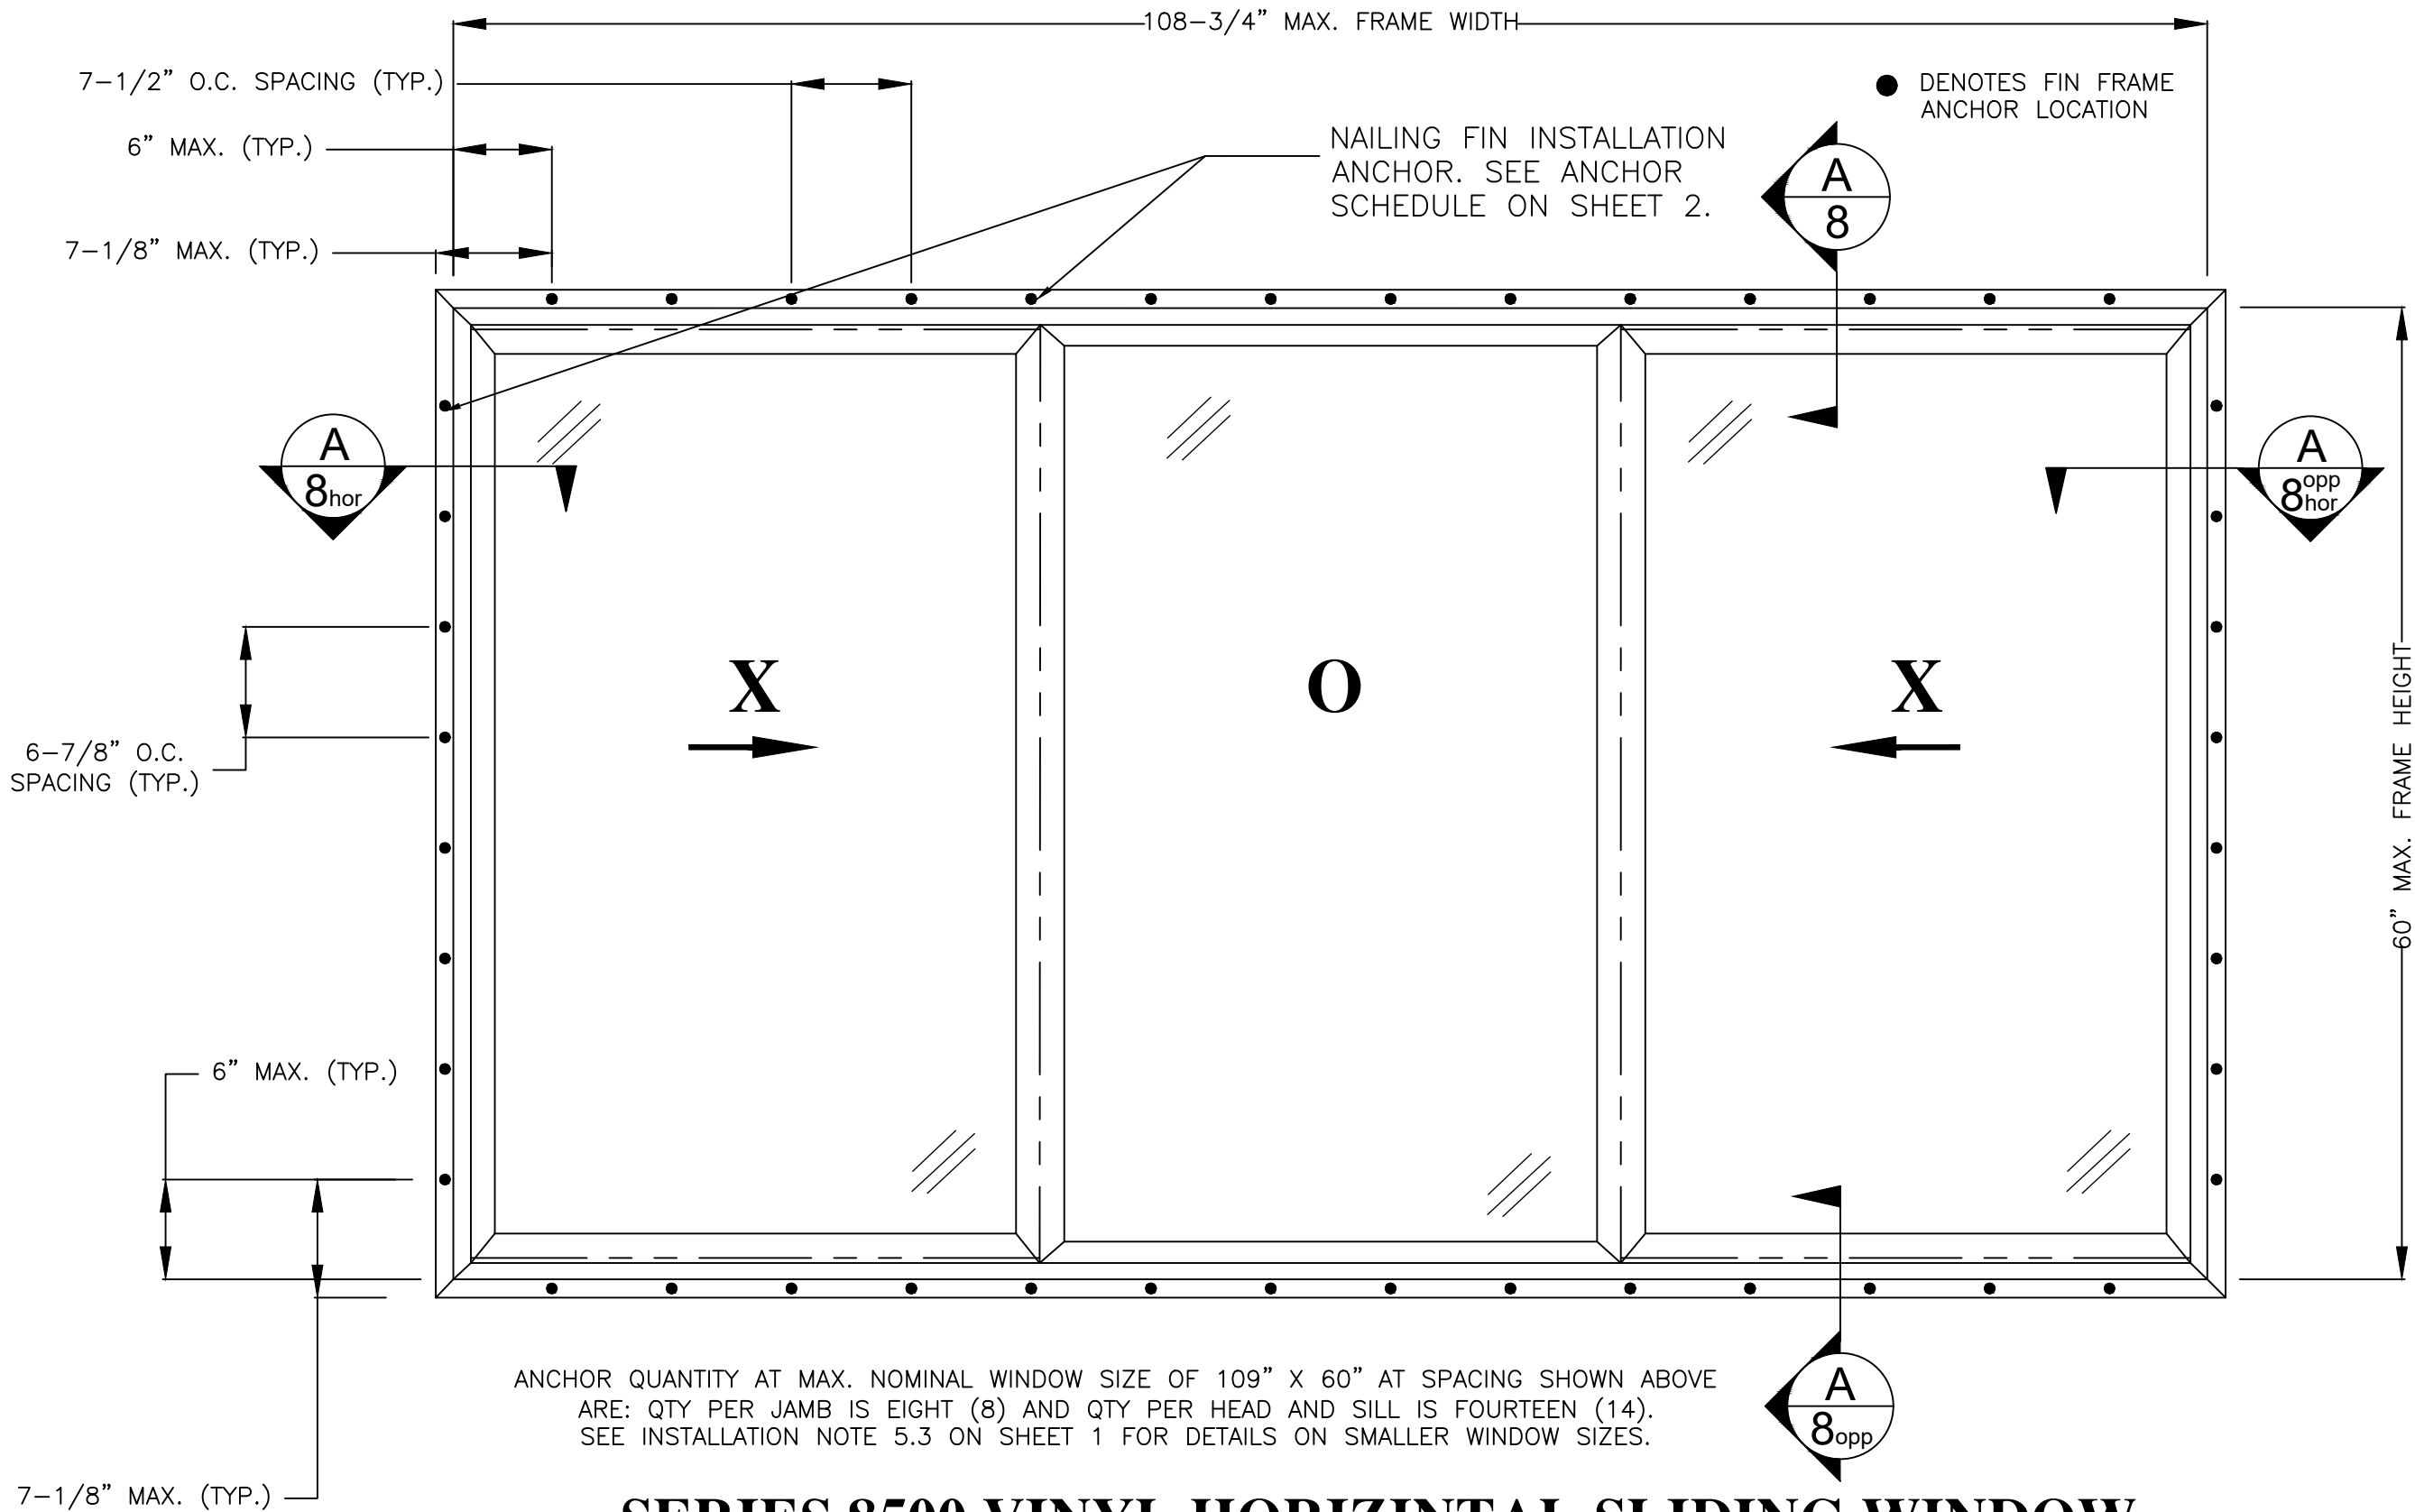

ANCHOR QUANTITY AT MAX. NOMINAL WINDOW SIZE OF 109" X 60" AT SPACING SHOWN ABOVE
ARE: QTY PER JAMB IS EIGHT (8) AND QTY PER HEAD AND SILL IS FOURTEEN (14).
SEE INSTALLATION NOTE 5.3 ON SHEET 1 FOR DETAILS ON SMALLER WINDOW SIZES.

SERIES 8500 VINYL HORIZONTAL SLIDING WINDOW


EXTERIOR VIEW (109" X 60" NOMINAL SIZE SHOWN)
FIN FRAME ANCHOR LOCATIONS AND QUANTITIES

PROJECT # ACE-2025-127					
RENAISSANCE WINDOWS AND DOORS 13340 INTERNATIONAL PARKWAY JACKSONVILLE, FL 32218	TITLE: SERIES 8500 VINYL XOX HORIZONTAL SLIDING WINDOW NOMINAL 108" x 60" FIN FRAME ANCHORING LAYOUT ELEVATION	DRAWN BY: RJA	SCALE: N.T.S.	DATE: 12/11/19	BY: RJA
					8/4/26
					UPDATE TO THE 9TH EDITION (2026) FBC
AMORUSO CONSULTING ENG., LLC FBPE REGISTRATION NO. 38327 226 N NOVA RD, NO. 142 ORMOND BEACH, FL 32174 RIAENGPE@GMAIL.COM	PREPARED BY: RJA	DRAWING NO: RWD0017	REV: A	SHEET: 4 OF 10	DESCRIPTION
					DATE
					BY

Robert J. Amoruso, P.E.
Florida P.E. No. 49752



SIGNED/SEALED: 8/4/26

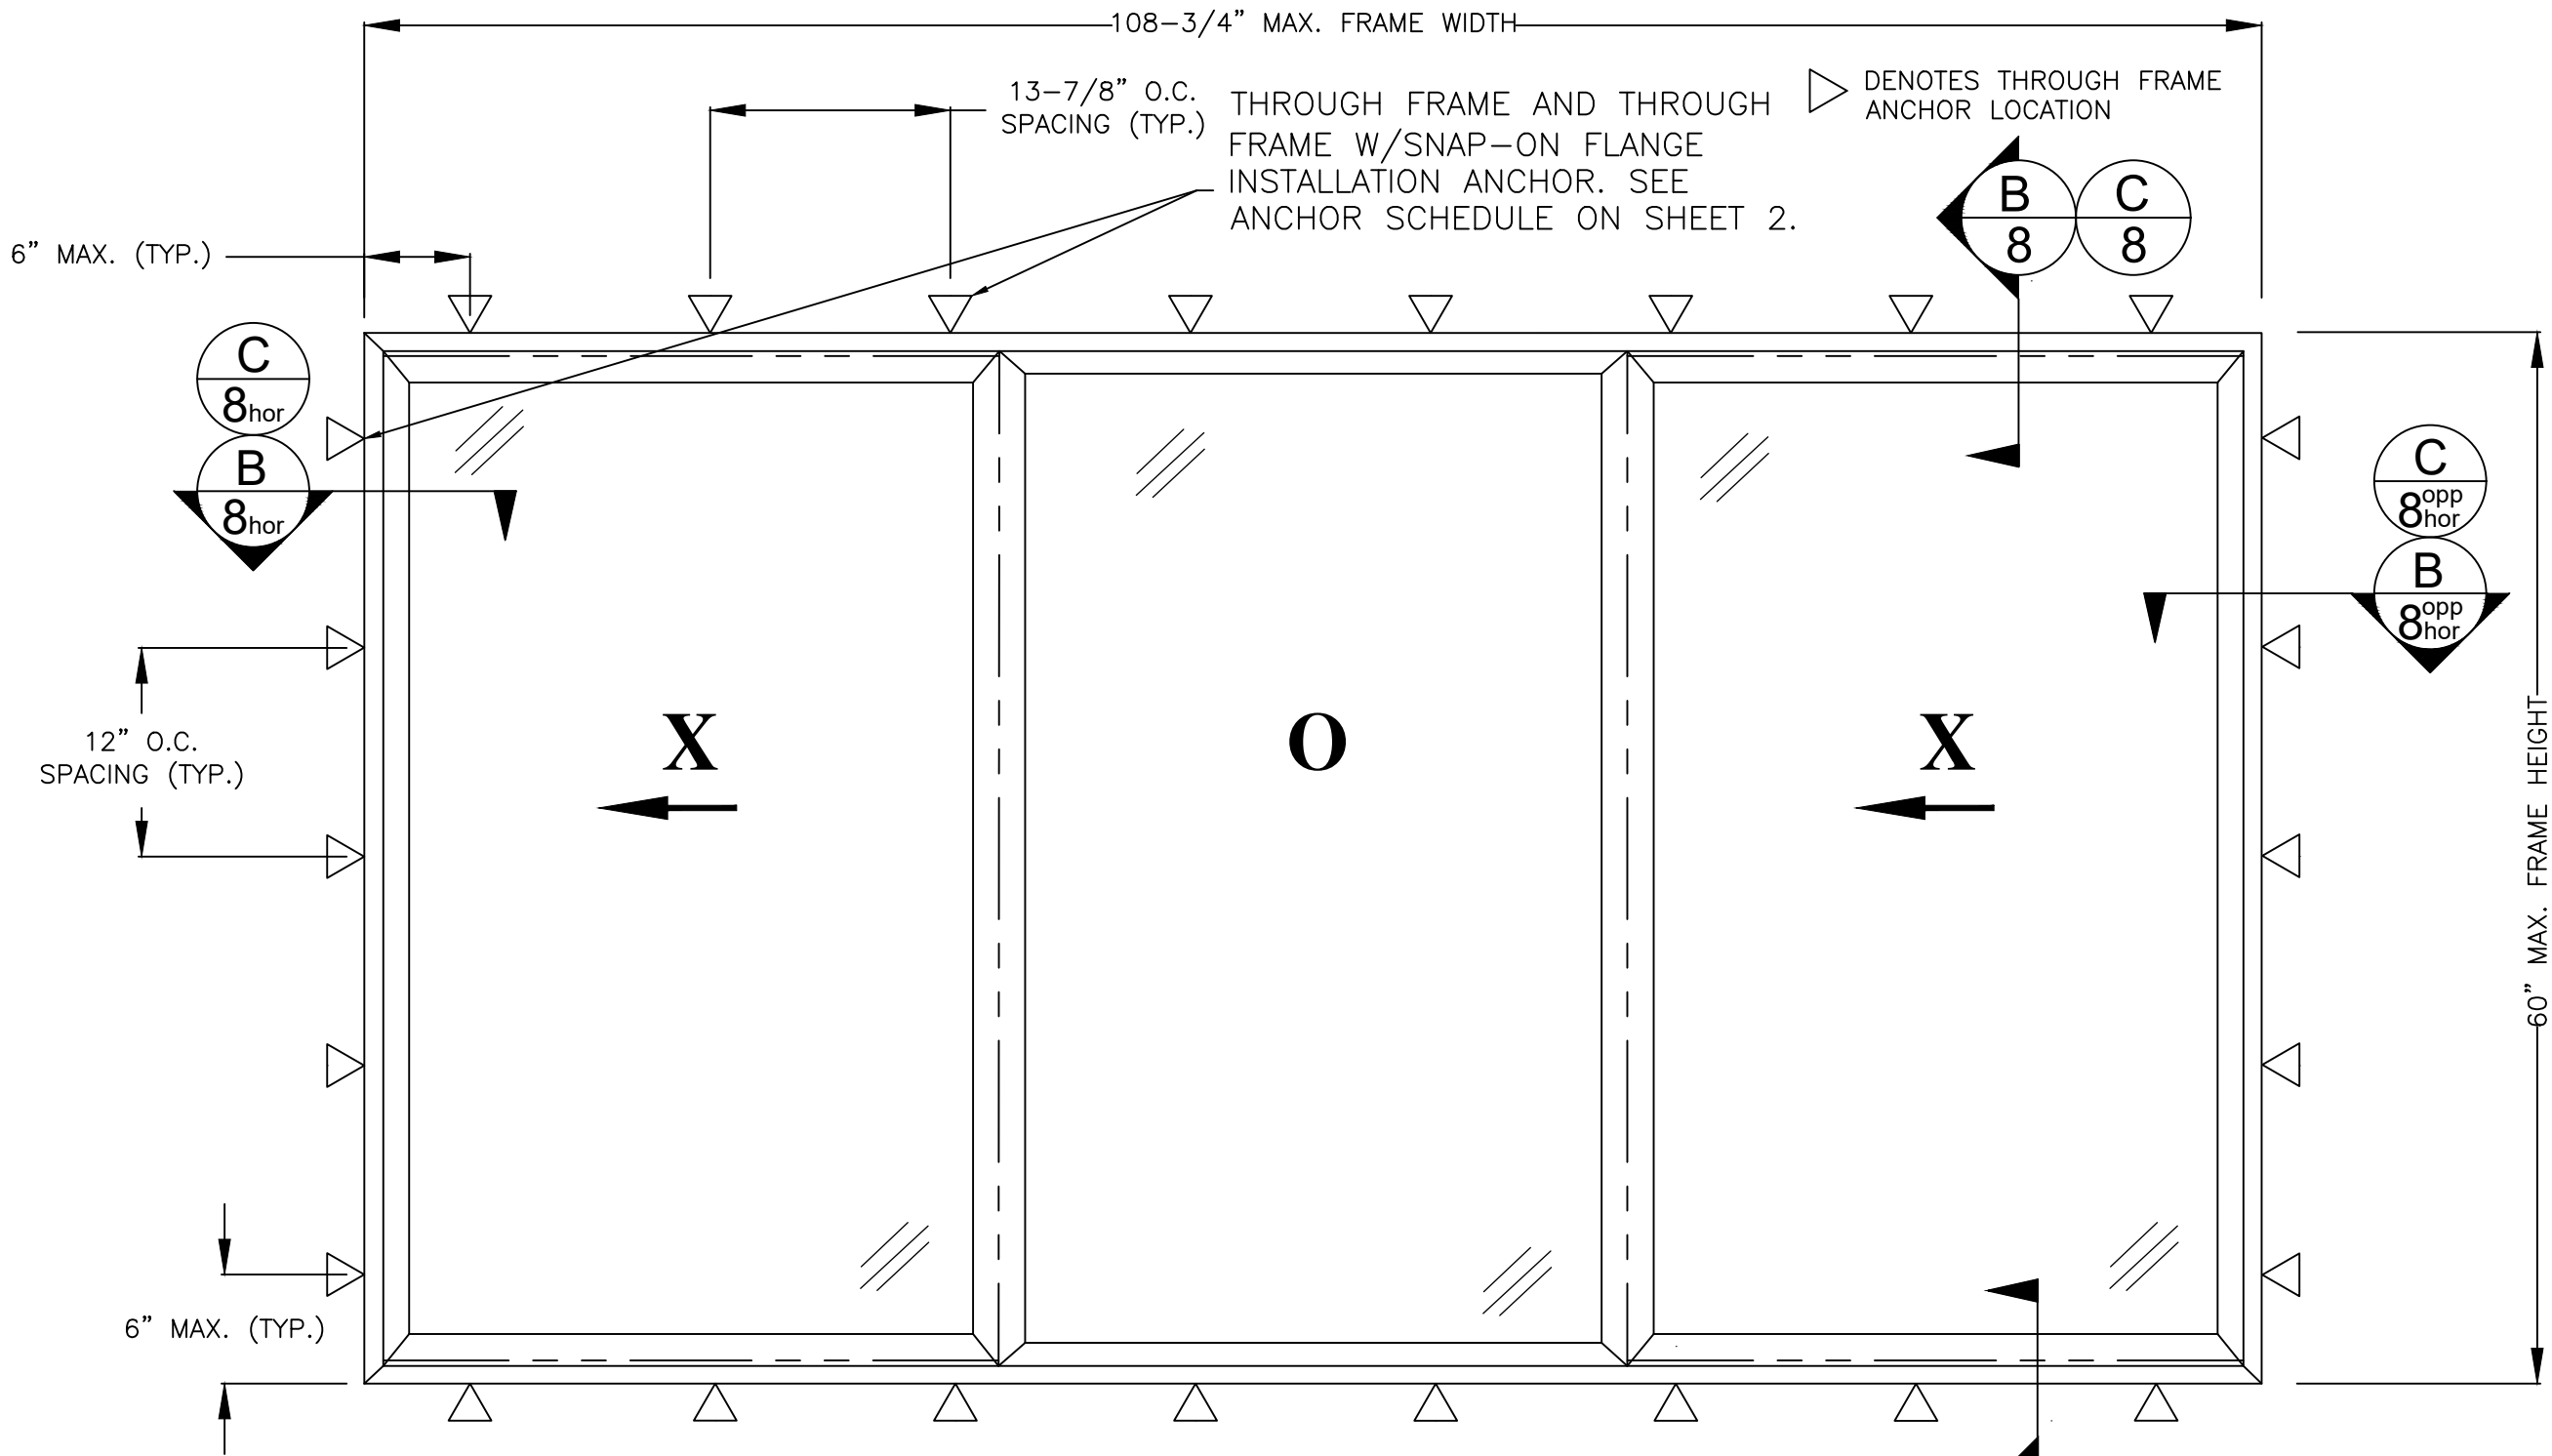

ANCHOR QUANTITY AT MAX. NOMINAL WINDOW SIZE OF 109" X 60" AT SPACING SHOWN
ABOVE ARE: QTY PER JAMB IS FIVE (5) AND QTY PER HEAD AND SILL IS EIGHT (8).
SEE INSTALLATION NOTE 5.3 ON SHEET 1 FOR DETAILS ON SMALLER WINDOW SIZES.


SERIES 8500 VINYL HORIZONTAL SLIDING WINDOW
EXTERIOR VIEW (109" X 60" NOMINAL SIZE SHOWN) WITH FIN REMOVED
THROUGH FRAME ANCHOR LOCATIONS AND QUANTITIES

PROJECT # ACE-2025-127					
RENAISSANCE WINDOWS AND DOORS 13340 INTERNATIONAL PARKWAY JACKSONVILLE, FL 32218	TITLE: SERIES 8500 VINYL XOX HORIZONTAL SLIDING WINDOW NOM. 108" x 60" THRU FRAME ANCHORING LAYOUT ELEVATION	DRAWN BY: RJA	SCALE: N.T.S.	DATE: 12/11/19	8/4/26
					RJA
					UPDATE TO THE 9TH EDITION (2026) FBC
AMORUSO CONSULTING ENG., LLC FBPE REGISTRATION NO. 38327 226 N NOVA RD, NO. 142 ORMOND BEACH, FL 32174 RIAENGPE@GMAIL.COM	REV: A	SHEET: 5 OF 10	DESCRIPTION	DATE	BY

Robert J. Amoruso, P.E.
Florida P.E. No. 49752



SIGNED/SEALED: 8/4/26

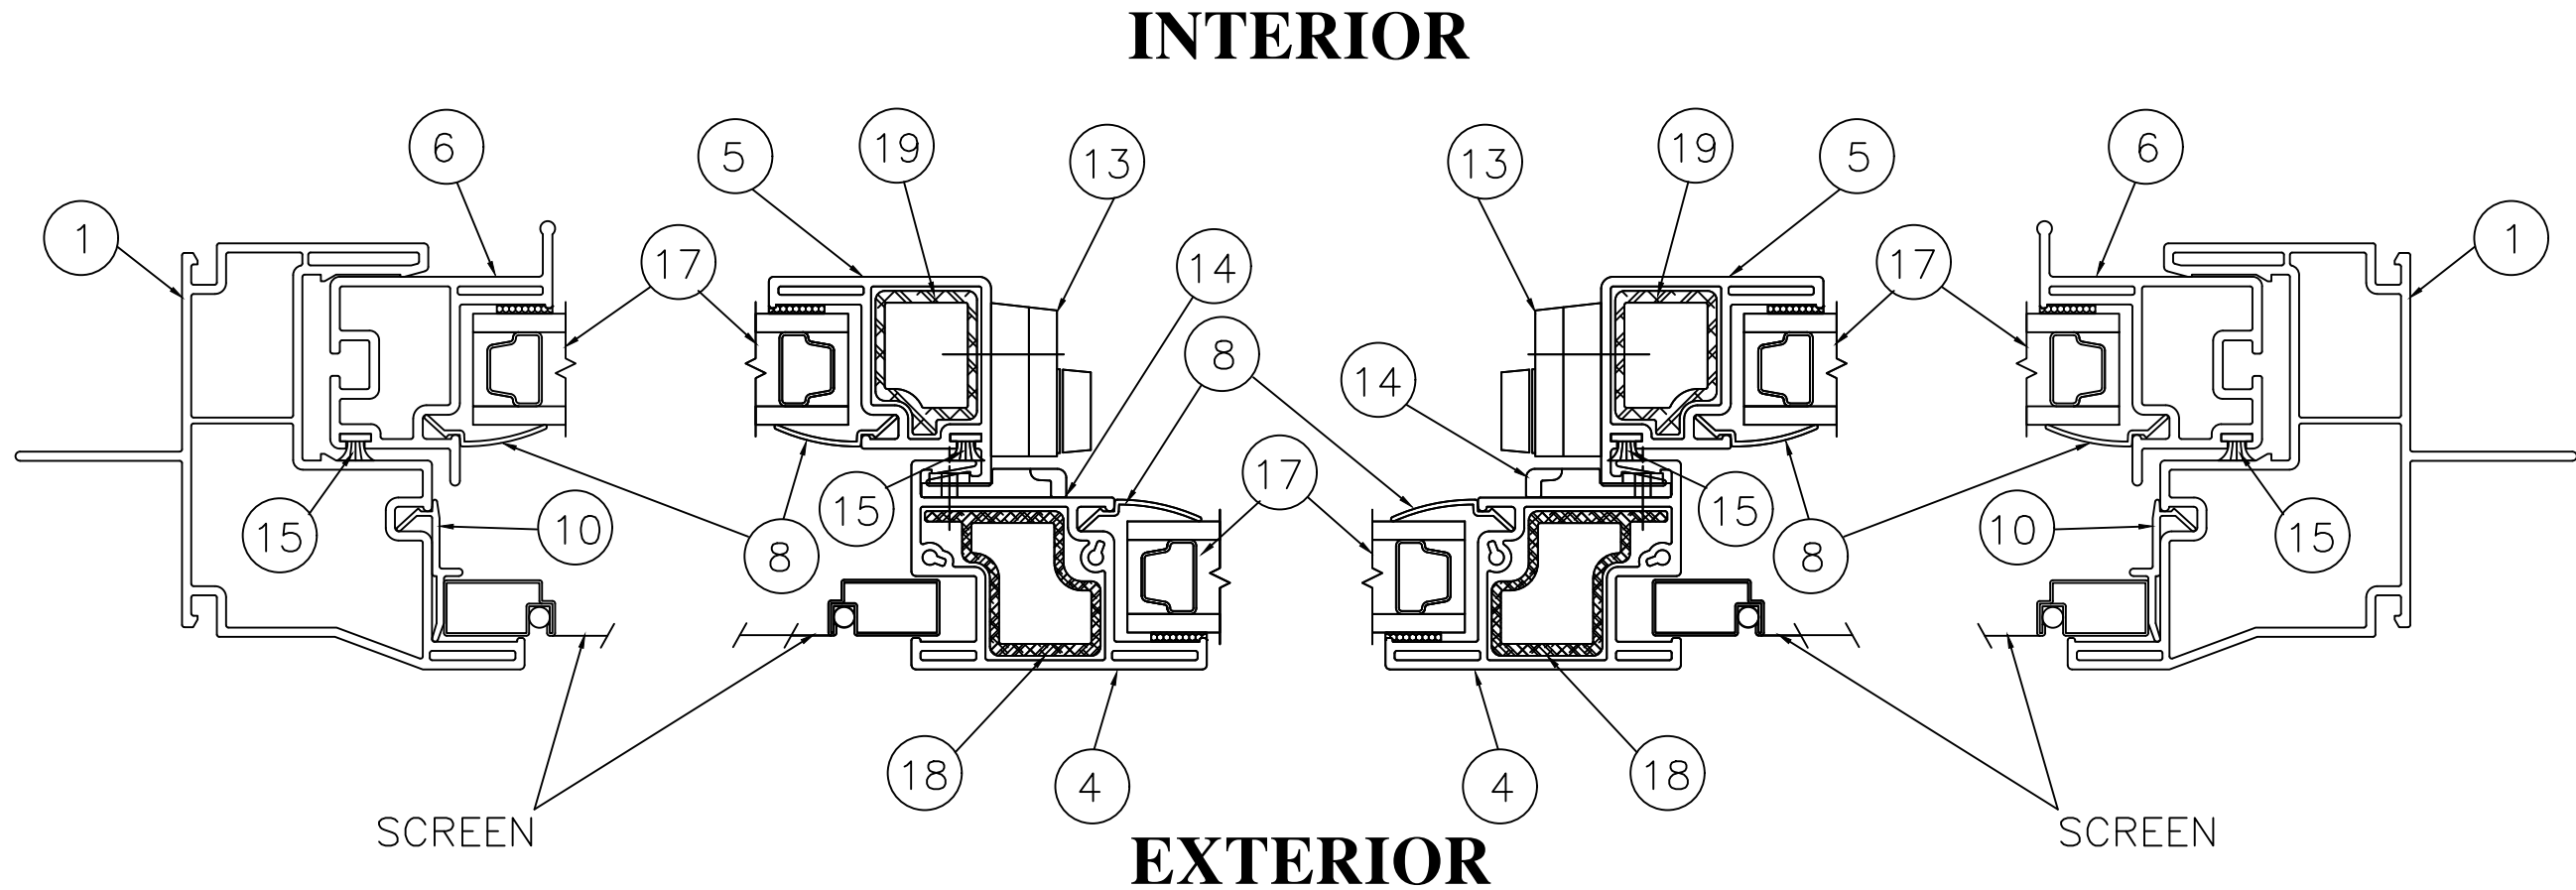

C
7

**XOX HORIZONTAL
CROSS SECTION**

FIN FRAME ANCHORING CROSS SECTION SHOWN
THROUGH-FRAME ANCHORING CROSS SECTION
SAME WITH FIN REMOVED

Robert J. Amoruso, P.E.
Florida P.E. No. 49752



SIGNED/SEALED: 8/4/26

PROJECT # ACE-2025-127					
RENAISSANCE WINDOWS AND DOORS 13340 INTERNATIONAL PARKWAY JACKSONVILLE, FL 32218	SERIES 8500 VINYL XOX HORIZONTAL SLIDING WINDOW HORIZONTAL CROSS SECTION		DRAWN BY: RJA	DATE: 12/11/19	BY: RJA
	PREPARED BY: AMORUSO CONSULTING ENG., LLC FBPE REGISTRATION NO. 38327 226 N NOVA RD, NO. 142 ORMOND BEACH, FL 32174 RIAENGPE@GMAIL.COM		SCALE: N.T.S.	DRAWING NO: RWD0017	8/4/26
			REV: A	SHEET: 7 OF 10	DESCRIPTION
					DATE
					BY



NAILING FIN FRAME INSTALLATION



THROUGH-FRAME INSTALLATION




SNAP-ON FLANGE THROUGH-FRAME INSTALLATION

Robert J. Amoruso, P.E.
Florida P.E. No. 49752



SIGNED/SEALED: 8/4/26

BILL OF MATERIALS 8500 SERIES XOX HORIZONTAL SLIDING WINDOW			
BOM NO.	PART NO.	DESCRIPTION	REMARKS
1	7862	FRAME - HEAD, SILL AND JAMBS	PVC
2	7866	STILE	PVC
3	7863	RAIL	PVC
4	7864	FIXED INTERLOCK	PVC
5	7865	VENT INTERLOCK	PVC
6	7866	VENT PIVOT RAIL/STILE	PVC
7	7870	TRACK	PVC
8	6177	GLAZING BEAD	PVC
9	6555	SETTING BLOCK	NOT SHOWN
10	7871	SCREEN LOCK	PVC
	HARDWARE		
12	---	ROLLER	
13	---	CAM LOCK	
14	---	KEEPER	
15	---	WEATHERSTRIP	.187 x .260 FIN PILE
	GLAZING		
16	---	FOAM TAPE BACK-BEDDING	
17	GLAZING DETAIL A	3/4" OVERLL THICKNESS IGU 1/8" ANNEALED X 1/2"AIR SPACE X 1/8" ANNEALED	
	REINFORCEMENT		
18	7864.1	FIXED REINFORCING BAR	ALUMINUM 6063-T5
19	7865.1	VENT REINFORCING BAR	ALUMINUM 6063-T5
	INSTALLATION COMPONENTS		
20	6384	SILL CLIP	PVC
21	8864	SNAP-ON FLANGE	PVC

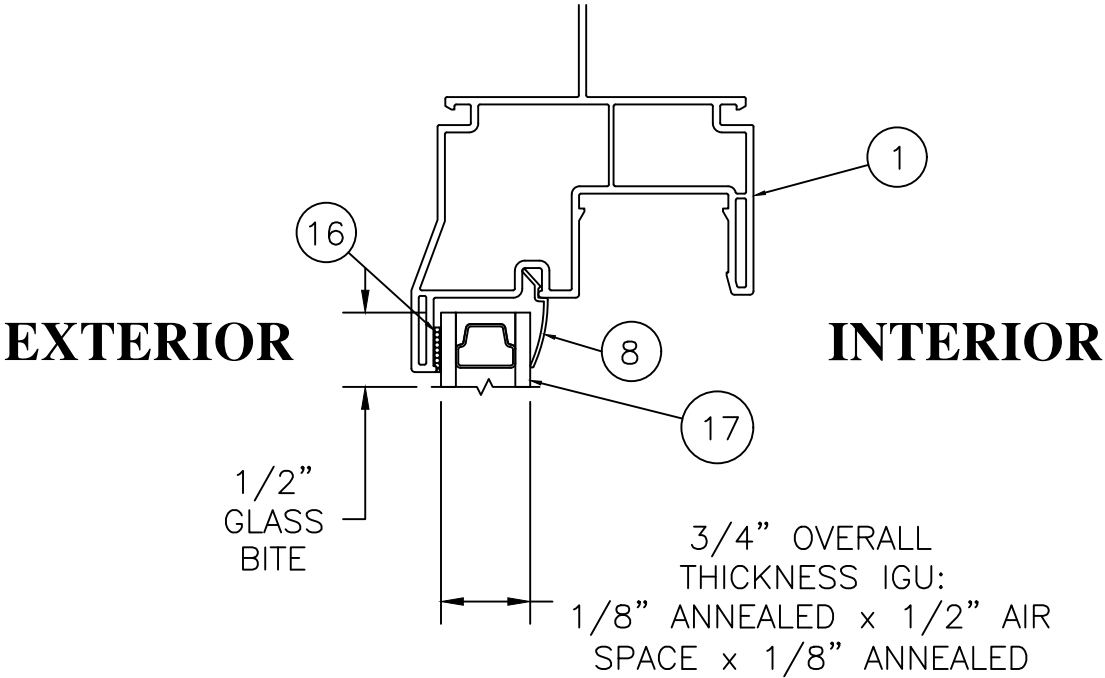

GLAZING DETAIL A

FIXED LITE AT HEAD SHOWN.
SILL & JAMBS SAME FOR FIXED
LITE. FOR VENT/SASH LITE,
GLAZING CONFIGURATION
REVERSED (EXTERIOR VS.
INTERIOR GLAZED AS SHOWN
HERE) FROM FIXED LITE,
OTHERWISE SAME.

- NOTES:
- A MINIMUM OF TWO (2) NEOPRENE SETTING BLOCKS WITH 70 TO 90 SHORE A DUROMETER HARDNESS ARE REQUIRED AT BOTTOM (SILL) OF GLAZING LITES MORE THAN 3 FEET IN WIDTH.
 - AS-TESTED IGU SYSTEM SHOWN. SUBSTITUTIONS ARE ALLOWED IN ACCORDANCE WITH AAMA/WDMA/CSA 101/I.S. 2/A440-11, SECTIONS 10.2.3.2 AND 10.2.3.4. SEE SHEET 1 FOR DETAILS RELATED TO WINDOW SIZE / GLAZING DETAIL / DESIGN PRESSURE.

Robert J. Amoruso, P.E.
Florida P.E. No. 49752



SIGNED/SEALED: 8/4/26

RENAISSANCE WINDOWS AND DOORS 13340 INTERNATIONAL PARKWAY JACKSONVILLE, FL 32218			PROJECT # ACE-2025-127		
TITLE: SERIES 8500 VINYL XOX HORIZONTAL SLIDING WINDOW GLAZING DETAILS AND NOTES / BILL OF MATERIALS					
PREPARED BY: AMORUSO CONSULTING ENG., LLC FBPE REGISTRATION NO. 38327 226 N NOVA RD, NO. 142 ORMOND BEACH, FL 32174 RIAENGPE@GMAIL.COM			DRAWN BY: RJA	DATE: 12/11/19	
			SCALE: N.T.S.	DRAWING NO: RWD0017	RJA
			REV: A	SHEET: 10 OF 10	8/4/26
				DESCRIPTION	DATE
			REV		BY