

GENERAL NOTES:

- SERIES 26000 HIGH IMPACT SLIDING GLASS DOOR (2,3,4 & 5 TRACK DOORS) SHOWN ON THIS PRODUCT EVALUATION DOCUMENT (P.E.D.) HAS BEEN VERIFIED FOR COMPLIANCE IN ACCORDANCE WITH THE 2020 (7th EDITION) OF THE FLORIDA BUILDING CODE. SERIES 26000 HIGH IMPACT SLIDING GLASS DOOR MAY BE INSTALLED AT HIGH VELOCITY HURRICANE ZONES (H.V.H.Z) AND OUT OF IT (N.H.V.H.Z).

DESIGN WIND LOADS SHALL BE DETERMINED AS PER SECTIONS 1620 AND 1609 OF THE ABOVE MENTIONED CODE, USING ASCE 7-16 AND SHALL NOT EXCEED THE MAXIMUM (A.S.D.) DESIGN PRESSURE RATINGS INDICATED ON NOTE 3 BELOW.

IN ORDER TO VERIFY THE ABOVE CONDITION, ULTIMATE DESIGN WIND LOADS DETERMINED PER ASCE 7-16 SHALL BE FIRST REDUCED TO A.S.D. DESIGN WIND LOADS BY MULTIPLYING THEM BY 0.6 IN ORDER TO COMPARE THESE W/ MAX. (A.S.D.) DESIGN PRESSURE RATINGS INDICATED ON NOTE 3 BELOW.

IN ORDER TO VERIFY THAT ANCHORS ON THIS P.E.D., AS TESTED, WERE NOT OVERSTRESSED, A 33% INCREASE IN ALLOWABLE STRESS FOR WIND LOADS WAS NOT USED IN THEIR ANALYSIS. A DURATION FACTOR $CD=1.60$ WAS USED TO VERIFY FASTENERS IN WOOD. FASTENERS SPACING TO WOOD HAS BEEN DETERMINED IN ACCORDANCE WITH N.D.S. 2018.
THESE DOOR'S ADEQUACY FOR IMPACT AND WIND RESISTANCE HAS BEEN VERIFIED IN ACCORDANCE WITH SECTIONS 1626 & 1609.1.2 OF THE ABOVE MENTIONED CODE AS PER PROTOCOLS TAS-201, TAS-202, TAS-203, PER FENESTRATION TESTING LABORATORY INC., LAB REPORTS # 11026 , 12031 & 12031.01 AND AS PER SUBMITTED STRUCTURAL CALCULATIONS, PERFORMED AS PER SECTIONS 1616 & 1604 OF THE FLORIDA BUILDING CODE.
- REMAINING COMPONENTS FOR THIS SLIDING GLASS DOOR SYSTEM SHALL BE AS INDICATED ON BILL OF MATERIALS SHEETS 2,3,4,5 & 6 OF THIS DRAWING.
- MAXIMUM A.S.D. DESIGN PRESSURE RATINGS FOR THESE DOORS SHALL BE AS SHOWN ON SHEETS 8 & 9 (SMALL & LARGE MISSILE). SEE DOOR ELEVATION ON SHEET 7 FOR QUALIFIED CONFIGURATIONS & NOTES.**
- THIS SERIES 26000 HIGH IMPACT SLIDING GLASS DOOR WILL NOT REQUIRE A HURRICANE PROTECTION DEVICE.**
- THIS SERIES 26000 HIGH IMPACT SLIDING GLASS DOOR IS APPROVED FOR AIR AND WATER INFILTRATION, FOLLOWING LIMITATIONS INDICATED ON SHEET 8 BASED ON RISER SILL USED.**
- ALL ALUMINUM EXTRUSIONS IN CONTACT WITH DISSIMILAR MATERIALS SHALL COMPLY WITH SECTION III-6 OF THE 2015 ALUMINUM DESIGN MANUAL.
- ALL SCREWS USED FOR ASSEMBLY CONNECTIONS (METAL TO METAL) TO BE STAINLESS STEEL 304 OR 316 AISI SERIES OR CORROSION RESISTANT COATED CARBON STEEL AS PER DIN 50018 WITH 50 ksi YIELD STRENGTH AND 90 ksi TENSILE STRENGTH & SHALL COMPLY W/ FLORIDA BUILDING CODE SECTION 2411.3.3.4.
- WOOD BUCKS, BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE BUILDING STRUCTURE. WOOD BUCKS MUST BE SOUTHERN PINE, $G=0.55$. AND SHALL COMPLY WITH SECTIONS 2411.3.3.3 & 2411.3.3.4 OF THE FLORIDA BUILDING CODE SEE BELOW.

(8.1) 2X WOOD BUCKS MUST BE PROPERLY ANCHORED TO EXISTING STRUCTURE TO TRANSFER LOADS TO IT. ANCHORAGE IS INDEPENDENT OF SLIDING DOOR FRAME ANCHORAGE. SLIDING DOOR FRAME MUST BE SEPARATELY ANCHORED TO 2X WOOD BUCK FOLLOWING DETAILS ON THIS DRAWING.

(8.2) 1X WOOD BUCK (OR ANY WOOD BUCK LESS THAN 2X) MUST BE PROPERLY ANCHORED TO EXISTING STRUCTURE TO TRANSFER LOADS TO IT. SLIDING DOOR FRAME ANCHOR SHALL BE USED TO ATTACH 1X WOOD BUCK TO EXISTING STRUCTURE BY DRIVING ANCHOR THRU BOTH SLIDING DOOR FRAME & 1X WOOD BUCK INTO EXISTING STRUCTURE W/ PROPER EMBEDMENT AND EDGE DISTANCE AS SHOWN ON THIS DRAWING.

(8.3) SLIDING DOOR FRAME MAY BE DIRECTLY CONNECTED TO EXISTING STRUCTURE WITH NO NEED OF WOOD BUCKS WHEN MASONRY OPENING IS NOT LARGER THAN ACTUAL DOOR OVERALL DIMENSIONS. HOWEVER, SHIMS (SEE NOTE 10) MAY BE ALLOWED AT SLIDING DOOR FRAME ANCHOR LOCATION IF NEEDED.
- ANCHOR NOTES:** EMBEDMENT AND EDGE DISTANCE ARE BEYOND ANY FINISH.

(A) **TO EXISTING POURED CONCRETE:** (Min. $f_c = 3.000$ ksi), MIN. EDGE DISTANCE = 2 1/2".
- 1/4"Ø ULTRACON W/ 1 3/4" MIN. EMBEDMENT, AS MANUFACTURED BY ELCO CONSTRUCTION PRODUCTS, INC. (COMPONENT 30), THRU 1" P.T. WOOD BUCK.

(B) **TO EXISTING A.S.T.M. C-90 CONCRETE BLOCK** MIN. EDGE DISTANCE = 2 1/2". (APPLICABLE TO JAMBS ONLY)
- 1/4"Ø ULTRACON W/ 1 1/4" MIN. EMBEDMENT, AS MANUFACTURED BY ELCO CONSTRUCTION PRODUCTS, INC. (COMPONENT 30), THRU 1" P.T. WOOD BUCK.

(C) **TO EXISTING 2x P.T. WOOD BUCK (MIN. $G=0.55$).** MIN. EDGE DISTANCE = 1".
- 1/4"Ø ULTRACON W/ 1 1/2" MIN. THREADED PENETRATION, AS MANUFACTURED BY ELCO CONSTRUCTION PRODUCTS, INC. (COMPONENT 30).

(D) **TO EXISTING 1/8" (6063-T5) ALUMINUM OR 1/8" GRADE 33 STEEL:** MIN. EDGE DISTANCE = 1/2"
- 1/4" AISI 401 TEK SCREWS W/MIN. 3 THREADS PASSED METAL THICKNESS EMBEDMENT, AS MANUFACTURED BY ITW / BUILDIX (COMPONENT 30A).
- PROVIDE 1/4" MAX. LOAD BEARING SHIM, WHEN ALLOWED BY THIS DRAWING.
- PRODUCT MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION AT PRODUCT IN ACCORDANCE WITH SECTION 1709.5 OF THE FLORIDA BUILDING CODE. ONE LABEL SHALL BE PLACED FOR EVERY OPENING.
- (a) THIS P.E.D. PREPARED BY THIS ENGINEER IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT; I.E. WHERE THE SITE CONDITIONS DEVIATE FROM THE P.E.D.

(b) CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION INCLUDING LIFE SAFETY OF THIS PRODUCT, BASED ON THIS P.E.D., PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT. CONSTRUCTION SAFETY AT SITE IS THE CONTRACTOR'S RESPONSIBILITY.

(c) THIS P.E.D. WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.

(b) SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE PROFESSIONAL OF RECORD (P.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE PED.

(c) ORIGINAL P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

S.G.D SELECTION PROCEDURE:

- STEP 1:** DETERMINE A.S.D. DESIGN WIND LOAD REQUIREMENTS BASED ON WIND VELOCITY, BUILDING HEIGHT, WIND ZONE, USING APPLICABLE ASCE 7 STANDARD.
- STEP 2:** GO TO SCHEDULES BASED ON MAXIMUM DOOR FRAME HEIGHT ON SHEETS 8 & 9 TO DETERMINE MAXIMUM A.S.D. DESIGN PRESSURE RATING (psf) OF DESIRED GLASS & DOOR HEIGHT & PANEL WIDTH.
- STEP 3:** DETERMINE MAXIMUM DOOR FRAME HEIGHT (in) FOR A GIVEN DESIGN PRESSURE, ON SCHEDULE ON SHEET 8, 9, 24 & 25. SELECT ANCHOR AT JAMBS & HEAD/SILL W/ A.S.D. DESIGN PRESSURE RATING EQUAL OR GREATER THAN DESIGN LOAD SPECIFIED IN STEP 1 USING ELEVATIONS AND SECTIONS ON SHEETS 7 & 10 THRU 22 FOR LARGE & SMALL MISSILE DOORS.


WEEP HOLES		
DESCRIPTION	DISTANCE	MAX. A.S.D. PRESSURE RATING/ MISSILE TYPE
0.60" BY 1/4" WIDE WEEP HOLES	13" FROM LEFT JAMB, AND 5" FROM RIGHT USE (4) EACH END PANEL + (4) AT OPERABLE PANEL AT BALANCE AT MAX 8" O.C AT FA TRACK	GREATER THAN +100 psf. UP TO 140 psf FOR SMALL MISSILE INSTALLATIONS.
1/8" X 1" WIDE WEEP HOLES	6 3/4" FROM CORNERS THEN @ 47" O.C. (MAX.) EA. TRACK.	EQUAL OR LESS THAN +100 psf, FOR LARGE MISSILE INSTALLATIONS.

PADS AND GASKETS		
PADS AND GASKET TYPE	NUMBER AND SIZE	LOCATION
SELF ADHESIVE PILE PADS	3" LONG BY 1" WIDE	FRAME HEAD AND FRAME SILL AT INTERIOR STILE AND ASTRAGAL STILE

FIXED PANEL INSTALLATION TO FRAME JAMB

1. ANY FIXED END PANEL ("O") SHALL BE FASTENED TO THE FRAME JAMB THRU THE SILL REAR FLANGE USING COMPONENT # 33 LOCATED 8" FROM TOP AND BOTTOM.

THIS DRAWING SHALL BE USED ONLY TO OBTAIN PERMITS IN THE STATE OF FLORIDA

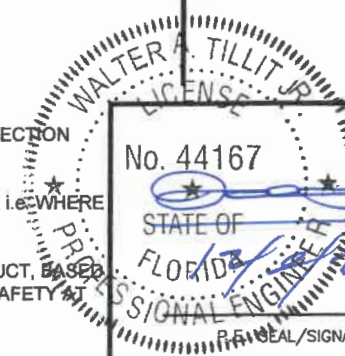

© 2021 TILTECO INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305) 871-1530 Fax : (305) 871-1531
e-mail: tilteco@aol.com
CA-0005719
WALTER A. TILLIT Jr., P.E.
FLORIDA Lic. 44167


FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

SERIES 26000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE		M.P. DRAWN BY:
		8/5/2021 DATE
		21-114 DRAWING No
290 WEST 78 ROAD HIALEAH, FL. 33014 PHONE: (305) 558-8103 FAX: (305) 558-6665 www.generalimpact.com		
REV. NO.	DESCRIPTION	DATE
1	ULD 20-25	8/6/21
REV. No.	DESCRIPTION	DATE

SHEET 1 OF 26

BILL OF MATERIALS: FOR LARGE & SMALL MISSILE DOOR

COMPONENT #	DESCRIPTION	DIMENSIONS/REMARKS	MATERIAL
1A	FRAME HEAD & SILL 2 TRACKS	SEE SHEET 4	6005-T5
1B	FRAME JAMB 2 TRACKS	SEE SHEET 4	6005-T5
1C	FRAME HEAD & SILL 2 TRACKS ALT.	SEE SHEET 4, VALID ONLY FOR ±60 psf ASD PRESSURE RATING INSTALLATIONS.	6005-T5
2A	FRAME HEAD & SILL 3 TRACKS	SEE SHEET 4	6005-T5
2B	FRAME JAMB 3 TRACKS	SEE SHEET 4	6005-T5
2C	FRAME HEAD & SILL 3 TRACKS ALT.	SEE SHEET 4, VALID ONLY FOR ±60 psf ASD PRESSURE RATING INSTALLATIONS.	6005-T5
3A	FRAME HEAD & SILL 4 TRACKS	SEE SHEET 4	6005-T5
3B	FRAME JAMB 4 TRACKS	SEE SHEET 4	6005-T5
3C	FRAME HEAD & SILL 4 TRACKS ALT.	SEE SHEET 4, VALID ONLY FOR ±60 psf ASD PRESSURE RATING INSTALLATIONS.	6005-T5
4A	FRAME HEAD & SILL 5 TRACKS ADAPT	SEE SHEET 4	6005-T5
4B	FRAME JAMB 5 TRACKS ADAPT	SEE SHEET 4	6005-T5
4C	FRAME HEAD & SILL 5 TRACKS ADAPT ALT.	SEE SHEET 4, VALID ONLY FOR ±60 psf ASD PRESSURE RATING INSTALLATIONS.	6005-T5
5A	TOP & BOTTOM RAIL 4 INCH	SEE SHEET 4 (FOR 39A & 39B)	6005-T5
5B	TOP & BOTTOM RAIL 4 INCH	SEE SHEET 4 (FOR 39C)	6005-T5
6A	BOTTOM RAIL 6 INCH	SEE SHEET 4 (FOR 39A & 39B)	6005-T5
6B	BOTTOM RAIL 6 INCH	SEE SHEET 4 (FOR 39C)	6005-T5
7	LOCK STILE	SEE SHEET 4	6005-T5
7A	ALTERNATE LOCK STILE	SEE SHEET 4	6005-T5
8	MEETING STILE INNER LOCK	SEE SHEET 4	6005-T5
9	MEETING STILE OUTER LOCK	SEE SHEET 4	6005-T5
10	ASTRAGAL	SEE SHEET 4	6005-T5
10A	ASTRAGAL ADAPT	SEE SHEET 5	6005-T5
11A	GLAZING BEAD 7/16"	SEE SHEET 5	6005-T5
11B	GLAZING BEAD 9/16"	SEE SHEET 5	6005-T5
11C	GLAZING BEAD 1"	SEE SHEET 5	6005-T5
12	ROLLER PIN	SEE SHEET 5	6005-T5
13	HEAD INSERT	SEE SHEET 5	6005-T5
14A	SILL RISER 3"	SEE SHEET 5	6005-T5
14B	SILL RISER 4"	SEE SHEET 5	6005-T5
14C	SILL RISER 5-1/2"	SEE SHEET 5	6005-T5
15	SCREW COVER	SEE SHEET 5	6005-T5
16	SCREW COVER JAMB	SEE SHEET 5	6005-T5
17	HOOK STRIP	SEE SHEET 5	6005-T5
18	JAMB REINFORCEMENT 2 TRACKS	SEE SHEET 5	6005-T5
19	JAMB REINFORCEMENT 3 TRACKS	SEE SHEET 5	6005-T5
20	1/4"x1-7/8" ALUMINUM REINFORCEMENT LS	SEE SHEET 5 (FOR 7)	6005-T5
21	1/4"x2-1/8" ALUMINUM REINFORCEMENT IL	SEE SHEET 5 (FOR 8 & 9)	6005-T5
22	1/4"x2-1/4" ALUMINUM REINFORCEMENT AA	SEE SHEET 5 (FOR 10A)	6005-T5
23	GLAZING GASKET	SEE SHEET 5	T.P.E.
24	GLAZING PRO-LON	SEE SHEET 5	FOAM
25	CORNER 90° ACTIVE	SEE SHEET 5	6005-T5
26	CORNER 90° IN-ACTIVE	SEE SHEET 5	6005-T5
27	PANEL SEAL	SEE SHEETS 4 & 5 (FOR PARTS 7, 8, 9, 10 & 11A)	NYLON
28	SETTING BLOCK	0.122"x0.5" (ULTRAFAB)	E.P.D.M.
29	#14 x 2 1/2" H.H SCREW	ASSEMBLY SCREW (FRAME & PANELS)	STEEL

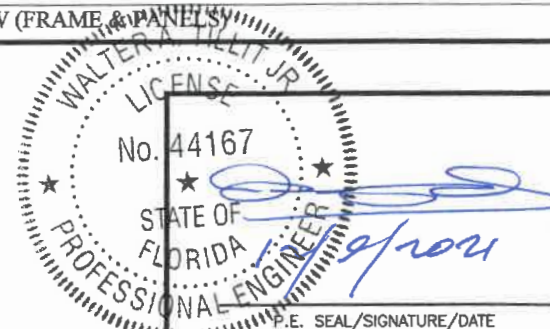

© 2021 TILTECO INC.

TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY


6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33166
 Phone : (305)871-1530 . Fax : (305)871-1531
 e-mail: tilteco@aol.com
 CA-0006719
 WALTER A. TILLIT Jr., P.E.
 FLORIDA Lic. 44167

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

SERIES 28000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE				M.P. DRAWN BY:
				8/5/2021 DATE
290 WEST 78 ROAD HIALEAH, FL. 33014 PHONE: (305) 558-8103 FAX: (305) 558-6665 www.generalimpact.com				21-114 DRAWING No
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION
1	OLD 20-275	8/5/21	2	-

SHEET 2 OF 26

BILL OF MATERIALS CONTINUATION: FOR LARGE & SMALL MISSILE DOOR			
COMPONENT #	DESCRIPTION	DIMENSIONS/REMARKS	MATERIAL
(30)	1/4" Ø ULTRACON ANCHOR	BY ELCO CONSTRUCTION PRODUCTS	COATED STEEL
(30A)	1/4" Ø-14 TEK SCREWS	BY I.T.W. BUILDEX	AISI 401 S.S.
(33)	#10 x 1/2" FH S.S SELF DRILL SCREW	FIXED PANEL, ASTRAGAL ADAPTER & INACTIVE CORNER 90°	S.S.
(34)	#10 x 1/2" S.S MACHINE SCREW W/ NUT	5 TRACKS ASSEMBLY (PARTS (2A) WITH (4A) & (2B) WITH (4B)) 3" FROM EDGE & 1' O.C MAX	S.S.
(35)	STRUCTURAL SILICONE DOWSIL 983	ALL AROUND GLASS	SILICONE
(35A)	NON STRUCTURAL SILICONE	CCS (CONTRACTORS CONCRETE SEALANT) ALL AROUND FRAME AS SHOWN ON SECTIONS	SILICONE
(35B)	STRUCTURAL SILICONE-SIKASIL SG-500 CN	ALL AROUND GLASS	SILICONE
(36)	T-SLOT ULTRA FIN	W23211NK000B (0.210Hx0.187W) ULTRAFAB	PLASTIC
(37)	T-SLOT ULTRA FIN	W23351NK000B (0.350Hx0.187W) ULTRAFAB	PLASTIC
(38)	T-SLOT EXTRUDED SEAL	E23318KN2020 (0.450Hx0.187W) ULTRAFAB	VINYL
(39A)	SR-2003	TEANDEM ROLLER ASSY S/S HOUSING WITH 1-1/4" S/S WHEELS BY DELTA INDUSTRIAL SYSTEMS (LOCATED AT 5" MIN FROM PANEL END)	S.S.
(39B)	PR03-6000	SS7000 TANDEM ROLLER S/S TUNED WITH 1-1/4" S/S WHEELS ANTHONY INNOVATIONS (INTERLOCK USA) (LOCATED AT 7" MIN FROM PANEL END)	S.S.
(39C)	PJS-TA-188-OF-PRN	TANDEM ROLLER S/S TUNED WITH 1-5/8" ACETAL (DERLIN) WHEELS (LOCATED AT 7" MIN FROM PANEL END)	S.S.
(40)	FASTENER	(2)#10x1" LONG ROLLER ASSEMBLY FASTENING	S.S.
(41)	PS01-1020	SMLM 2PT MORTICE LOCK STAINLESS HOOKS	S.S.
(42)	PS01-1015	15mm ADJUSTABLE SBML STRIKE + MOUNTING SCREW (2) #10x1 1/4" P.H. S.D.S.	S.S.
(43)	2307	IMPACT DOOR STOPPER	
(44)	INSULATED GLASS UNIT SPACER	SEE SHEET 5	3105-H24 ALUMINUM
(45)	T-SLOT ULTRA FIN	D7593AMK (0.750Hx0.750W) ULTRAFAB (FOR INACTIVE PANEL 90°)	PLASTIC
(46)	T-SLOT ULTRA FIN	D3893AMK (0.750Hx0.375W) ULTRAFAB (FOR WATER INTRUSION ADHESIVE AT SILL TRACK AT EACH INTERLOCK 3" LONG)	PLASTIC
(47)	#10-24 x 5/16" PH PHILLIPS MACHINE SCREW	CORNER 90° ACTIVE PANEL (3" FROM EDGE & 8" O.C. MAX)	S.S.

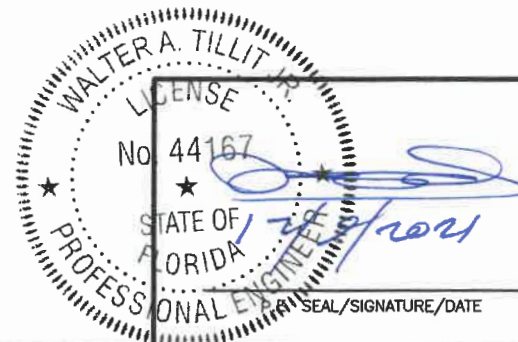

© 2021 TILTECO INC.

TILTECO INC.

















TILLIT TESTING & ENGINEERING COMPANY

6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33166
 Phone : (305)871-1530 . Fax : (305)871-1531
 e-mail: tiltco@aol.com
 CA-0006719
 WALTER A. TILLIT Jr., P.E.
 FLORIDA Lic. 44167

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

SERIES 28000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE			M.P. DRAWN BY:		
 GENERAL IMPACT GLASS & WINDOWS			8/5/2021 DATE		
			21-114 DRAWING No		
290 WEST 78 ROAD HIALEAH, FL. 33014 PHONE: (305) 558-8103 FAX: (305) 558-6665 www.generalimpact.com					
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-275	8/6/21	2	-	-
			SHEET 3 OF 26		


SHEET 3 OF 26

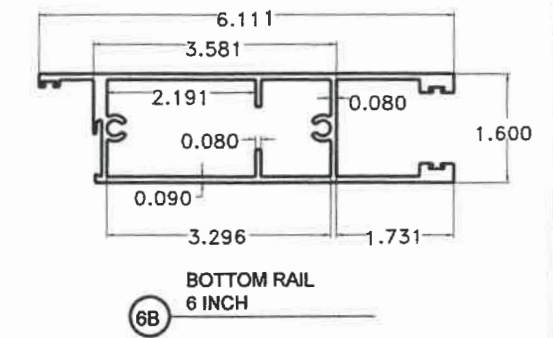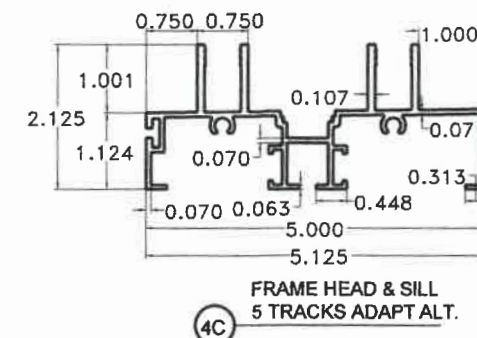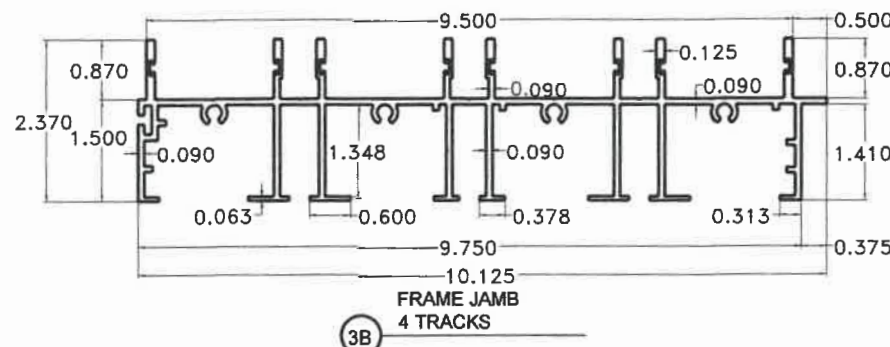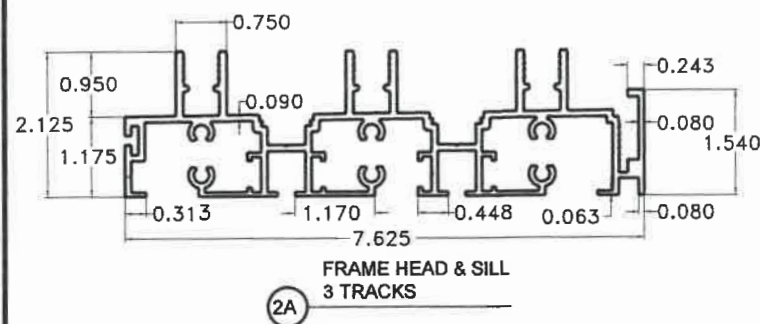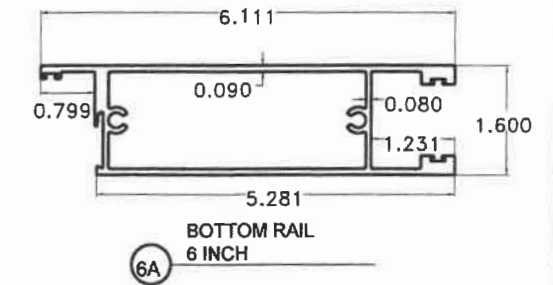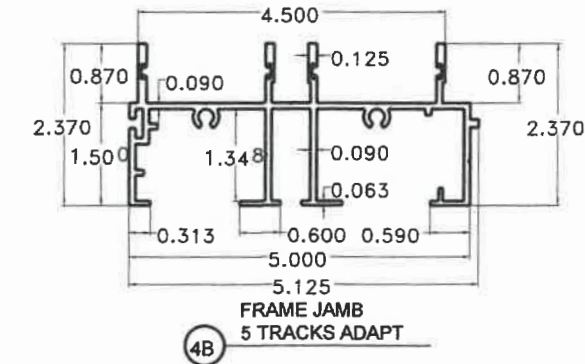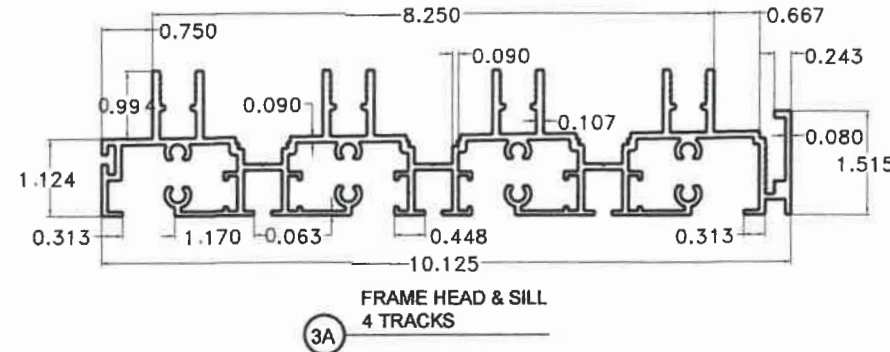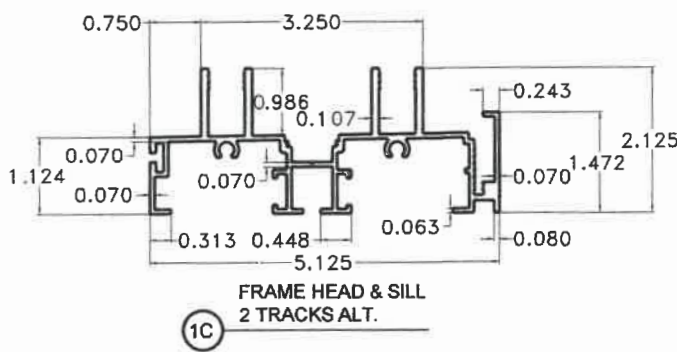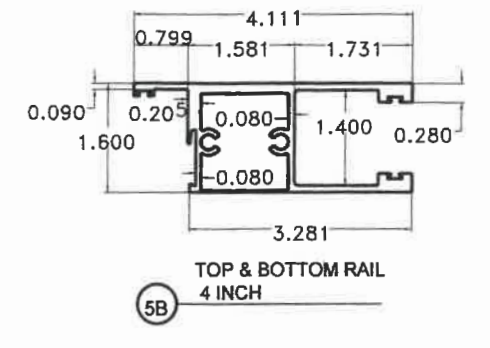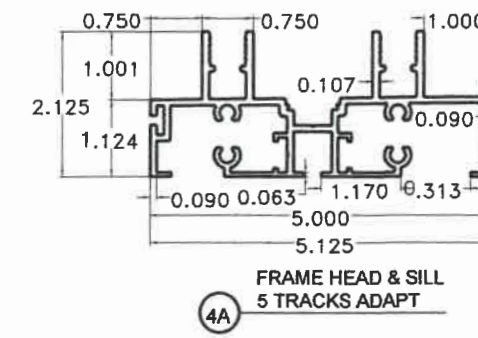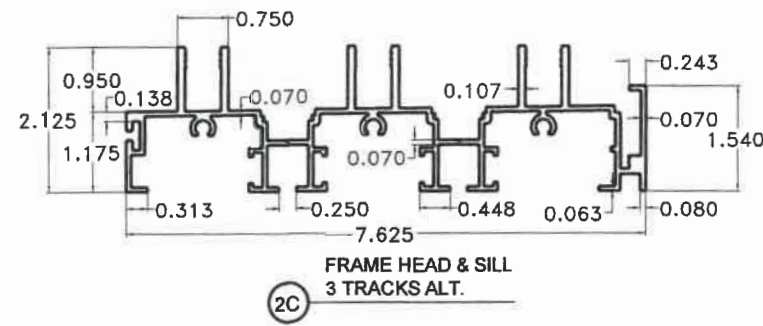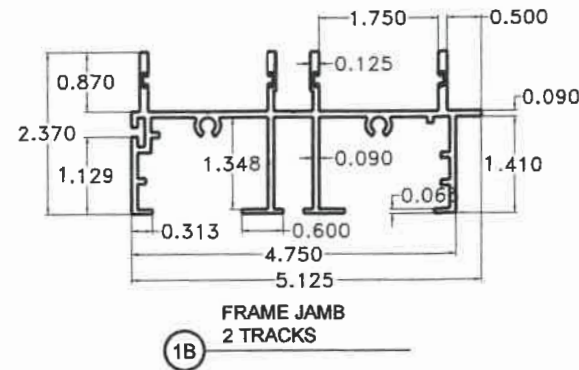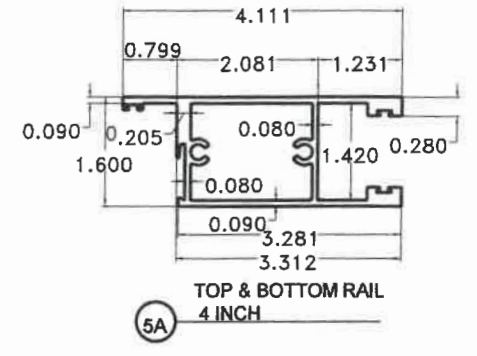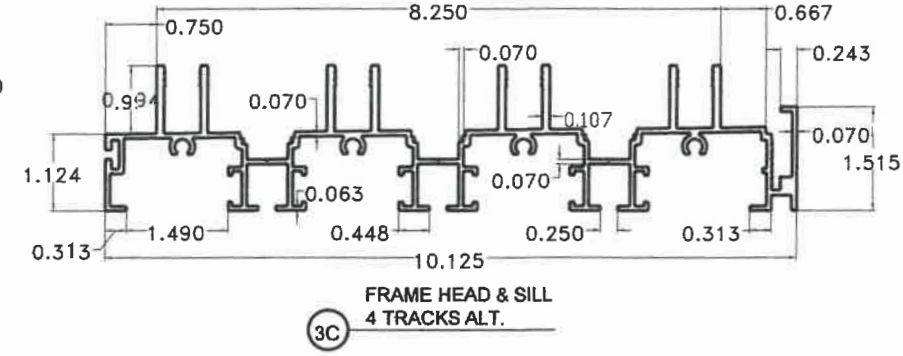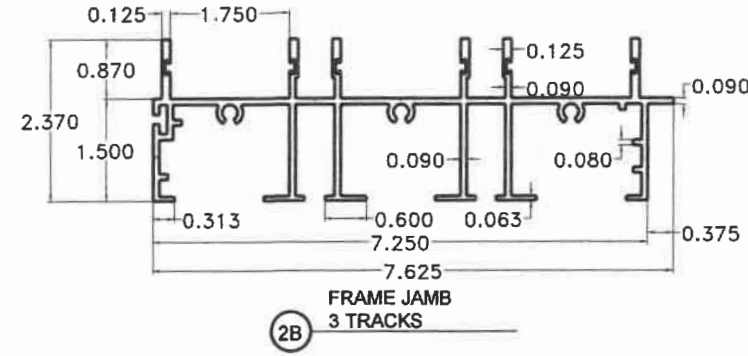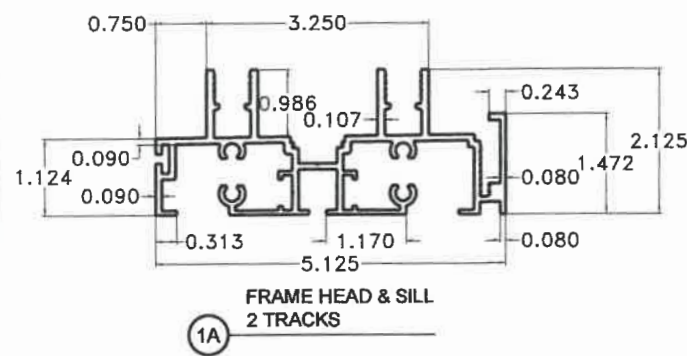

COMPONENTS

SCALE: 3/8"=1"

























LARGE & SMALL MISSILE DOORS

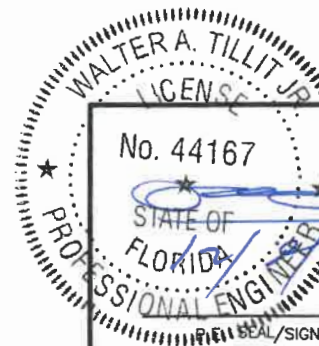

© 2021 TILTECO INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 38th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr., P.E.
FLORIDA Lic. 44167

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

SERIES 26000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE						M.P. DRAWN BY:
 290 WEST 78 ROAD HIALEAH, FL. 33014 PHONE: (305) 558-8103 FAX: (305) 558-6665 www.generalimpact.com						8/5/2021 DATE
						21-114 DRAWING No
REV. NO	DESCRIPTION	DATE	REV. NO	DESCRIPTION	DATE	
1	OLD 20-275	8/6/21	2	-	-	
SHEET 4 OF 26						

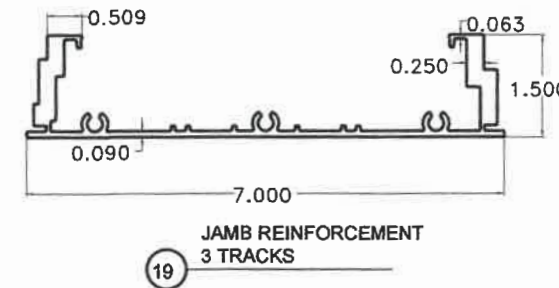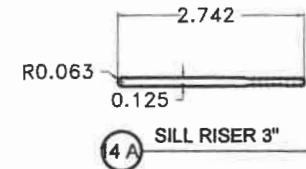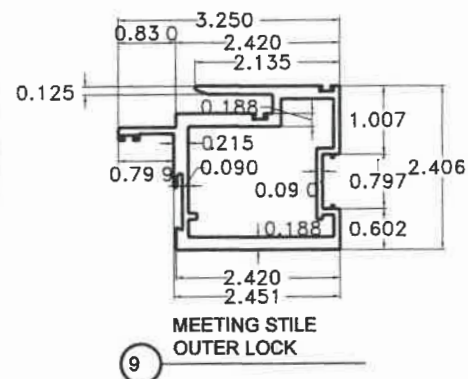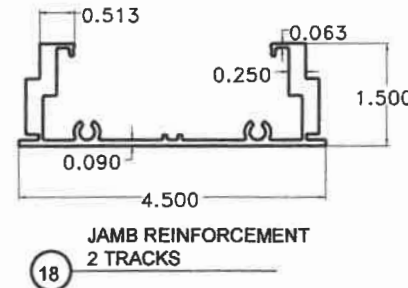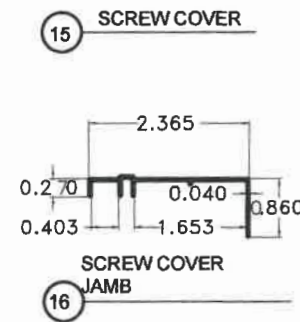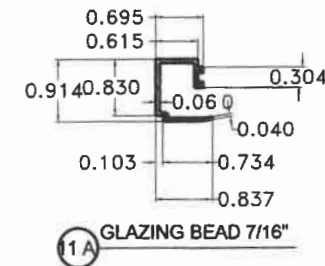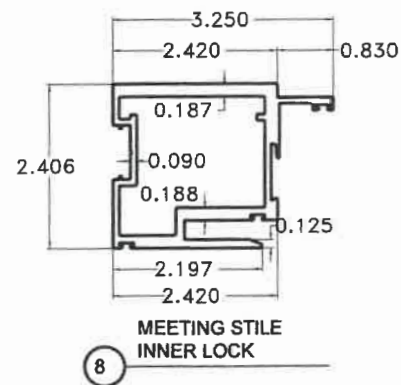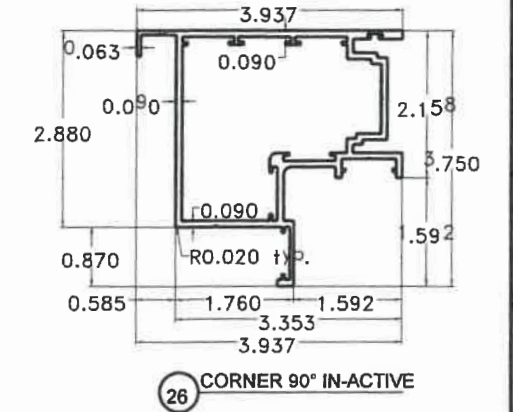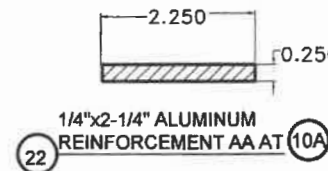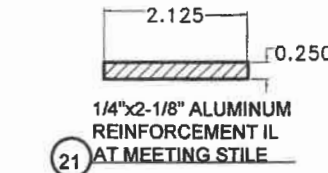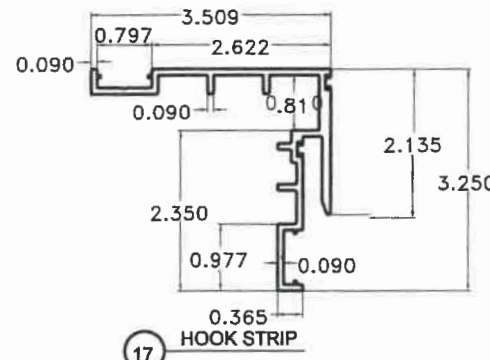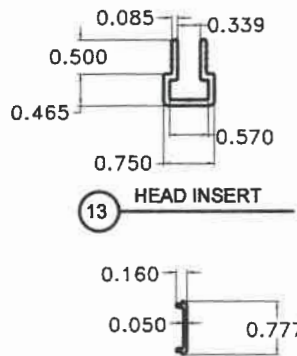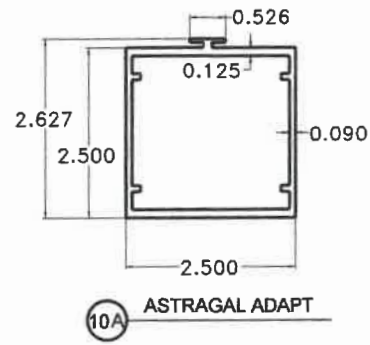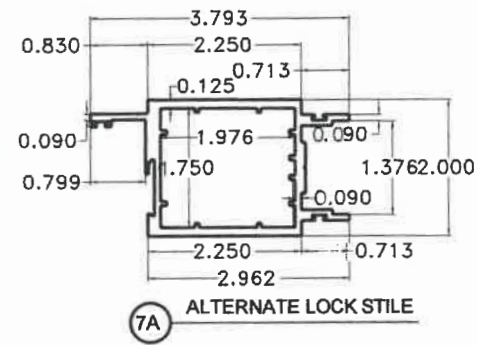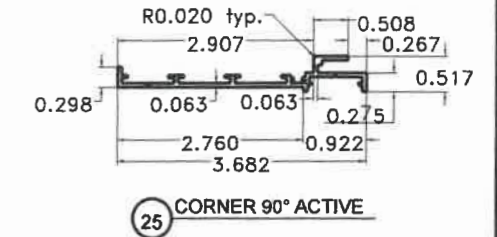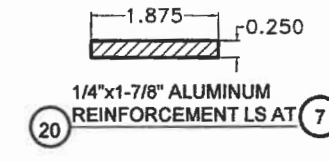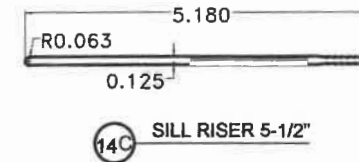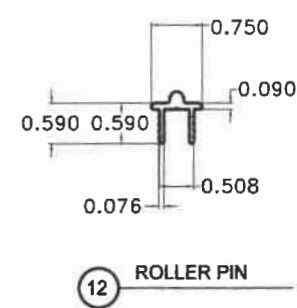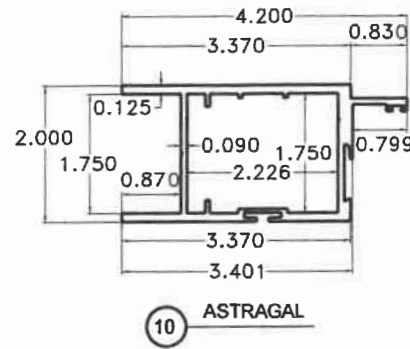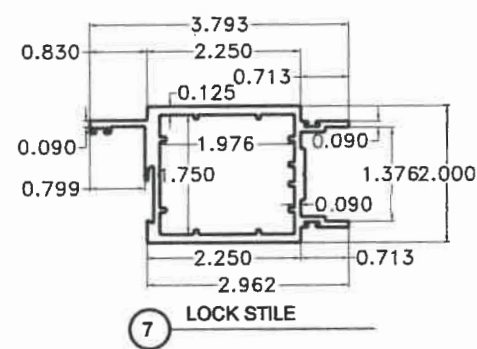

COMPONENTS

CONT'D: LARGE & SMALL MISSILE DOORS
SCALE: 3/8"=1"




© 2021 TILTECO INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 38th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone: (305) 871-1530 • Fax: (305) 871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr., P.E.
FLORIDA Lic. 44167

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

SERIES 26000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE				W.P. DRAWN BY:	
				8/5/2021 DATE	
				21-114 DRAWING No	
REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 21-114	8/6/21	2	-	-
				SHEET 5 OF 26	

BILL OF MATERIALS (CONT'D): REQUIRED GLASS FOR QUALIFIED LARGE & SMALL MISSILE DOORS

COMPONENT #	DESCRIPTION	ALLOWED MISSILE TYPE
(A)	7/16" NOMINAL LAMINATED GLASS W/ 3/16" H.S. GLASS +0.090" TROSIFOL PVB INTERLAYER BY KURARAY AMERICA, INC. + 3/16" H.S. GLASS.	LARGE & SMALL MISSILE
(A1)	1" NOMINAL INSULATED-LAMINATED GLASS W/ 3/16" TEMPERED GLASS OUT BOARD - 3/8" ARGON SPACER + 3/16" H.S. GLASS +0.090" TROSIFOL PVB INTERLAYER BY KURARAY AMERICA, INC. + 3/16" H.S. GLASS.	LARGE & SMALL MISSILE
(B)	9/16" NOMINAL LAMINATED GLASS W/ 1/4" H.S. GLASS +0.090" TROSIFOL PVB INTERLAYER BY KURARAY AMERICA, INC. + 1/4" H.S. GLASS.	LARGE & SMALL MISSILE
(B1)	9/16" NOMINAL LAMINATED GLASS W/ 1/4" TEMPERED GLASS +0.060" TROSIFOL PVB INTERLAYER BY KURARAY AMERICA, INC. + 1/4" TEMPERED GLASS.	SMALL MISSILE
(C)	7/16" NOMINAL LAMINATED GLASS W/ 3/16" H.S. GLASS +0.090" SENTRYGLAS® INTERLAYER BY KURARAY AMERICA, INC. + 3/16" H.S. GLASS.	LARGE & SMALL MISSILE
(C1)	1" NOMINAL INSULATED-LAMINATED GLASS W/ 3/16" TEMPERED GLASS OUT BOARD - 3/8" ARGON SPACER + 3/16" H.S. GLASS +0.090" SENTRYGLAS® INTERLAYER BY KURARAY AMERICA, INC. + 3/16" H.S. GLASS.	LARGE & SMALL MISSILE
(D)	9/16" NOMINAL LAMINATED GLASS W/ 1/4" H.S. GLASS +0.090" SENTRYGLAS® INTERLAYER BY KURARAY AMERICA, INC. + 1/4" H.S. GLASS.	LARGE & SMALL MISSILE
(E)	7/16" NOMINAL LAMINATED GLASS W/ 3/16" ANNEALED GLASS +0.090" TROSIFOL PVB INTERLAYER BY KURARAY AMERICA, INC. + 3/16" ANN. GLASS.	LARGE & SMALL MISSILE
(E1)	1" NOMINAL INSULATED-LAMINATED GLASS W/ 3/16" TEMPERED GLASS OUT BOARD - 3/8" ARGON SPACER + 3/16" ANN. GLASS +0.090" TROSIFOL PVB INTERLAYER BY KURARAY AMERICA, INC. + 3/16" ANN. GLASS.	LARGE & SMALL MISSILE

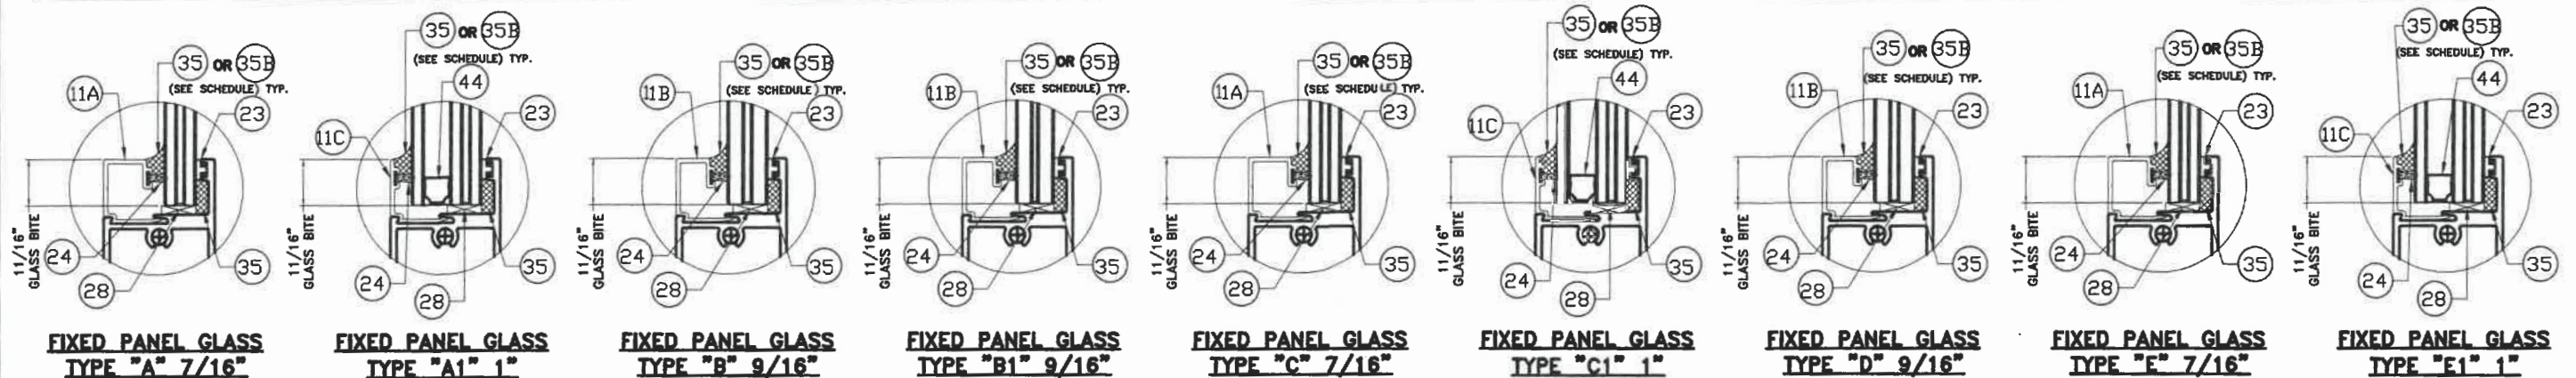

STRUCTURAL SILICONE SCHEDULE

COMPONENT #	MAX. NEGATIVE ASD PRESSURE RATING	MISSILE TYPE
(35)	177 psf	LM & SM
(35B)	60 psf	LM & SM

GLASS CONFIGURATION



© 2021 TILTECO INC.

TILTECO INC.


TILLIT TESTING & ENGINEERING COMPANY

6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
 Phone : (305) 871-1530 . Fax : (305) 871-1531
 e-mail: tilteco@aol.com
 CA-0006719
 WALTER A. TILLIT Jr., P.E.
 FLORIDA Lic. 44167

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

SERIES 28000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE			M.P. DRAWN BY:		
 GENERAL IMPACT GLASS & WINDOWS			290 WEST 78 ROAD HIALEAH, FL. 33014 PHONE: (305) 558-8103 FAX: (305) 558-6665 www.generalimpact.com		
			8/5/2021 DATE		
			21-114 DRAWING No		
REV. NO	DESCRIPTION	DATE	REV. NO	DESCRIPTION	DATE
1	OLD 20-275	8/6/21	2	-	-
SHEET 6 OF 26					

SHEET 6 OF 26

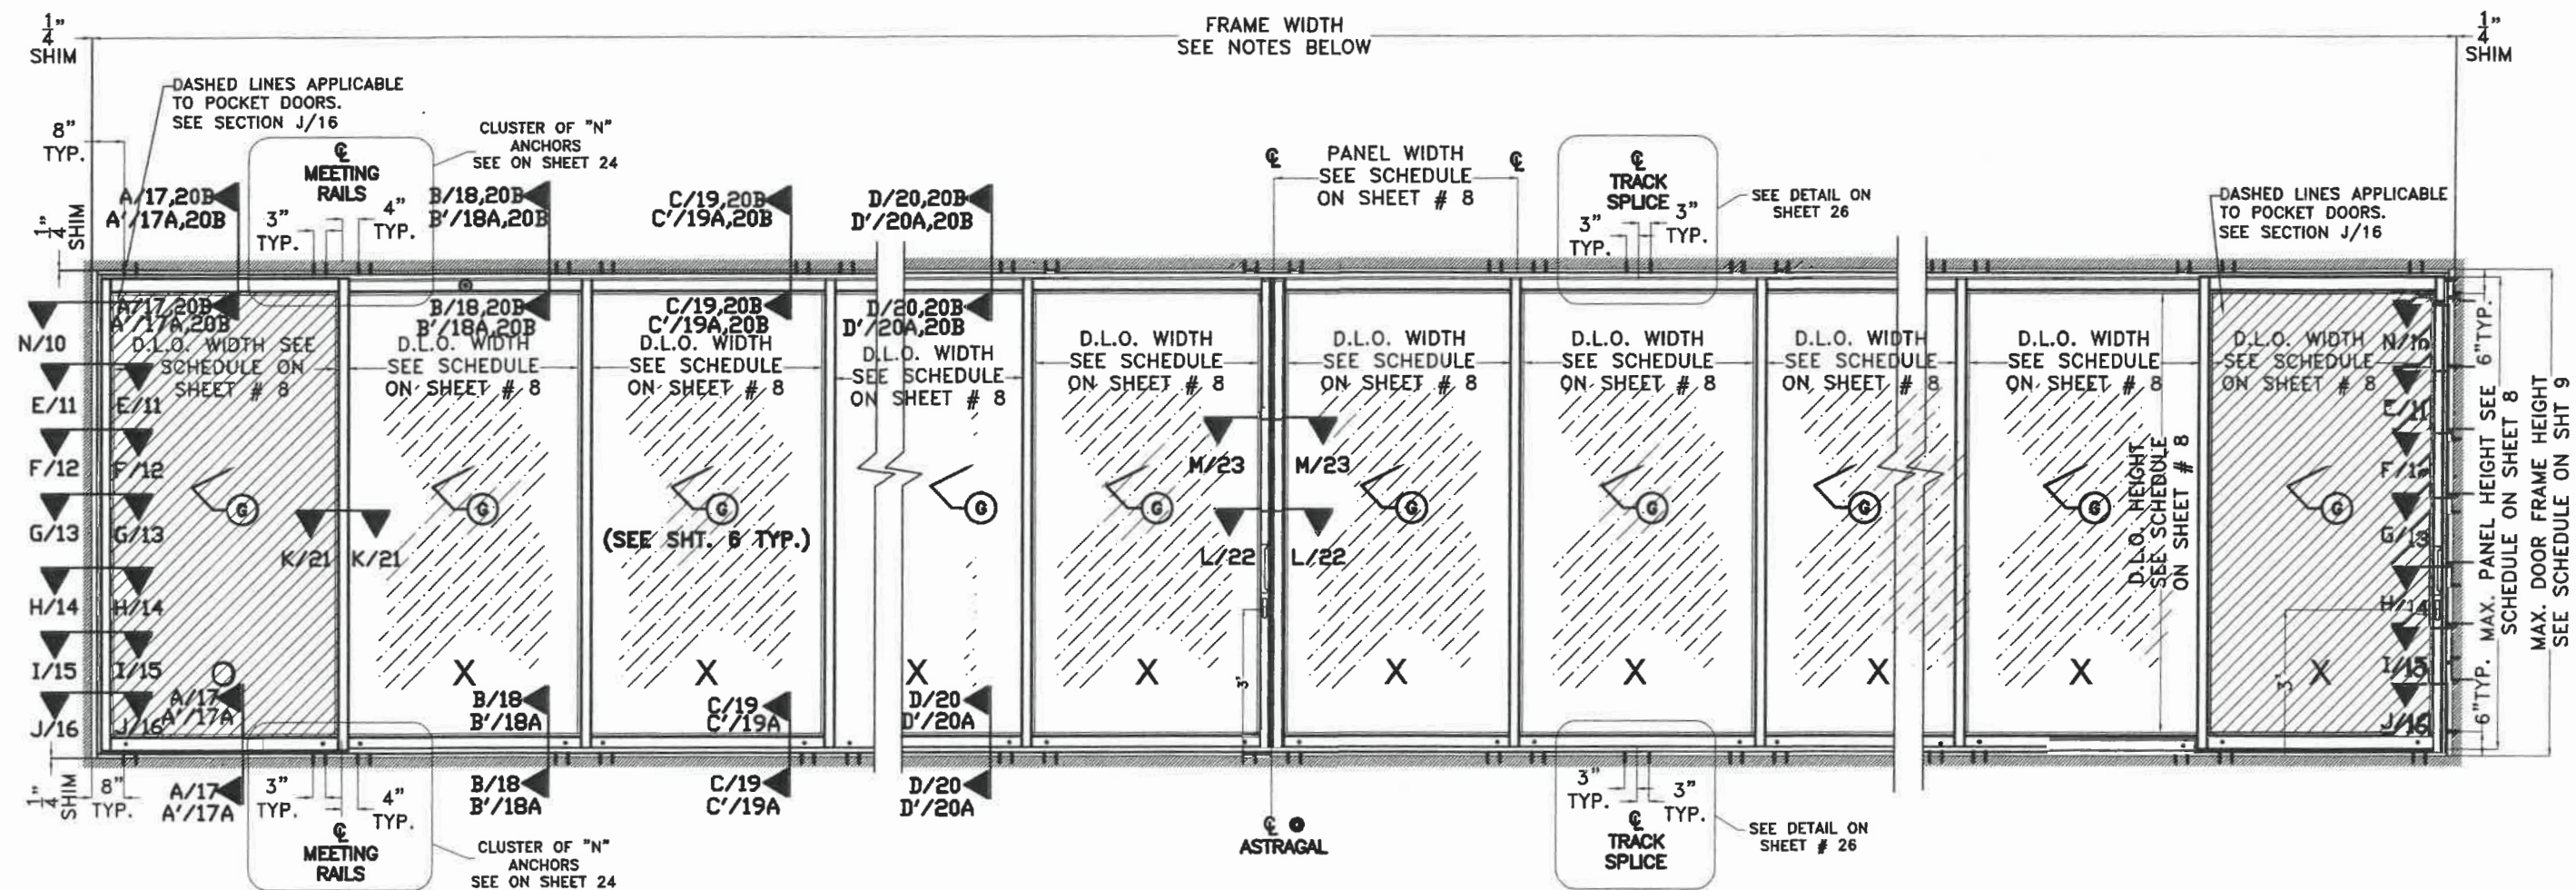

TYPICAL EXTERIOR ELEVATION 2 THRU 5 TRACK DOOR: LARGE & SMALL MISSILE DOOR

N.T.S.

NOTES:

LARGE & SMALL MISSILE DOORS


1-TYPICAL EXTERIOR ELEVATION SHOWS A 2 THRU 5 TRACK DOOR WITH VARIABLE PANEL CONDITION AS PER SCHEDULE ON SHEET 8. SECTION N/10 SHOWS A FULL VIEW OF A DOOR WITH 5 TRACKS AS A GENERIC VIEW. DOORS W/ 2, 3 & 4 TRACKS WILL LOOK SIMILAR AS PER SECTIONS A-A THRU N-N. SEE SECTIONS A-A, B-B, C-C, D-D, E-E, F-F, G-G, H-H, I-I, J-J FOR 2, 3, 4 AND 5 TRACK DOOR CONFIGURATIONS.

2- IF NEEDED, AND BASED ON 50'-4" TOTAL TESTED UNREINFORCED DOOR FRAME WIDTH, AN ALLOWABLE NEW TOTAL FRAME WIDTH OF 1.5x 50'-4" = 75'-5" WILL BE ALLOWED TO BE INSTALLED FOR UP TO 120" FRAME HEIGHT DOORS AND A MAXIMUM PANEL WIDTH OF 60". ALTERNATIVELY, AND BASED ON 41'-11 1/2" TOTAL TESTED REINFORCED DOOR FRAME WIDTH, AN ALLOWABLE NEW TOTAL FRAME WIDTH OF 1.5x 41'-11 1/2" = 62'-11" WILL BE ALLOWED FOR UP TO 144" FRAME HEIGHT AND A MAXIMUM PANEL WIDTH OF 50". SEE MAX. A.S.D. LOADS FOR UNREINFORCED & REINFORCED DOORS ON SCHEDULE ON SHEET 9.

3- TYPICAL EXTERIOR ELEVATION SHOWS A CONFIGURATION W/ ATTACHED JAMBS AT RIGHT SIDE AND FREE STANDING JAMB MULTIPANE (REINFORCED) AT LEFT SIDE. ANY INSTALLATION MAY USE BOTH JAMBS EITHER ATTACHED, FREE STANDING OR A COMBINATION OF ATTACHED ON ONE JAMB FREE STANDING ON THE OTHER ONE, AS LONG AS MAX. PANEL WIDTH IS 60" FOR 120" FRAME HEIGHT UNREINFORCED DOORS AND 50" FOR 144" FRAME HEIGHT REINFORCED DOORS.

4- TYPICAL EXTERIOR ELEVATION SHOWS AN OXXXXXXX CONFIGURATION. OTHER ALLOWED CONFIGURATIONS ARE ACCEPTABLE AS LONG AS TYPICAL MEETING RAILS AND ASTRAGAL CONFORM TO SECTIONS K/21, L/22 & M/23.

5- END PANELS MAY INCLUDE (IF NEEDED) INSTALLATION OF POCKET DOOR. SEE SECTION J ON SHEET 16 FOR DETAILS. DOORS INCLUDING POCKET WILL BE LIMITED TO A TOTAL FRAME WIDTH AS LIMITED BY NOTE 2 ABOVE.

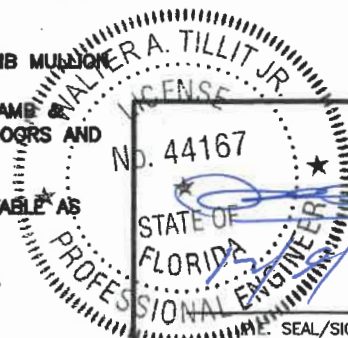

SEAL/SIGNATURE/DATE

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

© 2021 TILTECO INC.
TILTECO INC.
 TILLIT TESTING & ENGINEERING COMPANY
 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
 Phone: (305) 871-1530 Fax: (305) 871-1531
 e-mail: tilteco@aol.com
 CA-0006719
 WALTER A. TILLIT JR., P.E.
 FLORIDA Lic. 44167

SERIES 26000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE			M.P. DRAWN BY:		
			290 WEST 78 ROAD HIALEAH, FL. 33014 PHONE: (305) 558-8103 FAX: (305) 558-6665 www.generalimpact.com		
			8/5/2021 DATE		
REV. NO	DESCRIPTION	DATE	REV. NO	DESCRIPTION	DATE
1	OLD 20-275	8/6/21	2	-	-
21-114 DRAWING No					SHEET 7 OF 26

**MAXIMUM A.S.D. DESIGN PRESSURE RATING SCHEDULE FOR A MAXIMUM FRAME HEIGHT, FRAME WIDTH,
D.L.O. HEIGHT & D.L.O. WIDTH VALID FOR 2, 3, 4 & 5 TRACK Δ DOORS, LARGE & SMALL MISSILE**

MAX. A.S.D. DESIGN PRESSURE RATING*	MAXIMUM FRAME HEIGHT ***	MAXIMUM FRAME WIDTH	MAXIMUM D.L.O. HEIGHT ***	MAXIMUM D.L.O. WIDTH ***	MAX. FIXED PANEL WIDTH ***	MAX. OPERABLE PANEL WIDTH ***	MAXIMUM PANEL HEIGHT ***	REQ'D GLASS TYPE & IMPACT RATING ***, *****	REQUIRED LOCK STILE & ASTRAGAL ****	REQUIRED REINFORCED MEETING STILES ****
+60, -60 psf	120"	SEE NOTES ON SHEET 7	108 3/16"	56 3/4"	54 9/16"	56 3/4"	116 3/8"	(A), (A1), (B) SMALL & LARGE MISSILE	(7) OR (7A) & (10A) + (10) W/O REINFORCEMENT	NO
+100, -100 psf	84"	SEE NOTES ON SHEET 7	72 3/16"	56 3/4"	54 9/16"	56 3/4"	80 3/8"	(A), (A1), (B) SMALL & LARGE MISSILE	(7) OR (7A) & (10A) + (10) W/O REINFORCEMENT	NO
+70, -70 psf	144"	SEE NOTES ON SHEET 7	132 3/16"	46 3/4"	44 9/16"	46 3/4"	140 3/8"	(C), (C1), (D) SMALL & LARGE MISSILE	(7) OR (7A) & (10A) + (10) W/(20) + (22)	YES (21)
+100, -177 psf	84"	SEE NOTES ON SHEET 7	72 3/16"	46 3/4"	44 9/16"	46 3/4"	80 3/8"	(C), (C1), (D) SMALL & LARGE MISSILE	(7) OR (7A) & (10A) + (10) W/(20) + (22)	YES (21)
+55, -55 psf	120"	SEE NOTES ON SHEET 7	108 3/16"	56 3/4"	56 3/4"	56 3/4"	116 3/8"	(A), (A1), (B), (E), (E1) SMALL & LARGE MISSILE	(7) OR (7A) & (10) + (2) (20)	NO
+100, -140 psf	120"	SEE NOTES ON SHEET 7	108 3/16"	44 3/4"	42 9/16"	44 3/4"	116 3/8"	(B1) SMALL MISSILE	(7) OR (7A) & (10A) + (10) W/O REINFORCEMENT	YES (21)
+60, -60 psf	120"	SEE NOTES ON SHEET 7	108 3/16"	54 9/16"	54 9/16"	56 3/4"	116 3/8"	(A), (A1), (B), (C), (C1), (D), (E), (E1)***** SM&LM	(25) + (26) + (2) (7) OR (7A)	NO

**SILL RISER SCHEDULE, GIVEN AN A.S.D POSITIVE
DESIGN WIND LOAD AND AN EXISTING OVERHANG
PROJECTION ABOVE AND OUT FROM DOOR
EQUAL TO DOOR FRAME HEIGHT**

SILL RISER TYPE	MAX. POSITIVE A.S.D. DESIGN WIND LOAD	OVERHANG REQUIRED	DOOR INCLUDES CORNER W/ (25) & (26) ?
(14A)	50.0 psf or less	NO	ALLOWED †
(14A), (14B), (14C)	Larger than 100.0 psf	YES	NOT ALLOWED
(14B), (14C)	+ 60.0 psf	NO	NOT ALLOWED
(14C)	+ 100.0 psf	NO	NOT ALLOWED
(14B), (14C)	+ 50.0 psf	NO	ALLOWED
(14B), (14C)	+ 60.0 psf	NO	ALLOWED

† : IF POSITIVE ASD DESIGN WIND LOAD IS 50.0 psf
OR LESS, NO OVERHANG IS REQUIRED.
IF POSITIVE ASD DESIGN WIND LOAD IS LARGER
THAN 50.0 psf, OVERHANG, IS REQUIRED.

* SEE SILL RISER SCHEDULE ON THIS SHEET & DETAILS FOR REQUIREMENTS TO ACHIEVE WATER INFILTRATION CAPABILITIES BASED
ON SILL RISERS (14A), (14B) OR (14C) AND EXISTING OVERHANG AT BUILDING.


** SEE SHEET 6 FOR LIMITATION FOR SMALL/LARGE MISSILE GIVEN THE GLASS TYPE

*** SEE SHEET 9 FOR MAX FRAME HEIGHT & MAX. D.L.O. HEIGHT AND ON CENTERS PANEL WIDTH FOR INTERMEDIATE DESIGN PRESSURES

**** SEE HORIZONTAL SECTIONS FOR REQUIRED REINFORCEMENT (20) & (22) AT ASTRAGALS & REINFORCEMENT (21) AT MEETING STILES ON SHEETS 21, 22 & 23.

***** LIMITED TO ± 55 psf WHEN GLASS (E) OR (E1) IS USED.

Δ SEE LIMITATIONS FOR TRACKS (1C), (2C), (3C) & (4C) ON NOTE Δ, SHEET 9.

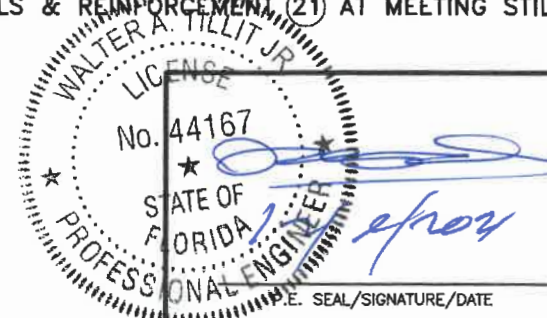

© 2021 TILTECO INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305) 871-1530 • Fax : (305) 871-1531
e-mail: tiltco@aol.com
CA-0006719
WALTER A. TILLIT JR., P.E.
FLORIDA Lic. 44167

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

SERIES 26000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE			M.P. DRAWN BY:		
 GENERAL IMPACT GLASS & WINDOWS			290 WEST 78 ROAD HIALEAH, FL. 33014 PHONE: (305) 558-8103 FAX: (305) 558-6665 www.generalimpact.com		
			8/5/2021 DATE		
			21-114 DRAWING No		
REV. NO	DESCRIPTION	DATE	REV. NO	DESCRIPTION	DATE
1	OLD 20-275	8/6/21	2	-	-

SHEET 8 OF 26

SCHEDULE # 1

MAX. DOOR FRAME AND D.L.O HEIGHT* FOR A GIVEN A.S.D. WIND LOAD, VALID FOR 2, 3, 4 & 5 TRACK Δ DOORS W/ UNREINFORCED MEETING STILES AND UNREINFORCED DEEP ASTRAGAL (COMP. ⑦ + ⑩ + ⑩A) AS PER SECTIONS K/21 & L/22, AND 5'-0" O.C. MAX. PANEL WIDTH**

A.S.D. WIND LOAD	MAX. DOOR FRAME HEIGHT			
	L+ (ft-in)	D.L.O. (HEIGHT)	L- (ft-in)	D.L.O. (HEIGHT)
60.0 or LESS	10'-0"	9'-0 3/16"	10'-0"	9'-0 3/16"
62.0	9'-10"	8'-10 3/16"	9'-10"	8'-10 3/16"
64.0	9'-8"	8'-8 3/16"	9'-8"	8'-8 3/16"
66.0	9'-6"	8'-6 3/16"	9'-6"	8'-6 3/16"
68.0	9'-5"	8'-5 3/16"	9'-5"	8'-5 3/16"
70.0	9'-3"	8'-3 3/16"	9'-3"	8'-3 3/16"
72.0	9'-1"	8'-1 3/16"	9'-1"	8'-1 3/16"
74.0	8'-9"	7'-9 3/16"	8'-9"	7'-9 3/16"
76.0	8'-7"	7'-7 3/16"	8'-7"	7'-7 3/16"
78.0	8'-4"	7'-4 3/16"	8'-4"	7'-4 3/16"
80.0	8'-3"	7'-3 3/16"	8'-3"	7'-3 3/16"
82.0	8'-2"	7'-2 3/16"	8'-2"	7'-2 3/16"
84.0	8'-1"	7'-1 3/16"	8'-1"	7'-1 3/16"
86.0	8'-0"	7'-0 3/16"	8'-0"	7'-0 3/16"
88.0	7'-10"	6'-10 3/16"	7'-10"	6'-10 3/16"
90.0	7'-8"	6'-8 3/16"	7'-8"	6'-8 3/16"
92.0	7'-6"	6'-6 3/16"	7'-6"	6'-6 3/16"
94.0	7'-4"	6'-4 3/16"	7'-4"	6'-4 3/16"
96.0	7'-2"	6'-2 3/16"	7'-2"	6'-2 3/16"
98.0	7'-1"	6'-1 3/16"	7'-1"	6'-1 3/16"
100.0	7'-0"	6'-0 3/16"	7'-0"	6'-0 3/16"

* DEFINITIONS :

L+ : MAXIMUM DOOR FRAME & D.L.O HEIGHT FOR A GIVEN POSITIVE A.S.D. WIND LOAD. SEE SCHEDULE ON SHEET 8 FOR SILL RISER REQUIREMENTS FOR WATER INFILTRATION.

L- : MAXIMUM DOOR FRAME & D.L.O HEIGHT FOR A GIVEN NEGATIVE A.S.D. WIND LOAD.

L_{FINAL} : MINIMUM BETWEEN L+, L- FOR A GIVEN A.S.D. WIND LOAD ON A JOB.

** MAX. A.S.D. PRESSURE RATING FOR DOORS WITH "SHALLOW" ASTRAGAL PER SECTION M/23 AND /OR WITH ⑪ HOOK STRIP (POCKET DOORS) PER SHT. 16 IS ± 55.0 psf, VALID FOR UP TO 120" FRAME HEIGHT & 5'-0" O.C. MAX. PANEL WIDTH.

MAX. A.S.D. PRESSURE RATING FOR DOORS W/ CORNERS AT 90° W/ ⑫, ⑬ PER SHT. 16 VARIES WITH SILL RISER, USE ⑭A, ⑭B PER SCHEDULE ON SHT. 8, BUT NOT TO EXCEED ± 60 p.s.f. VALID FOR UP TO 120" MAX. DOOR HEIGHT & 5'-0" O.C. MAX. PANEL WIDTH.

Δ TRACKS ①C, ②C, ③C & ④C ARE LIMITED TO INSTALLATIONS WITH -60 psf MAX. A.S.D. NEGATIVE PRESSURE RATING, AND FOR +50 psf MAX. A.S.D. POSITIVE PRESSURE RATING, IF USED WITH SILL RISER ①A, AND +55 p.s.f., IF USED WITH SILL RISER ④C FOR BOTH LIGHT (COMP. ⑩) OR HEAVY (COMP. ⑩ + ⑩A) ASTRAGAL OR IF USED WITH 90° CORNER ACTIVE & INACTIVE PROFILES (COMP. ⑫, ⑬).

SCHEDULE # 2

MAX. DOOR FRAME AND D.L.O HEIGHT* FOR A GIVEN A.S.D. WIND LOAD, VALID FOR 2, 3, 4 & 5 TRACK Δ DOORS W/ REINFORCED MEETING STILES AND REINFORCED DEEP ASTRAGAL (COMP. ⑦ + ⑩ + ⑩A) AS PER SECTIONS K/21 & L/22, AND 5'-0" O.C. MAX. PANEL WIDTH** FOR LARGE MISSILE & 4'-2" FOR SMALL MISSILE**

A.S.D. WIND LOAD	MAX. DOOR FRAME HEIGHT			
	L+ (ft-in)	D.L.O. (HEIGHT)	L- (ft-in)	D.L.O. (HEIGHT)
+70.0, -70.0 or LESS	12'-0"	11'-0 3/16"	12'-0"	11'-0 3/16"
72.0	11'-6"	10'-6 3/16"	11'-10"	10'-10 3/16"
74.0	11'-0"	10'-0 3/16"	11'-8"	10'-8 3/16"
76.0	10'-6"	9'-6 3/16"	11'-2"	10'-2 3/16"
78.0	10'-0"	9'-0 3/16"	11'-0"	10'-0 3/16"
80.0	9'-8"	8'-8 3/16"	10'-10"	9'-10 3/16"
82.0	9'-4"	8'-4 3/16"	10'-8"	9'-8 3/16"
84.0	9'-0"	8'-0 3/16"	10'-6"	9'-6 3/16"
86.0	8'-8"	7'-8 3/16"	10'-4"	9'-4 3/16"
88.0	8'-6"	7'-6 3/16"	10'-0"	9'-0 3/16"
90.0	8'-4"	7'-4 3/16"	9'-10"	8'-10 3/16"
92.0	8'-1"	7'-1 3/16"	9'-8"	8'-8 3/16"
94.0	7'-9"	6'-9 3/16"	9'-6"	8'-6 3/16"
96.0	7'-6"	6'-6 3/16"	9'-4"	8'-4 3/16"
98.0	7'-3"	6'-3 3/16"	9'-4"	8'-4 3/16"
100.0	7'-0"	6'-0 3/16"	9'-3"	8'-3 3/16"
102.0	-	-	9'-2"	8'-2 3/16"
104.0	-	-	9'-1"	8'-1 3/16"
106.0	-	-	9'-0"	8'-0 3/16"
108.0	-	-	8'-11"	7'-11 3/16"
110.0	-	-	8'-10"	7'-10 3/16"
112.0	-	-	8'-9"	7'-9 3/16"
114.0	-	-	8'-8"	7'-8 3/16"
116.0	-	-	8'-7"	7'-7 3/16"
118.0	-	-	8'-6"	7'-6 3/16"
120.0	-	-	8'-6"	7'-6 3/16"
122.0	-	-	8'-5"	7'-5 3/16"

CONTINUATION				
124.0	-	-	8'-4"	7'-4 3/16"
126.0	-	-	8'-3"	7'-3 3/16"
128.0	-	-	8'-2"	7'-2 3/16"
130.0	-	-	8'-1"	7'-1 3/16"
132.0	-	-	8'-0"	7'-0 3/16"
134.0	-	-	8'-0"	7'-0 3/16"
136.0	-	-	7'-11"	6'-11 3/16"
138.0	-	-	7'-10"	6'-10 3/16"
140.0	-	-	7'-10"	6'-10 3/16"
142.0	-	-	7'-10"	6'-10 3/16"
144.0	-	-	7'-9"	6'-9 3/16"
146.0	-	-	7'-7"	6'-7 3/16"
148.0	-	-	7'-7"	6'-7 3/16"
150.0	-	-	7'-6"	6'-6 3/16"
152.0	-	-	7'-6"	6'-6 3/16"
154.0	-	-	7'-5"	6'-5 3/16"
156.0	-	-	7'-5"	6'-5 3/16"
158.0	-	-	7'-4"	6'-4 3/16"
160.0	-	-	7'-4"	6'-4 3/16"
162.0	-	-	7'-4"	6'-4 3/16"
164.0	-	-	7'-3"	6'-3 3/16"
166.0	-	-	7'-3"	6'-3 3/16"
168.0	-	-	7'-2"	6'-2 3/16"
170.0	-	-	7'-2"	6'-2 3/16"
172.0	-	-	7'-1"	6'-1 3/16"
174.0	-	-	7'-1"	6'-1 3/16"
176.0	-	-	7'-0"	6'-0 3/16"
177.0	-	-	7'-0"	6'-0 3/16"

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

WALTER A. TILLIT JR.
LICENSE
No. 44167
FLORIDA
PROFESSIONAL ENGINEER
SEAL/SIGNATURE/DATE


© 2021 TILTECO INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305) 871-1530 . Fax : (305) 871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT JR., P.E.
FLORIDA Lic. 44167

SERIES 28000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE
M.P. DRAWN BY:
8/5/2021 DATE
21-114 DRAWING No
SHEET 9 OF 26


290 WEST 78 ROAD
HIALEAH, FL. 33014
PHONE: (305) 558-8103
FAX: (305) 558-6665
www.generalimpact.com

GENERAL
IMPACT GLASS & WINDOWS

REV. NO	DESCRIPTION	DATE	REV. NO	DESCRIPTION	DATE
1	OLD 20-275	8/6/21	2	-	-

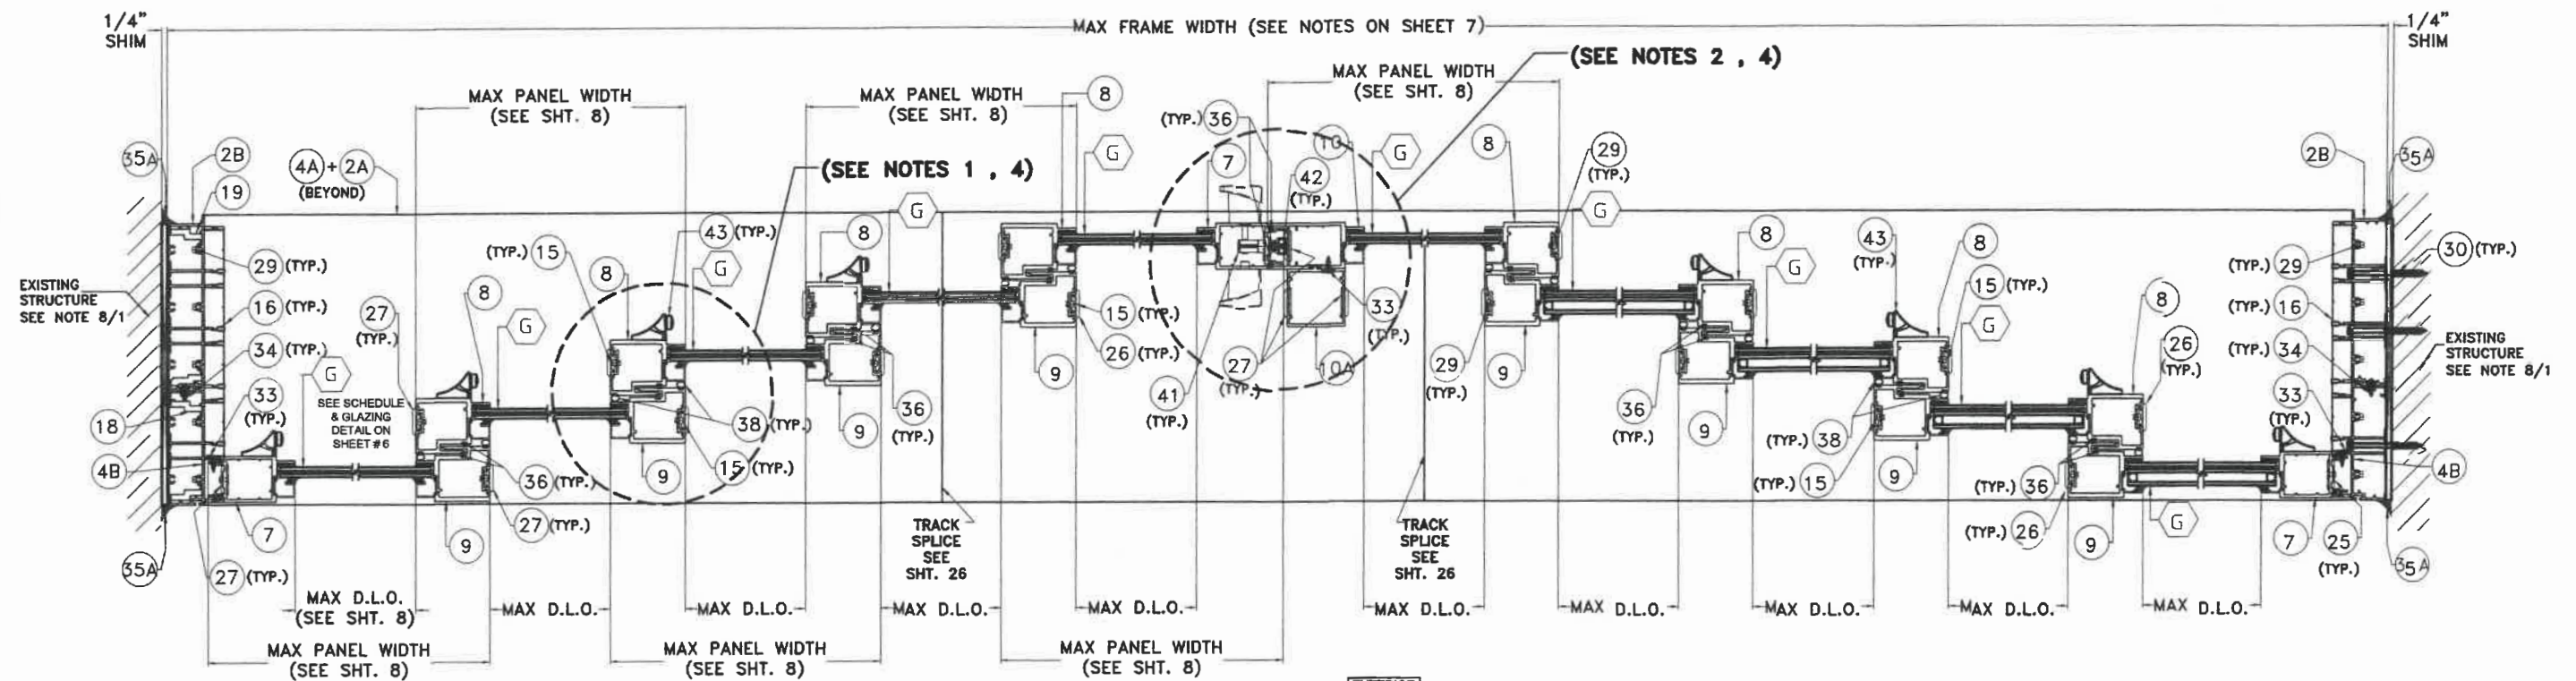


SECTION N-N (W/ "DEEP ASTRAGAL")
N.T.S.
(SEE SHEET 7 FOR NOTES ON 2, 3 & 4 TRACK CONFIGURATION)

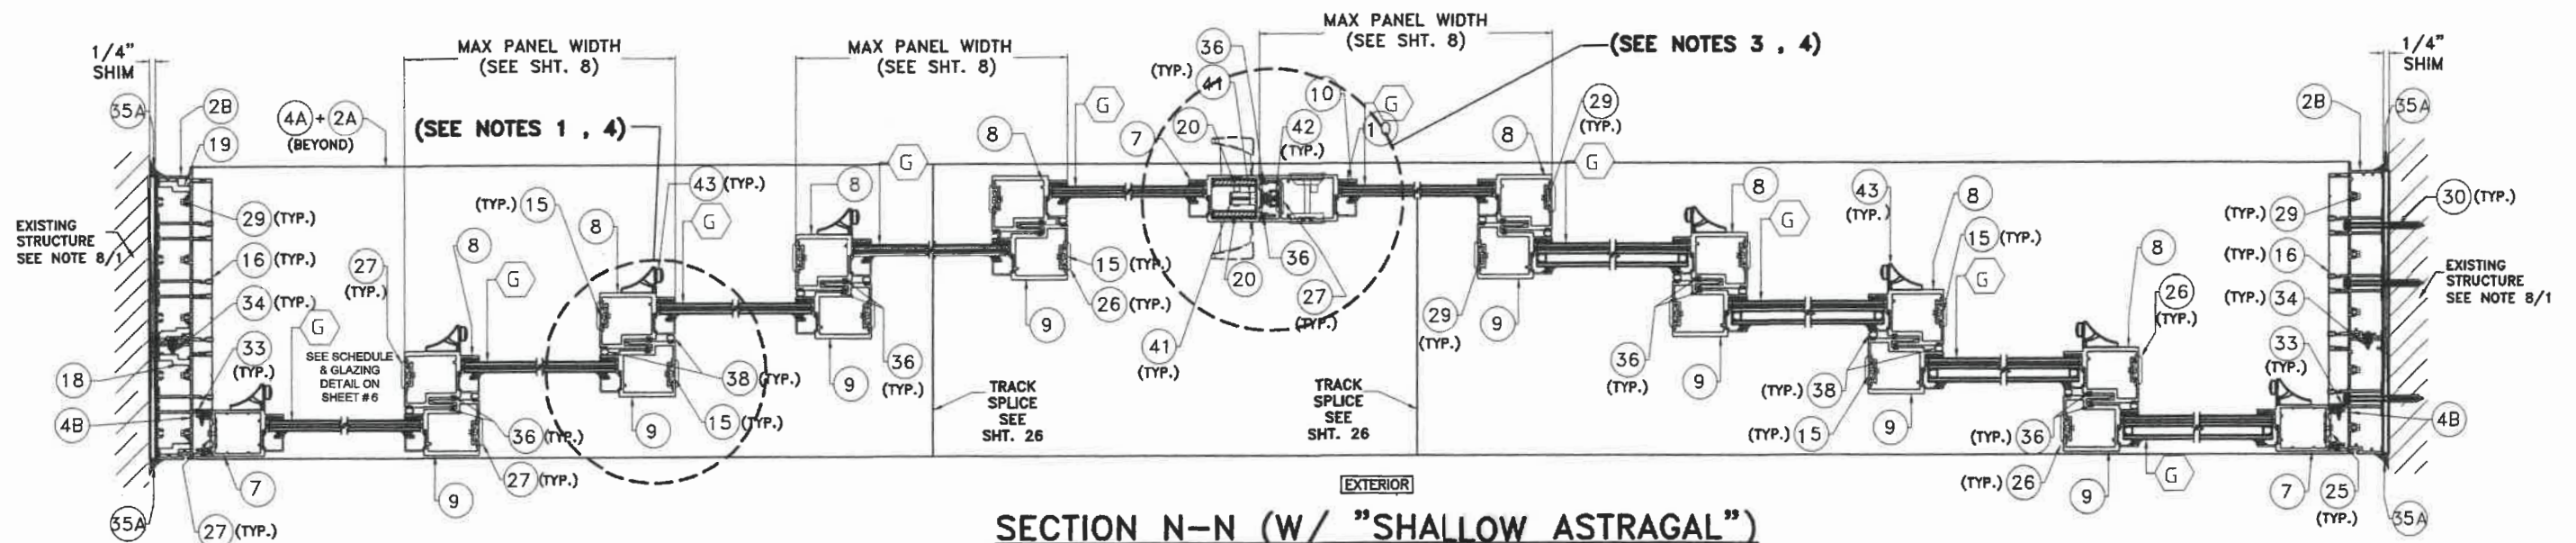

SECTION N-N (W/ "SHALLOW ASTRAGAL")
N.T.S.
(SEE SHEET 7 FOR NOTES ON 2, 3 & 4 TRACK CONFIGURATION)

NOTES:

- 1- SEE SHEET 21 FOR REINFORCED & UNREINFORCED MEETING STILES DETAILS.
- 2- SEE SHEET 22 FOR REINFORCED & UNREINFORCED "DEEP ASTRAGAL" DETAILS.
- 3- SEE SHEET 23 FOR REINFORCED "SHALLOW ASTRAGAL" DETAILS.
- 4- SEE SCHEDULE ON SHEET 8 FOR REINFORCED REQUIREMENTS FOR ASTRAGALS & MEETING STILES

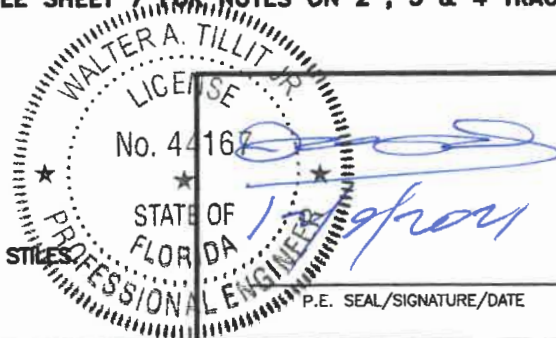

© 2021 TILTECO INC.






TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY

6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33168
Phone: (305) 871-1530 Fax: (305) 871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr., P.E.
FLORIDA Lic. 44167

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

SERIES 26000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE			M.P. DRAWN BY:		
			290 WEST 78 ROAD HIALEAH, FL. 33014		
			PHONE: (305) 558-8103		
			FAX: (305) 558-6665		
			www.generalimpact.com		
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-275	8/6/21	2	-	-

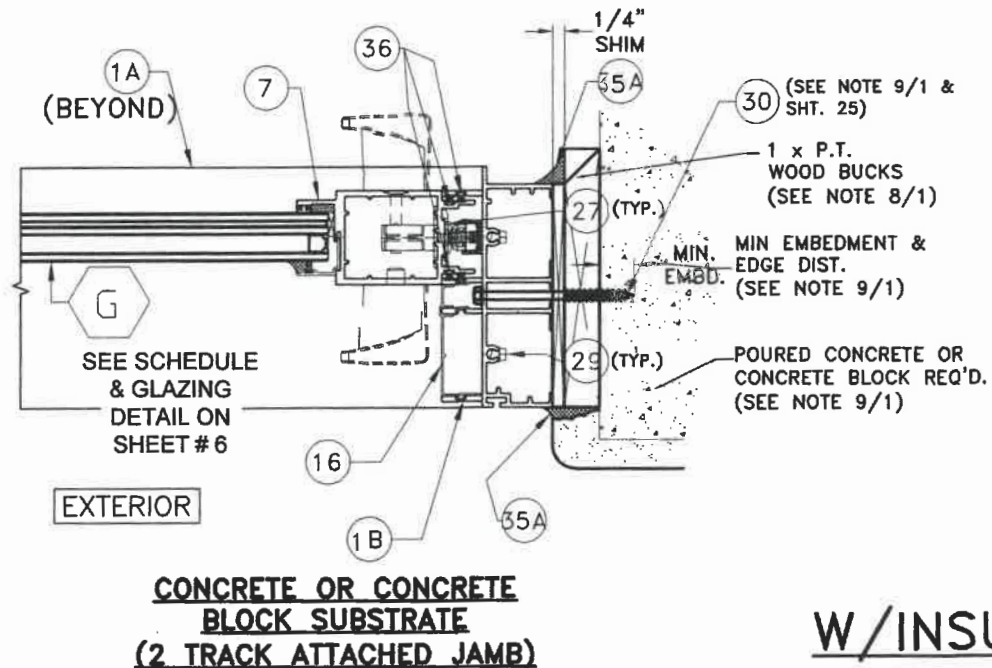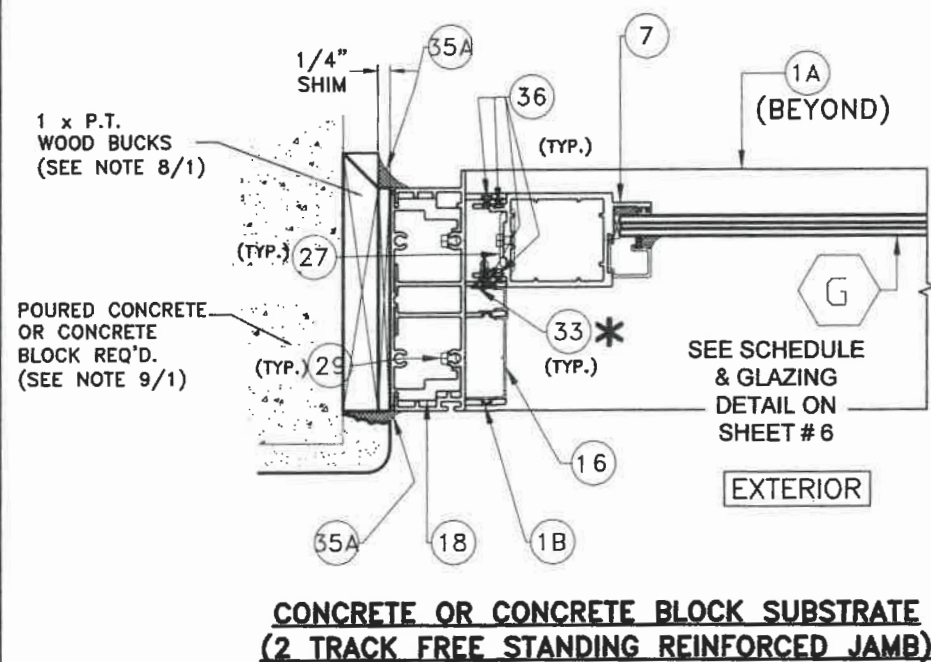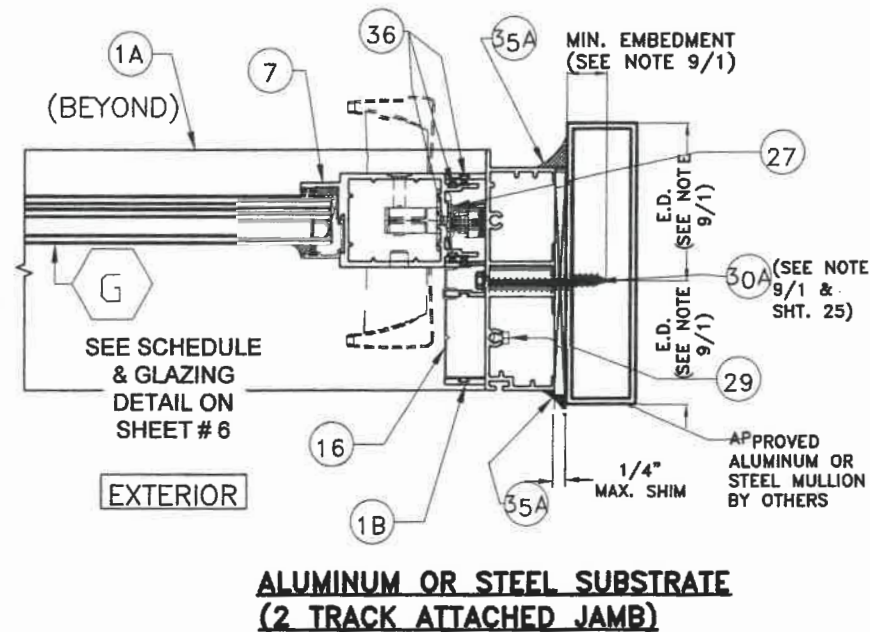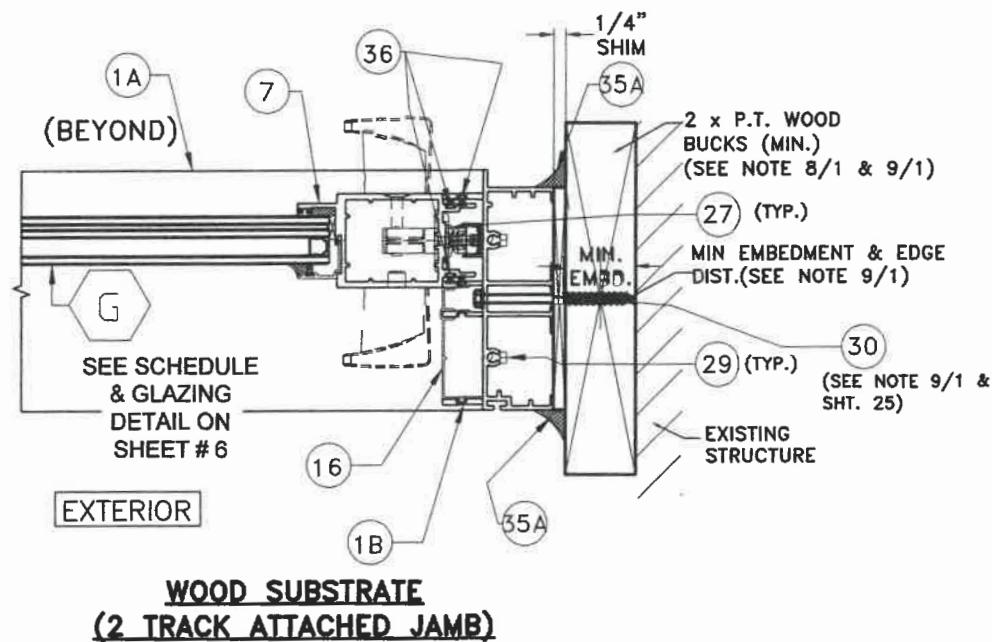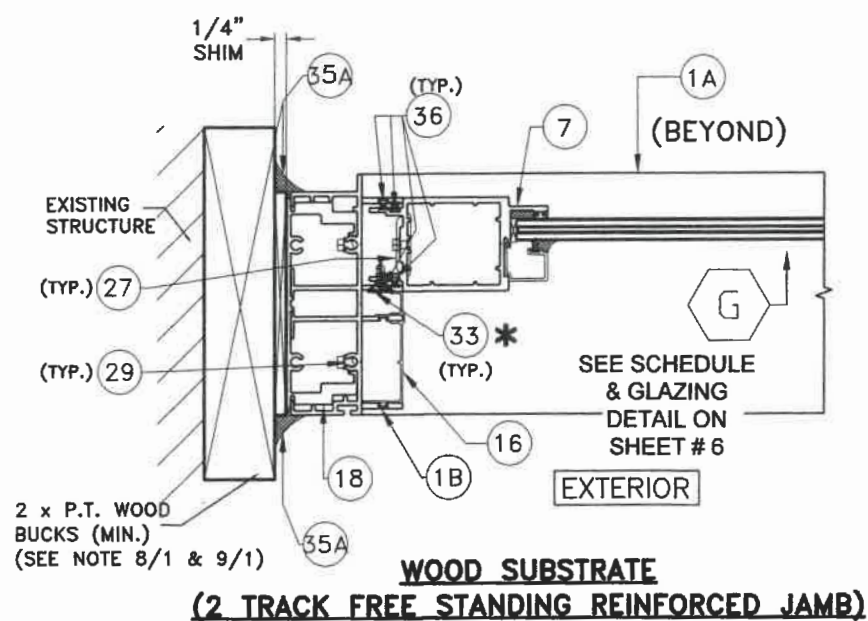

SECTIONS E-E W/INSULATED OR LAMINATED GLASS (2 TRACK)


N.T.S.

NOTE 1: FOR MAXIMUM FRAME, PANEL & DLO LIMITATIONS SEE SCHEDULE ON SHEET 8 & ANCHOR SPACING SEE SCHEDULE ON SHEET 25

NOTE 2: SUBSTRATE CAN BE COMBINED AS APPLICABLE

NOTE 3: GLASS TYPE CAN BE LAMINATED OR INSULATED SEE SCHEDULE FOR LIMITATIONS ON SHEET 6

*** FIX PANEL ASSEMBLY REQUIRES COMPONENT 33 AT TOP & BOTTOM 1" FROM EDGES AND AT 8" O.C.**

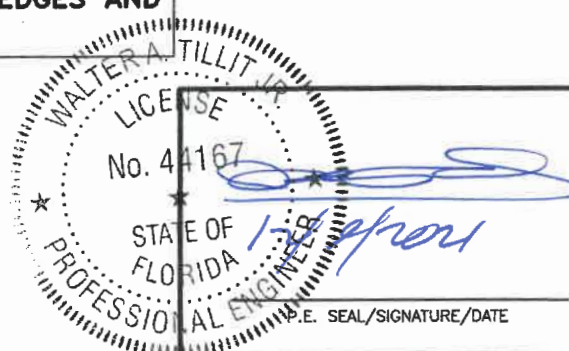

© 2021 TILTECO INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone: (305) 871-1530 Fax: (305) 871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr., P.E.
FLORIDA Lic. 44167

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

**SERIES 26000 HIGH IMPACT SLIDING
GLASS DOOR / LARGE AND SMALL MISSILE**



290 WEST 78 ROAD
HIALEAH, FL. 33014
PHONE: (305) 558-8103
FAX: (305) 558-6665
www.generalimpact.com


M.P.
DRAWN BY:

8/5/2021
DATE


21-114
DRAWING No

SHEET 11 OF 26


REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	010 20-275	8/6/21	2	-	-

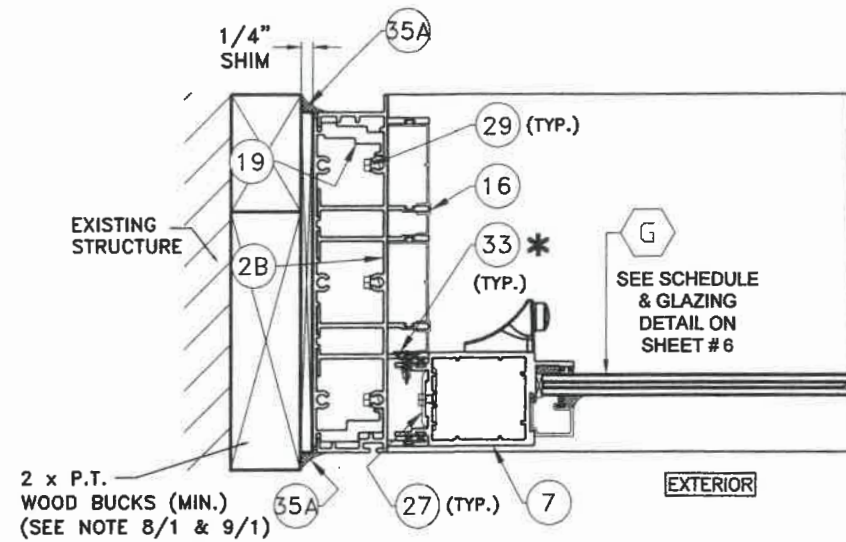


**WOOD SUBSTRATE
(3 TRACK REINFORCED JAMB)**

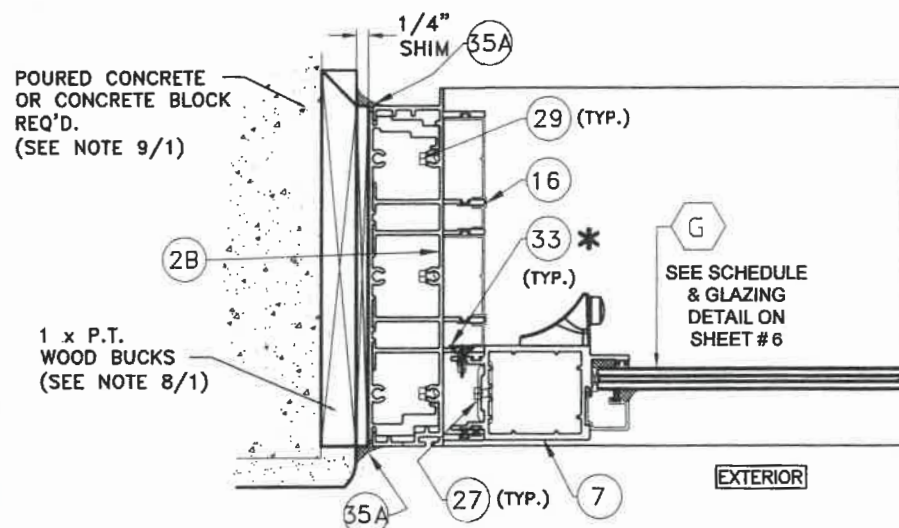


**CONCRETE OR CONCRETE BLOCK SUBSTRATE
(3 TRACK FREE STANDING ATTACHED JAMB)**

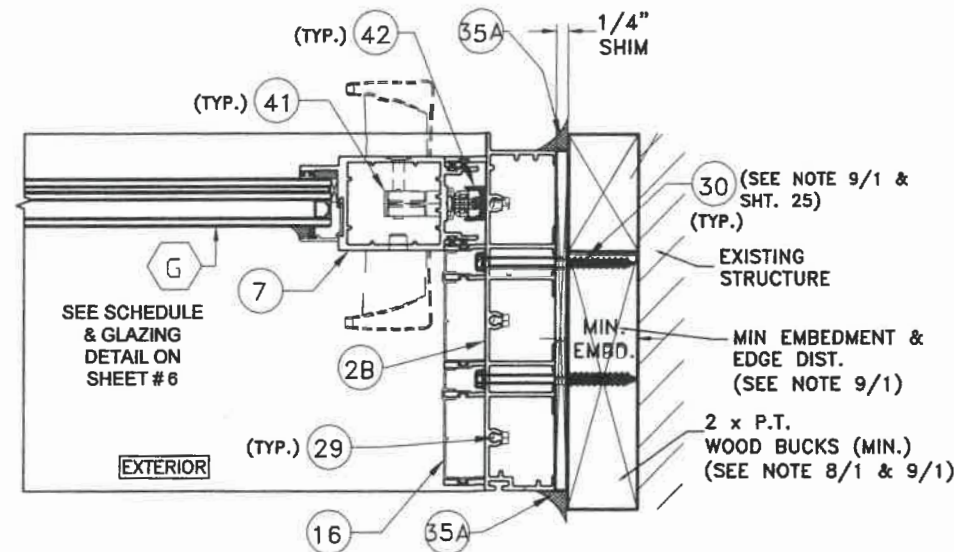

**WOOD SUBSTRATE
(3 TRACK ATTACHED JAMB)**

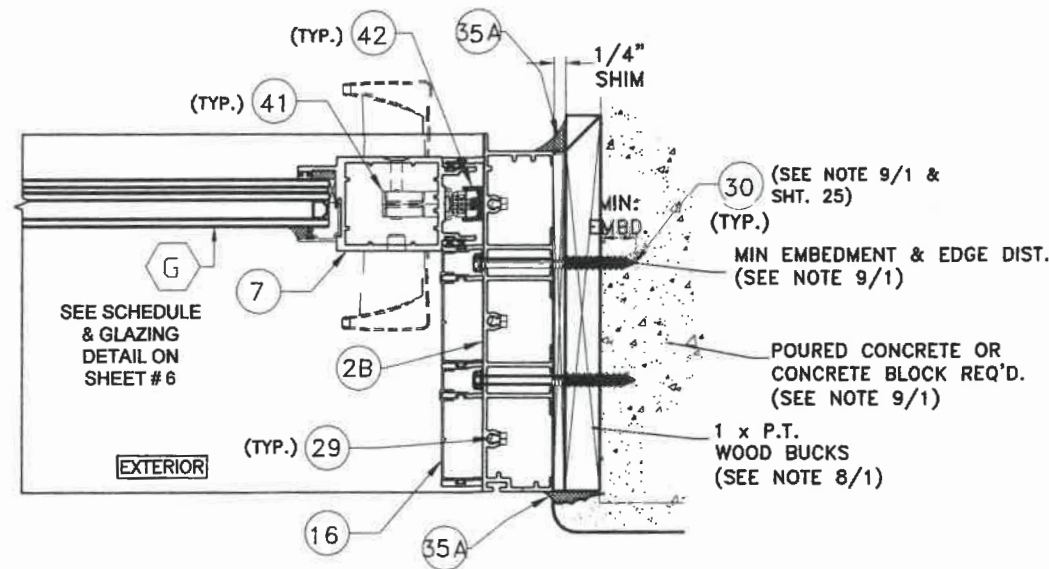

**CONCRETE OR CONCRETE BLOCK SUBSTRATE
(3 TRACK ATTACHED JAMB)**

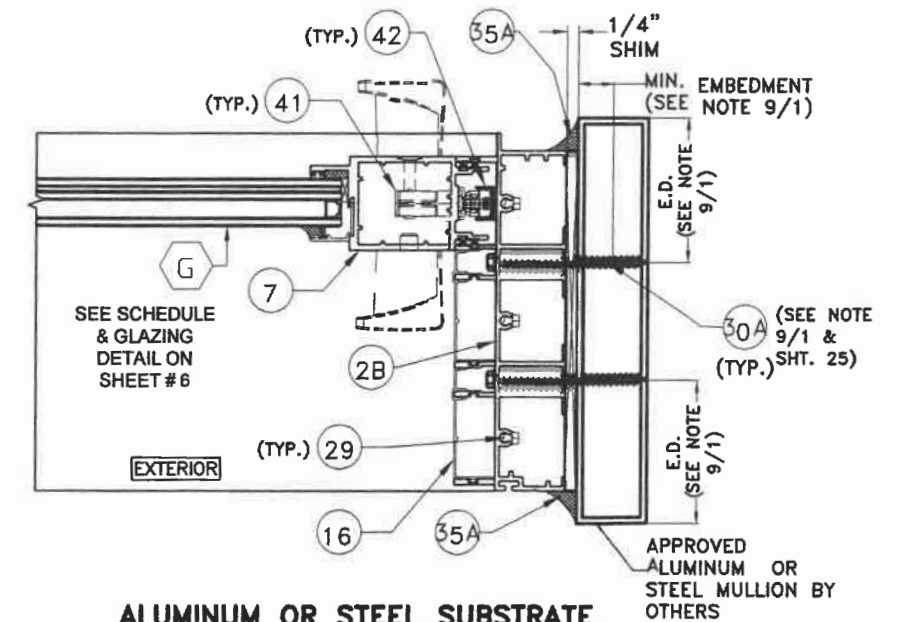

**ALUMINUM OR STEEL SUBSTRATE
(3 TRACK ATTACHED JAMB)**


**SECTIONS F-F
W/LAMINATED OR INSULATED GLASS
(3 TRACK)
N.T.S.**

NOTE 1: FOR MAXIMUM FRAME, PANEL & DLO LIMITATIONS SEE SCHEDULE ON SHEET 8 & ANCHOR SPACING SEE SCHEDULE ON SHEET 25

NOTE 2: SUBSTRATE CAN BE COMBINED AS APPLICABLE

NOTE 3: GLASS TYPE CAN BE LAMINATED OR INSULATED SEE SCHEDULE FOR LIMITATIONS ON SHEET 6





*** FIX PANEL ASSEMBLY REQUIRES COMPONENT 33 AT TOP & BOTTOM 1" FROM EDGES AND AT 8" O.C.**

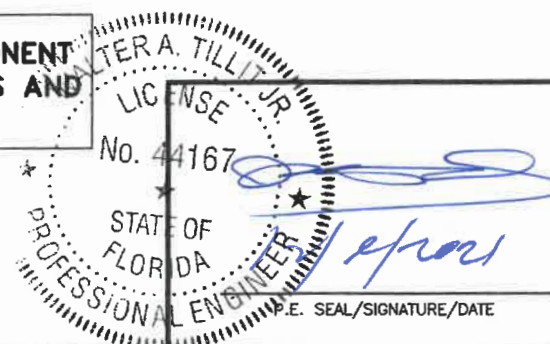

© 2021 TILTECO INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305) 871-1530 • Fax : (305) 871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr., P.E.
FLORIDA Lic. 44167

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)


SERIES 26000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE			M.P. DRAWN BY:		
			8/5/2021		
			DATE		
290 WEST 78 ROAD HIALEAH, FL. 33014			21-114		
PHONE: (305) 558-8103			DRAWING No		
FAX: (305) 558-6665					
www.generalimpact.com					
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 29-275	8/5/21	2	-	-

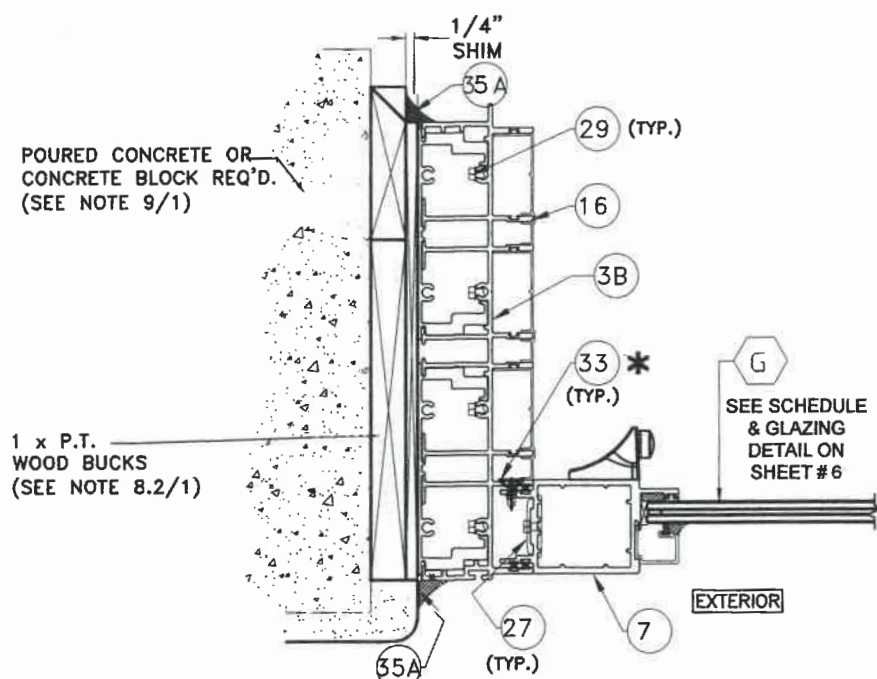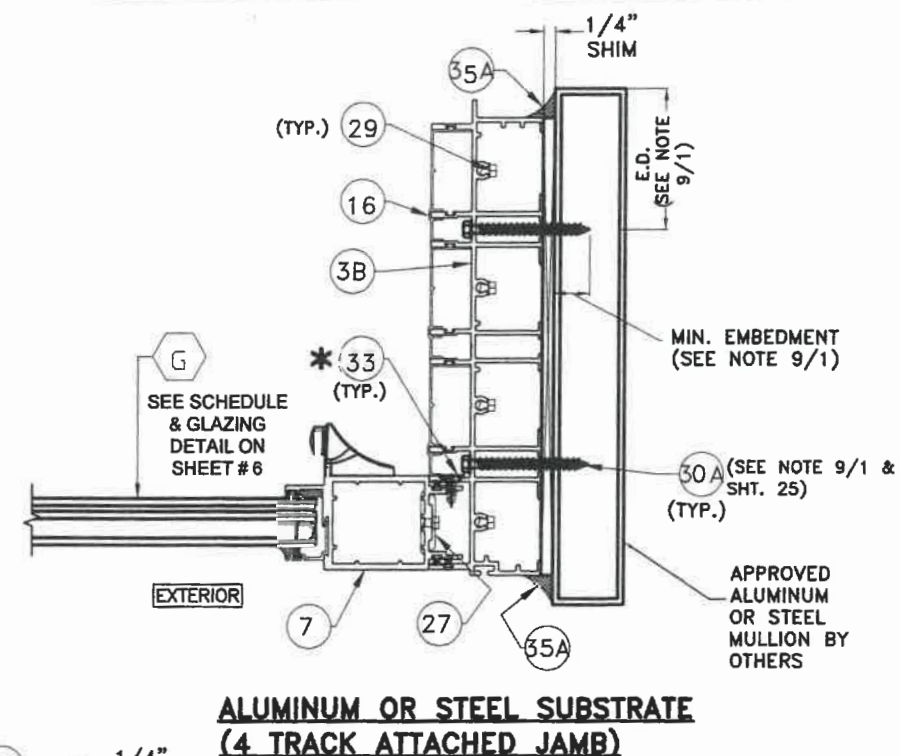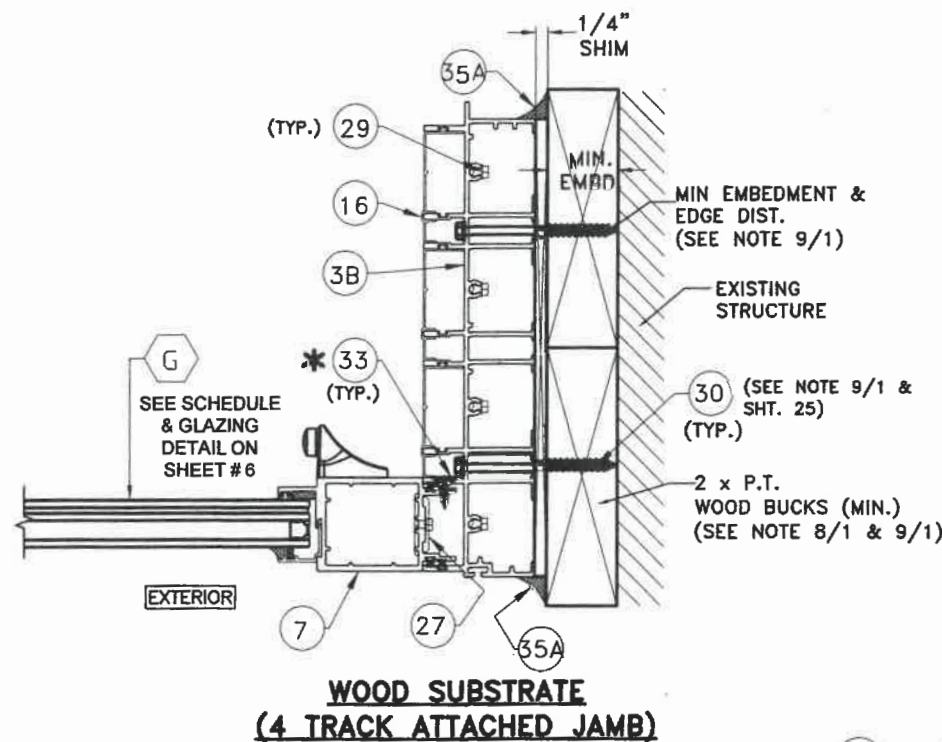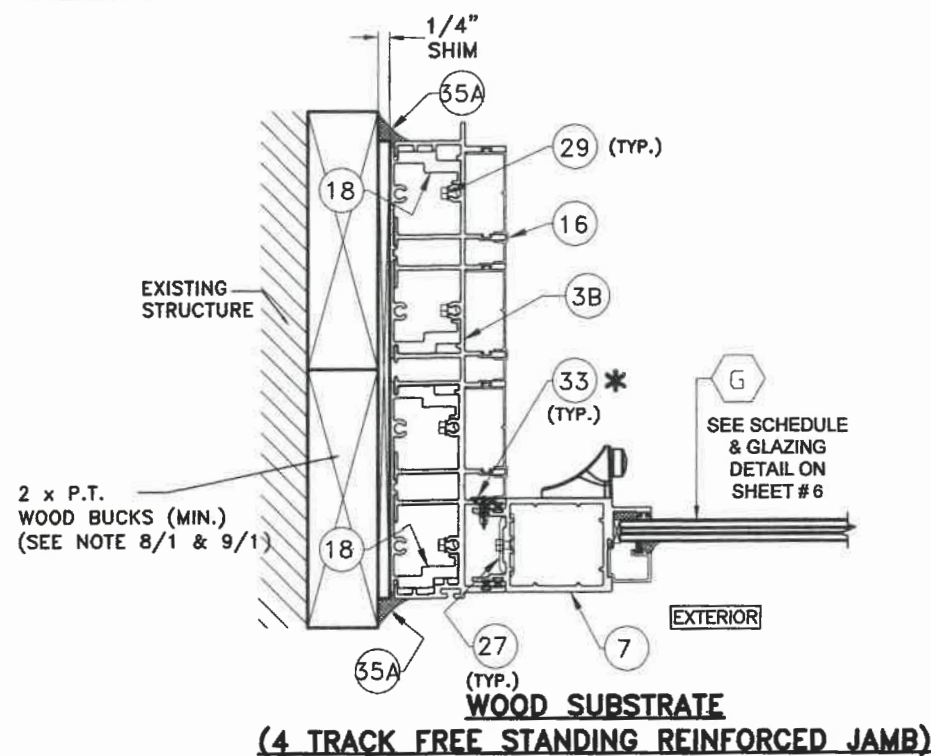

NOTE 1: FOR MAXIMUM FRAME, PANEL & DLO LIMITATIONS SEE SCHEDULE ON SHEET 8 & ANCHOR SPACING SEE SCHEDULE ON SHEET 25

NOTE 2: SUBSTRATE CAN BE COMBINED AS APPLICABLE

NOTE 3: GLASS TYPE CAN BE LAMINATED OR INSULATED SEE SCHEDULE FOR LIMITATIONS ON SHEET 6

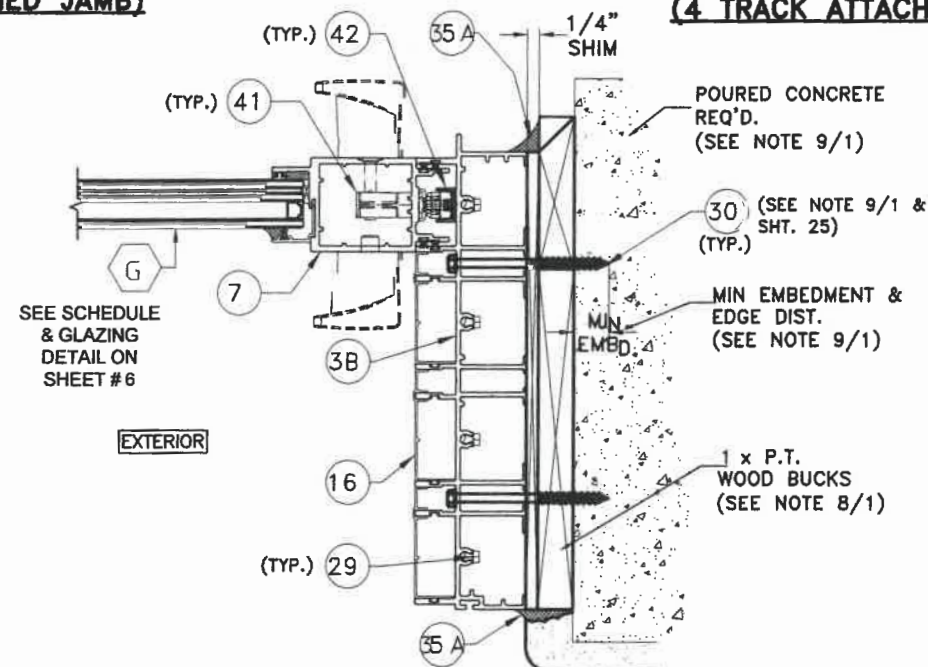


**CONCRETE OR CONCRETE BLOCK SUBSTRATE
(4 TRACK FREE STANDING REINFORCED JAMB)**

SECTIONS G-G W/LAMINATED OR INSULATED GLASS (4 TRACK)

**CONCRETE OR CONCRETE BLOCK SUBSTRATE
(4 TRACK ATTACHED JAMB)**

* FIX PANEL ASSEMBLY REQUIRES COMPONENT 33 AT TOP & BOTTOM 1" FROM EDGES AND AT 8" O.C.

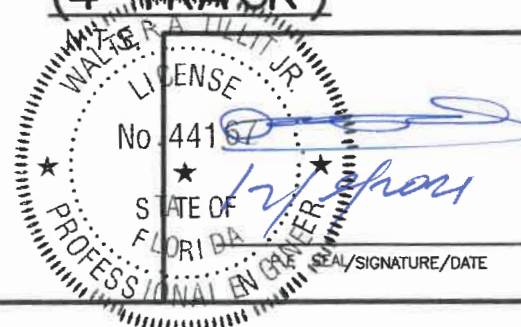

© 2021 TILTECO INC.

TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY

6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33166

Phone : (305)871-1530 . Fax : (305)871-1531

e-mail: tilteco@aol.com

CA-0006719





WALTER A. TILLIT Jr., P.E.

FLORIDA Lic. 44167


FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

SERIES 26000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE			M.P DRAWN BY:		
 GENERAL IMPACT GLASS & WINDOWS			8/5/2021 DATE		
			21-114 DRAWING No		
290 WEST 78 ROAD HIALEAH, FL. 33014 PHONE: (305) 558-8103 FAX: (305) 558-6665 www.generalimpact.com					
REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-23	8/6/21	2		
			SHEET 13 OF 26		


SHEET 13 OF 26

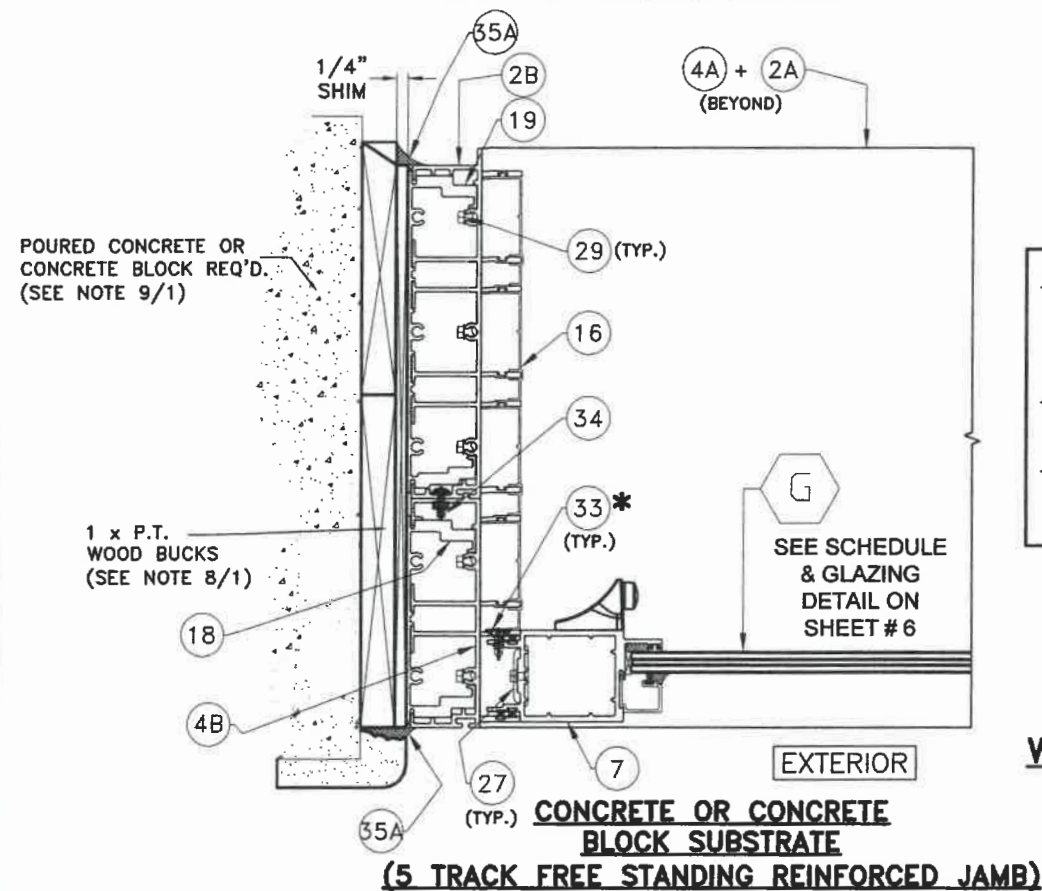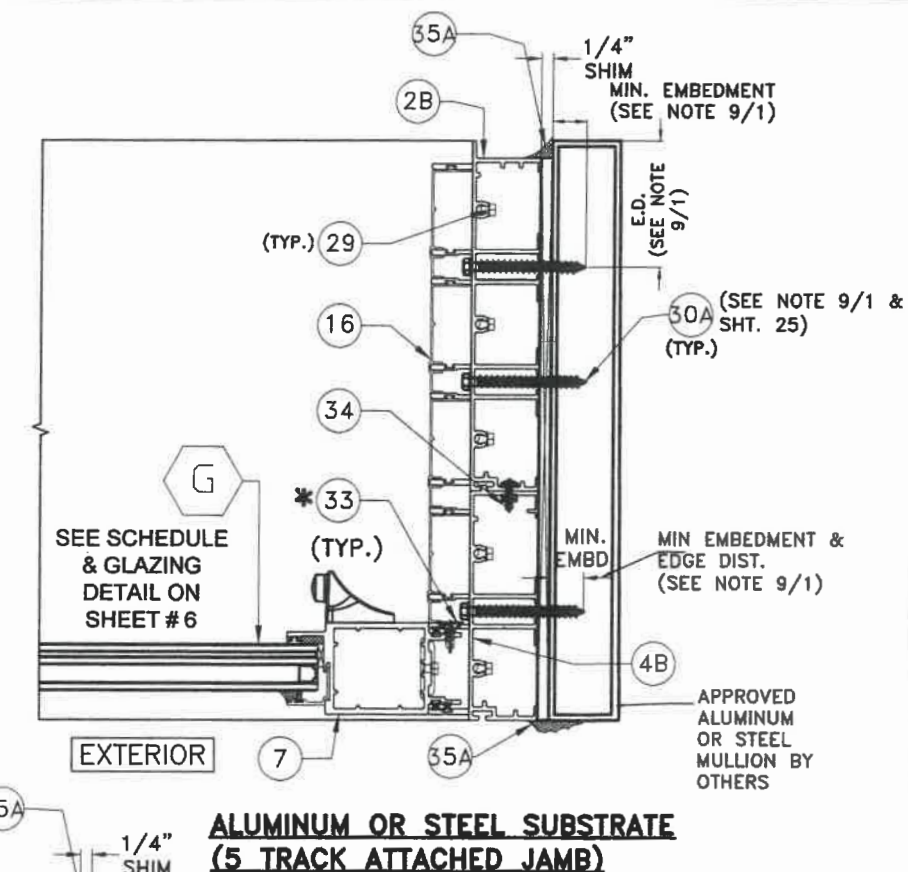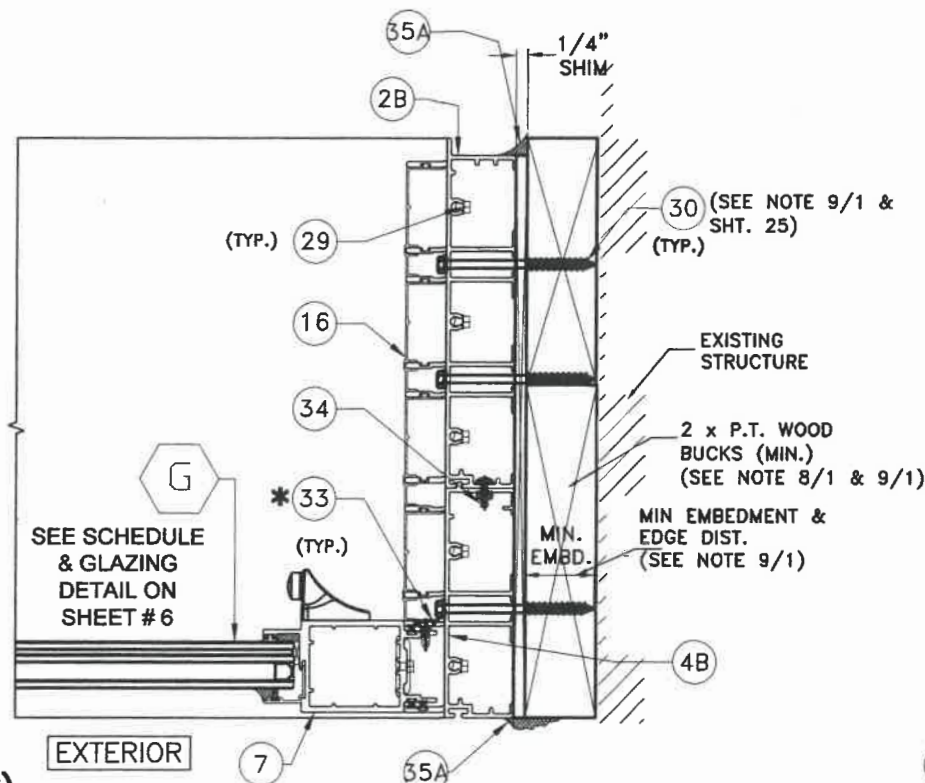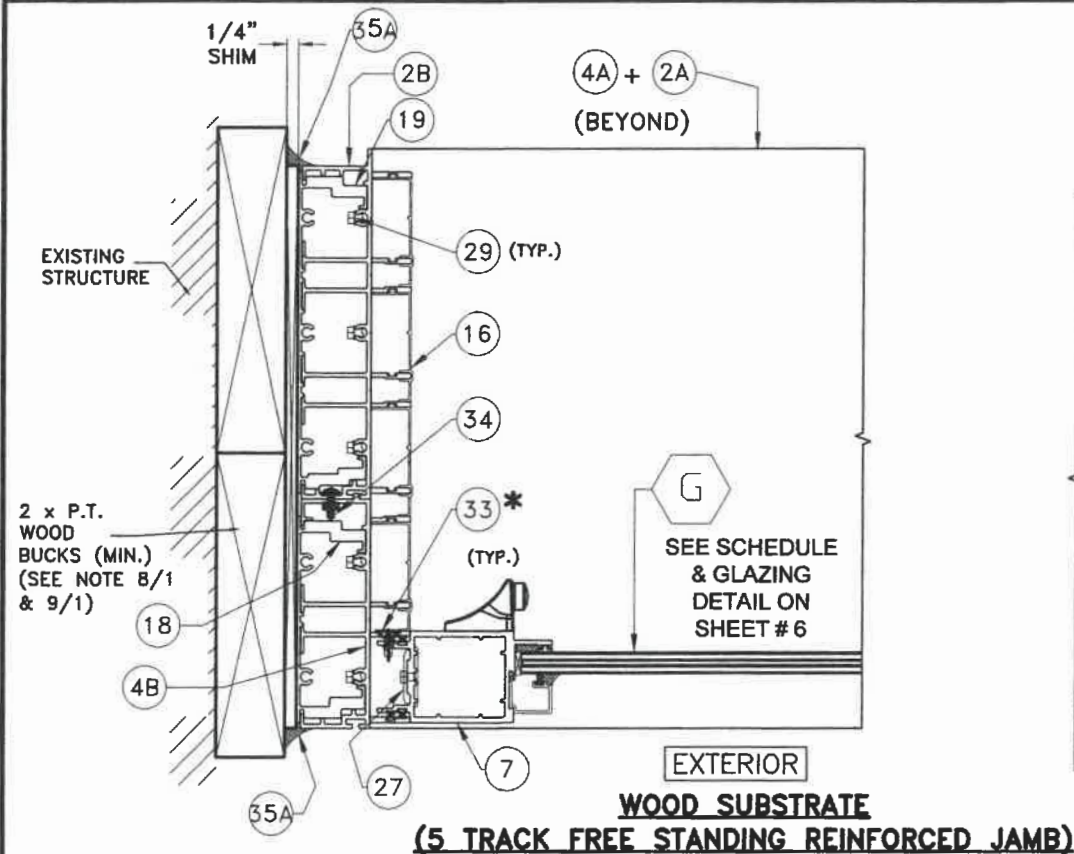

- NOTE 1:** FOR MAXIMUM FRAME, PANEL & DLO LIMITATIONS SEE SCHEDULE ON SHEET 8 & ANCHOR SPACING SEE SCHEDULE ON SHEET 25
- NOTE 2:** SUBSTRATE CAN BE COMBINED AS APPLICABLE
- NOTE 3:** GLASS TYPE CAN BE LAMINATED OR INSULATED SEE SCHEDULE FOR LIMITATIONS ON SHEET 6

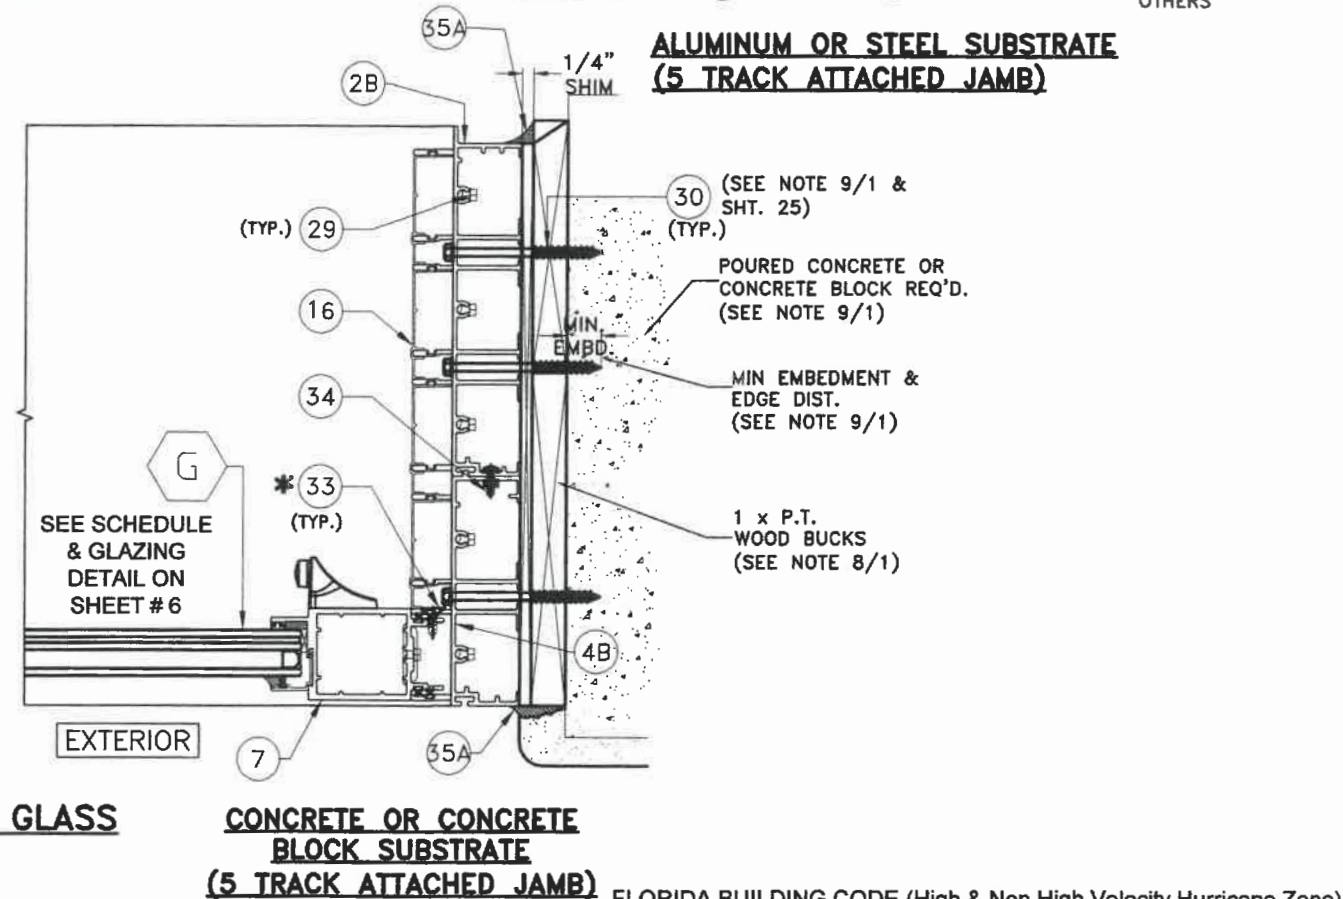

SECTIONS H-H
W/LAMINATED OR INSULATED GLASS

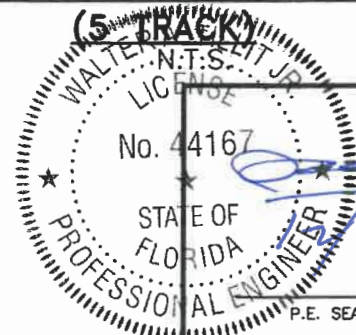

CONCRETE OR CONCRETE BLOCK SUBSTRATE
(5 TRACK ATTACHED JAMB)

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

* FIX PANEL ASSEMBLY REQUIRES COMPONENT 33 AT TOP & BOTTOM 1" FROM EDGES AND AT 8" O.C.

© 2021 TILTECO INC.

TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY

6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166

Phone: (305) 871-1530 Fax: (305) 871-1531

e-mail: tilteco@aol.com

CA-0006719

WALTER A. TILLIT JR., P.E.

FLORIDA Lic. 44167

SERIES 26000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE

GENERAL

290 WEST 78 ROAD
HIALEAH, FL. 33014


PHONE: (305) 558-8103
FAX: (305) 558-6665
www.generalimpact.com

REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-275	8/6/21	2	-	-

M.P. DRAWN BY: 8/5/2021 DATE

21-114 DRAWING No

SHEET 14 OF 26

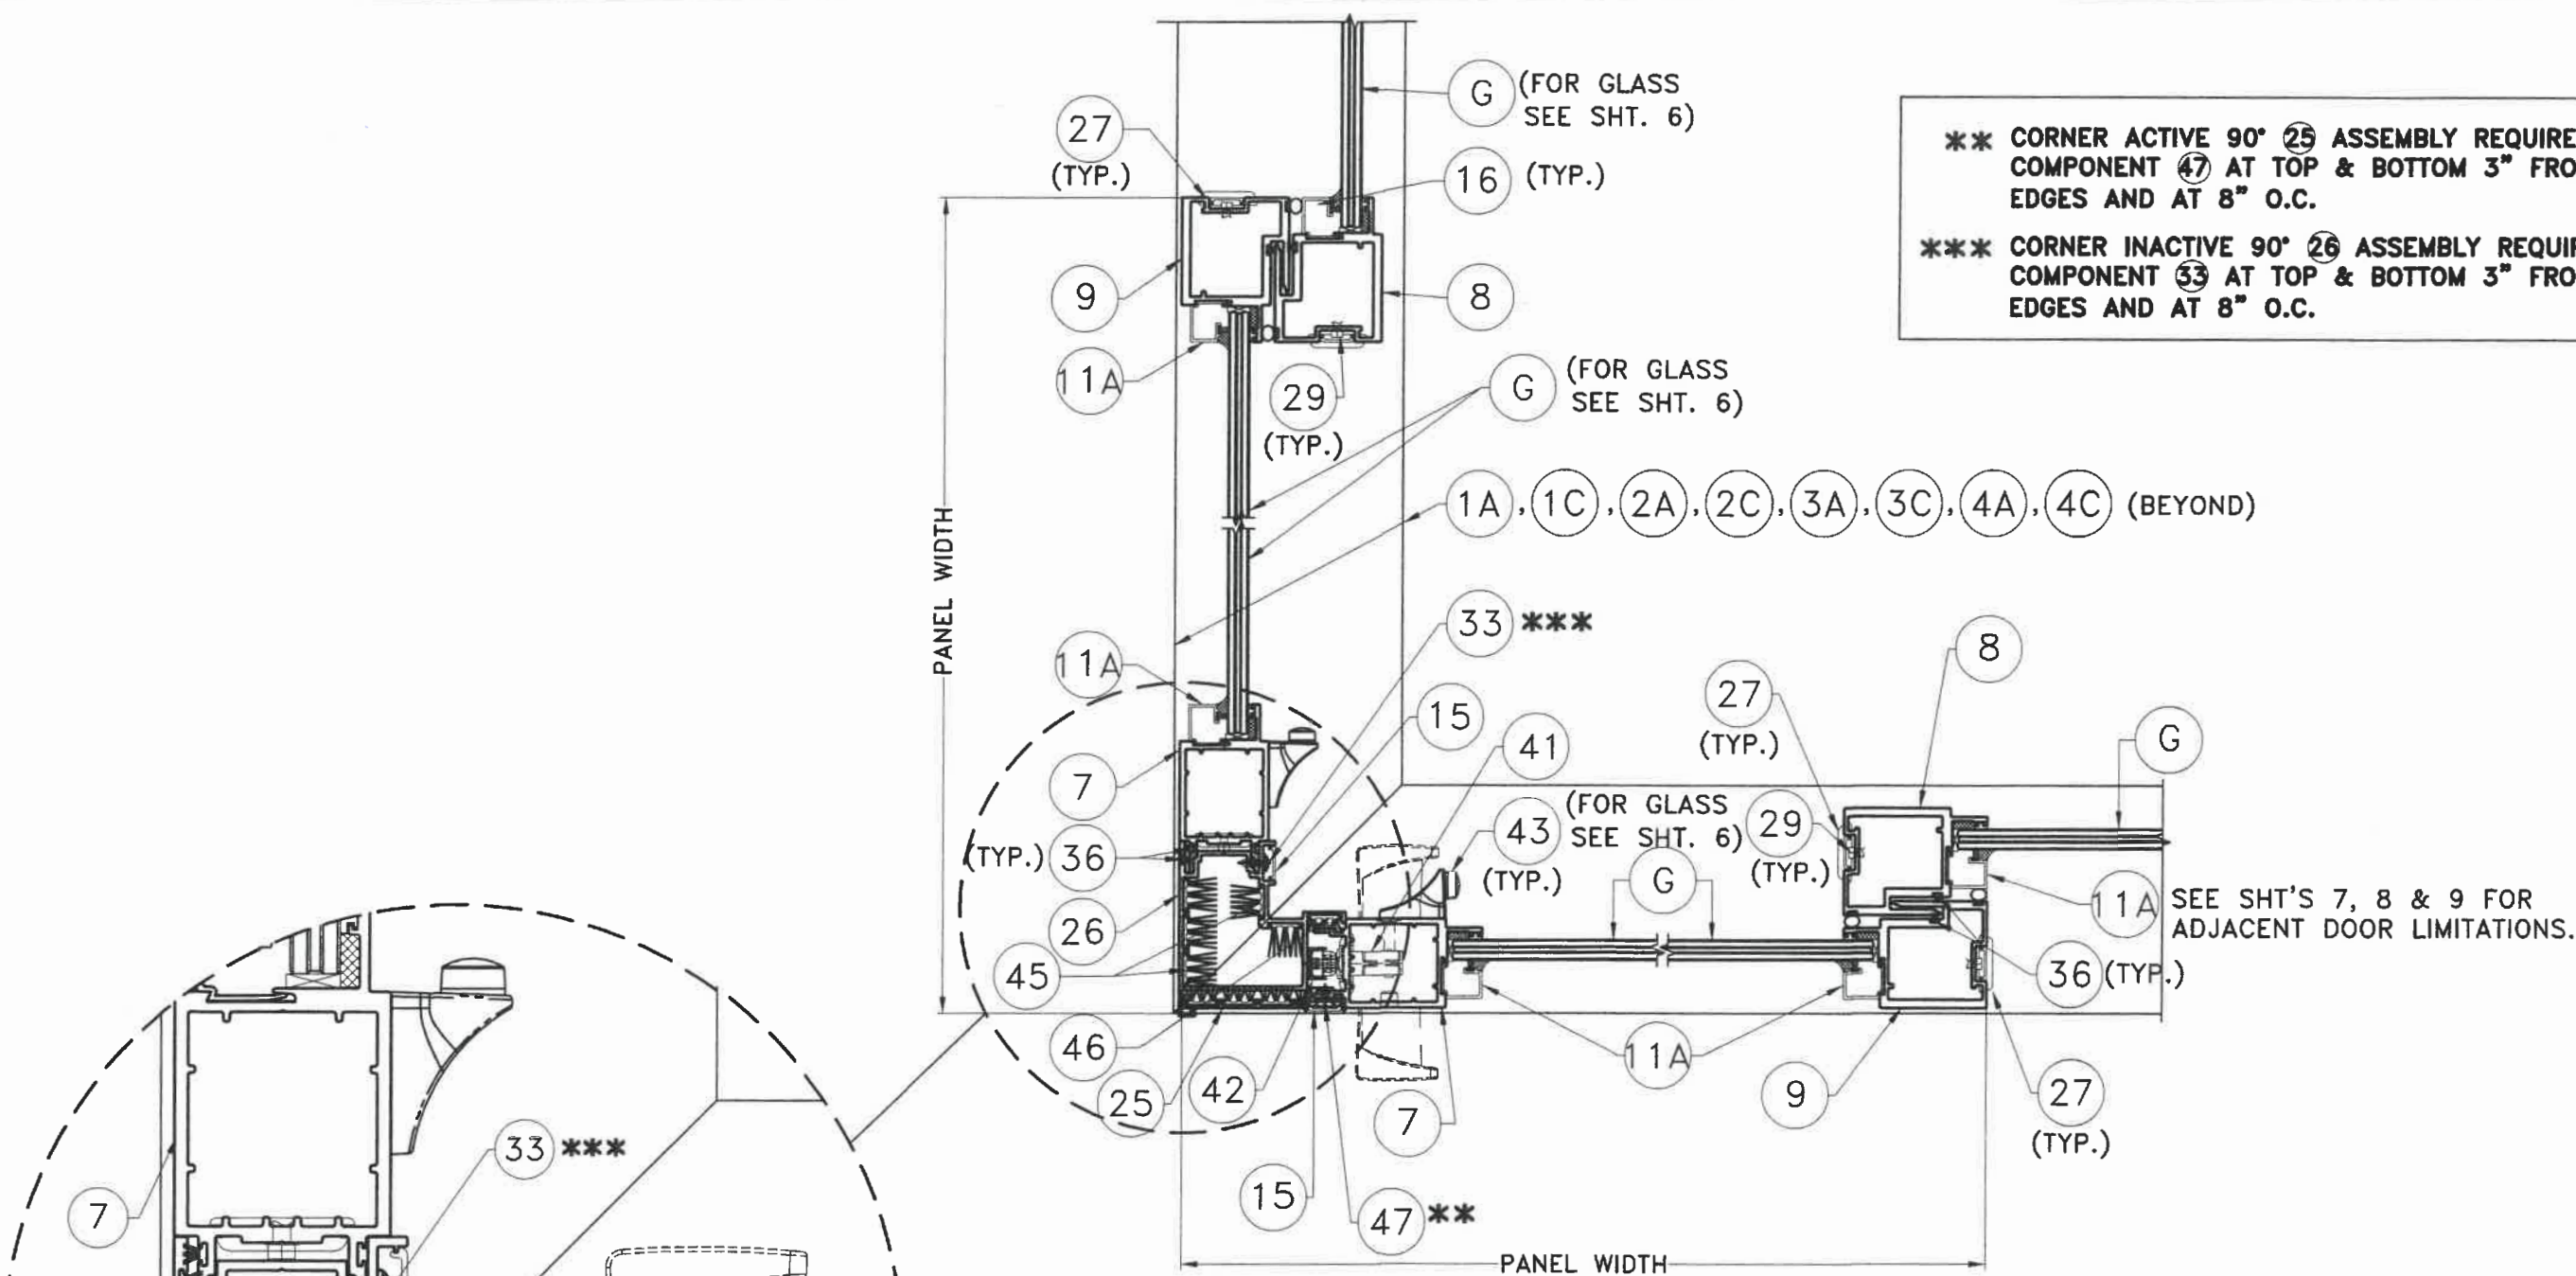


EXTERIOR

SECTION I-I

N.T.S.

(2, 3, 4, & 5 TRACK)


FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

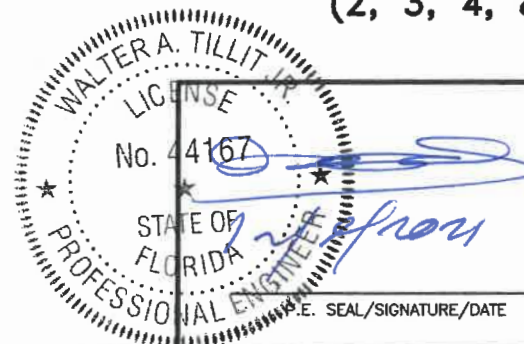


© 2021 TILTECO INC.
TILTECO INC.
 TILLIT TESTING & ENGINEERING COMPANY
 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
 Phone: (305) 871-1530 • Fax: (305) 871-1531
 e-mail: tilteco@aol.com
 CA-0006719
 WALTER A. TILLIT Jr., P.E.
 FLORIDA Lic. 44167

SERIES 26000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE				M.P. DRAWN BY:	
				8/5/2021 DATE	
				21-114 DRAWING No	
REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-275	8/6/21	2	-	-


SHEET 15 OF 26

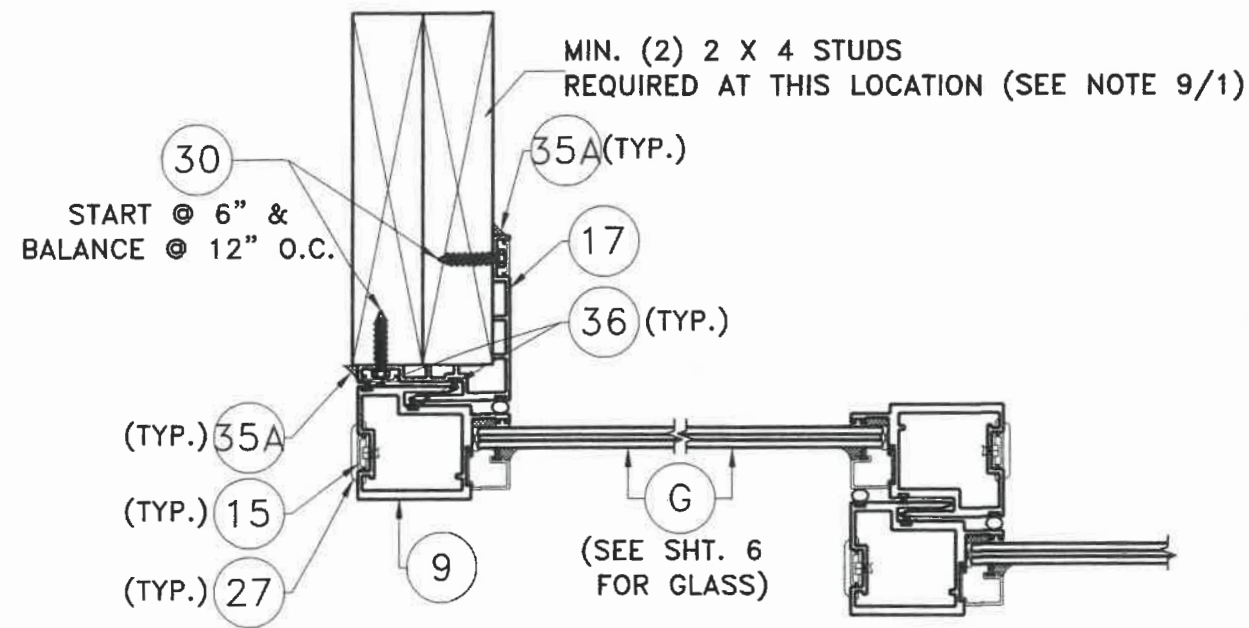

WOOD SUBSTRATE
N.T.S.

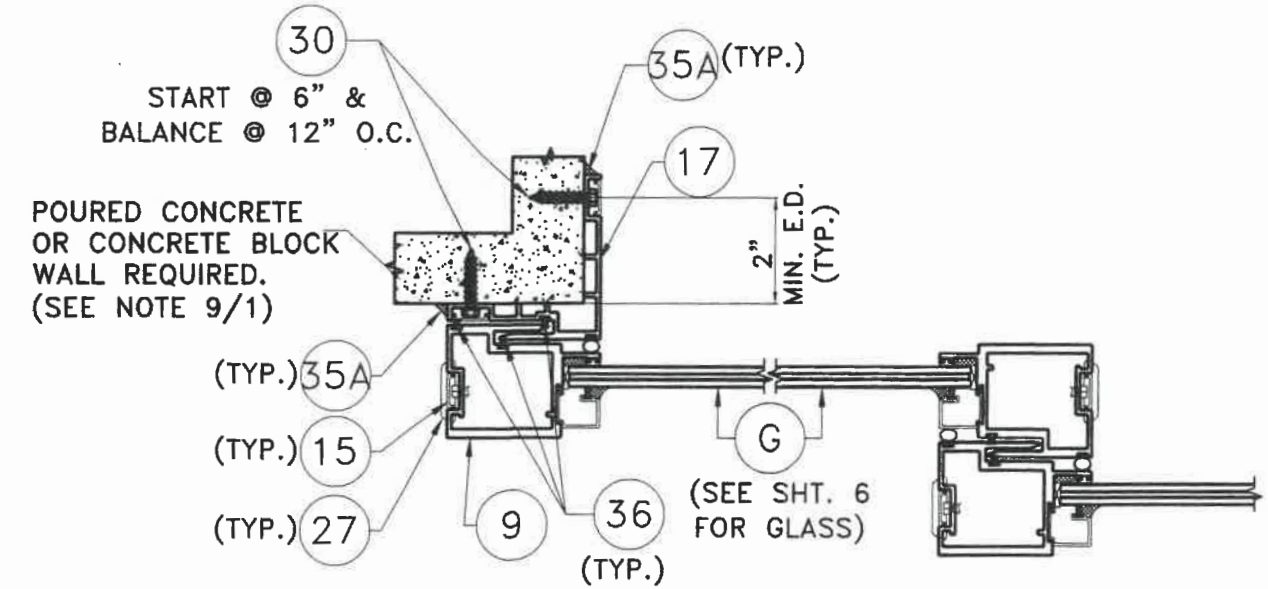


**POURED CONCRETE OR
CONCRETE BLOCK SUBSTRATE**
N.T.S.

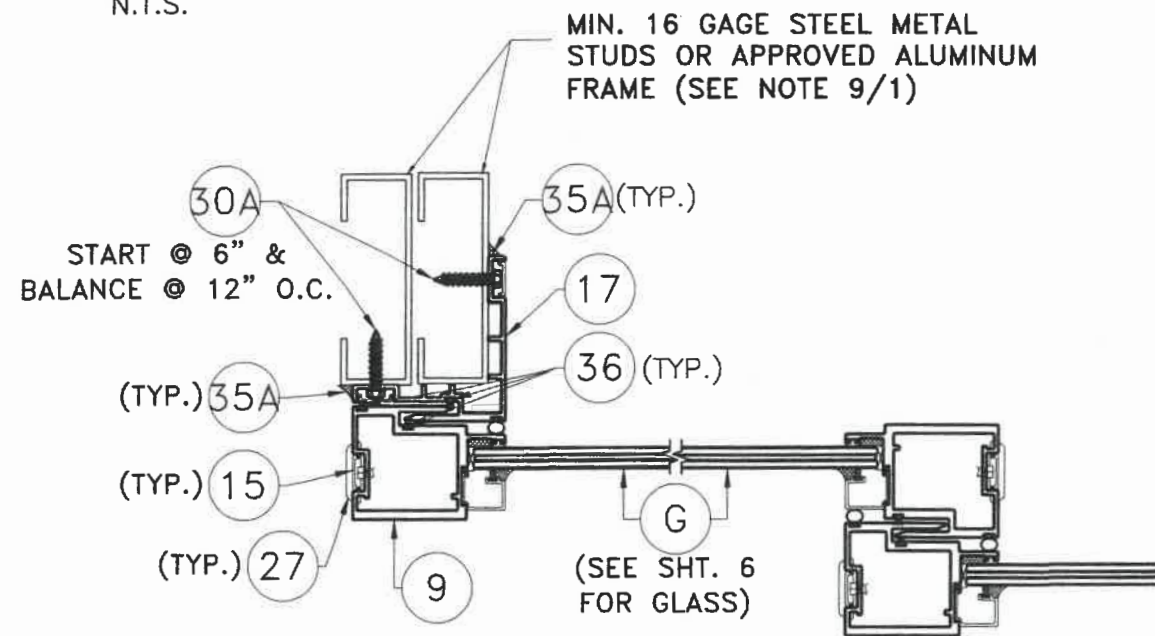

STEEL STUDS SUBSTRATE
N.T.S.

SECTIONS J-J
POCKET DOOR DETAIL W/ 17
(2-5 TRACK DOORS)*

* VALID ONLY FOR MAX. A.S.D. PRESSURE RATING OF ± 55.0 psf, MAX. FRAME HEIGHT OF 120" & MAX. PANEL WIDTH OF 5'-0" O.C.

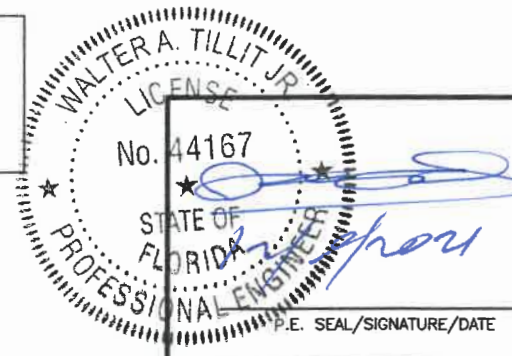


© 2021 TILTECO INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305) 871-1530 • Fax : (305) 871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr., P.E.
FLORIDA Lic. 44167


FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

SERIES 28000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE						M.P. DRAWN BY:
 GENERAL IMPACT GLASS & WINDOWS 290 WEST 78 ROAD HIALEAH, FL. 33014 PHONE: (305) 558-8103 FAX: (305) 558-6665 www.generalimpact.com						8/5/2021 DATE
						21-114 DRAWING No
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE	
1	OLD 20-275	8/6/21	2	-	-	


SHEET 16 OF 26

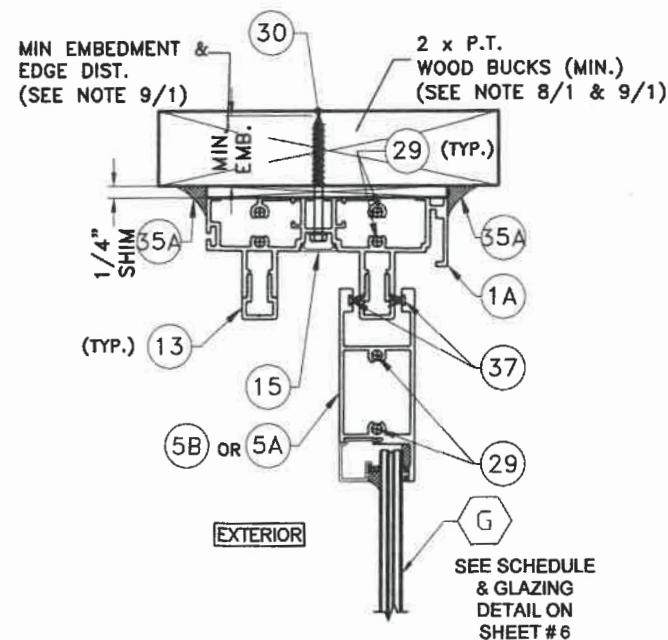


**WOOD SUBSTRATE *
(2 TRACK HEAD)**

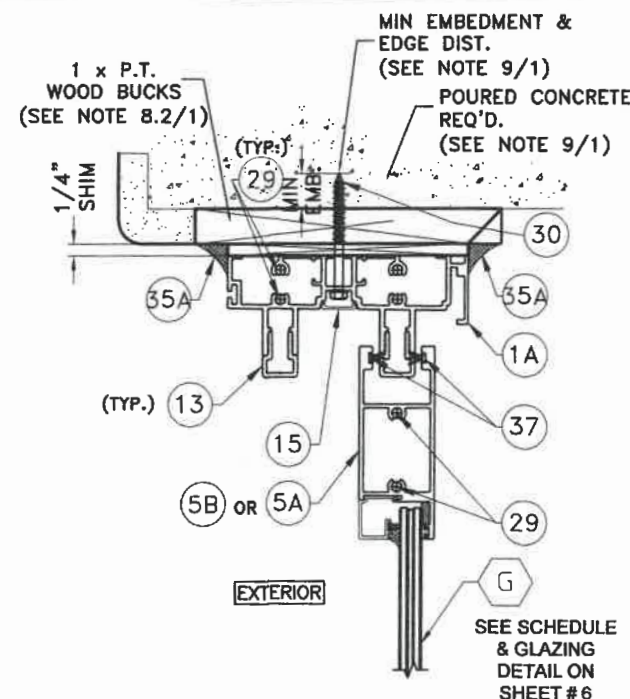


**CONCRETE SUBSTRATE *
(2 TRACK HEAD)**

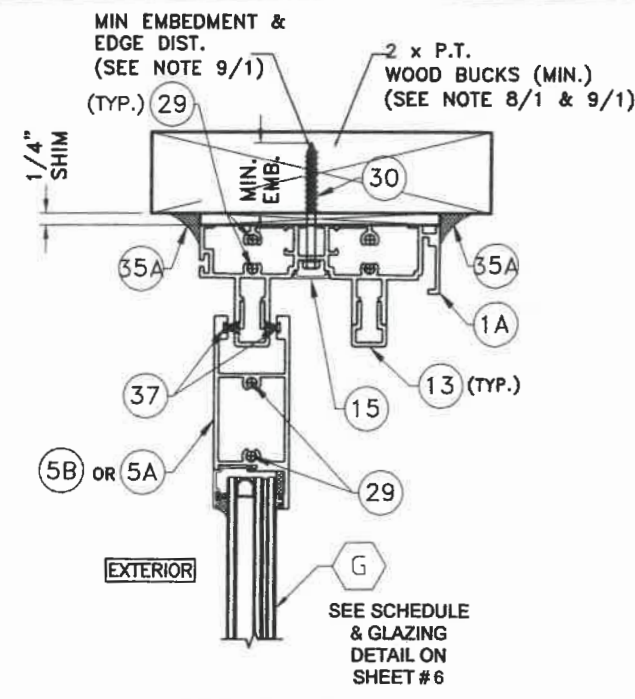


**WOOD SUBSTRATE *
(2 TRACK HEAD)**

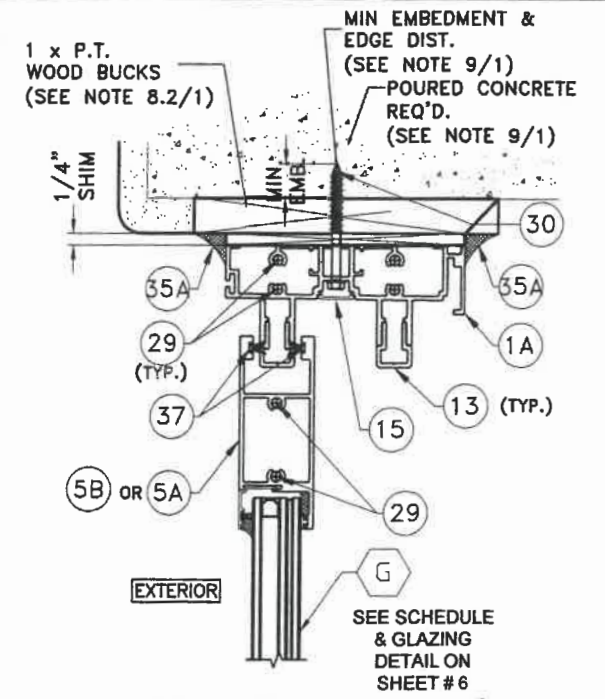


**CONCRETE SUBSTRATE *
(2 TRACK HEAD)**

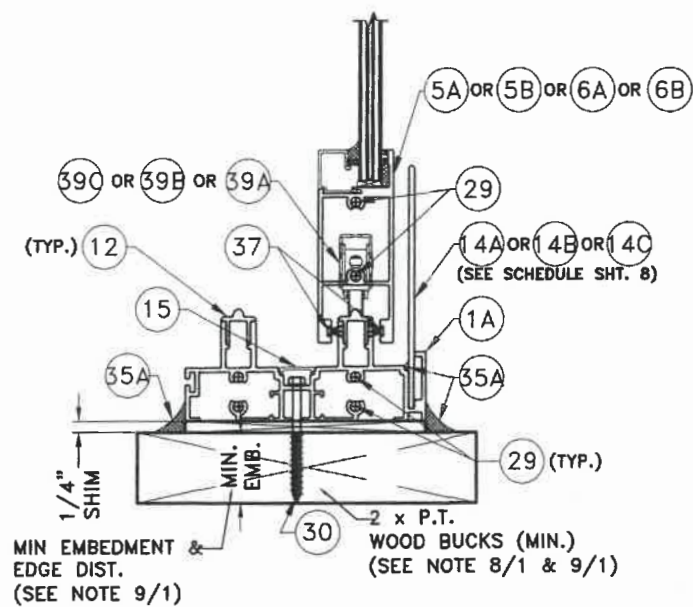


**WOOD SUBSTRATE
(2 TRACK SILL)**

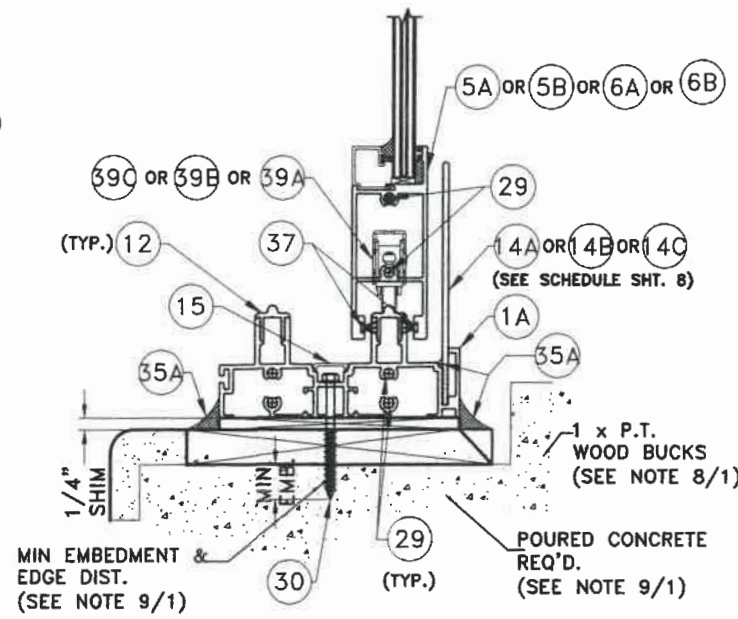

**CONCRETE SUBSTRATE
(2 TRACK SILL)**

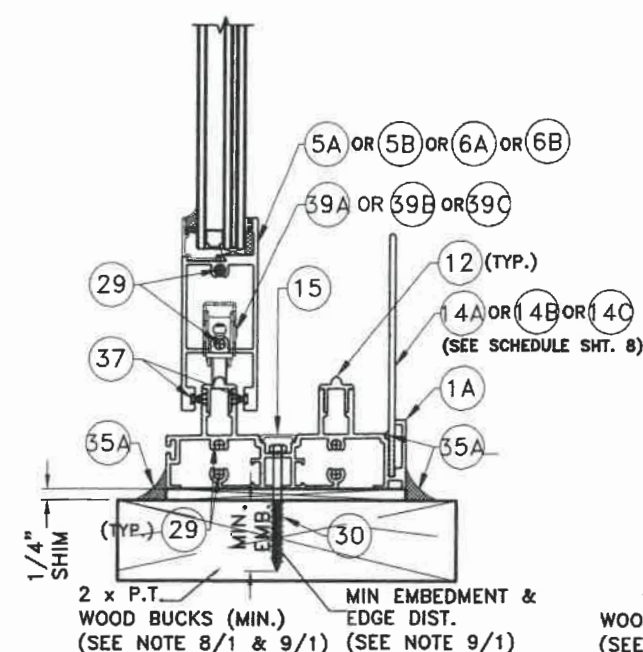

**WOOD SUBSTRATE
(2 TRACK SILL)**

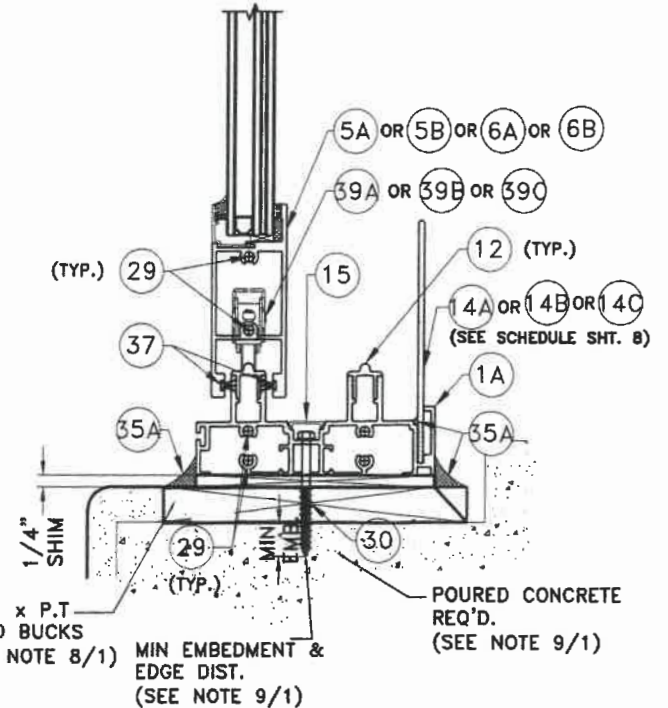

**CONCRETE SUBSTRATE
(2 TRACK SILL)**

**SECTIONS A-A
W/LAMINATED GLASS
2 TRACK**

N.T.S.

*** SEE SHEET 20B FOR
HEADER CONNECTION W/METAL**

NOTE 1: FOR MAXIMUM FRAME, PANEL & DLO LIMITATIONS SEE SCHEDULE ON SHEET 8 & ANCHOR SPACING SEE SCHEDULE ON SHEET 24

NOTE 2: SUBSTRATE CAN BE COMBINED AS APPLICABLE

NOTE 3: GLASS TYPE CAN BE LAMINATED OR INSULATED SEE SCHEDULE FOR LIMITATIONS ON SHEET 6


WALTER A. TILLIT JR.
LICENSE
No. 44167
STATE OF FLORIDA
PROFESSIONAL ENGINEER
P.E. SEAL/SIGNATURE/DATE

**SECTIONS A-A
W/INSULATED GLASS
2 TRACK**


N.T.S. FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

© 2021 TILTECO INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone: (305) 871-1530 Fax: (305) 871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT JR., P.E.
FLORIDA Lic. 44167


SERIES 26000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE					M.P. DRAWN BY:
 GENERAL IMPACT GLASS & WINDOWS 290 WEST 78 ROAD HIALEAH, FL. 33014 PHONE: (305) 558-8103 FAX: (305) 558-6665 www.generalimpact.com					8/5/2021 DATE
					21-114 DRAWING No
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-275	8/6/21	2	-	-

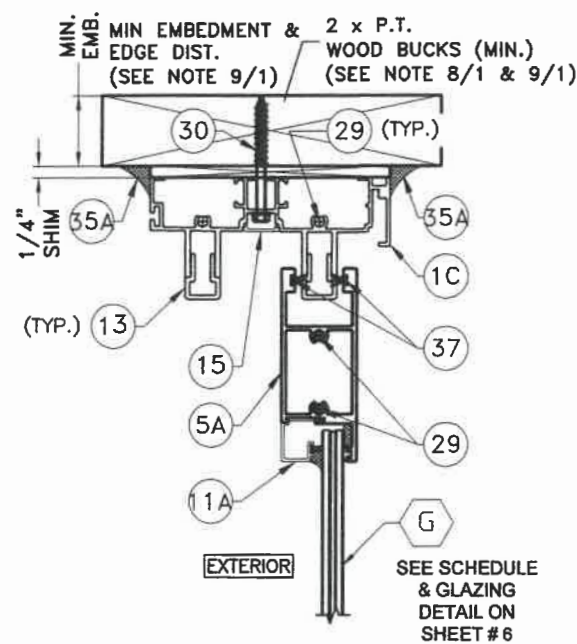


**WOOD SUBSTRATE *
(2 TRACK HEAD)**

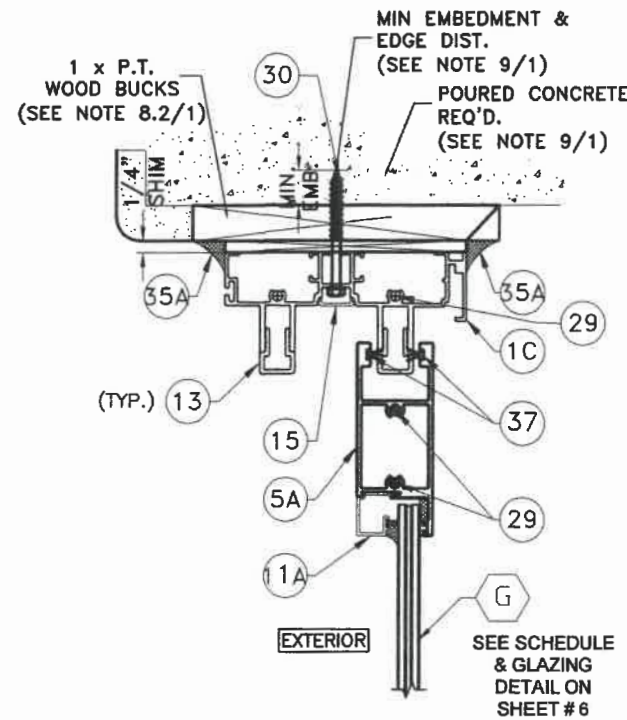


**CONCRETE SUBSTRATE *
(2 TRACK HEAD)**

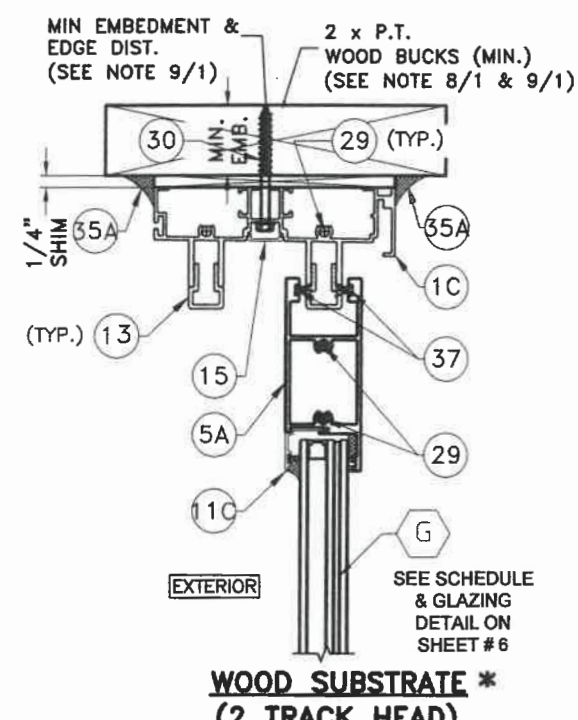


**WOOD SUBSTRATE *
(2 TRACK HEAD)**

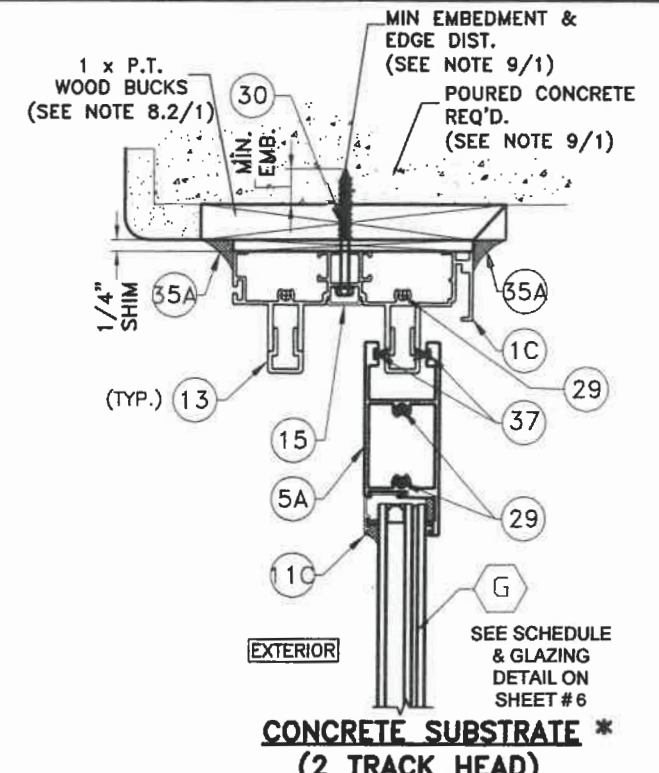


**CONCRETE SUBSTRATE *
(2 TRACK HEAD)**

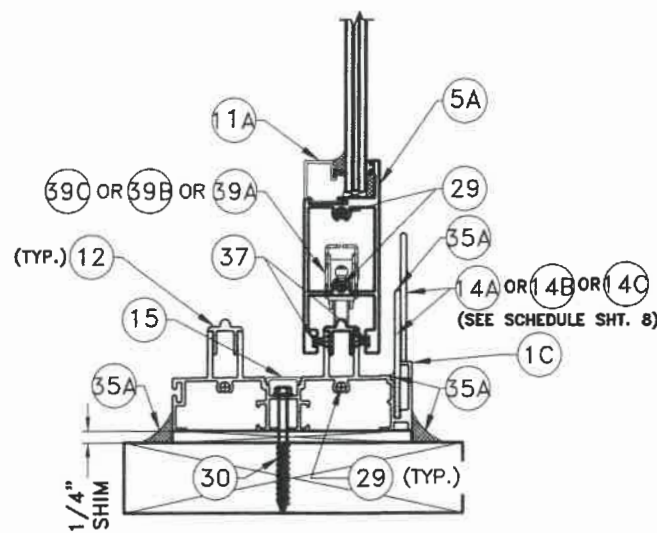


**WOOD SUBSTRATE
(2 TRACK HEAD)**

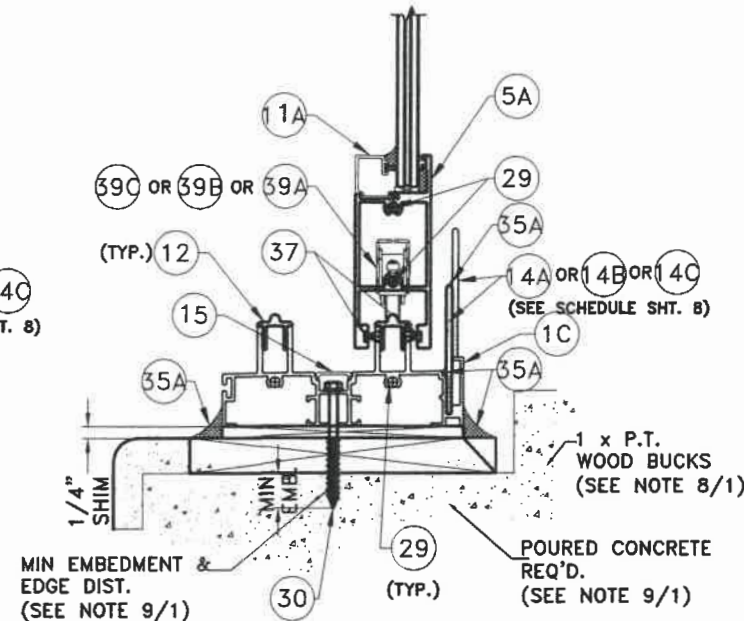

**CONCRETE SUBSTRATE
(2 TRACK SILL)**

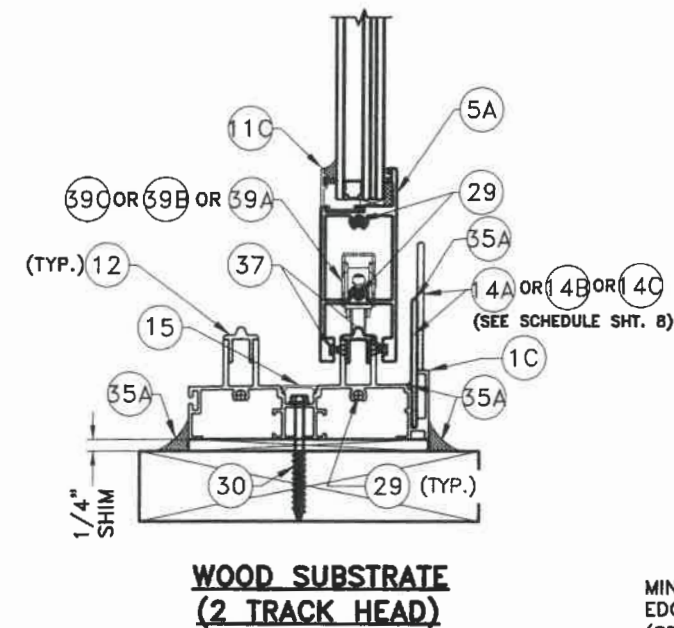

**WOOD SUBSTRATE
(2 TRACK HEAD)**

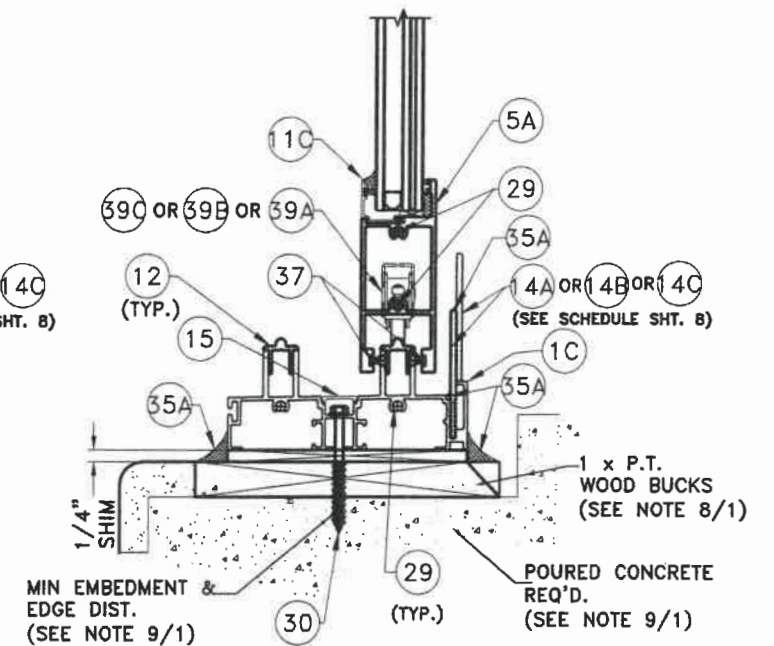

**CONCRETE SUBSTRATE
(2 TRACK SILL)**

**SECTIONS A'-A'
W/INSULATED GLASS
2 TRACK****

N.T.S.

NOTE 1: FOR MAXIMUM FRAME, PANEL & DLO LIMITATIONS SEE SCHEDULE ON SHEET 8 & ANCHOR SPACING SEE SCHEDULE ON SHEET 24

NOTE 2: SUBSTRATE CAN BE COMBINED AS APPLICABLE

NOTE 3: GLASS TYPE CAN BE LAMINATED OR INSULATED SEE SCHEDULE FOR LIMITATIONS ON SHEET 6

**SECTIONS A'-A'
W/LAMINATED GLASS
2 TRACK ****

N.T.S.

**** SEE Δ NOTE ON SHEET 9
FOR LIMITATIONS W/ 1C**

*** SEE SHEET 20B FOR HEADER
CONNECTION W/ METAL**


WALTER A. TILLIT JR.
LICENSE
No. 44167
STATE OF FLORIDA
PROFESSIONAL ENGINEER
SEAL/SIGNATURE/DATE

© 2021 TILTECO INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305) 871-1530 • Fax : (305) 871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr., P.E.
FLORIDA Lic. 44167


FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

SERIES 26000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE			M.P. DRAWN BY:		
 GENERAL IMPACT GLASS & WINDOWS			8/5/2021 DATE		
			21-114 DRAWING No		
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-275	8/5/21	2	-	-


SHEET 17A OF 26

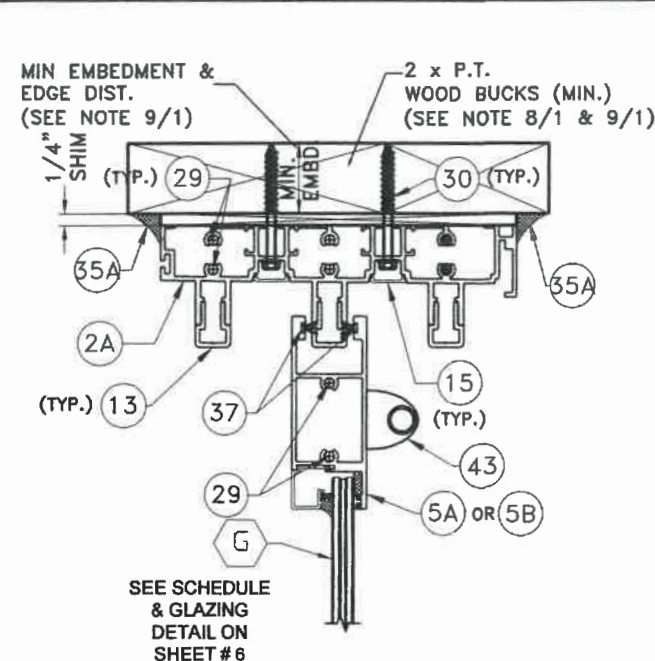


WOOD SUBSTRATE *
(3 TRACK HEAD)

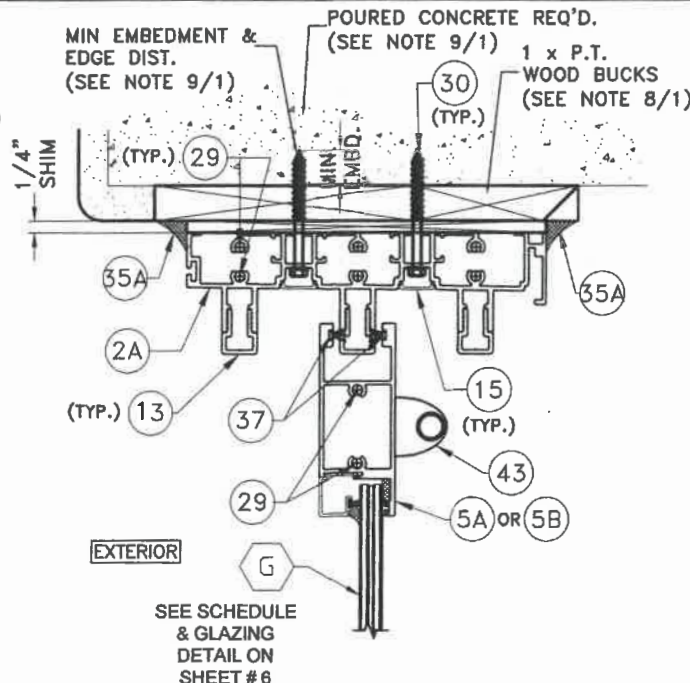


CONCRETE SUBSTRATE *
(3 TRACK HEAD)

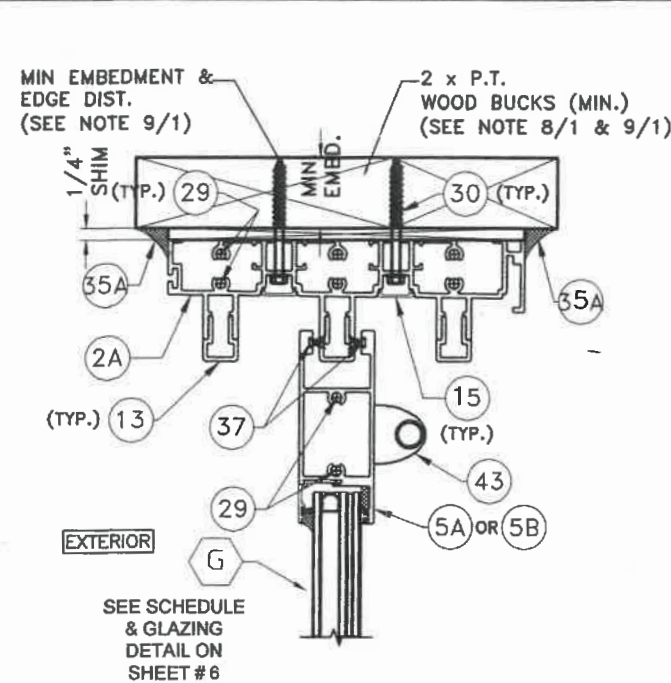


WOOD SUBSTRATE *
(3 TRACK HEAD)

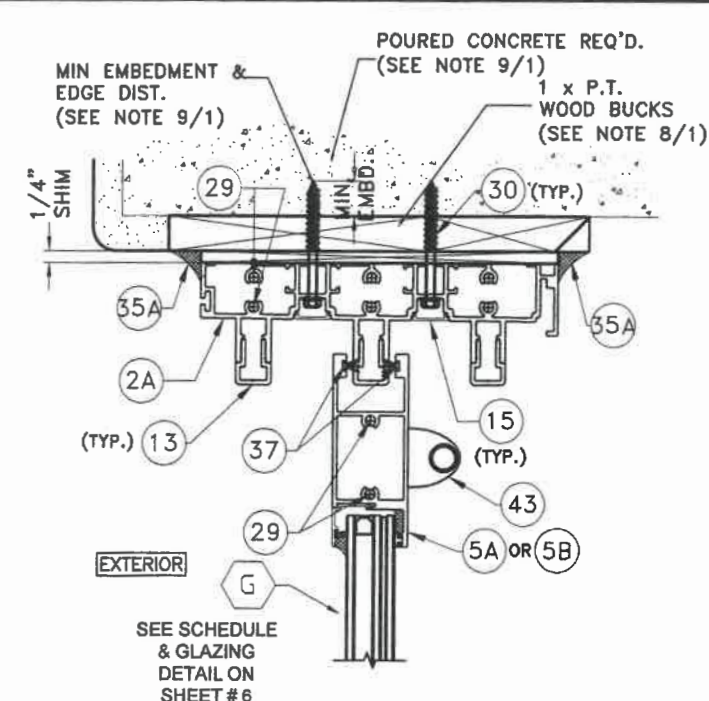


CONCRETE SUBSTRATE *
(3 TRACK HEAD)

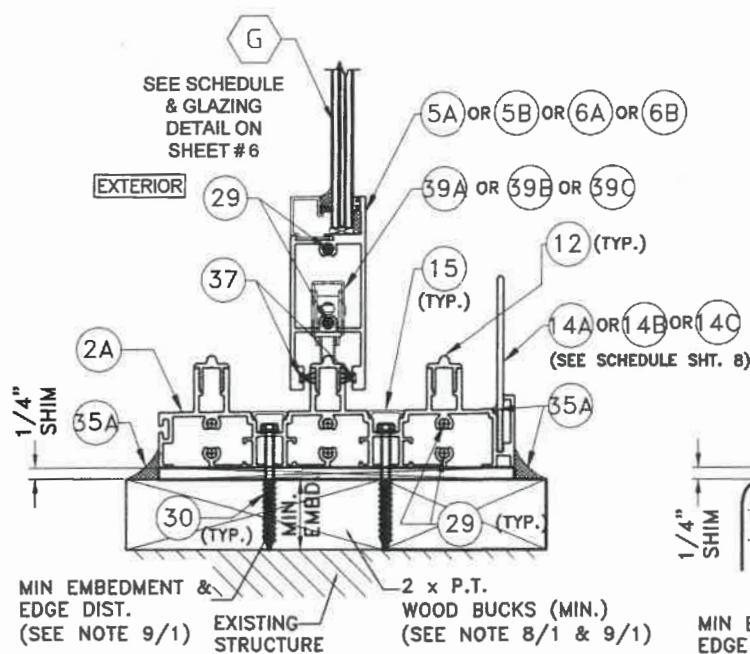


WOOD SUBSTRATE
(3 TRACK SILL)

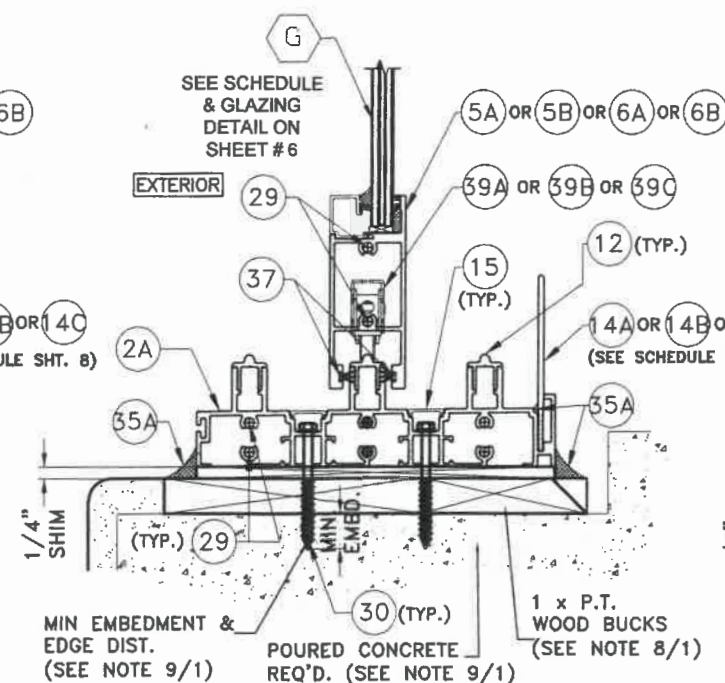

CONCRETE SUBSTRATE
(3 TRACK SILL)

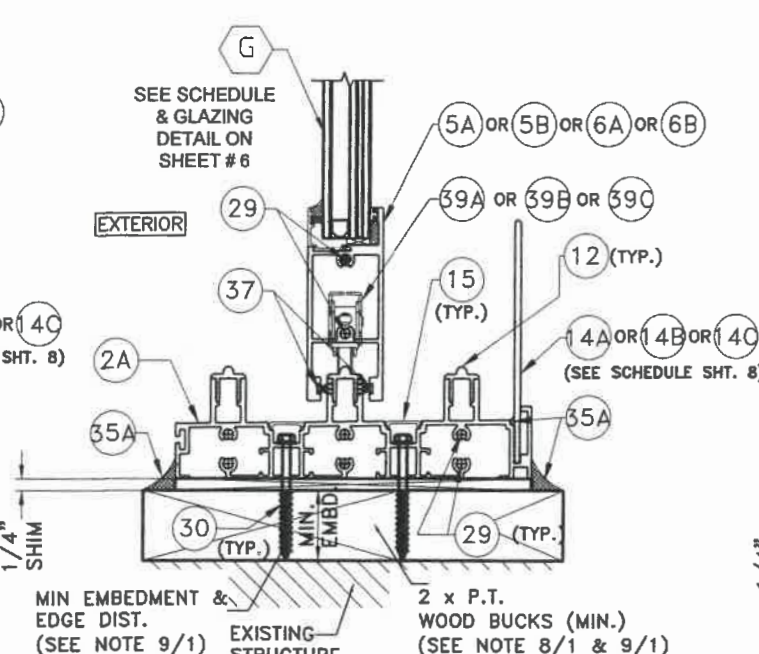

WOOD SUBSTRATE
(3 TRACK SILL)

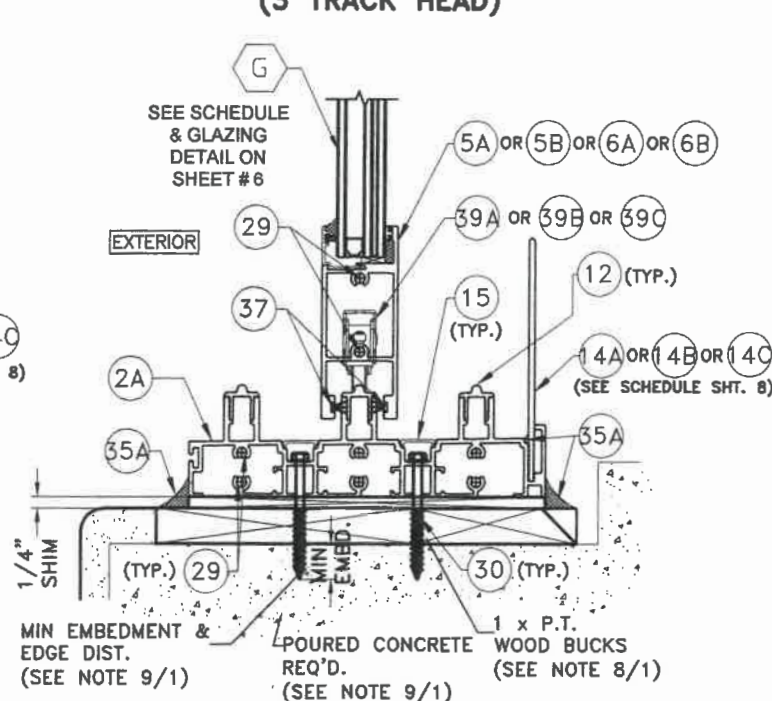

CONCRETE SUBSTRATE
(3 TRACK SILL)

SECTIONS B-B
W/LAMINATED GLASS
3 TRACK


N.T.S.

NOTE 1: FOR MAXIMUM FRAME, PANEL & DLO LIMITATIONS SEE SCHEDULE ON SHEET 8 & ANCHOR SPACING SEE SCHEDULE ON SHEET 24

NOTE 2: SUBSTRATE CAN BE COMBINED AS APPLICABLE

NOTE 3: GLASS TYPE CAN BE LAMINATED OR INSULATED SEE SCHEDULE FOR LIMITATIONS ON SHEET 6

*** SEE SHEET 20B FOR**
HEADER CONNECTION W/METAL

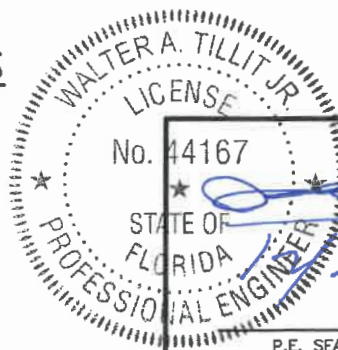

P.E. SEAL/SIGNATURE/DATE

© 2021 TILTECO INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6325 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305) 871-1530 . Fax : (305) 871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT JR., P.E.
FLORIDA Lic. 44167

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

SERIES 28000 HIGH IMPACT SLIDING
GLASS DOOR / LARGE AND SMALL MISSILE



290 WEST 78 ROAD
HIALEAH, FL. 33014
PHONE: (305) 558-8103
FAX: (305) 558-6665
www.generalimpact.com


M.P.
DRAWN BY:

8/5/2021
DATE


21-114
DRAWING No

REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-275	8/6/21	2		


SHEET 18 OF 26

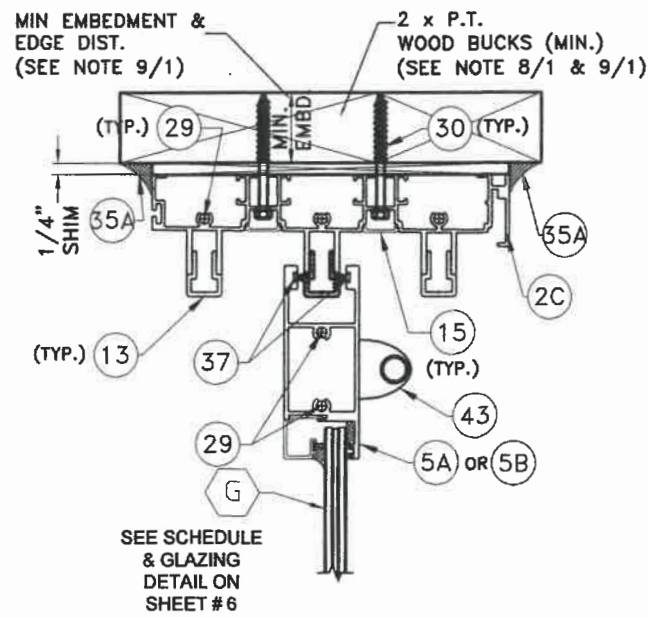


WOOD SUBSTRATE *
(3 TRACK HEAD)

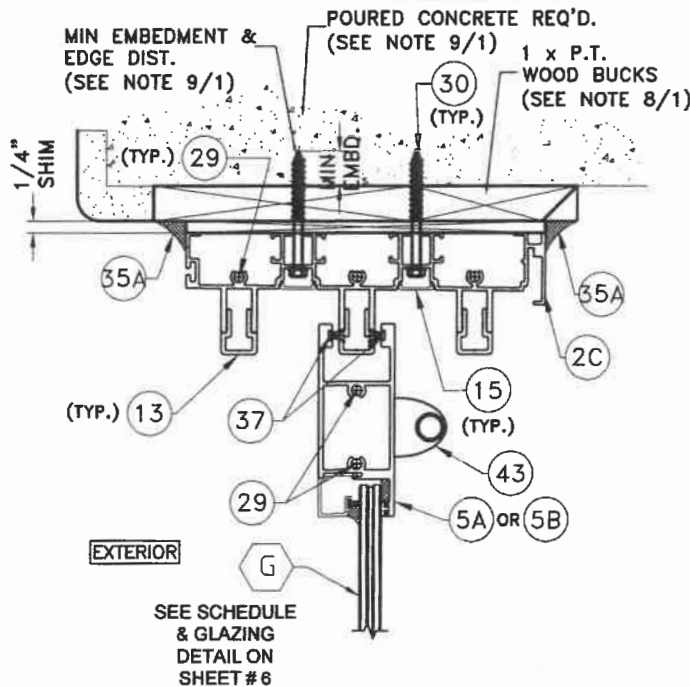


CONCRETE SUBSTRATE *
(3 TRACK HEAD)

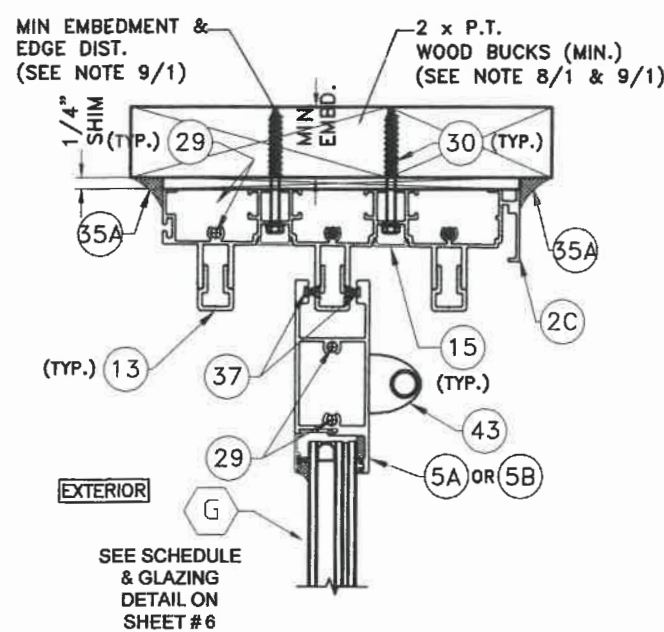


WOOD SUBSTRATE *
(3 TRACK HEAD)

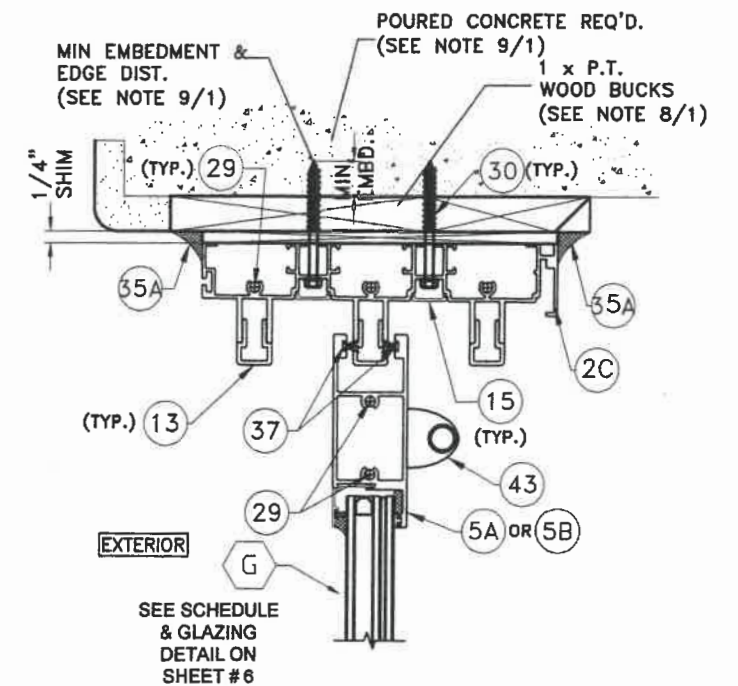


CONCRETE SUBSTRATE *
(3 TRACK HEAD)

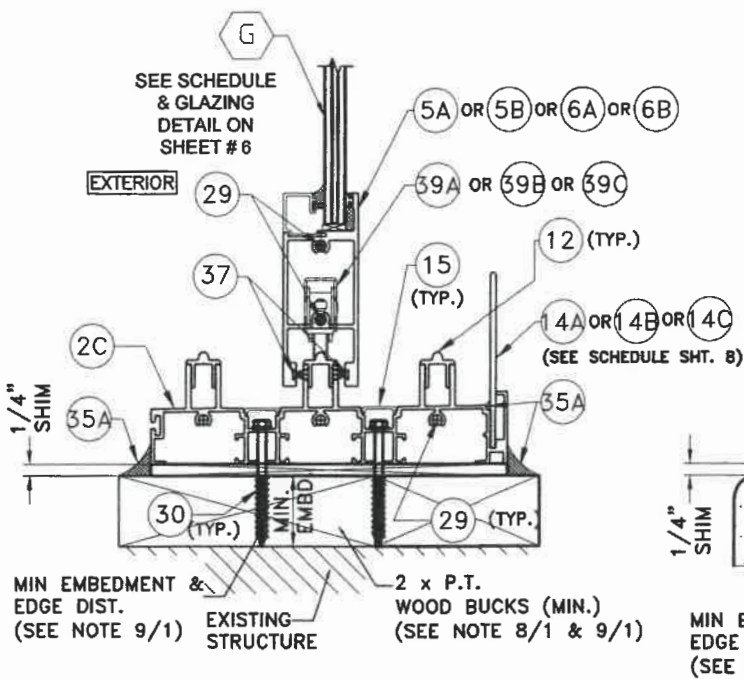


WOOD SUBSTRATE
(3 TRACK SILL)

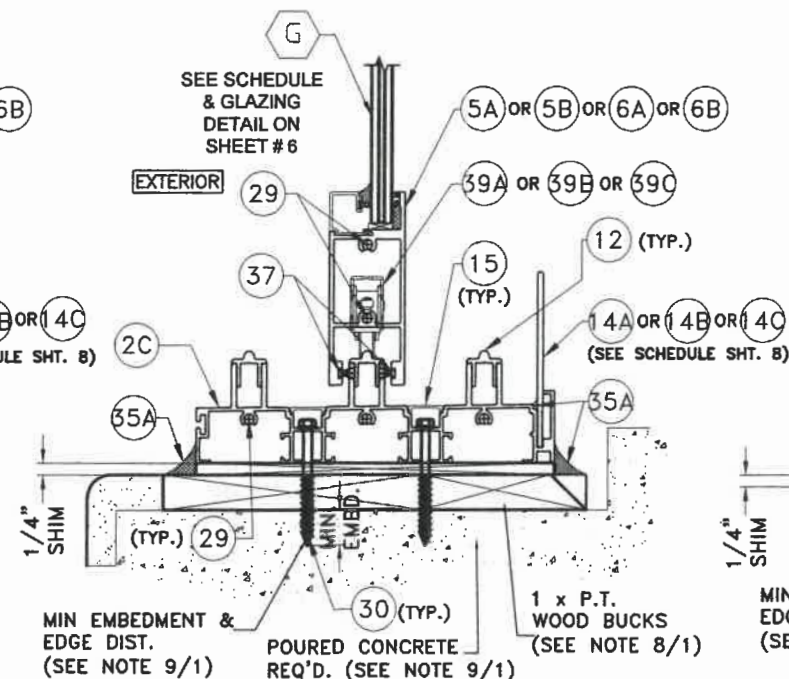

CONCRETE SUBSTRATE
(3 TRACK SILL)

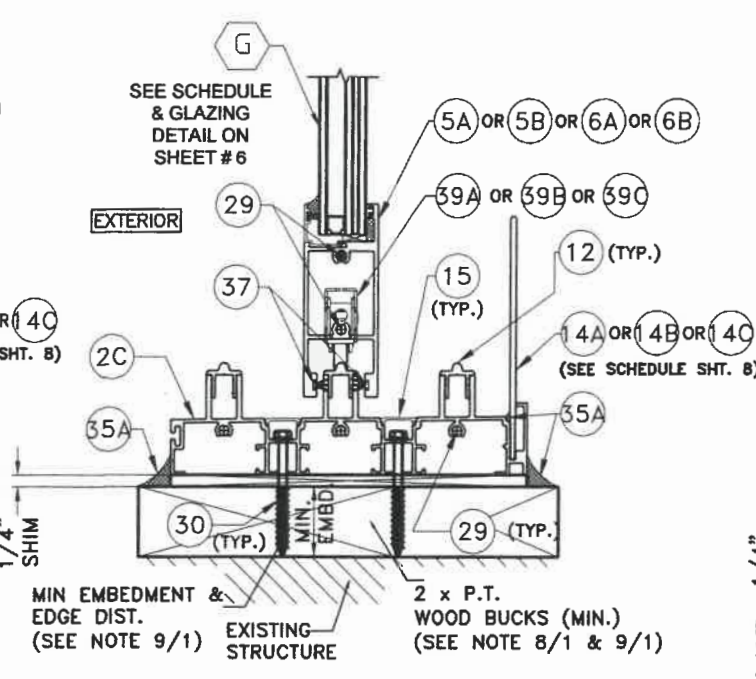

WOOD SUBSTRATE
(3 TRACK SILL)

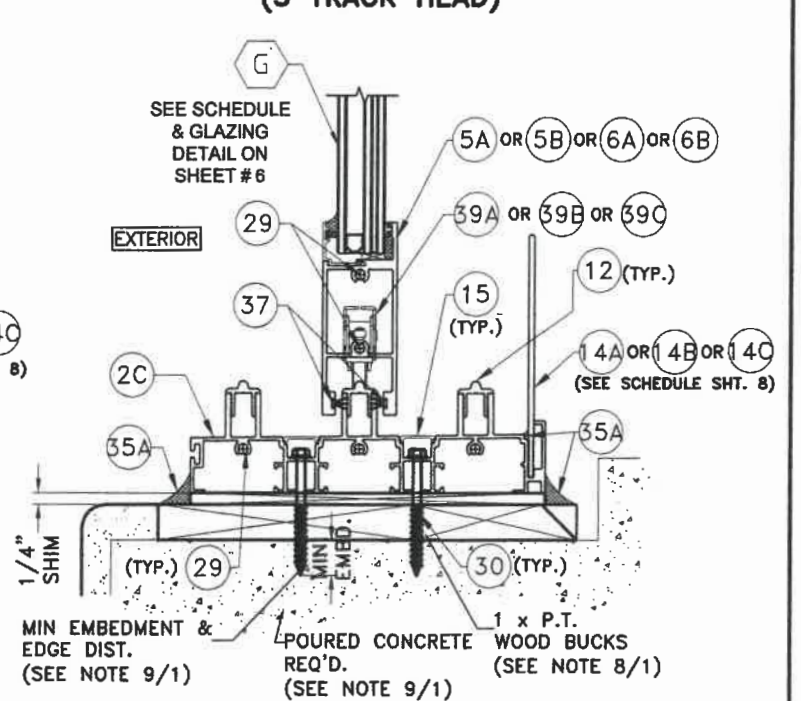

CONCRETE SUBSTRATE
(3 TRACK SILL)

SECTIONS B'-B'
W/INSULATED GLASS
3 TRACK **

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

NOTE 1: FOR MAXIMUM FRAME, PANEL & DLO LIMITATIONS SEE SCHEDULE ON SHEET 8 & ANCHOR SPACING SEE SCHEDULE ON SHEET 24


NOTE 2: SUBSTRATE CAN BE COMBINED AS APPLICABLE

NOTE 3: GLASS TYPE CAN BE LAMINATED OR INSULATED SEE SCHEDULE FOR LIMITATIONS ON SHEET 6

SECTIONS B'-B'
W/LAMINATED GLASS
3 TRACK **


**** SEE Δ NOTE ON SHEET 9 FOR LIMITATIONS W/ (2C)**

*** SEE SHEET 20B FOR HEADER CONNECTION W/ METAL**

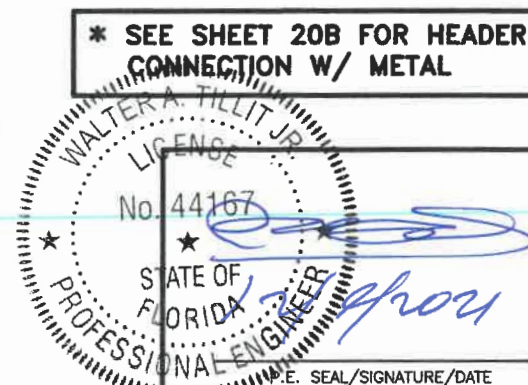


© 2021 TILTECO INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone: (305) 871-1530 Fax: (305) 871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT JR., P.E.
FLORIDA Lic. 44167


SERIES 26000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE			M.P. DRAWN BY:		
			8/5/2021 DATE		
			21-114 DRAWING No		
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-275	8/6/21	2	-	-

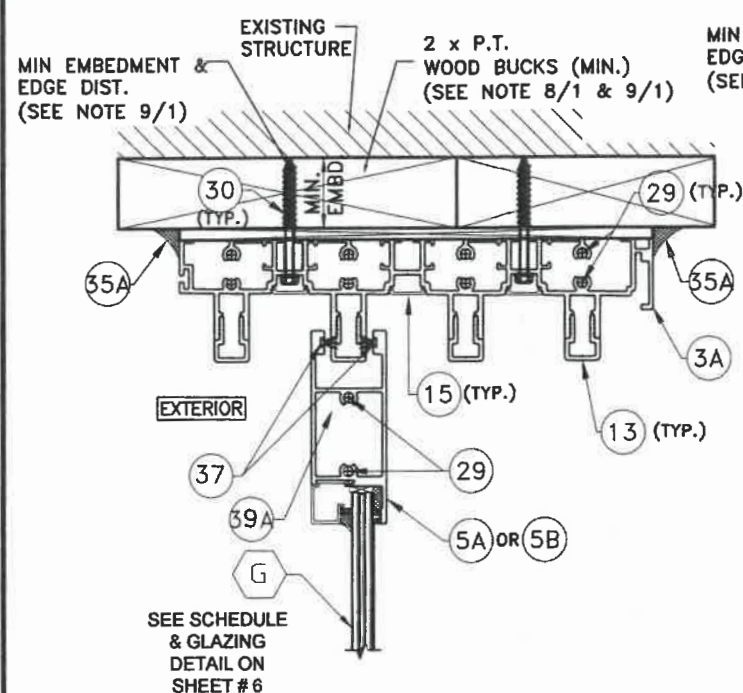


**WOOD SUBSTRATE *
(4 TRACK HEAD)**

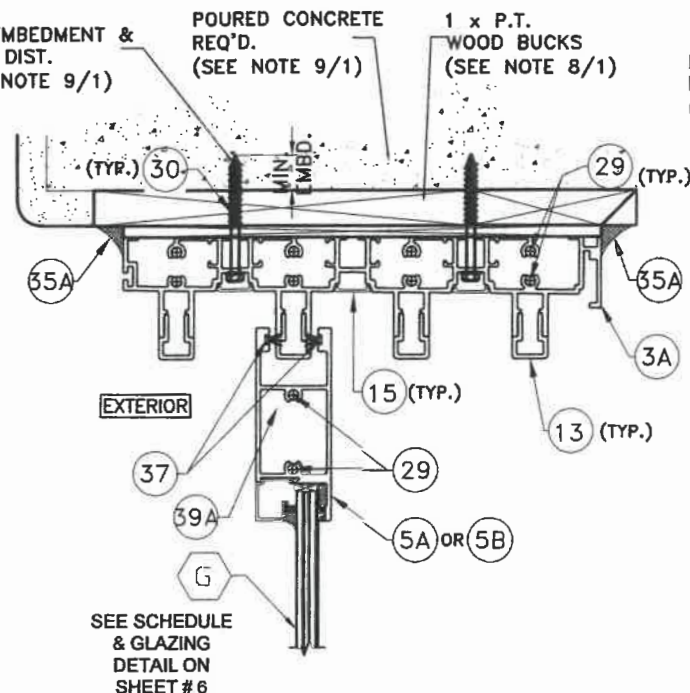


**CONCRETE SUBSTRATE *
(4 TRACK HEAD)**

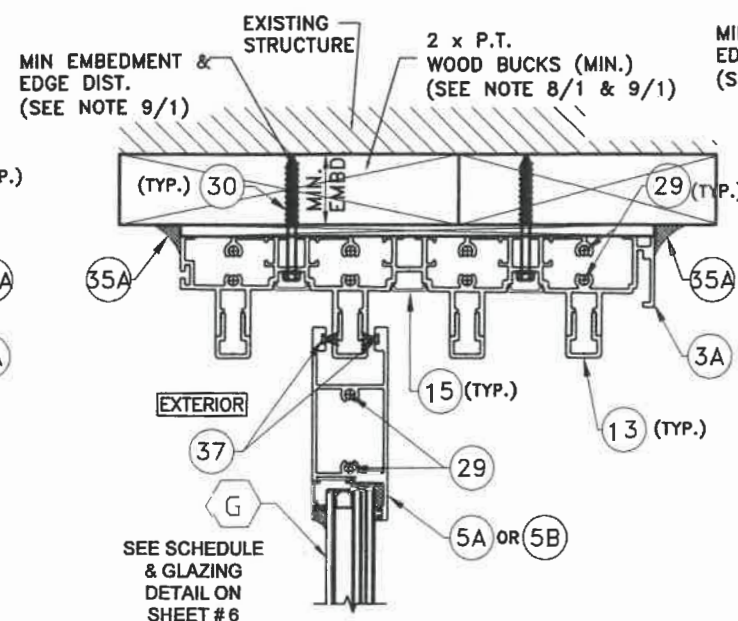


**WOOD SUBSTRATE *
(4 TRACK HEAD)**

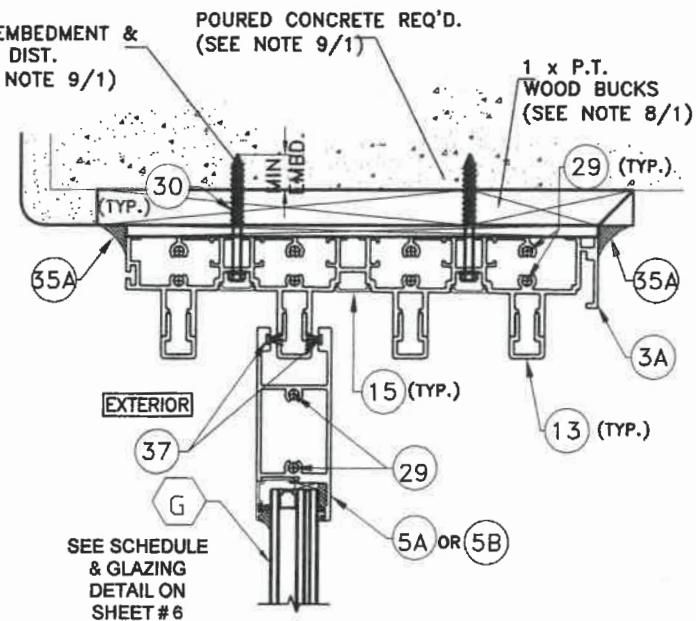


**CONCRETE SUBSTRATE *
(4 TRACK HEAD)**

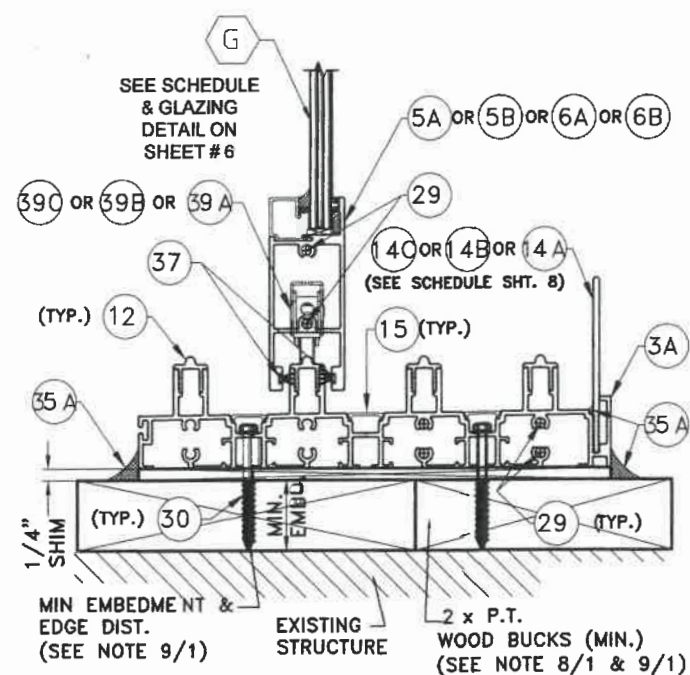


**WOOD SUBSTRATE
(4 TRACK SILL)**

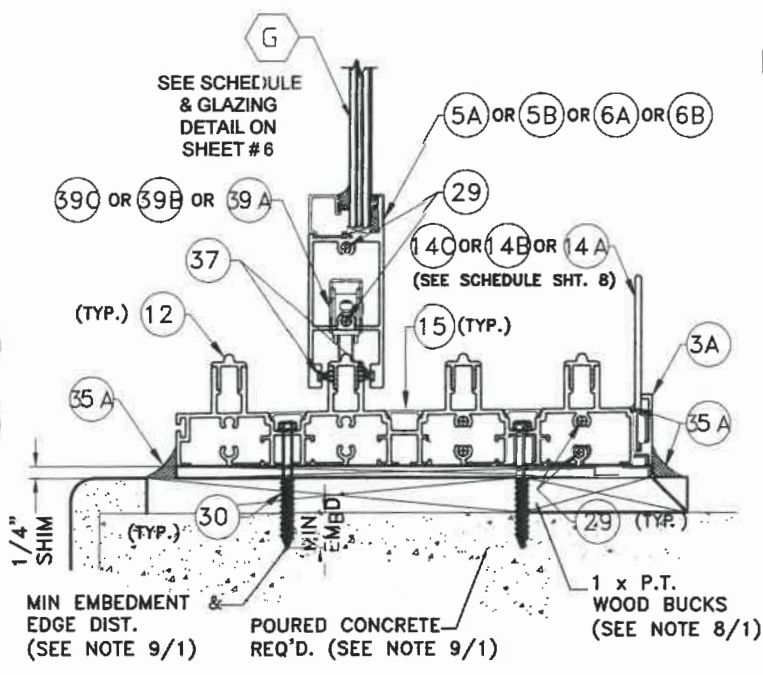

**CONCRETE SUBSTRATE
(4 TRACK SILL)**

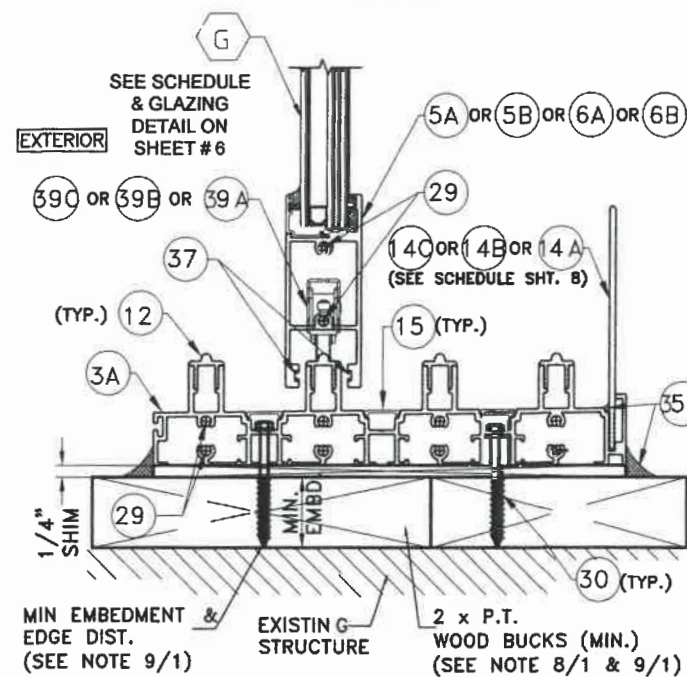

**WOOD SUBSTRATE
(4 TRACK SILL)**

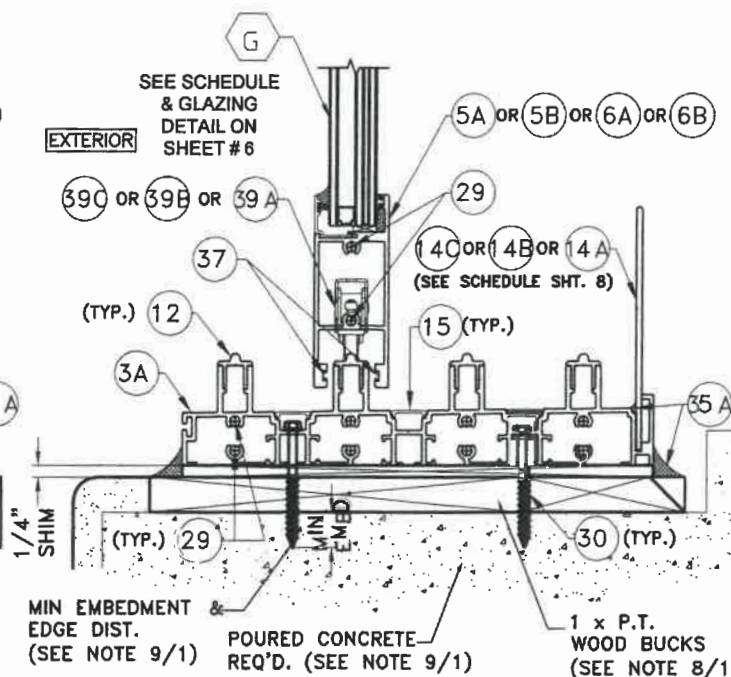

**CONCRETE SUBSTRATE
(4 TRACK SILL)**

**SECTIONS C-C
W/INSULATED GLASS
4 TRACK**

N.T.S.

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

- NOTE 1:** FOR MAXIMUM FRAME, PANEL & DLO LIMITATIONS SEE SCHEDULE ON SHEET 8 & ANCHOR SPACING SEE SCHEDULE ON SHEET 24
- NOTE 2:** SUBSTRATE CAN BE COMBINED AS APPLICABLE
- NOTE 3:** GLASS TYPE CAN BE LAMINATED OR INSULATED SEE SCHEDULE FOR LIMITATIONS ON SHEET 6

**SECTIONS C-C
W/LAMINATED GLASS
4 TRACK**

N.T.S.

*** SEE SHEET 20B FOR
HEADER CONNECTION W/METAL**



P.E. SEAL/SIGNATURE/DATE

© 2021 TILTECO INC.

TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY

6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166

Phone : (305) 871-1530, Fax : (305) 871-1531


e-mail: tiltco@aol.com

CA-0006719


WALTER A. TILLIT JR., P.E.

FLORIDA Lic. 44167


SERIES 26000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE			M.P. DRAWN BY:		
 290 WEST 78 ROAD HIALEAH, FL. 33014 PHONE: (305) 558-8103 FAX: (305) 558-6665 www.generalimpact.com			8/5/2021 DATE		
			21-114 DRAWING No		
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-275	8/6/21	2	-	-

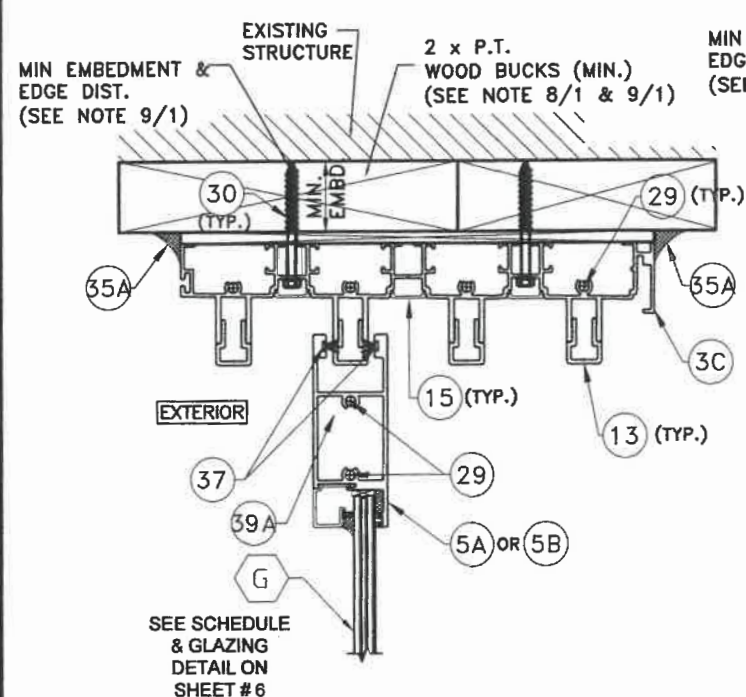


WOOD SUBSTRATE *
(4 TRACK HEAD)

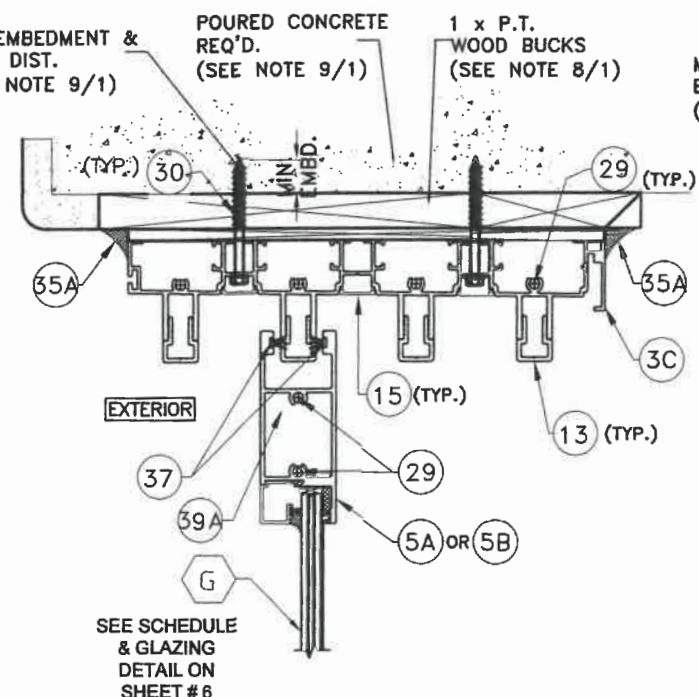


CONCRETE SUBSTRATE *
(4 TRACK HEAD)

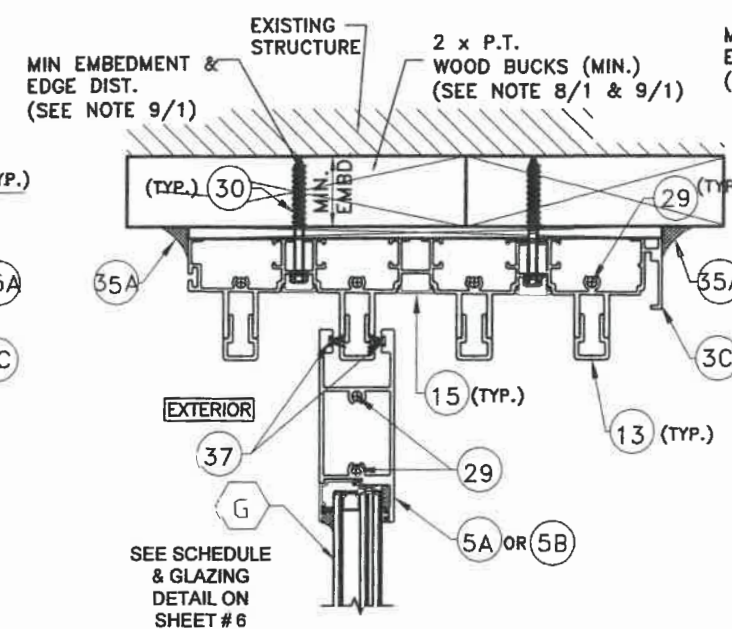


WOOD SUBSTRATE *
(4 TRACK HEAD)

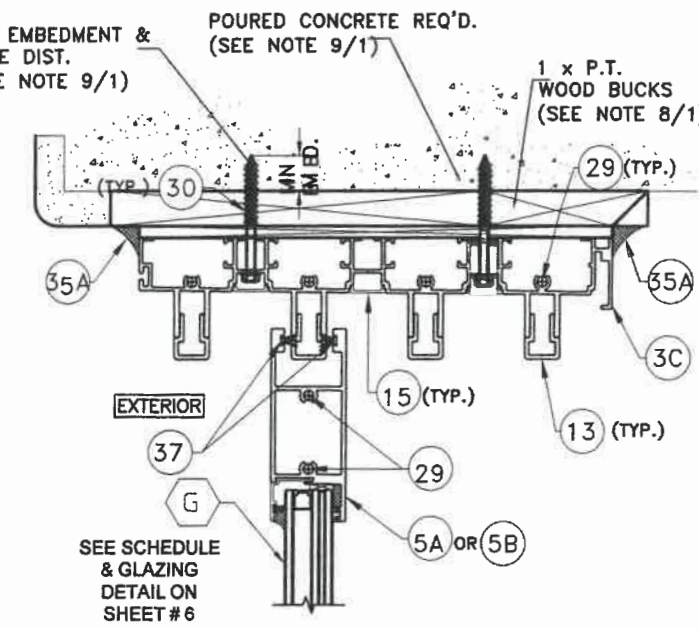


CONCRETE SUBSTRATE *
(4 TRACK HEAD)

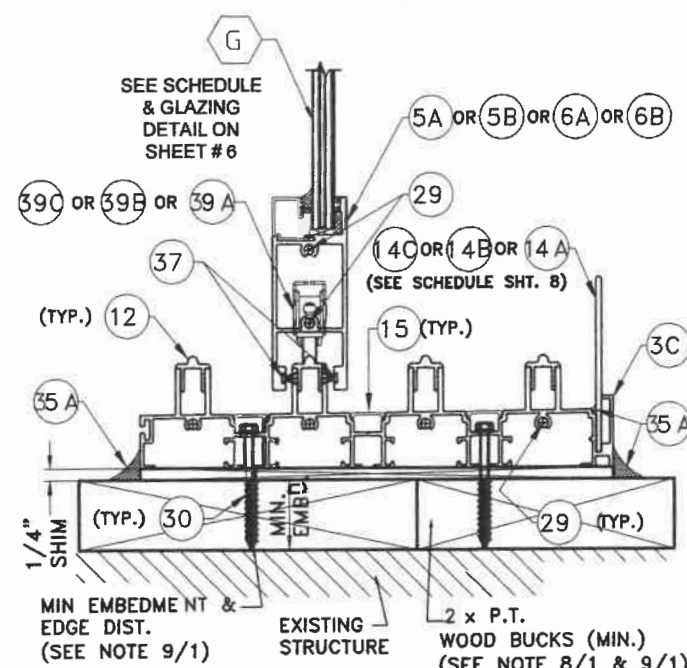


WOOD SUBSTRATE
(4 TRACK SILL)

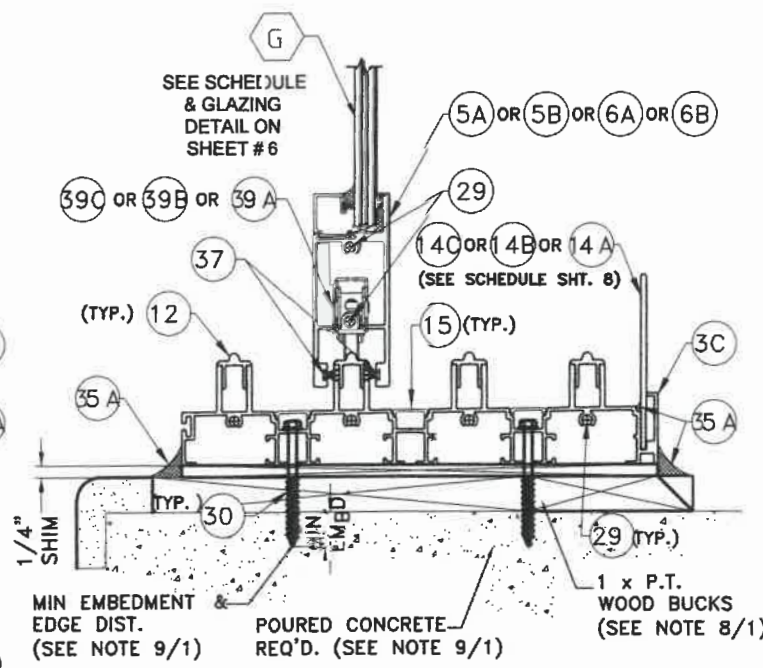

CONCRETE SUBSTRATE
(4 TRACK SILL)

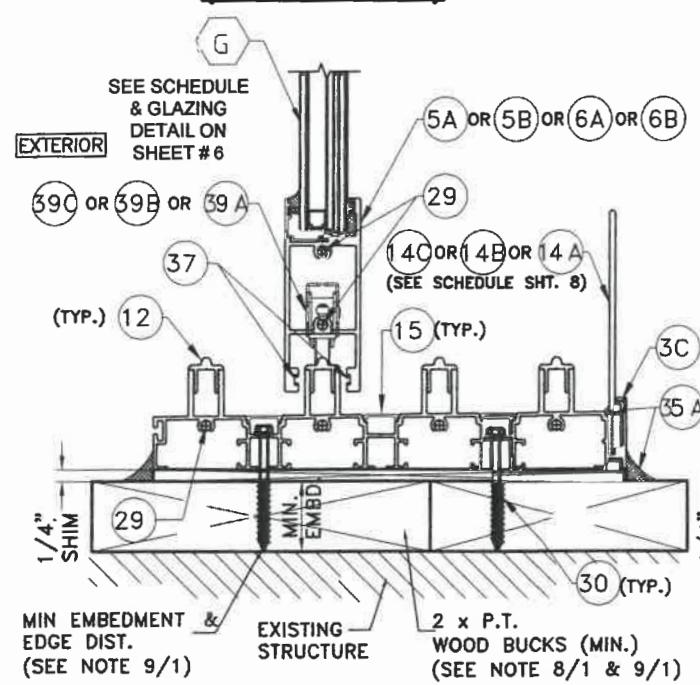

WOOD SUBSTRATE
(4 TRACK SILL)

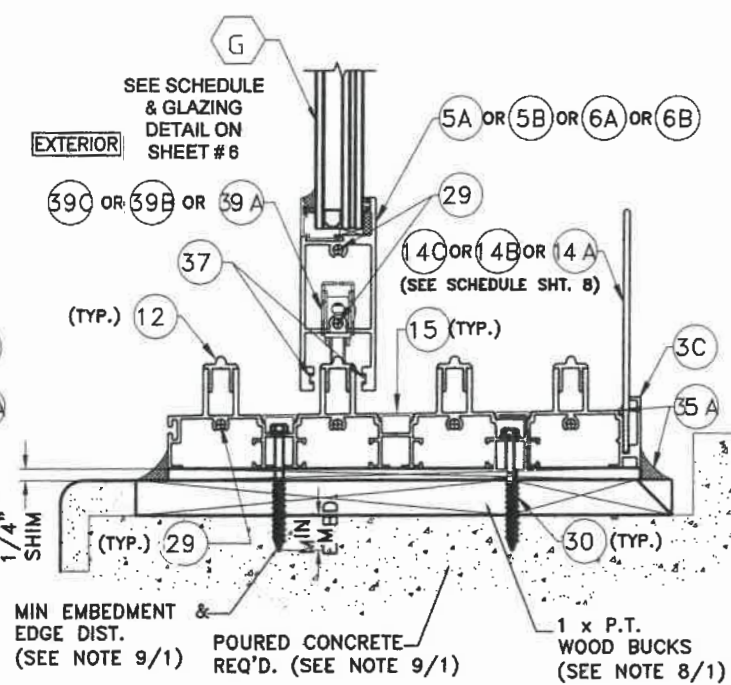

CONCRETE SUBSTRATE
(4 TRACK SILL)

SECTIONS C'-C'
W/ INSULATED GLASS
4 TRACK **

N.T.S.
FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

NOTE 1: FOR MAXIMUM FRAME, PANEL & DLO LIMITATIONS SEE SCHEDULE ON SHEET 8 & ANCHOR SPACING SEE SCHEDULE ON SHEET 24

NOTE 2: SUBSTRATE CAN BE COMBINED AS APPLICABLE

NOTE 3: GLASS TYPE CAN BE LAMINATED OR INSULATED SEE SCHEDULE FOR LIMITATIONS ON SHEET 6

SECTIONS C'-C'
W/ LAMINATED GLASS
4 TRACK **


**** SEE Δ NOTE ON SHEET 9 FOR LIMITATIONS W/ 3C**

*** SEE SHEET 20B FOR HEADER CONNECTION W/ METAL**

WALTER A. TILLIT, Jr., P.E.
FLORIDA Lic. 44167
PROFESSIONAL ENGINEER
SEAL/SIGNATURE/DATE

© 2021 TILTECO INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6305 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone: (305) 871-1530 • Fax: (305) 871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT, Jr., P.E.
FLORIDA Lic. 44167

SERIES 26000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE			M.P. DRAWN BY:		
			8/5/2021 DATE		
			21-114 DRAWING No		
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	CILD 26-275	8/5/21	2	-	-

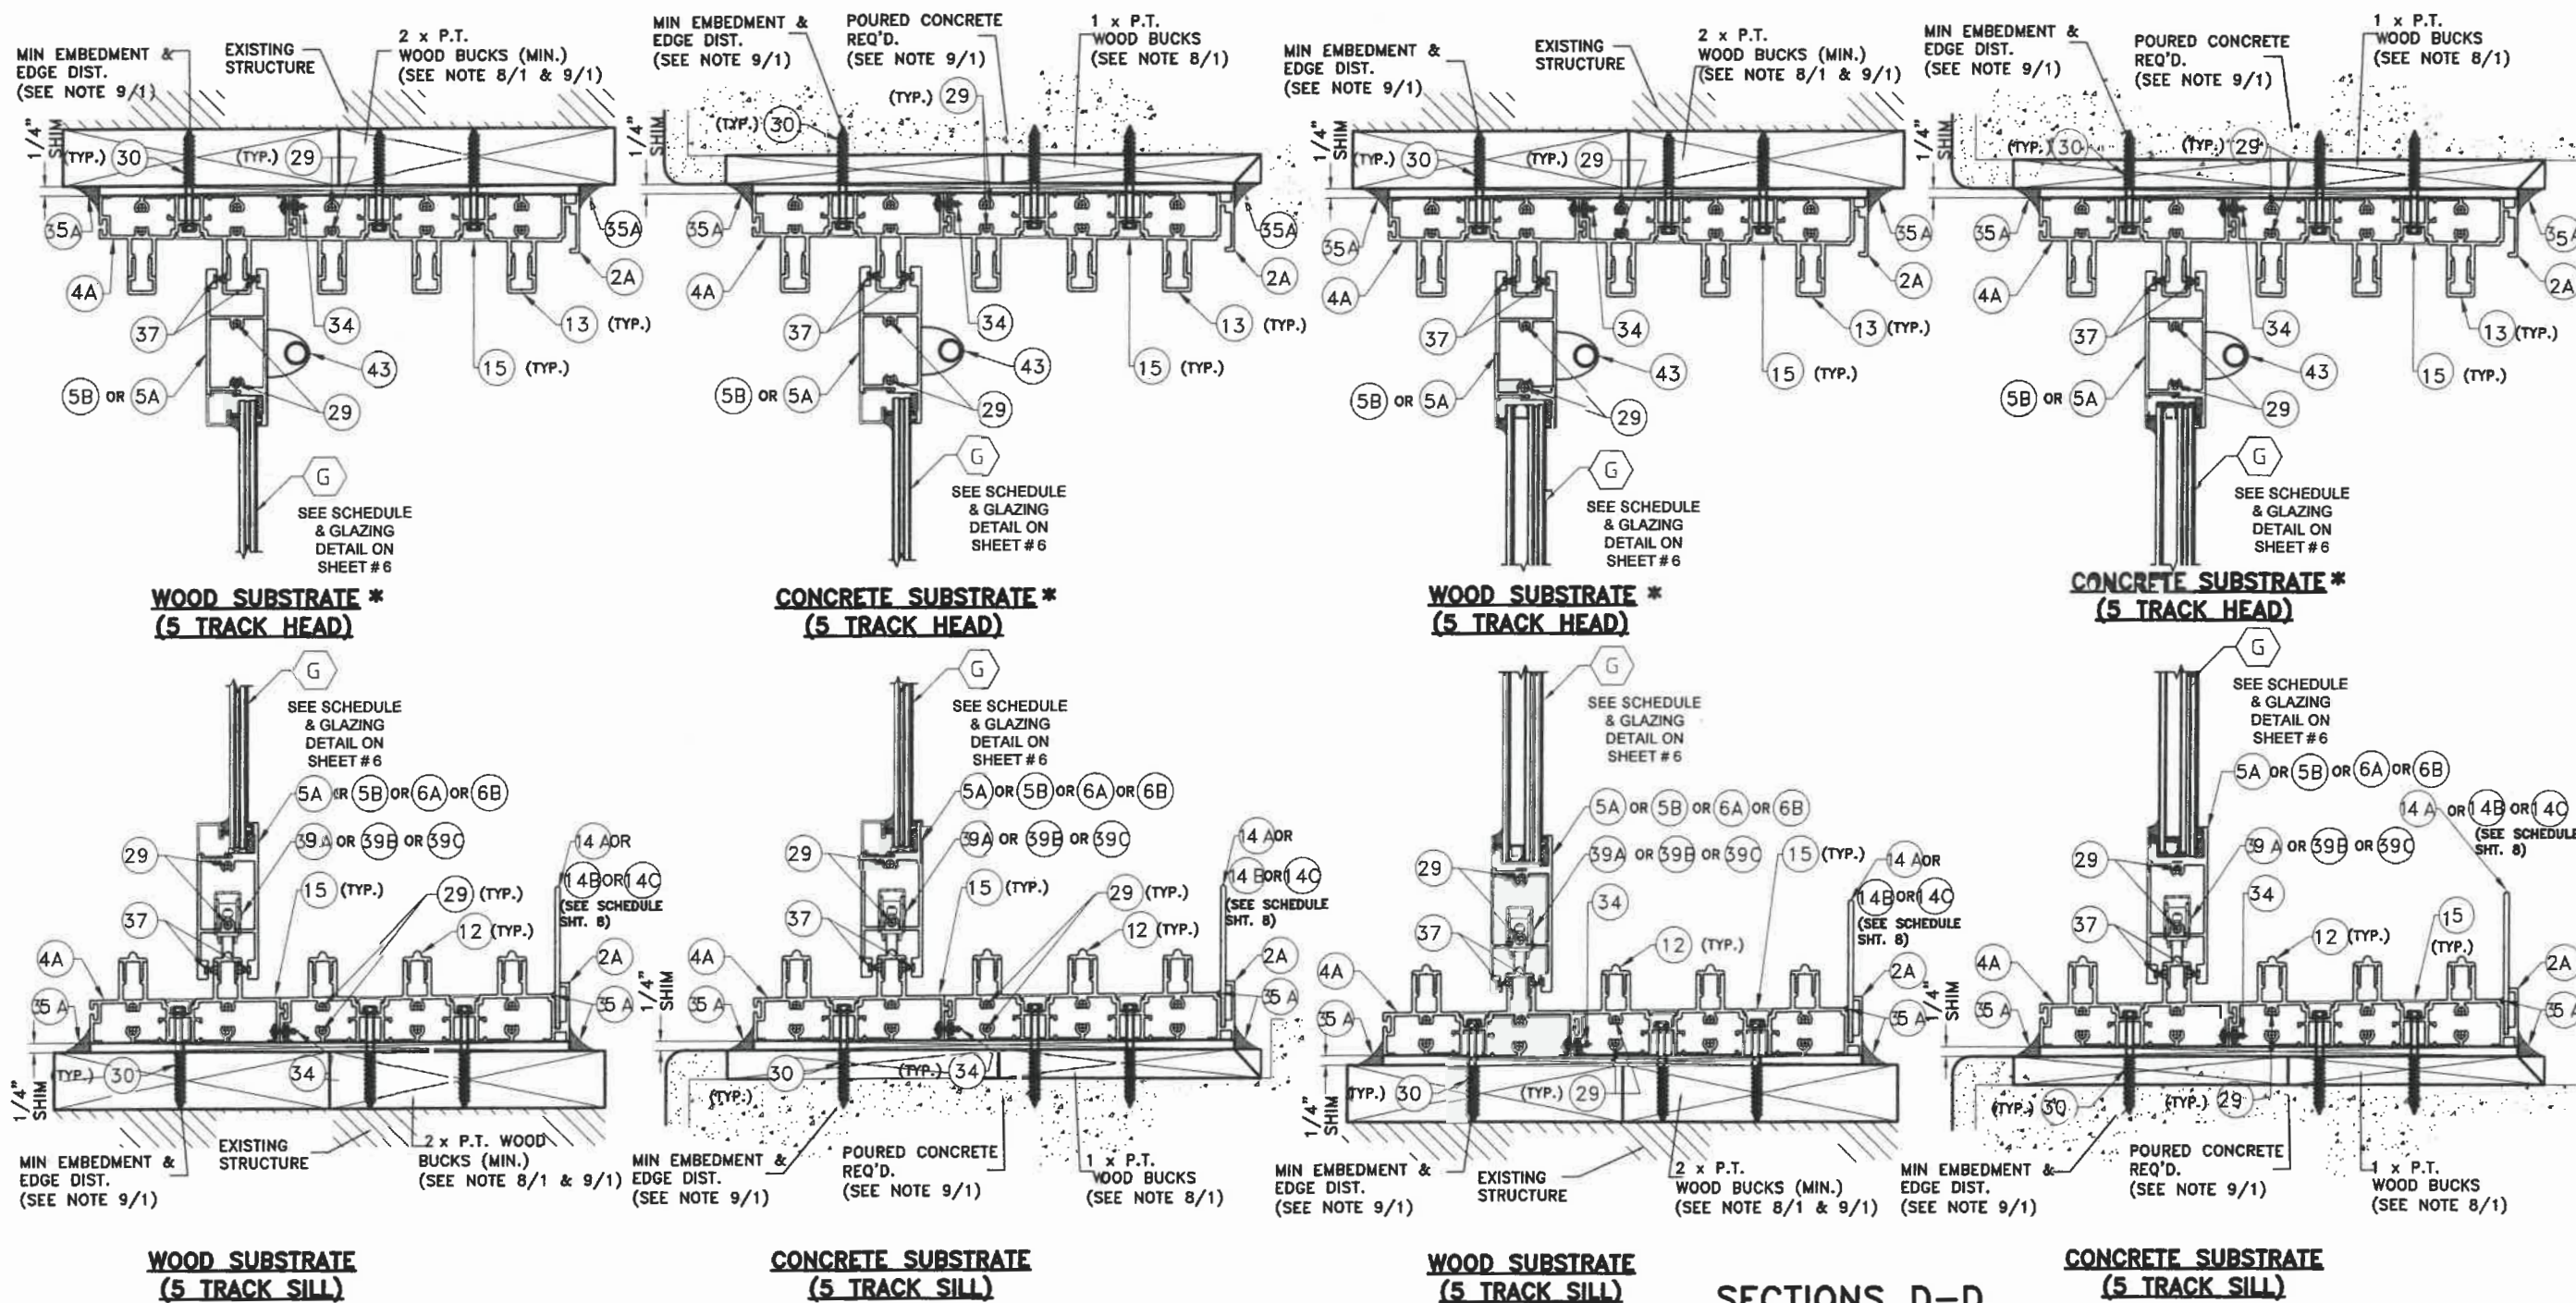

NOTE 1: FOR MAXIMUM FRAME, PANEL & DLO LIMITATIONS SEE SCHEDULE ON SHEET 8 & ANCHOR SPACING SEE SCHEDULE ON SHEET 24


NOTE 2: SUBSTRATE CAN BE COMBINED AS APPLICABLE

NOTE 3: GLASS TYPE CAN BE LAMINATED OR INSULATED SEE SCHEDULE FOR LIMITATIONS ON SHEET 6

SECTIONS D-D W/LAMINATED GLASS (5 TRACK)

N.T.S.

* SEE SHEET 20B FOR
HEADER CONNECTION W/METAL

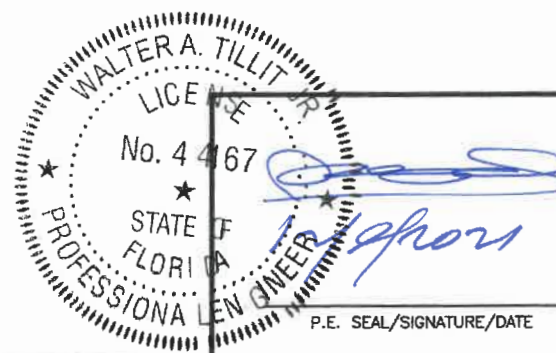

P.E. SEAL/SIGNATURE/DATE

SECTIONS D-D W/INSULATED GLASS (5 TRACK)

N.T.S.

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

© 2021 TILTECO INC.

TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY

6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166

Phone: (305) 871-1530 Fax: (305) 871-1531


e-mail: tilliteco@aol.com

CA-0006719

WALTER A. TILLIT JR., P.E.

FLORIDA Lic. 44167


SERIES 26000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE			M.P. DRAWN BY:		
GENERAL IMPACT GLASS & WINDOWS			290 WEST 78 ROAD HIALEAH, FL. 33014		
			PHONE: (305) 558-8103 FAX: (305) 558-6665 www.generalimpact.com		
REV.	NO.	DESCRIPTION	DATE	REV.	NO.
1	OLD 29-25		8/6/21	2	
			21-114 DRAWING No		
			SHEET 20 OF 26		




SHEET 20A OF 26

290 WEST 78 ROAD
HIALEAH, FL. 33014
PHONE: (305) 558-8103
FAX: (305) 558-6665
www.generalimpact.com


REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 25-275	12/1/00	2		

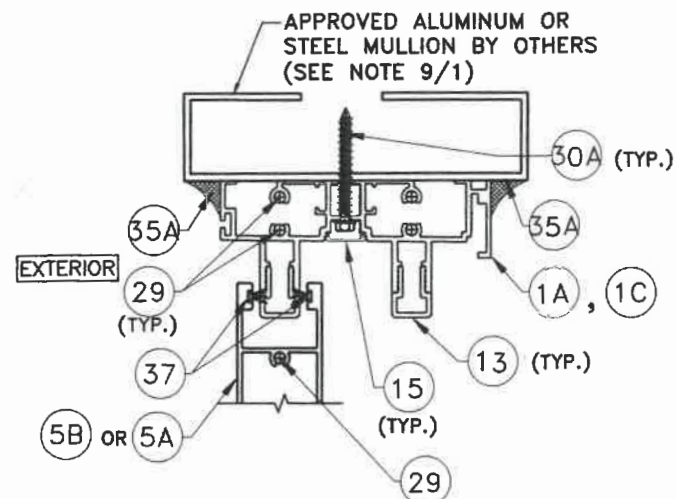


**ALUMINUM & STEEL
SUBSTRATE
(2 TRACK HEAD)**

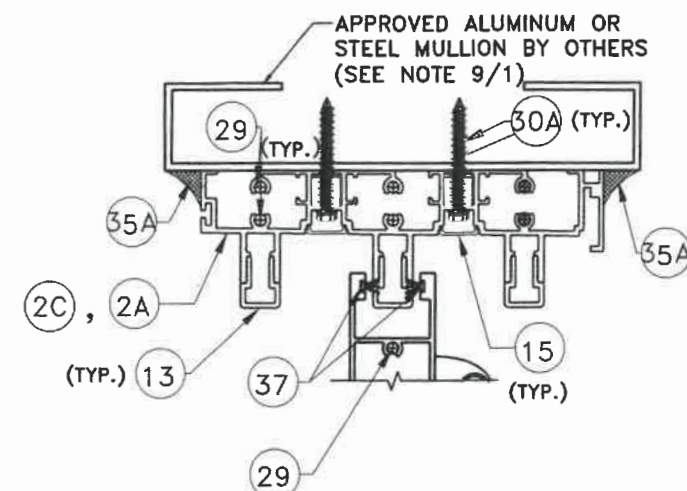

**ALUMINUM & STEEL
SUBSTRATE
(3 TRACK HEAD)**

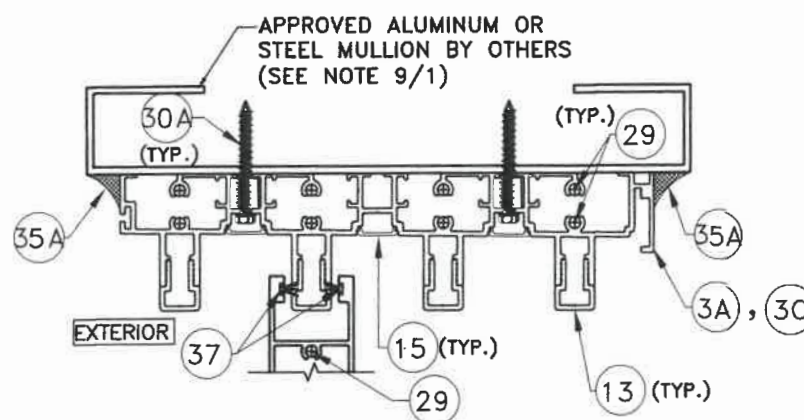


**ALUMINUM & STEEL
SUBSTRATE
(4 TRACK HEAD)**

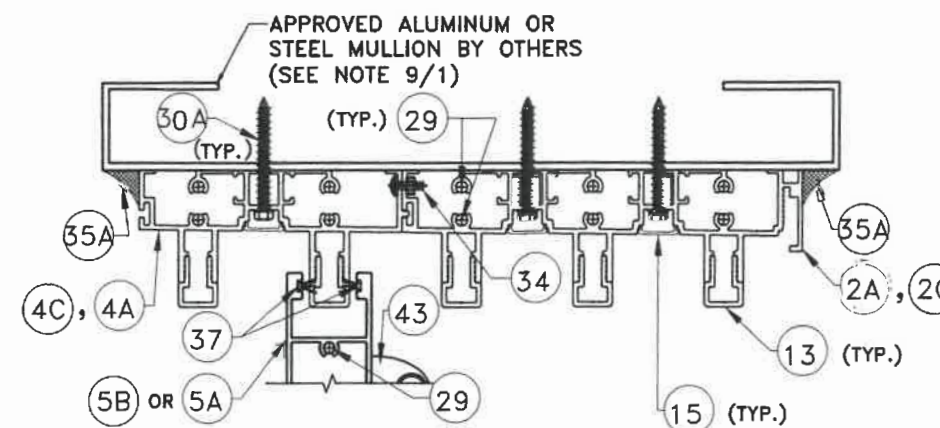

**ALUMINUM & STEEL
SUBSTRATE
(5 TRACK HEAD)**

SECTIONS A, A', B, B', C, C', D, D' AT HEADER
W/LAMINATED OR INSULATED GLASS
2, 3, 4 & 5 TRACK
TO METAL SUBSTRATE

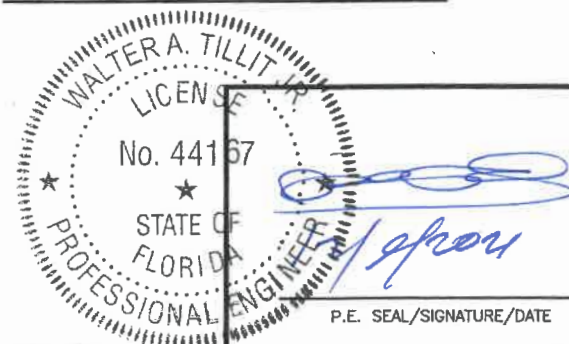


© 2021 TILTECO INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone: (305) 871-1530 • Fax: (305) 871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr., P.E.
FLORIDA Lic. 44167

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)


SERIES 26000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE			M.P. DRAWN BY:		
			8/5/2021 DATE		
			21-114 DRAWING No		
REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-275	8/6/21	2	-	-

SHEET 20B OF 26

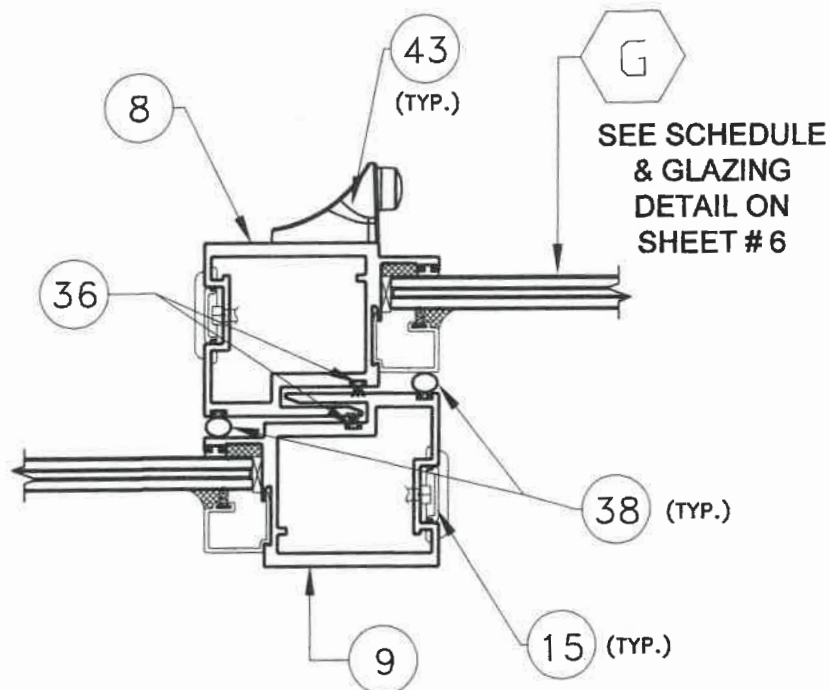


**UNREINFORCED MEETING STILES
W/LAMINATED GLASS**

N.T.S.

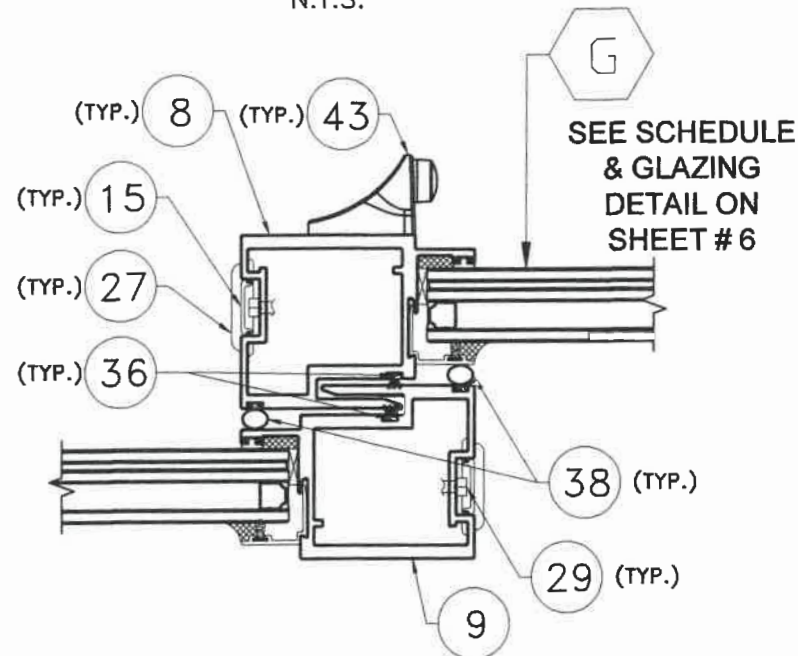


**UNREINFORCED MEETING STILES
W/INSULATED GLASS**

N.T.S.

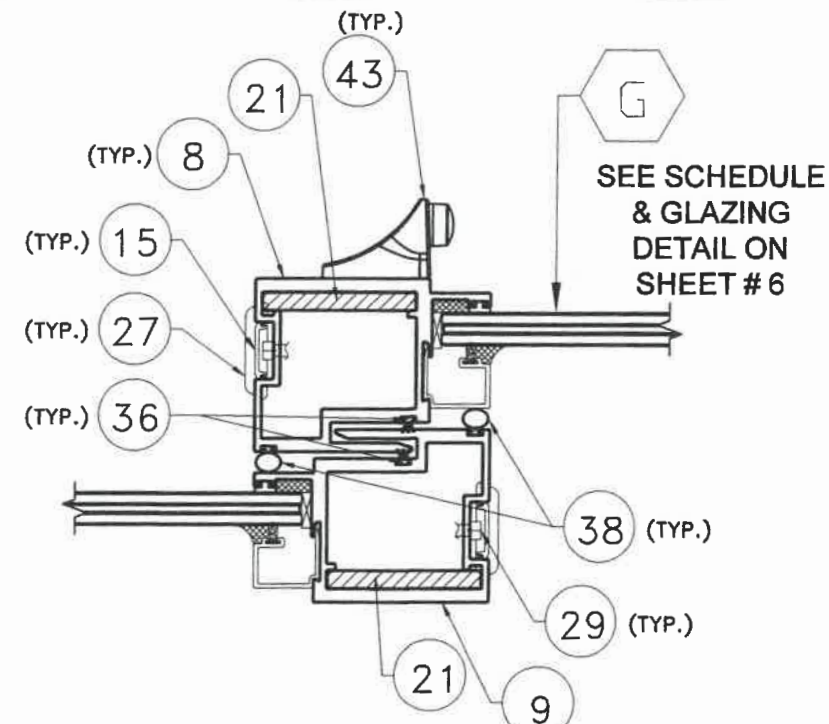

**REINFORCED MEETING STILES
W/LAMINATED GLASS**


N.T.S.

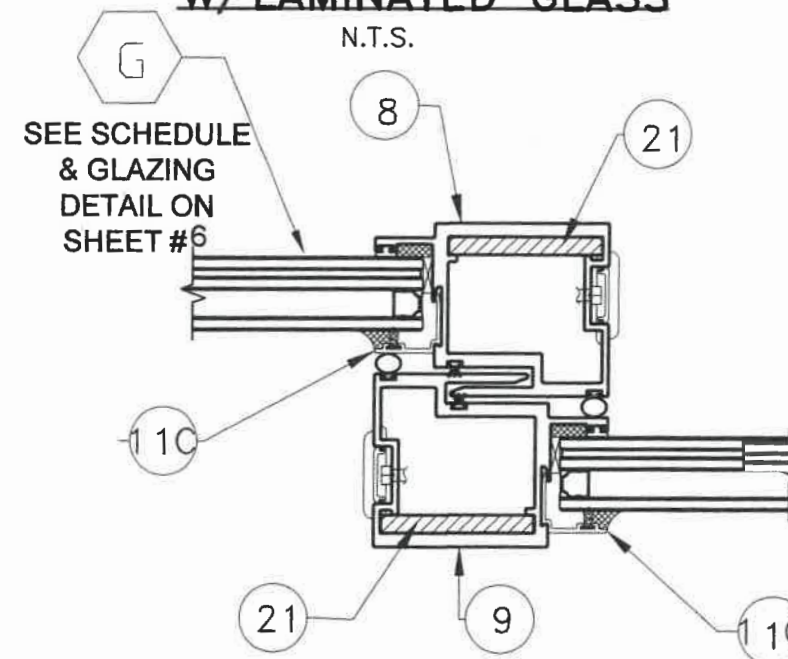

**REINFORCED MEETING STILES
W/INSULATED GLASS**

N.T.S.

SECTIONS K-K

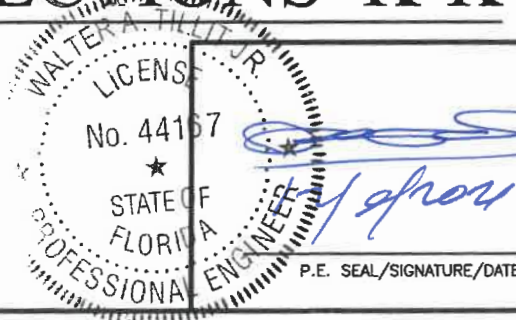

P.E. SEAL/SIGNATURE/DATE

© 2021 TILTECO INC.

TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tiltco@aol.com
CA-0006719
WALTER A. TILLIT Jr., P.E.
FLORIDA Lic. 44167

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

**SERIES 26000 HIGH IMPACT SLIDING
GLASS DOOR / LARGE AND SMALL MISSILE**



290 WEST 78 ROAD
HIALEAH, FL. 33014
PHONE: (305) 558-8103
FAX: (305) 558-6665
www.generalimpact.com


M.P.
DRAWN BY:

8/5/2021
DATE

21-114
DRAWING No


REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-275	8/6/21	2	-	-

SHEET 21 OF 26

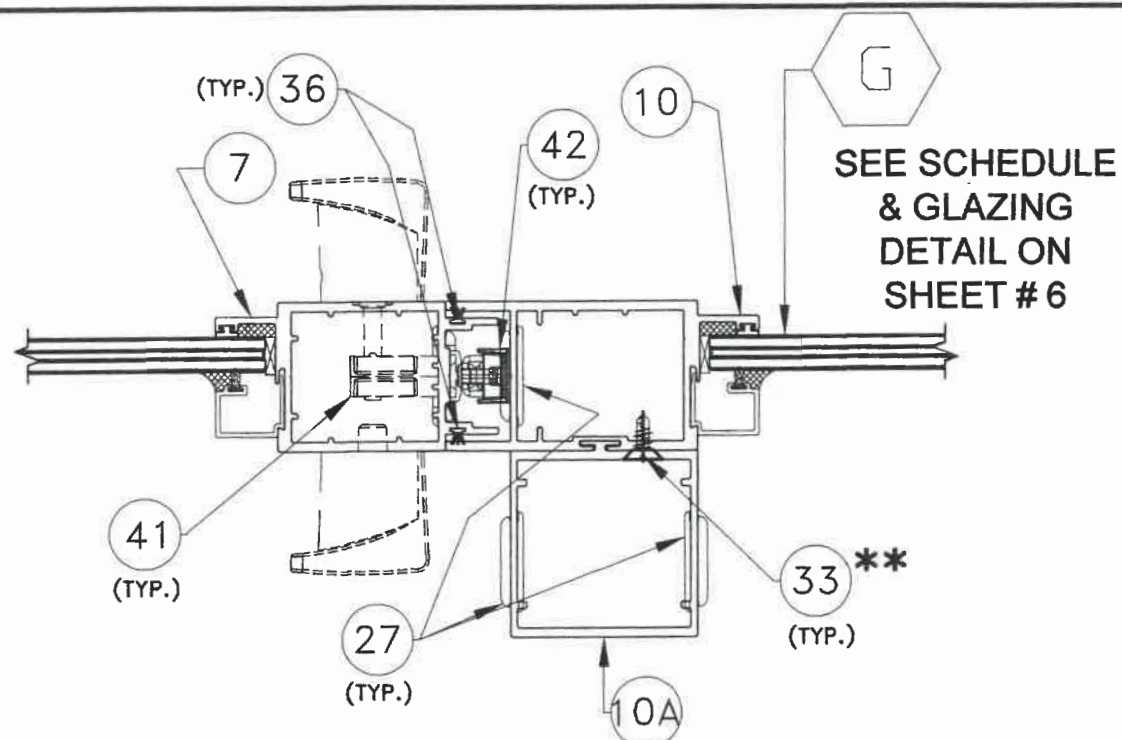

**UNREINFORCED DEEP ASTRAGAL
W/LAMINATED GLASS**


N.T.S.

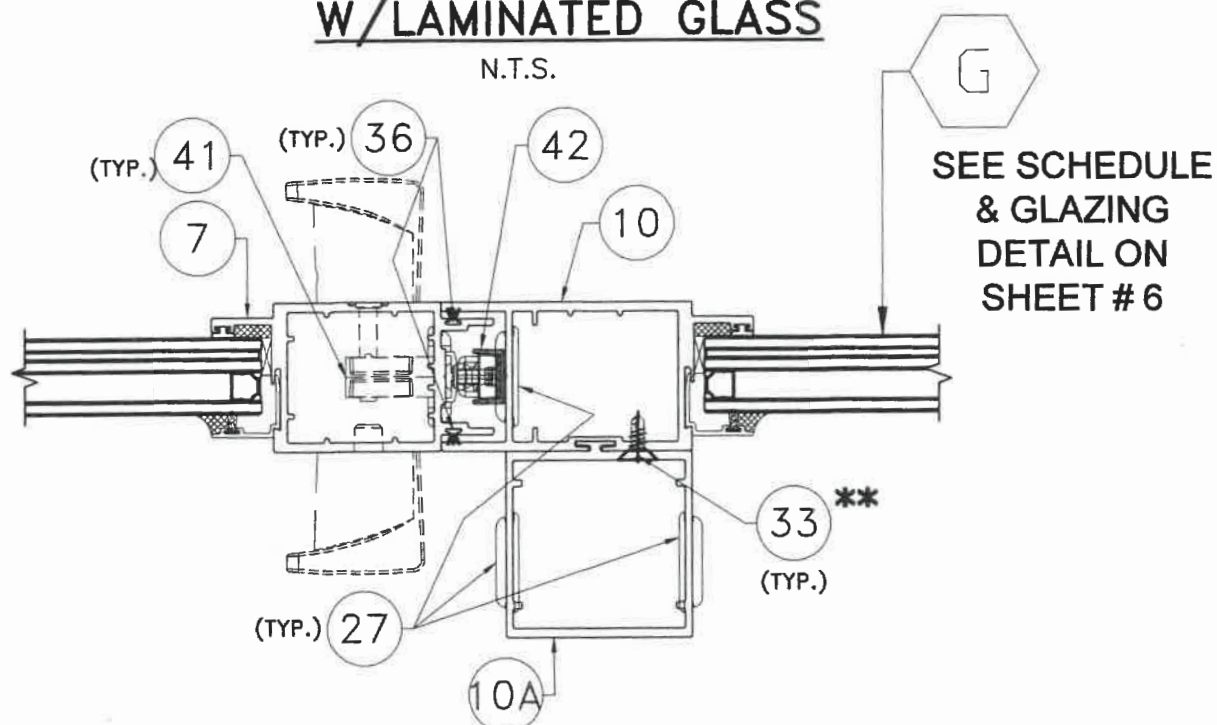

**UNREINFORCED DEEP ASTRAGAL
W/INSULATED GLASS**


N.T.S.

**** ASTRAGAL ASSEMBLY REQUIRES
COMPONENT 33 AT TOP & BOTTOM
AT 1" FROM EDGES**

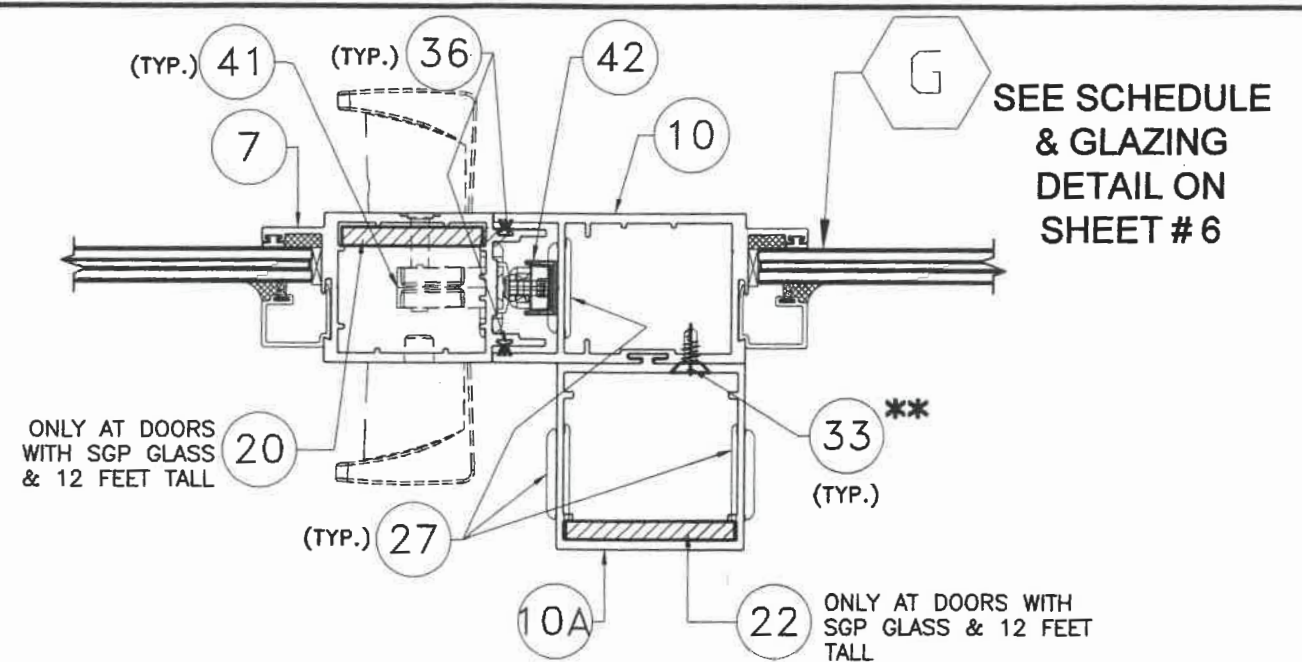

**REINFORCED DEEP ASTRAGAL
W/LAMINATED GLASS**

N.T.S.

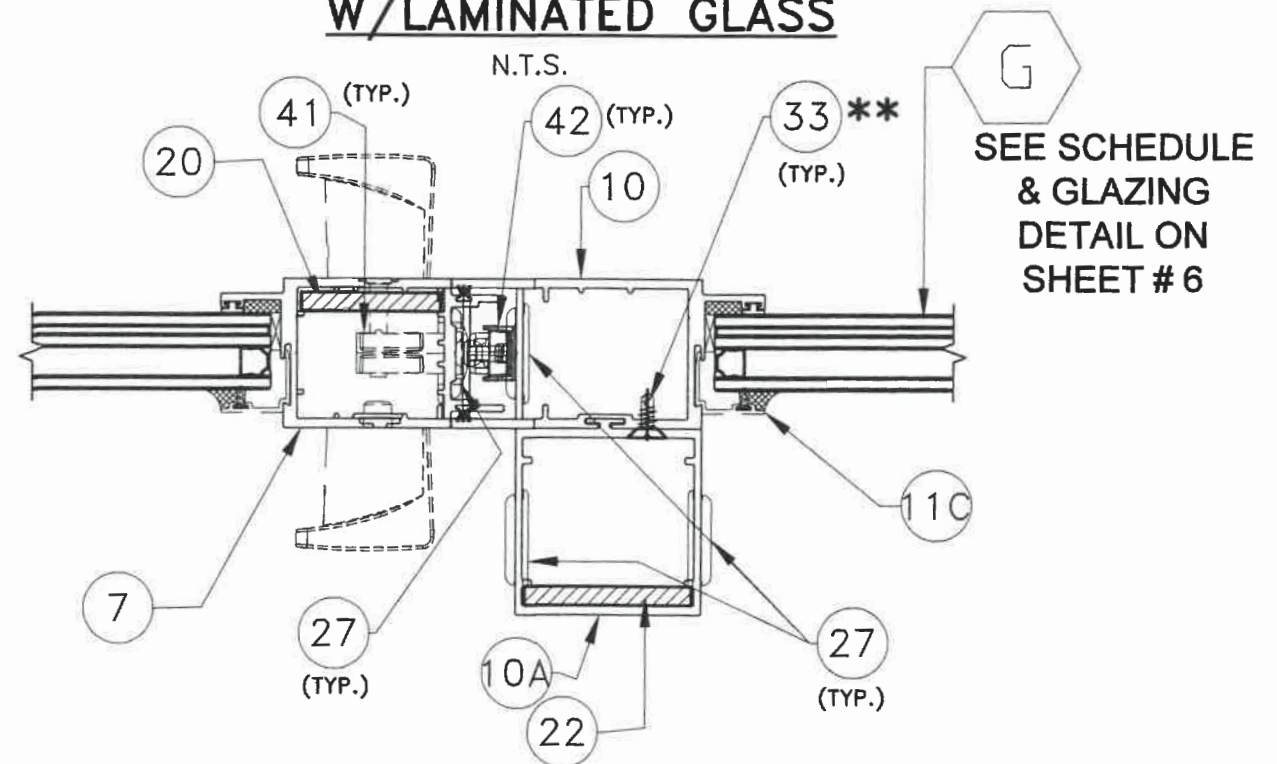


**REINFORCED DEEP ASTRAGAL
W/INSULATED GLASS**

N.T.S.


FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

SECTIONS L-L

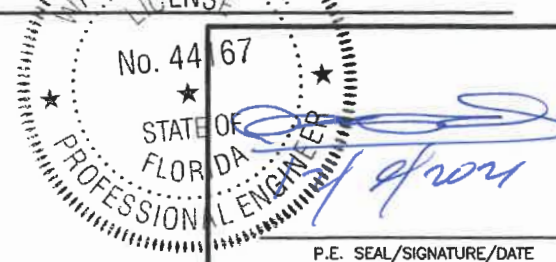


© 2021 TILTECO INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone: (305) 871-1530 Fax: (305) 871-1531
e-mail: tiltco@aol.com
CA-0006719
WALTER A. TILLIT Jr., P.E.
FLORIDA Lic. 44167

SERIES 26000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE					
290 WEST 78 ROAD HIALEAH, FL. 33014 PHONE: (305) 558-8103 FAX: (305) 558-6665 www.generalimpact.com					MLP DRAWN BY:
8/5/2021 DATE					21-114 DRAWING No
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-275	8/6/21	2	-	-

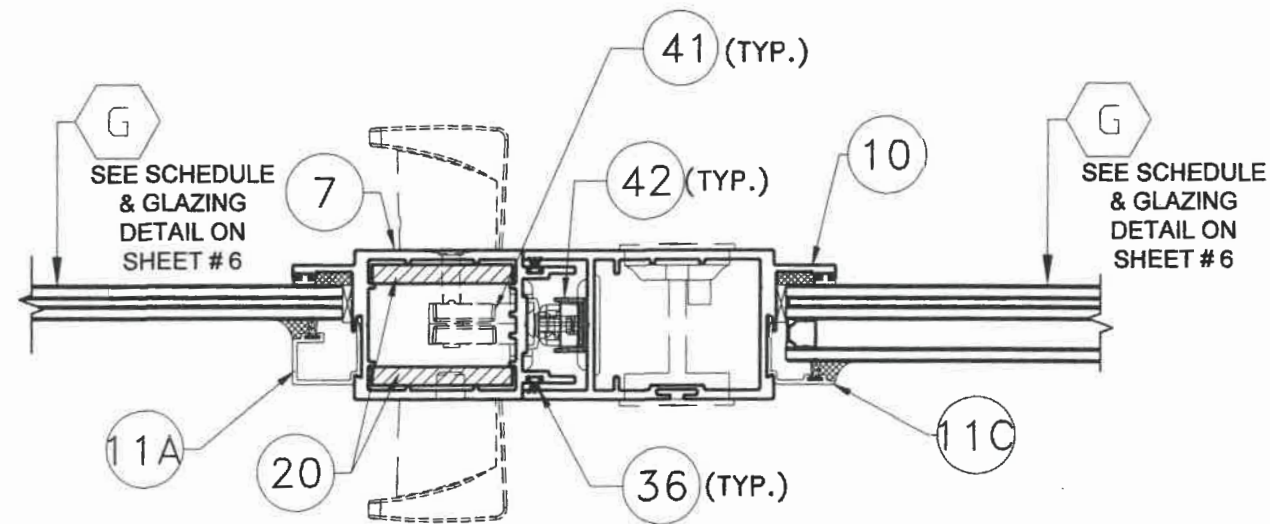

**"SHALLOW" ASTRAGAL
W/REINFORCEMENT (20)**
N.T.S.

SECTIONS M-M

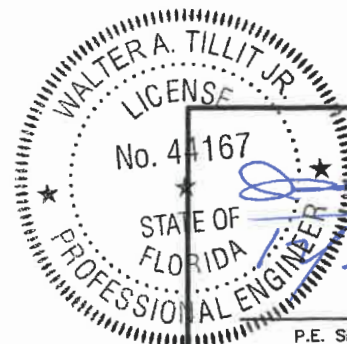

P.E. SEAL/SIGNATURE/DATE

© 2021 TILTECO INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305) 871-1530 • Fax : (305) 871-1531
e-mail: tilliteco@aol.com
CA-0006719
WALTER A. TILLIT JR., P.E.
FLORIDA Lic. 44167

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

**SERIES 26000 HIGH IMPACT SLIDING
GLASS DOOR / LARGE AND SMALL MISSILE**



290 WEST 78 ROAD
HIALEAH, FL. 33014
PHONE: (305) 558-8103
FAX: (305) 558-6665
www.generalimpact.com

M.P.
DRAWN BY:


8/5/2021
DATE

21-114
DRAWING No


REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-275	8/6/21	2	-	-

SHEET 23 OF 26

**REQUIRED CLUSTER OF ANCHORS (30) AT TOP & BOTTOM & (30A) (ONLY AT TOP) OF MEETING STILES AND ASTRAGAL
AT HEAD & SILL FOR ANY GIVEN A.S.D. DESIGN WIND LOAD AND ANY DOOR PANEL WIDTH AND
FRAME HEIGHT, GIVEN A 2, 3, 4, 5 TRACK DOOR TYPE AND SUBSTRATE TYPE
(LARGE & SMALL MISSILE DOORS) ***

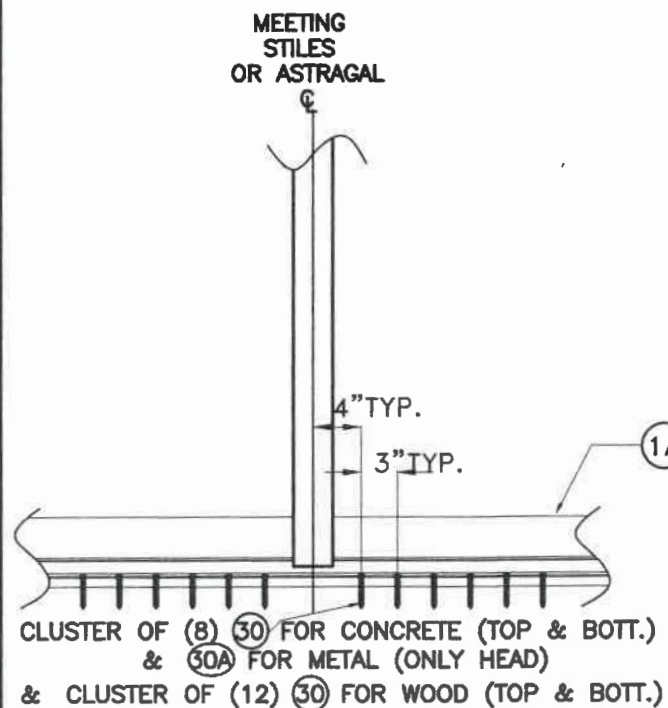


ELEVATION

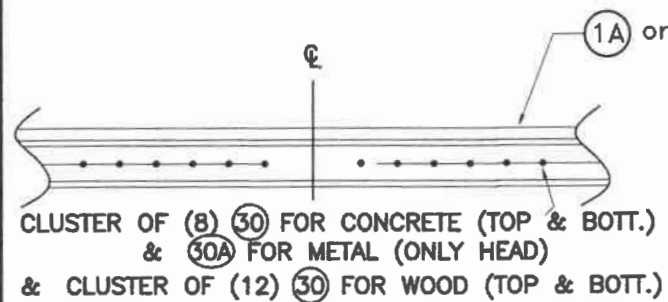


PLAN

2 TRACK DOOR

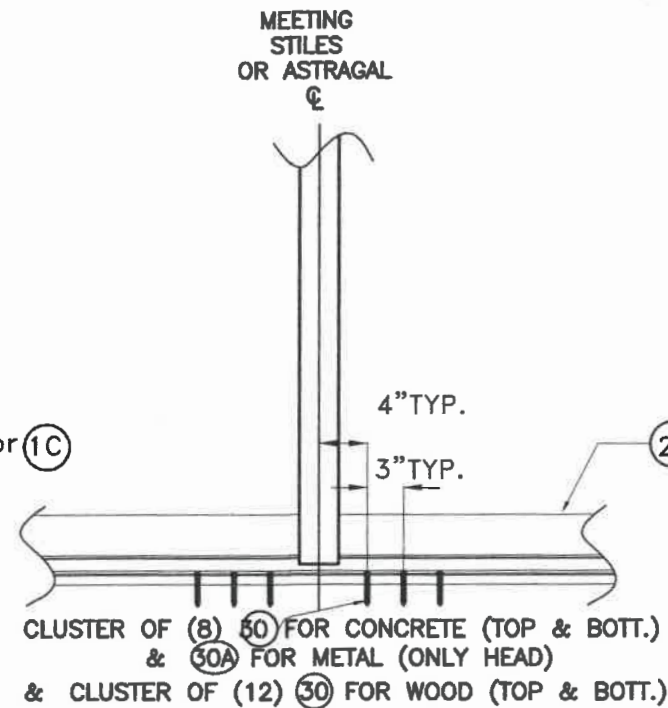


ELEVATION

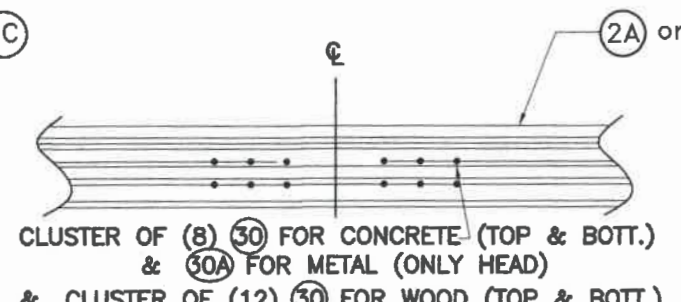


PLAN

3 TRACK DOOR

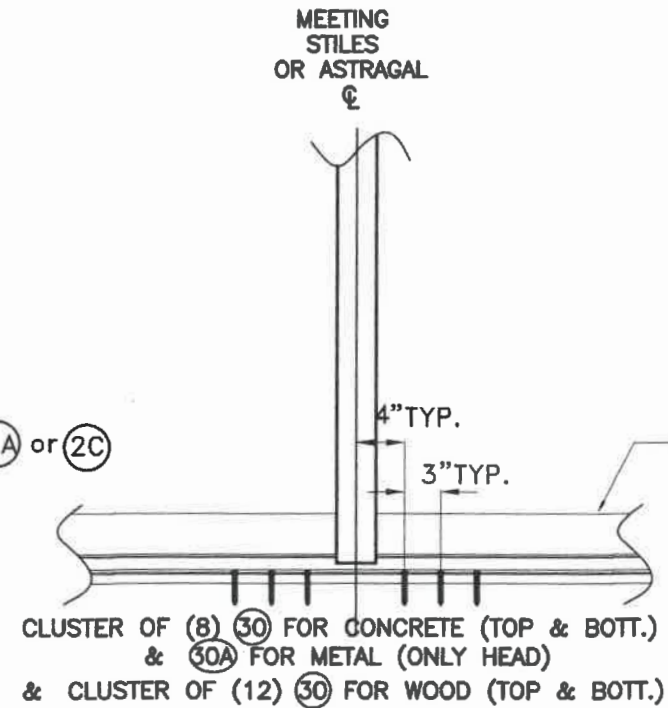


ELEVATION

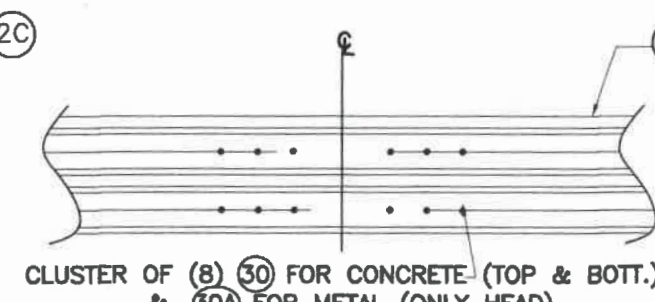


PLAN

4 TRACK DOOR

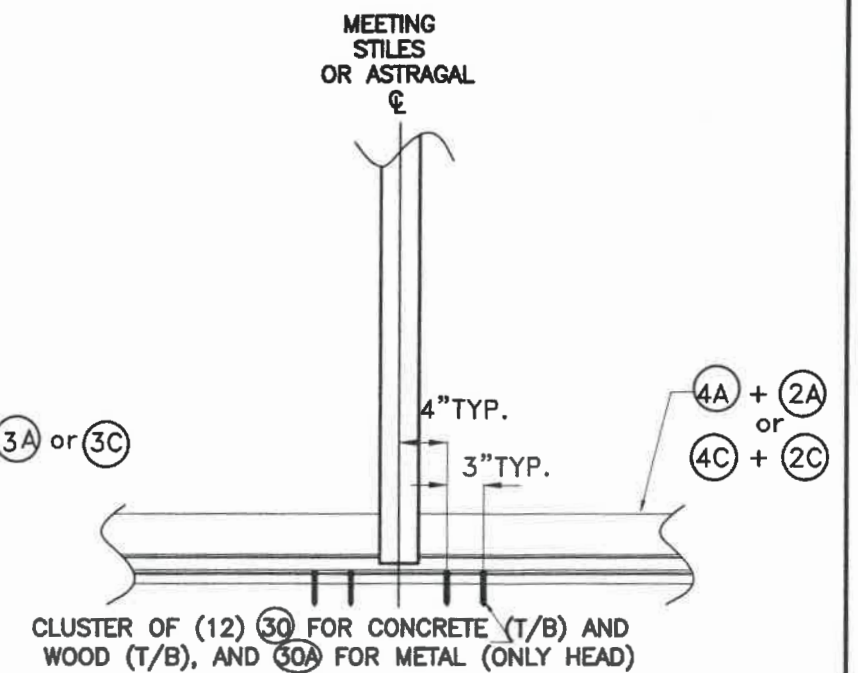

ELEVATION

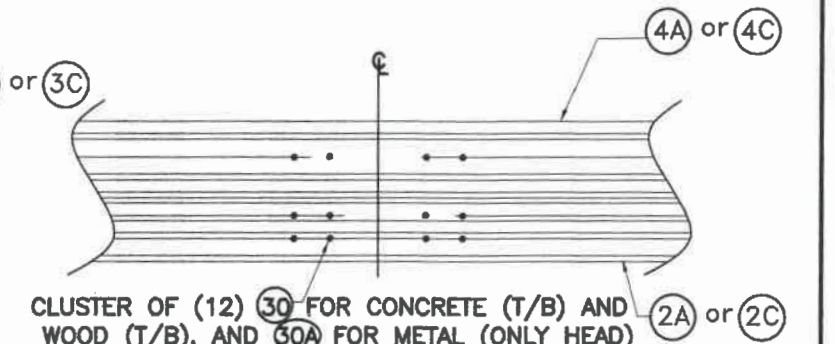

PLAN

5 TRACK DOOR

*** NOTE:**

- USE HALF OF TOTAL ANCHORS CLUSTER AT HEAD & SILL AT JAMBS (ATTACHED OR FREE-STANDING).
- SEE VERTICAL SECTIONS A, A', B, B', C, C', D & D' ON SHT'S 17 THRU 20B.
- SEE NOTE 9/1 FOR SUBSTRATE DEFINITION FOR EACH ANCHOR TYPE.



P.E. SEAL/SIGNATURE/DATE

© 2021 TILTECO INC.

TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY

6355 N.W. 38th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone: (305) 871-1530 • Fax: (305) 871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr., P.E.
FLORIDA Lic. 44167

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)


SERIES 26000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE			M.P. DRAWN BY:		
 290 WEST 78 ROAD HIALEAH, FL. 33014 PHONE: (305) 558-8103 FAX: (305) 558-6665 www.generalimpact.com			8/5/2021 DATE		
			21-114 DRAWING No		
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-275	8/5/21	2	-	-

SHEET 24 OF 26

**MAX. ANCHOR 30 OR 30A SPACING AND MIN. QUANTITY OF ANCHORS 30 & 30A SCHEDULE FOR ATTACHED JAMBS
FOR A GIVEN A.S.D. DESIGN WIND LOAD AND A GIVEN NUMBER OF DOOR JAMB TRACKS.
FOR A GIVEN SUBSTRATE TYPE AT EXISTING JAMB ***

A.S.D. NEGATIVE DESIGN WIND LOAD (psf)	POURED CONCRETE OR CONCRETE BLOCK WALL				WOOD FRAME OR 2x WOOD BUCKS OR 1/8" STEEL (MIN. GRADE 33) OR 1/8" ALUMINUM (6063-T5)			
	2 TRACK DOOR	3 TRACK DOOR	4 TRACK DOOR	5 TRACK DOOR	2 TRACK DOOR	3 TRACK DOOR	4 TRACK DOOR	5 TRACK DOOR
60.0 or LESS	(1) @ 18" O.C.	(2) @ 18" O.C.	(2) @ 18" O.C.	(3) @ 18" O.C.	(1) @ 12" O.C.	(2) @ 18" O.C.	(2) @ 18" O.C.	(3) @ 18" O.C.
>60.0 to 90.0	(1) @ 14" O.C.	(2) @ 14" O.C.	(2) @ 14" O.C.	(3) @ 14" O.C.	(1) @ 10" O.C.	(2) @ 14" O.C.	(2) @ 14" O.C.	(3) @ 14" O.C.
>90.0 up to 110.0	(1) @ 9" O.C.	(2) @ 9" O.C.	(2) @ 9" O.C.	(3) @ 9" O.C.	(1) @ 8" O.C.	(2) @ 9" O.C.	(2) @ 9" O.C.	(3) @ 9" O.C.
>110.0 up to 177.0	(1) @ 8" O.C.	(2) @ 8" O.C.	(2) @ 8" O.C.	(3) @ 8" O.C.	(1) @ 8" O.C.	(2) @ 8" O.C.	(2) @ 8" O.C.	(3) @ 8" O.C.

* REQUIRED ONLY FOR ATTACHED JAMBS, NOT REQUIRED FOR FREE STANDING JAMBS (JAMB W/19 REINFORCEMENT).
SEE SECTIONS FOR ANCHOR LOCATIONS AT JAMBS ON SHEETS 11 THRU 14.

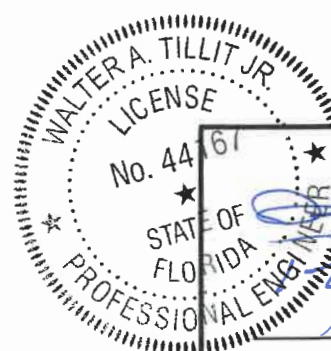

P.E. SEAL/SIGNATURE/DATE


© 2021 TILTECO INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305) 871-1530 . Fax : (305) 871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr., P.E.
FLORIDA Lic. 44167

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

SERIES 26000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE			M.P. DRAWN BY:		
 GENERAL IMPACT GLASS & WINDOWS 290 WEST 78 ROAD HIALEAH, FL. 33014 PHONE: (305) 558-8103 FAX: (305) 558-6665 www.generalimpact.com			8/5/2021 DATE		
			21-114 DRAWING No		
REV. NO	DESCRIPTION	DATE	REV. NO	DESCRIPTION	DATE
1	OLD 20-275	8/5/21			


SHEET 25 OF 26

SHEET 25 OF 26

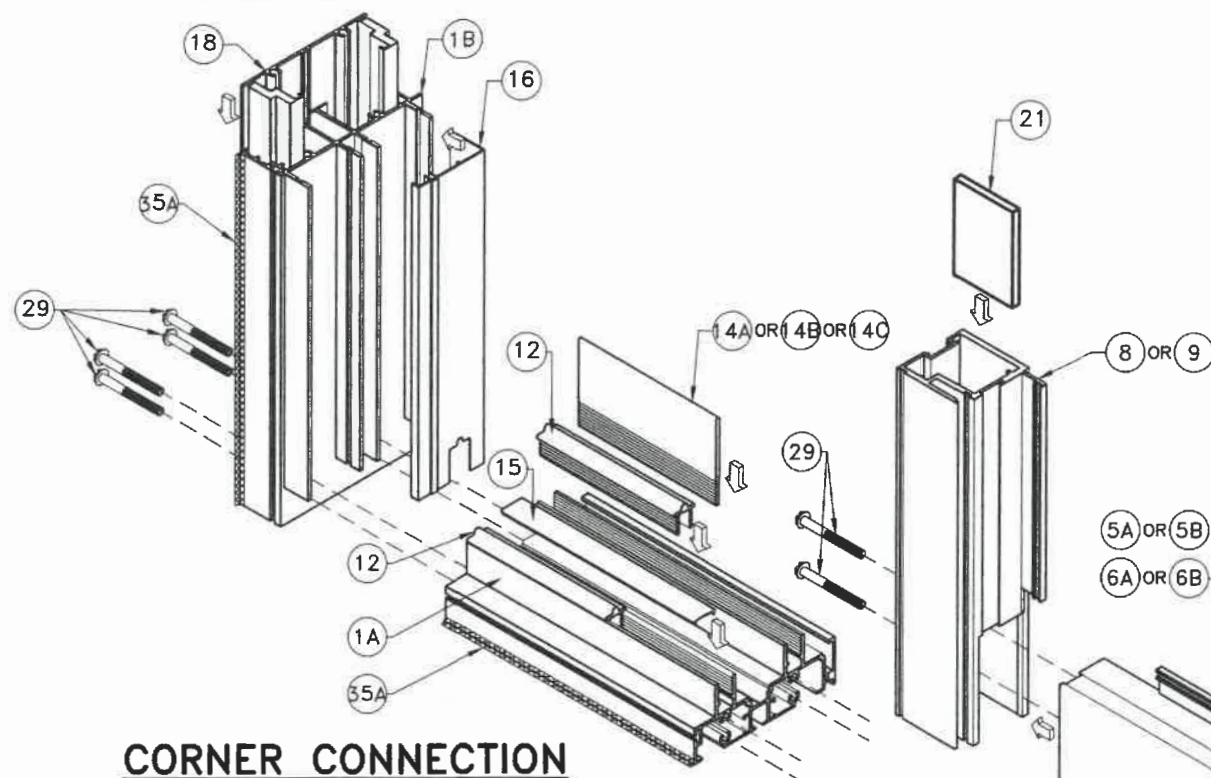

**CORNER CONNECTION
AT FRAME SILL**

**CORNER CONNECTION
MEETING STILES AT
BOTTOM RAIL**

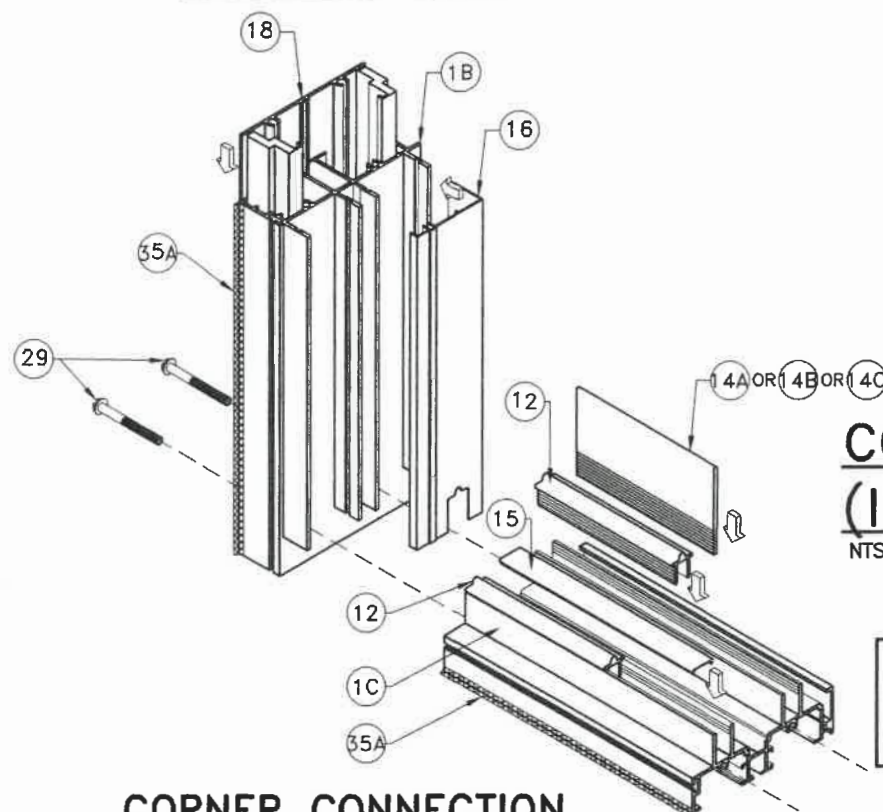

**CORNER CONNECTION
AT ALTERNATIVE
FRAME SILL**


CORNER DETAILS

(ISOMETRIC): 2 TRACK CONFIGURATION IS SHOWN
3-5 TRACKS CONFIGURATIONS ARE SIMILAR

APPLY (35A) ALL AROUND EVERY CORNER
JOINT AT DOOR PANEL AS WELL AS
BETWEEN FRAMING MEMBERS.

USE (1) (30) @ 2 TRACK DOOR
USE (2) (30) @ 3 TRACK DOOR
USE (2) (30) @ 4 TRACK DOOR
USE (3) (30) @ 5 TRACK DOOR
AT EITHER SIDE OF SPLICE

(1A OR 2A OR 3A OR 4A) + 2A
(1C OR 2C OR 3C OR 4C) + 2C

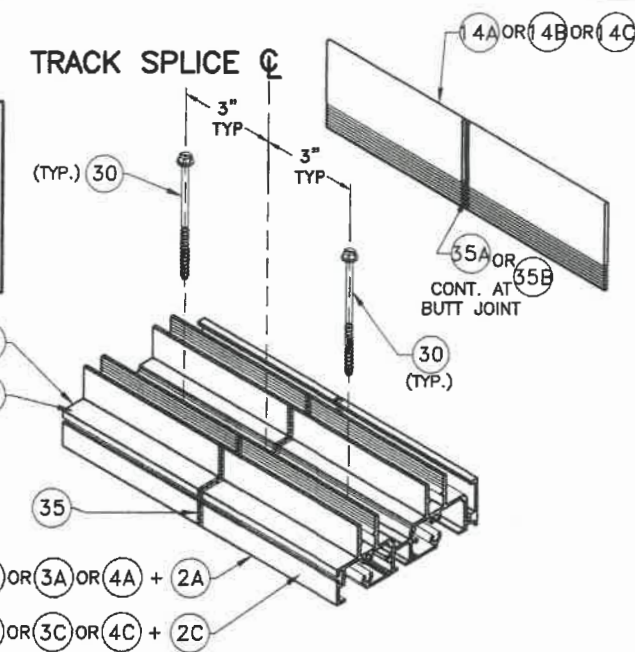


**DETAIL Y: TRACK BUTT SPLICE TYPICAL
(HEAD & SILL)
APPLICABLE FOR 2, 3, 4 & 5 TRACKS
PLUS SILL RISER BUTT SPLICE DETAIL**

**CORNER CONNECTION
MEETING STILE & ATRAGAL
AT BOTTOM RAIL**

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

LARGE & SMALL MISSILE DOORS

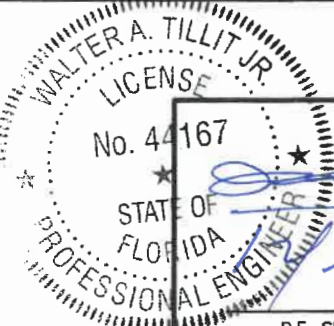

P.E. SEAL/SIGNATURE/DATE

© 2021 TILTECO INC.

TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY

6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone: (305) 871-1530 Fax: (305) 871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr., P.E.
FLORIDA Lic. 44167

SERIES 28000 HIGH IMPACT SLIDING GLASS DOOR / LARGE AND SMALL MISSILE			M.P. DRAWN BY:		
290 WEST 78 ROAD HIALEAH, FL. 33014 PHONE: (305) 558-8103 FAX: (305) 558-6665 www.generalimpact.com			8/5/2021 DATE		
			21-114 DRAWING No		
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-279	8/6/21	2	-	-