
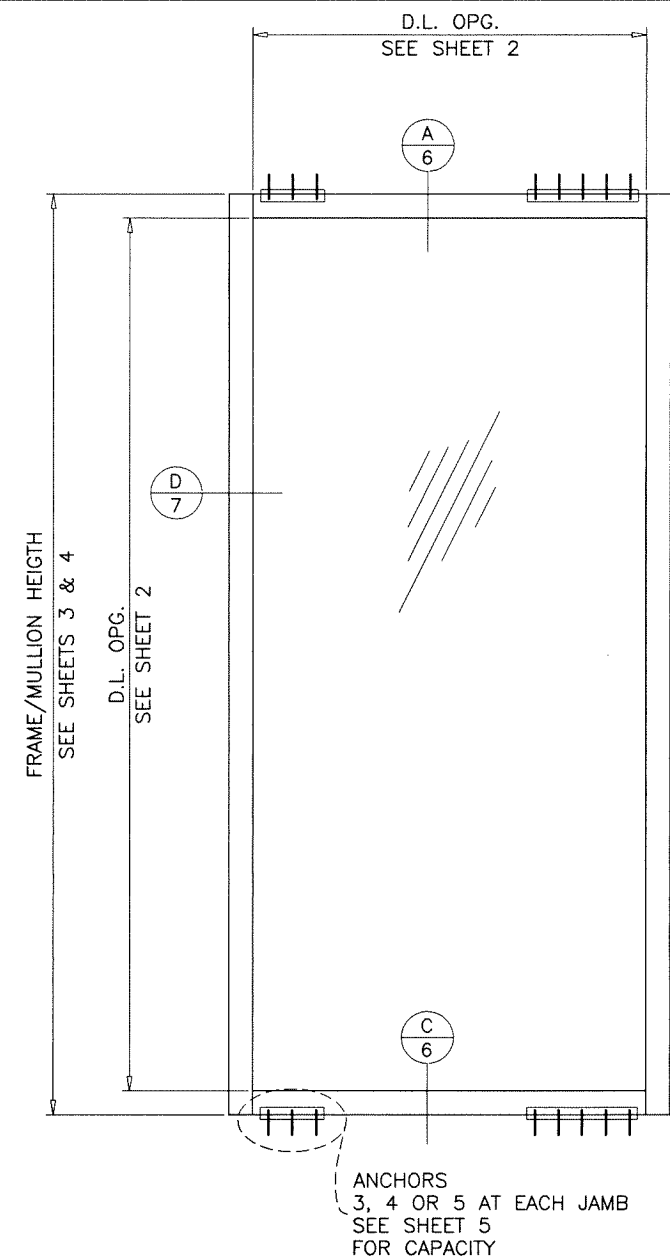


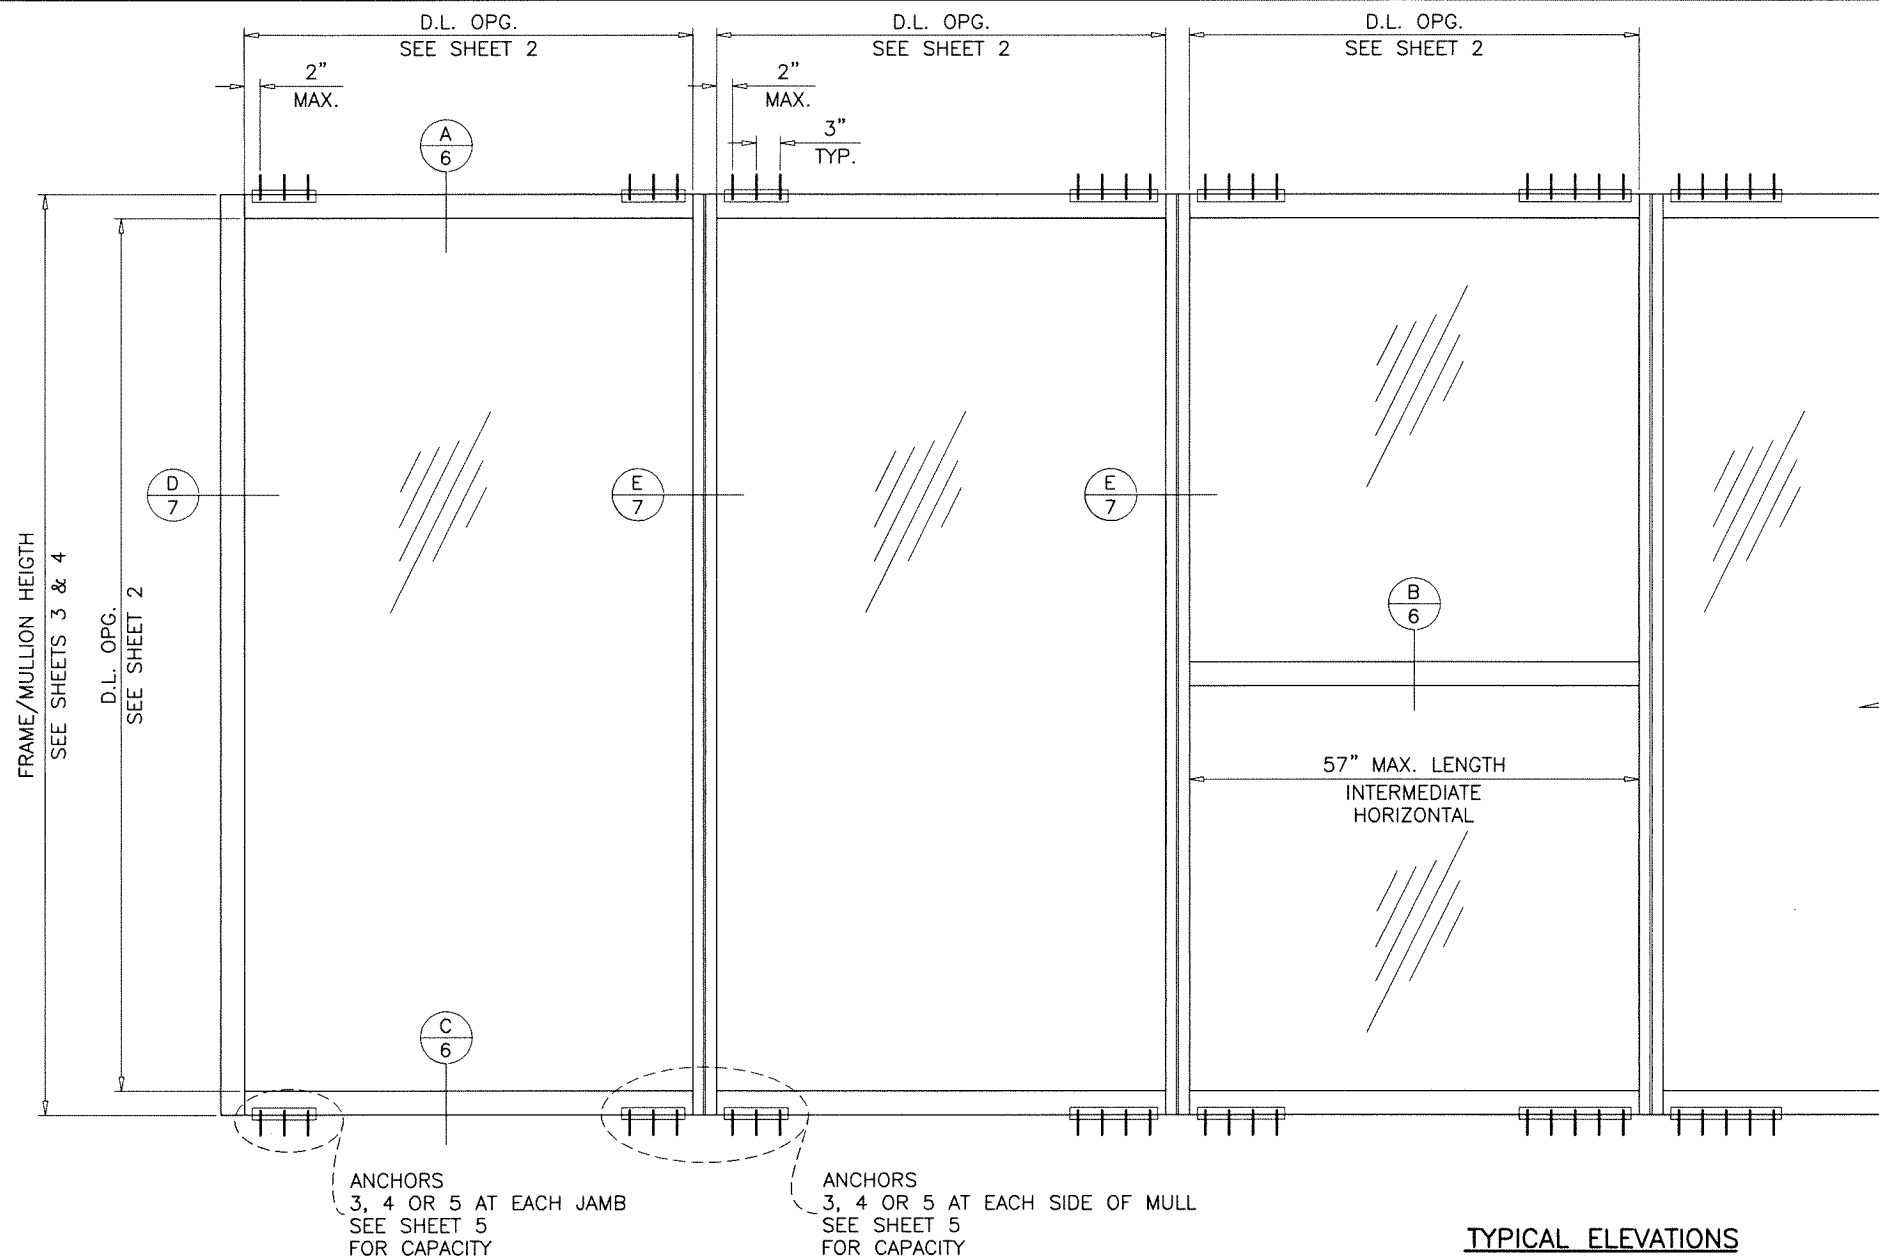

SERIES 1050 ALUMINUM WINDOW WALL SYSTEM

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2020 (7TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2020 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC.

CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

INSTRUCTIONS:

- USE CHARTS AS FOLLOWS.
- STEP 1** DETERMINE DESIGN WIND PRESSURE REQUIREMENTS BASED ON WIND VELOCITY, BLDG. HEIGHT, WIND ZONE USING APPLICABLE ASCE 7 STANDARD.
 - STEP 2** SEE CHARTS ON SHEET 2 FOR GLASS DESIGN LOAD CAPACITY.
 - STEP 3** CHECK MULLION DESIGN LOAD CAPACITY FOR A GIVEN SPACING AND HEIGHT USING CHARTS ON SHEETS 3 & 4 THE CAPACITY SHOULD EXCEED THE DESIGN LOAD.
 - STEP 4** USING CHARTS ON SHEET 5 SELECT ANCHOR OPTION WITH DESIGN LOAD CAPACITY MORE THAN DESIGN LOAD SPECIFIED IN STEP 1 ABOVE.
 - STEP 5** FOR JAMBS, USING SHEET 7, DETERMINE THE MIN. & MAX. GAP DIMENSIONS.
 - STEP 6** THE LOWEST VALUE RESULTING FROM STEPS 2, 3, 4 AND 5 THAT EXCEED THE DESIGN WIND PRESSURES DETERMINED THRU STEP 1 SHALL APPLY TO ENTIRE SYSTEM.

THIS SYSTEM IS RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

PRODUCT COMPLIES WITH REQUIREMENTS OF ANSI Z97.1.

Sealed: 5/4/2021


FL #31610

A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT.

B- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.

C- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC DRAWINGS FOR REVIEW.

D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

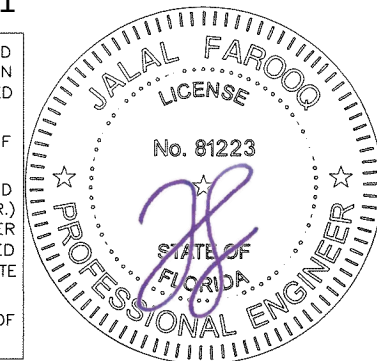

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES 1050 ALUM WINDOW WALL SYS. (L.M.I.)

ECO WINDOW SYSTEMS, LLC.
8502 N.W. 80th STREET
MEDLEY, FL. 33166
TEL. (305) 885-5299 FAX (305) 885-5902

revisions:	no	date	description	by
	A	09.28.20	UPDATED TO 2020 FBC	
	B	04.23.21	NEW TEST ADDED	

date: 01-27-20

scale: 1/2"=1'-0"

dr. by: TARIQ

chk. by:

drawing no.



20-05F

sheet 1 of 9

GLASS DESIGN LOAD CAPACITY - PSF			
NOMINAL DIMS.		9/16" LAM. GLASS	
D.L.O. WIDTH	D.L.O. HEIGHT	EXT. (+)	INT. (-)
36"	78"	100.0	140.0
42"		100.0	140.0
48"		100.0	140.0
54"		100.0	140.0
60"		95.0	133.0
66"		86.4	120.9
72"		79.2	110.8
78"		73.1	102.3
81"		73.1	102.3
36"	90"	100.0	140.0
42"		100.0	140.0
48"		100.0	140.0
54"		100.0	140.0
60"		95.0	133.0
66"		86.4	120.9
72"		79.2	110.8
78"		65.8	65.8
81"		63.3	63.3
36"	102"	100.0	140.0
42"		100.0	140.0
48"		100.0	140.0
54"		100.0	140.0
60"		95.0	133.0
63"		90.5	126.7
66"		77.7	77.7
72"		71.3	71.3
78"		65.8	65.8
81"		63.3	63.3
36"	114"	100.0	140.0
42"		100.0	140.0
48"		100.0	140.0
54"		100.0	140.0
57"		100.0	134.0
60"		85.5	85.5
66"		77.7	77.7
72"		71.3	71.3
78"		65.8	65.8
81"		63.3	63.3
36"	126"	100.0	140.0
42"		100.0	140.0
48"		100.0	140.0
54"		90.0	95.0
57"		90.0	90.0
60"		85.5	85.5
66"		77.7	77.7
72"		71.3	71.3

GLASS DESIGN LOAD CAPACITY - PSF			
NOMINAL DIMS.		9/16" LAM. GLASS	
D.L.O. WIDTH	D.L.O. HEIGHT	EXT. (+)	INT. (-)
36"	138"	100.0	140.0
42"		100.0	140.0
48"		90.0	100.0
54"		90.0	95.0
57"		90.0	90.0
60"		85.5	85.5
66"		77.7	77.7
36"	150"	90.0	100.0
42"		90.0	100.0
48"		90.0	100.0
54"		90.0	95.0
57"		90.0	90.0
60"		85.5	85.5
36"	162"	90.0	100.0
42"		90.0	100.0
48"		90.0	100.0
54"		90.0	93.9
57"		90.0	90.0

INTERPOLATION BETWEEN WIDTHS OR HEIGHTS ALLOWED.

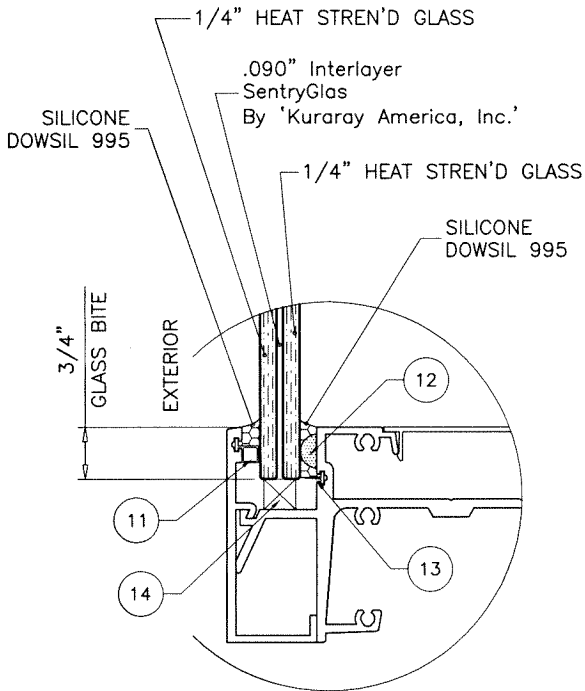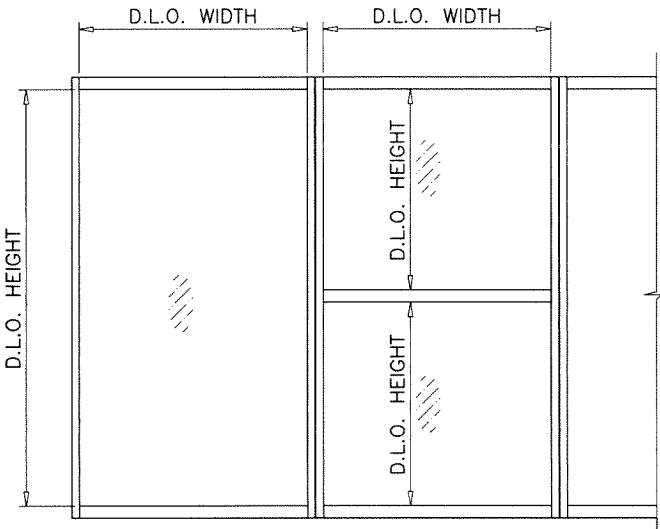

GLAZING DETAIL
9/16" OVERALL LAM. GLASS

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS).

Sealed: 5/4/2021

FL #31610



AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 262-6978 FAX. (305) 262-6978
STORE\20-05F-ECO

SERIES 1050 ALUM WINDOW WALL SYS. (L.M.I.)

ECO WINDOW SYSTEMS, LLC.
8502 N.W. 80th STREET
MEDLEY, FL. 33166
TEL. (305) 885-5299 FAX (305) 885-5902

revisions:

no	date	by	description

date: 01-27-20

scale: 3/8" = 1"

dr. by: TARIQ

chk. by:



drawing no.

20-05F


sheet 2 of 9

JAMB & MULLION LOAD CAPACITY - PSF													
JAMBS & MULLIONS WITH INTERMEDIATE HORIZONTALS													
NOMINAL DIMS.		JAMB 'J'		JAMB 'J1'		MULL 'M'		MULL 'M1'		MULL 'M2'		MULL 'M3'	
WIDTH (W)	FRAME HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
42"	84"	100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0	100.0	140.0
48"		100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0	100.0	140.0
54"		100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0	100.0	140.0
60"		100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0	100.0	140.0
42"	96"	100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0	100.0	140.0
48"		100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0	100.0	140.0
54"		100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0	100.0	140.0
60"		100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0	100.0	140.0
42"	108"	100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0	100.0	140.0
48"		100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0	100.0	140.0
54"		100.0	140.0	100.0	140.0	-	-	100.0	140.0	100.0	140.0	100.0	140.0
60"		100.0	140.0	100.0	140.0	-	-	100.0	140.0	100.0	140.0	100.0	140.0
42"	120"	100.0	140.0	100.0	140.0	100.0	124.0	100.0	140.0	100.0	140.0	100.0	140.0
48"		100.0	140.0	100.0	140.0	100.0	108.5	100.0	140.0	100.0	140.0	100.0	140.0
54"		100.0	140.0	100.0	140.0	-	-	100.0	130.3	100.0	140.0	100.0	140.0
60"		100.0	138.8	100.0	140.0	-	-	100.0	117.3	100.0	140.0	100.0	140.0
42"	132"	100.0	140.0	100.0	140.0	-	-	-	-	100.0	140.0	100.0	140.0
48"		100.0	132.6	100.0	140.0	-	-	-	-	100.0	140.0	100.0	140.0
54"		-	-	100.0	100.0	-	-	-	-	-	-	100.0	100.0
60"		-	-	100.0	100.0	-	-	-	-	-	-	100.0	100.0
42"	144"	100.0	116.7	100.0	140.0	-	-	-	-	100.0	140.0	100.0	140.0
48"		100.0	102.1	100.0	140.0	-	-	-	-	100.0	131.2	100.0	131.2
54"		-	-	100.0	100.0	-	-	-	-	-	-	100.0	100.0
60"		-	-	100.0	100.0	-	-	-	-	-	-	100.0	100.0
42"	156"	-	-	100.0	100.0	-	-	-	-	-	-	100.0	100.0
48"		-	-	100.0	100.0	-	-	-	-	-	-	100.0	100.0
54"		-	-	100.0	100.0	-	-	-	-	-	-	100.0	100.0
60"		-	-	100.0	100.0	-	-	-	-	-	-	97.3	97.3
42"	168"	-	-	100.0	100.0	-	-	-	-	-	-	100.0	100.0
48"		-	-	100.0	100.0	-	-	-	-	-	-	100.0	100.0
54"		-	-	96.0	96.0	-	-	-	-	-	-	92.5	92.5
60"		-	-	86.4	86.4	-	-	-	-	-	-	83.3	83.3


INTERPOLATION BETWEEN WIDTHS OR HEIGHTS ALLOWED.

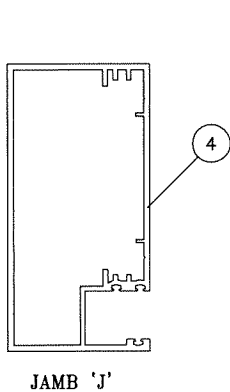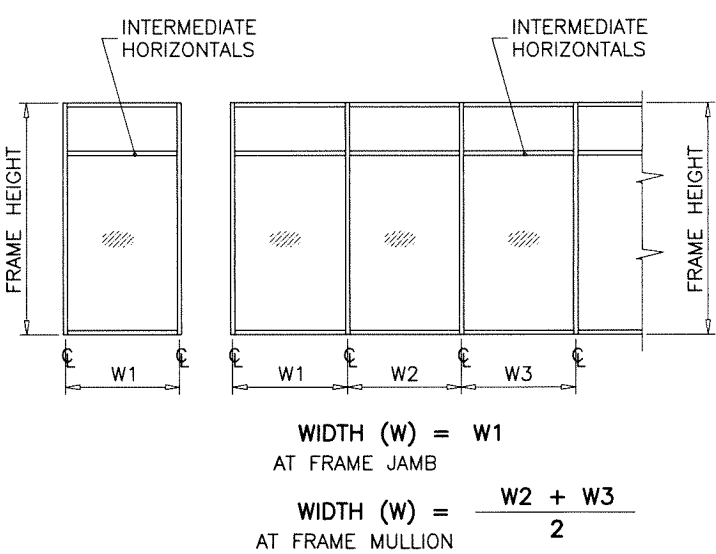


Ix IN ⁴	Sx IN ³
11.791	3.819

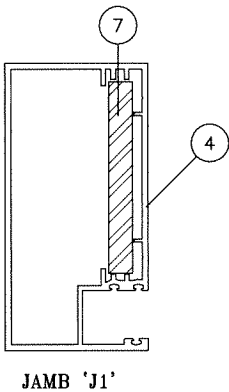


Ix IN ⁴	Sx IN ³
ALUMINUM	11.791
STEEL	2.6667
TOTAL	14.4577
Ix ALUM + Ix STL X 2.9	

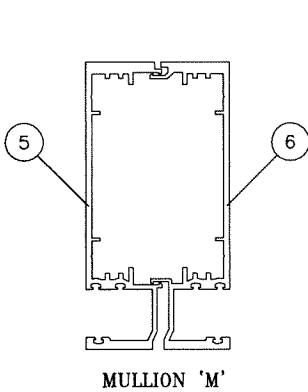


Ix IN ⁴	Sx IN ³
15.7335	5.2354

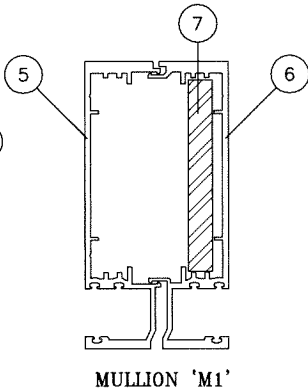

Ix IN ⁴	Sx IN ³
ALUMINUM	15.7335
STEEL	2.6667
TOTAL	18.3999
Ix ALUM + Ix STL X 2.9	

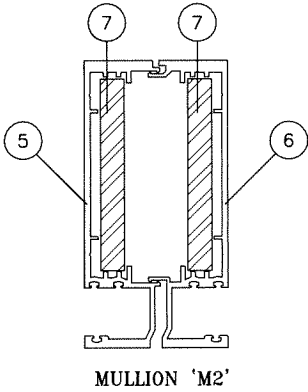

Ix IN ⁴	Sx IN ³
ALUMINUM	15.7335
STEEL	5.3334
TOTAL	21.0669
Ix ALUM + Ix STL X 2.9	

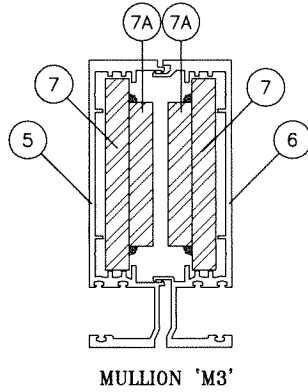


Ix IN ⁴	Sx IN ³
ALUMINUM	15.7335
STEEL	7.5834
TOTAL	23.3169
Ix ALUM + Ix STL X 2.9	

NOTE:
LOWER CAPACITY OF JAMBS 'J' OR 'J1' AND MULLION 'M', 'M1', 'M2' OR 'M3'
SHALL CONTROL WHEN USED IN COMBINATION.

Sealed: 5/4/2021

FL #31610

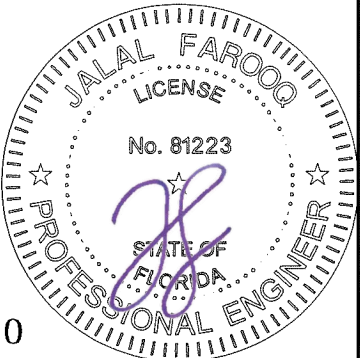

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES 1050 ALUM WINDOW WALL SYS. (L.M.I.)

ECO WINDOW SYSTEMS, LLC.
8502 N.W. 80th STREET
MEDLEY, FL. 33166
TEL. (305) 885-5299 FAX (305) 885-5902

revisions:

no	date	by	description

date: 01-27-20

scale: -


dr. by: TARIQ

chk. by:

drawing no.
20-05F
sheet 4 of 9


HEAD/SILL ANCHOR DESIGN LOAD CAPACITY – PSF							
EXT.(+) & INT.(–)							
NOMINAL DIMS.		ANCHOR TYPE 'A'			ANCHOR TYPES 'B' & 'C'		
WIDTH (W)	FRAME HEIGHT	A3	A4	A5	B3/C3	B4/C4	B5/C5
42"	84"	101.1	134.8	140.0	140.0	140.0	140.0
48"		88.4	117.9	140.0	140.0	140.0	140.0
54"		78.6	104.8	131.0	125.2	140.0	140.0
60"		70.7	94.3	117.9	112.6	140.0	140.0
66"		64.3	85.8	107.2	102.4	136.5	140.0
72"		59.0	78.6	98.3	93.9	125.2	140.0
78"		54.4	72.6	90.7	86.7	115.5	140.0
84"		50.5	67.4	84.2	80.5	107.3	134.1
42"	96"	88.4	117.9	140.0	140.0	140.0	140.0
48"		77.4	103.2	129.0	123.2	140.0	140.0
54"		68.8	91.7	114.6	109.5	140.0	140.0
60"		61.9	82.5	103.2	98.6	131.4	140.0
66"		56.3	75.0	93.8	89.6	119.5	140.0
72"		51.6	68.8	86.0	82.1	109.5	136.9
78"		47.6	63.5	79.4	75.8	100.0	100.0
84"		44.2	59.0	73.7	70.4	93.9	100.0
42"	108"	78.6	104.8	131.0	125.2	140.0	140.0
48"		68.8	91.7	114.6	109.5	140.0	140.0
54"		61.1	81.5	101.9	97.3	129.8	140.0
60"		55.0	73.4	91.7	87.6	116.8	140.0
66"		50.0	66.7	83.4	79.6	106.2	132.7
72"		45.9	61.1	76.4	73.0	97.3	100.0
78"		42.3	56.4	70.5	67.4	89.9	100.0
84"		39.3	52.4	65.5	62.6	83.4	100.0
42"	120"	70.7	94.3	117.9	112.6	140.0	140.0
48"		61.9	82.5	103.2	98.6	131.4	140.0
54"		55.0	73.4	91.7	87.6	116.8	140.0
60"		49.5	66.0	82.5	78.9	105.1	131.4
66"		45.0	60.0	75.0	71.7	95.6	100.0
72"		41.3	55.0	68.8	65.7	87.6	100.0
78"		38.1	50.8	63.5	60.7	80.9	100.0
84"		35.4	47.2	59.0	56.3	75.1	93.9
42"	132"	64.3	85.8	107.2	102.4	136.5	140.0
48"		56.3	75.0	93.8	89.6	119.5	140.0
54"		50.0	66.7	83.4	79.6	106.2	132.7
60"		45.0	60.0	75.0	71.7	95.6	100.0
66"		40.9	54.6	68.2	65.2	86.9	100.0
72"		37.5	50.0	62.5	59.7	79.6	99.6
42"	144"	59.0	78.6	98.3	93.9	125.2	140.0
48"		51.6	68.8	86.0	82.1	109.5	136.9
54"		45.9	61.1	76.4	73.0	97.3	100.0
60"		41.3	55.0	68.8	65.7	87.6	100.0
66"		37.5	50.0	62.5	59.7	79.6	99.6
42"	156"	54.4	72.6	90.7	86.7	100.0	100.0
48"		47.6	63.5	79.4	75.8	100.0	100.0
54"		42.3	56.4	70.5	67.4	89.9	100.0
60"		38.1	50.8	63.5	60.7	80.9	100.0
63"		36.3	48.4	60.5	57.8	77.0	96.3
42"	168"	50.5	67.4	84.2	80.5	100.0	100.0
48"		44.2	59.0	73.7	70.4	93.9	100.0
54"		39.3	52.4	65.5	62.6	83.4	100.0
60"		35.4	47.2	59.0	56.3	75.1	93.9

INTERPOLATION BETWEEN WIDTHS OR HEIGHTS ALLOWED.

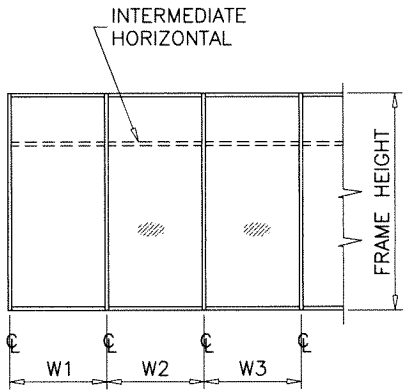


WIDTH (W) = W1
AT FRAME JAMB


WIDTH (W) = $\frac{W2 + W3}{2}$
AT FRAME MULLION



A3, B3, C3



A4, B4, C4

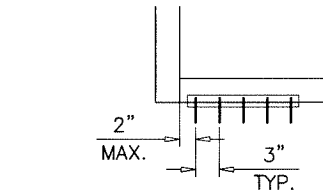


A5, B5, C5

ANCHORS TYPES: SEE SHEET 6 FOR DESCRIPTION

- A3 = (3) ANCHORS TYPE 'A' AT EACH SIDE OF JAMB AND MULLION
B3 = (3) ANCHORS TYPE 'B' AT EACH SIDE OF JAMB AND MULLION
C3 = (3) ANCHORS TYPE 'C' AT EACH SIDE OF JAMB AND MULLION
A4 = (4) ANCHORS TYPE 'A' AT EACH SIDE OF JAMB AND MULLION
B4 = (4) ANCHORS TYPE 'B' AT EACH SIDE OF JAMB AND MULLION
C4 = (4) ANCHORS TYPE 'C' AT EACH SIDE OF JAMB AND MULLION
A5 = (5) ANCHORS TYPE 'A' AT EACH SIDE OF JAMB AND MULLION
B5 = (5) ANCHORS TYPE 'B' AT EACH SIDE OF JAMB AND MULLION
C5 = (5) ANCHORS TYPE 'C' AT EACH SIDE OF JAMB AND MULLION

Sealed: 5/4/2021

FL #31610

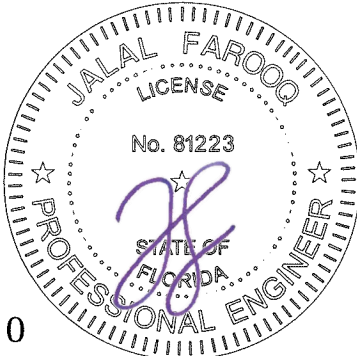

afcc





AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

SERIES 1050 ALUM WINDOW WALL SYS. (L.M.I.)

ECO WINDOW SYSTEMS, LLC.
8502 N.W. 80th STREET
MEDLEY, FL. 33166
TEL. (305) 885-5299 FAX (305) 885-5902

revisions:		no		date		by		description	
date:	01-27-20	scale:	–	dr. by:	TARIQ	chk. by:		drawing no.	20-05F
								sheet 5 of 9	

STORE\20-05F-ECO

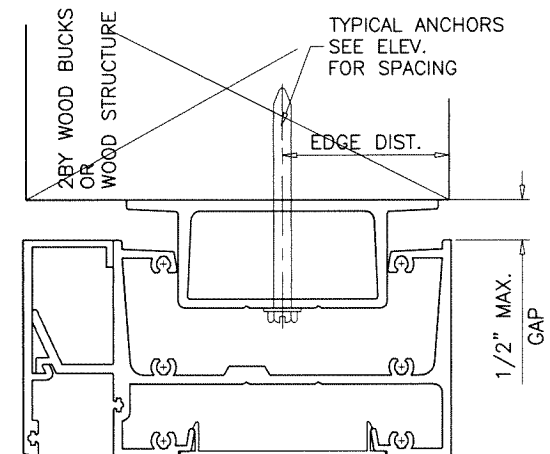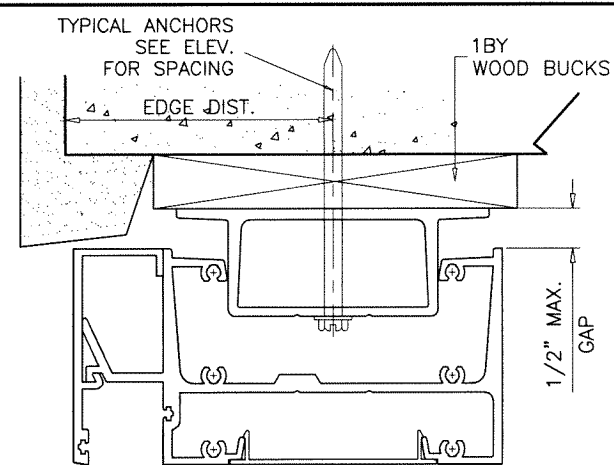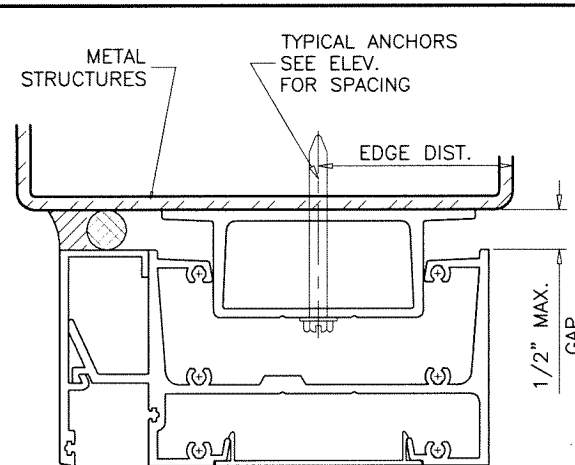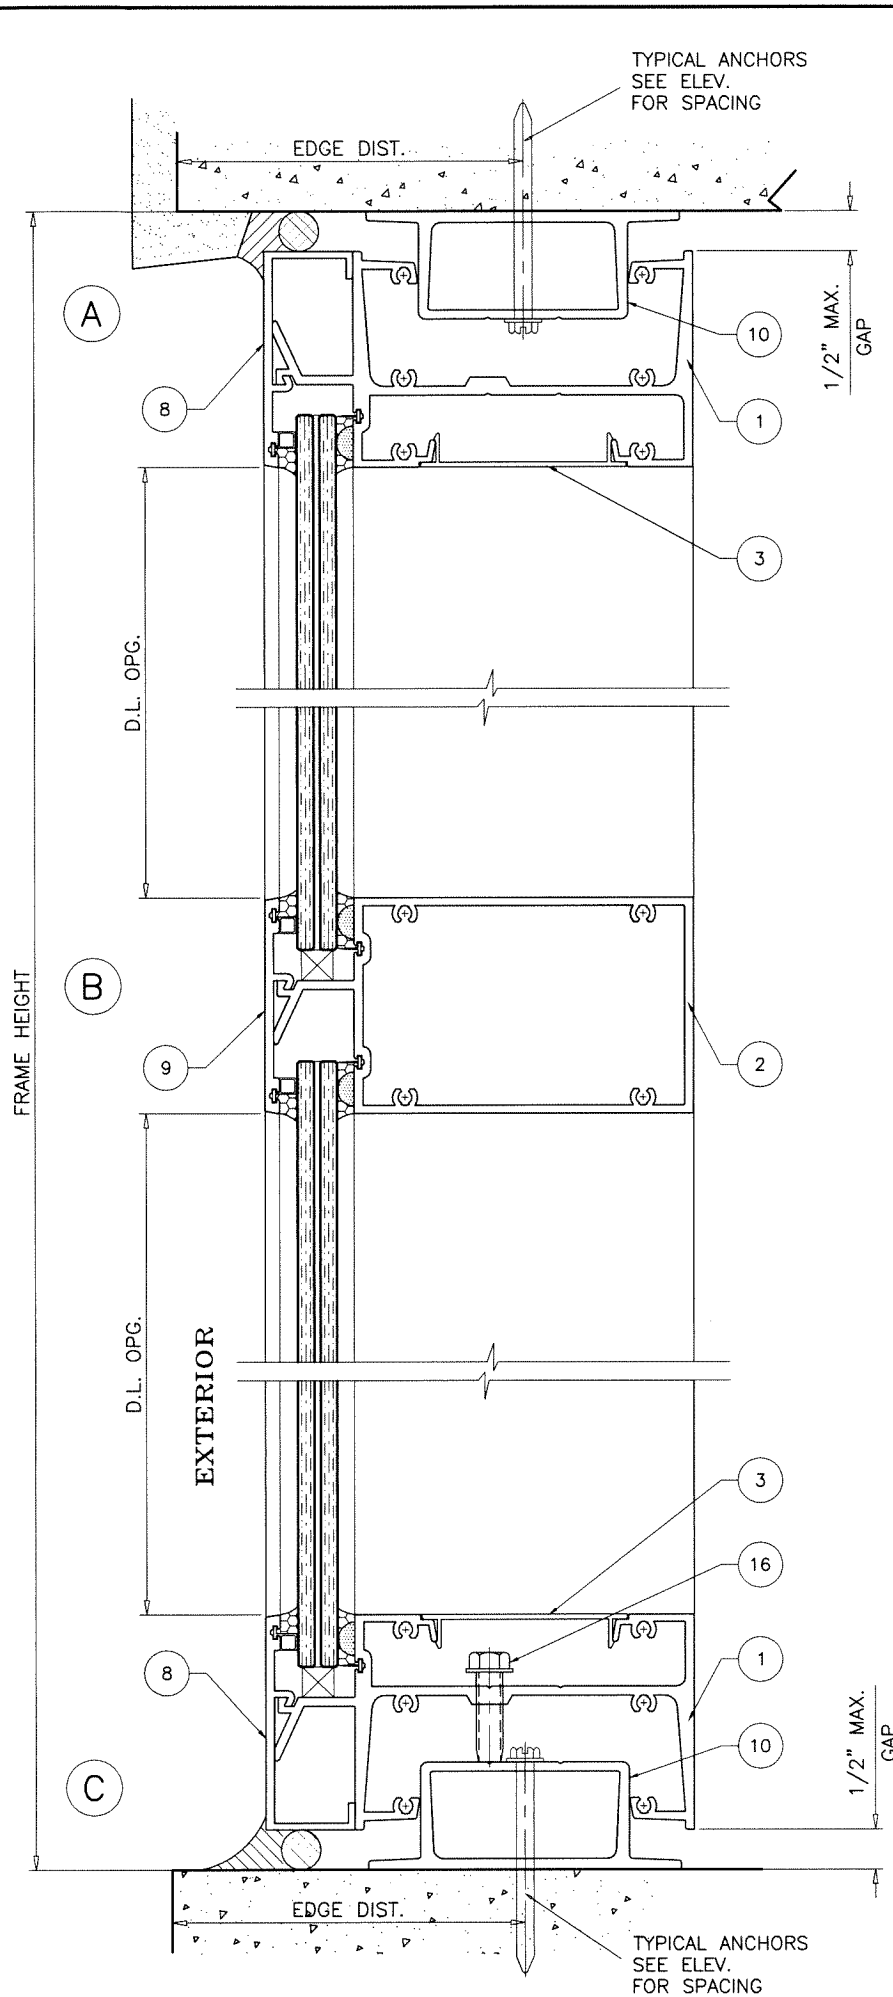

1BY OR 2BY WOOD BUCKS AND METAL STRUCTURES NOT BY 'ECO WINDOW' MUST SUPPORT LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

TYPE 'A'— 1/4" DIA. ULTRACON+ BY 'DEWALT' ($F_u=164$ KSI, $F_y=148$ KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD
 THRU 1BY BUCKS INTO CONCRETE
 1-3/4" MIN. EMBED INTO CONCRETE

TYPE 'B'— 1/4" DIA. ULTRACON+ BY 'DEWALT' ($F_u=164$ KSI, $F_y=148$ KSI)
 DIRECTLY INTO CONCRETE
 1-3/4" MIN. EMBED INTO CONCRETE

TYPE 'C'— #14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS
 OR
 INTO METAL STRUCTURES
 (3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS
 ALUMINUM: 3/16" THK. MIN. (6063-T5 MIN.)
 STEEL: 1/8" THK. MIN. ($F_y = 36$ KSI MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)


TYPICAL EDGE DISTANCE

INTO CONCRETE = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD OR SILL SG = 0.55 MIN.
 CONCRETE AT HEAD OR SILL $f'_c = 3000$ PSI MIN.

Sealed: 5/4/2021


FL #31610

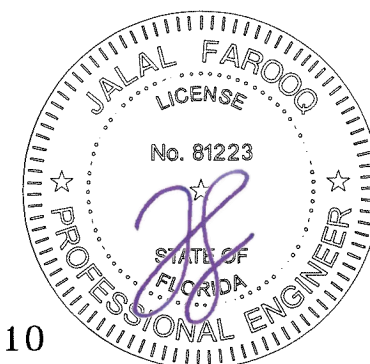

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX (305) 262-6978
 STORE 20-05F-ECO

SERIES 1050 ALUM WINDOW WALL SYS. (L.M.I.)
ECO WINDOW SYSTEMS, LLC.
 8502 N.W. 80th STREET
 MEDLEY, FL. 33166
 TEL. (305) 885-5299 FAX (305) 885-5902

revisions:		no		date		by		description	
date:	01-27-20	scale:	3/8" = 1"	dr. by:	TARIQ	chk. by:		drawing no.	20-05F
								sheet 6 of 9	

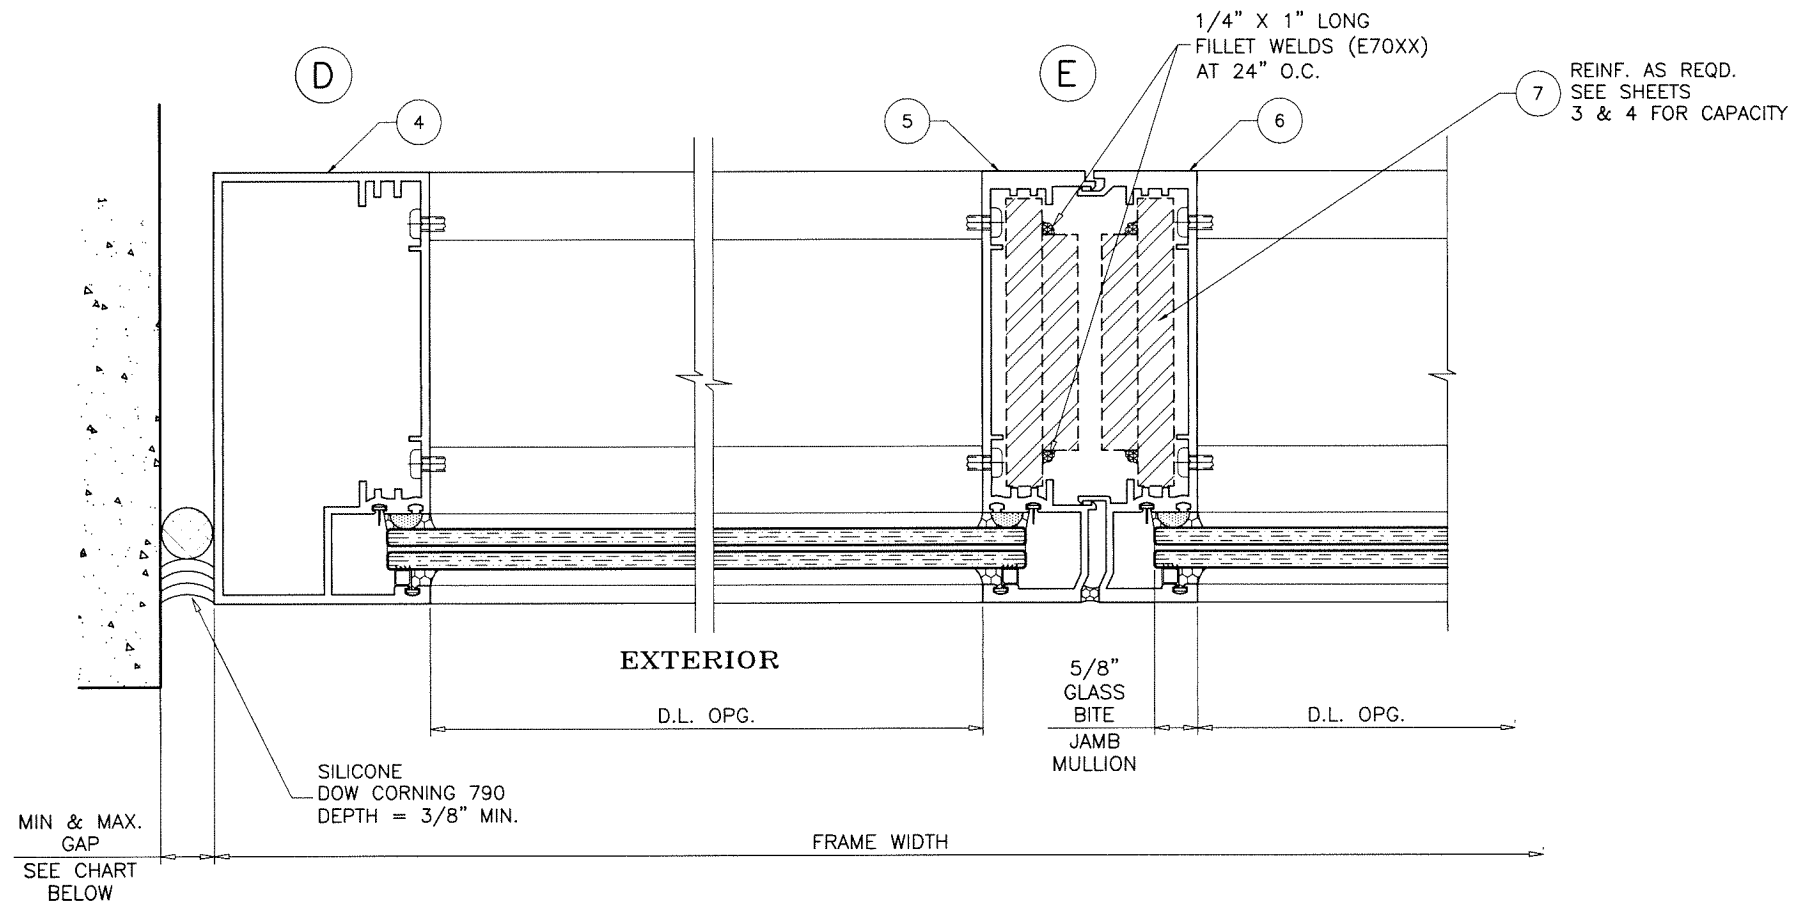


MAX. FRAME HEIGHT	GAP	
	MIN.	MAX.
78"	1/4"	3/4"
96"	5/16"	3/4"
120"	3/8"	3/4"
144"	1/2"	3/4"
168"	9/16"	3/4"

NOTE:
 MAX. MOVEMENT CONSIDERED=100% STRETCH.
 PLEASE REFER TO SEALANT MANUFACTURER'S DATA AND APPLICATION MANUAL FOR COMPATABILITY OF SEALANT TO SUBSTRATE & WINDOWALL MATERIAL/FINISH AND COMPLIANCE FOR WARRANTY.
 REFER TO ACI-117-10 FOR CONSTRUCTION TOLERANCES.

ALTERNATE SEALANTS AT JAMB GAPS CAN BE DESIGNED BY ENGINEER OF RECORD BASED ON MANUFACTURER GUIDE LINES.

GAPS LESS THAN 1/4" MAY BE DESIGNED BY ENGINEER OF RECORD BY THE USE OF BOND BREAKER TAPE OR 15% OF GAP ALLOWED MOVEMENT.

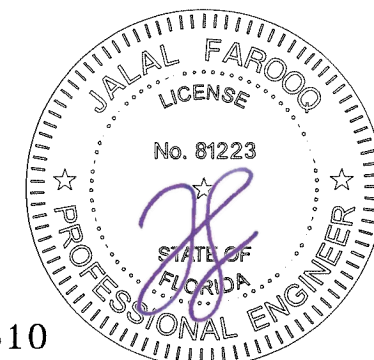











Sealed: 5/4/2021

FL #31610

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173 (C.A.N. 3538)
 TEL. (305) 264-8100 FAX. (305) 262-6978
 STORE\20-05F-ECO

SERIES 1050 ALUM WINDOW WALL SYS. (L.M.I.)
ECO WINDOW SYSTEMS, LLC.
 8502 N.W. 80th STREET
 MEDLEY, FL. 33166
 TEL. (305) 885-5299 FAX (305) 885-5902


revisions:		no	date	by	description
date:	01-27-20	scale:	3/8" = 1"	dr. by:	TARIQ
				chk. by:	
drawing no.		20-05F			
sheet		7 of 9			

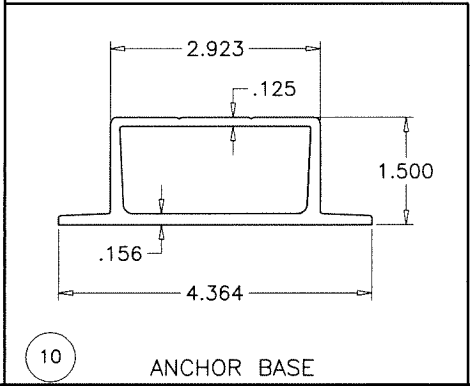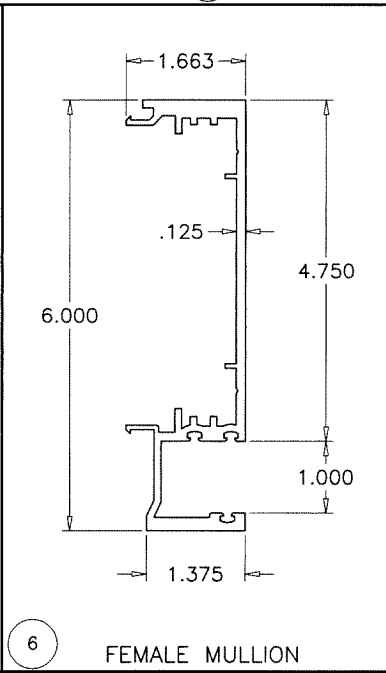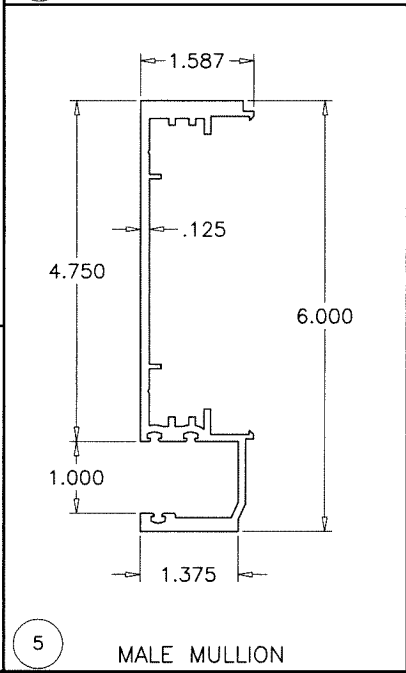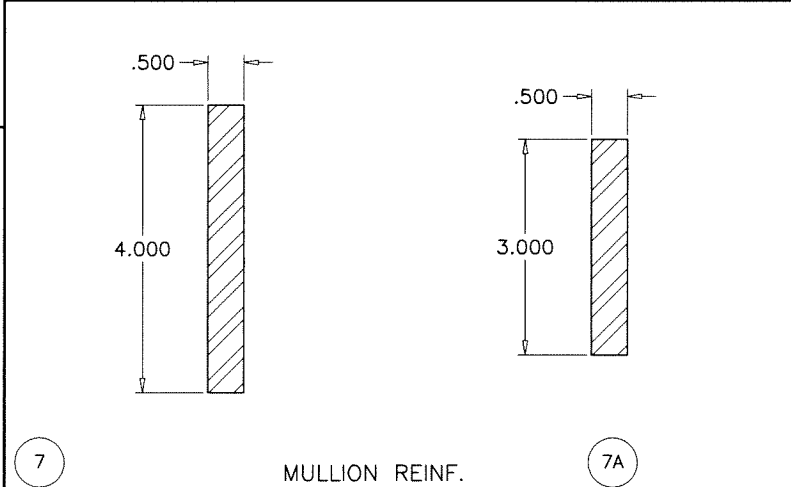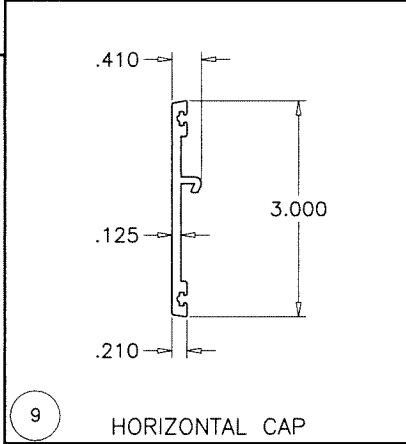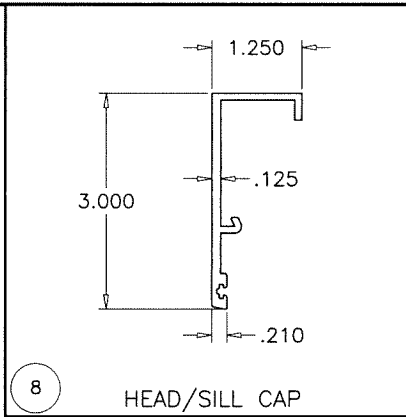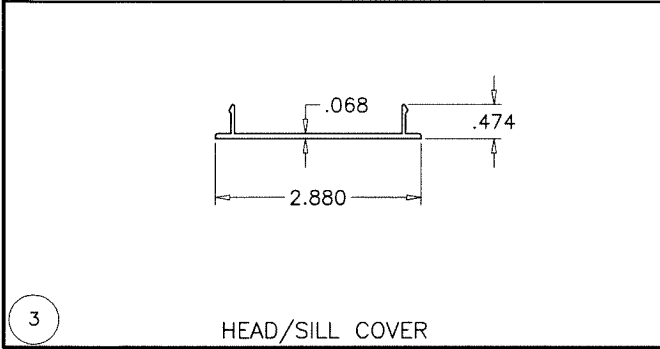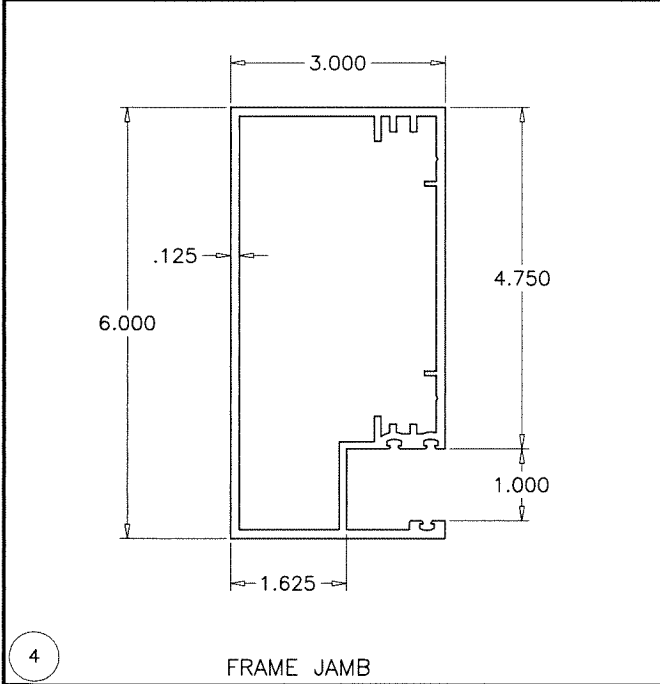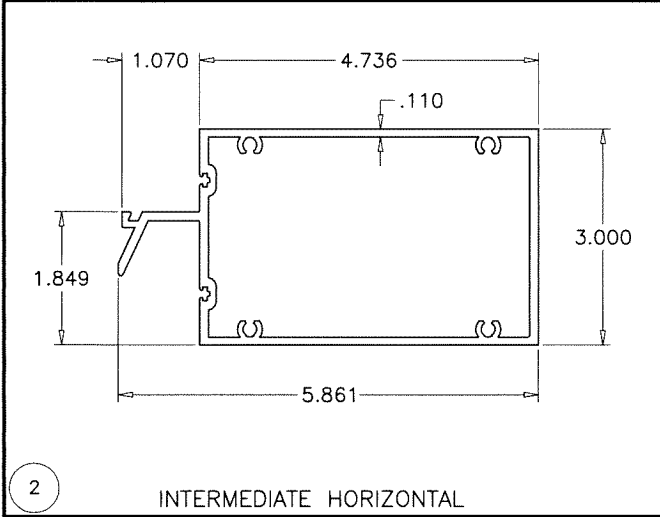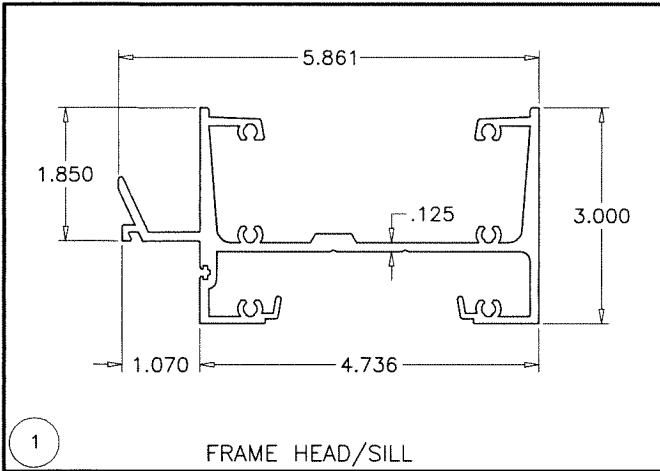

ITEM #	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	E1055	AS REQD.	FRAME HEAD/SILL	6063-T6	-
2	E1053	AS REQD.	INTERMEDIATE HORIZONTAL	6063-T6	-
3	E1058	AS REQD.	HEAD/SILL COVER	6063-T5	-
4	E1054	AS REQD.	FRAME JAMB	6063-T6	-
5	E1051	AS REQD.	MALE MULLION	6063-T6	-
6	E1052	AS REQD.	FEMALE MULLION	6063-T6	-
7	-	AS REQD.	MULLION REINF.	STEEL	-
7A	-	AS REQD.	MULLION REINF.	STEEL	-
8	E1056	AS REQD.	HEAD/SILL CAP	6063-T6	-
9	E1057	AS REQD.	HORIZONTAL CAP	6063-T6	-
10	E1059	AS REQD.	ANCHOR BASE	6063-T6	-
11	E1060	4/ LITE	EXTERIOR GLASS SPACER	EPDM	DUROMETER 70±5 SHORE A
12	-	4/ LITE	INTERIOR GLASS SPACER	EPDM	DUROMETER 80±5 SHORE A
13	E1061	4/ LITE	SILICONE DAM	EPDM	DUROMETER 80±5 SHORE A
14	-	2/ LITE	SETTING BLOCKS, AT 1/4 POINTS (LAM. GLASS)	EPDM	DUROMETER 80±5 SHORE A
15	#12 X 1-1/4"	AS REQD.	ASSEMBLY FASTENERS	ST/ST	PH SMS
16	5/16" MACH. BOLT	2/ LITE	LEVELING SCREW	ST/ST	-

Sealed: 5/4/2021

FL #31610

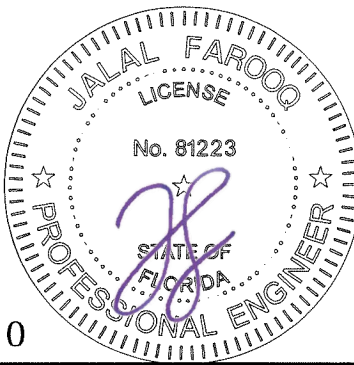

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES 1050 ALUM WINDOW WALL SYS. (L.M.I.)

ECO WINDOW SYSTEMS, LLC.
8502 N.W. 80th STREET
MEDLEY, FL. 33166
TEL. (305) 885-5299 FAX (305) 885-5902

revisions:

no	date	by	description

date: 01-27-20

scale: 3/8" = 1"

dr. by: TARIQ


chk. by:

drawing no.


20-05F

sheet 8 of 9


STORE\20-05F-ECO

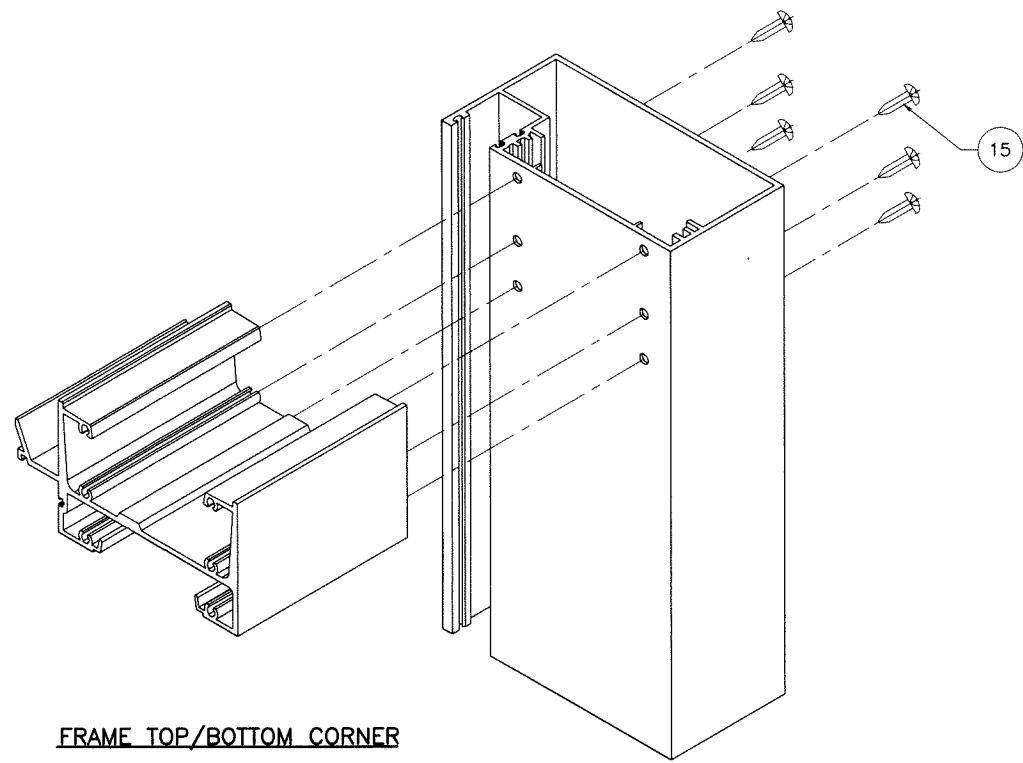


FRAME TOP/BOTTOM CORNER

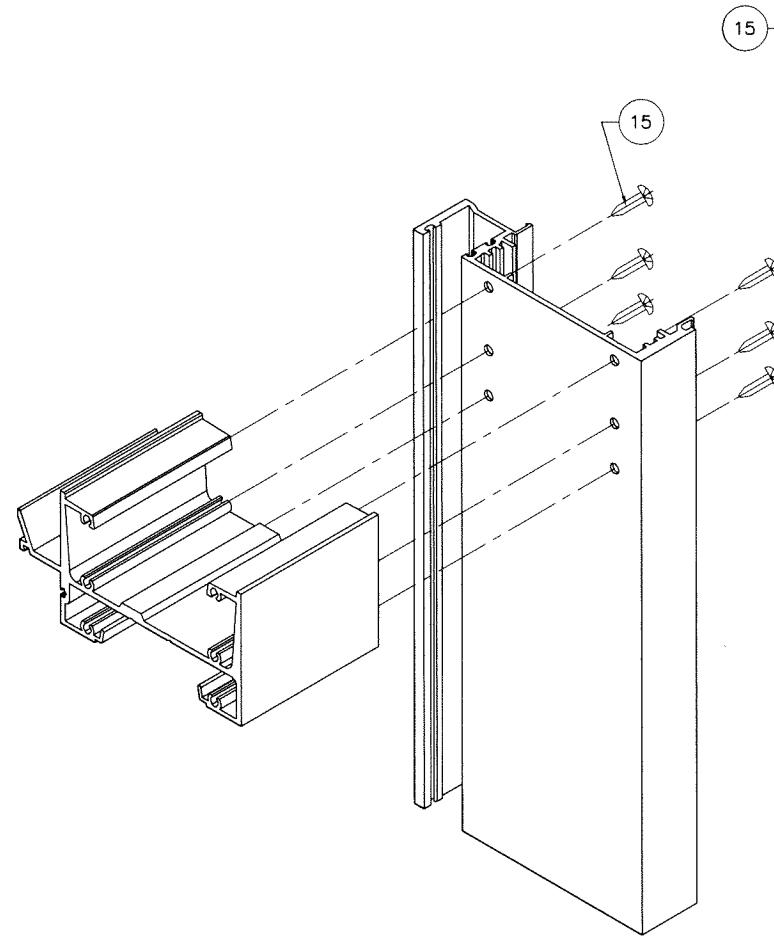

MULLION CORNER

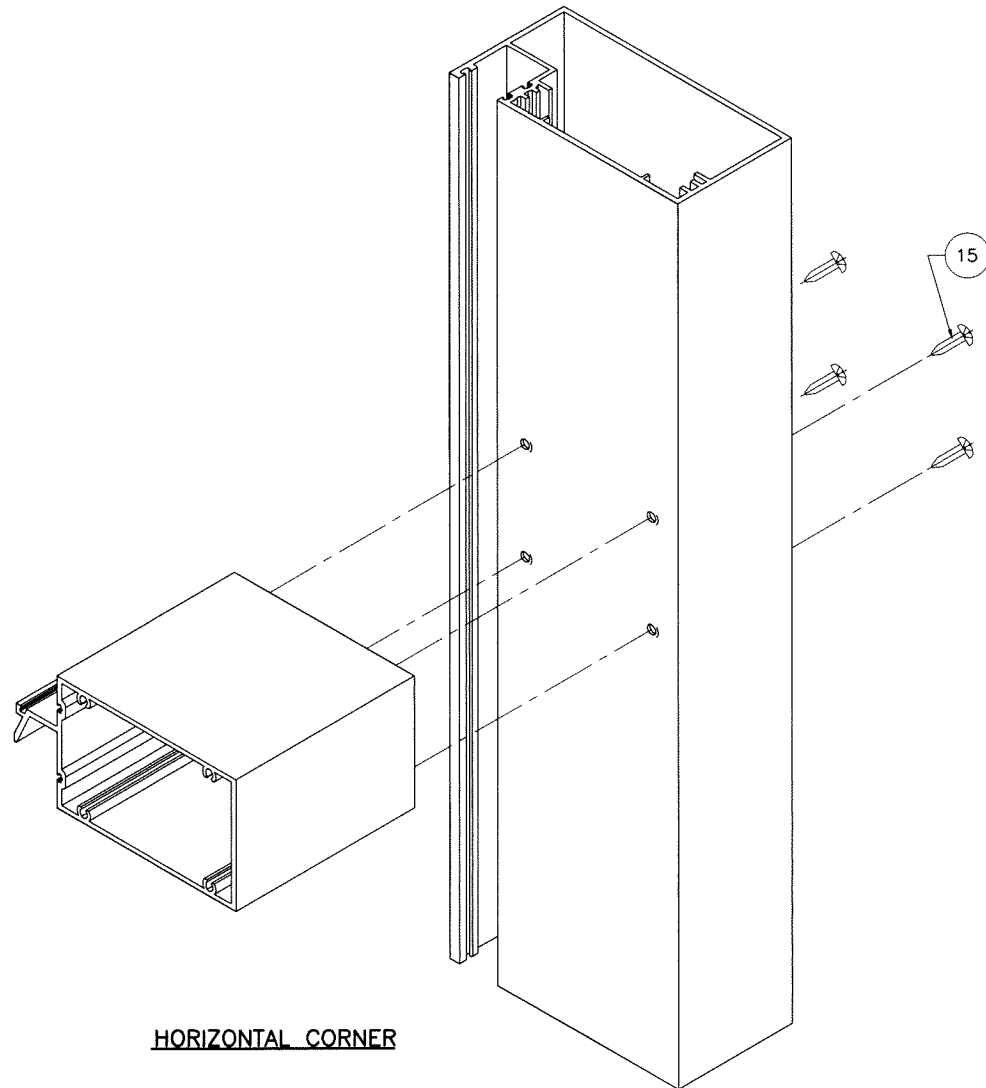

HORIZONTAL CORNER

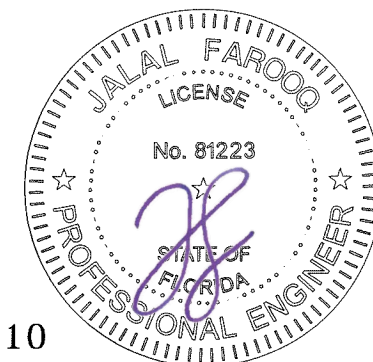

Sealed: 5/4/2021

FL #31610

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220 (C.A.N. 3538)
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978
 STORE \ 20-05F-ECO

SERIES 1050 ALUM WINDOW WALL SYS. (L.M.I.)
ECO WINDOW SYSTEMS, LLC.
 8502 N.W. 80th STREET
 MEDLEY, FL. 33166
 TEL. (305) 885-5299 FAX (305) 885-5902

revisions:		date		by		description	
no	date	no	date	no	date	no	date

date: 01-27-20
 scale: 3/8" = 1"
 dr. by: TARIQ
 chk. by:

drawing no.
20-05F
 sheet 9 of 9