
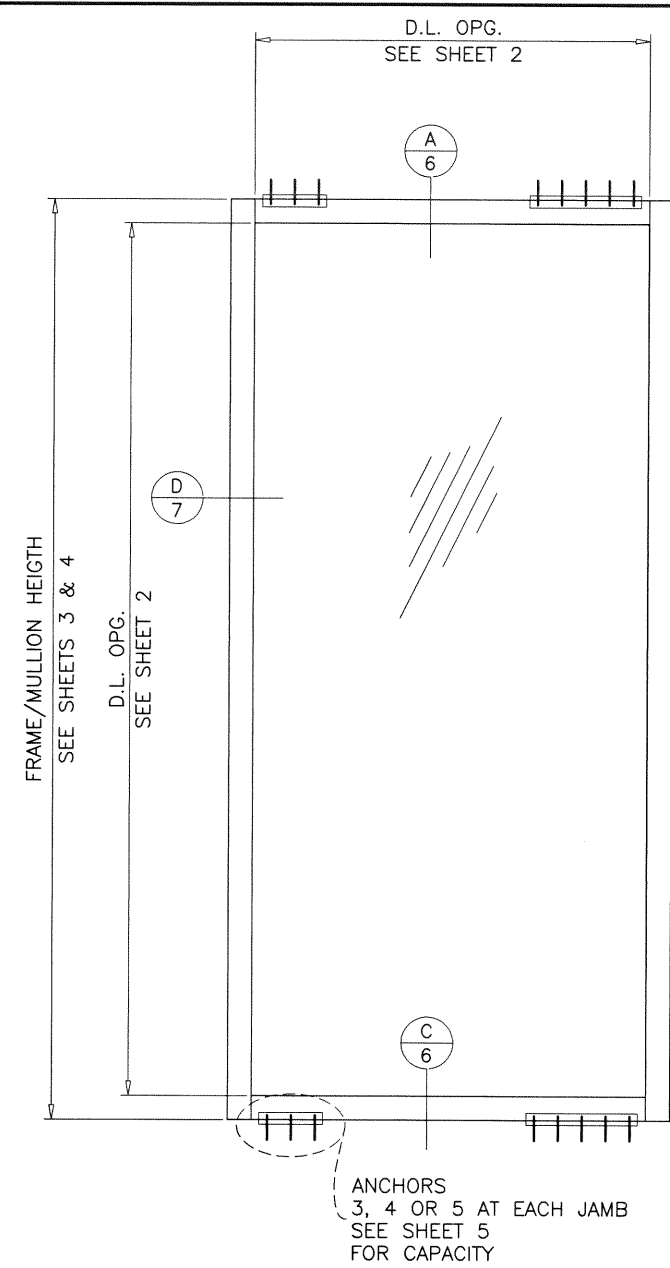


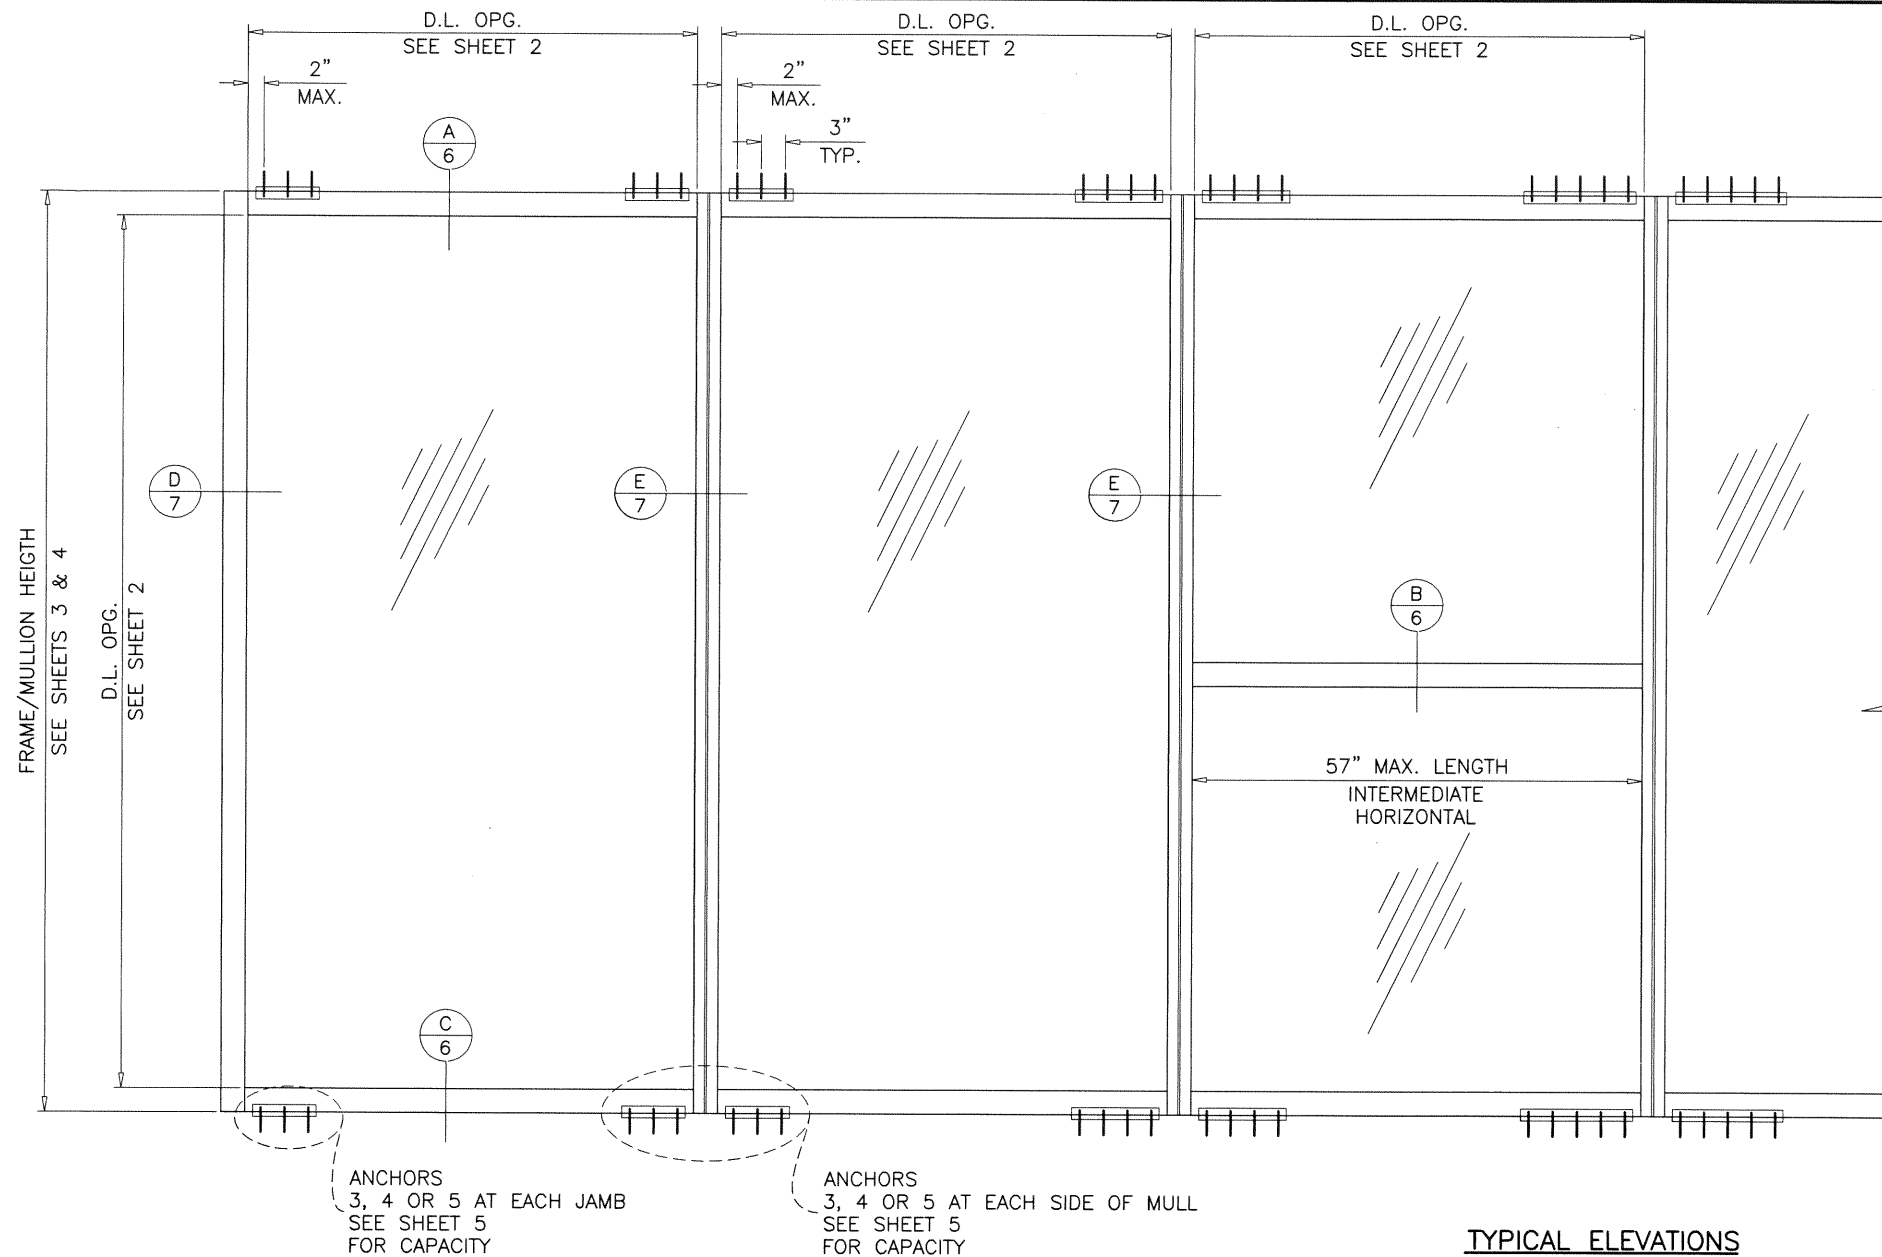

TYPICAL ELEVATIONS

SERIES 1050 ALUMINUM WINDOW WALL SYSTEM

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2017 (6TH EDITION)/2020 (7TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2017/2020 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC. CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

INSTRUCTIONS:

USE CHARTS AS FOLLOWS.


- STEP 1** DETERMINE DESIGN WIND PRESSURE REQUIREMENTS BASED ON WIND VELOCITY, BLDG. HEIGHT, WIND ZONE USING APPLICABLE ASCE 7 STANDARD.
- STEP 2** SEE CHARTS ON SHEET 2 FOR GLASS DESIGN LOAD CAPACITY.
- STEP 3** CHECK MULLION DESIGN LOAD CAPACITY FOR A GIVEN SPACING AND HEIGHT USING CHARTS ON SHEETS 3 & 4 THE CAPACITY SHOULD EXCEED THE DESIGN LOAD.
- STEP 4** USING CHARTS ON SHEET 5 SELECT ANCHOR OPTION WITH DESIGN LOAD CAPACITY MORE THAN DESIGN LOAD SPECIFIED IN STEP 1 ABOVE.
- STEP 5** FOR JAMBS, USING SHEET 7, DETERMINE THE MIN. & MAX. GAP DIMENSIONS.
- STEP 6** THE LOWEST VALUE RESULTING FROM STEPS 2, 3, 4 AND 5 THAT EXCEED THE DESIGN WIND PRESSURES DETERMINED THRU STEP 1 SHALL APPLY TO ENTIRE SYSTEM.

THIS SYSTEM IS RATED FOR SMALL MISSILE IMPACT.
F.B.C. APPROVED IMPACT RESISTANT SHUTTERS REQUIRED FOR INSTALLATIONS UP TO 30 FT. OF GRADE.
SHUTTERS NOT REQD. FOR INSTALLATIONS ABOVE 30 FT. OF GRADE.

PRODUCT COMPLIES WITH REQUIREMENTS OF ANSI Z97.1.

Sealed: 10/5/2020

FL #31610

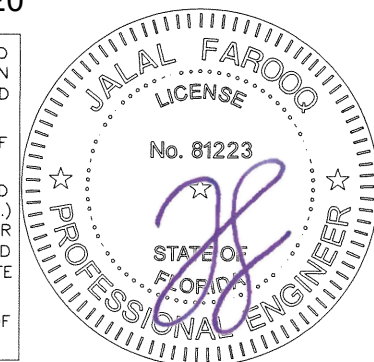



af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
STORE \20-11F-ECO

SERIES 1050 ALUM WINDOW WALL SYS. (S.M.I.)
ECO WINDOW SYSTEMS, LLC.
8502 N.W. 80th STREET
MEDLEY, FL. 33166
TEL. (305) 885-5299 FAX (305) 885-5902

revisions:		no	date	by	description
		A	10/9/2020		UPDATED TO 2020 FBC
date:	01-27-20	scale:	1/2"=1'-0"	dr. by:	TARIQ
		chk. by:			
drawing no.		20-11F			
sheet		1 of 9			


GLASS DESIGN LOAD CAPACITY - PSF			
NOMINAL DIMS.		9/16" LAM. GLASS	
D.L.O. WIDTH	D.L.O. HEIGHT	EXT. (+)	INT. (-)
36"	78"	100.0	140.0
42"		100.0	140.0
48"		100.0	140.0
54"		100.0	137.2
60"		95.0	123.5
66"		86.4	112.3
72"		79.2	102.9
78"		73.1	95.0
81"		73.1	95.0
36"	90"	100.0	140.0
42"		100.0	140.0
48"		100.0	140.0
54"		100.0	137.2
60"		95.0	123.5
66"		86.4	112.3
72"		79.2	102.9
78"		73.1	95.0
36"	102"	100.0	140.0
42"		100.0	140.0
48"		100.0	140.0
54"		100.0	137.2
60"		95.0	123.5
66"		86.4	112.3
72"		79.2	102.9
78"		73.1	95.0
36"	114"	100.0	140.0
42"		100.0	140.0
48"		100.0	140.0
54"		100.0	137.2
60"		95.0	123.5
66"		86.4	112.3
72"		79.2	102.9
78"		73.1	95.0
36"	126"	100.0	140.0
42"		100.0	140.0
48"		100.0	140.0
54"		100.0	137.2
60"		95.0	123.5
66"		86.4	112.3
72"		79.2	102.9
78"		73.1	95.0
36"	138"	100.0	140.0
42"		100.0	140.0
48"		100.0	140.0
54"		100.0	137.2
60"		95.0	123.5
66"		86.4	112.3
72"		79.2	102.9
78"		73.1	95.0

INTERPOLATION BETWEEN WIDTHS OR HEIGHTS ALLOWED.

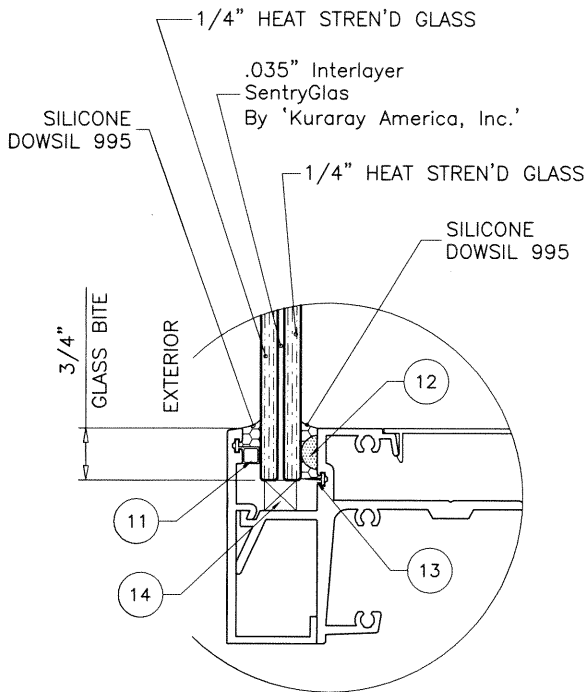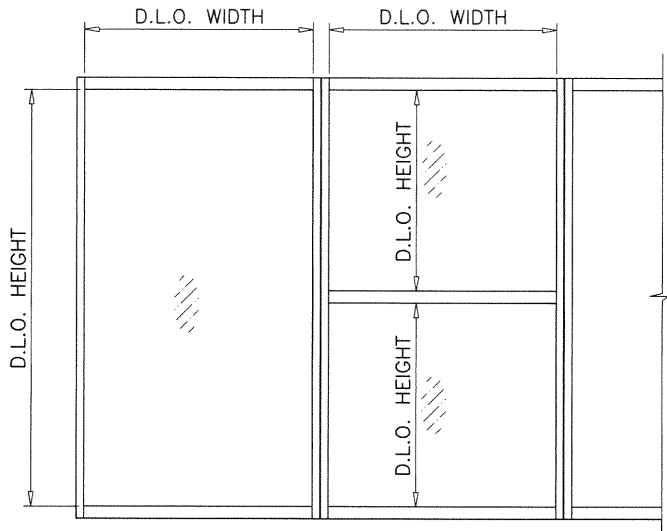

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS).

GLAZING DETAIL
9/16" OVERALL LAM. GLASS

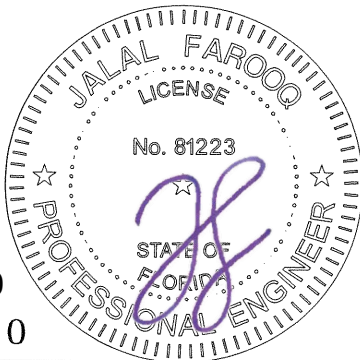

Sealed: 10/5/2020
FL #31610

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES 1050 ALUM WINDOW WALL SYS. (S.M.I.)
ECO WINDOW SYSTEMS, LLC.
8502 N.W. 80th STREET
MEDLEY, FL. 33166
TEL. (305) 885-5299 FAX (305) 885-5902

revisions:
no date by description

date: 01-27-20
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:



drawing no.
20-11F

sheet 2 of 9

STORE 20-11F-ECO


JAMB & MULLION LOAD CAPACITY - PSF											
JAMBS & MULLIONS WITHOUT INTERMEDIATE HORIZONTALS											
NOMINAL DIMS.		JAMB 'J'		JAMB 'J1'		MULL 'M'		MULL 'M1'		MULL 'M2'	
WIDTH (W)	FRAME HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
42"	84"	100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0
48"		100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0
54"		100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0
60"		100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0
66"		100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0
72"		100.0	140.0	100.0	140.0	-	-	100.0	140.0	100.0	140.0
78"		100.0	140.0	100.0	140.0	-	-	100.0	140.0	100.0	140.0
84"		100.0	140.0	100.0	140.0	-	-	100.0	140.0	100.0	140.0
42"	96"	100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0
48"		100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0
54"		100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0
60"		100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0
66"		100.0	140.0	100.0	140.0	-	-	100.0	140.0	100.0	140.0
72"		100.0	140.0	100.0	140.0	-	-	100.0	140.0	100.0	140.0
42"	108"	100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0
48"		100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0
54"		100.0	140.0	100.0	140.0	-	-	100.0	140.0	100.0	140.0
60"		100.0	140.0	100.0	140.0	-	-	100.0	140.0	100.0	140.0
66"		100.0	140.0	100.0	140.0	-	-	100.0	140.0	100.0	140.0
42"	120"	100.0	140.0	100.0	140.0	100.0	129.1	100.0	140.0	100.0	140.0
48"		100.0	140.0	100.0	140.0	100.0	114.4	100.0	140.0	100.0	140.0
54"		100.0	140.0	100.0	140.0	-	-	100.0	139.5	100.0	140.0
60"		100.0	140.0	100.0	140.0	-	-	100.0	127.7	100.0	140.0
42"	132"	100.0	140.0	100.0	140.0	-	-	-	-	100.0	140.0
48"		100.0	139.5	100.0	140.0	-	-	-	-	100.0	140.0
42"	144"	100.0	120.5	100.0	140.0	-	-	-	-	100.0	140.0
48"		100.0	106.5	100.0	140.0	-	-	-	-	100.0	135.0

INTERPOLATION BETWEEN WIDTHS OR HEIGHTS ALLOWED.

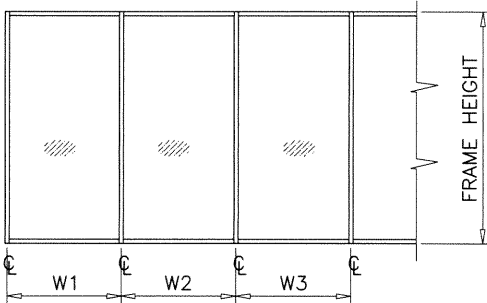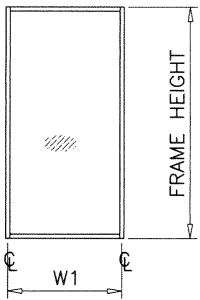


WIDTH (W) = W1
AT FRAME JAMB

WIDTH (W) = $\frac{W2 + W3}{2}$
AT FRAME MULLION

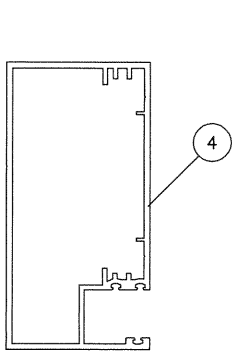


JAMB 'J'

Ix IN^4	Sx IN^3
11.791	3.819

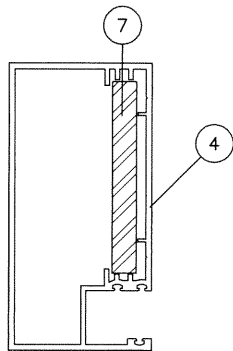


JAMB 'J1'

ALUMINUM	Ix IN^4	Sx IN^3
STEEL	2.6667	1.3333
TOTAL		
Ix ALUM + Ix STL X 2.9	19.4479	

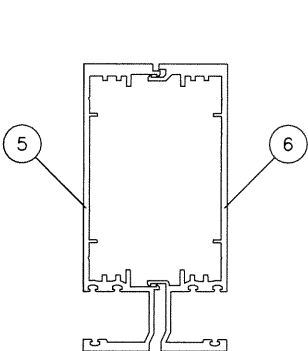


MULLION 'M'

Ix IN^4	Sx IN^3
15.7335	5.2354

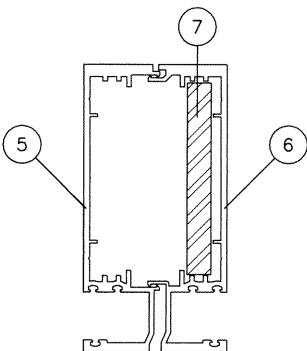


MULLION 'M1'

ALUMINUM	Ix IN^4	Sx IN^3
STEEL	2.6667	1.3333
TOTAL		
Ix ALUM + Ix STL X 2.9	23.3904	

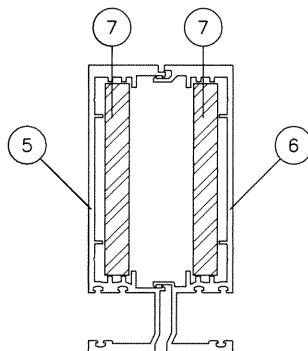

MULLION 'M2'

ALUMINUM	Ix IN^4	Sx IN^3
STEEL	5.3334	2.6667
TOTAL		
Ix ALUM + Ix STL X 2.9	31.0472	

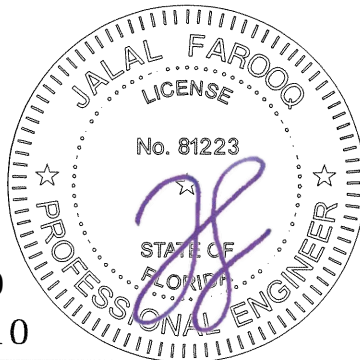

Sealed: 10/5/2020
FL #31610

afC

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES 1050 ALUM WINDOW WALL SYS. (S.M.I.)


ECO WINDOW SYSTEMS, LLC.
8502 N.W. 80th STREET
MEDLEY, FL. 33166
TEL. (305) 885-5299 FAX (305) 885-5902

revisions:		no date by description	
date:	01-27-20	scale:	-
dr.	TARIQ	chk.	by:
drawing no.		20-11F	
sheet		3 of 9	

STORE\20-11F-ECO

JAMB & MULLION LOAD CAPACITY - PSF											
JAMBS & MULLIONS WITH INTERMEDIATE HORIZONTALS											
NOMINAL DIMS.		JAMB 'J'		JAMB 'J1'		MULL 'M'		MULL 'M1'		MULL 'M2'	
WIDTH (W)	FRAME HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
42"	84"	100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0
48"		100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0
54"		100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0
60"		100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0
66"		100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0
72"		100.0	140.0	100.0	140.0	-	-	100.0	140.0	100.0	140.0
78"		100.0	140.0	100.0	140.0	-	-	100.0	140.0	100.0	140.0
84"		100.0	140.0	100.0	140.0	-	-	100.0	140.0	100.0	140.0
42"	96"	100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0
48"		100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0
54"		100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0
60"		100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0
66"		100.0	140.0	100.0	140.0	-	-	100.0	140.0	100.0	140.0
72"		100.0	140.0	100.0	140.0	-	-	100.0	140.0	100.0	140.0
42"	108"	100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0
48"		100.0	140.0	100.0	140.0	100.0	130.0	100.0	140.0	100.0	140.0
54"		100.0	140.0	100.0	140.0	-	-	100.0	140.0	100.0	140.0
60"		100.0	140.0	100.0	140.0	-	-	100.0	140.0	100.0	140.0
66"		100.0	140.0	100.0	140.0	-	-	100.0	131.7	100.0	140.0
42"	120"	100.0	140.0	100.0	140.0	100.0	124.0	100.0	140.0	100.0	140.0
48"		100.0	140.0	100.0	140.0	100.0	108.5	100.0	140.0	100.0	140.0
54"		100.0	140.0	100.0	140.0	-	-	100.0	130.3	100.0	140.0
60"		100.0	138.8	100.0	140.0	-	-	100.0	117.3	100.0	140.0
42"	132"	100.0	140.0	100.0	140.0	-	-	-	-	100.0	140.0
48"		100.0	132.6	100.0	140.0	-	-	-	-	100.0	140.0
42"	144"	100.0	116.7	100.0	140.0	-	-	-	-	100.0	140.0
48"		100.0	102.1	100.0	140.0	-	-	-	--	100.0	131.2

INTERPOLATION BETWEEN WIDTHS OR HEIGHTS ALLOWED.

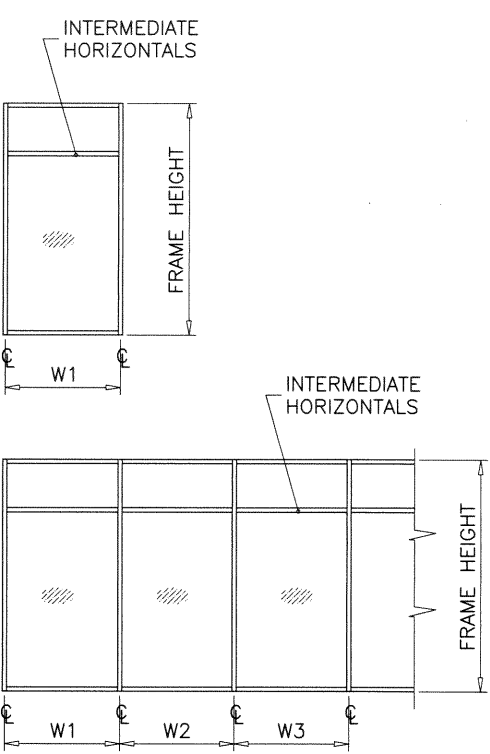

WIDTH (W) = W1
AT FRAME JAMB

WIDTH (W) = $\frac{W2 + W3}{2}$
AT FRAME MULLION

JAMB 'J'

Ix IN^4	Sx IN^3
11.791	3.819

JAMB 'J1'

Ix IN^4	Sx IN^3
ALUMINUM	11.791
STEEL	2.6667
TOTAL	19.4479
Ix ALUM + Ix STL X 2.9	

MULLION 'M'

Ix IN^4	Sx IN^3
15.7335	5.2354

MULLION 'M1'

Ix IN^4	Sx IN^3
ALUMINUM	15.7335
STEEL	2.6667
TOTAL	23.3904
Ix ALUM + Ix STL X 2.9	

MULLION 'M2'

Ix IN^4	Sx IN^3
ALUMINUM	15.7335
STEEL	5.3334
TOTAL	31.0472
Ix ALUM + Ix STL X 2.9	

Sealed: 10/5/2020
FL #31610



AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES 1050 ALUM WINDOW WALL SYS. (S.M.I.)

ECO WINDOW SYSTEMS, LLC.
8502 N.W. 80th STREET
MEDLEY, FL. 33166
TEL. (305) 885-5299 FAX (305) 885-5902

revisions:

no	date	by	description

date: 01-27-20

scale: -

dr. by: TARIQ


chk. by:

drawing no.
20-11F

sheet 4 of 9


HEAD/SILL ANCHOR DESIGN LOAD CAPACITY - PSF							
EXT.(+) & INT.(-)							
NOMINAL DIMS.		ANCHOR TYPE 'A'			ANCHOR TYPES 'B' & 'C'		
WIDTH (W)	FRAME HEIGHT	A3	A4	A5	B3/C3	B4/C4	B5/C5
42"	84"	132.2	140.0	140.0	140.0	140.0	140.0
48"		115.7	140.0	140.0	140.0	140.0	140.0
54"		102.9	137.1	140.0	140.0	140.0	140.0
60"		92.6	123.4	140.0	133.7	140.0	140.0
66"		84.2	112.2	140.0	121.6	140.0	140.0
72"		77.1	102.9	128.6	111.4	140.0	140.0
78"		71.2	94.9	118.7	102.9	137.1	140.0
84"		66.1	88.2	110.2	95.5	127.3	140.0
42"	96"	115.7	140.0	140.0	140.0	140.0	140.0
48"		101.3	135.0	140.0	140.0	140.0	140.0
54"		90.0	120.0	140.0	130.0	140.0	140.0
60"		81.0	108.0	135.0	117.0	140.0	140.0
66"		73.6	98.2	122.7	106.4	140.0	140.0
72"		67.5	90.0	112.5	97.5	130.0	140.0
42"	108"	102.9	137.1	140.0	140.0	140.0	140.0
48"		90.0	120.0	140.0	130.0	140.0	140.0
54"		80.0	106.7	133.3	115.6	140.0	140.0
60"		72.0	96.0	120.0	104.0	138.7	140.0
66"		65.5	87.3	109.1	94.5	126.1	140.0
42"	120"	92.6	123.4	140.0	133.7	140.0	140.0
48"		81.0	108.0	135.0	117.0	140.0	140.0
54"		72.0	96.0	120.0	104.0	138.7	140.0
60"		64.8	86.4	108.0	93.6	124.8	140.0
42"	132"	84.2	112.2	140.0	121.6	140.0	140.0
48"		73.6	98.2	122.7	106.4	140.0	140.0
42"	144"	77.1	102.9	128.6	111.4	140.0	140.0
48"		67.5	90.0	112.5	97.5	130.0	140.0

INTERPOLATION BETWEEN WIDTHS OR HEIGHTS ALLOWED.

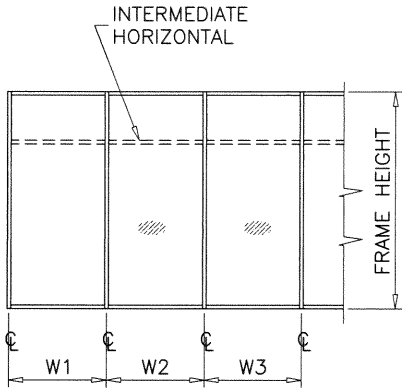


WIDTH (W) = W1
AT FRAME JAMB


WIDTH (W) = $\frac{W2 + W3}{2}$
AT FRAME MULLION



A3, B3, C3



A4, B4, C4

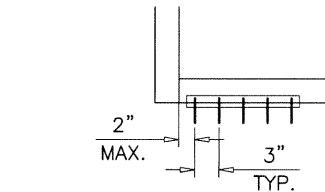


A5, B5, C5

ANCHORS TYPES: SEE SHEET 6 FOR DESCRIPTION

- A3 = (3) ANCHORS TYPE 'A' AT EACH SIDE OF JAMB AND MULLION
B3 = (3) ANCHORS TYPE 'B' AT EACH SIDE OF JAMB AND MULLION
C3 = (3) ANCHORS TYPE 'C' AT EACH SIDE OF JAMB AND MULLION
A4 = (4) ANCHORS TYPE 'A' AT EACH SIDE OF JAMB AND MULLION
B4 = (4) ANCHORS TYPE 'B' AT EACH SIDE OF JAMB AND MULLION
C4 = (4) ANCHORS TYPE 'C' AT EACH SIDE OF JAMB AND MULLION
A5 = (5) ANCHORS TYPE 'A' AT EACH SIDE OF JAMB AND MULLION
B5 = (5) ANCHORS TYPE 'B' AT EACH SIDE OF JAMB AND MULLION
C5 = (5) ANCHORS TYPE 'C' AT EACH SIDE OF JAMB AND MULLION

Sealed: 10/5/2020
FL #31610

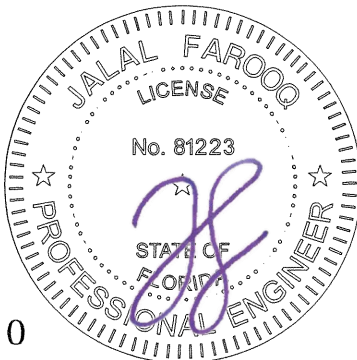

SERIES 1050 ALUM WINDOW WALL SYS. (S.M.I.)

ECO WINDOW SYSTEMS, LLC.

8502 N.W. 80th STREET

MEDLEY, FL. 33166

TEL. (305) 885-5299

FAX (305) 885-5902

AL-FAROOQ CORPORATION

ENGINEERS & PRODUCT DEVELOPMENT

9360 SUNSET DRIVE, SUITE 220

MIAMI, FLORIDA 33173

TEL. (305) 264-8100

FAX. (305) 262-6978

STORE 20-11F-ECO

revisions:
no date by description

date: 01-27-20

scale: -





dr. by: TARIQ

chk. by:

drawing no.

20-11F

sheet 5 of 9

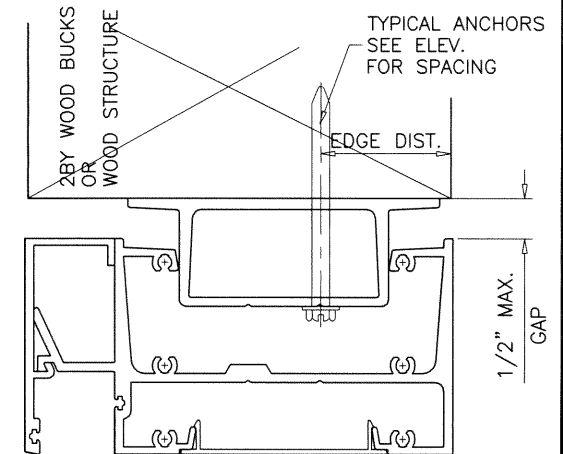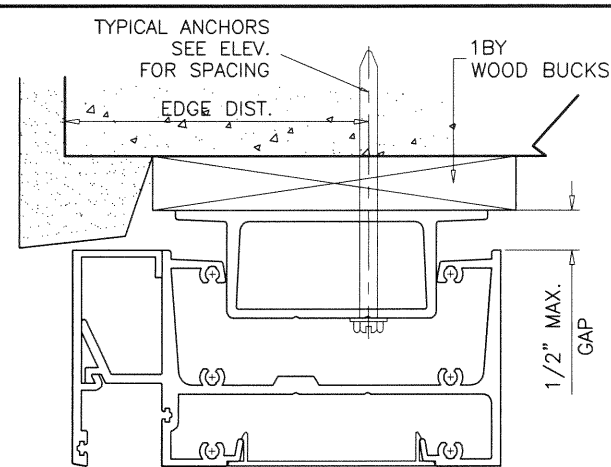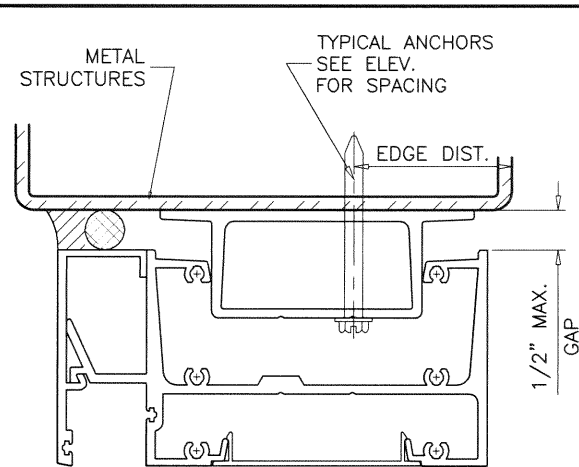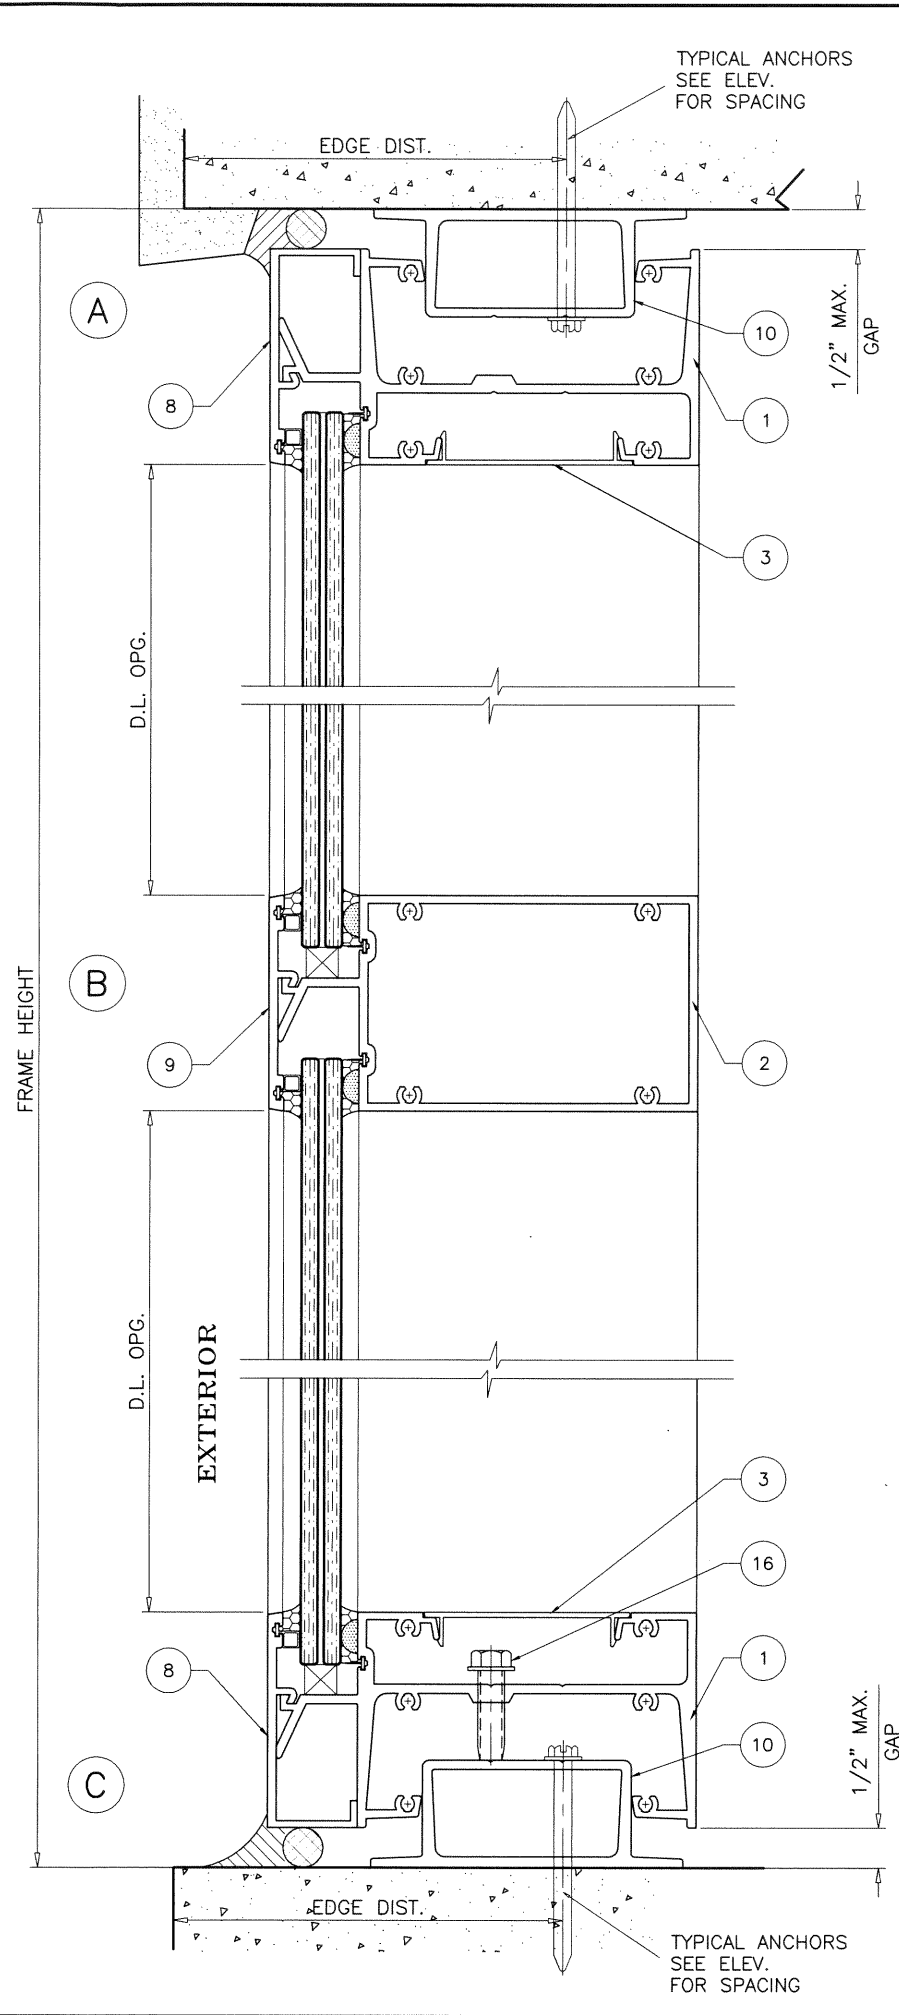

METAL STRUCTURES NOT BY 'ECO WINDOW'
MUST SUPPORT LOADS IMPOSED BY GLAZING SYSTEM AND
TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

TYPE 'A' - 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD
THRU 1BY BUCKS INTO CONCRETE
1-3/4" MIN. EMBED INTO CONCRETE

TYPE 'B' - 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
DIRECTLY INTO CONCRETE
1-3/4" MIN. EMBED INTO CONCRETE


TYPE 'C' - #14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
INTO F.B.C. APPROVED MULLIONS
OR
INTO METAL STRUCTURES
(3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS
ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE = 2-1/2" MIN.
INTO WOOD STRUCTURE = 1" MIN.
INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD OR SILL SG = 0.55 MIN.
CONCRETE AT HEAD OR SILL f'c = 3000 PSI MIN.

Sealed: 10/5/2020
FL #31610

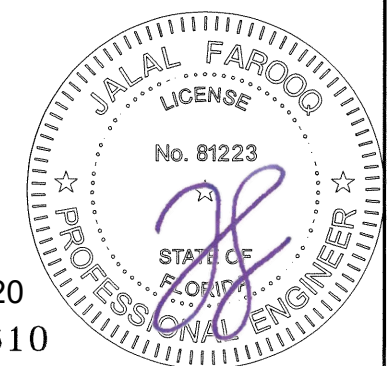

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
STORE 20-11F-ECO

SERIES 1050 ALUM WINDOW WALL SYS. (S.M.I.)
ECO WINDOW SYSTEMS, LLC.
8502 N.W. 80th STREET
MEDLEY, FL. 33166
TEL. (305) 885-5299 FAX (305) 885-5902


revisions:		date:		scale:		dr. by:		chk. by:	
no	by description	date	by	no	by	date	by	no	by
01-27-20				3/8" = 1"		TARIQ			
drawing no.		20-11F		sheet 6 of 9					

MAX. FRAME HEIGHT	GAP	
	MIN.	MAX.
78"	1/4"	3/4"
96"	5/16"	3/4"
120"	3/8"	3/4"
144"	1/2"	3/4"

NOTE:
 MAX. MOVEMENT CONSIDERED=100% STRETCH.
 PLEASE REFER TO SEALANT MANUFACTURER'S DATA AND APPLICATION
 MANUAL FOR COMPATABILITY OF SEALANT TO SUBSTRATE & WINDOWALL
 MATERIAL/FINISH AND COMPLIANCE FOR WARRANTY.
 REFER TO ACI-117-10 FOR CONSTRUCTION TOLERANCES.

ALTERNATE SEALANTS AT JAMB GAPS CAN BE DESIGNED BY
 ENGINEER OF RECORD BASED ON MANUFACTURER GUIDE LINES.

GAPS LESS THAN 1/4" MAY BE DESIGNED BY ENGINEER OF RECORD BY
 THE USE OF BOND BREAKER TAPE OR 15% OF GAP ALLOWED MOVEMENT.

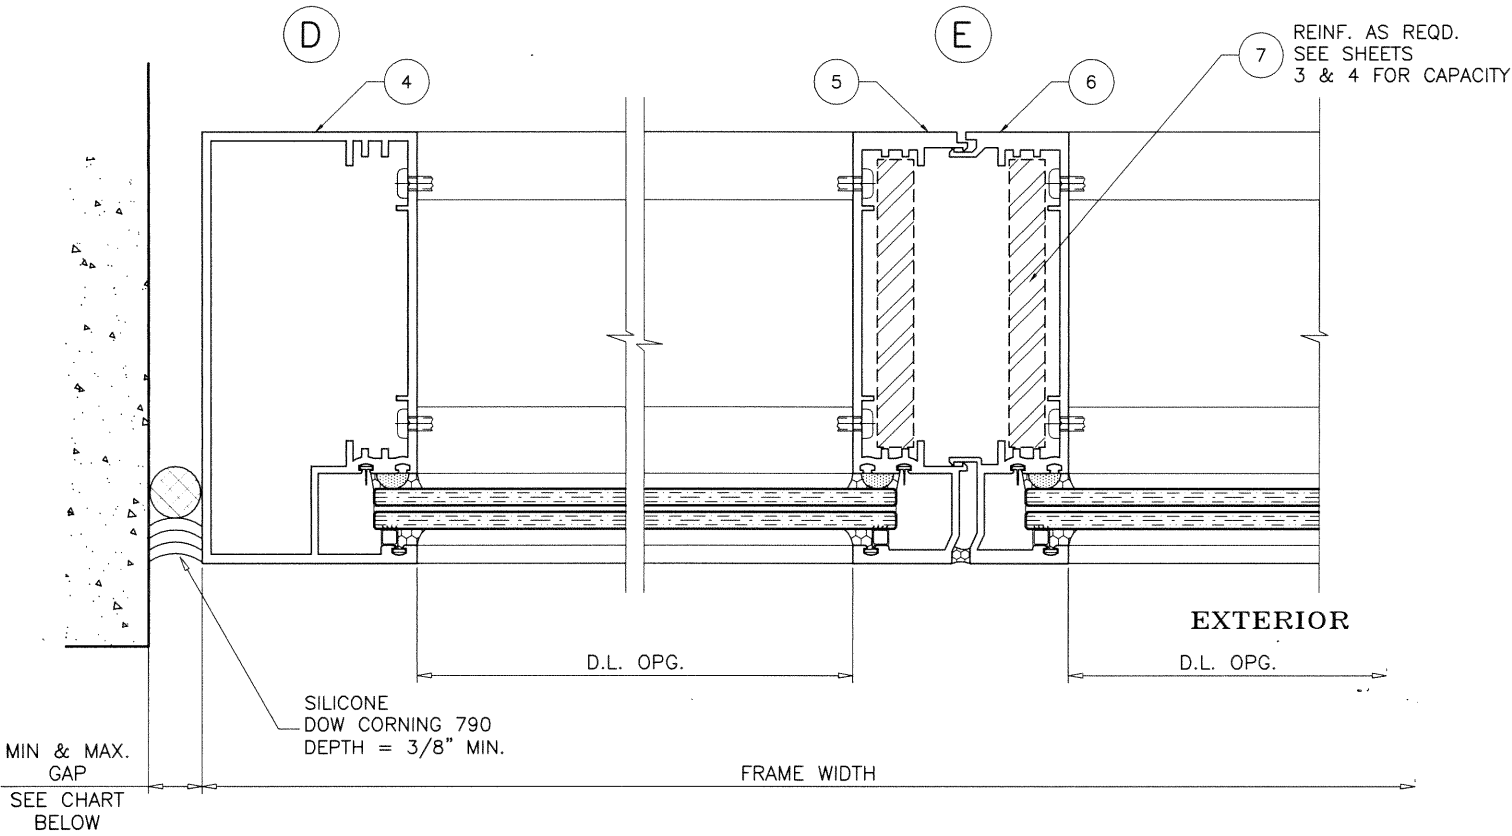

Sealed: 10/5/2020
 FL #31610

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES 1050 ALUM WINDOW WALL SYS. (S.M.I.)

ECO WINDOW SYSTEMS, LLC.
 8502 N.W. 80th STREET
 MEDLEY, FL. 33166
 TEL. (305) 885-5299 FAX (305) 885-5902

revisions:

no	date	by	description

date: 01-27-20

scale: 3/8" = 1"










dr. by: TARIQ

chk. by:

drawing no.


20-11F

sheet 7 of 9

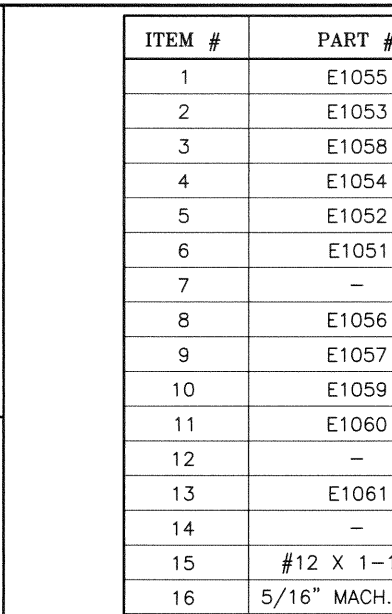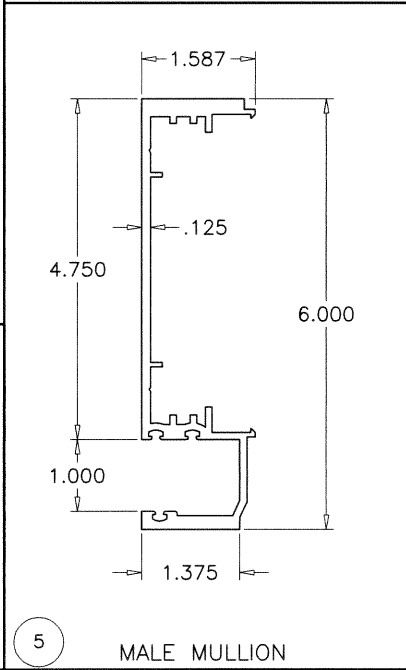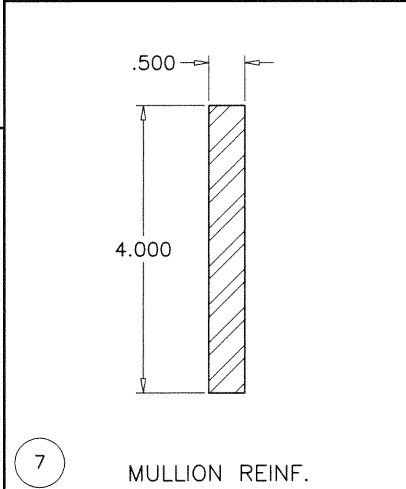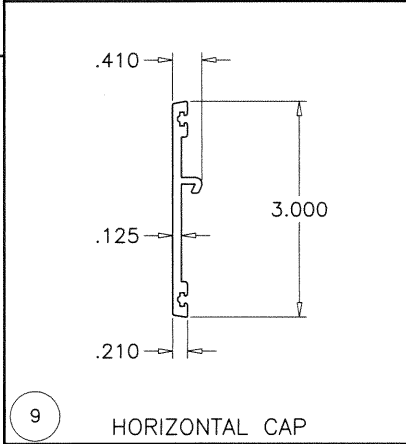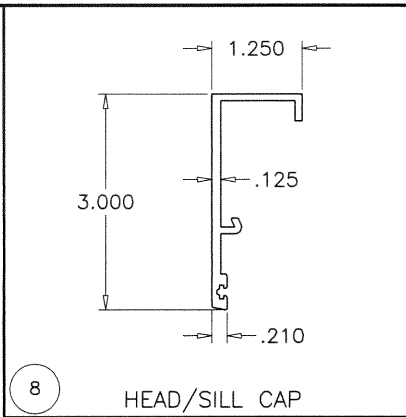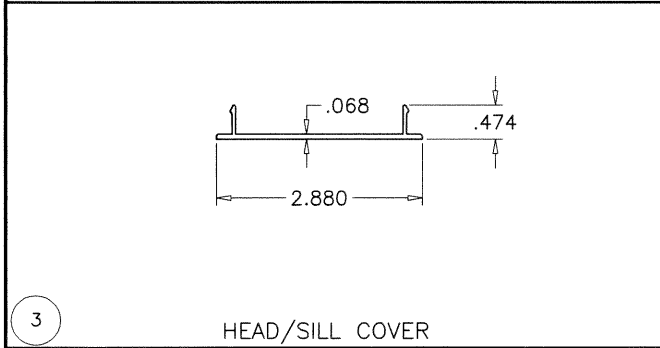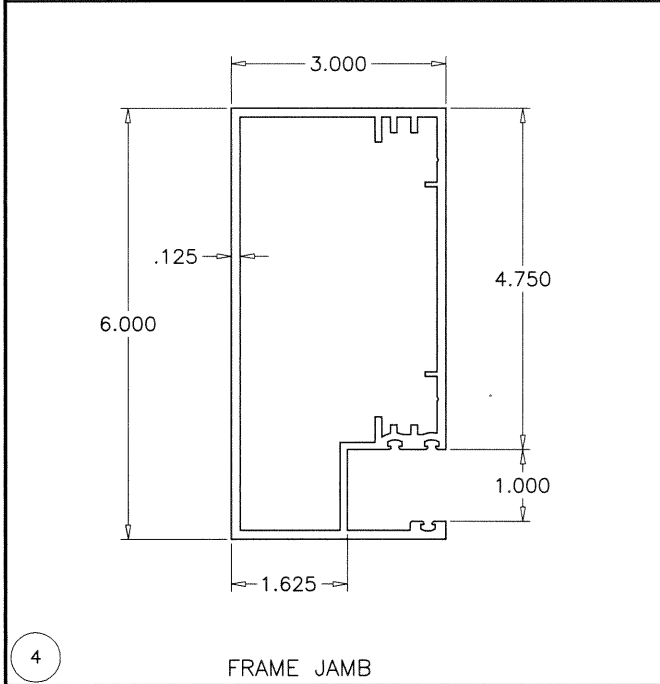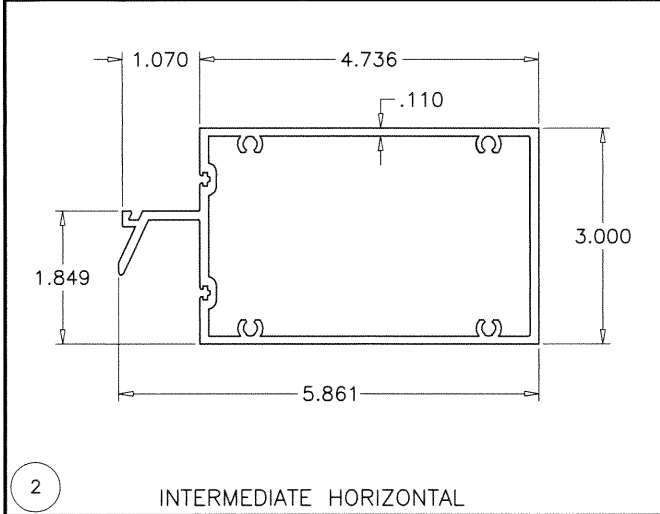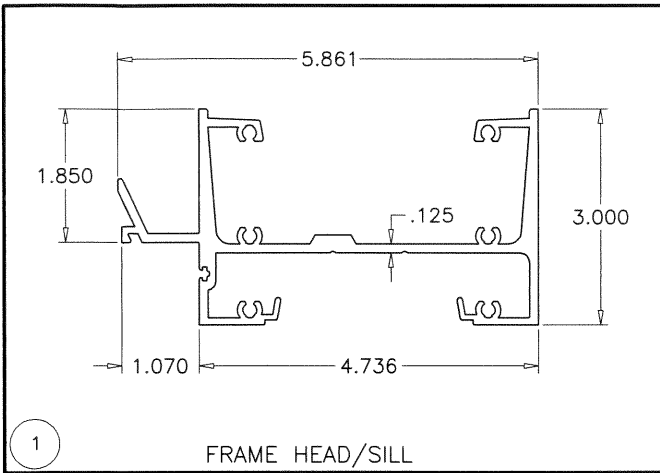

ITEM #	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	E1055	AS REQD.	FRAME HEAD/SILL	6063-T6	-
2	E1053	AS REQD.	INTERMEDIATE HORIZONTAL	6063-T6	-
3	E1058	AS REQD.	HEAD/SILL COVER	6063-T5	-
4	E1054	AS REQD.	FRAME JAMB	6063-T6	-
5	E1052	AS REQD.	MALE MULLION	6063-T6	-
6	E1051	AS REQD.	FEMALE MULLION	6063-T6	-
7	-	AS REQD.	MULLION REINF.	STEEL	-
8	E1056	AS REQD.	HEAD/SILL CAP	6063-T6	-
9	E1057	AS REQD.	HORIZONTAL CAP	6063-T6	-
10	E1059	AS REQD.	ANCHOR BASE	6063-T6	-
11	E1060	4/ LITE	EXTERIOR GLASS SPACER	EPDM	DUROMETER 70±5 SHORE A
12	-	4/ LITE	INTERIOR GLASS SPACER	EPDM	DUROMETER 80±5 SHORE A
13	E1061	4/ LITE	SILICONE DAM	EPDM	DUROMETER 80±5 SHORE A
14	-	2/ LITE	SETTING BLOCKS, AT 1/4 POINTS (LAM. GLASS)	EPDM	DUROMETER 80±5 SHORE A
15	#12 X 1-1/4"	AS REQD.	ASSEMBLY FASTENERS	ST/ST	PH SMS
16	5/16" MACH. BOLT	2/ LITE	LEVELING SCREW	ST/ST	-

Sealed: 10/5/2020
FL #31610

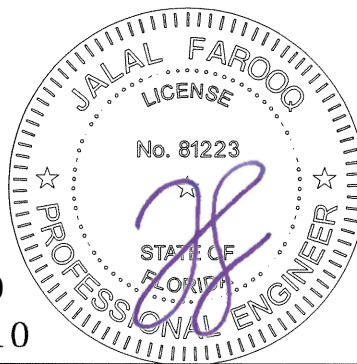

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 262-6978

SERIES 1050 ALUM WINDOW WALL SYS. (S.M.I.)


ECO WINDOW SYSTEMS, LLC.
8502 N.W. 80th STREET
MEDLEY, FL. 33166
TEL. (305) 885-5299 FAX (305) 885-5902

revisions:


no	date	by	description

date: 01-27-20
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:


drawing no.
20-11F
sheet 8 of 9

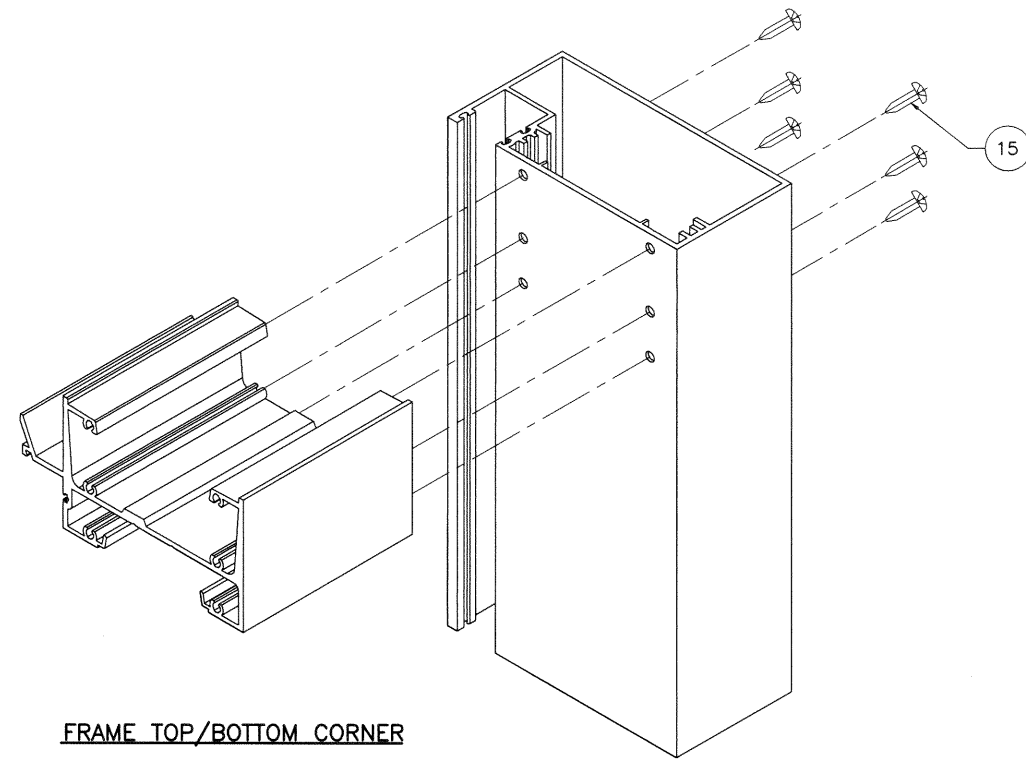


FRAME TOP/BOTTOM CORNER

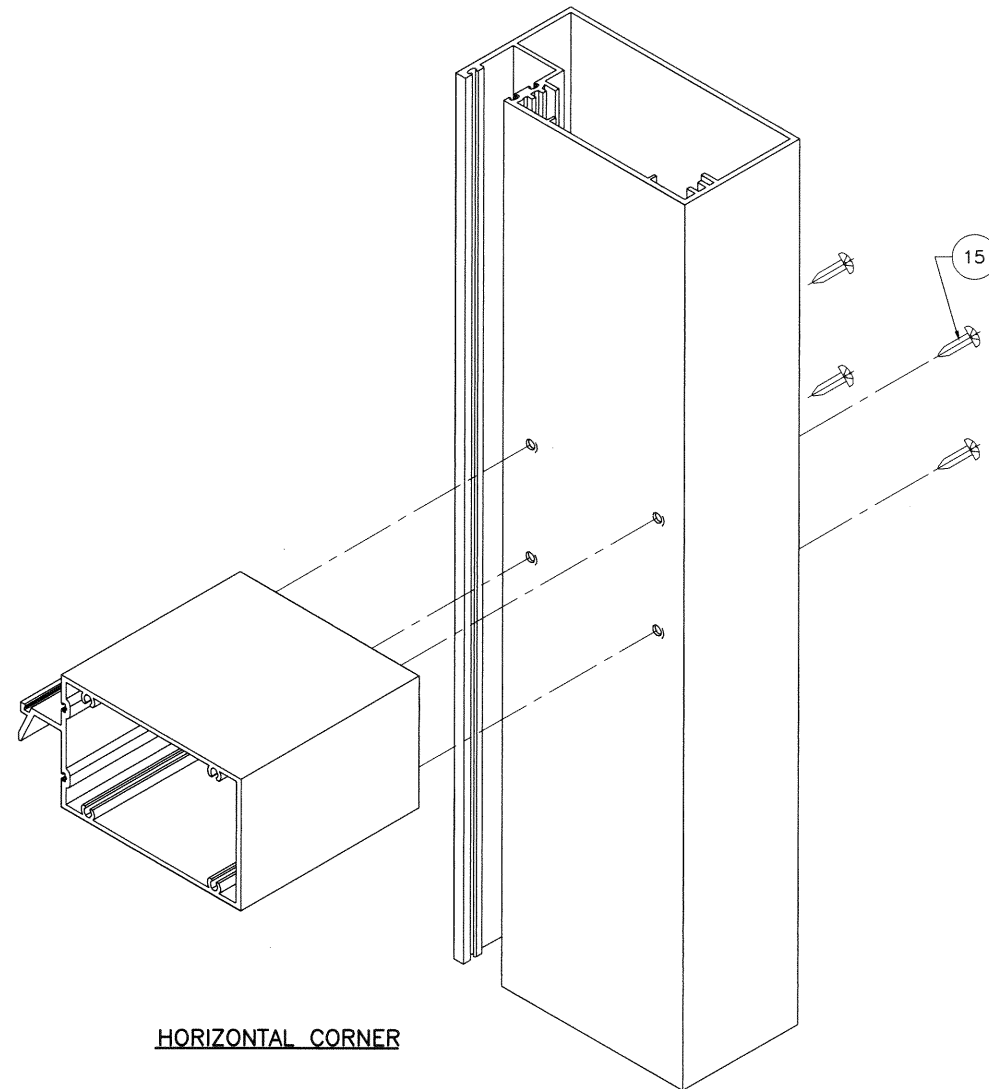

HORIZONTAL CORNER

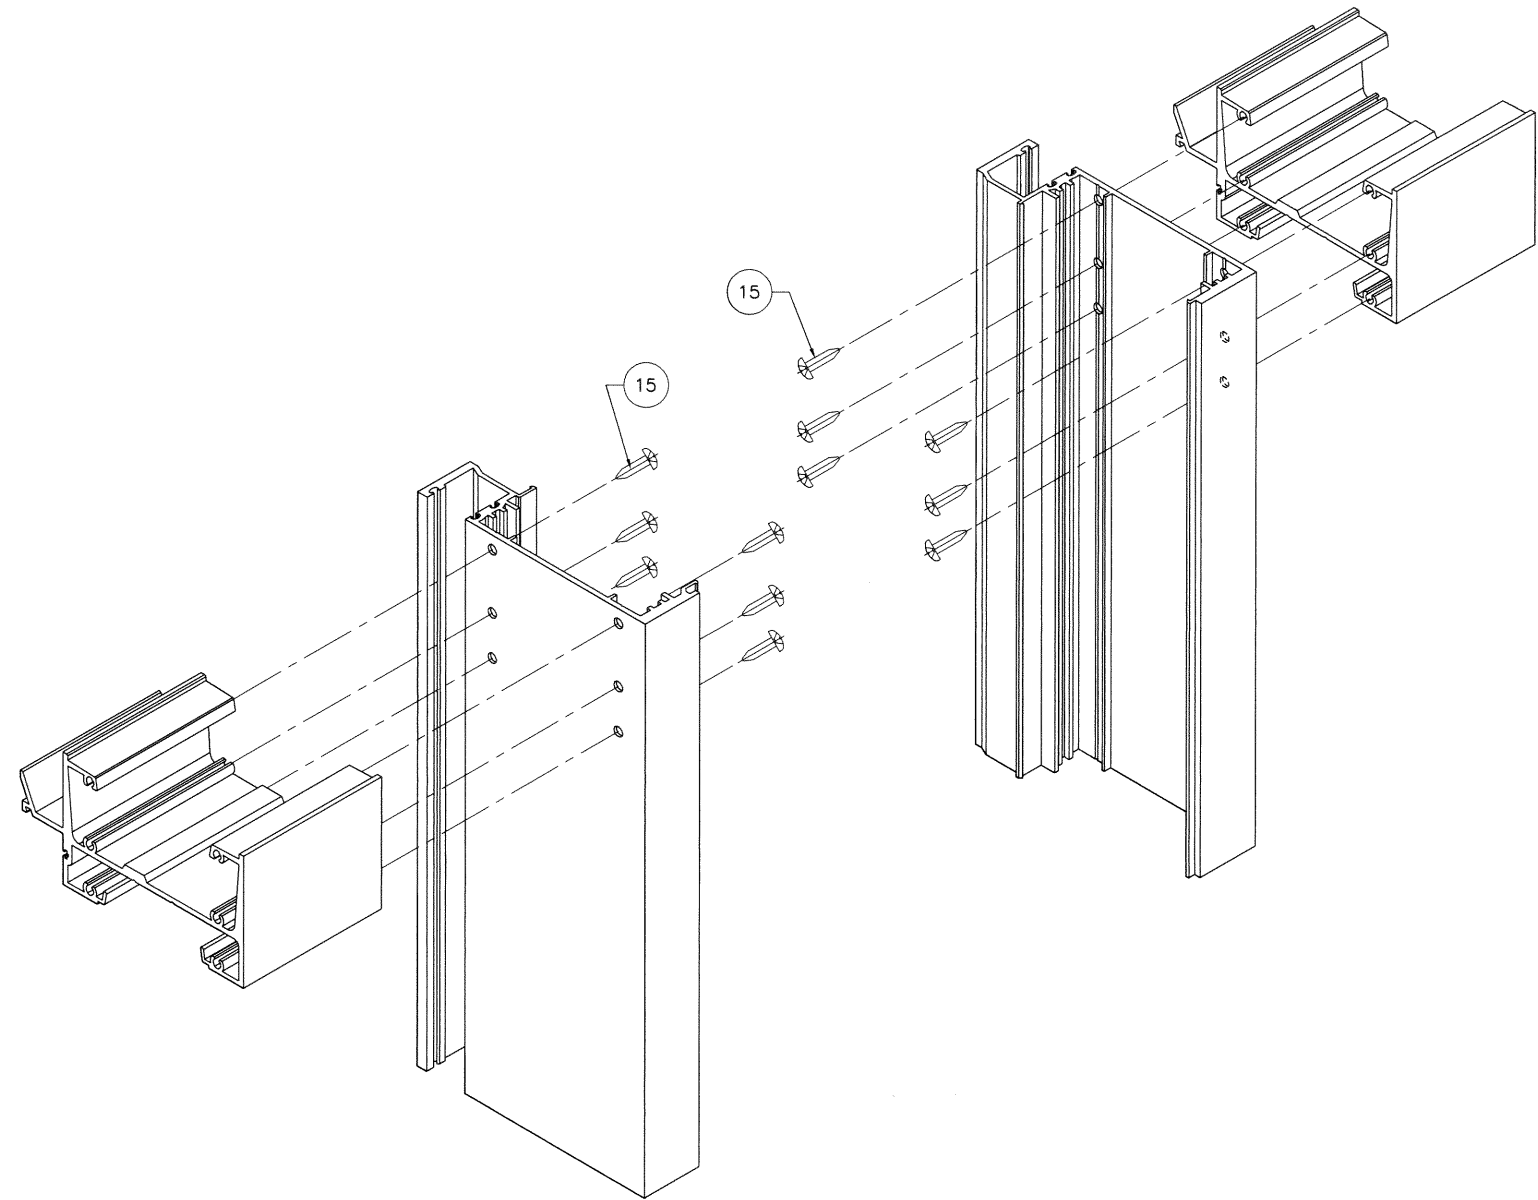

MULLION CORNER

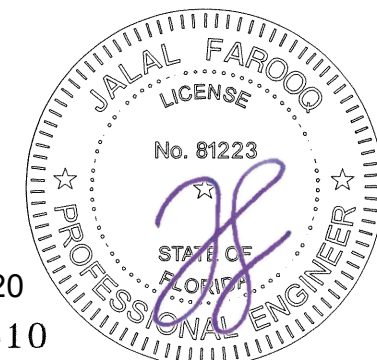

Sealed: 10/5/2020
FL #31610

af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

STORE 20-11F-ECO

SERIES 1050 ALUM WINDOW WALL SYS. (S.M.I.)

ECO WINDOW SYSTEMS, LLC.
8502 N.W. 80th STREET
MEDLEY, FL. 33166
TEL. (305) 885-5299 FAX (305) 885-5902

revisions:

no	date	by description

date: 01-27-20

scale: 3/8" = 1"

dr. by: TARIQ

chk. by:

drawing no.

20-11F

sheet 9 of 9