

s:\projects\euro-wall systems\fbc-23-1121 - fbc submittal - non-impact aluminum products design pressure table updates\dwgs\131965\ews032.dwg
12/8/2023 1:20 PM

EURO-WALL, LLC

FIXED WINDOW

(NON-HVHZ)(NON-IMPACT)

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN, UNLESS OTHERWISE STATED.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/16 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- THROUGH FRAME:** FOR INSTALLATION INTO 2X WOOD BUCK OR FRAMING, USE ONE #10 WOOD SCREW TYPE INSTALLATION ANCHOR PER LOCATION OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM 1 1/2" EMBEDMENT.
- THROUGH FRAME:** FOR INSTALLATION INTO METAL STUD, USE ONE #10 SELF-DRILLING SCREW TYPE INSTALLATION ANCHOR PER LOCATION OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM PENETRATION OF 3 THREADS BEYOND METAL STRUCTURE.
- THROUGH FRAME :** FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY OR DIRECTLY INTO CONCRETE/MASONRY, USE 3/16" ITW TAPCONS OR 3/16" DEWALT ULTRA CON+ OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2" MINIMUM EMBEDMENT.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - STEEL - MIN. TENSILE YIELD STRENGTH OF 33 KSI. MIN. 18 GAUGE THICKNESS (0.0478").
 - WOOD - MINIMUM SPECIFIC GRAVITY = 0.55.
 - ALUMINUM - MIN. 6063-T5, MIN 1/8" WALL THICKNESS.
 - CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
 - GROUT-FILLED CUM- UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI AN GROUT CONFORMS TO ASTM C-476 MINIMUM GROUT COMPRESSIVE STRENGTH OF 2000 PSI.

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED TO THE FOLLOWING:
 - TAS 202-94
- ADEQUACY OF THE EXISTING STRUCTURAL 2X WOOD FRAMING OR METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREA.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NIT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR THE USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** TO PROTECT THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- GLASS SHALL COMPLY WITH LOAD RESISTANCE REQUIREMENTS PER ASTM E1300. SEE SHEETS 9 & 10.
- WINDOW FRAME MATERIAL: 6063-T6 ALUMINUM
- DESIGNATION "X" AND "O" STAND FOR THE FOLLOWING
X: OPERABLE PANEL
O: FIXED PANEL

	TABLE OF CONTENTS
SHEET	SHEET DESCRIPTION
1	INSTALLATION NOTES & GENERAL NOTES
2	ELEVATION & ANCHOR LAYOUT
3	DESIGN PRESSURE TABLE
4	ELEVATION MULLED UNIT
5	ANCHOR LAYOUT MULLED UNIT
6	VERTICAL SECTIONS
7	HORIZONTAL SECTIONS
8	MULLION DESIGN PRESSURE TABLE & SECTIONS - ANGLE
9	GLAZING DETAILS (WET GLAZED)
10	GLAZING DETAILS (DRY GLAZED)

DESIGN PRESSURE TABLE		WATER TEST PRESSURE	IMPACT RATED
SINGLE UNIT	SEE SHEET 3	12 PSF	NON-IMPACT
MULLED UNIT	SEE SHEET 8	9 PSF	



EURO-WALL, LLC
P.O. BOX 8007
NORTH PORT, FL 34290
PH: 888-989-3876


TITLE: FIXED WINDOW
(NON-HVHZ)(NON-IMPACT)
INSTALLATION NOTES
& GENERAL NOTES

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
COMPANY NAME UPD.	SH	09/23
DP TABLE UPDATES	SH	12/23

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

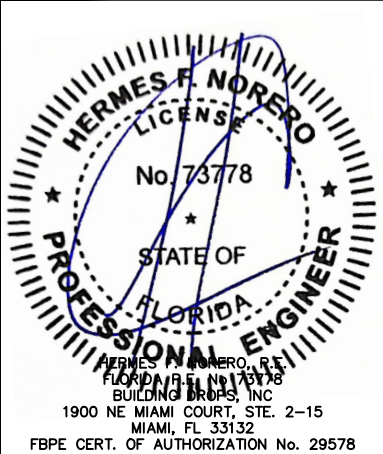

FL #: FL31965

DATE: 04.26.23

DWG. BY: SH
CHK. BY: HFN

SCALE: NTS


DWG. #: EWS032

SHEET:


1

OF 10

s:\projects\euro-wall systems\fbc-23-1121 - fbc submittal - non-impact aluminum products design pressure table updates\dwgs\131965\ews032.dwg
12/8/2023 1:20 PM

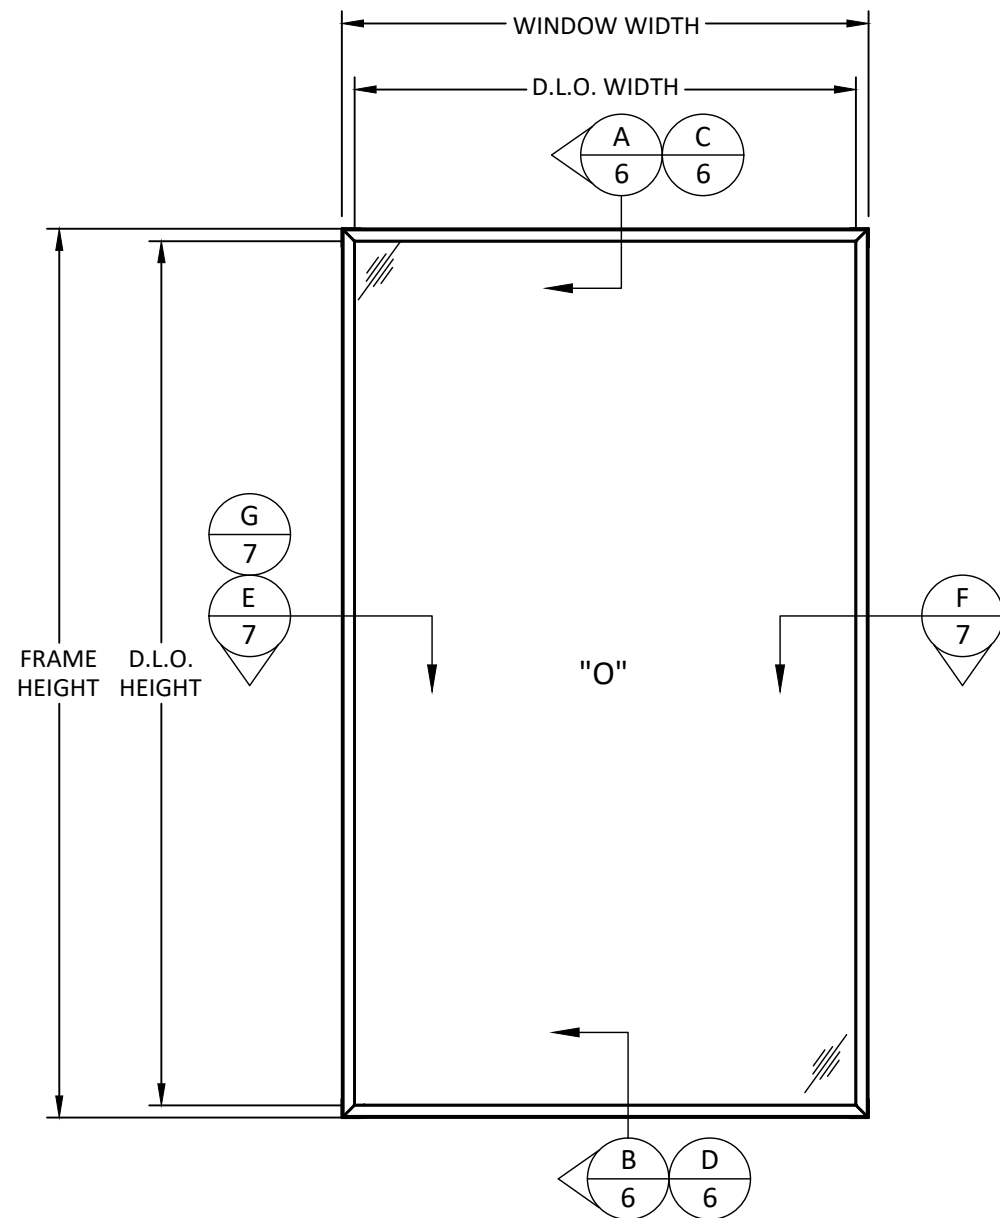

ELEVATION
SINGLE UNIT

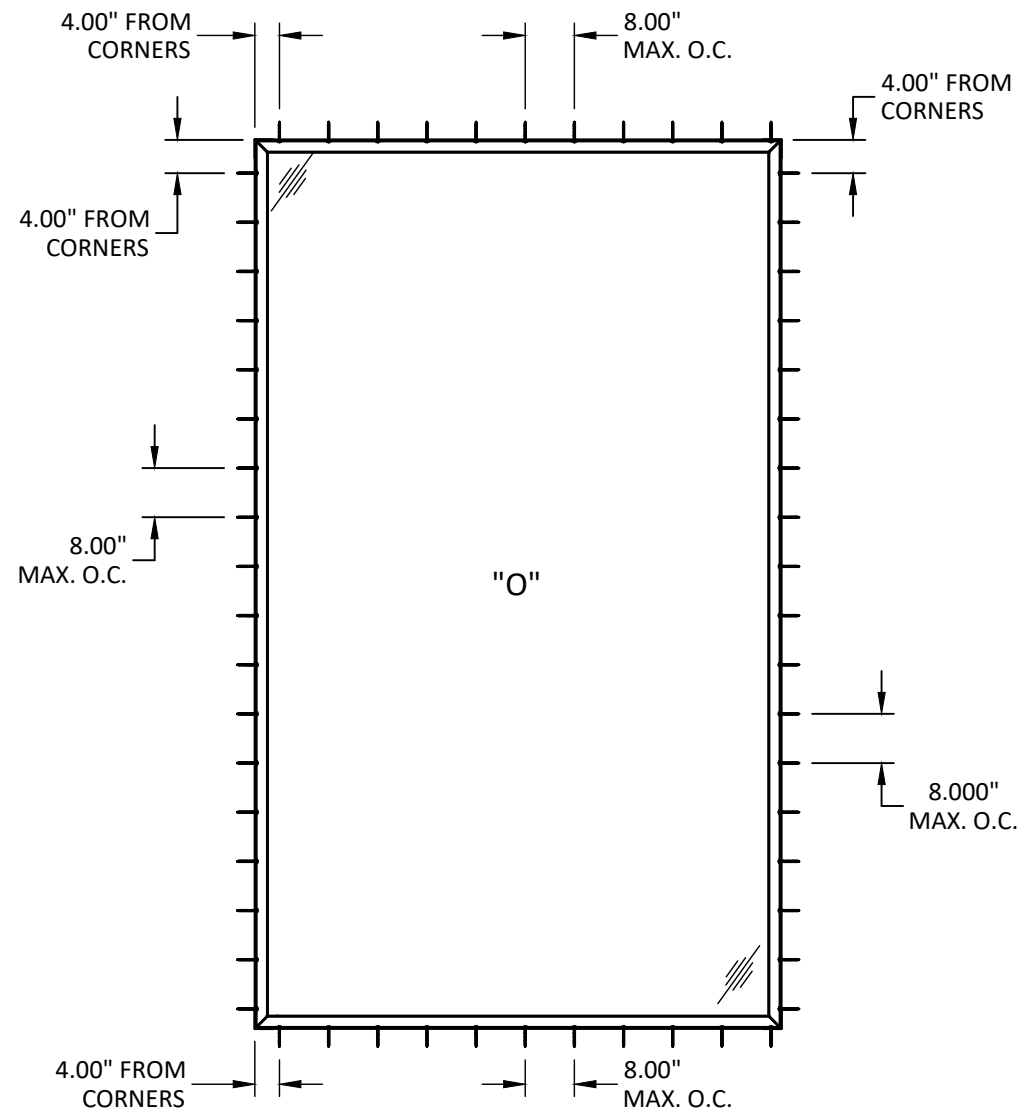

ANCHOR LAYOUT
THROUGH FRAME INSTALLATION


TITLE: **FIXED WINDOW**
(NON-HVHZ)(NON-IMPACT)
ELEVATION, ANCHOR LAYOUT, &
DESIGN PRESSURE TABLE
(SINGLE UNIT)

PREPARED BY: **BUILDING DROPS, INC.**
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
COMPANY NAME UPD.	SH	09/23
DP TABLE UPDATES	SH	12/23

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

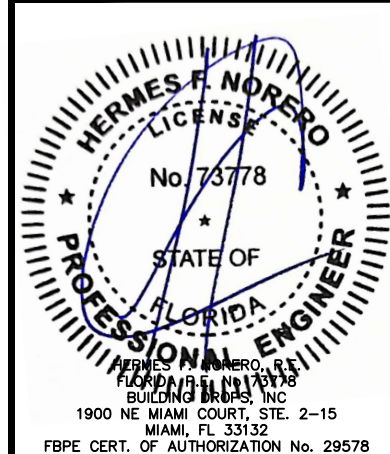

FL #: **FL31965**

DATE: **04.26.23**

DWG. BY: **SH** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **EWS032**

SHEET:


2

OF 10

s:\projects\euro-wall systems\fbc-23-1121 - fbc submittal - non-impact aluminum products design pressure table updates\dwgs\131965\ews032.dwg 12/8/2023 1:20 PM

DESIGN PRESSURE TABLE FOR FIXED WINDOW

DESIGN PRESSURE TABLE (+/- PSF)																					
UNIT HEIGHT (INCHES)	NOMINAL UNIT WIDTH (INCHES)																				
	49	55	61	67	73	79	85	91	97	103	109	115	121	127	133	139	145	151	157	163	169
	72	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
	78	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	79.9
	84	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	79.0	77.9	76.9	75.9
	90	80.0	80.0	80.0	80.0	80.0	80.0	80.0	75.6	75.6	75.6	75.6	75.6	75.6	75.6	75.6	75.6	75.6	74.7	73.6	72.6
	96	80.0	80.0	80.0	80.0	80.0	80.0	80.0	74.7	70.8	70.8	70.8	70.8	70.8	70.8	70.8	70.8	70.8	70.8	70.8	69.7
	102	80.0	80.0	80.0	80.0	80.0	80.0	80.0	74.7	70.1	66.7	66.7	66.7	66.7	66.7	66.7	66.7	66.7	66.7	66.7	66.7
	108	80.0	80.0	80.0	80.0	80.0	80.0	80.0	74.7	70.1	66.0	63.0	63.0	63.0	63.0	63.0	63.0	63.0	63.0	63.0	63.0
	114	80.0	80.0	80.0	80.0	80.0	80.0	80.0	74.7	70.1	66.0	62.4	59.6	59.6	59.6	59.6	59.6	59.6	59.6	59.6	59.6
	120	80.0	80.0	80.0	80.0	80.0	80.0	80.0	74.7	70.1	66.0	62.4	59.1	56.7	56.7	56.7	56.7	56.7	56.7	56.7	56.7
	126	80.0	80.0	80.0	80.0	80.0	80.0	80.0	74.7	70.1	66.0	62.4	59.1	56.2	54.0	54.0	54.0	54.0	54.0	54.0	54.0
	132	80.0	80.0	80.0	80.0	80.0	80.0	80.0	74.7	70.1	66.0	62.4	59.1	56.2	53.5	51.5	51.5	51.5	51.5	51.5	51.5
	138	80.0	80.0	80.0	80.0	80.0	80.0	80.0	74.7	70.1	66.0	62.4	59.1	56.2	53.5	51.1	49.3	49.3	49.3	49.3	49.3
	144	80.0	80.0	80.0	80.0	80.0	80.0	80.0	74.7	70.1	66.0	62.4	59.1	56.2	53.5	51.1	48.9	47.2	47.2	47.2	47.2
	150	80.0	80.0	80.0	80.0	80.0	80.0	78.7	74.7	70.1	66.0	62.4	59.1	56.2	53.5	51.1	48.9	46.9	45.3	45.3	45.3
	156	80.0	80.0	80.0	80.0	80.0	80.0	77.5	74.4	70.1	66.0	62.4	59.1	56.2	53.5	51.1	48.9	46.9	45.0	43.6	43.6
	162	80.0	80.0	80.0	80.0	80.0	80.0	76.4	73.2	70.1	66.0	62.4	59.1	56.2	53.5	51.1	48.9	46.9	45.0	43.3	42.0
	168	80.0	80.0	80.0	80.0	80.0	79.3	75.5	72.2	69.5	66.0	62.4	59.1	56.2	53.5	51.1	48.9	46.9	45.0	43.3	41.7
	174	80.0	80.0	80.0	80.0	80.0	78.5	74.6	71.3	68.5	66.0	62.4	59.1	56.2	53.5	51.1	48.9	46.9	45.0	43.3	41.7
	180	80.0	80.0	80.0	80.0	80.0	77.7	73.8	70.5	67.6	65.2	62.4	59.1	56.2	53.5	51.1	48.9	46.9	45.0	43.3	41.7
	186	80.0	80.0	80.0	80.0	80.0	77.0	73.1	69.7	66.8	64.4	62.2	59.1	56.2	53.5	51.1	48.9	46.9	45.0	43.3	41.7
	192	80.0	80.0	80.0	80.0	80.0	76.4	72.4	69.0	66.1	63.6	61.4	59.1	56.2	53.5	51.1	48.9	46.9	45.0	43.3	41.7
	198	80.0	80.0	80.0	80.0	80.0	75.8	71.8	68.4	65.4	62.9	60.7	58.7	56.2	53.5	51.1	48.9	46.9	45.0	43.3	41.7
	204	80.0	80.0	80.0	80.0	80.0	75.2	71.2	67.8	64.8	62.2	60.0	58.0	56.2	53.5	51.1	48.9	46.9	45.0	43.3	41.7
	210	80.0	80.0	80.0	80.0	79.5	74.7	70.7	67.2	64.3	61.7	59.4	57.4	55.6	53.5	51.1	48.9	46.9	45.0	43.3	41.7
	216	80.0	80.0	80.0	80.0	79.0	74.2	70.2	66.7	63.7	61.1	58.8	56.8	55.0	53.5	51.1	48.9	46.9	45.0	43.3	41.7




UNITS OF THE SHOWN SHAPES ARE ALLOWED PROVIDED CONSTRUCTION, GLAZING, & ANCHORAGE ARE PER DETAILS SHOWN HEREIN. ALL SHAPED UNITS SHALL FIT WITHIN THE RECTANGULAR AREAS AS SHOWN.

- MAXIMUM AREA (RECTANGLE UNITS)= 85" X 144"
- MAXIMUM DP = +/- 80 PSF

DAYLIGHT OPENING CALCULATIONS:

- D.L.O. HEIGHT = FRAME HEIGHT - 4.00"
- D.L.O. WIDTH=FRAME WIDTH - 4.00"

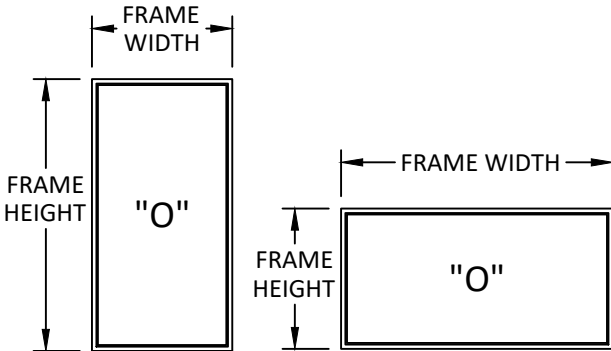

NOTE:
WINDOW WIDTH AND HEIGHT ARE INTERCHANGEABLE FOR ALL SIZES SHOWN HEREIN NOT TO EXCEED MAXIMUM QUALIFIED SQUARE FOOT AREA.

euro-wall

FOLDING | SLIDING | STACKING | PIVOT

EURO-WALL, LLC
P.O. BOX 8007
NORTH PORT, FL 34290
PH: 888-989-3876


TITLE:
FIXED WINDOW
(NON-HVHZ)(NON-IMPACT)
DESIGN PRESSURE TABLE

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
COMPANY NAME UPD.	SH	09/23
DP TABLE UPDATES	SH	12/23

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

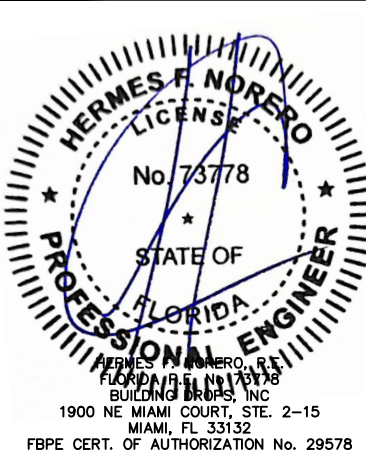

FL #:
FL31965

DATE: **04.26.23**

DWG. BY: **SH** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **EWS032**

SHEET:

3

s:\projects\euro-wall systems\fbc-23-1121 - fbc submittal - non-impact aluminum products design pressure table updates\dwg\131965\ews032.dwg 12/8/2023 1:20 PM

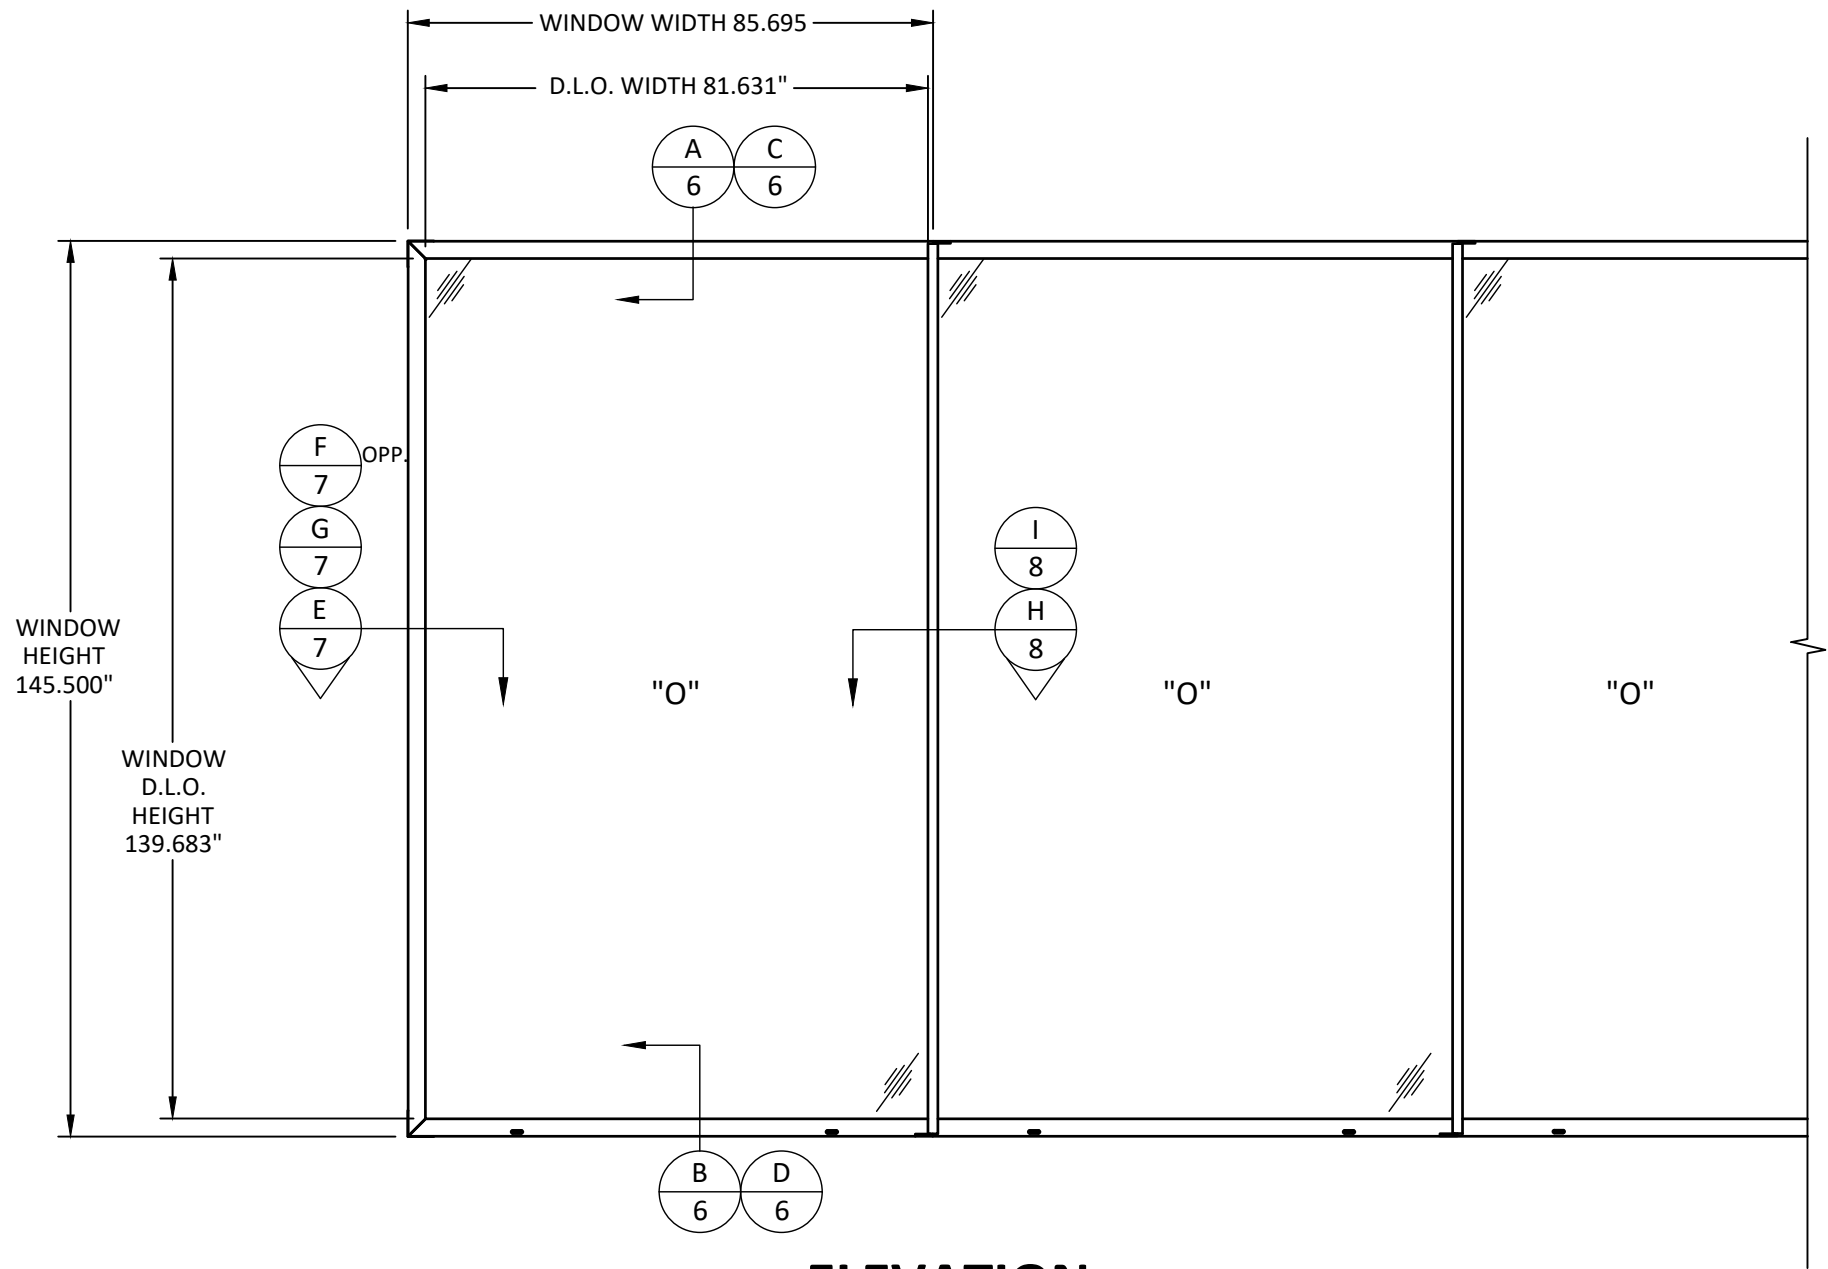

ELEVATION
MULLED UNIT

DESIGN PRESSURE RATING
SEE PAGE 8 FOR DESIGN PRESSURE TABLE

EURO-WALL, LLC
P.O. BOX 8007
NORTH PORT, FL 34290
PH: 888-989-3876

TITLE:
FIXED WINDOW
(NON-HVHZ)(NON-IMPACT)
ELEVATION(MULLED UNIT)

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
COMPANY NAME UPD.	SH	09/23
DP TABLE UPDATES	SH	12/23

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO, P.E.
FLORIDA RES. NO. 73778
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL31965

DATE: **04.26.23**

DWG. BY:
SH


CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **EWS032**

SHEET:
4
OF 10

s:\projects\euro-wall systems\fbc-23-1121 - fbc submittal - non-impact aluminum products design table updates\dwgs\131965\ews032.dwg 12/8/2023 1:20 PM

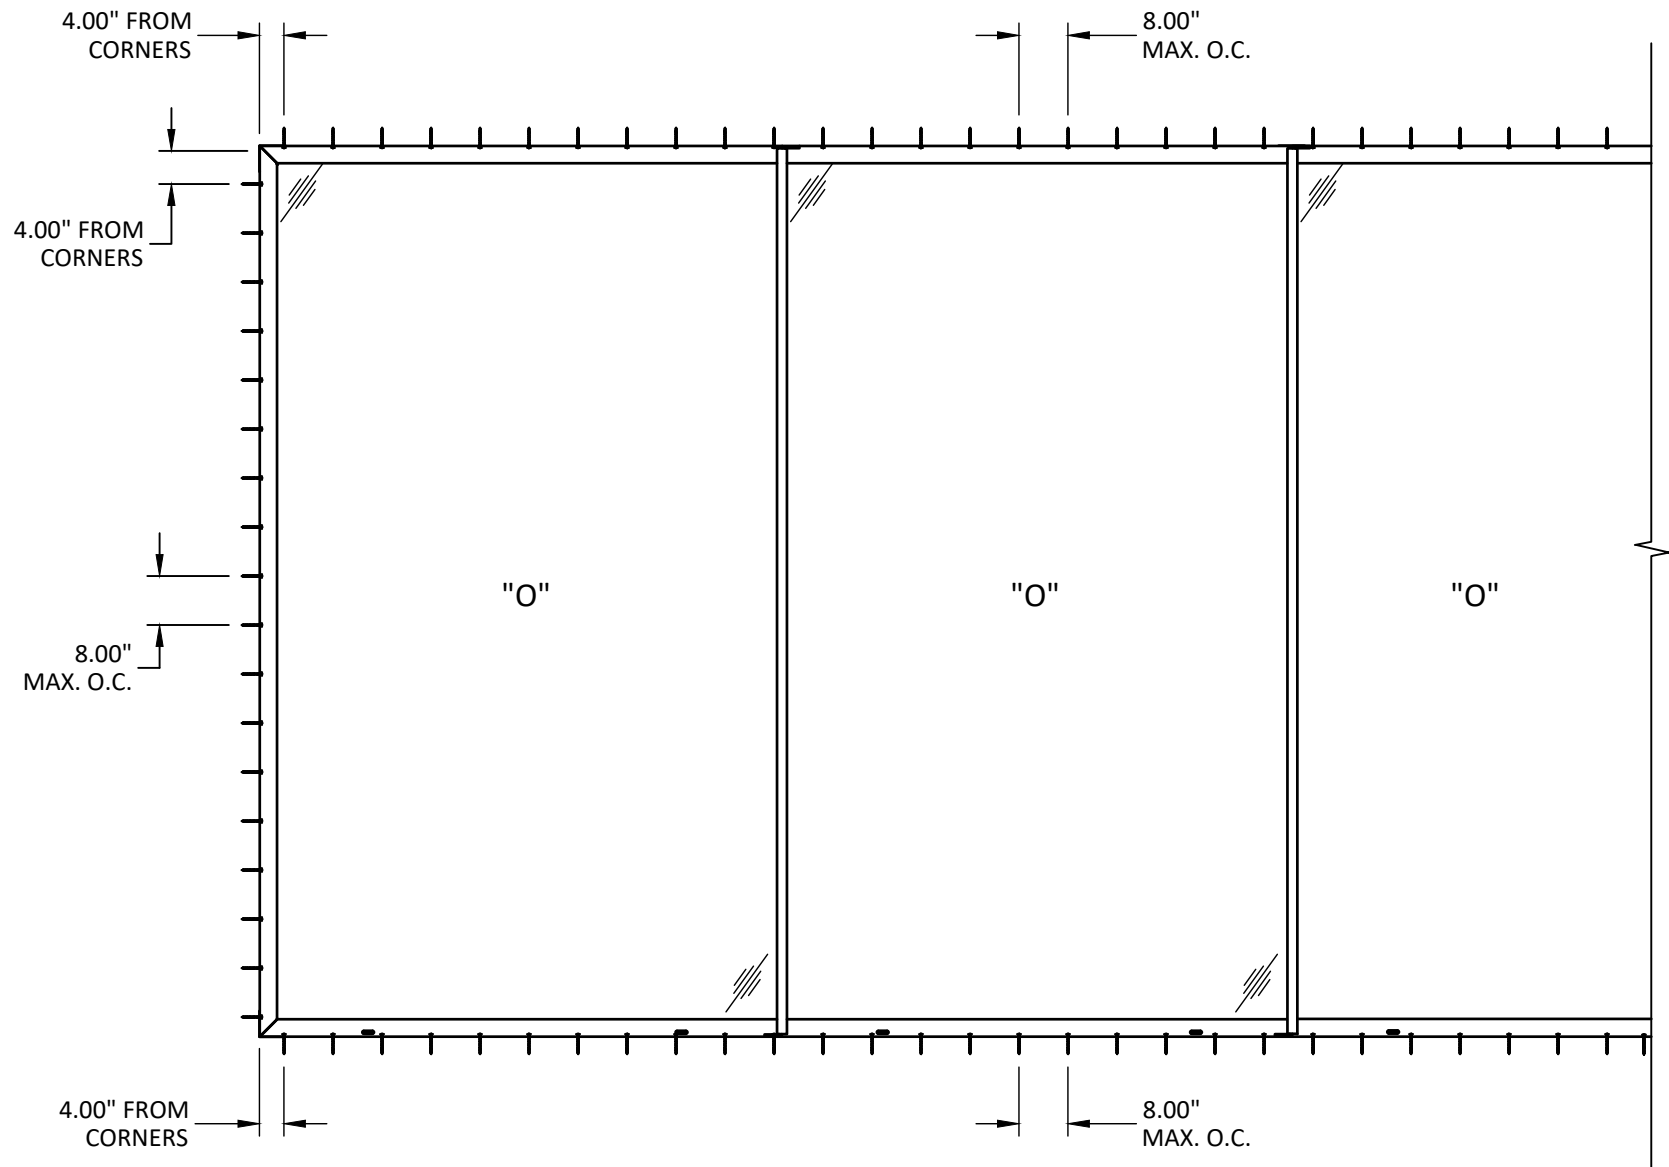

ANCHOR LAYOUT
THROUGH FRAME INSTALLATION

euro-wall

FOLDING | SLIDING | STACKING | PIVOT

EURO-WALL, LLC
P.O. BOX 8007
NORTH PORT, FL 34290
PH: 888-989-3876


TITLE: **FIXED WINDOW
(NON-HVHZ)(NON-IMPACT)
ANCHOR LAYOUT (MULLED UNIT)**

PREPARED BY: **BUILDING DROPS, INC.**
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
COMPANY NAME UPD.	SH	09/23
DP TABLE UPDATES	SH	12/23

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

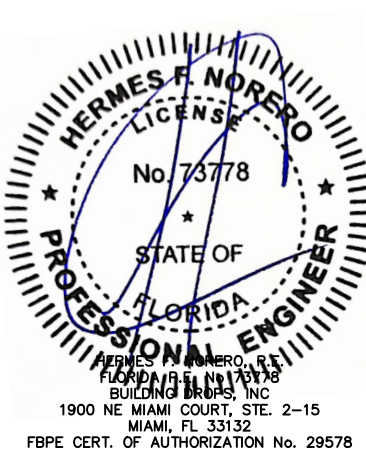

FL #: **FL31965**

DATE: **04.26.23**


DWG. BY: SH	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**


DWG. #: **EWS032**

SHEET:


s:\projects\euro-wall systems\fb-23-1121 - fb- submital - non-impact aluminum products design pressure table updates\dwgs\131965\ews032.dwg
12/8/2023 1:20 PM

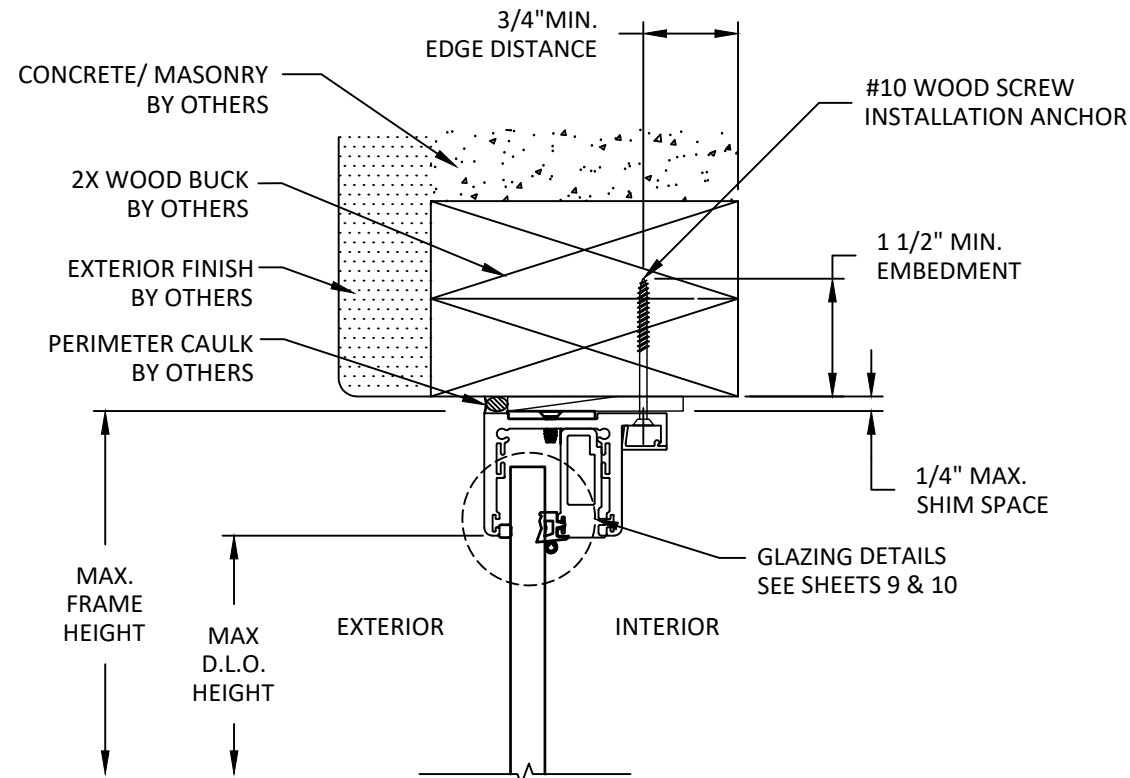


A
6 **VERTICAL SECTION**
HEAD - 2X WOOD BUCK
THROUGH FRAME INSTALLATION

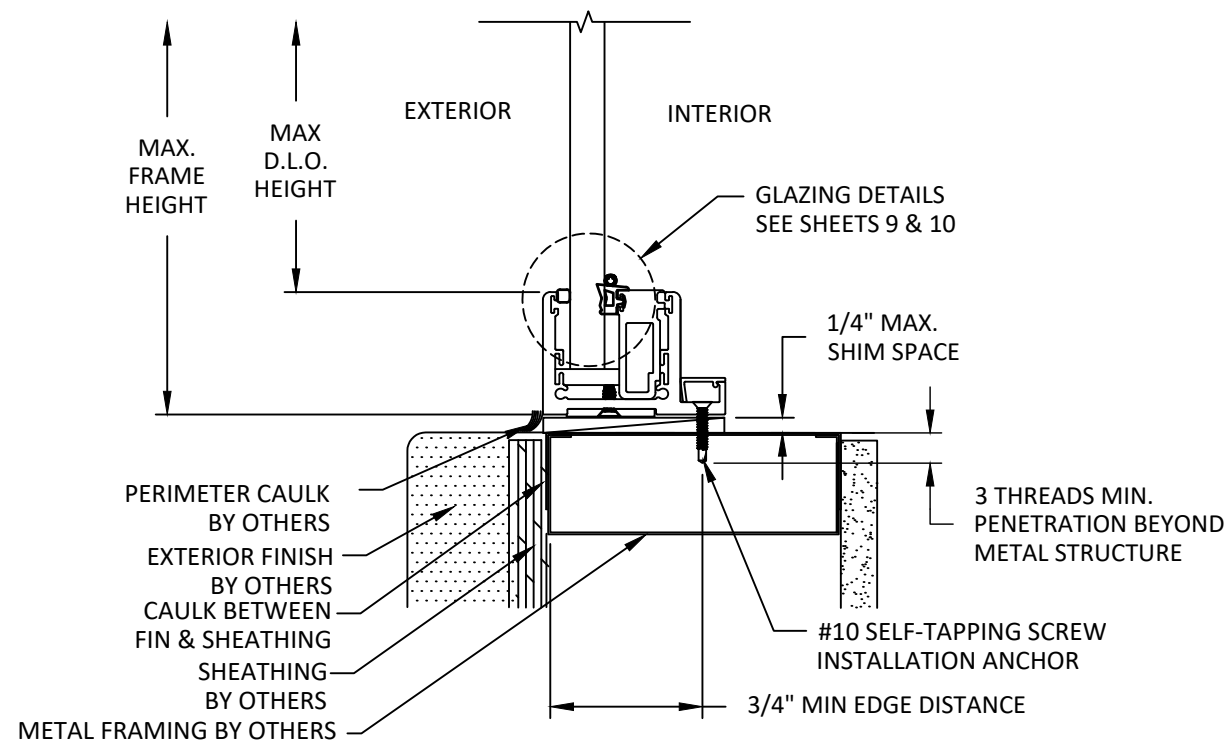

B
6 **VERTICAL SECTION**
SILL - METAL STUD
THROUGH FRAME INSTALLATION

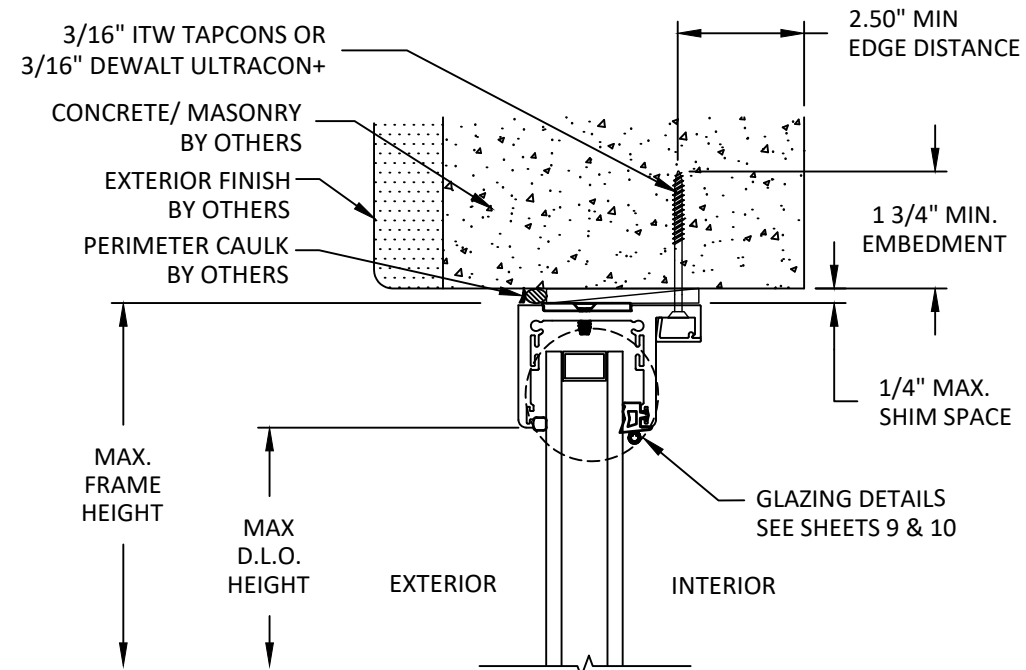

C
6 **VERTICAL SECTION**
HEAD - CONCRETE OR CMU
THROUGH FRAME INSTALLATION

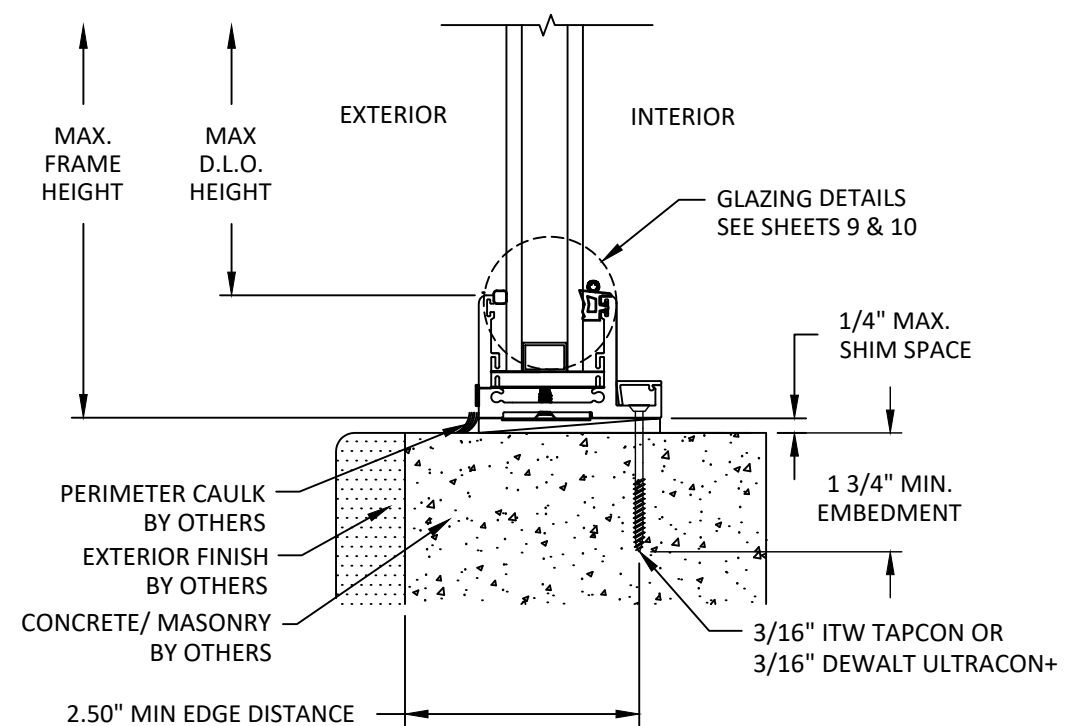

D
6 **VERTICAL SECTION**
SILL - CONCRETE OR CMU
THROUGH FRAME INSTALLATION


TITLE: FIXED WINDOW
(NON-HVHZ)(NON-IMPACT)
VERTICAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
COMPANY NAME UPD.	SH	09/23
DP TABLE UPDATES	SH	12/23

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

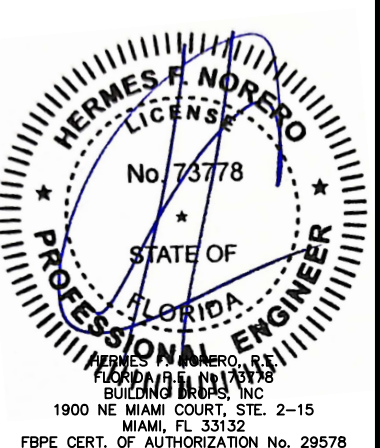

FL #:

FL31965

DATE: 04.26.23

DWG. BY:
SH

CHK. BY:
HFN


SCALE: NTS

DWG. #: EWS032


SHEET:

6


s:\projects\euro-wall systems\fbc-23-1121 - fbc submittal - non-impact aluminum products design pressure table updates\dwgs\131965\ews032.dwg
12/8/2023 1:20 PM

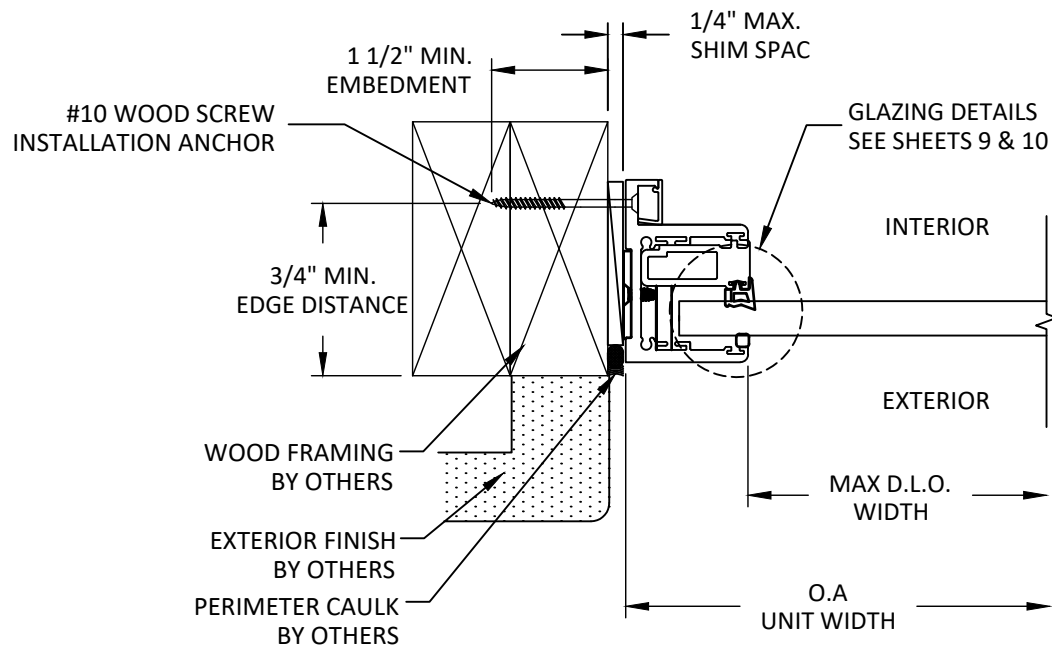

E
7 **HORIZONTAL SECTION**
JAMB - 2X WOOD FRAME
THROUGH FRAME INSTALLATION

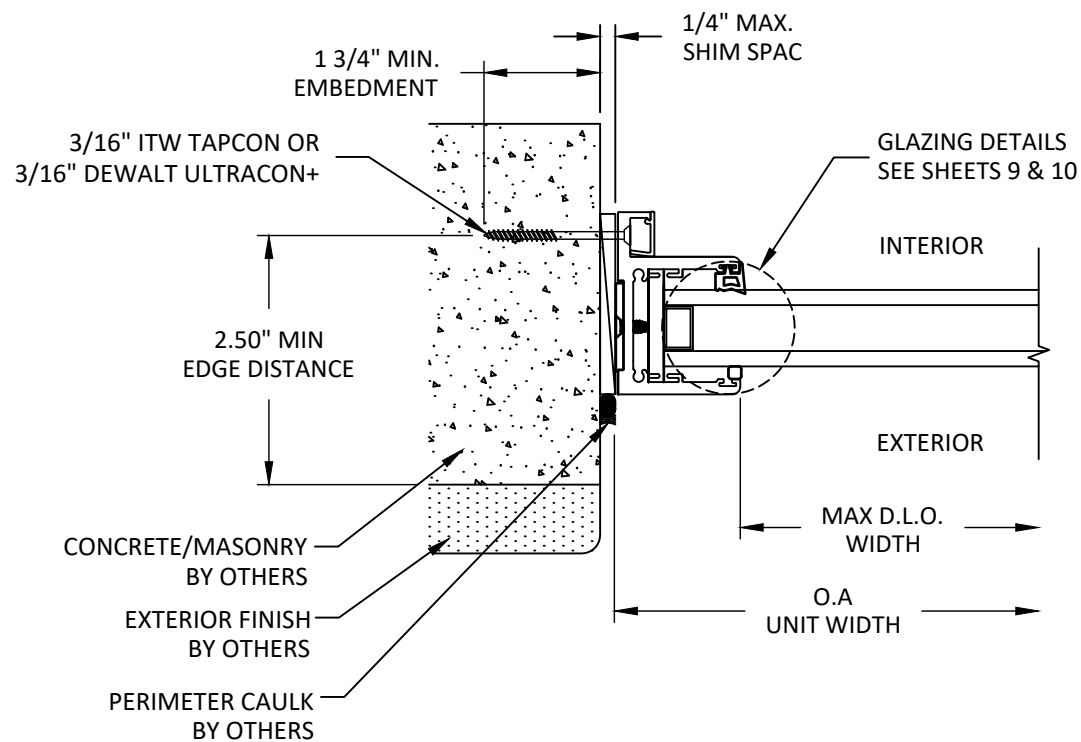

G
7 **HORIZONTAL SECTION**
JAMB-CONCRETE OR CMU
THROUGH FRAME INSTALLATION

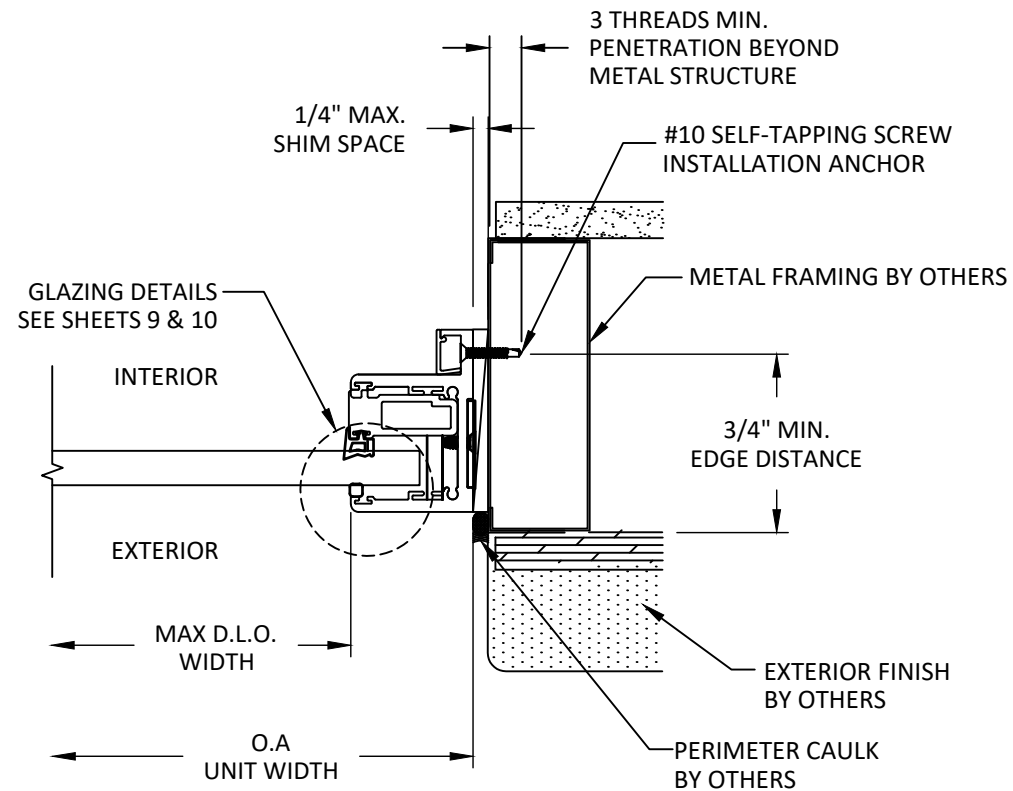

F
7 **HORIZONTAL SECTION**
METAL STUD
THROUGH FRAME INSTALLATION

euro-wall
FOLDING | SLIDING | STACKING | PIVOT

EURO-WALL, LLC
P.O. BOX 8007
NORTH PORT, FL 34290
PH: 888-989-3876


TITLE: FIXED WINDOW
(NON-HVHZ)(NON-IMPACT)
HORIZONTAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
COMPANY NAME UPD.	SH	09/23
DP TABLE UPDATES	SH	12/23

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

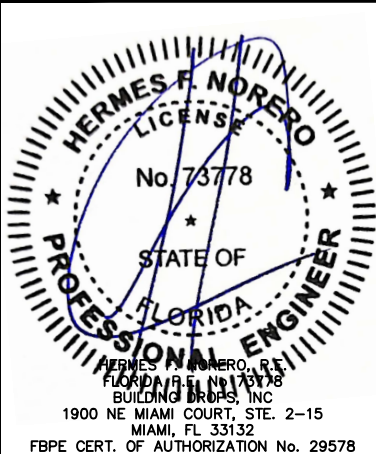

FL #: **FL31965**

DATE: **04.26.23**

DWG. BY:	CHK. BY:
SH	HFN

SCALE: **NTS**

DWG. #: **EWS032**

SHEET:

7

OF 10

s:\projects\euro-wall systems\fbc-23-1121 - fbc submittal - non-impact aluminum products design pressure table updates\dwgs\131965\ews032.dwg
12/8/2023 1:20 PM

DESIGN PRESSURE TABLE (+/- PSF)

	"W" MULLION TRIBUTARY WIDTH (INCHES)																			
	54	60	66	72	78	84	90	96	102	108	114	120	126	132	138	144	150	156	162	168
	72	78	84	90	96	102	108	114	120	126	132	138	144	150	156	162	168	174	180	186
"L" MULLION HEIGHT (INCHES)	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0
	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	59.6
	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	59.0	58.2	57.4	56.7	56.7
	60.0	60.0	60.0	60.0	60.0	60.0	60.0	56.0	56.0	56.0	56.0	56.0	56.0	56.0	56.0	56.0	55.7	54.9	54.2	54.2
	60.0	60.0	60.0	60.0	60.0	60.0	60.0	56.0	52.5	52.5	52.5	52.5	52.5	52.5	52.5	52.5	52.5	52.5	52.5	52.1
	60.0	60.0	60.0	60.0	60.0	60.0	60.0	56.0	52.5	49.4	49.4	49.4	49.4	49.4	49.4	49.4	49.4	49.4	49.4	49.4
	60.0	60.0	60.0	60.0	60.0	60.0	60.0	56.0	52.5	49.4	46.7	46.7	46.7	46.7	46.7	46.7	46.7	46.7	46.7	46.7
	60.0	60.0	60.0	60.0	60.0	60.0	60.0	56.0	52.5	49.4	46.7	44.2	44.2	44.2	44.2	44.2	44.2	44.2	44.2	44.2
	60.0	60.0	60.0	60.0	60.0	60.0	60.0	56.0	52.5	49.4	46.7	44.2	42.0	42.0	42.0	42.0	42.0	42.0	42.0	42.0
	60.0	60.0	60.0	60.0	60.0	60.0	60.0	56.0	52.5	49.4	46.7	44.2	42.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0
	60.0	60.0	60.0	60.0	60.0	60.0	60.0	56.0	52.5	49.4	46.7	44.2	42.0	38.2	38.2	38.2	38.2	38.2	38.2	38.2
	60.0	60.0	60.0	60.0	60.0	60.0	60.0	56.0	52.5	49.4	46.7	44.2	42.0	40.0	38.2	36.5	36.5	36.5	36.5	36.5
	60.0	60.0	60.0	60.0	60.0	60.0	60.0	56.0	52.5	49.4	46.7	44.2	42.0	40.0	38.2	36.5	35.0	35.0	35.0	35.0
	60.0	60.0	60.0	59.1	55.5	52.5	50.0	47.9	46.1	44.6	43.4	42.0	40.0	38.2	36.5	35.0	33.6	33.6	33.6	33.6
	60.0	60.0	56.1	52.2	48.9	46.2	43.9	42.0	40.4	39.0	37.9	36.9	36.1	35.5	35.1	34.7	33.6	32.3	32.3	32.3
	59.5	54.2	49.8	46.3	43.3	40.9	38.8	37.0	35.6	34.3	33.2	32.3	31.6	31.0	30.5	30.1	29.9	29.7	29.7	29.7
	53.2	48.4	44.5	41.3	38.6	36.4	34.5	32.9	31.5	30.3	29.3	28.5	27.8	27.2	26.7	26.3	26.0	25.8	25.7	25.6
	47.8	43.4	39.9	36.9	34.5	32.5	30.8	29.3	28.0	27.0	26.0	25.3	24.6	24.0	23.5	23.1	22.8	22.6	22.4	22.3
	43.0	39.1	35.9	33.2	31.0	29.2	27.6	26.2	25.1	24.1	23.2	22.5	21.9	21.3	20.9	20.5	20.1	19.9	19.7	19.6
	38.9	35.3	32.4	30.0	28.0	26.3	24.8	23.6	22.5	21.6	20.8	20.1	19.5	19.0	18.6	18.2	17.9	17.6	17.4	17.3
	35.3	32.0	29.4	27.2	25.3	23.8	22.4	21.3	20.3	19.5	18.7	18.1	17.5	17.1	16.6	16.3	16.0	15.7	15.5	15.3
	32.1	29.1	26.7	24.7	23.0	21.6	20.4	19.3	18.4	17.6	16.9	16.3	15.8	15.4	15.0	14.6	14.3	14.1	13.9	13.7
	29.3	26.6	24.3	22.5	20.9	19.6	18.5	17.6	16.7	16.0	15.4	14.8	14.3	13.9	13.5	13.2	12.9	12.7	12.4	12.3
	26.8	24.3	22.3	20.6	19.1	17.9	16.9	16.0	15.2	14.6	14.0	13.5	13.0	12.6	12.3	11.9	11.7	11.4	11.2	11.0
	24.6	22.3	20.4	18.8	17.5	16.4	15.5	14.6	13.9	13.3	12.8	12.3	11.9	11.5	11.1	10.9	10.6	10.4	10.2	10.0

euro-wall

FOLDING | SLIDING | STACKING | PIVOT

EURO-WALL, LLC
P.O. BOX 8007
NORTH PORT, FL 34290
PH: 888-989-3876

TITLE:
FIXED WINDOW
(NON-HVHZ)(NON-IMPACT)
MULLION DESIGN PRESSURE TABLE
& SECTIONS - ANGLE


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132

PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
COMPANY NAME UPD.	SH	09/23
DP TABLE UPDATES	SH	12/23

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

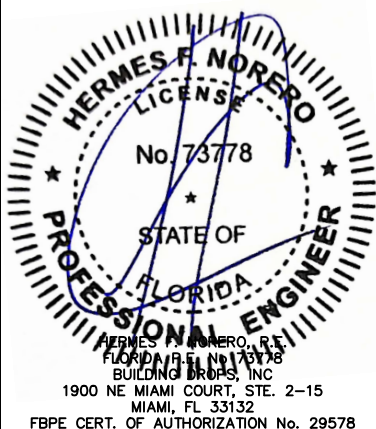

FL #:
FL31965

DATE: **04.26.23**

DWG. BY: **SH**
CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **EWS032**

SHEET:

8


OF 10

DAYLIGHT OPENING CALCULATIONS:

- D.L.O. HEIGHT = FRAME HEIGHT - 4.00"
- D.L.O. WIDTH = FRAME WIDTH - 4.00"

$$D = A + B$$

$$\text{TRIBUTARY WIDTH(W)} = (A+B)/2$$

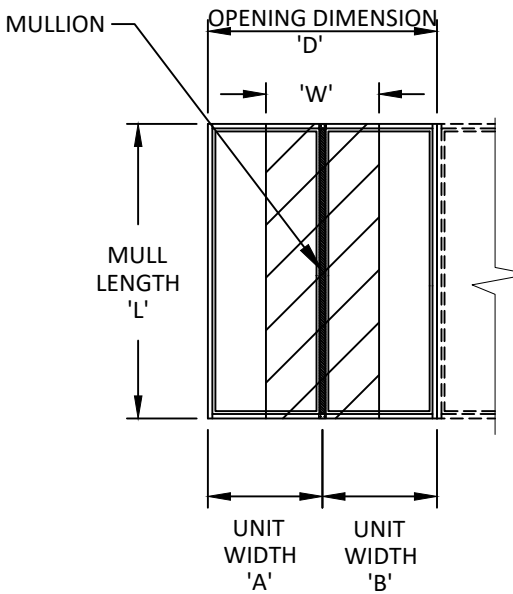



ANCHOR SCHEDULE MULLION CLIP

SUBSTRATE	ANCHOR SCHEDULE	MIN EMBEDMENT	MIN. EDGE DISTANCE
METAL: STEEL 18 GAUGE, MIN. Fy = 33KSI	1/4" SELF-DRILLING OR SELF-TAPPING SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.50"
METAL: ALUMINUM (6063-T5) MIN. 1/8" THICKNESS	1/4" SELF-DRILLING OR SELF-TAPPING SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.50"
CONCRETE: f'c=3000PSI	1/4" ITW TAPCON	1.75"	2.50"

GLAZING DETAILS
SEE SHEETS 9 & 10

GLAZING DETAILS
SEE SHEETS 9 & 10


GLAZING DETAILS
SEE SHEETS 9 & 10

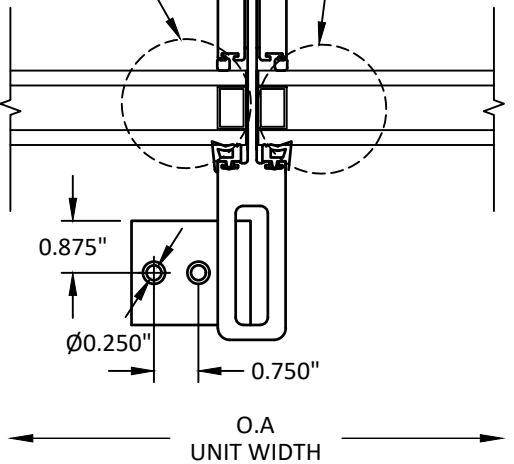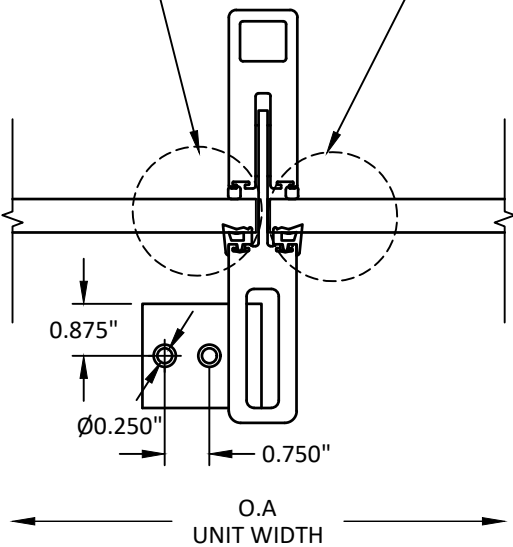


8 HORIZONTAL SECTION
MULLION ANGLE

8 HORIZONTAL SECTION
MULLION ANGLE


s:\projects\euro-wall systems\fb-23-1121 - fbc submittal - non-impact aluminum products design pressure table updates\dwgs\131965\ews032.dwg
12/8/2023 1:20 PM

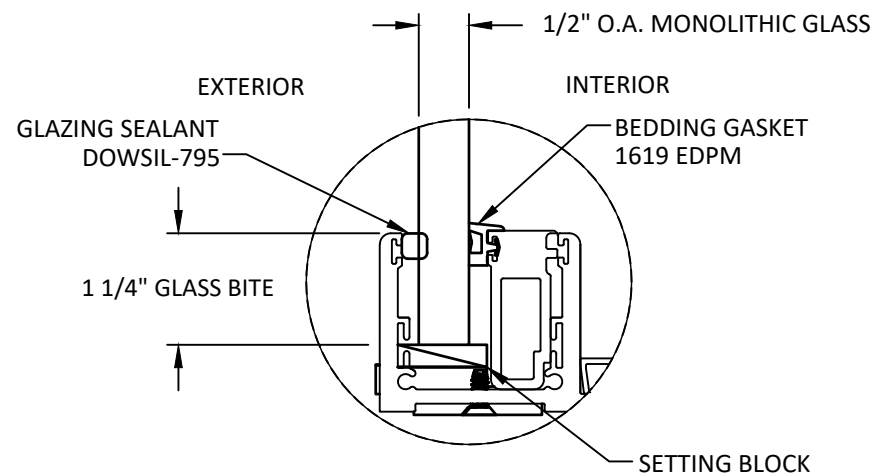

GLAZING DETAIL 1
SINGLE UNIT BOTTOM

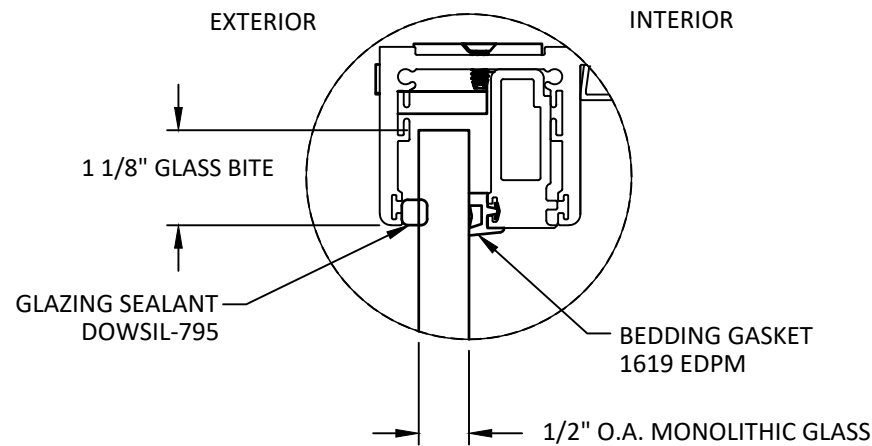


GLAZING DETAIL 3
SINGLE UNIT TOP

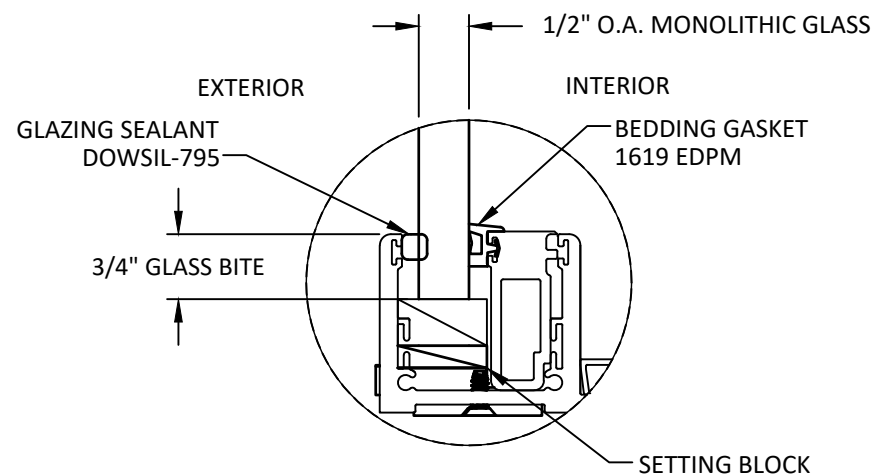


GLAZING DETAIL 5
MULTI UNIT TOP/BOTTOM


- GLAZING NOTES:**
1. GLASS TYPE SHALL COMPLY WITH ASTM E1300 REQUIREMENTS.
 2. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
 3. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
 4. GLASS TYPE SHALL COMPLY WITH APPLICABLE GLAZING REQUIREMENTS PER CHAPTER 24 OF THE FBC

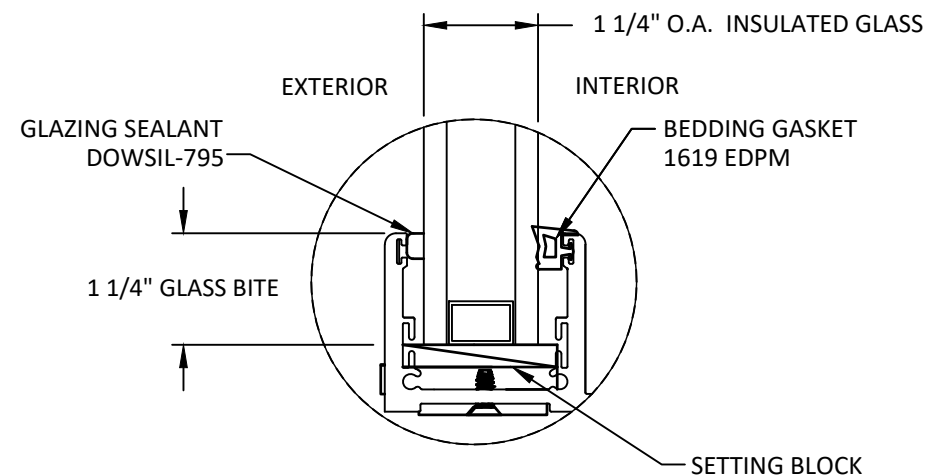

GLAZING DETAIL 2
SINGLE UNIT BOTTOM

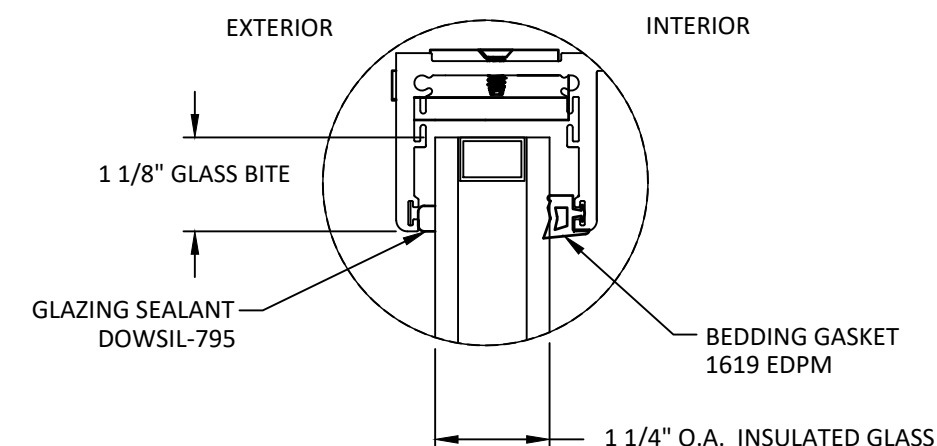

GLAZING DETAIL 4
SINGLE UNIT TOP

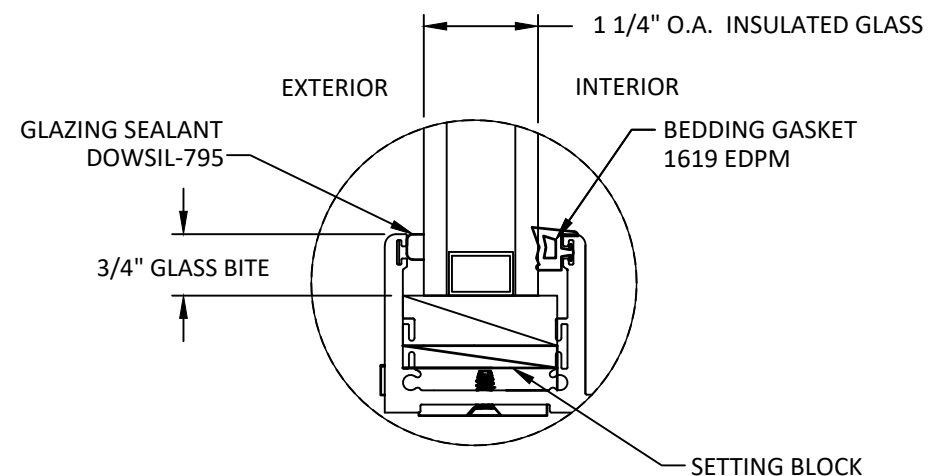

GLAZING DETAIL 6
MULTI UNIT TOP/BOTTOM

euro-wall
FOLDING | SLIDING | STACKING | PIVOT

EURO-WALL, LLC
P.O. BOX 8007
NORTH PORT, FL 34290
PH: 888-989-3876


TITLE: **FIXED WINDOW**
(NON-HVHZ)(NON-IMPACT)
GLAZING DETAILS (WET GLAZED)

PREPARED BY: **BUILDING DROPS, INC.**
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
COMPANY NAME UPD.	SH	09/23
DP TABLE UPDATES	SH	12/23

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

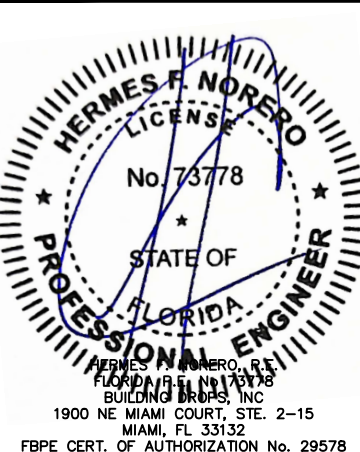


FL #:	FL31965
DATE:	04.26.23
DWG. BY:	SH
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	EWS032
SHEET:	9


s:\projects\euro-wall systems\fb-23-1121 - fbc submittal - non-impact aluminum products design pressure table updates\dwgs\131965\ews032.dwg
12/8/2023 1:20 PM

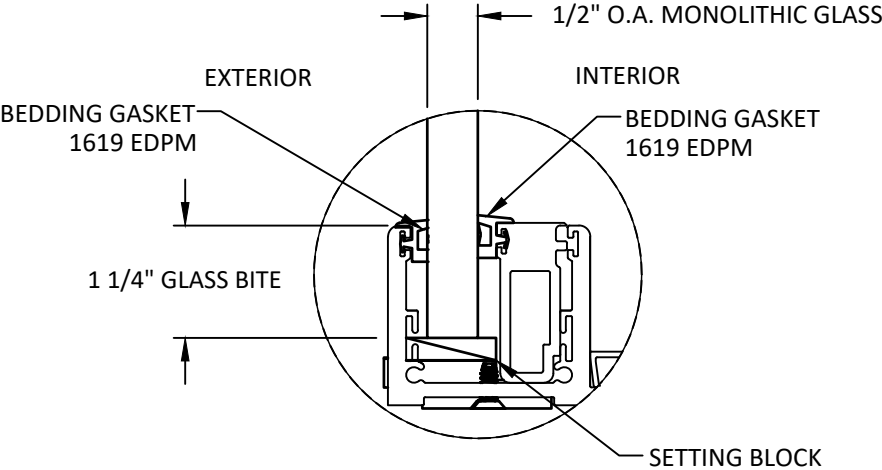

GLAZING DETAIL 7
SINGLE UNIT BOTTOM

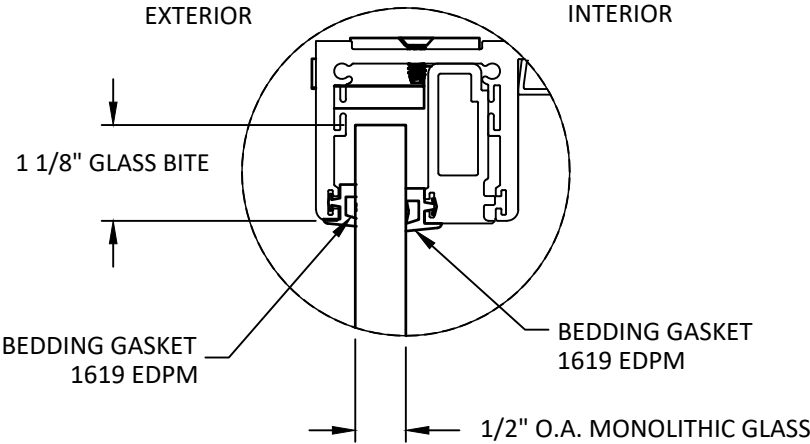


GLAZING DETAIL 9
SINGLE UNIT TOP

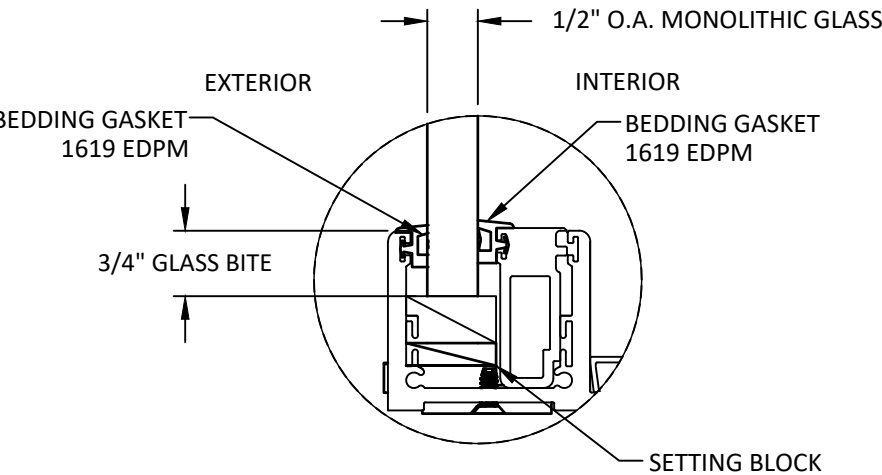


GLAZING DETAIL 11
MULTI UNIT TOP/BOTTOM


- GLAZING NOTES:**
1. GLASS TYPE SHALL COMPLY WITH ASTM E1300 REQUIREMENTS.
 2. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
 3. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
 4. GLASS TYPE SHALL COMPLY WITH APPLICABLE GLAZING REQUIREMENTS PER CHAPTER 24 OF THE FBC

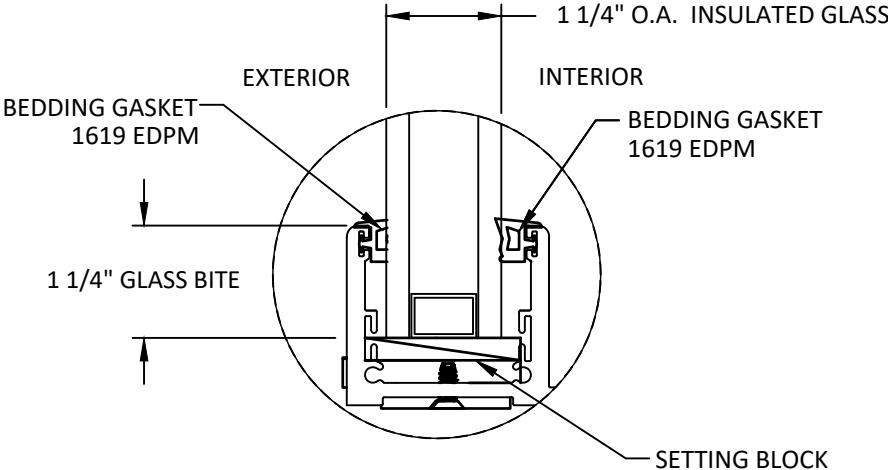

GLAZING DETAIL 8
SINGLE UNIT BOTTOM

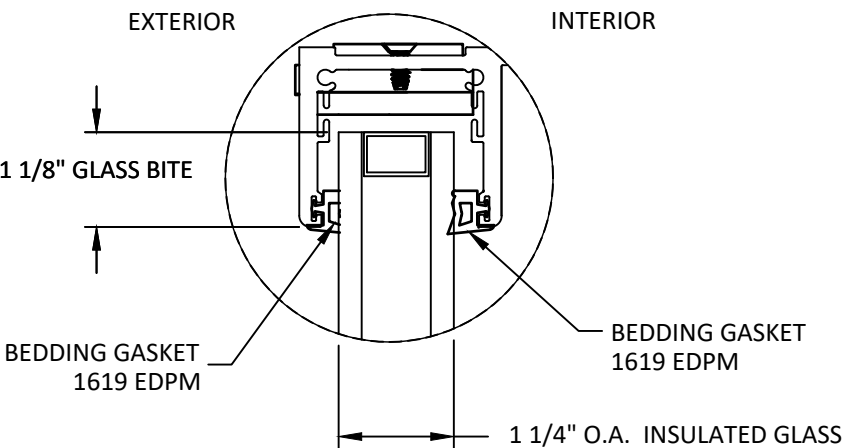

GLAZING DETAIL 10
SINGLE UNIT TOP

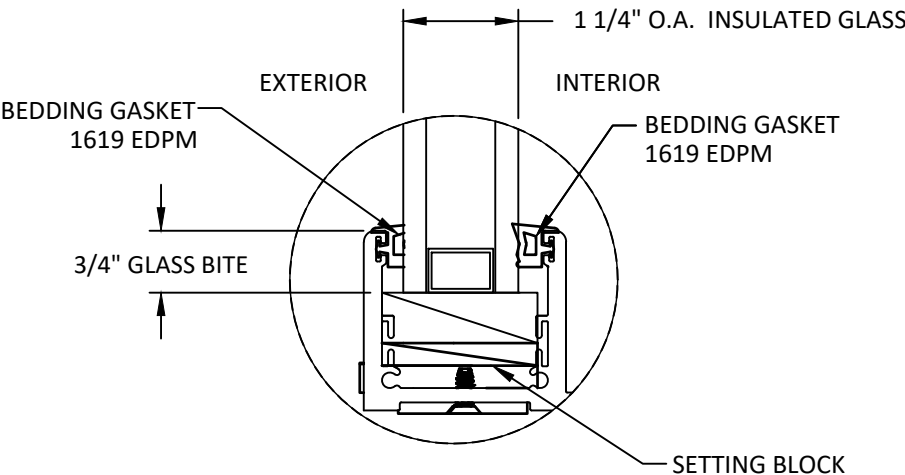

GLAZING DETAIL 12
MULTI UNIT TOP/BOTTOM

euro-wall
FOLDING | SLIDING | STACKING | PIVOT

EURO-WALL, LLC
P.O. BOX 8007
NORTH PORT, FL 34290
PH: 888-989-3876


TITLE: **FIXED WINDOW**
(NON-HVHZ)(NON-IMPACT)
GLAZING DETAILS (DRY GLAZED)

PREPARED BY: **BUILDING DROPS, INC.**
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
COMPANY NAME UPD.	SH	09/23
DP TABLE UPDATES	SH	12/23

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

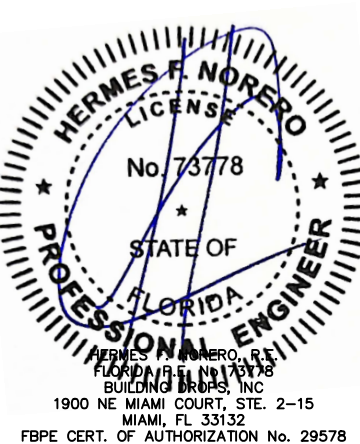

FL #:	FL31965
DATE:	04.26.23
DWG. BY:	SH
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	EWS032
SHEET:	10