

GENERAL NOTES:

1. THIS PRODUCT HAS BEEN TESTED, ANALYZED & APPROVED FOR DESIGN PRESSURES NOT TO EXCEED THOSE SHOWN IN THE "ALLOWABLE DESIGN PRESSURE TABLE(S)".
2. OPENINGS, BUCKING & BUCKING FASTENERS MUST BE PROPERLY DESIGNED & INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE.
3. ALL HARDWARE & FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS & SHALL NOT VARY UNLESS SPECIFICALLY MENTIONED ON THE DRAWINGS. SPECIFIED ANCHOR EMBED TO BASE MATERIAL SHALL BE BEYOND WALL FINISH OR STUCCO.
4. THIS PRODUCT HAS BEEN DESIGNED IN ACCORDANCE WITH AND MEETS THE REQUIREMENTS OF THE FLORIDA BUILDING CODE (FBC) INCLUDING HIGH VELOCITY HURRICANE ZONES (HVHZ) & IS LARGE MISSILE IMPACT RATED.
5. IMPACT SHUTTERS ARE NOT REQUIRED WITH THIS PRODUCT.
6. ALL ANCHORS SECURING PRODUCT FRAMES TO PRESSURE TREATED BUCKS OR WOOD FRAMING SHALL BE CAPABLE OF RESISTING CORROSION CAUSED BY THE PRESSURE TREATING CHEMICALS IN THE WOOD.
7. DETERMINE THE POSITIVE & NEGATIVE DESIGN LOADS TO USE WHEN REFERENCING THESE DOCUMENTS IN ACCORDANCE WITH THE GOVERNING CODE AND GOVERNING WIND VELOCITY. FOR WIND LOAD CALCULATIONS IN ACCORDANCE WITH THE FLORIDA BUILDING CODE, A DIRECTIONALITY FACTOR OF $K_d = 0.85$ MAY BE APPLIED PER THE ASCE-7 STANDARD.
8. MATERIALS, INCLUDING BUT NOT LIMITED TO STEEL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF FLORIDA BUILDING CODE.
9. TO THE BEST OF OUR KNOWLEDGE, THE PRODUCT SHOWN HEREIN IS QUALITY ASSURED BY A FLORIDA STATE APPROVED CERTIFICATION/QA ENTITY & SHALL BE LABELED IN ACCORDANCE WITH THE FBC AND THE FLORIDA DEPARTMENT OF BUSINESS & PROFESSIONAL REGULATION SPECIFICATIONS. THESE DRAWINGS SHOW ALL APPLICABLE ELEVATION, COMBINATION, INSTALLATION & COMPARATIVE ANALYSIS CONDITIONS AS DETERMINED THROUGH TESTING & ENGINEERING RATIONAL ANALYSIS. PRODUCT ASSEMBLY SHALL BE IN ACCORDANCE WITH THESE DRAWINGS, THE MANUFACTURER'S QUALITY ASSURANCE SPECIFICATIONS & TESTING REPORTS.
10. CERTIFICATION OF THIS PRODUCT SHALL BE CONSIDERED VOID IF IT IS INSTALLED WITHOUT A BUILDING PERMIT FROM THE APPLICABLE LOCAL BUILDING DEPARTMENT OR IF IT IS INSTALLED BY ANYONE OTHER THAN A LICENSED CONTRACTOR EXPERIENCED WITH INSTALLATIONS OF THIS TYPE OF PRODUCT.
11. ALL WOOD MEMBERS OF THIS PRODUCT THAT MAY POSSIBLY COME INTO CONTACT WITH MASONRY OR CONCRETE SUBSTRATES, ARE SUBJECT TO MOISTURE &/OR ARE SUBJECT TO THE OUTSIDE ENVIRONMENT SHALL BE OF AN APPROVED DURABLE SPECIES OR BE TREATED IN AN APPROVED METHOD WITH AN APPROVED PRESERVATIVE PER FBC REQUIREMENTS.

EVALUATION OF THIS PRODUCT IS BASED ON APPLICABLE STANDARDS AND/OR INFORMATION & RESULTS FROM APPLICABLE TEST REPORTS. THE FLORIDA BUILDING CODE VERSION CONSIDERED WITH THIS EVALUATION WAS THAT IN FORCE AT THE TIME OF THE EVALUATION. IN THE EVENT OF CODE VERSION CHANGES/UPDATES OR IN THE EVENT THAT NEW OR ADDITIONAL TESTING IS COMPLETED ON THIS PRODUCT, PRIOR TO STATING CODE COMPLIANCE WITH THE STATE, THE MANUFACTURER SHALL CONFIRM WITH THE EVALUATION ENGINEER OF RECORD THAT EVERYTHING SPECIFIED HERE-IN IS CURRENT WITH ALL CURRENT TESTING, CODES AND APPLICABLE STANDARDS.


FRAME ANCHOR REQUIREMENTS TABLE

OPENING TYPE (SUBSTRATE)	FRAME/CLIP/BACKET TO OPENING FASTENER TYPE	MINIMUM EMBED	MINIMUM EDGE DIST.
FRAME SCREWS			
MIN. 2X4 WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55)	NO. 14 SMS OR WOOD SCREW	1 1/4"	1"
MIN. 16 GA. 50 KSI METAL STUD	1/4" GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
MIN. 1/8" THK STEEL OR ALUMINUM	1/4" GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
MIN. C-90 CMU OR 2500 PSI CONCRETE	(1) 1/4" CONCRETE SCREW	1 1/2"	2 1/2"
MOUNTING CLIP SCREWS			
MIN. 2X4 WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55)	NO. 8 SMS OR WOOD SCREW	1 3/8"	1/2"
MIN. 1/8" THK STEEL OR ALUMINUM	NO. 8 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
NARROW MOUNTING BRACKET SCREWS			
MIN. 2X6 WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55)	NO. 8 SMS OR WOOD SCREW	1 3/8"	1/2"
MIN. 18 GA. 33 KSI METAL STUD	NO. 8 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
MIN. 1/8" THK STEEL OR ALUMINUM	NO. 8 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
WIDE MOUNTING BRACKET SCREWS			
MIN. 2X6 WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55)	NO. 8 SMS OR WOOD SCREW	1 3/8"	1/2"
MIN. 18 GA. 33 KSI METAL STUD	NO. 8 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
MIN. 1/8" THK STEEL OR ALUMINUM	NO. 8 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
MIN. C-90 CMU OR 2500 PSI CONCRETE	(1) 3/16" CONCRETE SCREW	1 1/2"	2"

(1) CONCRETE SCREWS SHALL BE ELCO ULTRACONS (C.S.), ELCO CRETE-FLEX (S.S.), ITW RAMSET/RED HEAD TAPCONS (C.S. OR S.S.) OR HILTI KWIK-CON II (C.S. OR S.S.).

FOR MAX. FRAME SHORT DIMENSION,
SEE SINGLE WINDOW PRESSURE
TABLE ON SHEET 2

SEE "CORNER
CONSTRUCTION"
DESCRIPTION ON
THIS SHEET

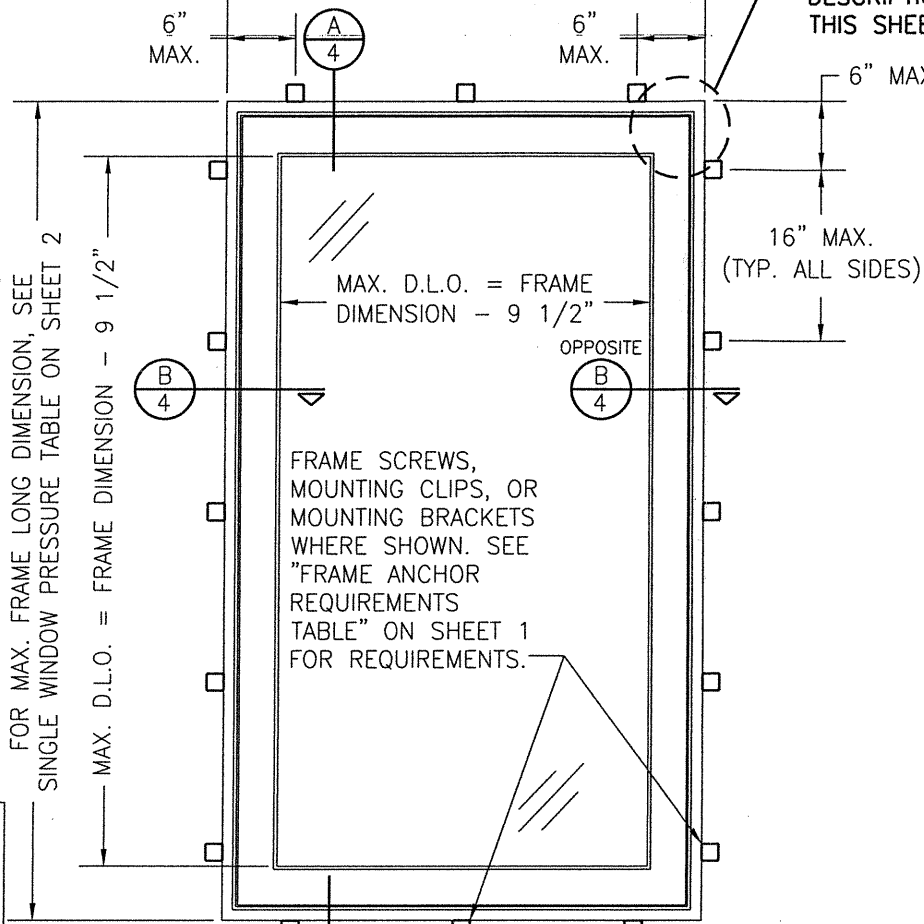


EXTERIOR ELEVATION
SINGLE FIXED WINDOW

SCALE: N.T.S.

LONG DIMENSION OF WINDOW MAY BE HORIZONTAL OR
VERTICAL (HEIGHT & WIDTH MAY BE INTERCHANGED).


APPROVED SHAPES

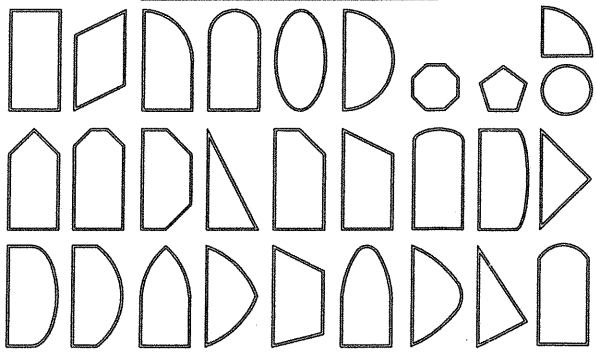

NOTES:

1. OTHER SHAPES MAY APPLY PROVIDING THEY ARE SIMILAR TO THOSE SHOWN & HAVE CORNER CONSTRUCTION AS DESCRIBED ON THIS SHEET.
2. ALL SHAPED UNITS MUST FIT INSCRIBED INTO THE ALLOWABLE RECTANGULAR UNITS & BE GOVERNED BY THE ALLOWABLE PRESSURE OF THE RESPECTIVE RECTANGULAR UNIT.

96" MAX. FRAME HEIGHT WITH NO ASTRAGAL REINFORCEMENT
132" MAX. FRAME HEIGHT WITH STEEL REINFORCED ASTRAGAL

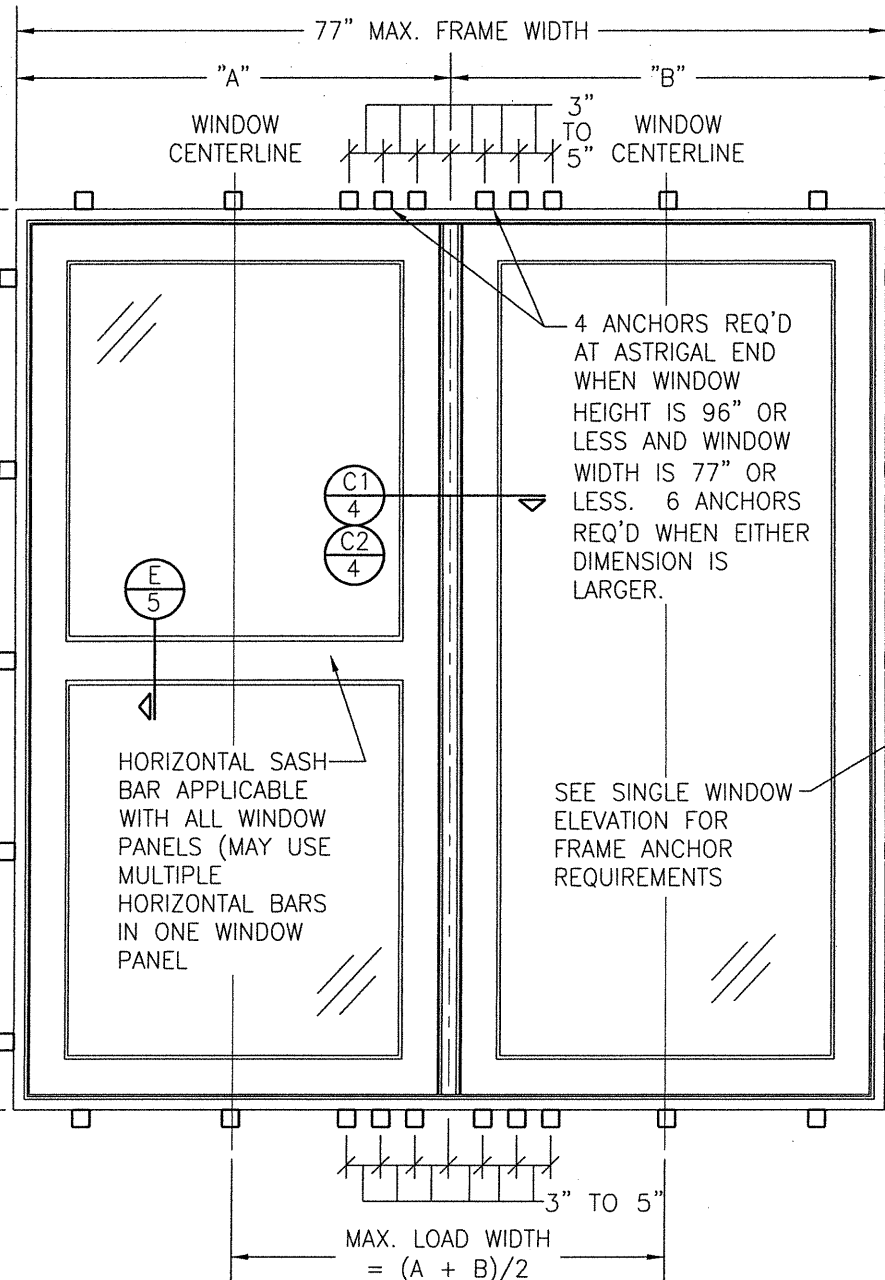

EXTERIOR ELEVATION
DOUBLE FIXED WINDOW WITH ASTRAGAL

SCALE: N.T.S.

SEE SINGLE WINDOW ELEVATION FOR WINDOW DETAIL NOT SHOWN

ALLOWABLE DESIGN PRESSURE
(ALL CONDITIONS)

SEE LOAD TABLES ON SHEET 2

CORNER CONSTRUCTION:

- JAMBS: COPED, BUTTED TOGETHER, JOINED WITH 3 NO. 10 X 3
1/8" SCREWS & GLUED WITH BINDAN D4 OR EQUAL.
- SASH: MULTI-FORKED, BUTTED & GLUED WITH BINDAN D4 OR EQUAL.

RECTANGULAR WINDOWS SHOWN. ANCHORING OF
SHAPED WINDOWS IS THE SAME WITH REQUIRED
ANCHOR SPACING ALONG THE FRAME
CIRCUMFERENCE BEING THE SAME AS SPECIFIED
FOR A STRAIGHT FRAME.

THESE DRAWINGS ARE APPLICABLE ONLY TO THE PRODUCT
SPECIFIED. THEY MAY NOT BE USED FOR THE ASSEMBLY
AND/OR INSTALLATION OF ANY OTHER PRODUCT NOR MAY
THEY BE USED FOR RATIONAL AND/OR LOCAL APPROVAL
OF ANY PRODUCT NOT PRODUCED BY THE MANUFACTURER
STATED ON THESE DRAWINGS.

DRAWN BY: S.T.R.		CHECKED BY: W.W.S.	
PLOT: 1=16		DATE: 3/15/05	
NO.	REVISION	DESCRIPTION	BY
A1	UPDATE TO PRESENT STANDARDS	WRM	05/06/10
B1	CHANGE CONSULTANTS ADDRESS	WRM	10/19/11
C1	UPDATE TO PRESENT STANDARDS	WWS	03/26/15
D1	CHANGE TO STATE APPROVAL	WWS	04/16/20
DRAWING TITLE AMERICAN OUT-SWING FIXED CASEMENT IMPACT WOOD WINDOWS			
MANUFACTURER PEETZ WINDOWS & DOORS 15951 S.W. 41ST STREET, SUITE 150 WESTON, FL 33331 954-659-3887			
CONSULTANTS W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809) 7480 150TH COURT NORTH PALM BEACH GARDENS, FL 33418 PHONE: 561-744-3424			
CERTIFICATION OF W. SCHAEFER, P.E. No. 44135 JUN 02 2020 PROFESSIONAL ENGINEER			
DRAWING NO. 1322		REV. D	
SHEET NO. 1		OF 7	


ALLOWABLE SINGLE WINDOW DESIGN PRESSURE					
MAXIMUM FRAME LONG DIMENSION (IN.)	MAXIMUM FRAME SHORT DIMENSION (IN.)	ALLOWABLE PRESSURE (POS. & NEG. PSF)			
		WITH I.G. GLAZING		WITH NON-I.G. GLAZING	
		OPTION 1	OPTION 2	OPTION 1	OPTION 2
132	39	75.0	75.0	75.0	75.0
120	42	71.9	71.9	71.9	71.9
	36	75.0	75.0	75.0	75.0
108	48	66.8	66.8	65.2	65.2
	42	73.7	73.7	73.7	73.7
	36	75.0	75.0	75.0	75.0
96	54		64.2		64.2
	48	69.2	69.2	69.2	69.2
	42	75.0	75.0	75.0	75.0
	39	75.0	75.0	75.0	75.0
90	54		65.9		65.9
	48	72.8	72.8	72.8	72.8
	42	75.0	75.0	75.0	75.0
84	60		64.6		64.6
	54		68.0		68.0
	48	72.7	72.7	72.7	72.7
	44	75.0	75.0	75.0	75.0
78	66		65.5		65.5
	60		67.5		67.5
	54		70.6		70.6
	48	75.0	75.0	75.0	75.0
72	66		68.2		68.2
	60		71.2		71.2
	54	73.9	73.9	73.9	73.9
	52	75.0	75.0	75.0	75.0
66	48	75.0	75.0	75.0	75.0
	66		68.2		68.2
	60	75.0	75.0	75.0	75.0
60	60	75.0	75.0	75.0	75.0

NOTES:

- SEE GLAZING DETAILS FOR GLAZING OPTIONS
- CROSSED OUT BOXES DESIGNATE SIZES NOT ACCEPTABLE FOR THE RESPECTIVE GLASS OPTION.

FIXED ASTRIGAL ALLOWABLE LOAD TABLE			
MAXIMUM ASTRIGAL SPAN (IN.)	MAXIMUM LOAD WIDTH (IN.)	ALLOWABLE PRESSURE (POS. & NEG. PSF)	
		NON-REINFORCED ASTRIGAL	REINFORCED ASTRIGAL
132	39	N/A	56.0
	36	N/A	59.9
	30	N/A	70.0
	24	N/A	75.0
120	42	N/A	59.1
	39	N/A	62.7
	36	N/A	66.9
	30	N/A	75.0
108	48	N/A	60.9
	42	N/A	67.2
	39	N/A	71.2
	36	N/A	75.0
96	54	46.8	65.9
	48	51.5	71.1
	42	57.7	75.0
	39	61.6	75.0
	36	66.0	75.0
	30	75.0	75.0
90	54	54.0	72.2
	48	59.2	75.0
	42	66.3	75.0
	39	71.3	75.0
	36	75.0	75.0
	60	59.3	75.0
84	54	63.3	75.0
	48	69.0	75.0
	42	75.0	75.0
	66	68.1	75.0
78	54	70.9	75.0
	48	75.0	75.0
	66	75.0	75.0
72	66	75.0	75.0

NON-REINFORCE ASTRIGAL SPAN MAY NOT EXCEED 96".

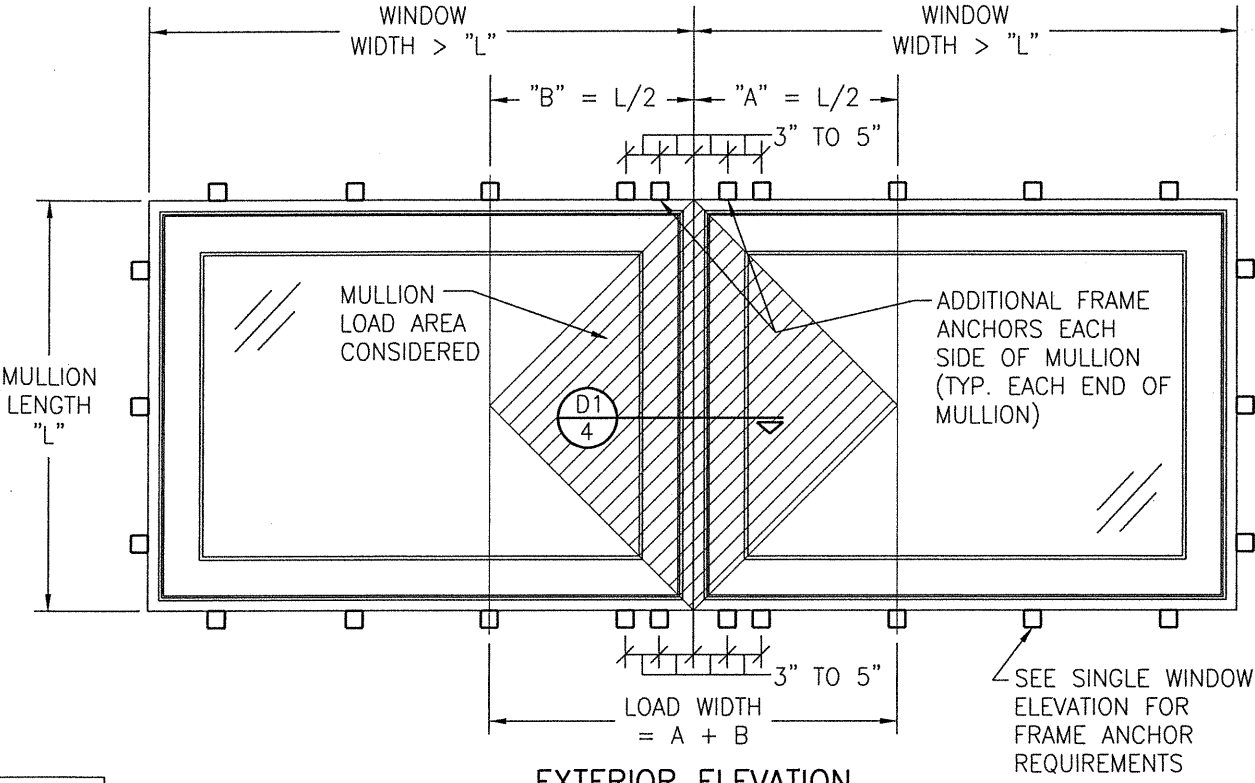

EXTERIOR ELEVATION
 FIXED WINDOW MULLED TO FIXED WINDOW WITH
 NON-REINFORCED MULLION WHEN WINDOW WIDTHS ARE
 GREATER THAN THE MULLION LENGTH
 (SEE MULLION LOAD TABLE)
 (MULTIPLE UNIT NOTES ON SHEET 3 SHALL APPLY)
 SEE SINGLE WINDOW ELEVATION FOR WINDOW DETAIL NOT SHOWN

MULLION ALLOWABLE LOAD TABLE			
MAXIMUM MULLION SPAN (IN.)	MAXIMUM LOAD WIDTH (IN.)	ALLOWABLE PRESSURE (POS. & NEG. PSF)	
		NON-REINFORCED MULLION	REINFORCED MULLION
132	39	N/A	75.0
120	42	N/A	75.0
108	48	N/A	75.0
96	54	53.2	75.0
	48	58.6	75.0
	42	65.5	75.0
	39	70.0	75.0
	36	75.0	75.0
	54	61.3	75.0
90	48	65.9	75.0
	42	72.1	75.0
	39	75.0	75.0
84	60	64.5	75.0
	54	67.9	75.0
	48	72.5	75.0
	42	75.0	75.0
78	66	70.3	75.0
	60	72.5	75.0
	54	75.0	75.0
72	66	75.0	75.0

LESSER OF THE PRESSURE SHOWN IN THIS TABLE & THAT ALLOWED FOR THE INDIVIDUAL WINDOW SHALL CONTROL AS ALLOWABLE FOR THE OVERALL UNIT.
 NON-REINFORCE MULLION SPAN MAY NOT EXCEED 96".

DRAWN BY: S.T.R.
 PLOT: 1=16
 DATE: 3/15/05
 CHECKED BY: W.W.S.
 DATE: 3/15/05


NO.	REVISION DESCRIPTION	DATE	BY

AMERICAN OUT-SWING FIXED CASEMENT IMPACT WOOD WINDOWS
 CONSULTANTS
 W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809)
 7480 150TH COURT NORTH
 PALM BEACH GARDENS, FL 33418
 PHONE: 561-744-3424

MANUFACTURER
 PEETZ WINDOWS & DOORS
 15951 S.W. 41ST STREET, SUITE 150
 WESTON, FL 33331
 954-659-3887

DRAWING NO. 1322
 SHEET NO. 2 OF 7

REV. D
 JUN 01 2020
 WARREN W. SCHAEFER, P.E.
 No. 44135
 STATE OF FLORIDA
 PROFESSIONAL SEAL

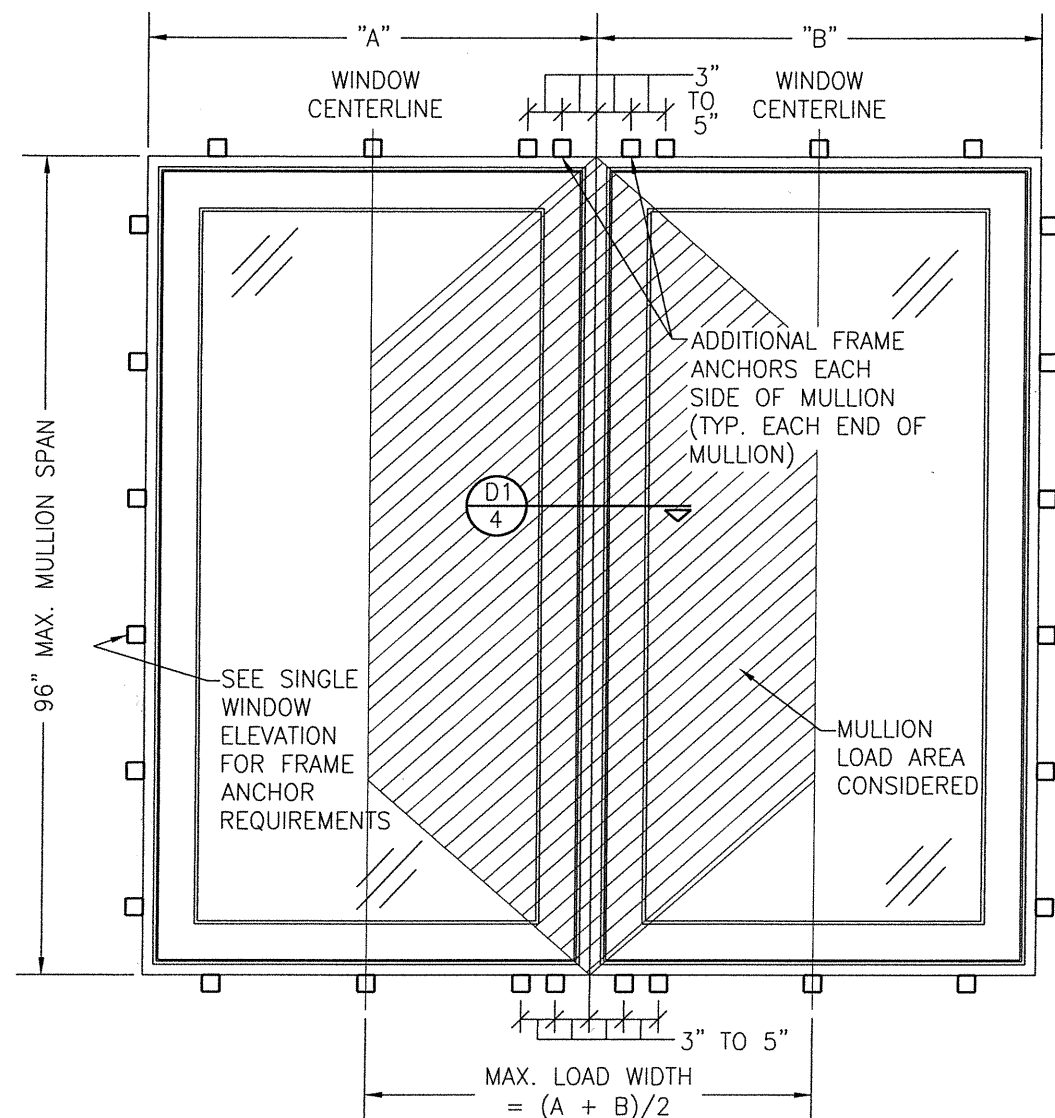


EXTERIOR ELEVATION
FIXED WINDOW MULLION TO FIXED WINDOW WITH
NON-REINFORCED MULLION WHEN WINDOW WIDTHS ARE
LESS THAN OR EQUAL TO THE MULLION LENGTH
(SEE MULLION LOAD TABLE)

SEE SINGLE WINDOW ELEVATION
 FOR WINDOW DETAIL NOT SHOWN

MULTIPLE UNIT NOTES:


1. ALL WINDOWS ARE RESTRICTED BY THE DIMENSIONS SPECIFIED.
2. THE MAXIMUM ALLOWABLE PRESSURE FOR A COMBINED UNIT IS RESTRICTED BY THE LESSER OF THE INDIVIDUAL WINDOW ALLOWABLE PRESSURE OR THE ALLOWABLE MULLION PRESSURE. SEE LOAD TABLES ON SHEET 2.
3. WINDOWS MAY BE STACKED HORIZONTAL OR VERTICAL. (IF VERTICALLY STACKED, MANUFACTURER MUST INSURE THAT THE DEAD WEIGHT OF THE WINDOWS DOES NOT CAUSE ANY WINDOW FAILURES OR DEFORMATIONS)

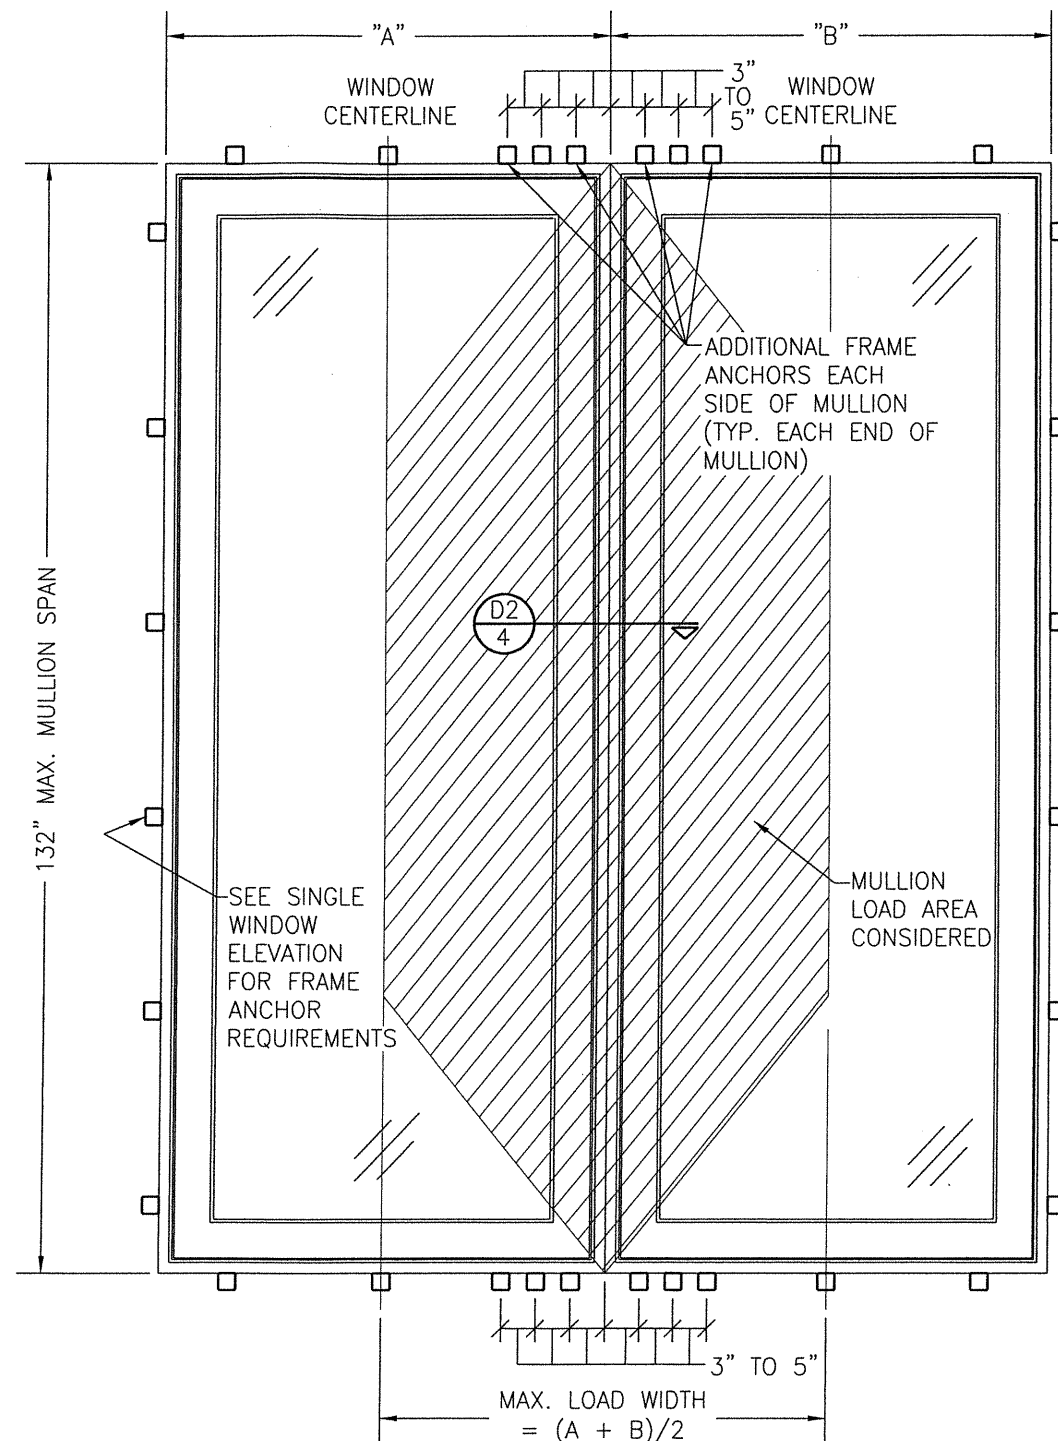


EXTERIOR ELEVATION
FIXED WINDOW MULLION TO FIXED WINDOW WITH
REINFORCED MULLION
(SEE MULLION LOAD TABLE)

SEE SINGLE WINDOW ELEVATION
 FOR WINDOW DETAIL NOT SHOWN


DRAWN BY: S.T.R.		CHECKED BY: W.W.S.	
PLOT: 1=16		DATE: 3/15/05	
DATE	BY	REVISION	DESCRIPTION
DRAWING TITLE AMERICAN OUT-SWING FIXED CASEMENT IMPACT WOOD WINDOWS		MANUFACTURER PEETZ WINDOWS & DOORS 15951 S.W. 41ST STREET, SUITE 150 WESTON, FL 33331 954-659-3887	
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809) 7480 150TH COURT NORTH PALM BEACH GARDENS, FL 33418 PHONE: 561-744-3424		P.E. NO. 44135	
DRAWING NO. 1322		REV. D	
SHEET NO. 3		OF 7	

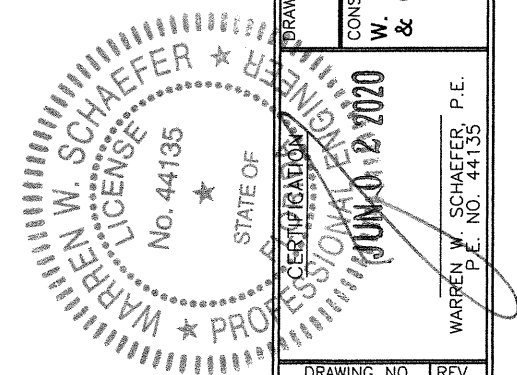

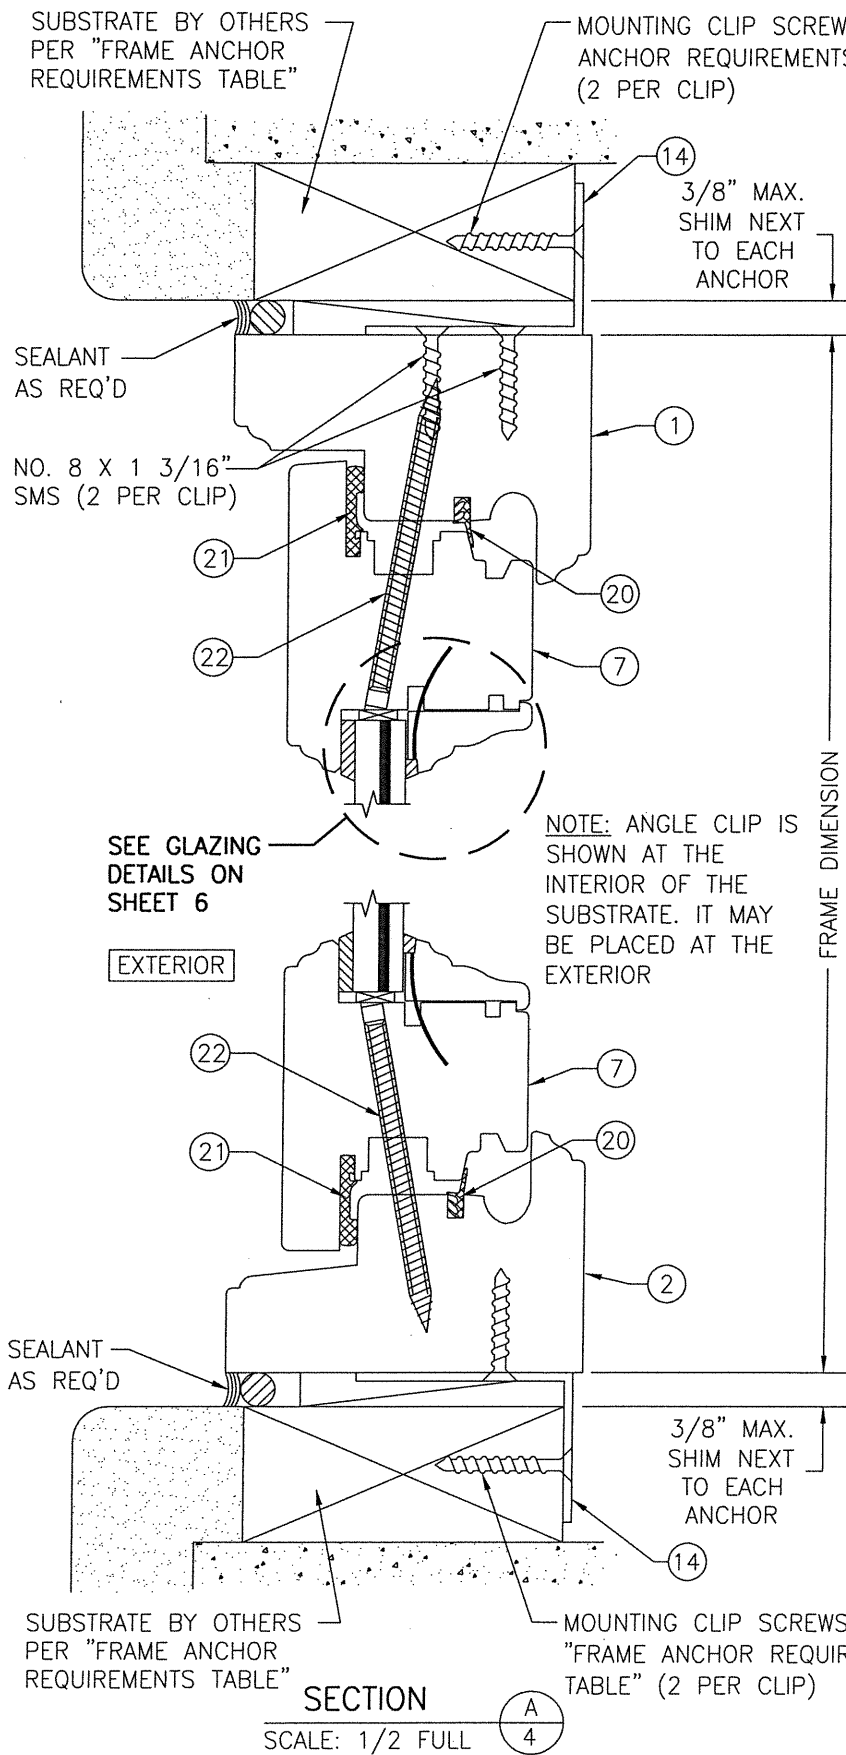


SEE GLAZING DETAILS ON SHEET 6

NOTE: ANGLE CLIP IS SHOWN AT THE INTERIOR OF THE SUBSTRATE. IT MAY BE PLACED AT THE EXTERIOR

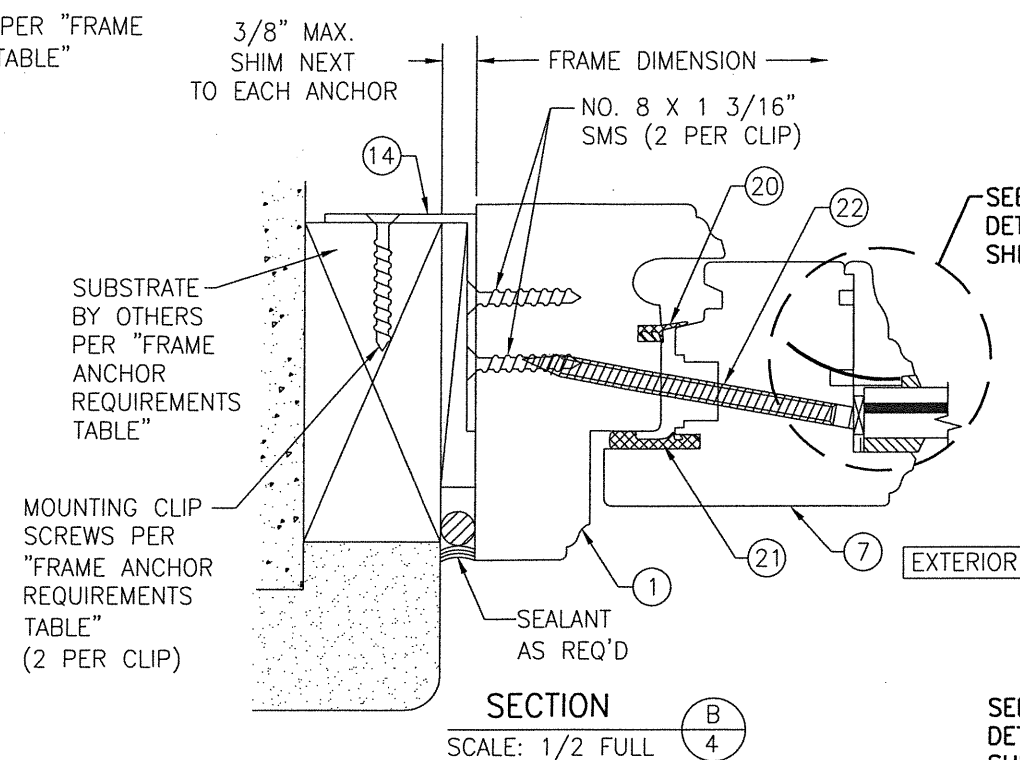

CLIP MOUNT SHOWN. SEE DETAILS ON SHEET 5 FOR, FRAME SCREW, DIRECT & BRACKET MOUNT DETAILS.

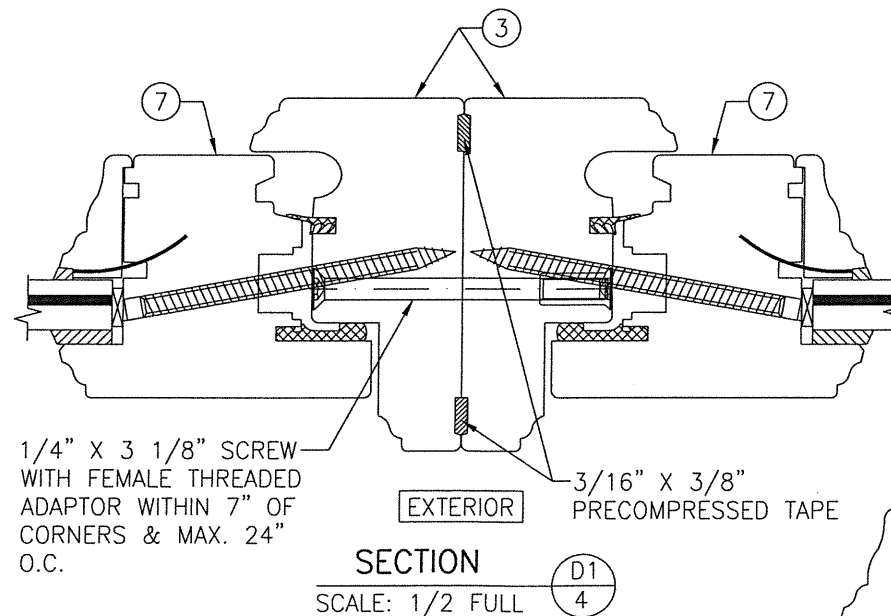


(SEE SECTION B/4 FOR DETAILS NOT SHOWN)



SEE GLAZING DETAILS ON SHEET 6

SEE GLAZING DETAILS ON SHEET 6

MANUFACTURER'S OPTION TO USE MULLION COVER

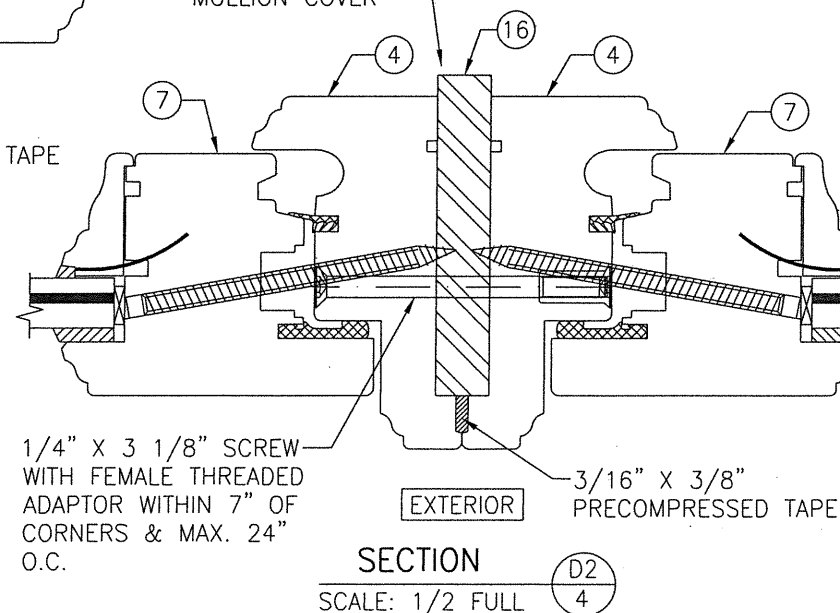


(SEE SECTION B/4 FOR DETAILS NOT SHOWN)

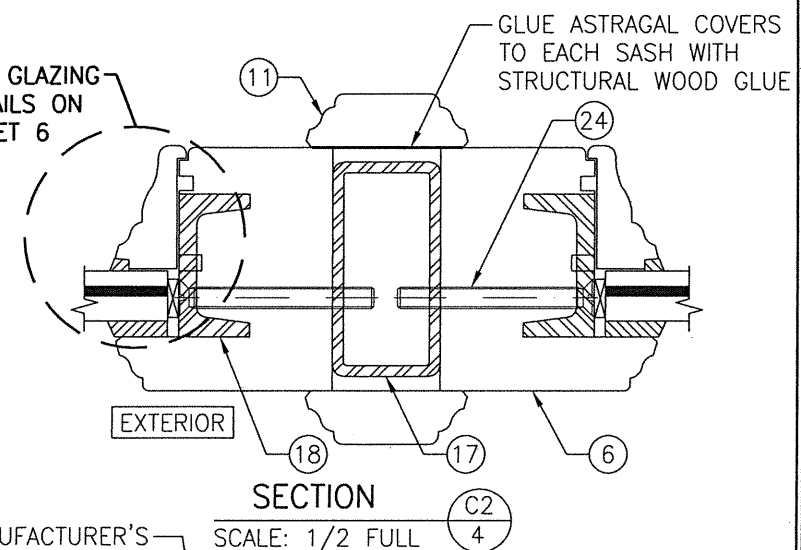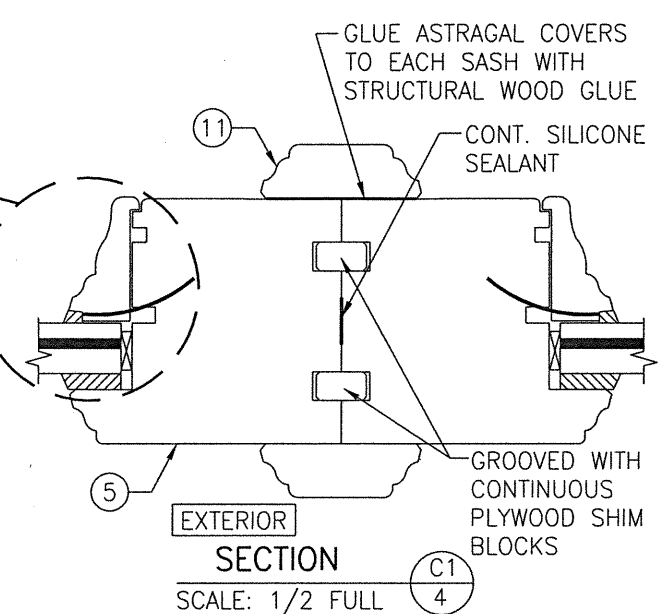


DRAWN BY:	S.T.R.	CHECKED BY:	WWS
PLOT:	1=2	DATE:	3/15/05
NO.		REVISION DESCRIPTION	
DATE		BY	
DESCRIPTION			
NO.			
DRAWING TITLE	AMERICAN OUT-SWING FIXED CASEMENT IMPACT WOOD WINDOWS		
CONSULTANTS	PEETZ WINDOWS & DOORS		
MANUFACTURER	15951 S.W. 41ST STREET, SUITE 150 WESTON, FL 33331 954-659-3887		
ENGINEER	W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809)		
PROFESSIONAL ENGINEER	7480 150TH COURT NORTH PALM BEACH GARDENS, FL 33418 PHONE: 561-744-3424		
CERTIFICATION	No. 44135		
STATE OF	FLORIDA		
EXPIRATION DATE	JUN 02 2020		
PROFESSIONAL ENGINEER	WARREN W. SCHAEFER, P.E.		
NO.	44135		
DRAWING NO.	1322		
REV.	D		
SHEET NO.	4 OF 7		

SEE GLAZING
DETAILS ON
SHEET 6

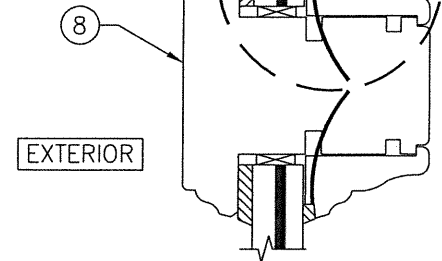

SECTION
SCALE: 1/2 FULL


E
5

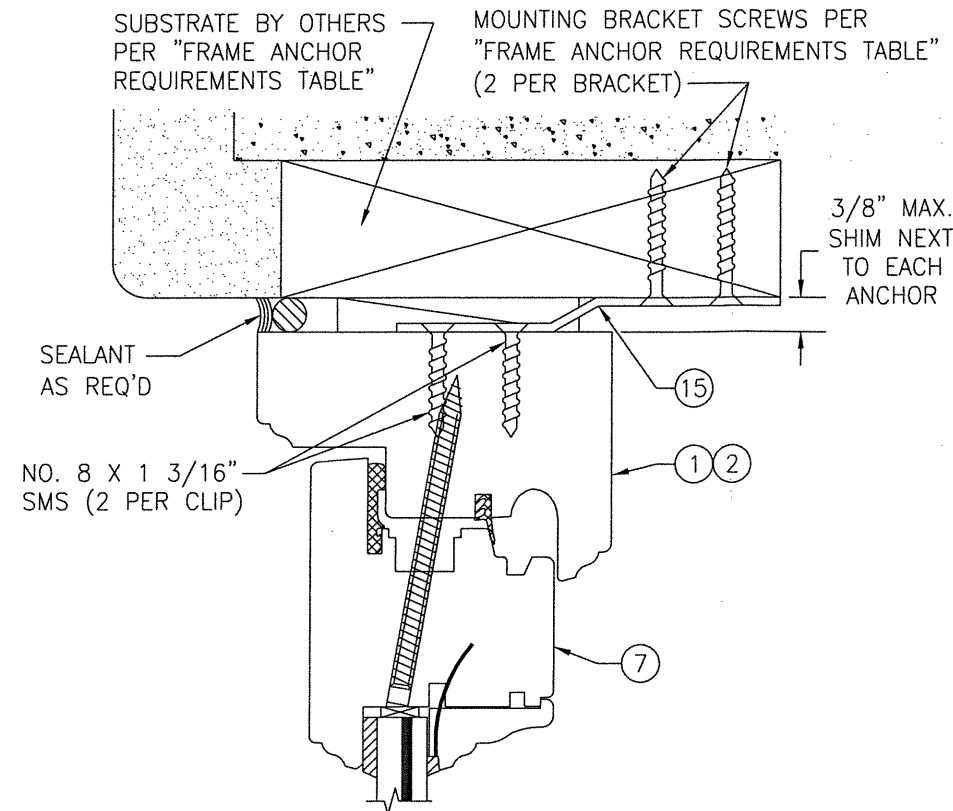

OPTIONAL NARROW INSTALLATION BRACKET MOUNT DETAIL

(HEAD SECTION SHOWN; SILL & SIDES ARE INSTALLED THE SAME)
(FOR DETAIL NOT SHOWN, SEE OTHER SECTIONS)


NOTE: BRACKET IS SHOWN PROJECTED TO THE INTERIOR.
IT MAY ALSO BE PROJECTED TO THE EXTERIOR.

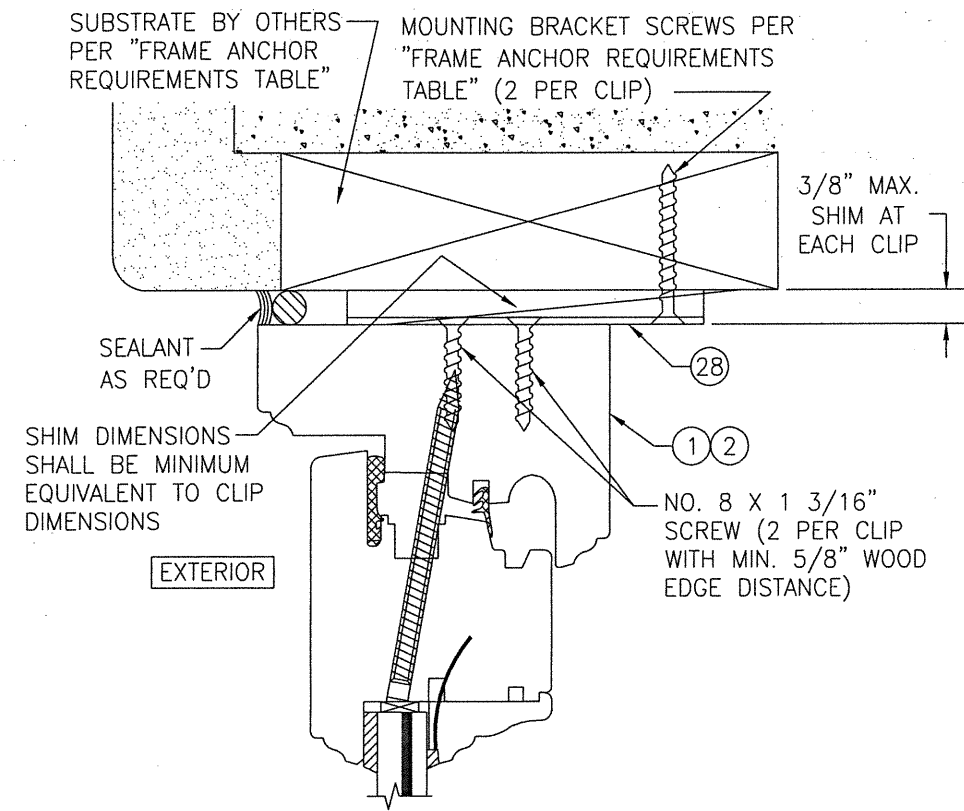

OPTIONAL WIDE BRACKET MOUNT DETAIL


(HEAD SECTION SHOWN; SILL & SIDES ARE INSTALLED THE SAME)
(FOR DETAIL NOT SHOWN, SEE OTHER SECTIONS)

NOTE: BRACKET IS SHOWN PROJECTED TO THE INTERIOR.
IT MAY ALSO BE PROJECTED TO THE EXTERIOR.

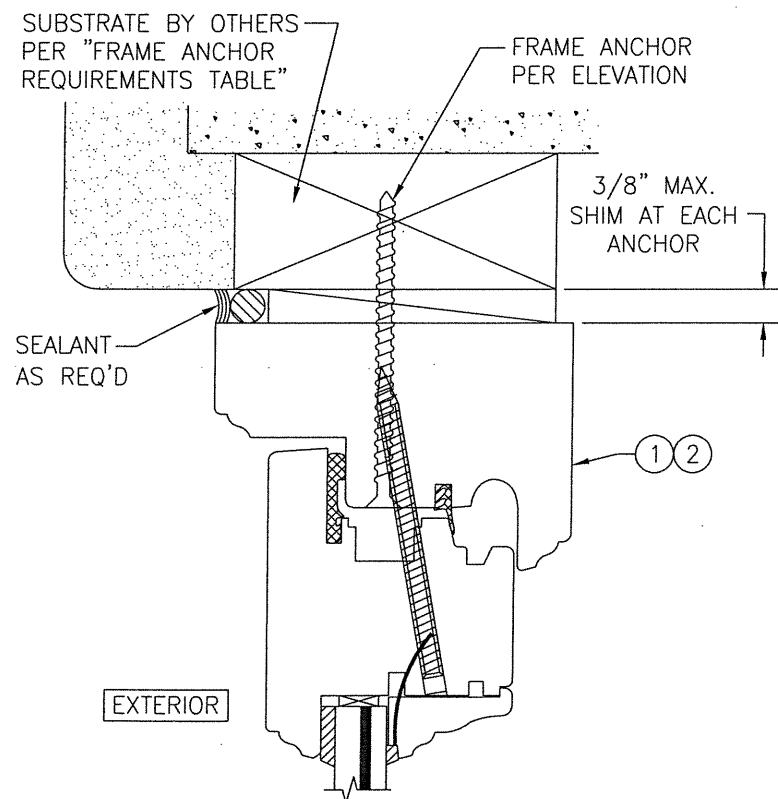

OPTIONAL FRAME SCREW MOUNT DETAIL


(HEAD SECTION SHOWN; SILL & SIDES ARE INSTALLED THE SAME)
(FOR DETAIL NOT SHOWN, SEE OTHER SECTIONS)

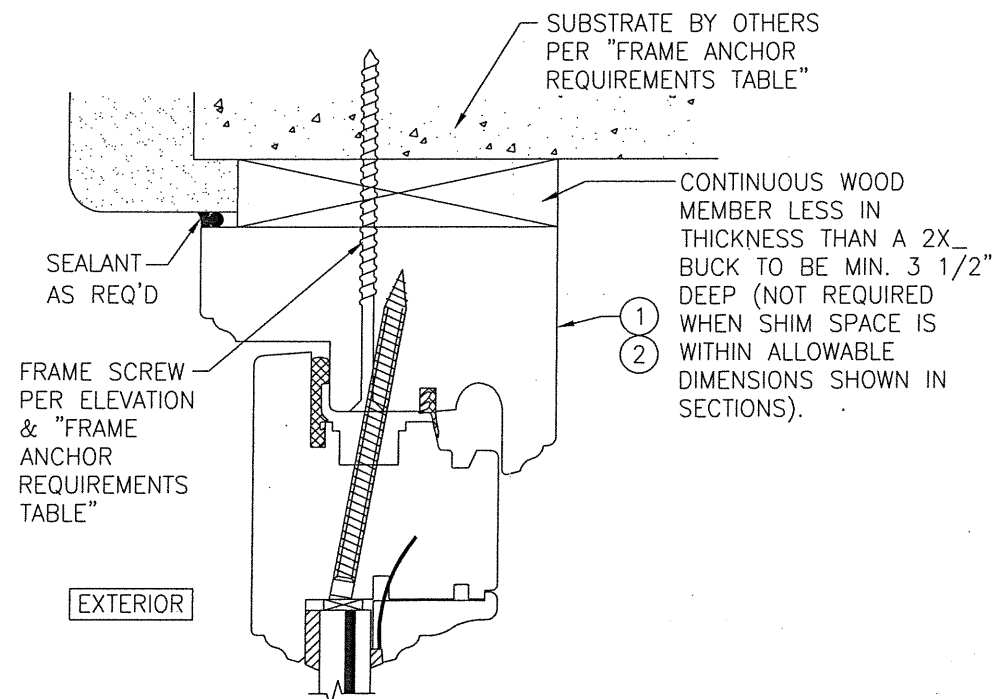

OPTIONAL DIRECT MOUNT DETAIL TO SUBSTRATE WITH SPACER


(HEAD SECTION SHOWN; SILL & SIDES ARE INSTALLED THE SAME)
(FOR DETAIL NOT SHOWN, SEE OTHER SECTIONS)

DRAWN BY: S.T.R.	CHECKED BY: WWS
PLOT: 1=2	DATE: 3/15/05
DATE	BY
REVISION DESCRIPTION	NO
AMERICAN OUT-SWING FIXED CASEMENT IMPACT WOOD WINDOWS MANUFACTURER PEETZ WINDOWS & DOORS 15951 S.W. 41ST STREET, SUITE 150 WESTON, FL 33331 954-659-3887 CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809) 7480 150TH COURT NORTH PALM BEACH GARDENS, FL 33418 PHONE: 561-744-3424	
DRAWING TITLE CERTIFICATION STATE OF FLORIDA WARREN W. SCHAEFER LICENSE No. 44135 P.E. NO. 44135 JUN 10 2 2020	
DRAWING NO. 1322	REV. D
SHEET NO. 5	OF 7

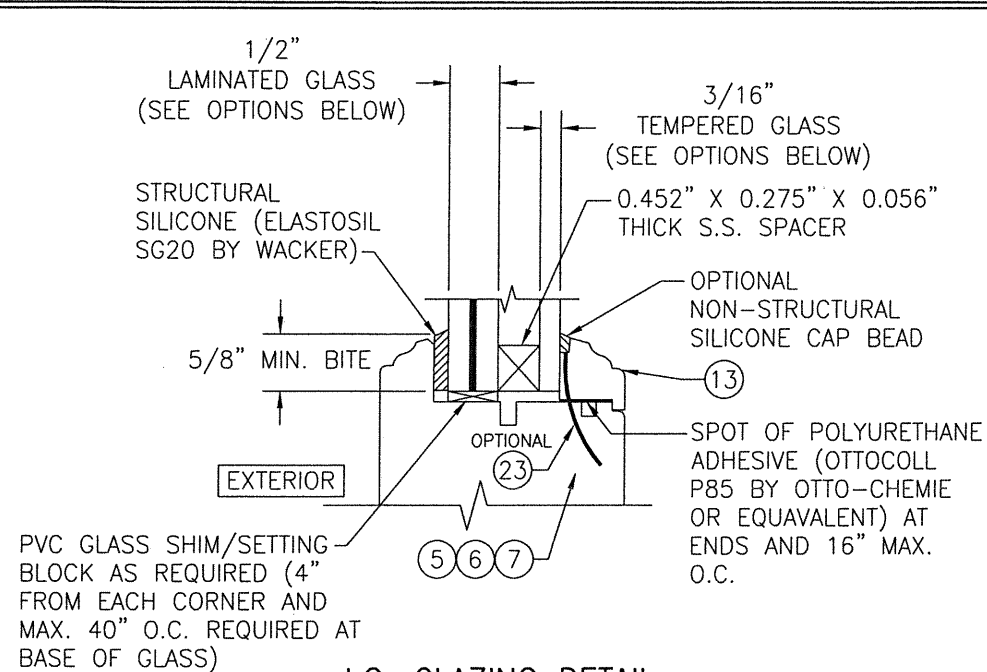


I.G. GLAZING DETAIL

- GLASS OPTION: 1. 1/2" THICK LAMINATED OUTER GLASS (3/16" AN/0.09 EASTMAN CHEMICAL CO. "SAFLEX"/1/4" AN); 3/16" TEMPERED SINGLE PANE INNER GLASS & 1/2" AIR SPACE
2. 1/2" THICK LAMINATED OUTER GLASS (3/16" AN/0.075 EASTMAN CHEMICAL CO. "SAFLEX CP"/1/4" AN); 3/16" TEMPERED SINGLE PANE INNER GLASS & 1/2" AIR SPACE

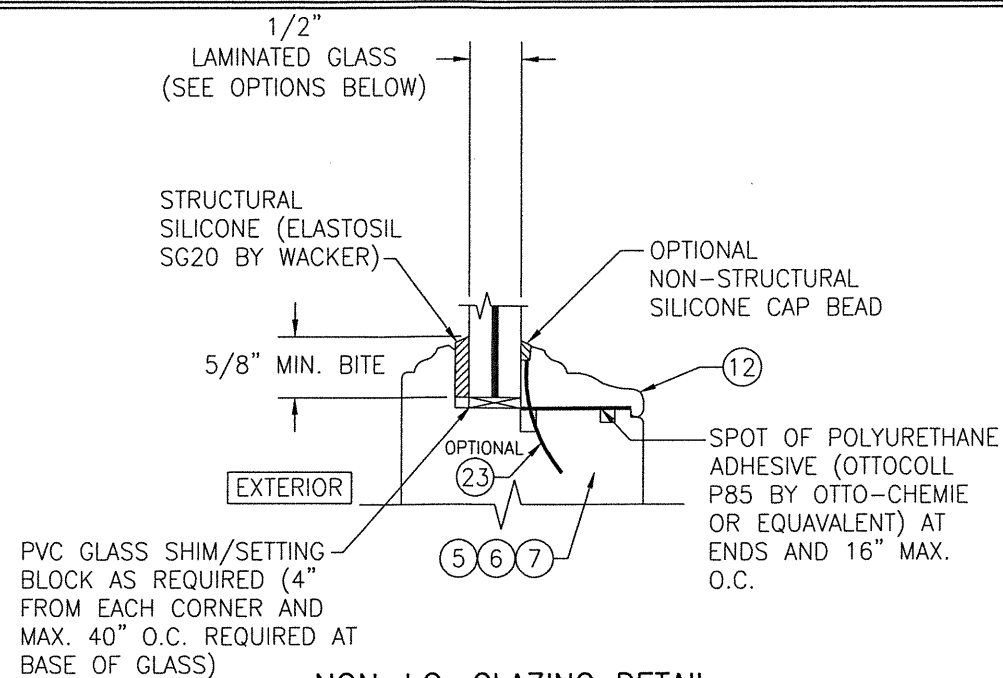

NON-I.G. GLAZING DETAIL

- GLASS OPTION: 1. 1/2" THICK LAMINATED GLASS (3/16" AN/0.09 EASTMAN CHEMICAL CO. "SAFLEX"/1/4" AN)
2. 1/2" THICK LAMINATED GLASS (3/16" AN/0.075" EASTMAN CHEMICAL CO. "SAFLEX CP"/1/4" AN)

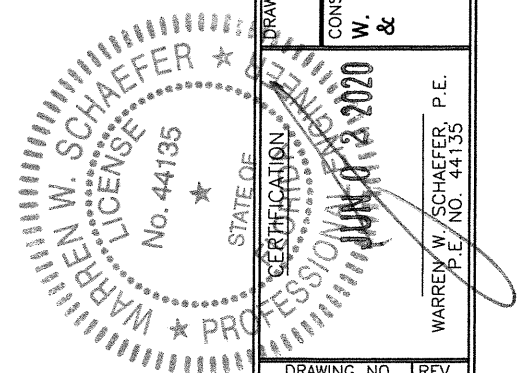

DRAWN BY: S.T.R.		CHECKED BY: W.W.S.	
PLOT: 1=2		DATE: 3/15/05	
DATE	BY	REVISION	DESCRIPTION
DRAWING TITLE AMERICAN OUT-SWING FIXED CASEMENT IMPACT WOOD WINDOWS			
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809) 7480 150TH COURT NORTH PALM BEACH GARDENS, FL 33418 PHONE: 561-744-3424		MANUFACTURER PEETZ WINDOWS & DOORS 15951 S.W. 41ST STREET, SUITE 150 WESTON, FL 33331 954-659-3887	
CERTIFICATION JUN 12 2020 WARREN W. SCHAEFER, P.E. P.E. NO. 44135		DRAWING NO. 1322	
SHEET NO. 6 OF 7		REV. D	

