

DESIGN LOAD CAPACITY - PSF													
AVERAGE PANEL WIDTH INCHES	DOOR FRAME HEIGHT INCHES	ANCHORS TYPE 'A'				ANCHORS TYPE 'B'				ANCHORS TYPE 'C'			
		4 ANCHORS AT STILE ENDS		6 ANCHORS AT STILE ENDS		4 ANCHORS AT STILE ENDS		6 ANCHORS AT STILE ENDS		4 ANCHORS AT STILE ENDS		6 ANCHORS AT STILE ENDS	
		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
30	82	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
36		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
42		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
48		76.0	76.0	80.0	80.0	78.0	78.0	80.0	80.0	80.0	80.0	80.0	80.0
54		71.0	71.0	80.0	80.0	73.0	73.0	80.0	80.0	80.0	80.0	80.0	80.0
30	84	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
36		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
42		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
48		73.0	73.0	80.0	80.0	76.0	76.0	80.0	80.0	80.0	80.0	80.0	80.0
54		68.0	68.0	78.8	78.8	71.0	71.0	78.8	78.8	78.8	78.8	78.8	78.8
30	90	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
36		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
42		73.0	73.0	80.0	80.0	75.0	75.0	80.0	80.0	80.0	80.0	80.0	80.0
48		67.0	67.0	78.6	78.6	69.0	69.0	78.6	78.6	77.0	77.0	78.6	78.6
30	96	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
36		75.0	75.0	80.0	80.0	78.0	78.0	80.0	80.0	80.0	80.0	80.0	80.0
42		67.0	67.0	76.5	76.5	69.0	69.0	76.5	76.5	76.5	76.5	76.5	76.5
48		61.0	61.0	73.1	73.1	63.0	63.0	73.1	73.1	71.0	71.0	73.1	73.1

AVERAGE PANEL WIDTH = $\frac{\text{DOOR FRAME WIDTH}}{\text{NUMBER OF PANELS}}$

DOOR HEIGHT AND WIDTH SIZE MUST COMPLY
EGRESS REQUIREMENTS PER FBC AS REQUIRED.

SERIES-1600

ALUMINUM SLIDING GLASS DOOR

DESIGN LOAD RATING FOR THESE DOORS TO BE AS PER
CHARTS SHOWN ABOVE.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE
REQUIREMENTS OF THE 2023 (8TH EDITION)/2026 (9TH EDITION) FLORIDA
BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE
DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT
LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS
AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE
MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

ALL SHIMS TO BE LOAD-BEARING, (HIGH DENSITY PLASTIC/COMPOSITE, METAL
OR OTHER RIGID MATERIALS).


MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT
COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE
REQUIREMENTS OF THE 2023/2026 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION
FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY
OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR
WATER INFILTRATION RESISTANCE ETC.
CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY,
AND TO BE REVIEWED BY BUILDING OFFICIAL.


DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION
IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE.
LABELING TO COMPLY WITH SECTION 1709.9.2.

NOTE:
GLASS CAPACITIES ARE BASED ON
ASTM E1300-16 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

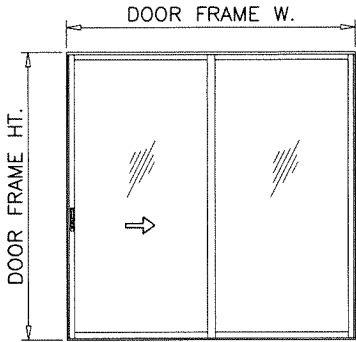

APPROVED CONFIGURATIONS

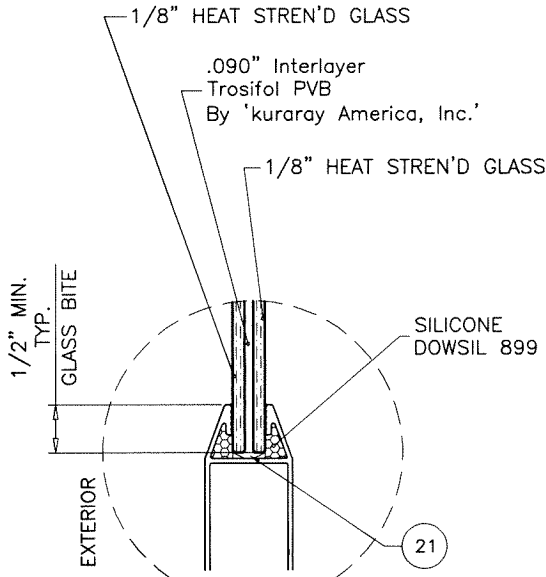

GLAZING DETAIL
5/16" OVERALL LAM. GLASS

FASTENERS AND CONNECTORS (AS APPLICABLE) SHOWN IN THIS APPROVAL MAY NOT MEET
CORROSION RESISTANCE REQUIREMENTS FOR COASTAL OR SALT WATER EXPOSURE ZONES.
COMPLIANCE WITH THESE CONDITIONS TO BE CHECKED PER FBC 1711.

THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT.
SHUTTERS ARE NOT REQUIRED.

LAMINATED GLASS
LARGE MISSILE IMPACT

Sealed: 8/3/2026

FL #32359

A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND
INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION
PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED
ON THIS DOCUMENT.
B- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF
ALTERED BY ANY MEANS.
C- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED
ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.)
FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER
USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED
ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE
SPECIFIC DRAWINGS FOR REVIEW.
D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF
THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.



SERIES-1600 ALUM SLIDING GLASS DOOR (L.M.I.)

Sunshine Windows Manufacturing, Inc.

1785 West 33rd Place
Hialeah, FL. 33012


Tel. (305) 364-9952 Fax. (305) 828-5118

afc

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 262-6978 FAX. (305) 262-6978

COMP-ANL\20-36F-SWM

revisions:		date		by		description	
no	date	no	date	no	date	no	date
A	08.27.20	1	08.27.20	1	08.27.20	1	08.27.20
B	07.21.23	2	07.21.23	2	07.21.23	2	07.21.23
C	07.21.26	3	07.21.26	3	07.21.26	3	07.21.26
date: 04-01-20		scale: 1/2" = 1"		dr. by: TARIQ		chk. by:	
drawing no.		20-36F		sheet 1 of 8			

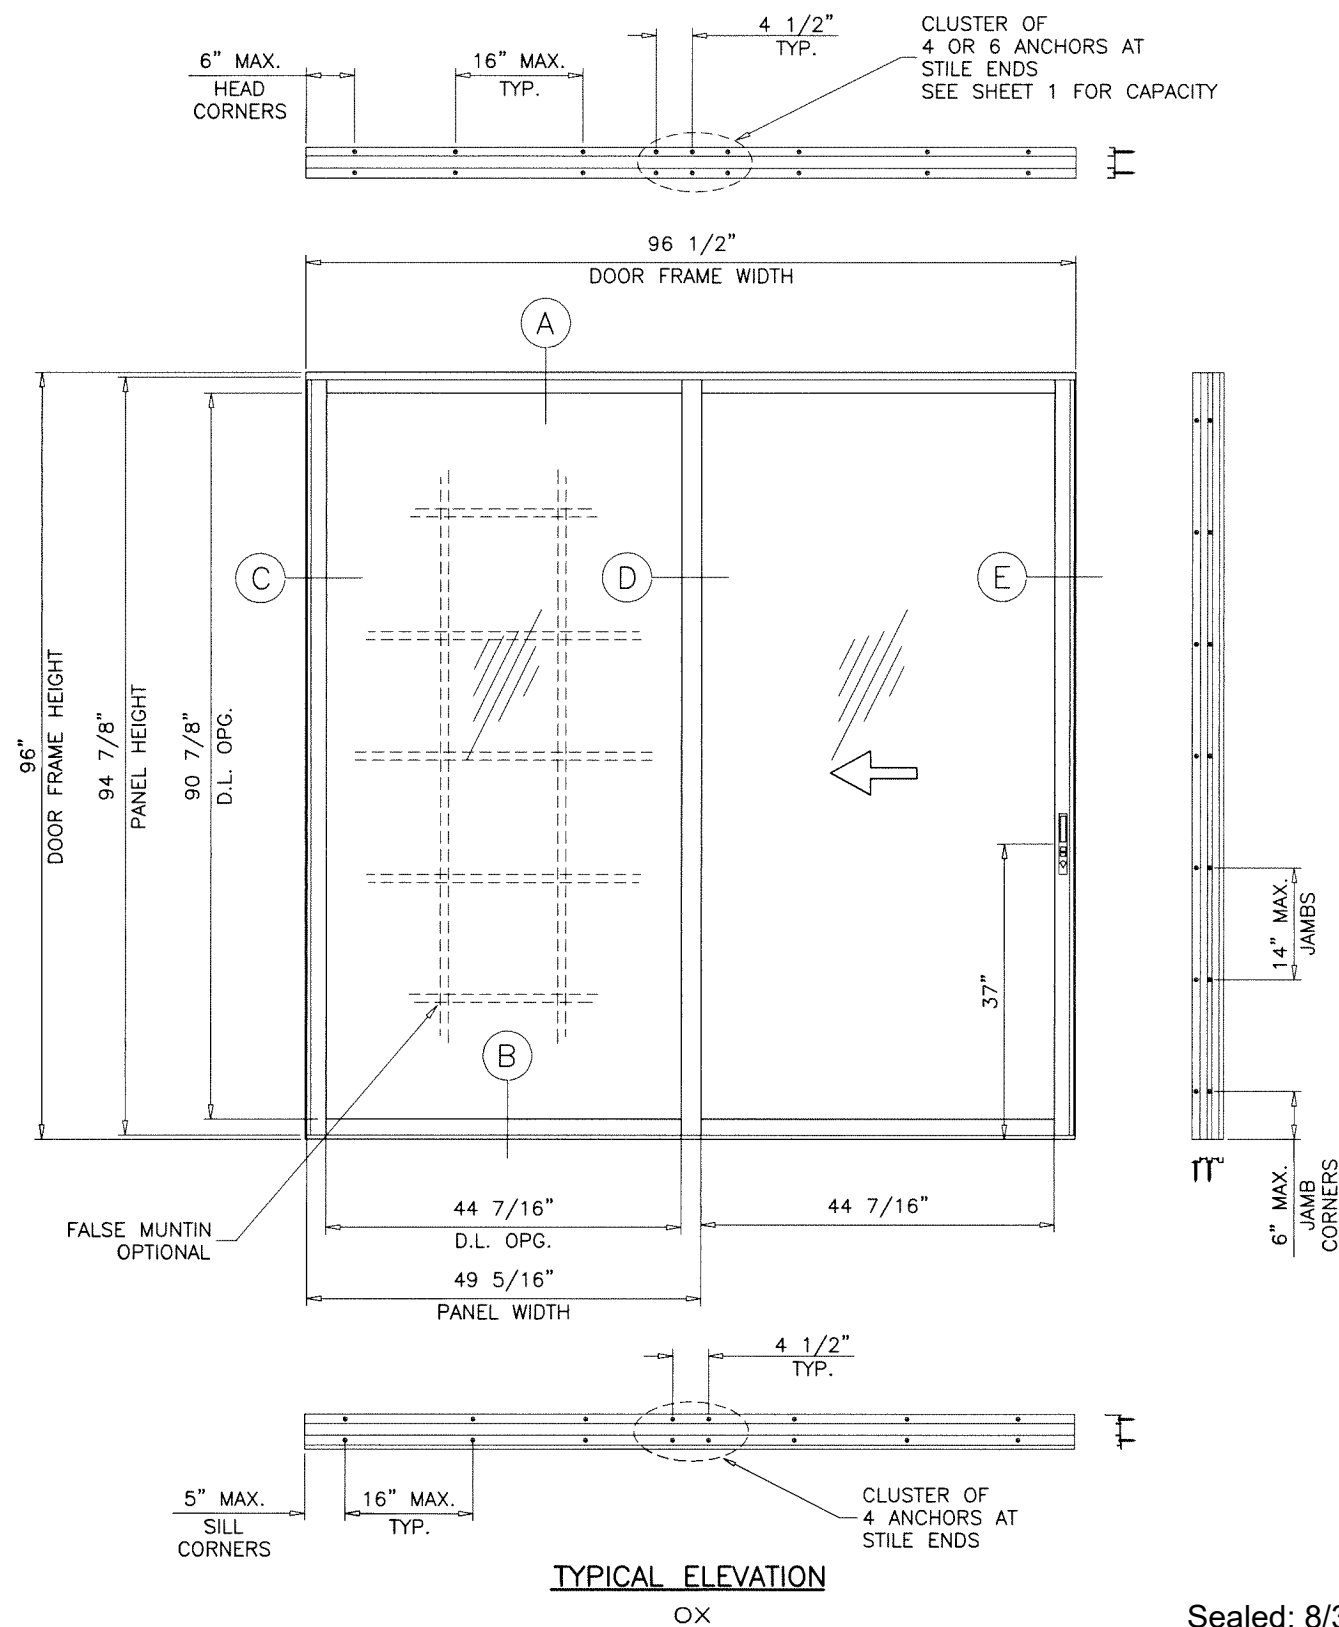

DAYLITE OPENINGS WIDTHS:
 PANEL WIDTH - 7.125"
 DAYLITE OPENING HEIGHT:
 PANEL HEIGHT - 6.50"
 PANEL HEIGHT = DOOR FRAME HEIGHT - 1.5625"

Sealed: 8/3/2026



AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978

af c

COMP-ANL\20-36F-SWM

SERIES-1600 ALUM SLIDING GLASS DOOR (L.M.I.)



Sunshine Windows Manufacturing, Inc.
 1785 West 33rd Place
 Hialeah, FL 33012
 Tel. (305) 364-9952 Fax. (305) 828-5118

revisions:	
no	description

date: 04-01-20
 scale: 1/2"=1'-0"
 dr. by: TARIQ
 chk. by:

drawing no.
20-36F
 sheet 2 of 8

FL #32359

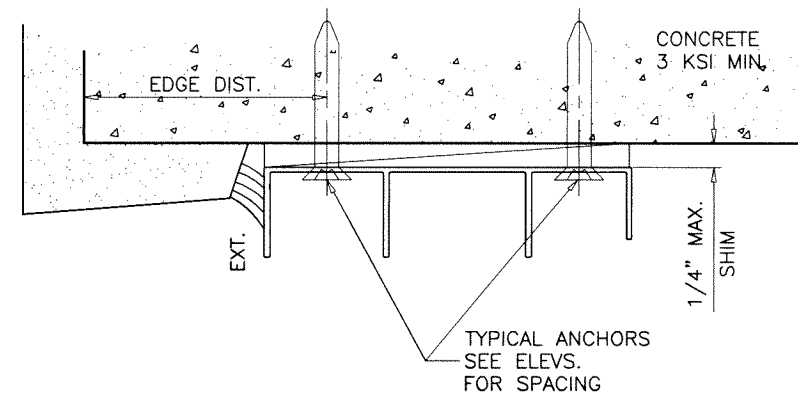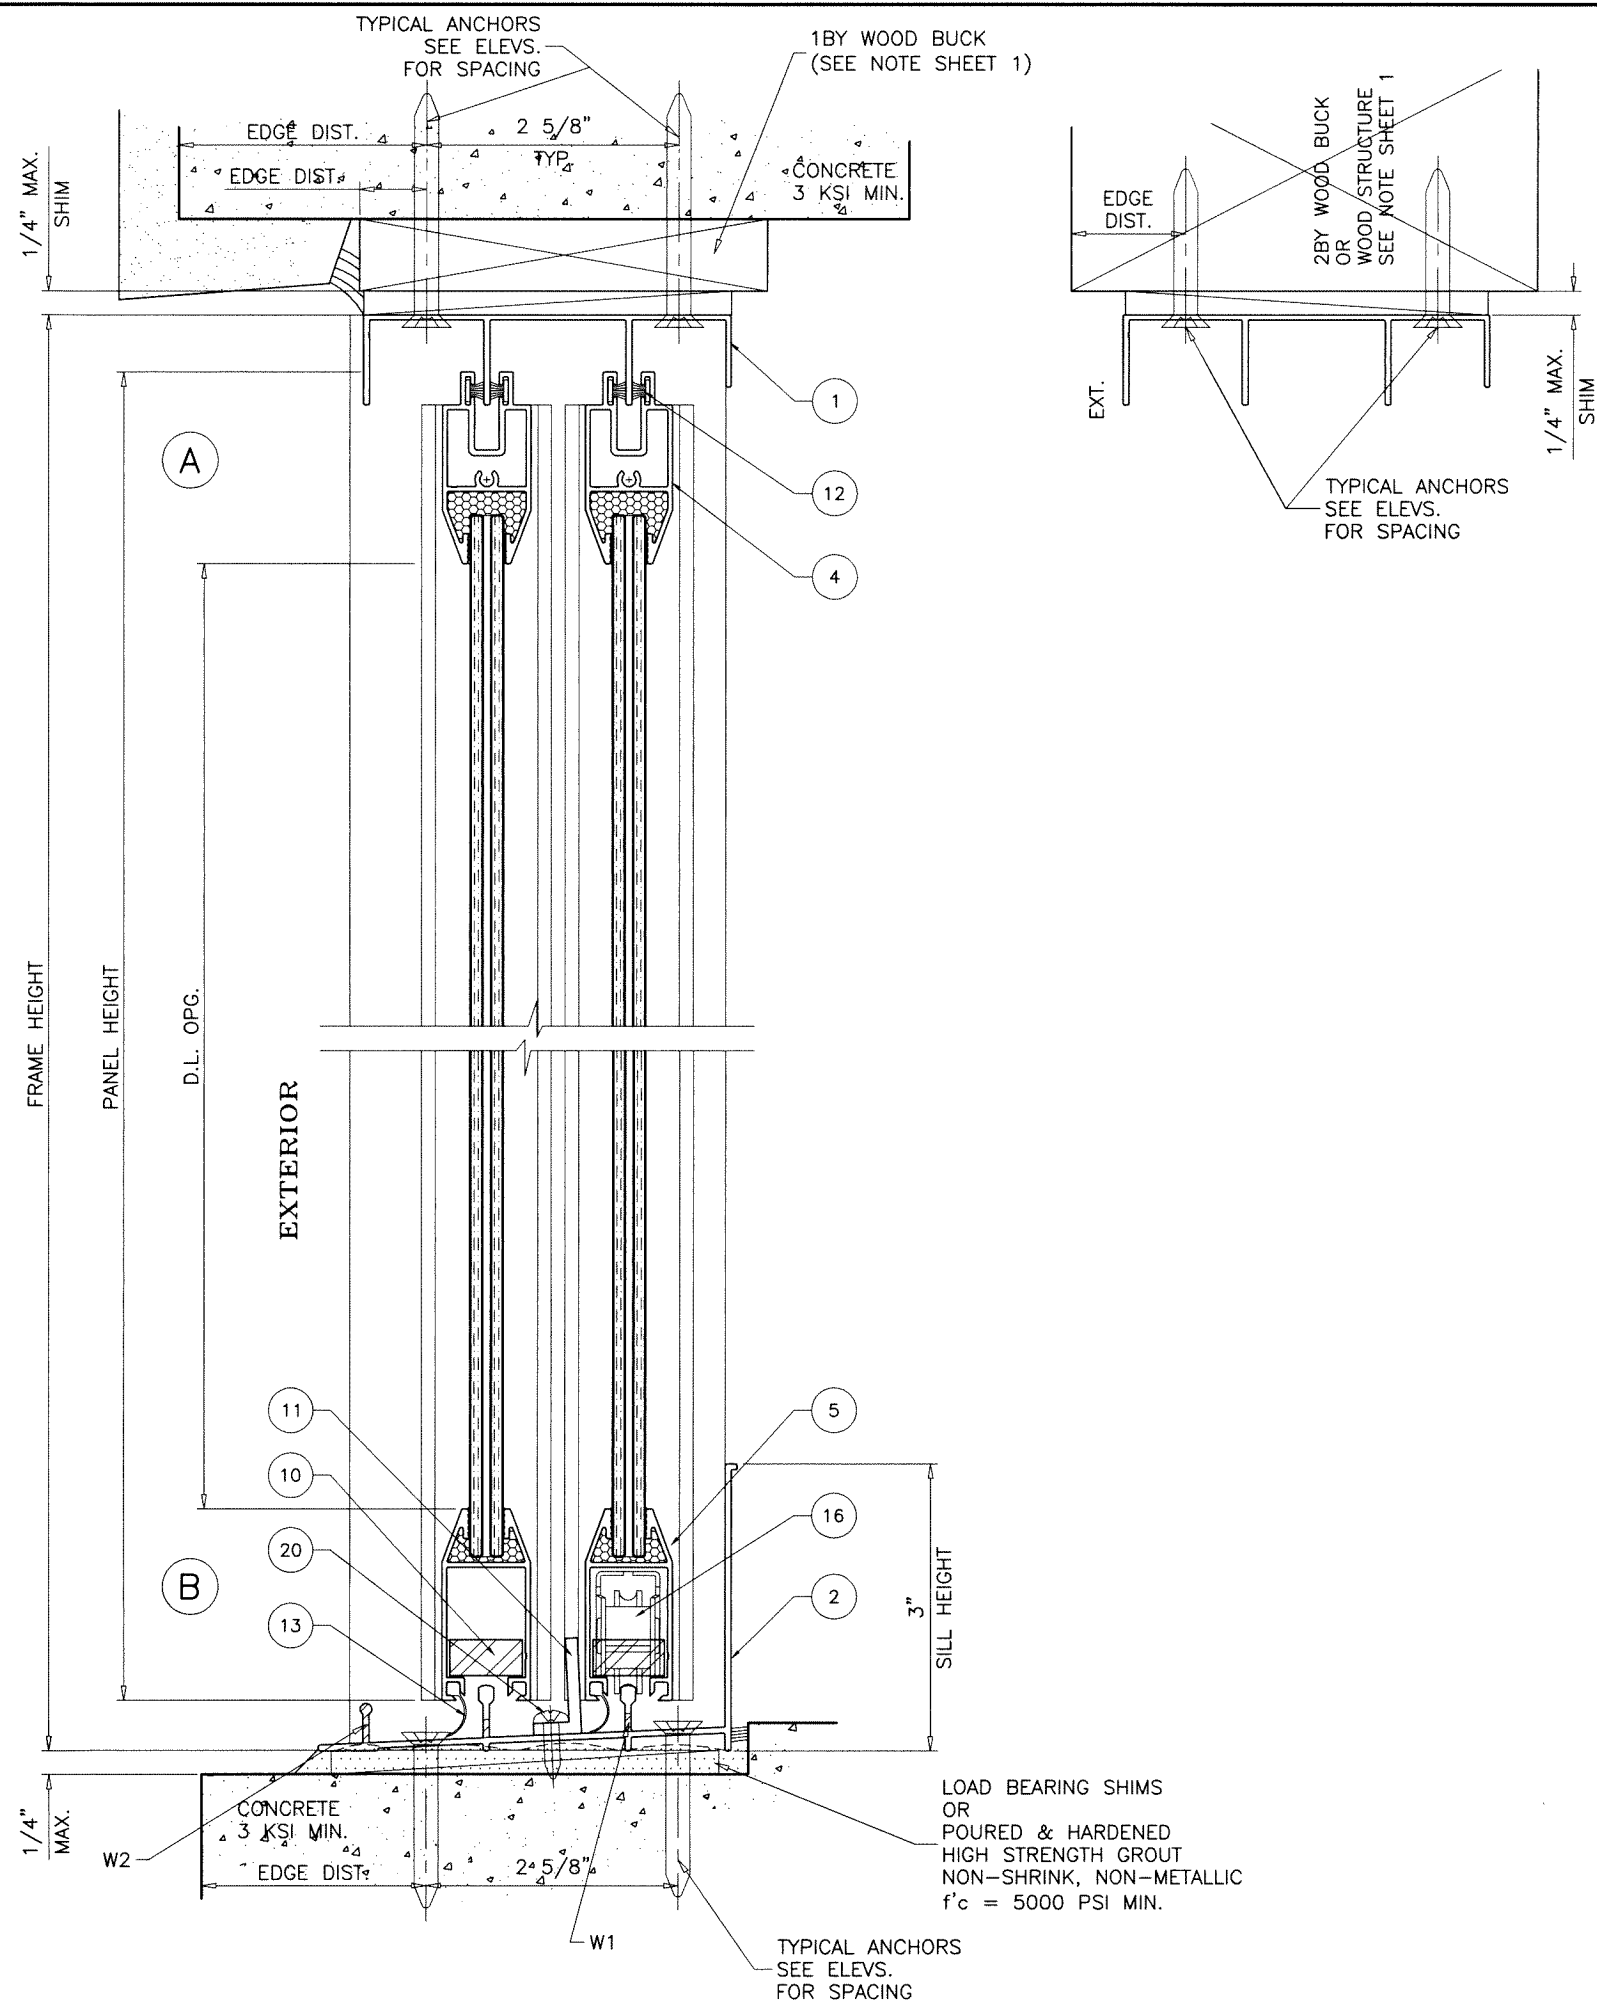

Sealed: 8/3/2026

1BY OR 2BY WOOD BUCKS AND METAL STRUCTURE NOT BY 'SUNSHINE WDW,'
MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM
AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
AT HEAD

TYPE 'A'— 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD
THRU 1BY BUCKS INTO CONCRETE
1-1/4" MIN. EMBED INTO CONCRETE

TYPE 'B'— 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
DIRECTLY INTO CONCRETE
1-1/4" MIN. EMBED INTO CONCRETE

TYPE 'C'— 1/4" DIA. TEKS OR SELF-DRILLING SCREWS (GRADE 5 CRS)
INTO F.B.C. APPROVED MULLIONS
AND
INTO METAL STRUCTURES
(3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS
ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

AT SILL

TYPE 'B'— 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
DIRECTLY INTO CONCRETE
1-1/4" MIN. EMBED INTO CONCRETE

AT JAMBS

TYPE 'A'— 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD
THRU 1BY BUCKS INTO CONC. OR BLOCKS
1-1/4" MIN. EMBED INTO CONCRETE OR BLOCKS



TYPE 'B'— 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
DIRECTLY INTO CONCRETE OR BLOCKS
1-1/4" MIN. EMBED INTO CONCRETE OR BLOCKS

TYPE 'C'— 1/4" DIA. TEKS OR SELF-DRILLING SCREWS (GRADE 5 CRS)
INTO F.B.C. APPROVED MULLIONS
AND
INTO METAL STRUCTURES
(3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS
ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)


CRITICAL EDGE DISTANCE

INTO CONCRETE AND BLOCKS = 2-1/2" MIN.
INTO WOOD STRUCTURE = 1" MIN.
INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.
CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

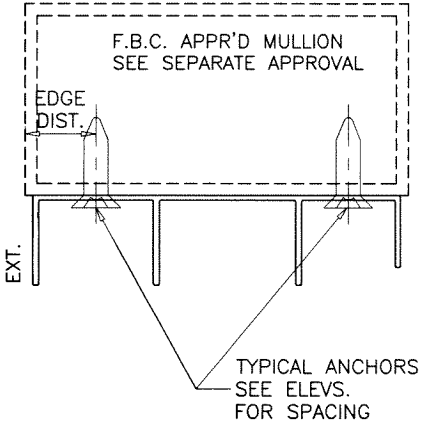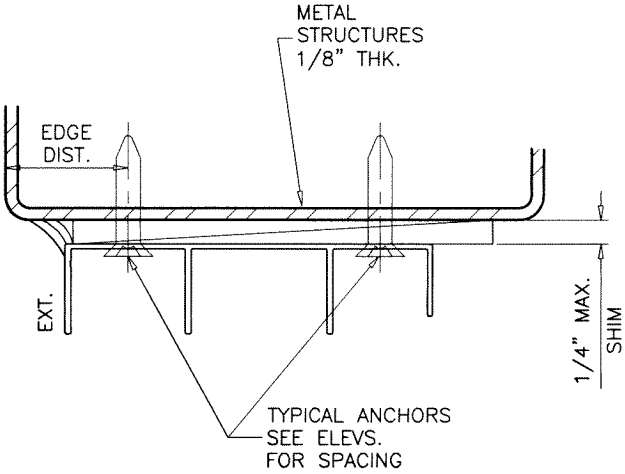

Sealed: 8/3/2026

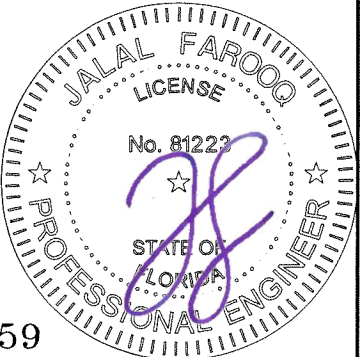

FL #32359

af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
C.O.N. 3538

SERIES-1600 ALUM SLIDING GLASS DOOR (L.M.I.)


Sunshine Windows Manufacturing, Inc.
1785 West 33rd Place
Hialeah, FL. 33012
Tel. (305) 364-9952 Fax. (305) 828-5118

revisions:
no. date by description

date: 04-01-20
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:

drawing no.
20-36F
sheet 4 of 8

COMP-ANL\20-36F-SWM

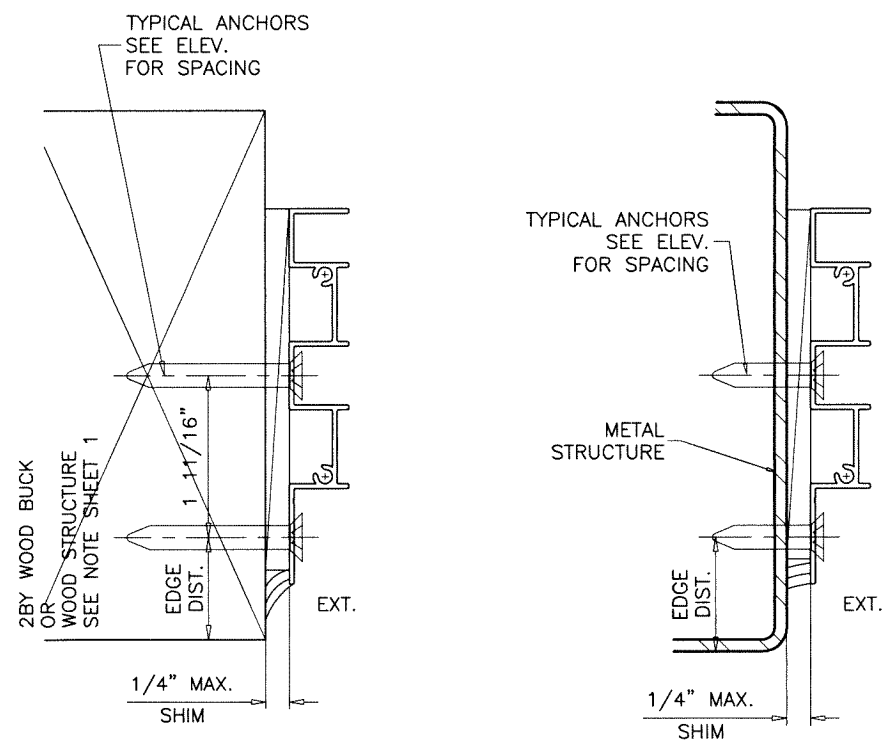

P2 = SELF ADHESIVE PILE PAD AT TOP AND BOTTOM
1" X 3" LONG

sheet 5 of 8

ITEM #	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	SW-002	1	FRAME HEAD	6063-T6	-
2	SSW-0002	1	HI-RISE FRAME SILL	6063-T6	-
3	SW-001	2	FRAME JAMB	6063-T6	-
4	SW-005	1/ PANEL	PANEL TOP RAIL	6063-T6	-
5	SW-004	1/ PANEL	PANEL BOTTOM RAIL	6063-T6	-
6	SW-006	2/ PANEL	PANEL FIXED STILE	6063-T6	-
7	SW-999	AS REQD.	PANEL INTERLOCK STILE	6063-T6	-
8	BA-4828	AS REQD.	PANEL H.D. LOCK STILE	6063-T6	-
9	-	AS REQD.	INTERLOCK REINF. BAR	STEEL	A36, Fu MIN. = 58 KSI
10	-	2	BOTTOM RAIL REINF. BAR	STEEL	A36, Fu MIN. = 58 KSI
11	-	1	RETAINER CLIP, 4-1/8" LONG	6063-T6	AT MID WIDTH OF MOV. PANEL
12	W11255NK000B	AS REQD.	PILE W'STRIPPING	POLYPROPYLENE	ULTRAFAB, #250
13	MPI N/P 4009	AS REQD.	FLAP W'STRIPPING	VINYL	MELTPPOINT PLASTICS
14	MPI N/P 3252A	AS REQD.	BULB W'STRIPPING	VINYL	MELTPPOINT PLASTICS
16	PJS-03-BSS	2/ MOV. PANEL	TANDEM STEEL WHEELS IN METALLIC HOUSING	ST. STEEL	SULLIVAN & ASSOC.
17	SM4400-SUN	AS REQD.	FLUSH MOUNT HOOK LOCK	ZINC/ST. STEEL	SULLIVAN & ASSOC.
18	#8 X 1"	AS REQD.	FRAME/PANEL ASSEMBLY FASTENERS	ST. STEEL	PH SMS
19	#8 X 1"	AS REQD.	FIX. PANEL FASTENERS, AT 6" FROM ENDS & 17" O.C. MAX.	ST. STEEL	PH SMS
20	#10 X 1"	3/ CLIP	RETAINER CLIP FASTENERS	ST. STEEL	PH SMS
21	-	2/ LITE	SETTING BLOCK (1/16" X 5/8" X 3" LONG) AT 1/4 POINTS	EPDM	DUROMETER 80±5 SHORE A

LOCK:

SURFACE MOUNT METALLIC HANDLE AT 37" FROM BOTTOM
FASTENED TO LOCK STILE WITH
(2) #10-24 X 2-3/4" OH MS
SURFACE MOUNT METALLIC 3 PLY HOOK LOCK AT
37" FROM BOTTOM
FASTENED TO LOCK STILE WITH
(2) #10-32 X 1/2" FH MS
SURFACE MOUNT METALLIC KEEPER AT 35-1/2" FROM BOTTOM
FASTENED TO FRAME JAMB AND ASTRAGAL STILE WITH
(2) #10 X 5/8" PH SMS

SEALANT:

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH
WHITE/ALUMINUM COLORED SILICONE.



Sealed: 8/3/2026

FL #32359




AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES-1600 ALUM SLIDING GLASS DOOR (L.M.I.)


Sunshine Windows Manufacturing, Inc.
1785 West 33rd Place
Hialeah, FL. 33012
Tel. (305) 364-9952 Fax. (305) 828-5118

revisions:	no	date	by	description


date: 04-01-20	scale: 1/2" = 1"	dr. by: TARIQ	chk. by:
drawing no. 20-36F			
sheet 6 of 8			

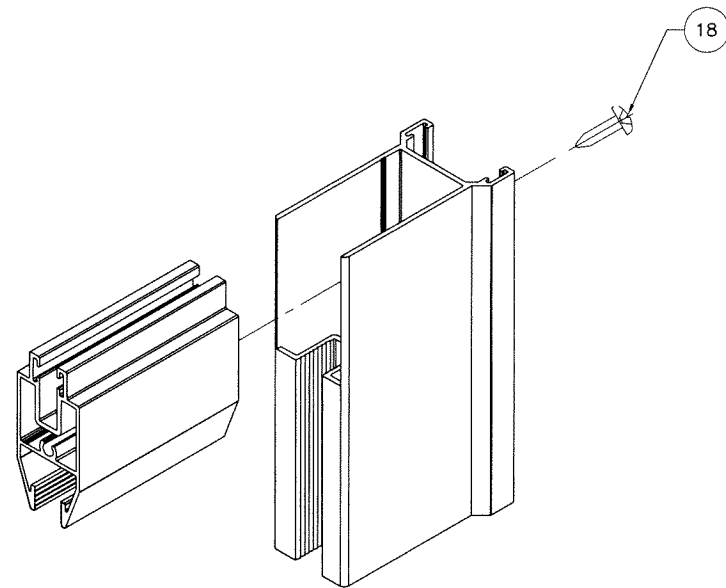


PANEL TOP CORNER

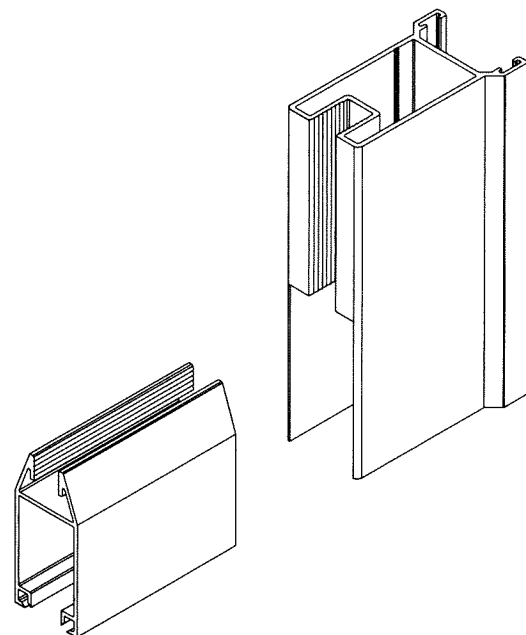

PANEL BOTTOM CORNER

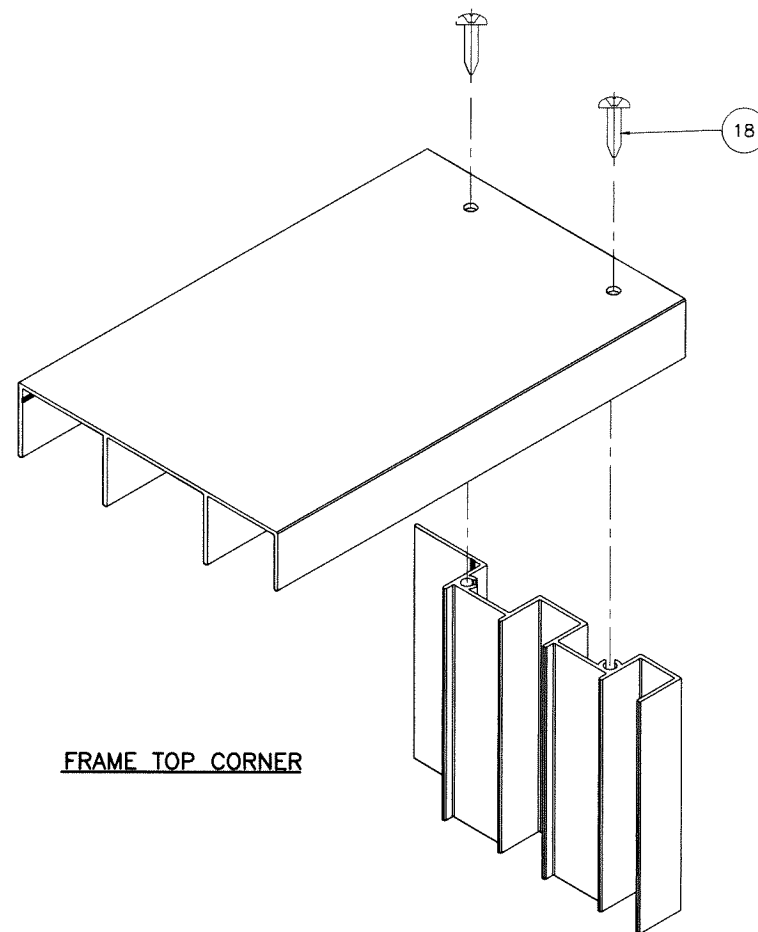


FRAME TOP CORNER

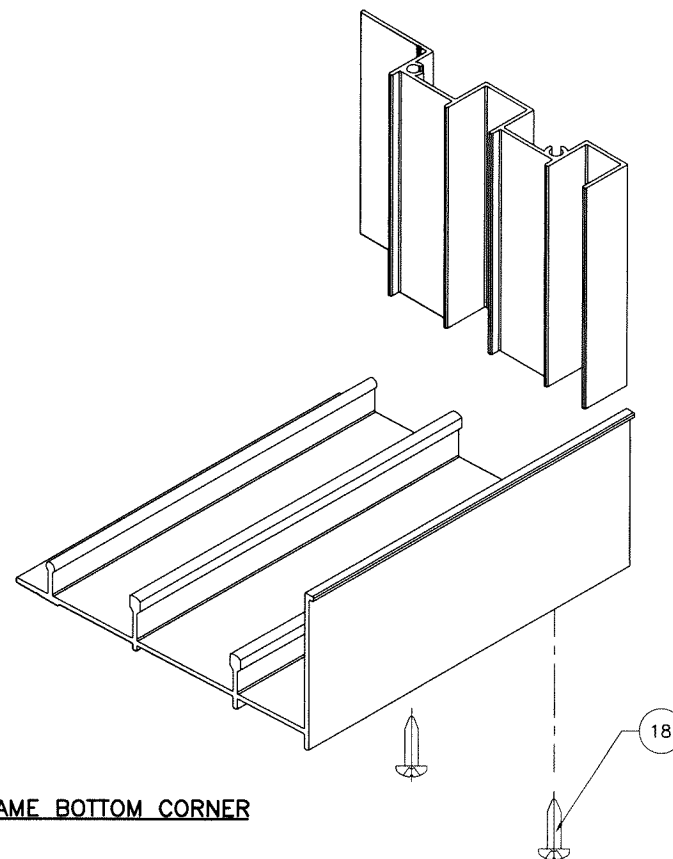

FRAME BOTTOM CORNER

Sealed: 8/3/2026

FL #32359

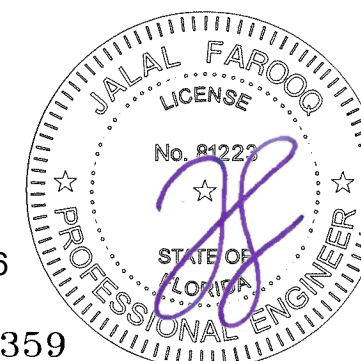

af c AL-FAROOQ CORPORATION ENGINEERS & PRODUCT DEVELOPMENT 9360 SUNSET DRIVE, SUITE 220 MIAMI, FLORIDA 33173 (C.A.N. 3538) TEL. (305) 264-8100 FAX. (305) 262-6978 COMP-ANL\20-36F-SWM																																													
SERIES-1600 ALUM SLIDING GLASS DOOR (L.M.I.) Sunshine Windows Manufacturing, Inc. 1785 West 33rd Place Hialeah, FL. 33012 Tel. (305) 364-9952 Fax. (305) 828-5118																																													
date: 04-01-20 scale: 1/2" = 1" dr. by: TARIQ chk. by:	revisions: <table border="1"> <thead> <tr> <th>no</th> <th>date</th> <th>by</th> <th>description</th> </tr> </thead> <tbody> <tr><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td></tr> </tbody> </table>	no	date	by	description																																								
no	date	by	description																																										
drawing no. 20-36F sheet 8 of 8	no. 20-36F sheet 8 of 8																																												