



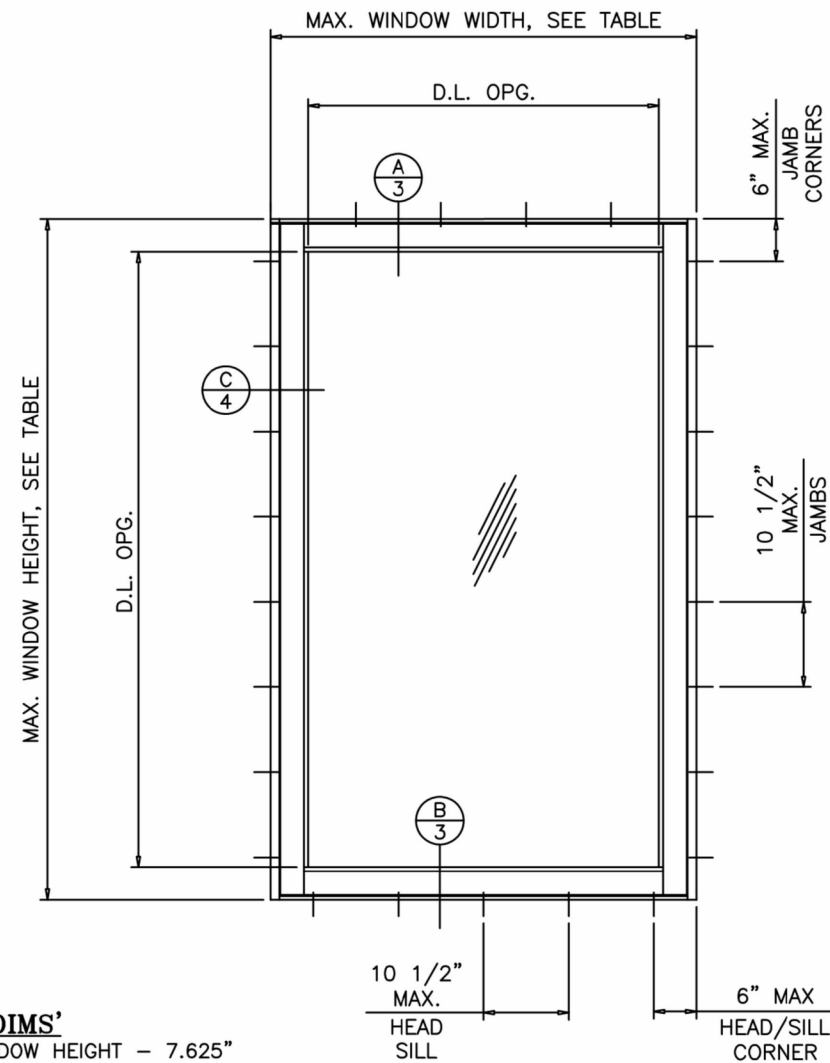


GLASS D.L.O. DIMS'
D.L.O. HEIGHT = WINDOW HEIGHT - 7.625"
D.L.O. WIDTH = WINDOW WIDTH - 7.625"

TYPICAL ELEVATION

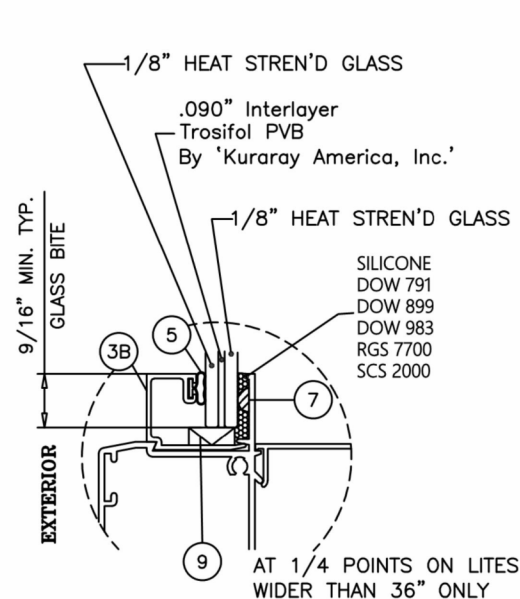


GLASS TYPE 'A'

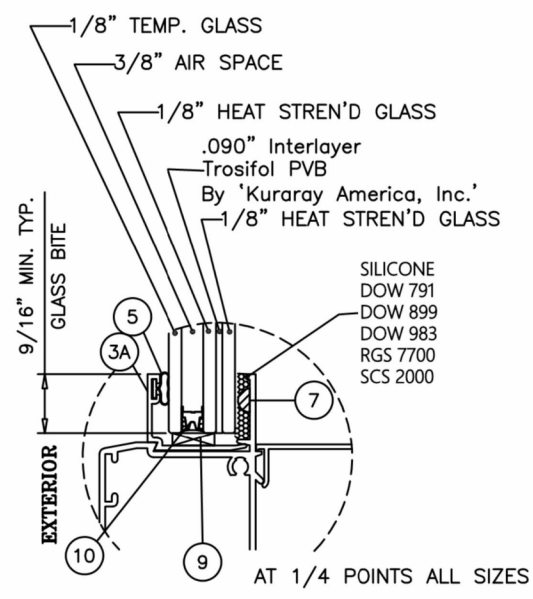


GLASS TYPE 'AA'

GLAZING OPTIONS

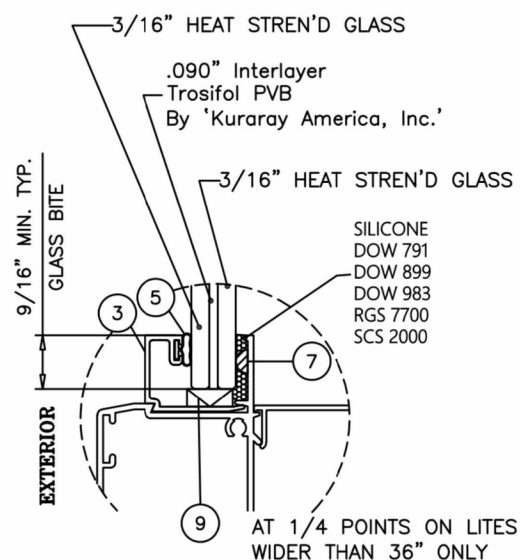

GLASS TYPE 'B'

ALL TEMPERED AND/OR LAMINATED GLASS OPTIONS IN THIS APPROVAL HAVE BEEN CERTIFIED BY THE SGCC FOR COMPLIANCE TO ANSI Z97.1, CLASS A AND CPSC 16 CFR 1201, CATEGORY II. THIS INCLUDES LAMINATED GLASS THAT IS MANUFACTURED WITH ANNEALED GLASS PLIES. FOR APPLICATIONS WHERE THE WINDOW IS BEING USED AS A GUARD, HEAT STRENGTHENED OR TEMPERED LAMINATED GLASS MUST BE USED.



SETTING BLOCKS AT LAM. GLASS AND INSUL. LAM. GLASS
NOTCH GLAZING BEAD LEG TO CLEAR BLOCKS

THESE WINDOWS ARE RATED FOR LARGE & SMALL MISSILE IMPACT.
SHUTTERS ARE NOT REQUIRED.

**ECO-GUARD SERIES-550
ALUMINUM FIXED WINDOW**

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEET 2.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF FIXED/FIXED OR FIXED WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING F.B.C. HVHZ APPROVED MULLIONS IN BETWEEN.

LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC. CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOAD SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.



JAVAD AHMAD PE, inc
7875 NW 12th St., Suite 102 Doral,
FL 33126
Ph: (305) 424-8001
support@ja-pe.com

CONSULTING • STRUCTURAL DESIGN • FACADES • BUILDING ENVELOPE • SYSTEM DESIGN • PRODUCT APPROVALS

drawing no.	date:	JA-1844-24	12/30/2024	MA	BS	drawn by:	check by:	REVISION	DESCRIPTION

SERIES 550: ALUMINUM FIXED WINDOW (L.M.I.)

LARGE MISSILE IMPACT RATED



ECO window systems
ECO WINDOW SYSTEMS, LLC.
8502 N.W. 80th ST., MEDLEY, FL 33166
TEL. (305) 885-5299 FAX. (305) 885-5902




SEALED: 12/30/2024

01
01 of 06

[illegible]

FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE WIDTH OR LENGTH DIMENSION SHOWN ON THE TABLE.

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-16 (3 SEC. GUSTS).

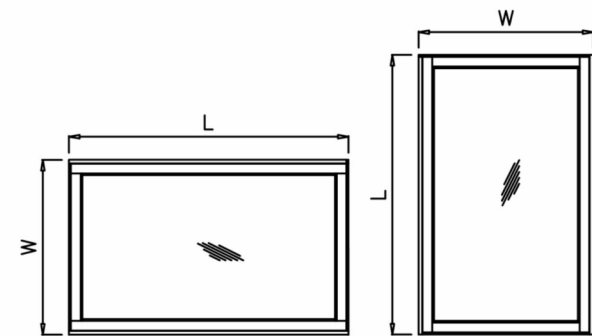

NOTE:
WITH AND LENGTH DIMENSIONS CAN BE ORIENTED
VERTICALLY OR HORIZONTALLY AS SHOW ABOVE.



JAVAD AHMAD PE, inc
7875 NW 12th St., Suite 102 Doral,
FL 33126
Ph: (305) 424-8001
support@ja-pe.com

Ph: (305) 424-8001
support@ja-pe.com

CONSULTING • STRUCTURAL DESIGN • FACADES • BUILDING ENVELOPE • SYSTEM DESIGN • PRODUCT APPROVALS

drawing no.	JA-1844-24	drawn by:	MA
date:	12/30/2024	check by:	BS
REVISION			
No.	DATE	BY	DESCRIPTION

SERIES 550:ALUMINUM FIXED WINDOW
(L.M.I.)







ECO WINDOW SYSTEMS, LLC.
8502 N.W. 80th ST. MEDLEY, FL 33166
TEL. (305) 885-5299 FAX. (305) 885-5902



02	02 of
----	-------

02


FL#32389.7

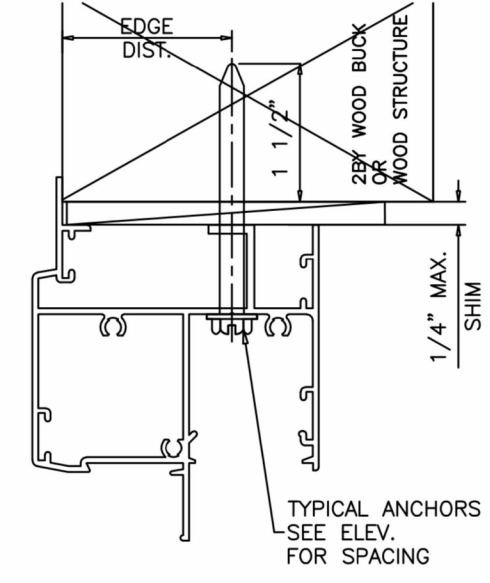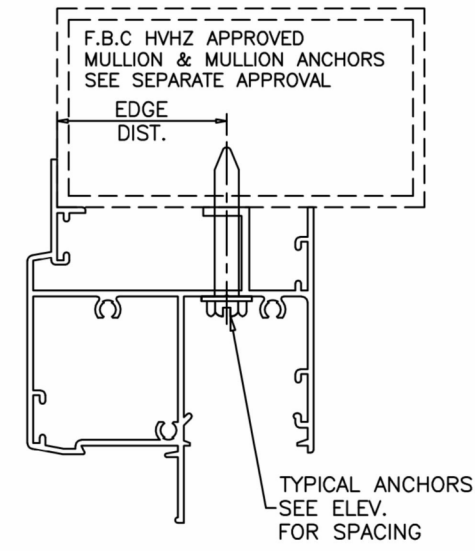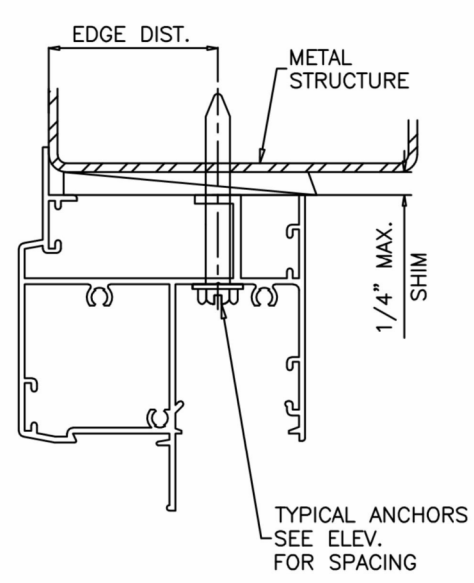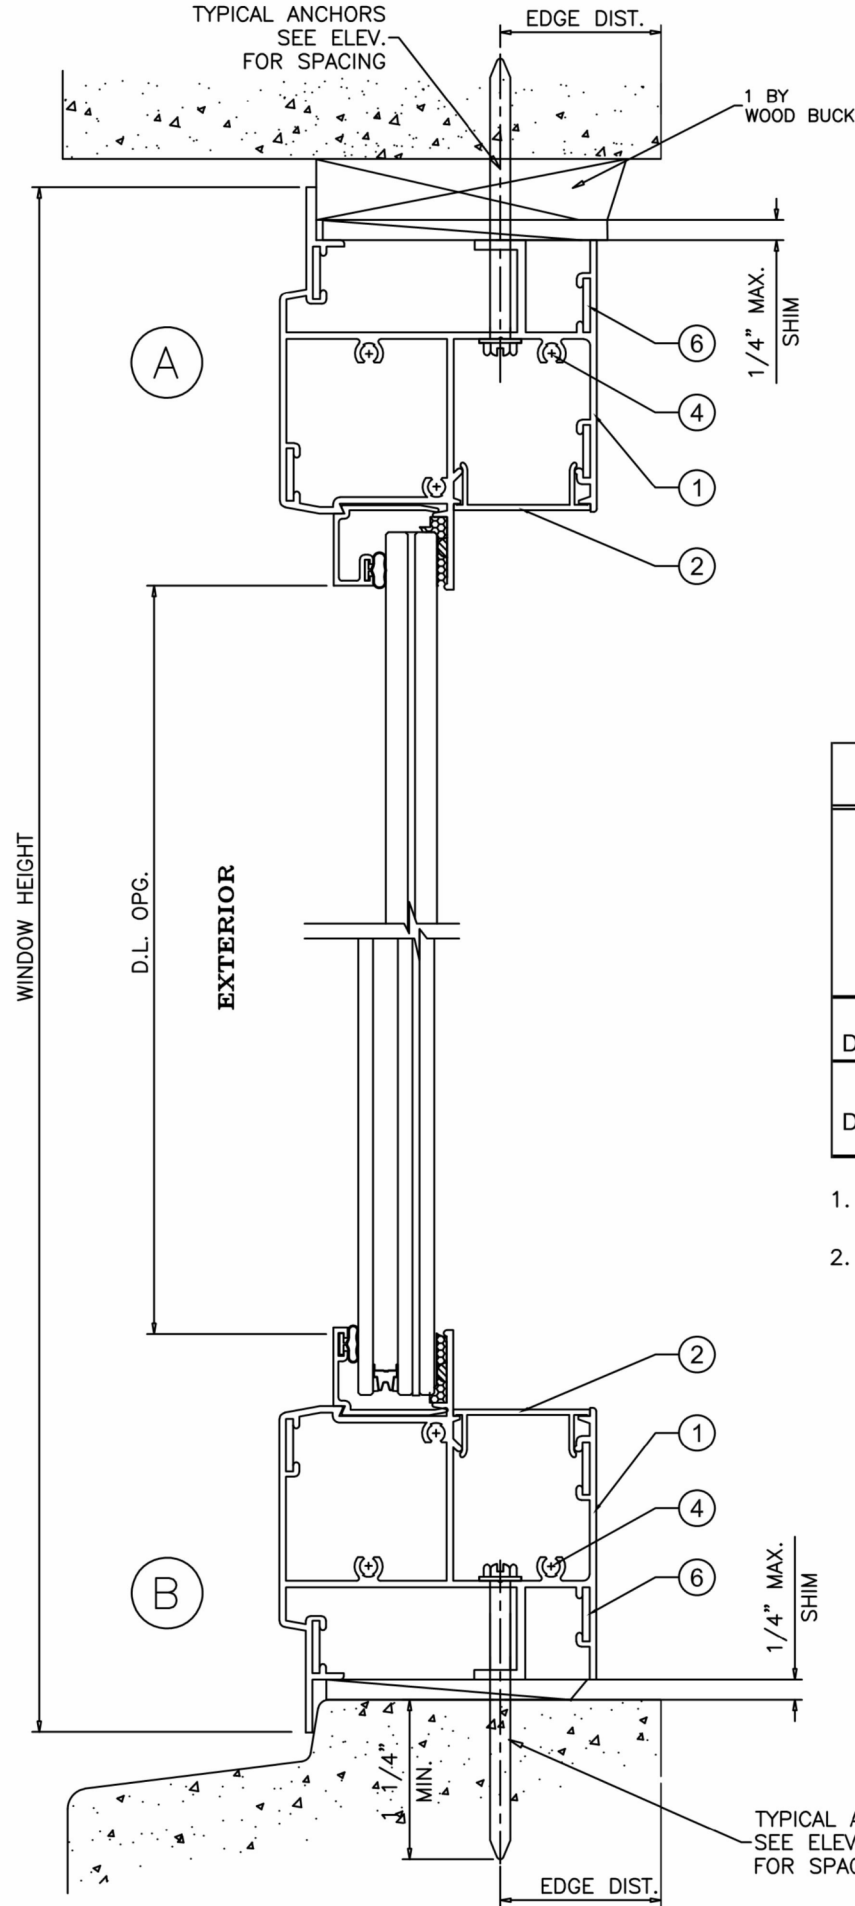

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

Anchor Type	Frame Member	Substrate	Min. Edge Distance	Min. Embedment or Metal Thickness
1/4" DeWalt UltraCon +	All	Southern Pine (SG = 0.55)	1"	1-1/2"
	All	Thru 1BY Buck into Concrete (min. 3 ksi)	2-1/2"	1-1/4"
	Jambs	Thru 1BY Buck into Hollow or Filled Block (ASTM C90, min. 2 ksi)	2-1/2"	1-1/4"
	All	Concrete (min. 3ksi)	2-1/2"	1-1/4"
	Jambs	Hollow or Filled Block (ASTM C90, min. 2 ksi)	2-1/2"	1-1/4"
#14 SMS or Self Drilling Screws (Gr. 2)	All	Aluminum 1/8" Thk. Min. (6063-T5)	3/4"	(3) Threads min. beyond metal thickness
	All	Steel 1/8" Thk. Min. (min. 36 ksi)	3/4"	(3) Threads min. beyond metal thickness
#12 SMS or Self Drilling Screws (Gr. 2)	All	F.B.C Approved Mullions	3/4"	(3) Threads min. beyond metal thickness
	All	Aluminum 1/8" Thk. Min. (6063-T5)	3/4"	(3) Threads min. beyond metal thickness
	All	Steel 1/8" Thk. Min. (min. 36 ksi)	3/4"	(3) Threads min. beyond metal thickness

1. STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED
2. ALL ANCHOR HEAD TYPES ARE ACCEPTABLE

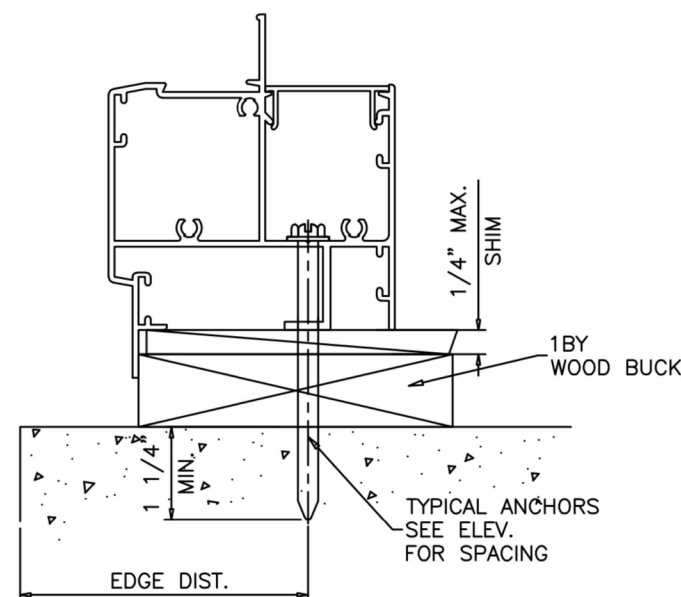

WOOD BUCKS AND METAL STRUCTURE NOT BY 'ECO WDW.' MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

SERIES 550:ALUMINUM FIXED WINDOW (L.M.I.)
LARGE MISSILE IMPACT RATED



ECO WINDOW SYSTEMS, LLC.
8502 N.W. 80th ST., MEDLEY, FL 33166
TEL. (305) 885-5299 FAX. (305) 885-5902



SEALED: 12/30/2024

FL#32389.7

JAVAD AHMAD PE, inc

7875 NW 12th St., Suite 102 Doral,
FL 33126




Ph: (305) 424-8001

support@ja-pe.com

CONSULTING • STRUCTURAL DESIGN • FACADES • BUILDING ENVELOPE • SYSTEM DESIGN • PRODUCT APPROVALS



drawing no.	JA-1844-24	MA	BS
date:	12/30/2024	drawn by:	check by:
REVISION			
No.	DATE	BY	DESCRIPTION

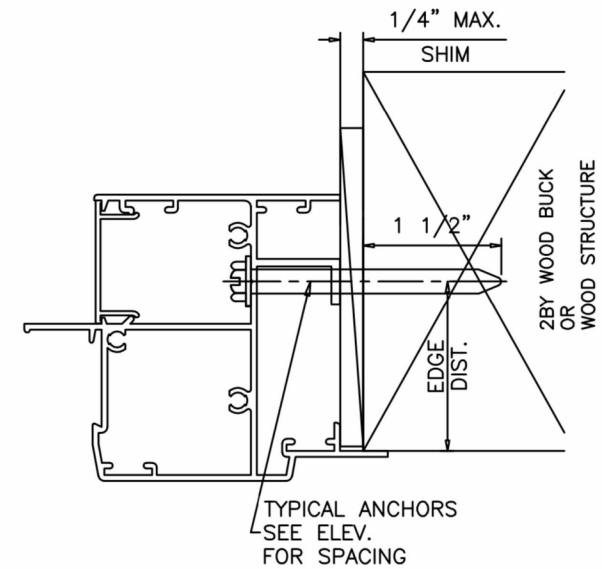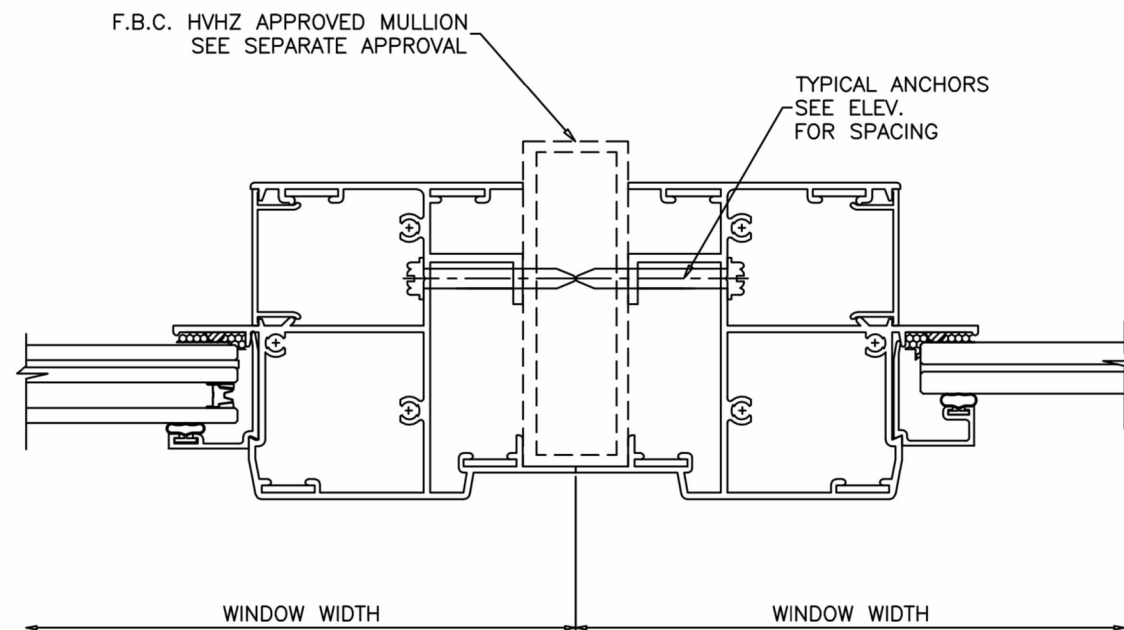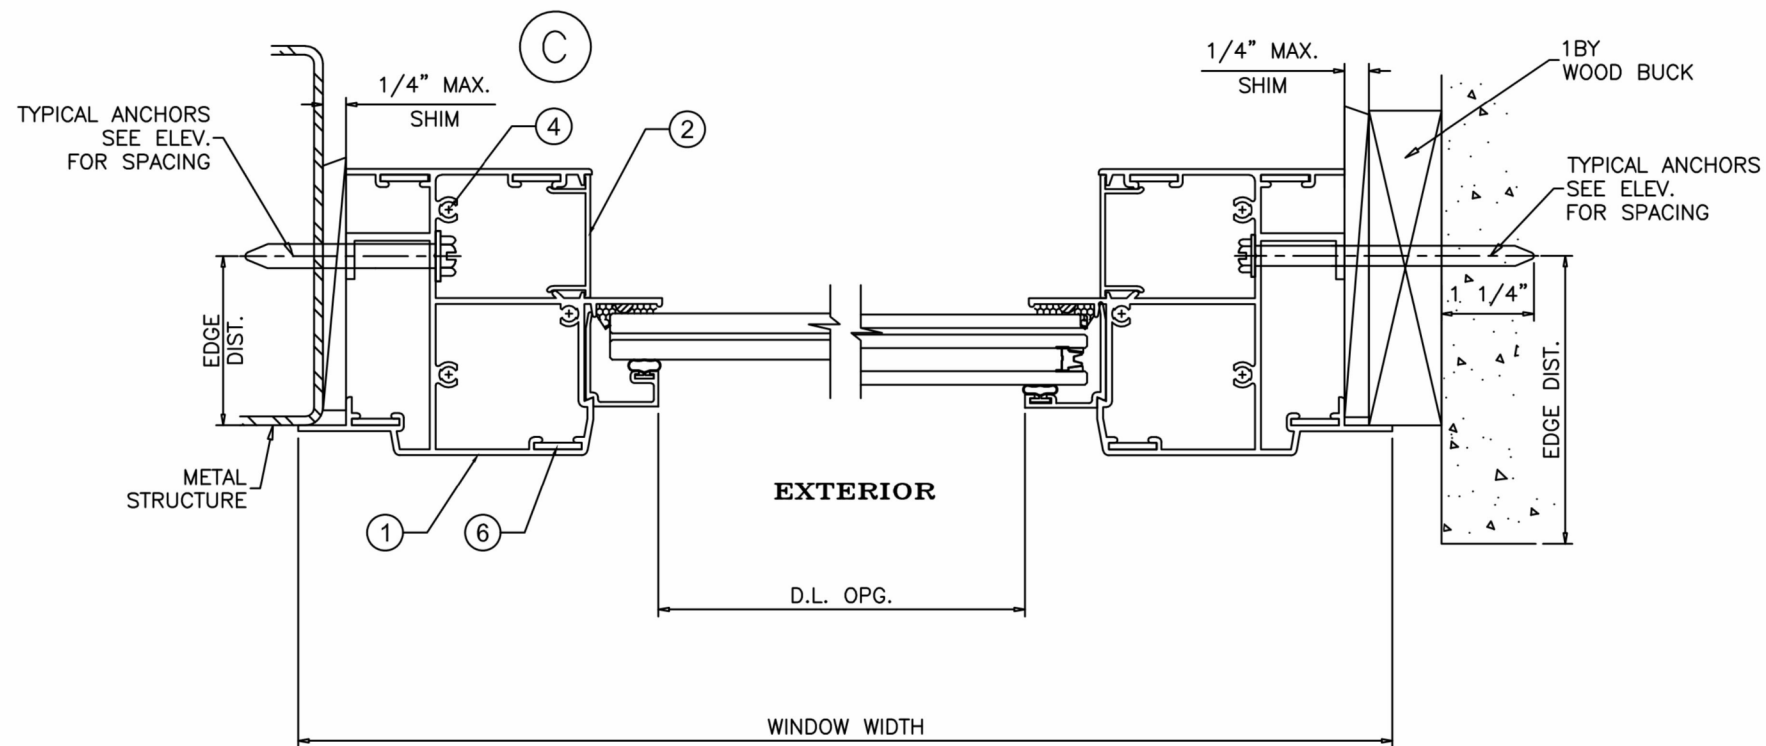

JAVAD AHMAD PE, inc

7875 NW 12th St., Suite 102 Doral,
FL 33126

Ph: (305) 424-8001

support@ja-pe.com

CONSULTING • STRUCTURAL DESIGN • FACADES • BUILDING ENVELOPE • SYSTEM DESIGN • PRODUCT APPROVALS

drawing no.	JA-1844-24	MA
date:	12/30/2024	BS
REVISION		
No.	DATE	DESCRIPTION

SERIES 550:ALUMINUM FIXED WINDOW
(L.M.I.)
LARGE MISSILE IMPACT RATED






ECO WINDOW SYSTEMS, LLC.
8502 N.W. 80th ST. MEDLEY, FL 33166
TEL. (305) 885-5299 FAX. (305) 885-5902



SEALED: 12/30/2024

FL#32389.7

B
ALT.

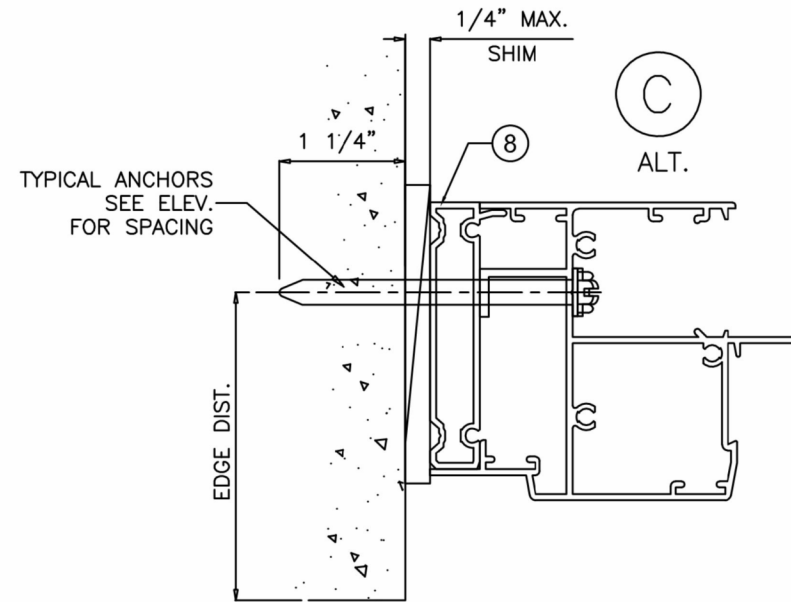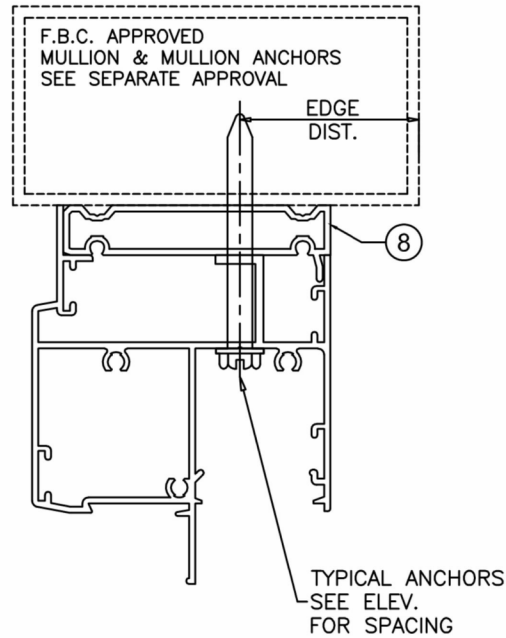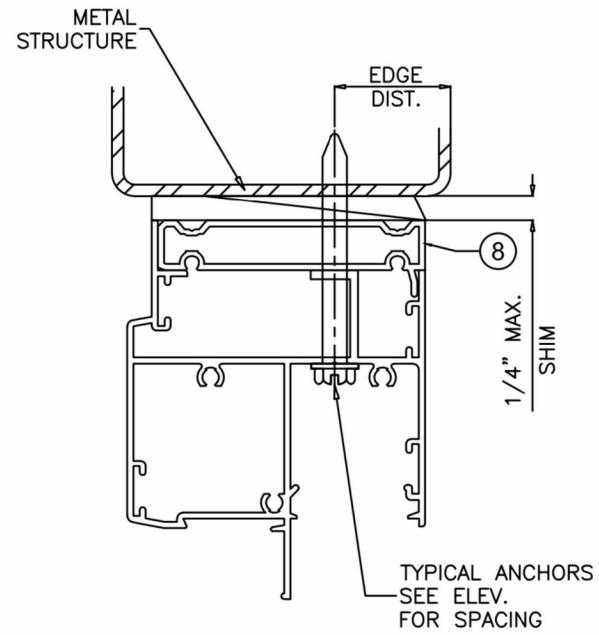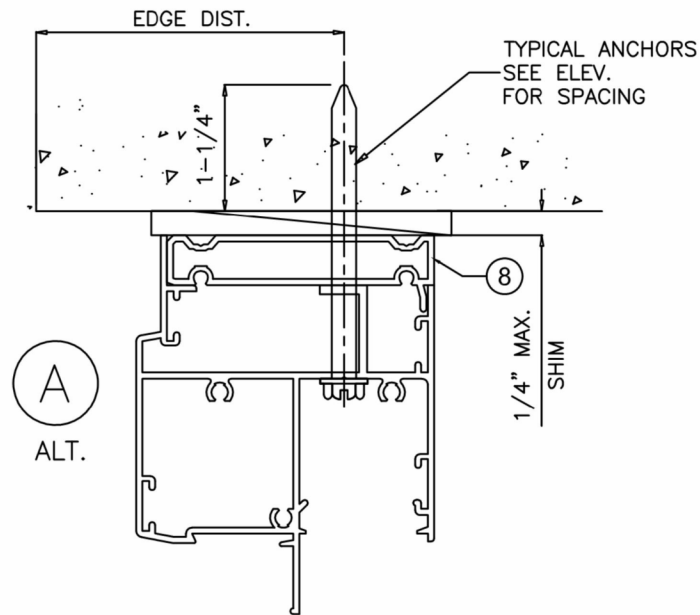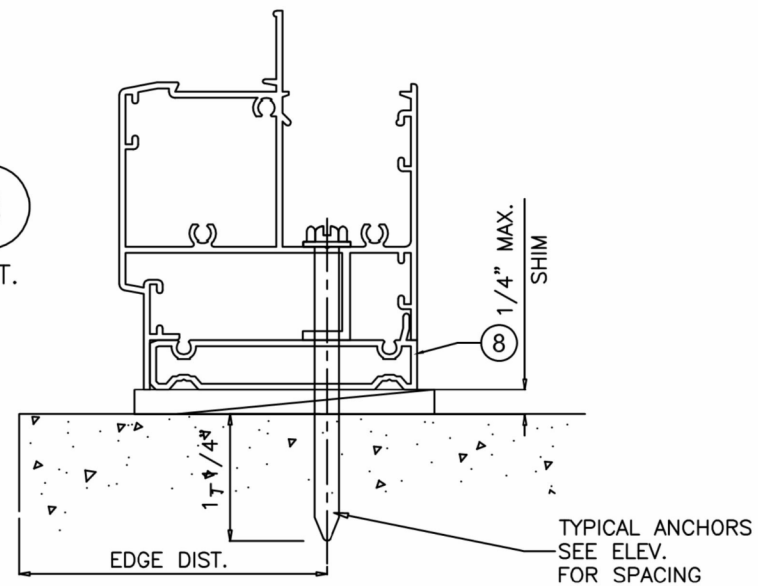

INSTALLATION DETAILS WITH FLUSH FRAME ADAPTER

FL#32389.7



JAVAD AHMAD PE, inc

7875 NW 12th St., Suite 102 Doral,
FL 33126

Ph: (305) 424-8001

support@ja-pe.com


CONSULTING • STRUCTURAL DESIGN • FACADES • BUILDING ENVELOPE • SYSTEM DESIGN • PRODUCT APPROVALS

drawing no.	JA-1844-24	drawn by:	MA
date:	12/30/2024	check by:	BS
REVISION			
No.	DATE	BY	DESCRIPTION

SERIES 550:ALUMINUM FIXED WINDOW
(L.M.I.)
LARGE MISSILE IMPACT RATED




ECO WINDOW SYSTEMS, LLC.
8502 N.W. 80th ST., MEDLEY, FL 33166
TEL. (305) 885-5299 FAX. (305) 885-5902




SEALED: 12/30/2024

05


05 of 06

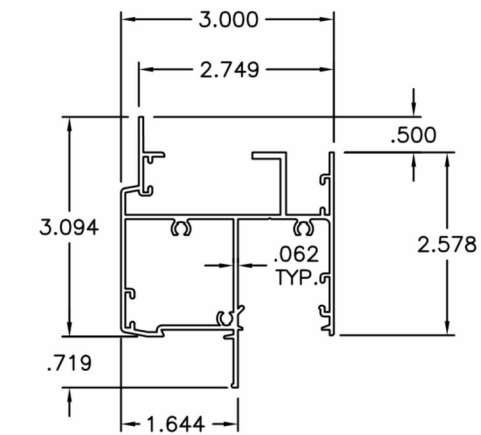


① FRAME HEAD/SILL/JAMB




② SNAP COVER




③ GLAZING BEAD (7/16" LAM GLASS)




③A GLAZING BEAD (INSUL. LAM. GLASS)



③B GLAZING BEAD (5/16" LAM. GLASS)

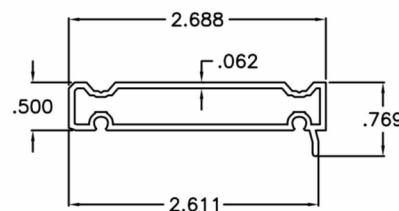

⑧ FLUSH FRAME ADAPTER

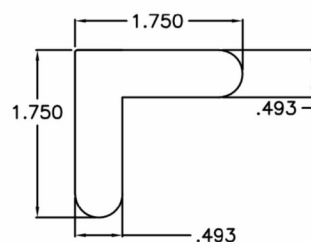


⑥ CORNER KEY

ITEM #	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	E503	4	FRAME HEAD/SILL/JAMB	6063 - T6	-
2	E504	4	SNAP COVER	6063 - T6	-
3	FY109	AS REQD.	GLAZING BEAD (7/16" LAM. GLASS)	6063 - T6	-
3A	E505	AS REQD.	GLAZING BEAD (INSUL. LAM. GLASS)	6063 - T6	-
3B	FY108	AS REQD.	GLAZING BEAD (5/16" LAM. GLASS)	6063 - T6	-
4	#10 X 1-1/4"	3/ CORNER	ASSEMBLY SCREWS	ST. STEEL	-
5	E203	AS REQD.	GLAZING BEAD BULB. DUROMETER 65	SANTOPRENE	ULTRAFAB
6	PSJ40-SS	2/ CORNER	FRAME CORNER KEY	ST. STEEL	-
7	FLB-50	-	GLASS SPACER - 1/8" HIGH	SILICONE	FRANK LOWE
8	FY120	AS REQD.	FLUSH FRAME ADAPTER	6063-T6	OPTIONAL
9	-	AS REQD.	SETTING BLOCK, 3/16" X 3/4" X 4" LONG	EPDM	DUROMETER 80±5 SHORE A
10	-	-	INSUL. GLASS SPACER	VARIOUS	VARIOUS

SEALANT:

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH SCHNEE-MOREHEAD SM5504 SEAM SEALER

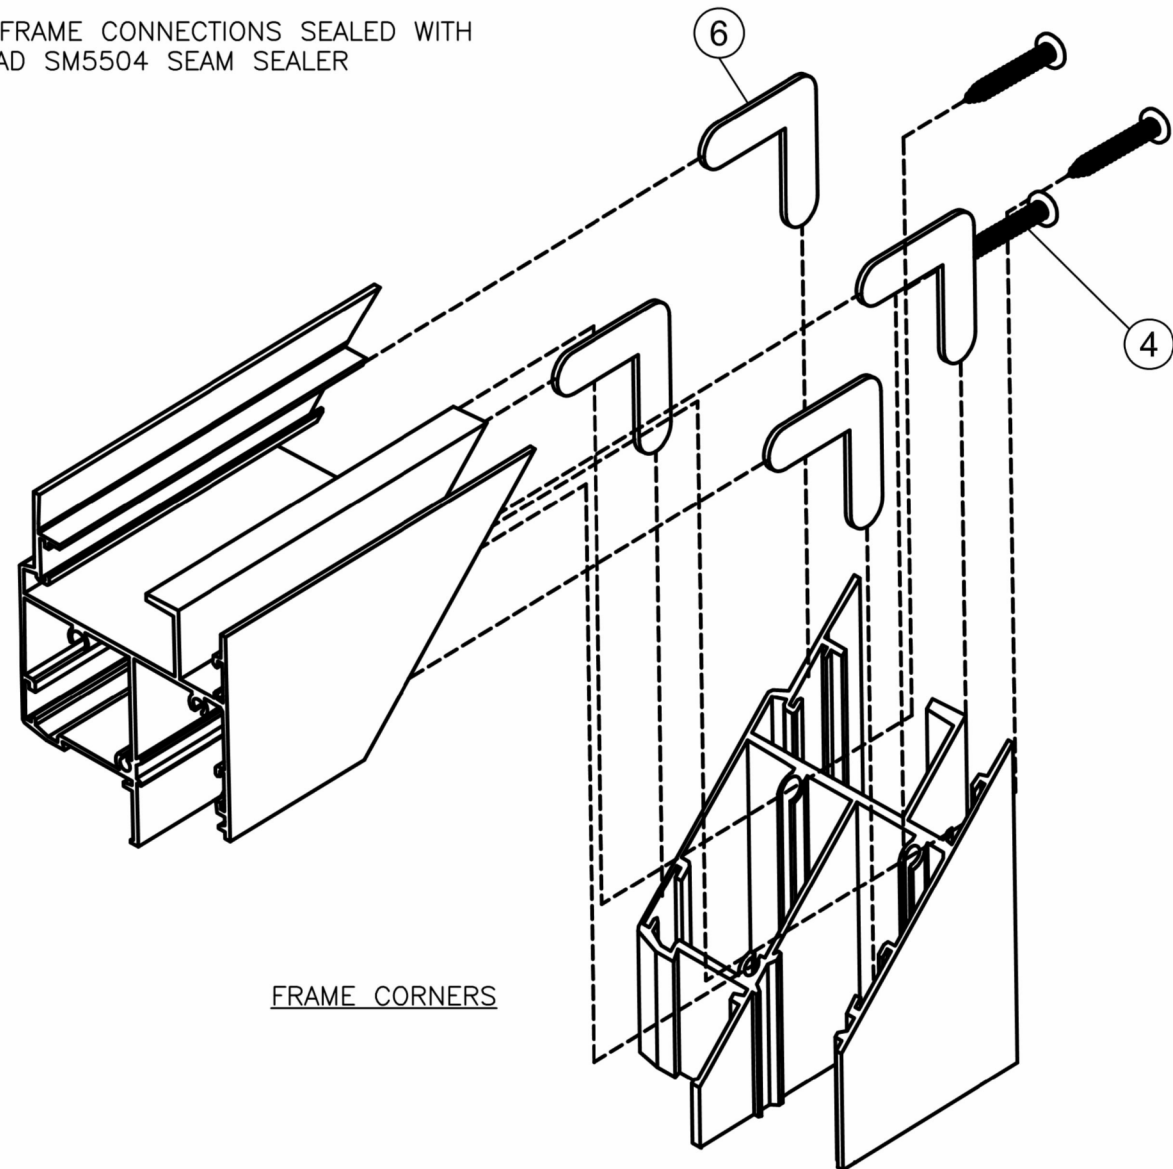

FRAME CORNERS

FL#32389.7



JAVAD AHMAD PE, inc

7875 NW 12th St., Suite 102 Doral,
FL 33126

Ph: (305) 424-8001

support@ja-pe.com


CONSULTING • STRUCTURAL DESIGN • FACADES • BUILDING ENVELOPE • SYSTEM DESIGN • PRODUCT APPROVALS

drawing no.	MA	drawn by:	BS
date:		12/30/2024	
REVISION		DATE	DESCRIPTION
No.	BY		

SERIES 550:ALUMINUM FIXED WINDOW
(L.M.I.)
LARGE MISSILE IMPACT RATED



ECO WINDOW SYSTEMS, LLC.
8502 N.W. 80th ST. MEDLEY, FL 33166
TEL. (305) 885-5299 FAX. (305) 885-5902



SEALED: 12/30/2024