


ARMRLITE
DOOR MANUFACTURING CO., INC.
CUSTOM MAX ALUMINUM AND GLASS OVERHEAD
SECTIONAL DOOR
(NON-HVHZ) (NON-IMPACT)

GENERAL NOTES:


- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - ASTM E330-14(21)
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** TO PROTECT THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- DOOR RAILS & STILES MATERIAL: ALUMINUM 6063-T5
- DOOR PANEL MATERIAL: ALUMINUM 5005-H14
- DOOR CONSTRUCTIONS: ALL ALUMINUM MEMBERS HELI-ARC WELDED IN CONCEALED LOCATIONS
- GLASS SHALL MEET THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAIL.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES & GLAZING DETAIL
2	ELEVATION AND OPENING DETAILS
3	ANCHOR LAYOUT AND TRACK DETAILS
4	VERTICAL SECTIONS
5	HORIZONTAL SECTIONS
6	INSTALLATION NOTES AND ANCHOR DETAIL

DESIGN PRESSURE RATING	
DESIGN PRESSURE	MISSILE IMPACT RATING
+23.3 / -23.3 PSF	NON-IMPACT RATED

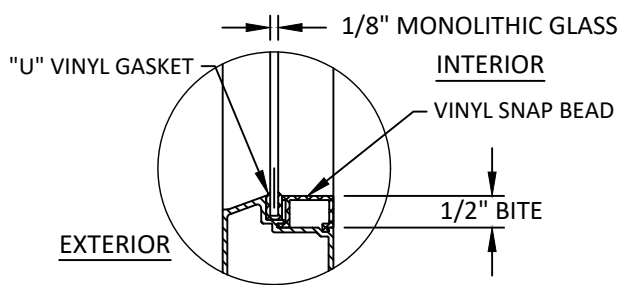

GLAZING DETAIL 1

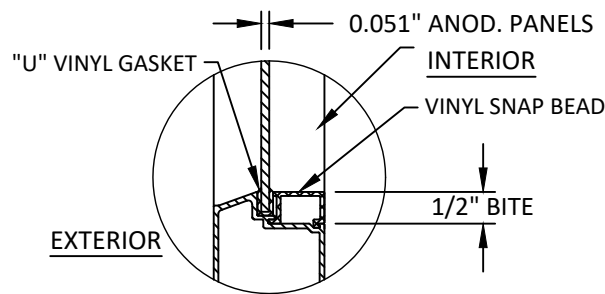

GLAZING DETAIL 2

GLAZING NOTES:

- GLASS TYPE SHALL COMPLY WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. THICKNESS, TEMPER, AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.



ARMRLITE
40 COLONIAL DR.
PISCATAWAY, NJ 08854
PH: (908) 754-2600 FAX: (908) 754-6522


TITLE: CUSTOM MAX ALUMINUM AND GLASS OVERHEAD SECTIONAL DOOR (NON-HVHZ) (NON-IMPACT) GENERAL NOTES AND GLAZING DETAIL

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI CT., STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2023 CODE CHANGE	MG	06/23
2026 CODE CHANGE	HJ	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.10.11 16:52:57 -0400

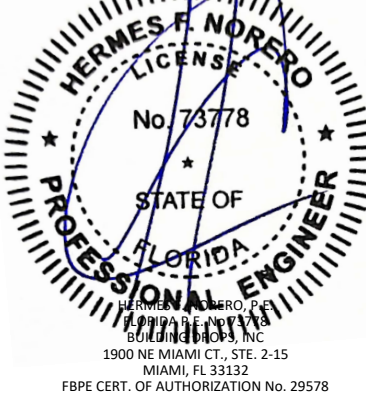

FL #: **FL32416**

DATE: **05.29.20**

DWG. BY: **LL** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **ARL001**

SHEET: **1** REV. **B**


OF 6

c:\Users\harley\OneDrive\building drops, inc\building drops landing - common\projects\2026 code change projects\armrlite door manufacturing co., inc\cc-26-0648 - 2026 code change\dwgs\ar001-b.dwg 9/24/2026 5:02 PM

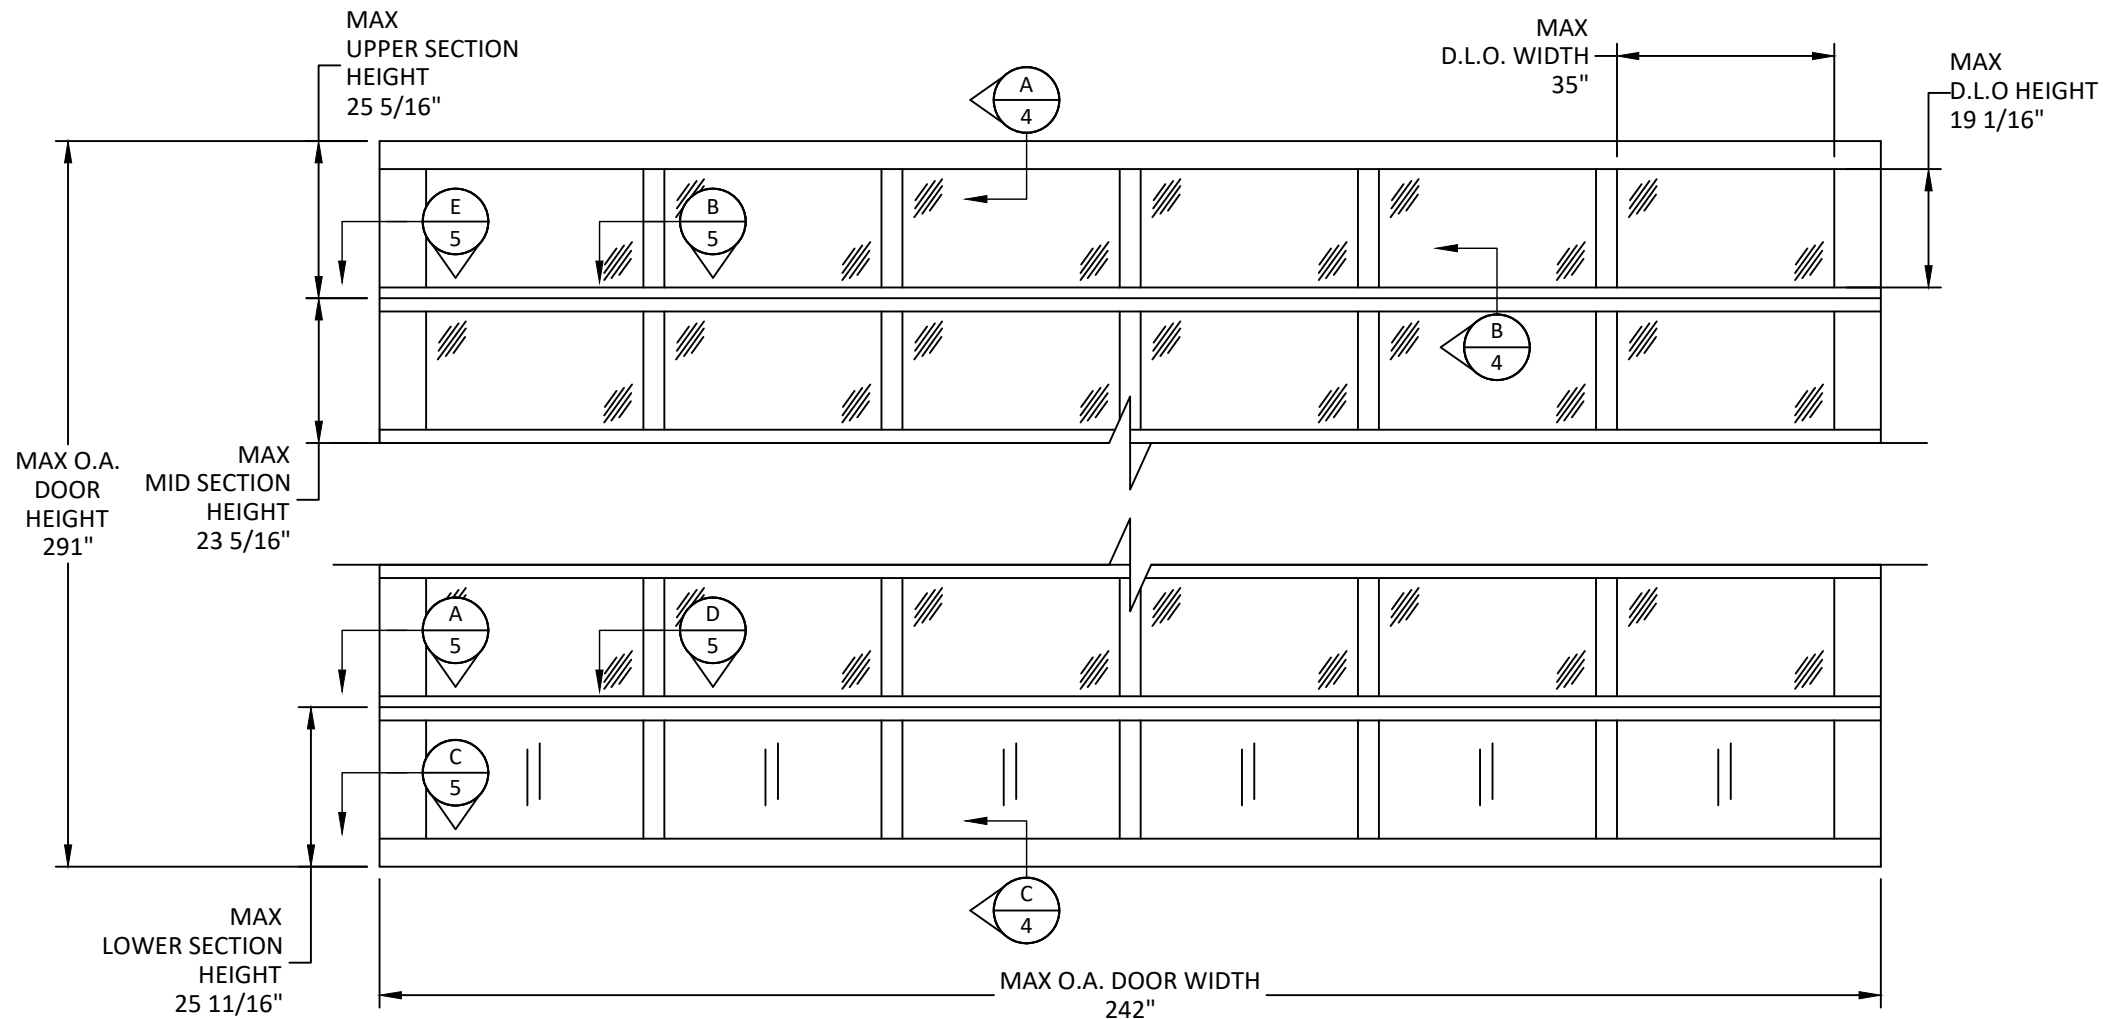

EXTERIOR DOOR ELEVATION

NOTE: ELEVATION SHOW 0.051" 5005-H14 BOTTOM PANELS, GLAZED BOTTOM PANELS ARE A QUALIFIED OPTION

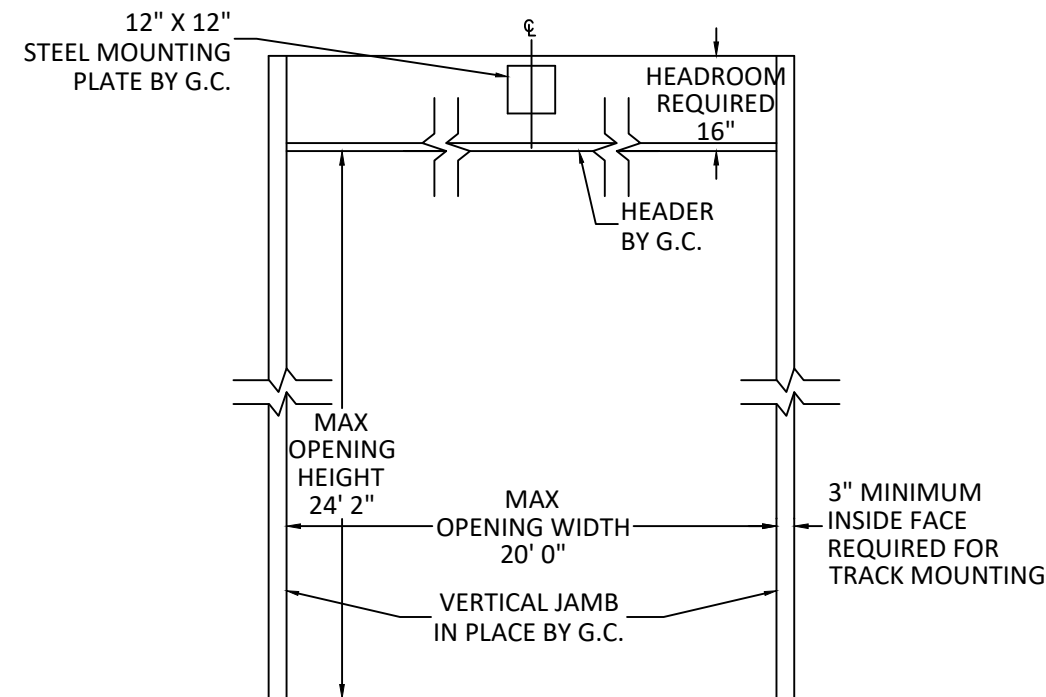

TYPICAL OPENING DETAILS



ARMRLITE
40 COLONIAL DR.
PISCATAWAY, NJ 08854
PH: (908) 754-2600 FAX: (908) 754-6522

TITLE: CUSTOM MAX ALUMINUM AND GLASS OVERHEAD SECTIONAL DOOR (NON-HVHZ) (NON-IMPACT)

ELEVATION & OPENING DETAILS


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI CT., STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2023 CODE CHANGE	MG	06/23
2026 CODE CHANGE	HJ	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT

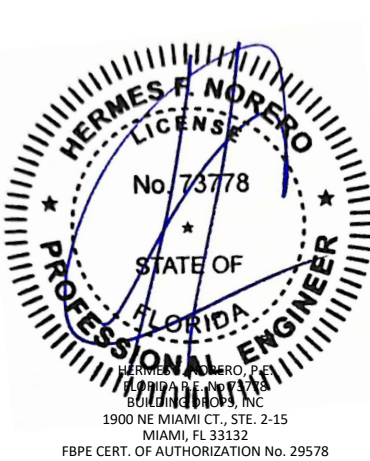


FL #:	FL32416
DATE:	05.29.20
DWG. BY:	LL
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	ARL001
SHEET:	2
REV.	B

c:\Users\harley\OneDrive\building drops, inc\building drops landing - common\projects\armrlite door manufacturing co., inc\cc-26-0648 - 2026 code change\dwgs\ar001-b.dwg 9/24/2026 5:02 PM

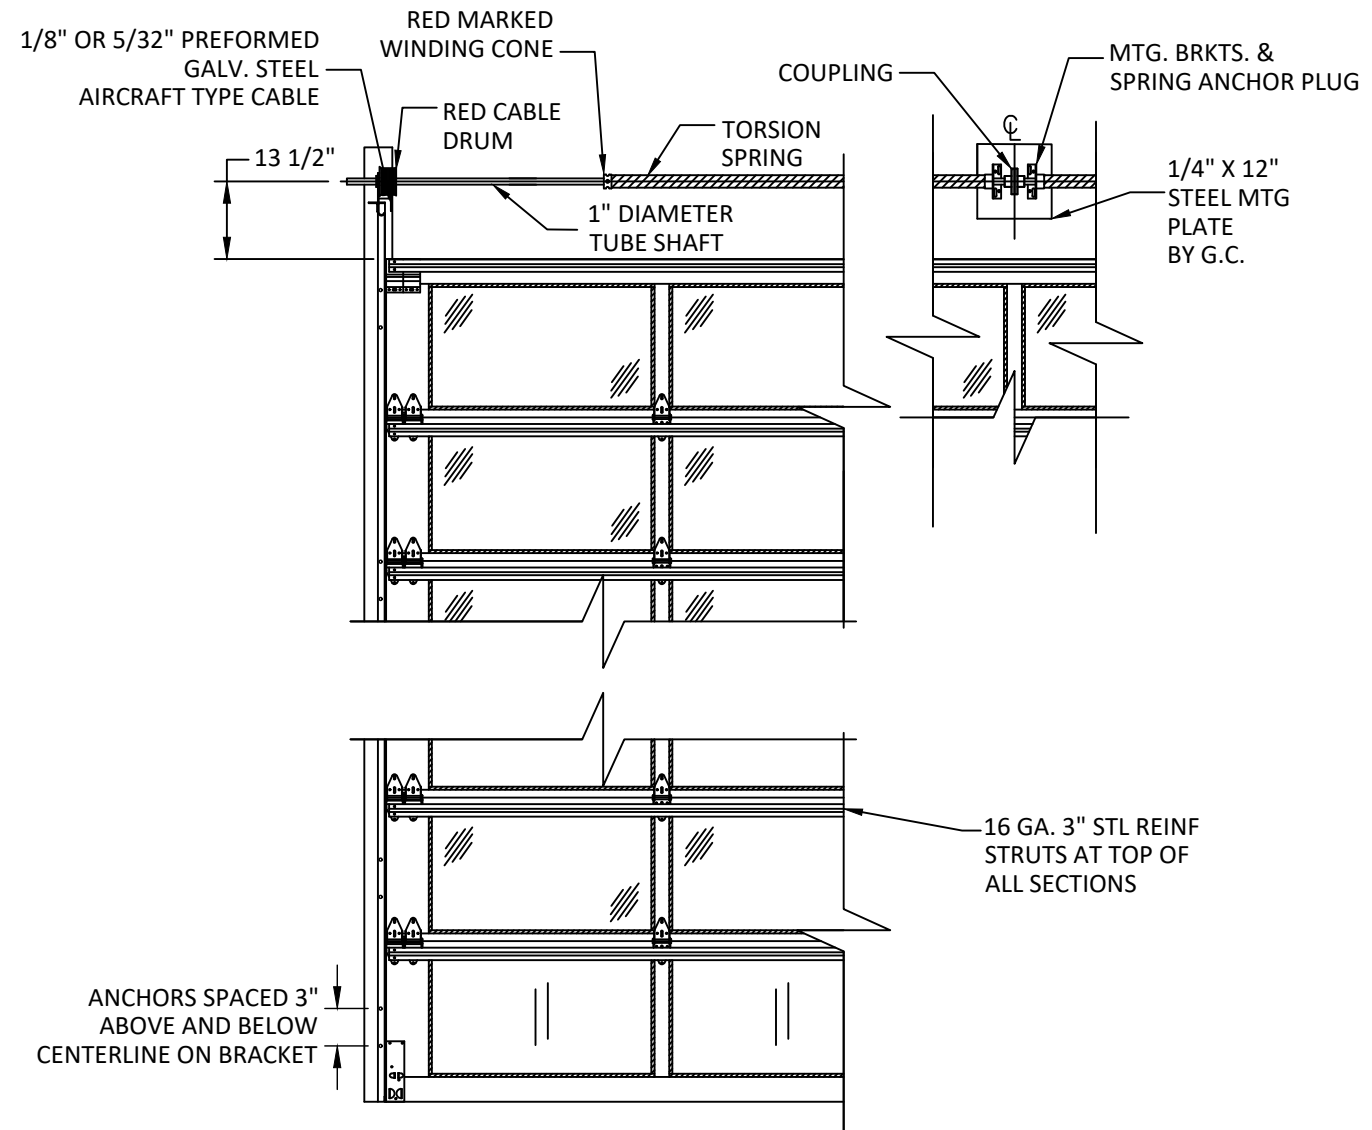

ANCHOR LAYOUT
HARDWARE DETAILS

NOTE: DESIGN AND OPERATION OF OPERATOR MECHANISM AND BALANCE SYSTEM IS NOT PART OF THIS APPROVAL, MANUFACTURER SPECIFICATIONS SHOULD BE FOLLOWED. TYPICAL DETAILS SHOWN ABOVE. CARE SHOULD BE TAKEN WHEN DOOR IS IN MOTION ENSURING THAT PERSONAL INJURY OR DAMAGE TO THIS PRODUCT DOES NOT OCCUR.

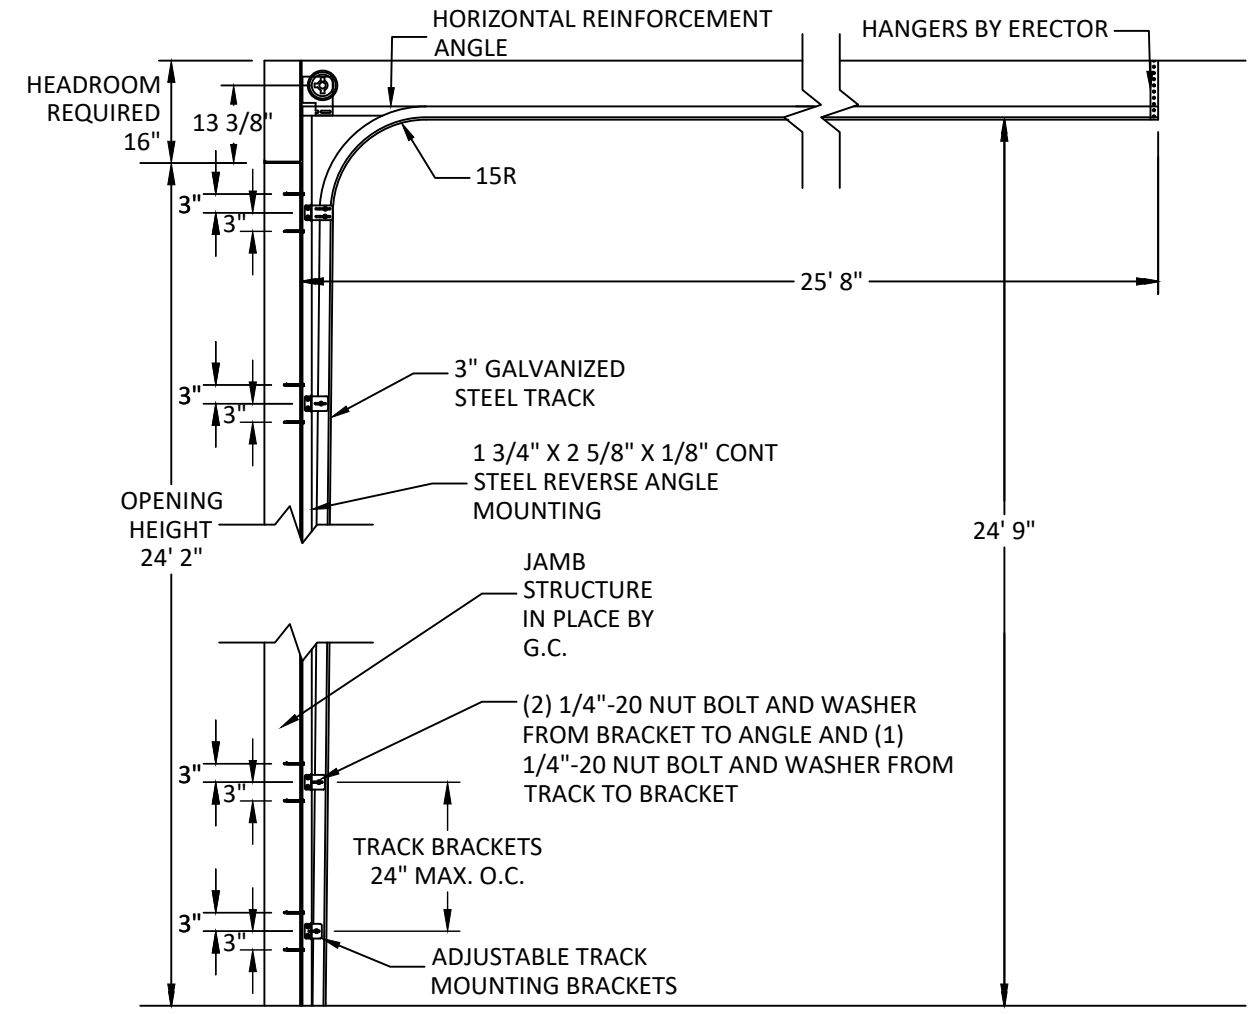

ANCHOR LAYOUT
TRACK DETAILS

ArmRLite
OVERHEAD DOORS

ARMRLITE
40 COLONIAL DR.
PISCATAWAY, NJ 08854
PH: (908) 754-2600 FAX: (908) 754-6522

TITLE: CUSTOM MAX ALUMINUM AND GLASS OVERHEAD SECTIONAL DOOR (NON-HVHZ) (NON-IMPACT) ANCHOR LAYOUT AND TRACK DETAILS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI CT., STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2023 CODE CHANGE	MG	06/23
2026 CODE CHANGE	HJ	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO
LICENSE
No. 73778
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
HERMES F. NORERO, P.E.
FLORIDA REG. NO. 73778
BUILDING DROPS, INC.
1900 NE MIAMI CT., STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL32416**

DATE: **05.29.20**

DWG. BY: LL	CHK. BY: HFN
-----------------------	------------------------


SCALE: **NTS**

DWG. #: **ARL001**


SHEET: 3	REV. B
--------------------	------------------

OF 6


c:\users\hanley\appdata\local\temp\project\2026 code change projects\armrlite door manufacturing co., inc\cc-26-0648 - 2026 code change\dwgs\ar001-b.dwg 9/24/2026 5:02 PM

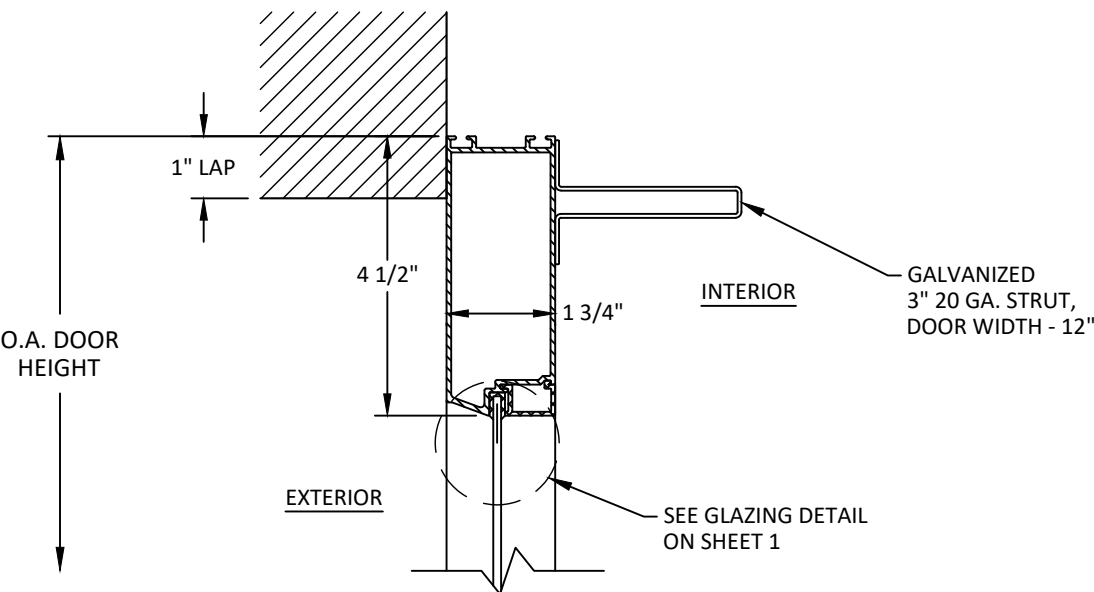

A
4 **VERTICAL SECTION**
UPPER SECTION DETAIL

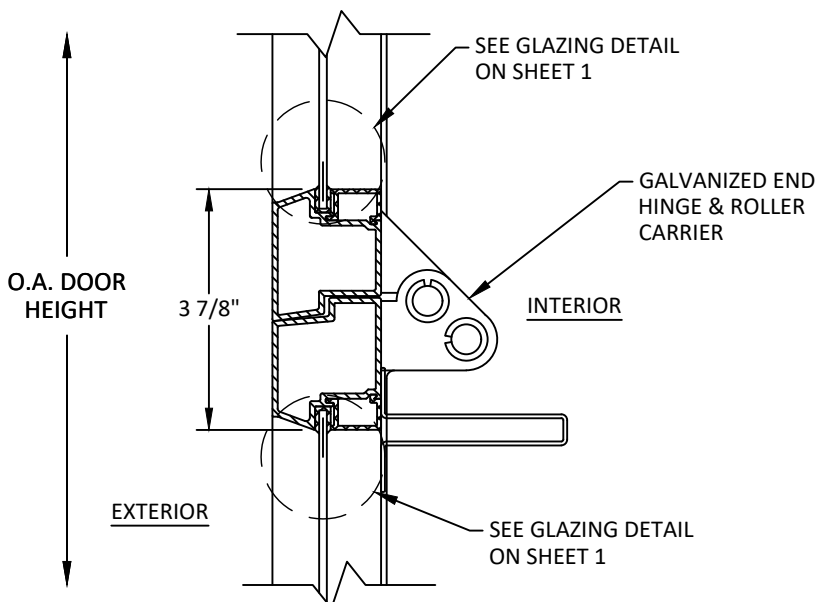

B
4 **VERTICAL SECTION**
MID SECTION DETAIL

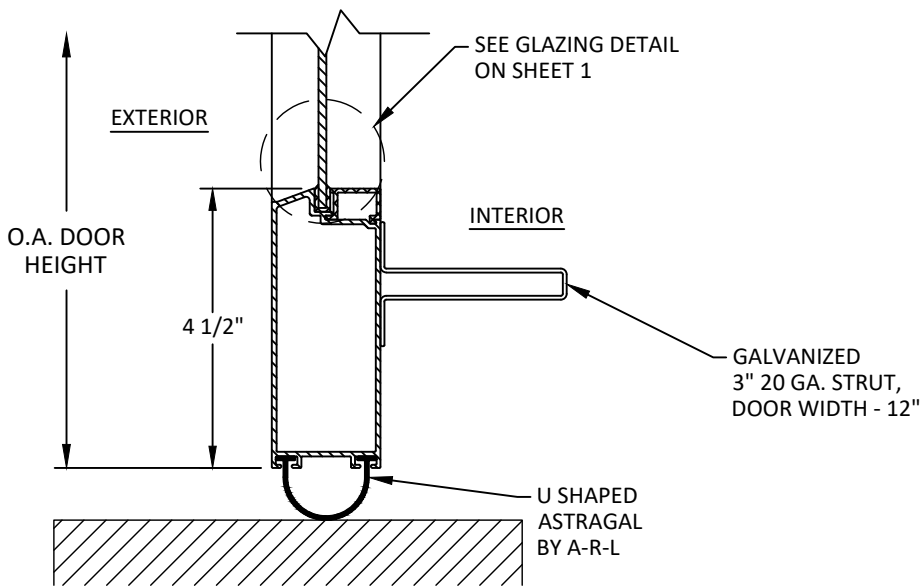

C
4 **VERTICAL SECTION**
LOWER SECTION DETAIL



ARMRLITE
40 COLONIAL DR.
PISCATAWAY, NJ 08854
PH: (908) 754-2600 FAX: (908) 754-6522

TITLE: CUSTOM MAX ALUMINUM AND GLASS
OVERHEAD SECTIONAL DOOR
(NON-HVHZ) (NON-IMPACT)

VERTICAL SECTIONS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI CT., STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2023 CODE CHANGE	MG	06/23
2026 CODE CHANGE	HJ	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

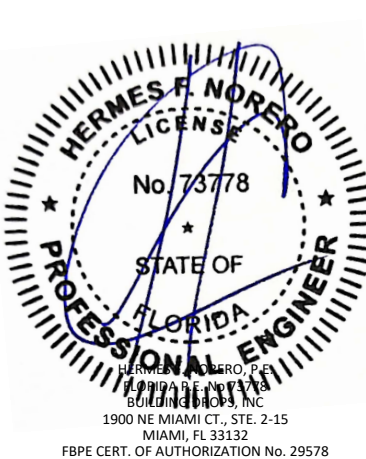


FL #:	FL32416
DATE:	05.29.20
DWG. BY:	LL
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	ARL001
SHEET:	4
REV.	B


c:\users\hmfley\appdata\local\temp\building drops, inc\building drops landing - common\projects\2026 code change projects\armrlite door manufacturing co., inc\cc-26-0648 - 2026 code change\dwg\ar001-b.dwg 9/24/2026 5:02 PM

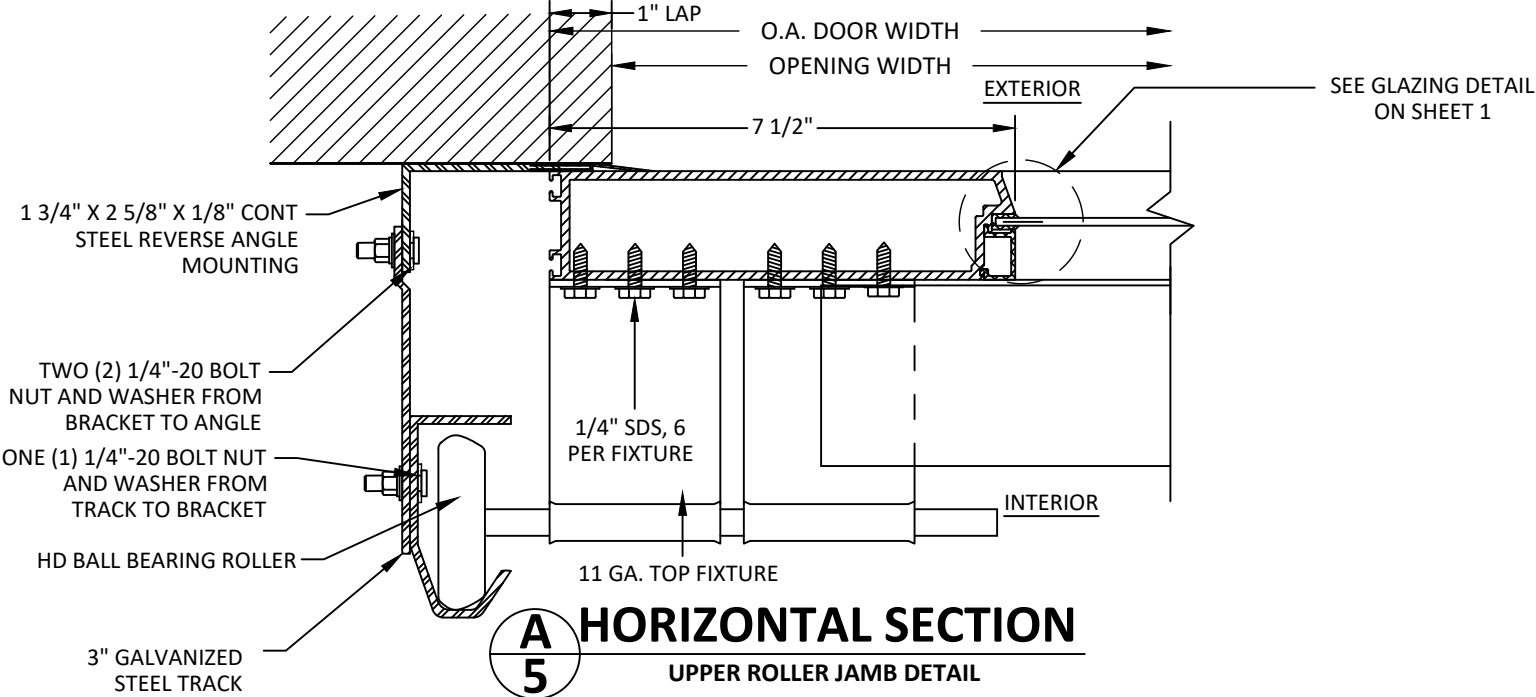


A HORIZONTAL SECTION
5 UPPER ROLLER JAMB DETAIL

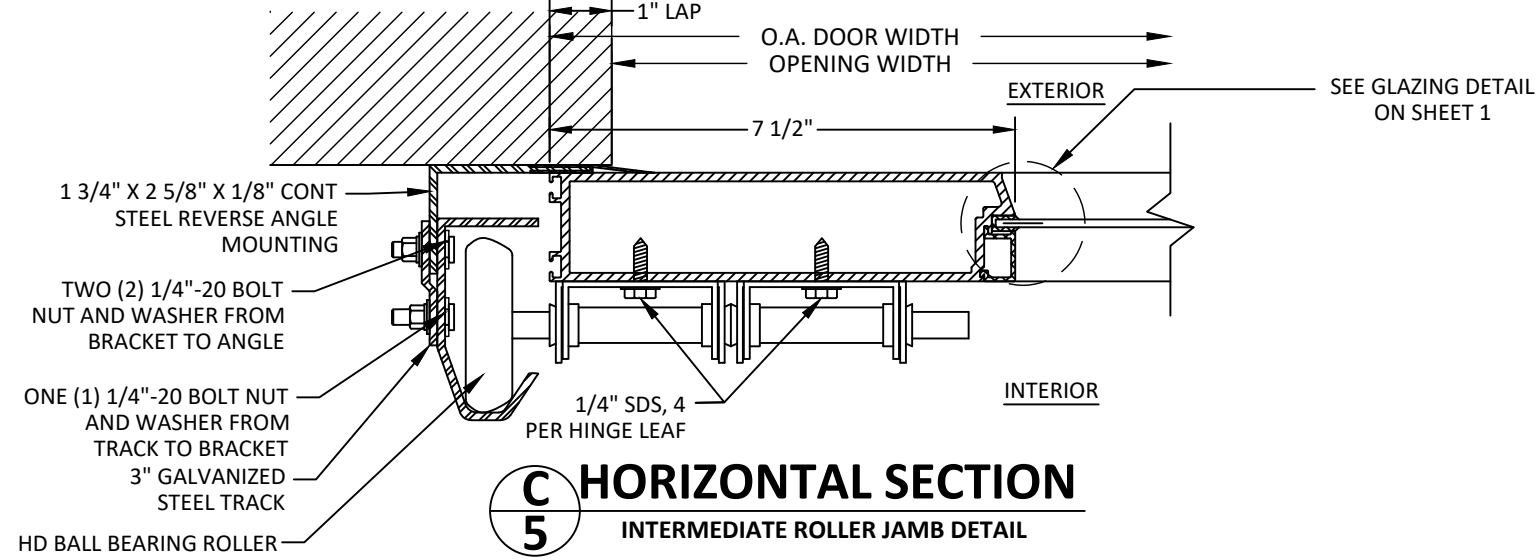


C HORIZONTAL SECTION
5 INTERMEDIATE ROLLER JAMB DETAIL

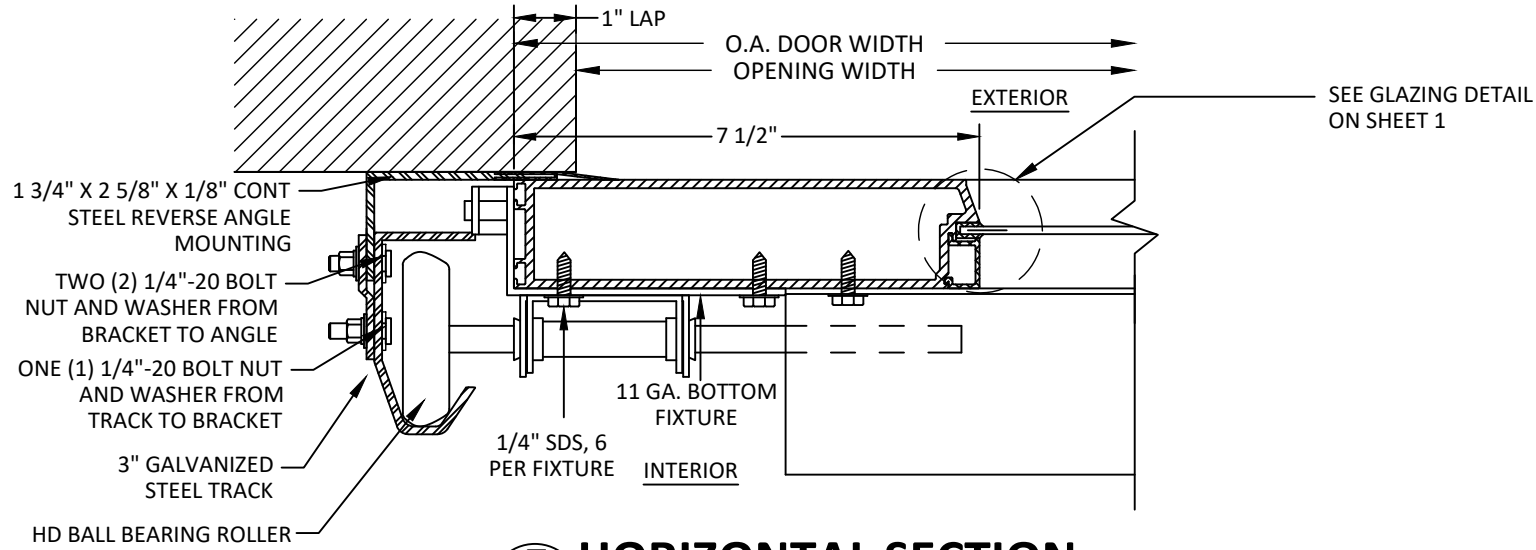

E HORIZONTAL SECTION
5 LOWER ROLLER JAMB DETAIL

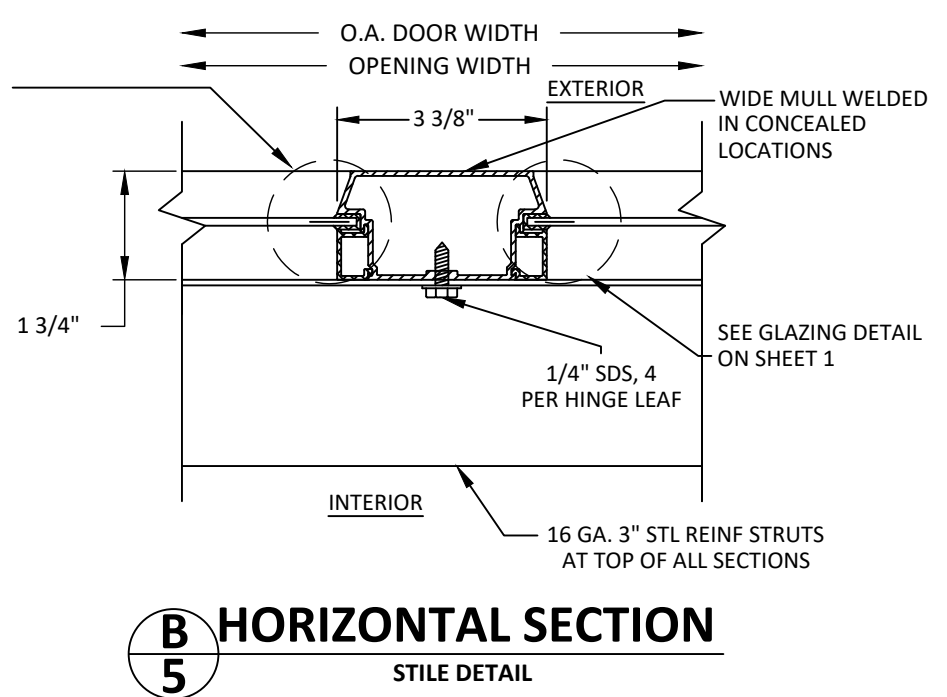

B HORIZONTAL SECTION
5 STILE DETAIL

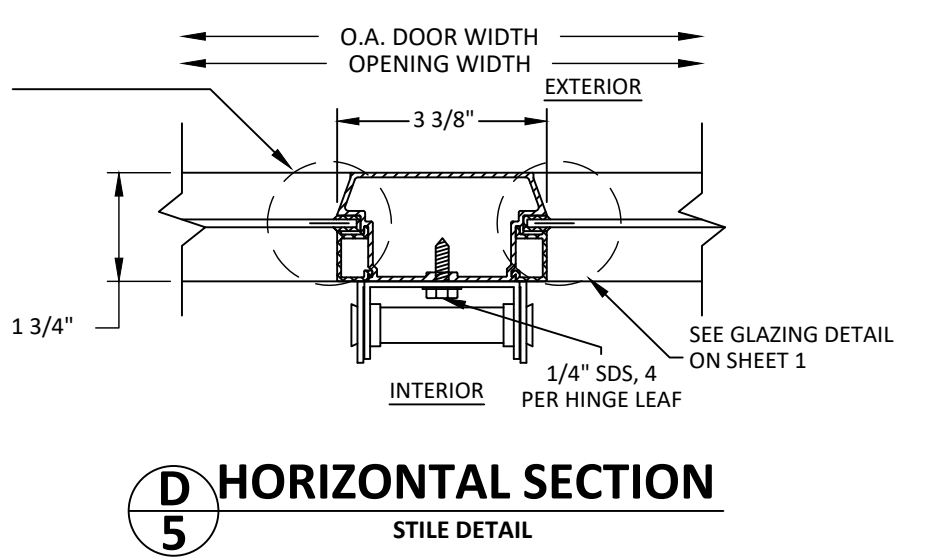

D HORIZONTAL SECTION
5 STILE DETAIL



ArmRLite
OVERHEAD DOORS

ARMRLITE
40 COLONIAL DR.
PISCATAWAY, NJ 08854
PH: (908) 754-2600 FAX: (908) 754-6522

TITLE: CUSTOM MAX ALUMINUM AND GLASS
OVERHEAD SECTIONAL DOOR
(NON-HVHZ) (NON-IMPACT)


HORIZONTAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI CT., STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2023 CODE CHANGE	MG	06/23
2026 CODE CHANGE	HJ	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

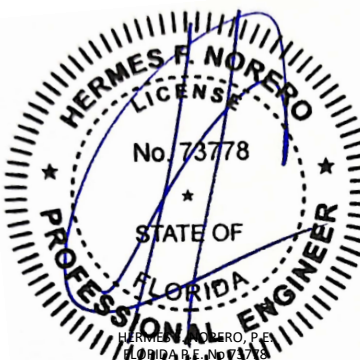

HERMES F. NORERO, P.E.
FLORIDA PROFESSIONAL ENGINEER
LICENSE No. 73778
STATE OF FLORIDA
BUILDING DROPS, INC.
1900 NE MIAMI CT., STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL32416**

DATE: **05.29.20**

DWG. BY: LL	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**





DWG. #: **ARL001**

SHEET: 5	REV. B
--------------------	------------------

OF 6

9/24/2026 5:02 PM

c:\users\hmfey\my\building drops, inc\building drops landing - common\projects\armrlite door manufacturing co, inc\cc-26-0648 - 2026 code change\dwgs\an001-b.dwg

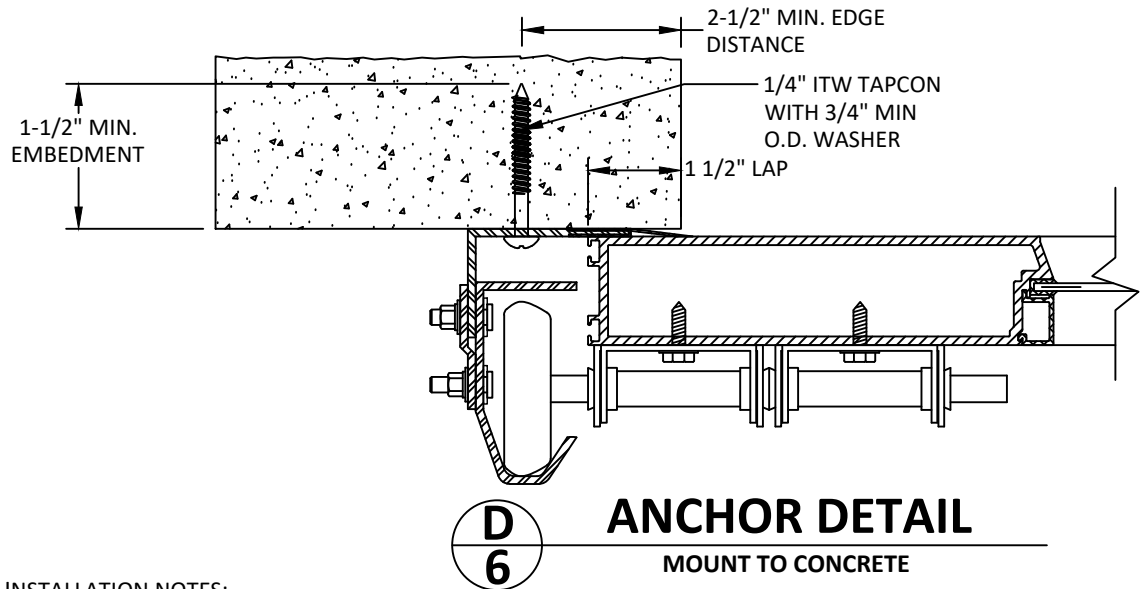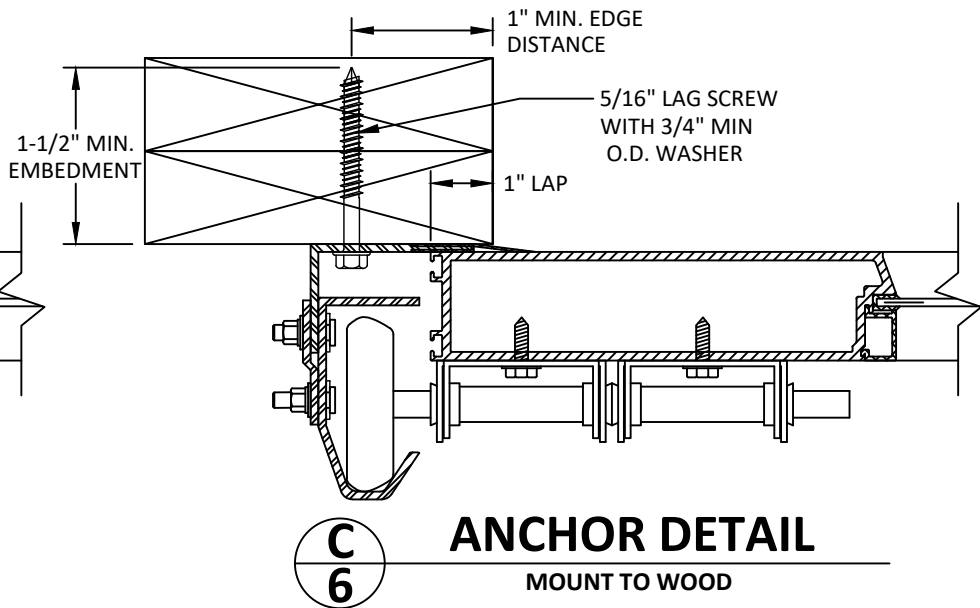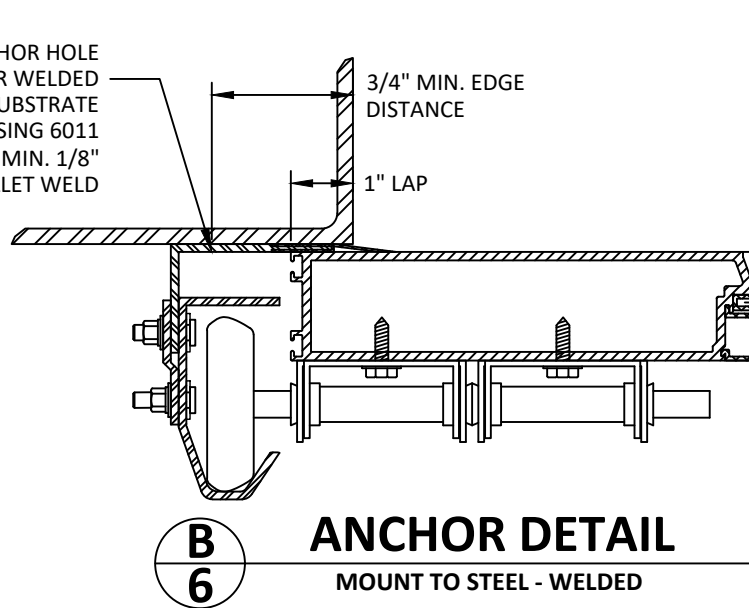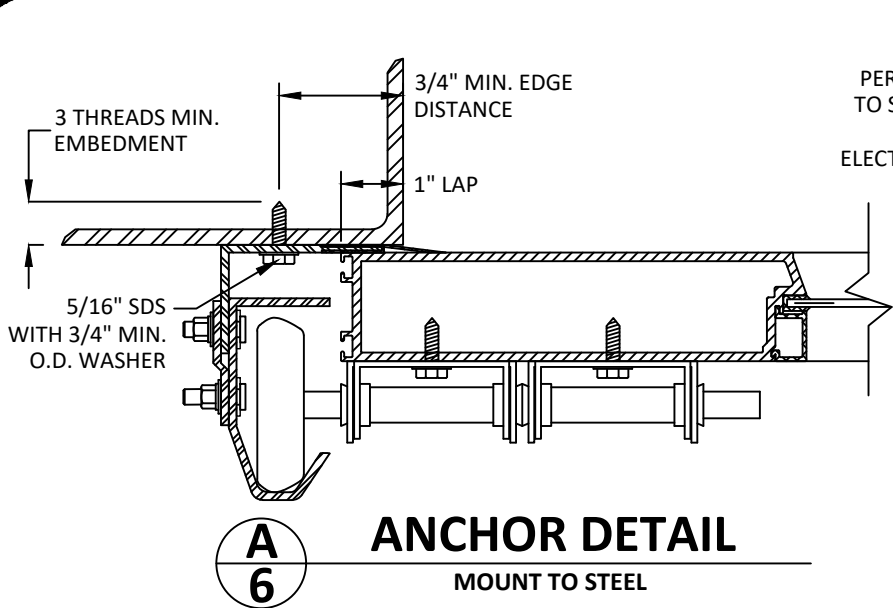

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN, UNLESS OTHERWISE STATED.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
 - FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).
 - CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE			
SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
WOOD: MIN. S.G. = 0.55	5/16" LAG SCREW	1.50"	1.00"
STEEL: MIN. 1/4" THICK. MIN. Fy = 33 ksi	5/16" SELF-DRILLING SCREW	3 THREADS MIN. PENETRATION BEYOND METAL	0.75"
	WELD 1/8" FILLET WELD W/ 6011 ELECTRODE AT ANCHOR HOLE PERIMETER	-	0.75"
CONCRETE: MIN. f'c = 3000 psi	1/4" ITW TAPCON	1.50"	2.50"

- ALL ANCHOR TYPES LISTED ABOVE VALID FOR MIN. SPECIFIED SUBSTRATE OR GREATER
- ANCHOR OPTION MUST MEET MINIMUM EMBEDMENT, EDGE DISTANCE SPECIFIED



ARMRLITE

40 COLONIAL DR.
PISCATAWAY, NJ 08854

PH: (908) 754-2600 FAX: (908) 754-6522


TITLE: CUSTOM MAX ALUMINUM AND GLASS
OVERHEAD SECTIONAL DOOR
(NON-HVHZ) (NON-IMPACT)
INSTALLATION NOTES AND
ANCHOR DETAILS AND SCHEDULE

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI CT., STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2023 CODE CHANGE	MG	06/23
2026 CODE CHANGE	HJ	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT

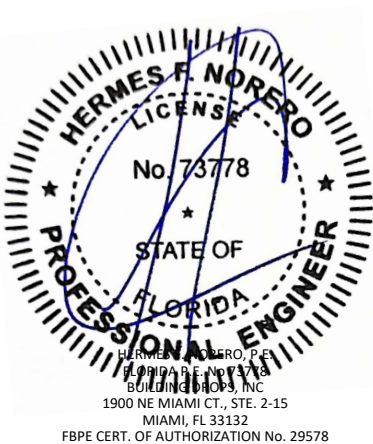

FL #:	FL32416
DATE:	05.29.20
DWG. BY:	LL
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	ARL001
SHEET:	6
REV.	B
OF 6	