




GLAZED IRON DOUBLE DOOR w/ & w/out TRANSOM INSWING/OUTSWING "IMPACT"

GENERAL NOTES


1. This product has been evaluated and is in compliance with the 7th Edition (2020) Florida Building Code (FBC) structural requirements including the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in the "HVHZ" this product complies with Section 1626 of the Florida Building Code and does not require an impact resistant covering.
4. When used in areas requiring wind borne debris protection this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E 1996 and FBC Sections 1609.1.2.2 & R301.2.1.2.1.
5. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
6. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.
7. Outswing configurations utilizing item #39 meet water infiltration requirements for "HVHZ".
8. Inswing configurations do not meet the water infiltration requirements for the "HVHZ". Inswing units shall be installed only in non-habitable areas or at habitable locations protected by an overhang or canopy such that the angle between the edge of canopy or overhang to sill is less than 45 degrees.
9. All steel shall be protected as specified in Section 2222.6 of the FBC.

TABLE OF CONTENTS

SHEET#	DESCRIPTION
1	Typical elevations, design pressures, & general notes
2	Door panel details & glazing details
3	Elevations
4	Horizontal & vertical cross sections
5	Vertical cross sections
6	Buck & frame anchoring (XX)
7	Buck & frame anchoring (O/XX)
8	Bill of materials & components

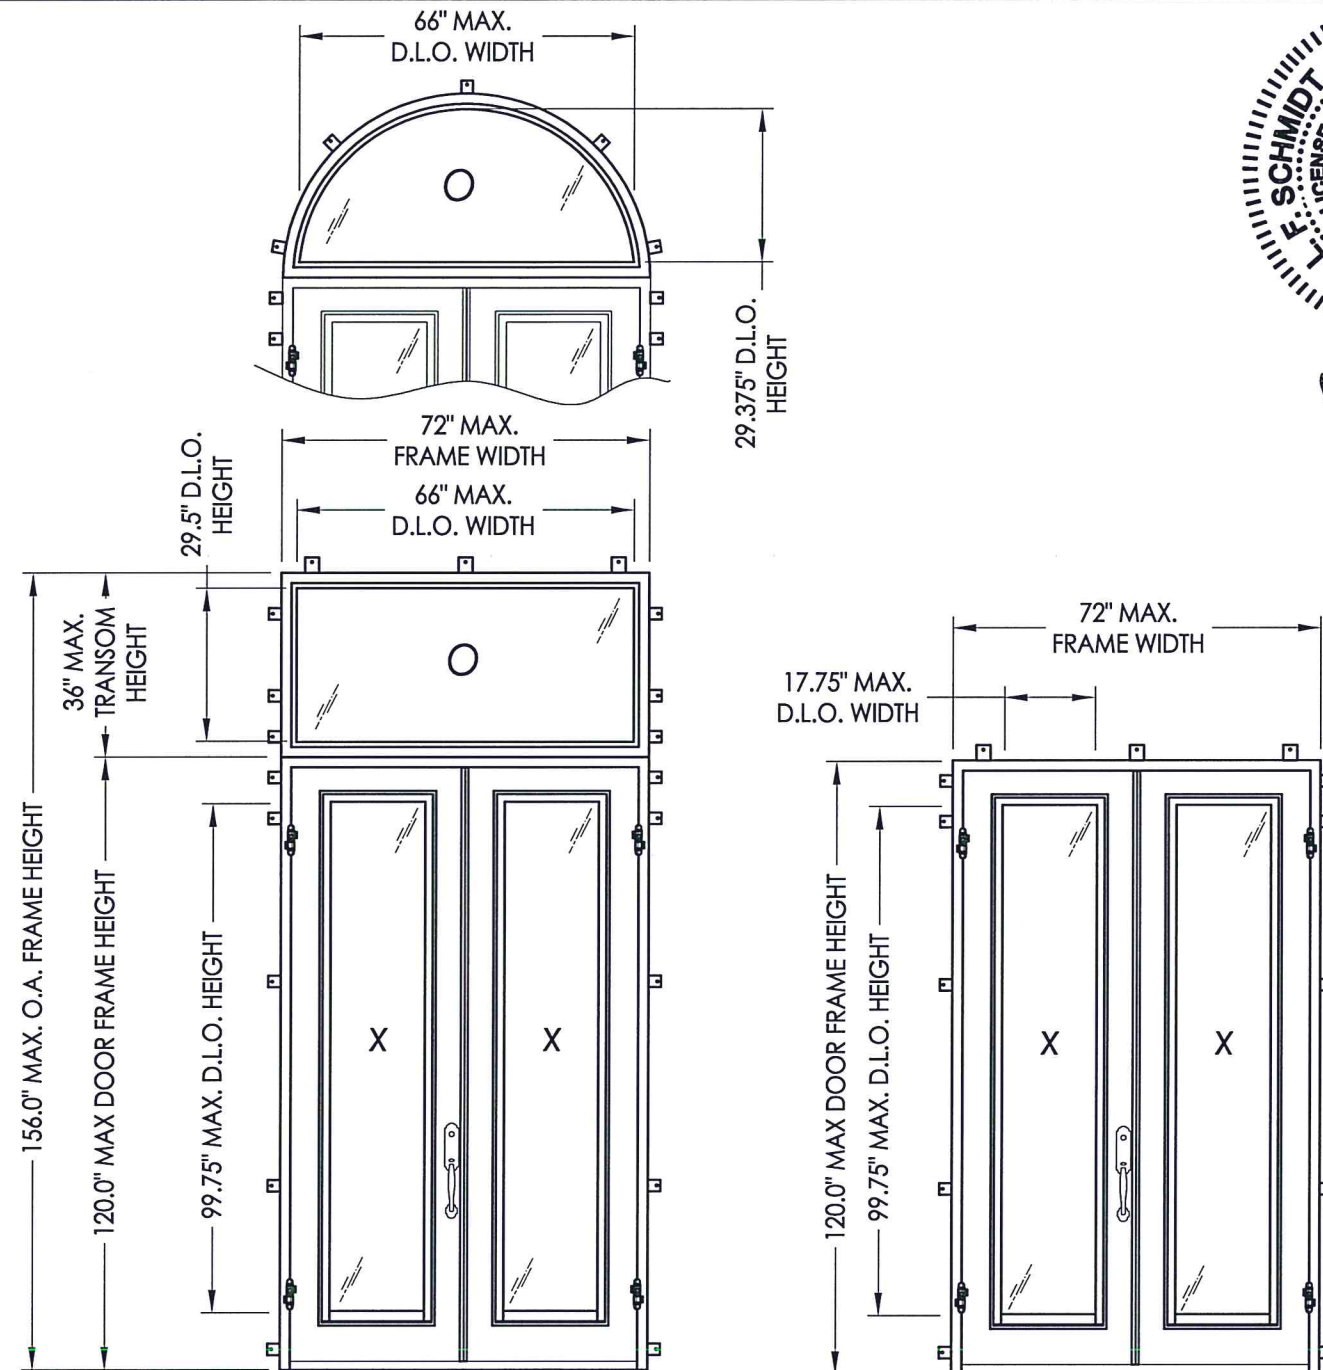


CONFIGURATION	OVERALL FRAME DIMENSION	GLASS TYPE	DESIGN PRESSURE (PSF)			
			INSWING		OUTSWING	
			POS.	NEG.	POS.	NEG.
XX	72.0" x 120.0"	G1	+70.0	-70.0	+70.0	-70.0
O/XX	72.0" x 156.0"	G1	+70.0	-70.0	+70.0	-70.0
XX	72.0" x 120.0"	G2	+50.0	-50.0	+50.0	-55.0
O/XX	72.0" x 156.0"	G2	+50.0	-50.0	+50.0	-55.0



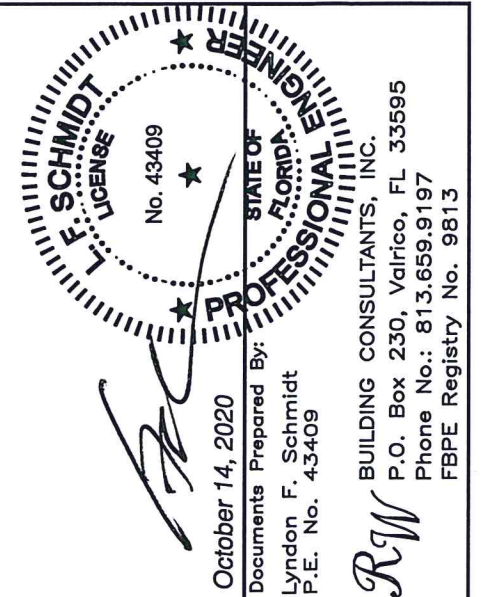


PRODUCT: IRON DOORS		PART OR ASSEMBLY: TYPICAL ELEVATIONS, DESIGN PRESSURES & GENERAL NOTES	
DATE: 8/06/20	SCALE: N.T.S.	DWG. BY: JK	CHK. BY: LFS
DRAWING NO.: FL-32651.8	SHEET 1 OF 8	REVISIONS	





\\dc01rvwbc\clients\Portal Elegance\A - Florida Product Approvals\FL-32651\C - Drawings\FL-32651\2020\FL-32651.5-8.dwg

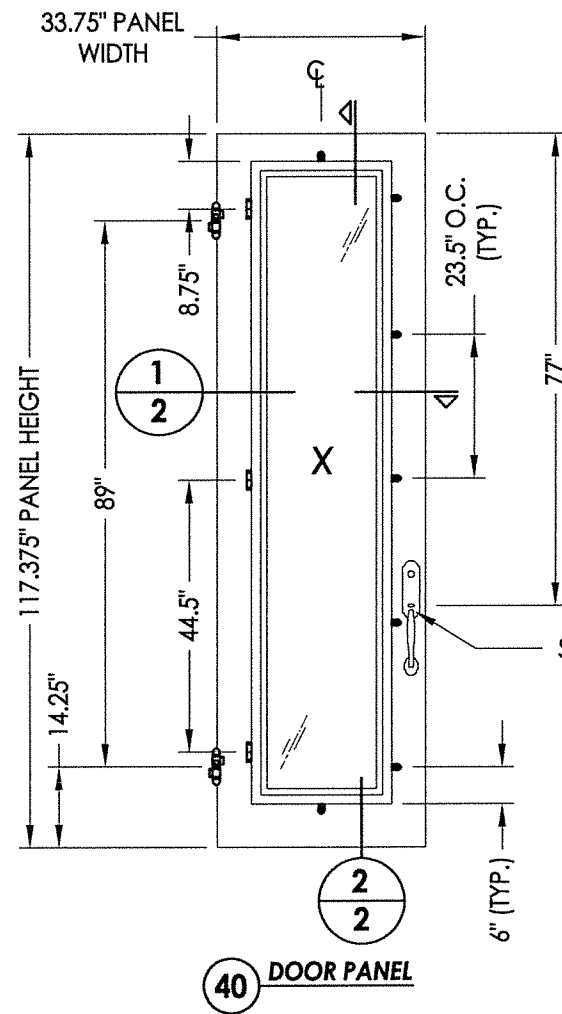

HARDWARE TABLE	
MANUFACTURER	MODEL
BALDWIN	HANDLESET (ESTATE SERIES)

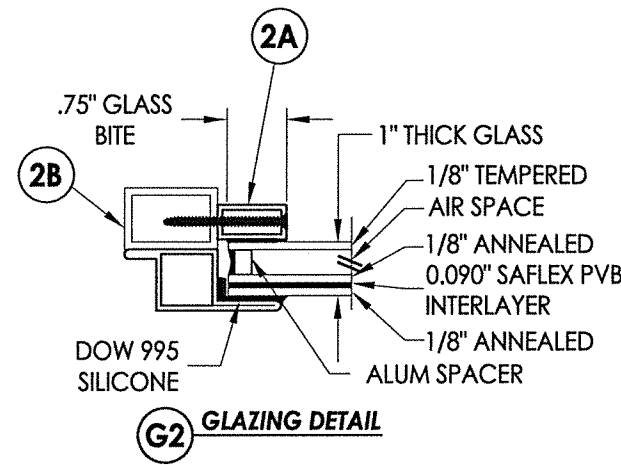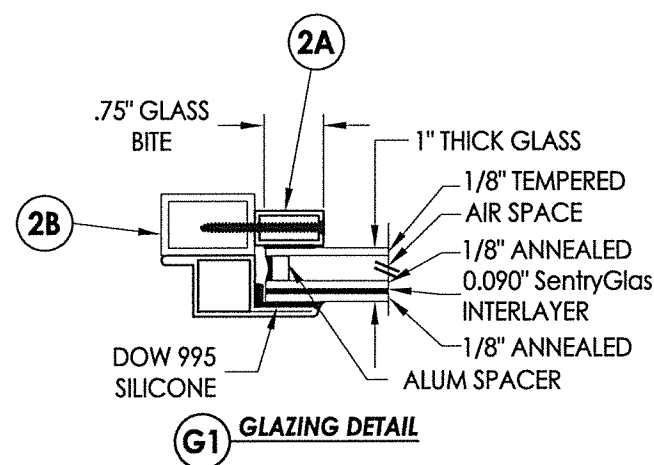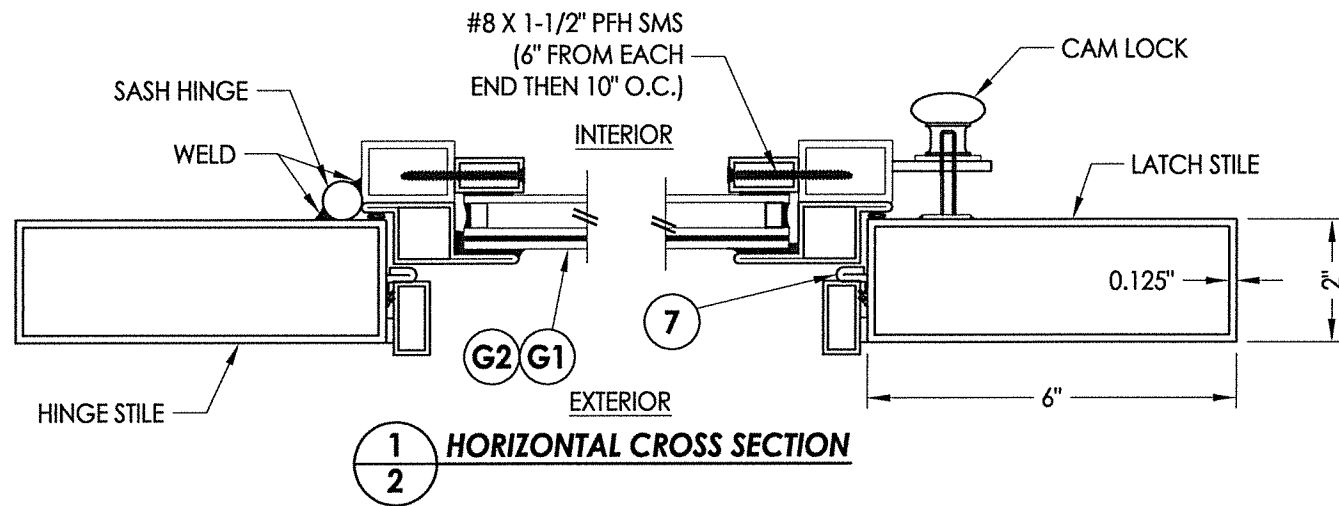




NOTE: GLAZING > 36" WIDE REQUIRES TWO (2) SETTING
BLOCKS CONFORMING TO FBC SECTION 241.1.3.3.1

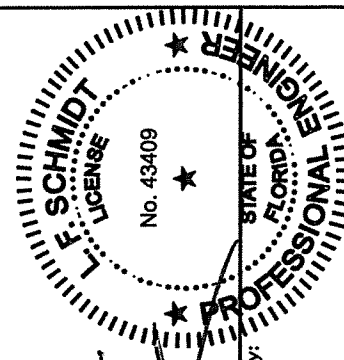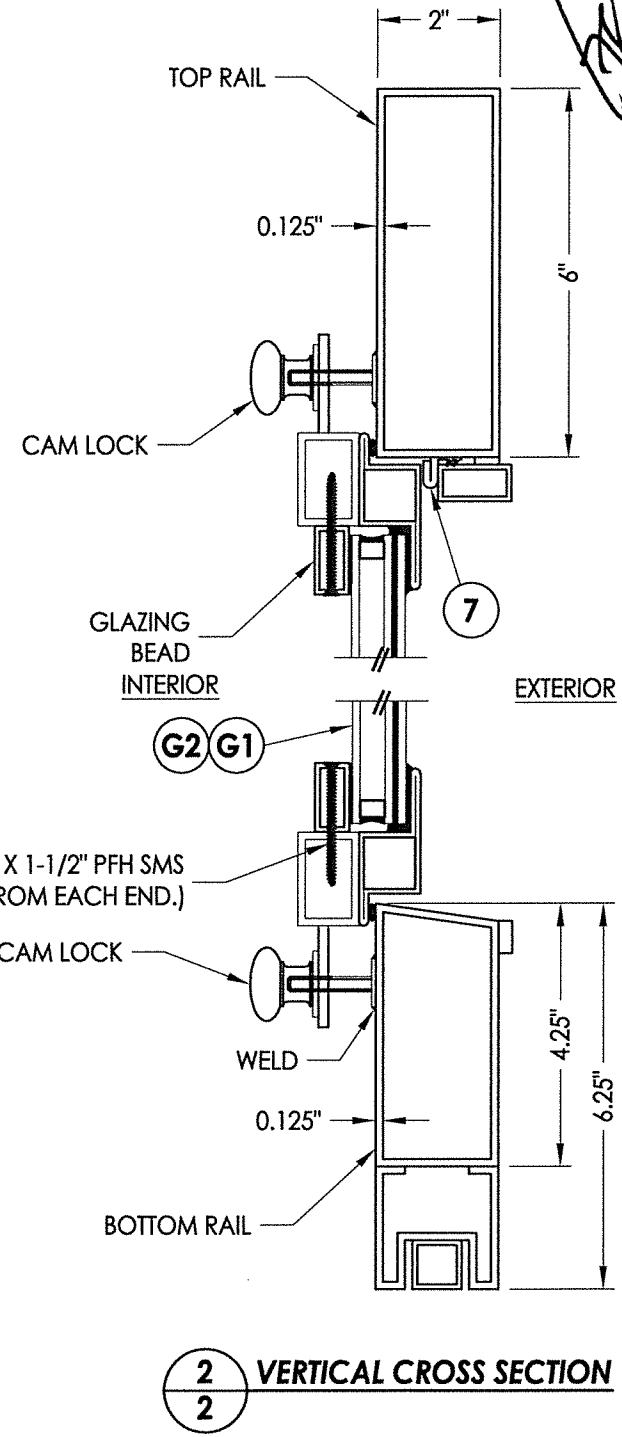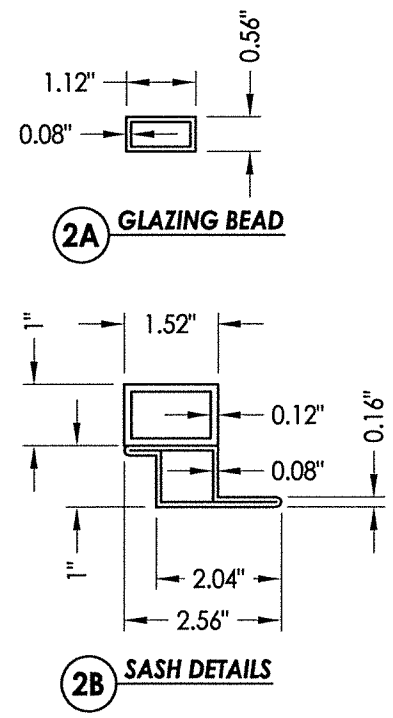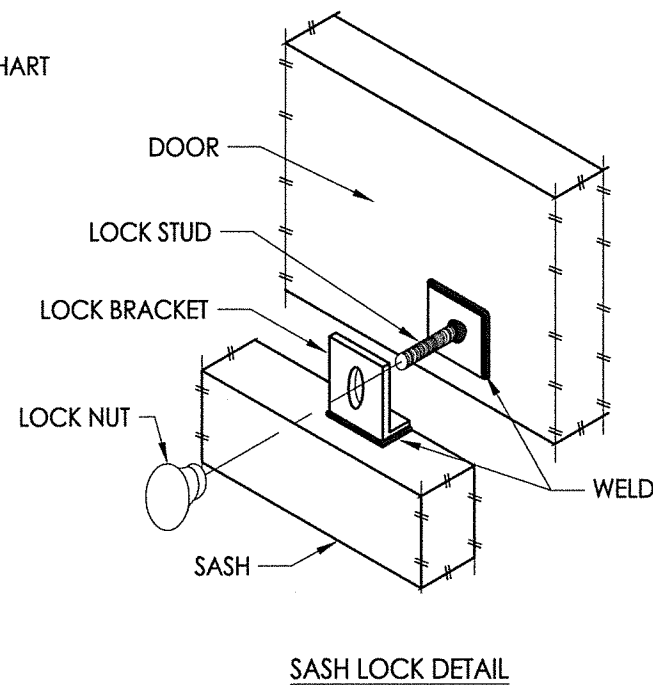

October 14, 2020
Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: IRON DOORS		PART OR ASSEMBLY: DOOR PANEL DETAILS & GLAZING DETAILS	
		RW	BY
		FBC	
1	10/14/20	UPDATE TO 7TH ED. (2020)	
	NO.	DATE	
REVISIONS			
DATE: 8/06/20			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-32651.8			
SHEET 2 OF 8			

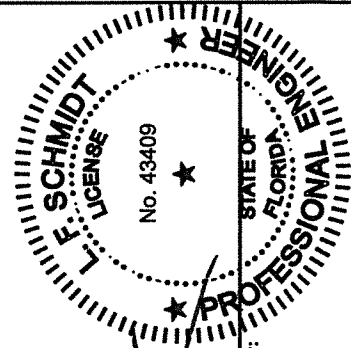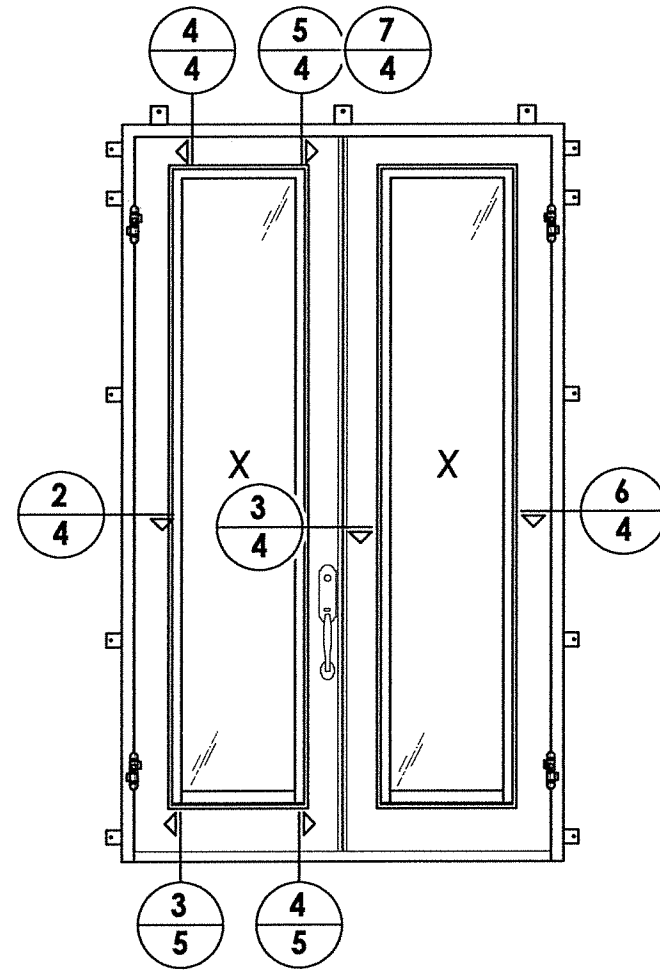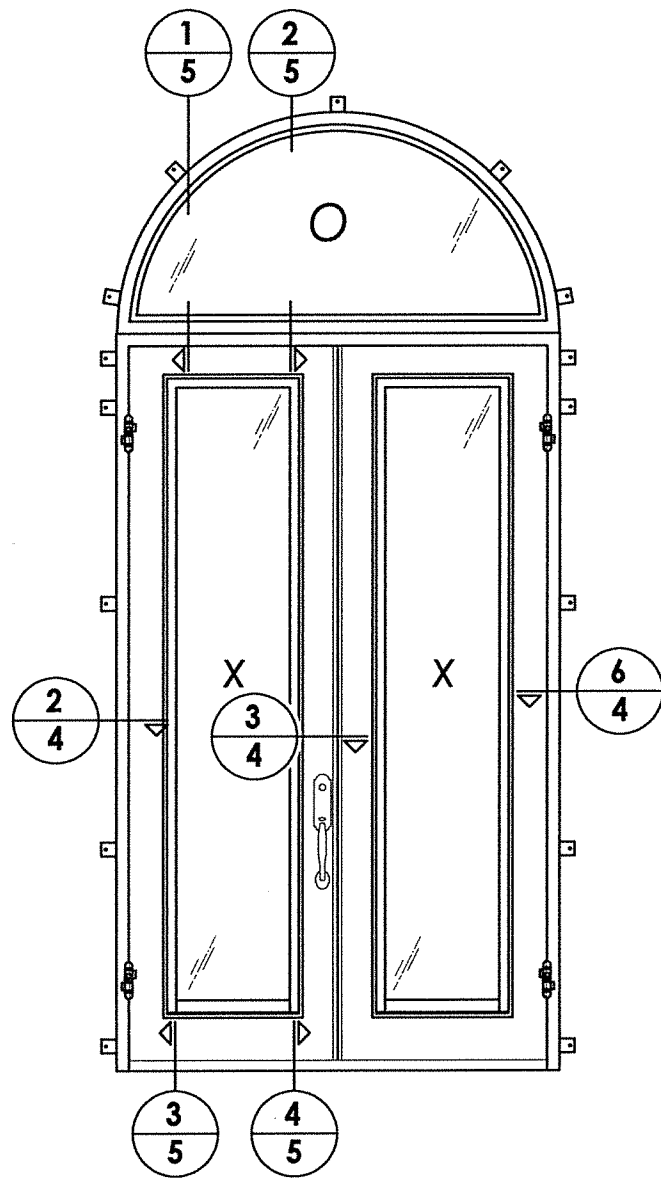


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PART OR ASSEMBLY:


1	10/14/20	UPDATE TO 7TH ED. (2020)	FBC	RW
NO.	DATE			BY
REVISIONS				

SHEET 3 OF 8


BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

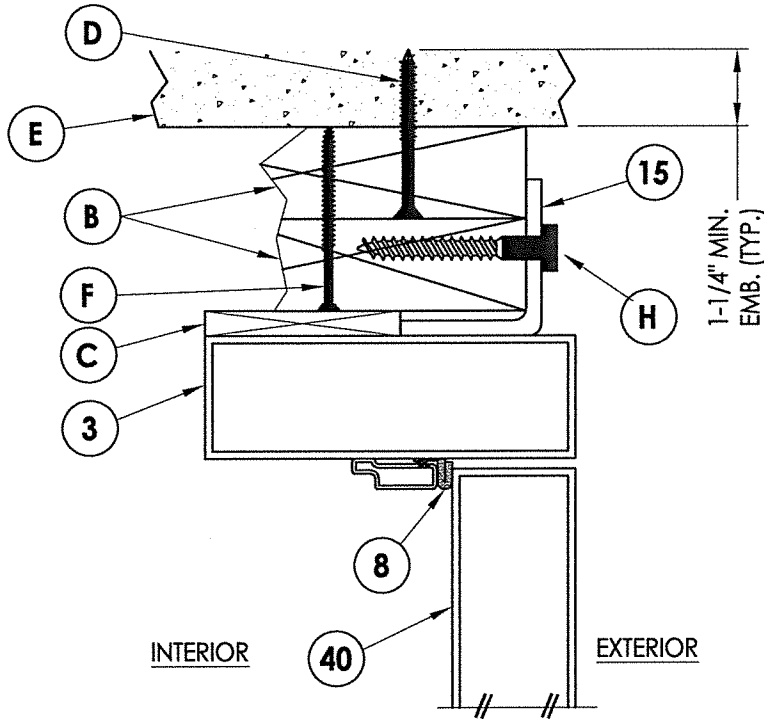


4 VERTICAL CROSS SECTION
4 Outswing

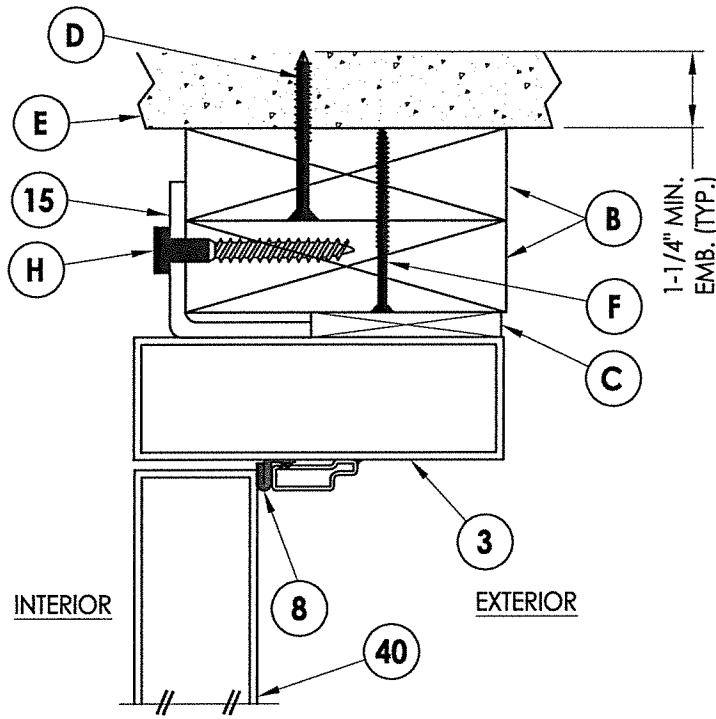


5 VERTICAL CROSS SECTION
4 Inswing

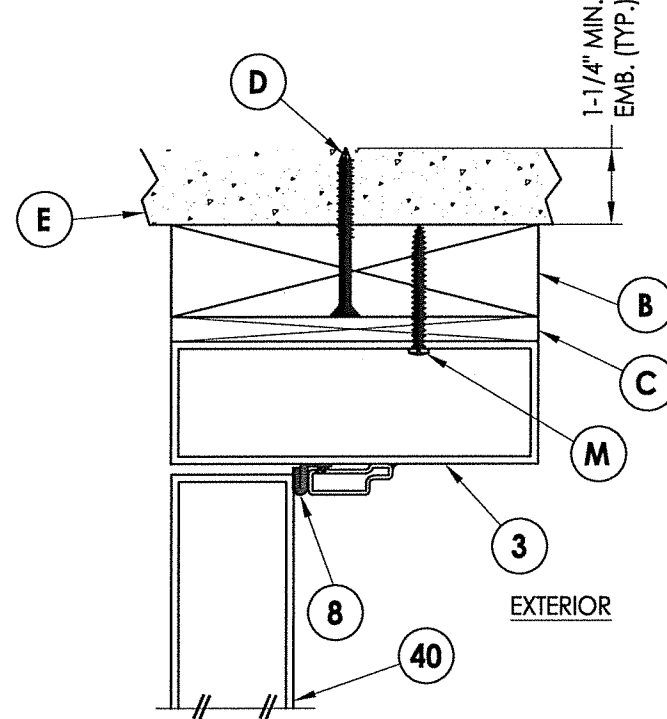


7 HORIZONTAL CROSS SECTION
4 Inswing Shown (Inswing Similar)
2X Buck Masonry Anchoring

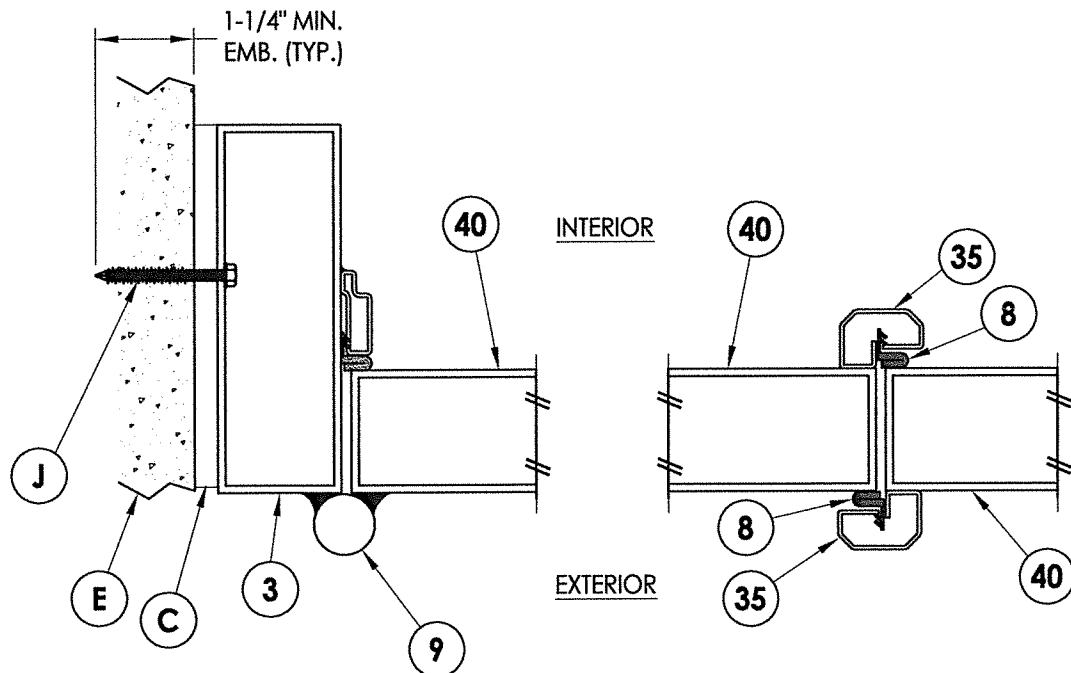


2 HORIZONTAL CROSS SECTION
4 Outswing Shown (Inswing Similar)
Direct to Masonry Anchoring

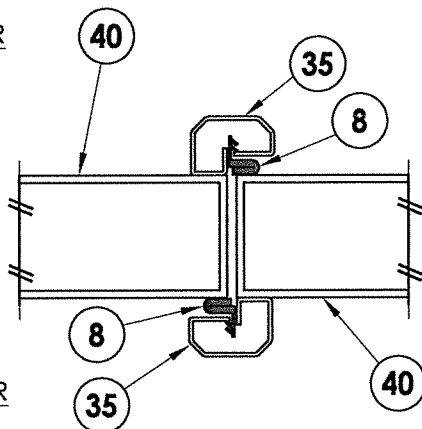


3 HORIZONTAL CROSS SECTION
4 Outswing Shown (Inswing Similar)

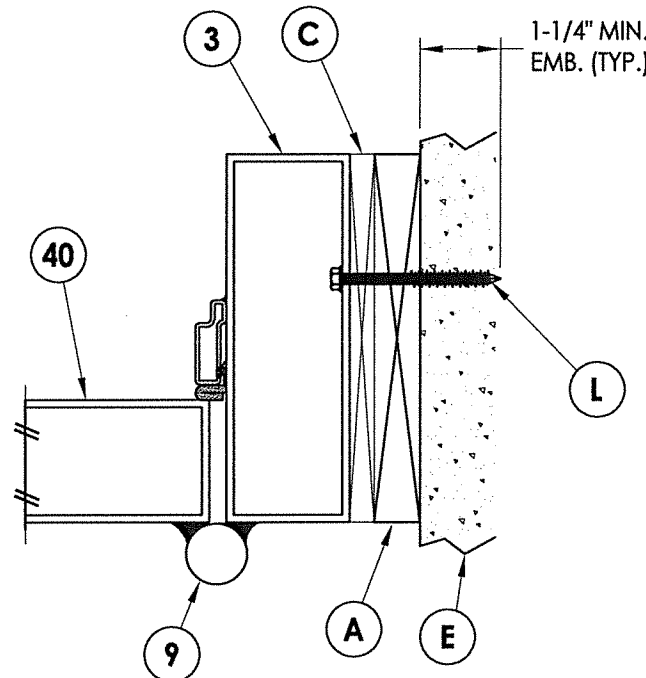

6 HORIZONTAL CROSS SECTION
4 Outswing Shown (Inswing Similar)
1X Buck Masonry Anchoring

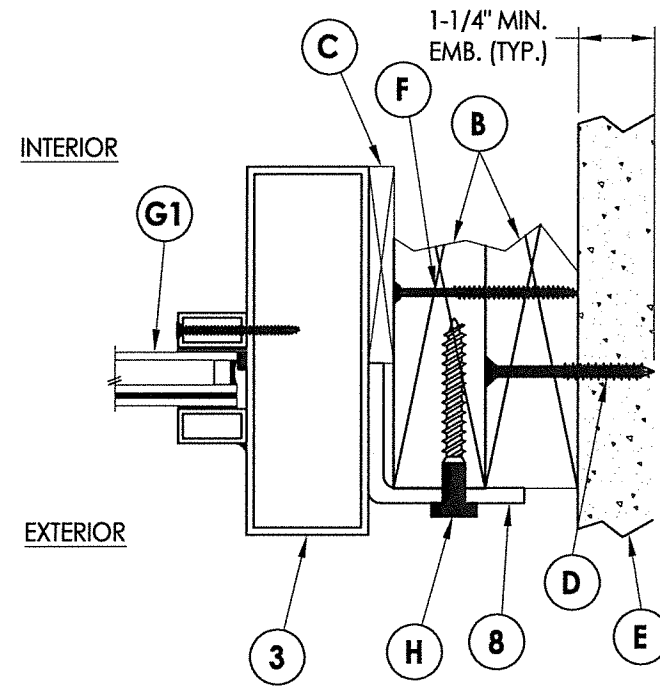

1 HORIZONTAL CROSS SECTION
4 Outswing Shown (Inswing Similar)

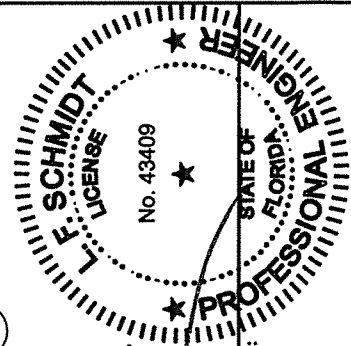

October 14, 2020
Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409
BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: IRON DOORS

PART OR ASSEMBLY:
HORIZONTAL AND VERTICAL
CROSS SECTIONS

NO.	DATE	REVISIONS
1	10/14/20	UPDATE TO 7TH ED. (2020) FBC
RW	BY	

DATE: 8/06/20



SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-32651.8

SHEET 4 OF 8

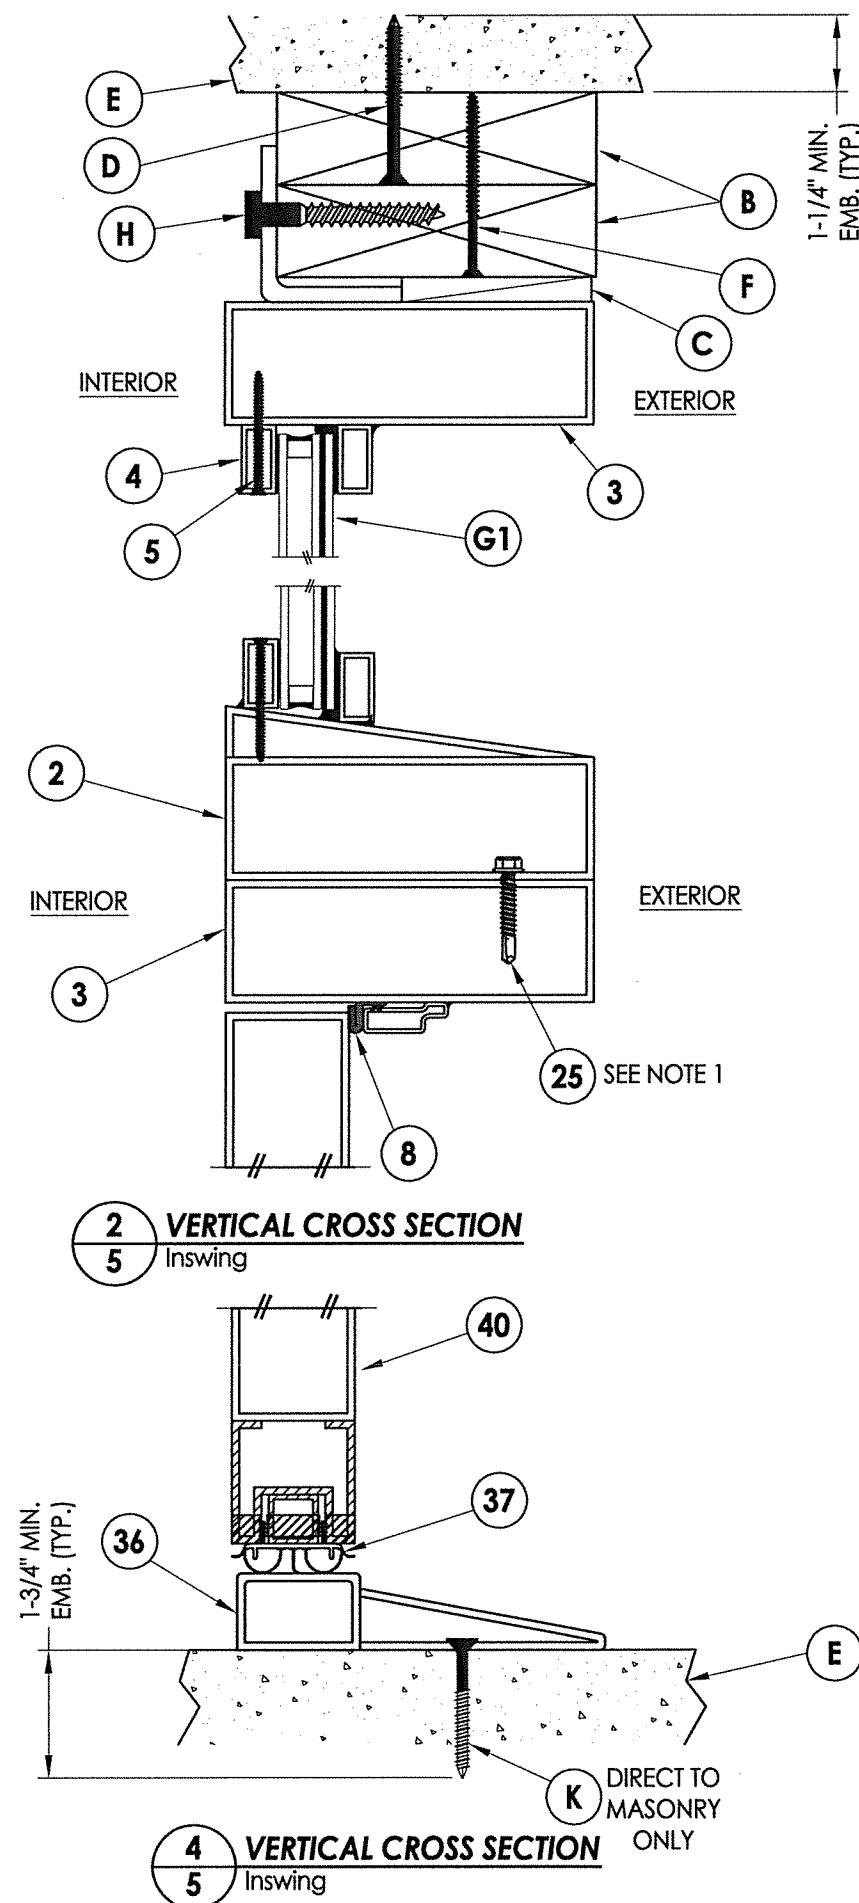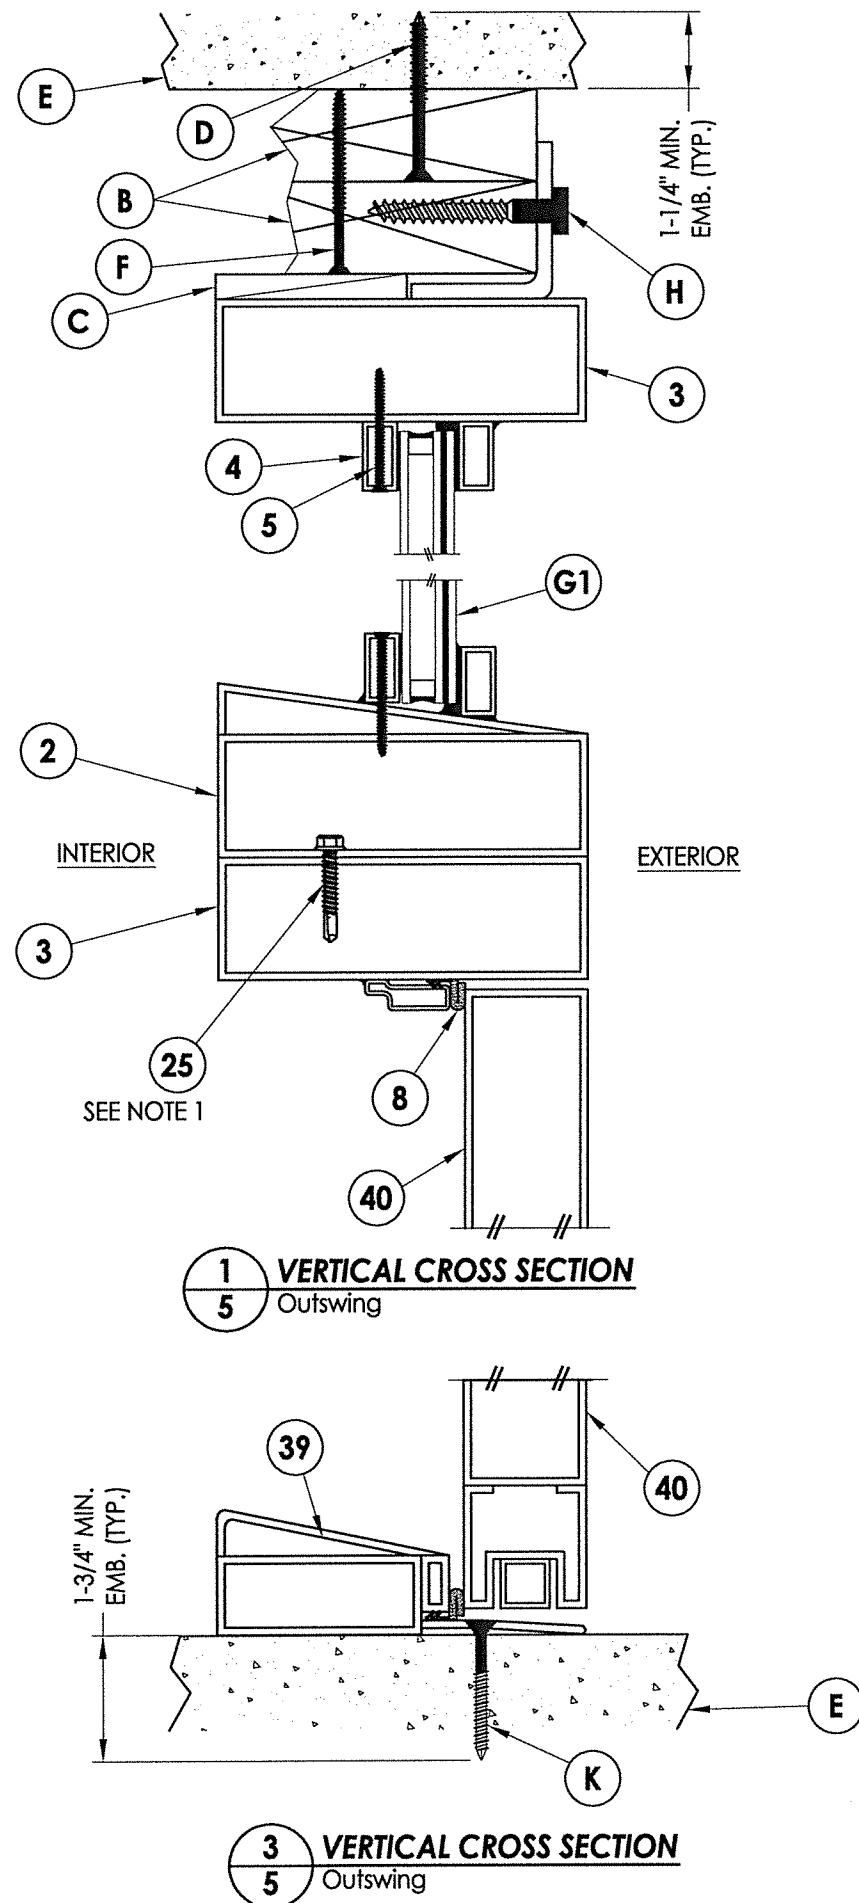

NOTE :
1. Item #35 location: 4" from each and
(2) more equally spaced (4 total).



F. SCHMIDT
LICENSE
No. 43409
STATE OF FLORIDA
PROFESSIONAL ENGINEER

October 14, 2020

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT: IRON DOORS

PART OR ASSEMBLY: VERTICAL CROSS SECTIONS

REVISONS	
NO.	DATE
1	10/14/20
	UPDATE TO 7TH ED. (2020)
	FBC
	RW
	BY

DATE: 8/06/20

SCALE: N.T.S.



DWG. BY: JK

CHK. BY: LFS









DRAWING NO.: FL-32651.8

SHEET 5 OF 8

\\dc01\wbc\Clients\Portal Elegance\A - Florida Product Approvals\FL-32651\1C - Drawings\FL-32651.5-8.dwg

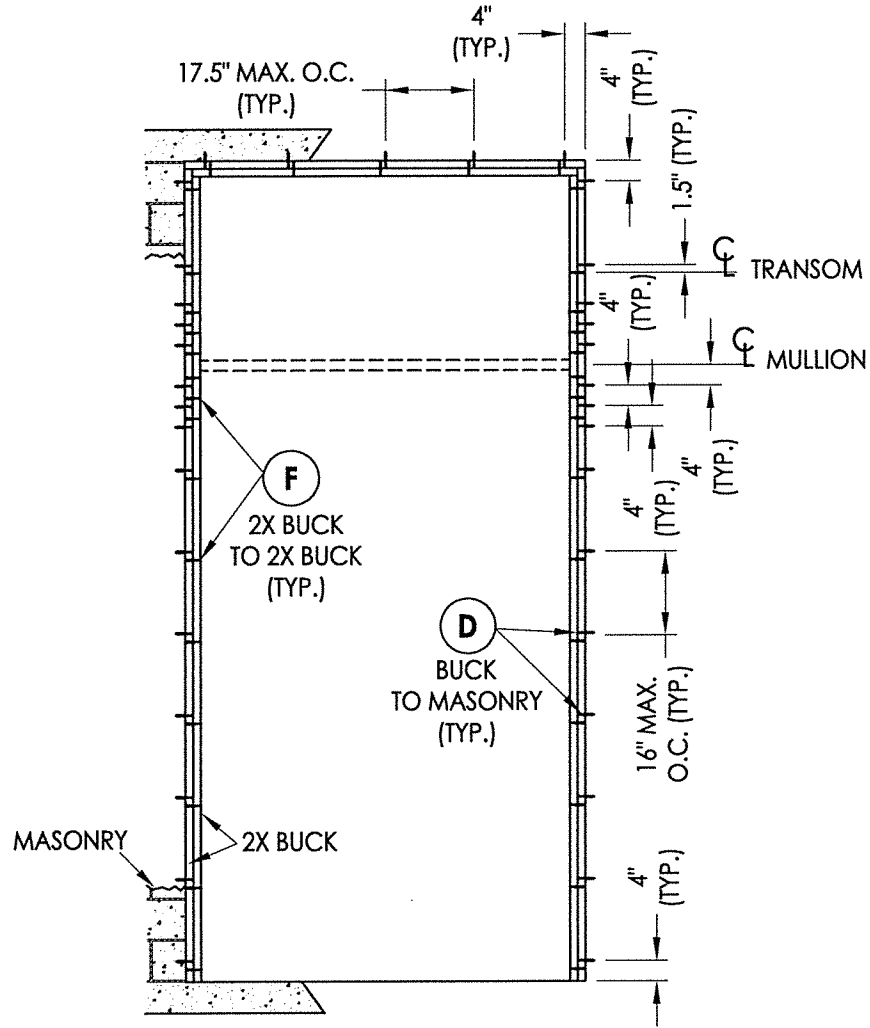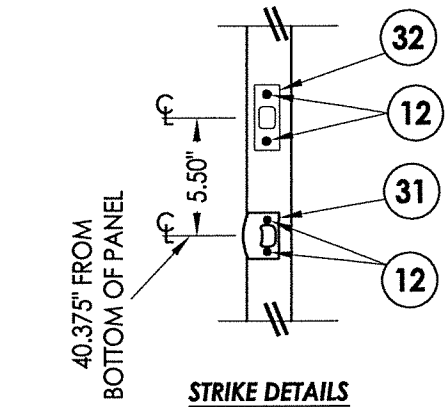

BUCK ANCHORING
Double Buck Shown
(Single Buck Similar)

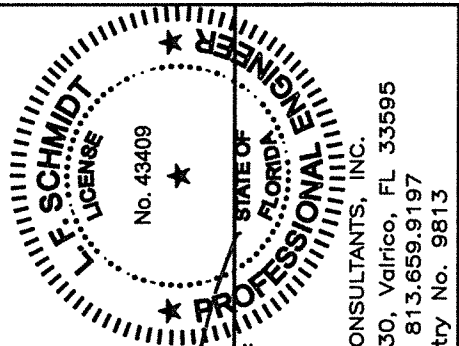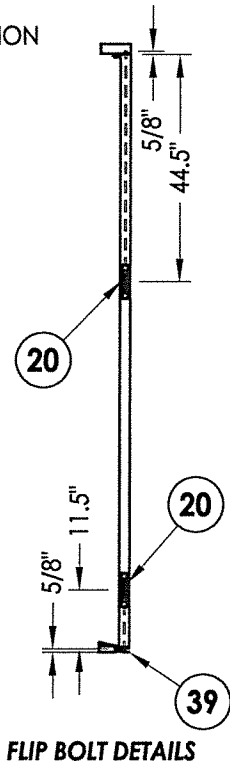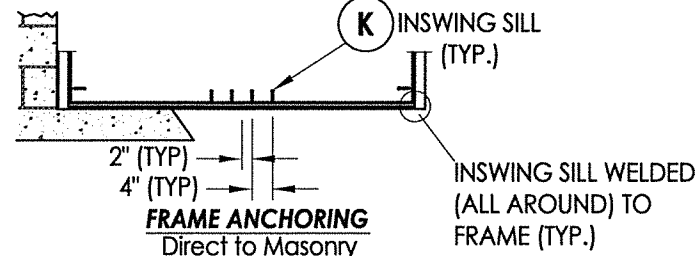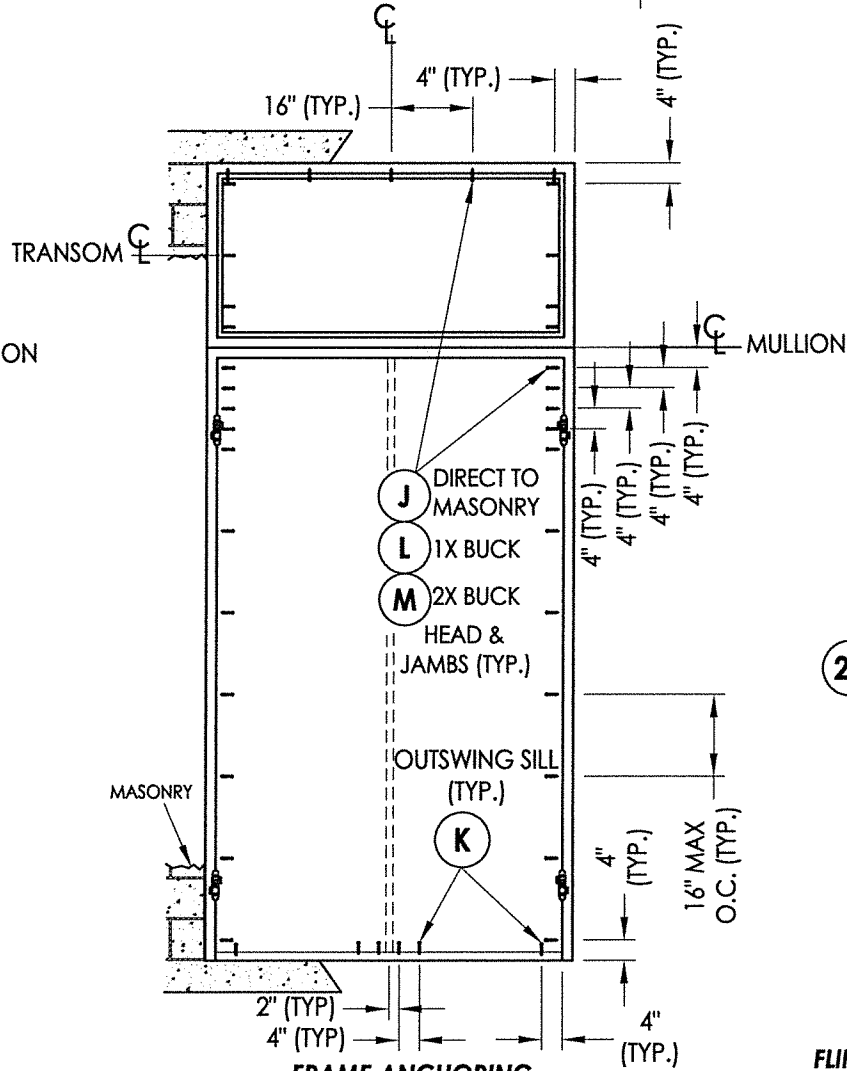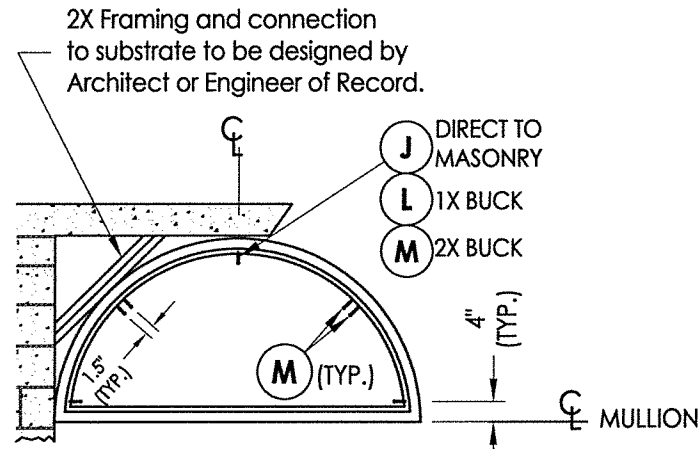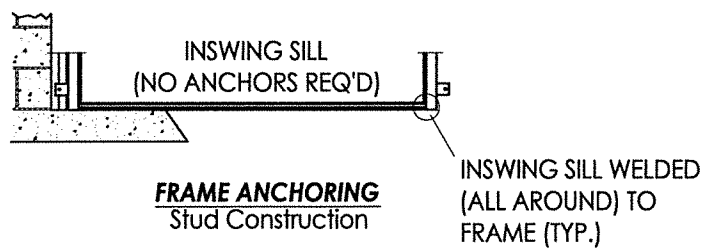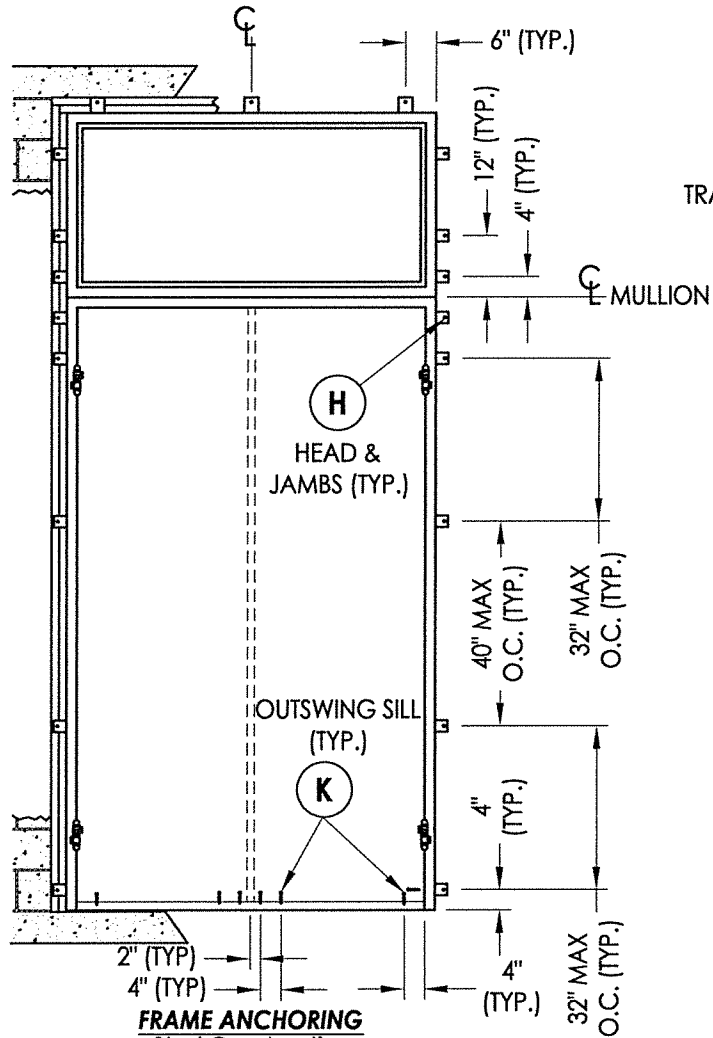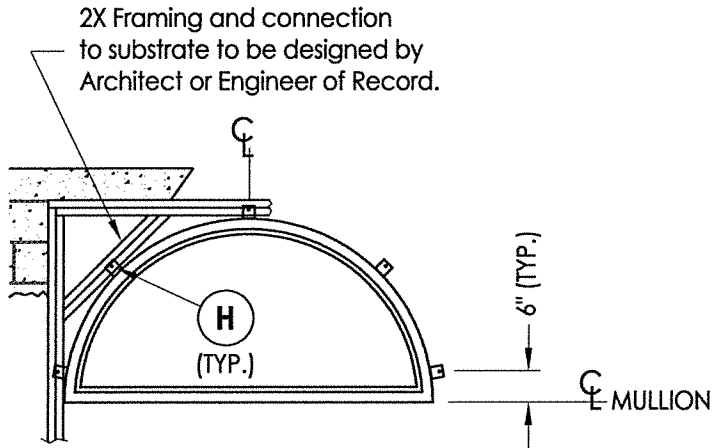


October 14, 2020
Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409
RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: IRON DOORS		PART OR ASSEMBLY: BUCK & FRAME ANCHORING (O/XX)	
NO.	DATE	BY	REVISIONS
1	10/14/20	FWC	UPDATE TO 7TH ED. (2020)
DATE: 8/06/20		SCALE: N.T.S.	
DWG. BY: JK		CHK. BY: LFS	
DRAWING NO.: FL-32651.8		SHEET 7 OF 8	


\\dc01\rbw\clients\Portal Elegance\A - Florida Product Approvals\FL-32651\Drawings\FL-32651\5-8.dwg

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (SG >= 0.55)	WOOD
B	2X BUCK (SG >= 0.55)	WOOD
C	3/8" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	#10 X 3" PFH WOOD SCREW	STEEL
G	1/4" X 1-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
H	3/8" X 3" HWH LAG SCREW (2-1/2" MIN. EMBEDMENT)	STEEL
J	1/4" X 1-3/4" HWH DeWALT OR ITW CONCRETE SCREW	STEEL
K	1/4" X 2-1/4" HWH ITW CONCRETE SCREW (1-3/4" MIN. EMBEDMENT)	STEEL
L	1/4" X 3-1/4" HWH DeWALT OR ITW CONCRETE SCREW	STEEL
M	#12 X 2" PH WOOD SCREW (1-1/2" MIN. EMBEDMENT)	STEEL
2	TRANSOM SILL	STEEL
3	FRAME	STEEL
4	GLAZING BEAD	STEEL
5	#8 X 1-1/4" PFH SELF-DRILLING SMS	STEEL
7	WEATHERSTRIP GASKET (.5")	FOAM
8	WEATHERSTRIP GASKET (.67")	FOAM
9	DOOR HINGE	STEEL
12	#8 X 3/4" PFH SELF-DRILLING SMS	STEEL
15	ANCHORING BRACKET	STEEL
20	FLIP BOLT	-
25	#10 X 1-1/2" HWH SELF-DRILLING SMS	STEEL
31	LATCH STRIKE PLATE	STEEL
32	DEADBOLT STRIKE PLATE	STEEL
35	ASTRAGAL	STEEL
36	THRESHOLD	STEEL
37	DOOR SWEEP	PVC
39	THRESHOLD	STEEL
40	DOOR PANEL	STEEL


All Door Component Steel: ASTM A36

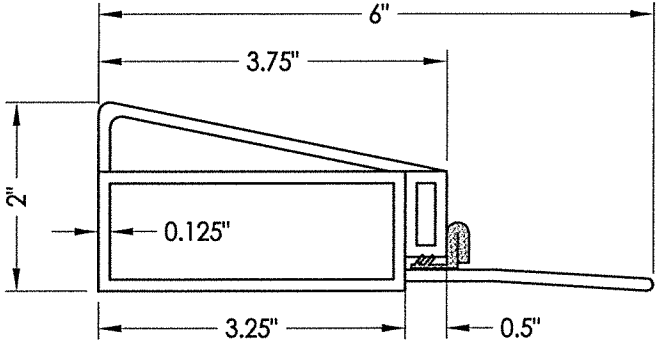


39 THRESHOLD
Outswing

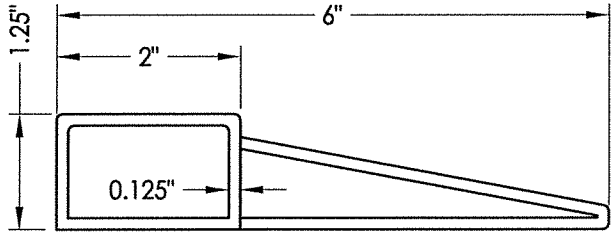


36 THRESHOLD
Inswing

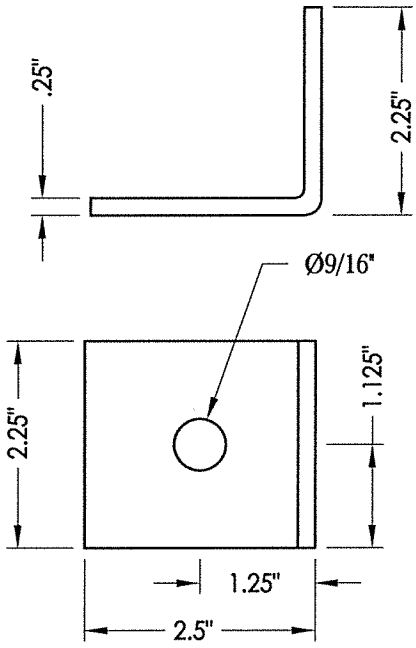


15 ANCHORING BRACKET

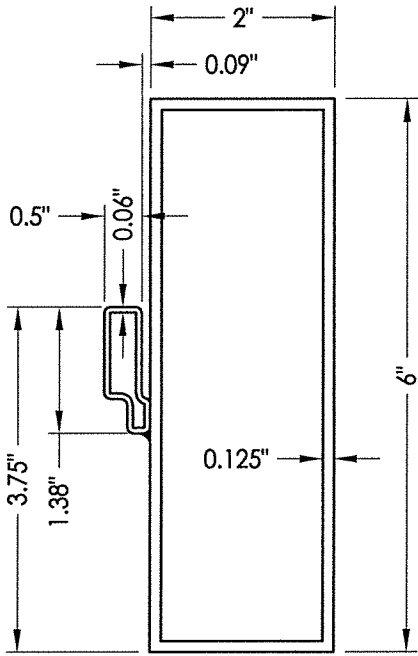


3 FRAME

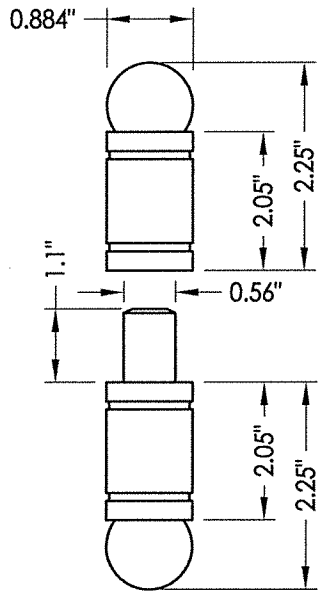

9 HINGE



35 ASTRAGAL

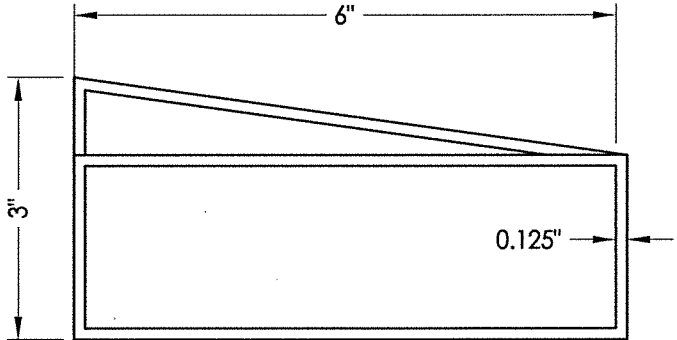

2 TRANSOM SILL


CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2-1/2"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	2-1/2"	4"

1. WOOD SCREW INSTALLATION NOTES:

Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

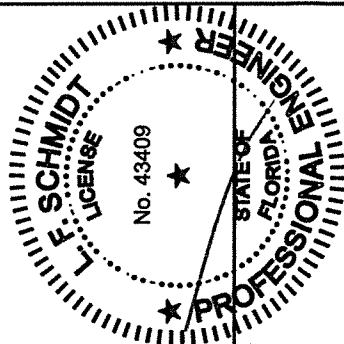

October 14, 2020
Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: IRON DOORS
PART OR ASSEMBLY:
BILL OF MATERIALS & COMPONENTS

NO.	DATE	REVISIONS
1	10/14/20	UPDATE TO 7TH ED. (2020) FBC

DATE: 8/06/20

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-32651.8

SHEET 8 OF 8