

GENERAL NOTES:

1. SERIES 21000 HIGH IMPACT FIXED LAMINATED GLASS WINDOWS, SHOWN ON THIS PRODUCT EVALUATION DOCUMENT (P.E.D.) HAVE BEEN VERIFIED FOR COMPLIANCE IN ACCORDANCE WITH THE 2020 (7th EDITION) OF THE FLORIDA BUILDING CODE. THESE WINDOWS MAY BE INSTALLED AT HIGH VELOCITY HURRICANE ZONES (H.V.H.Z.) OR OUT OF IT (N.H.V.H.Z.). DESIGN WIND LOADS SHALL BE DETERMINED AS PER SECTIONS 1620 & 1609 OF THE ABOVE MENTIONED CODE, USING ASCE 7-16 AND SHALL NOT EXCEED THE MAXIMUM (A.S.D.) DESIGN PRESSURE RATINGS INDICATED ON NOTE 2 BELOW.

IN ORDER TO VERIFY THE ABOVE CONDITION, ULTIMATE DESIGN WIND LOADS DETERMINED PER ASCE 7-16 SHALL BE FIRST REDUCED TO A.S.D. DESIGN WIND LOADS BY MULTIPLYING THEM BY 0.6 IN ORDER TO COMPARE THESE W/ MAX. (A.S.D.) DESIGN PRESSURE RATINGS INDICATED ON NOTE 2 BELOW.

IN ORDER TO VERIFY THAT ANCHORS ON THIS P.A.D., AS TESTED, WERE NOT OVERSTRESSED, A 33% INCREASE IN ALLOWABLE STRESS FOR WIND LOADS WAS **NOT** USED IN THEIR ANALYSIS. FASTENERS SPACING IN WOOD HAS BEEN DETERMINED IN ACCORDANCE WITH NDS 2018.

THESE WINDOWS' ADEQUACY FOR IMPACT AND WIND RESISTANCE HAS BEEN VERIFIED IN ACCORDANCE WITH SECTIONS 1626 & 1609.1.2 OF THE ABOVE MENTIONED CODE AS PER PROTOCOLS TAS-201, TAS-202, & TAS-203, PER FENESTRATION TESTING LAB REPORT # 6058 AND AS PER SUBMITTED STRUCTURAL CALCULATIONS, PERFORMED AS PER SECTIONS 1616 & 1604 OF THE FLORIDA BUILDING CODE.

2. MAXIMUM A.S.D. DESIGN PRESSURE RATINGS SHALL BE AS PER SCHEDULES SHOWN ON SHEETS 6, 7 & 8. CRITERIA FOR ADDRESSING DIFFERENT SHAPES IS AS EXPLAINED ON THIS SHEET (*).

3. THESE WINDOWS WILL NOT REQUIRE A HURRICANE PROTECTION DEVICE.

4. THESE WINDOWS ARE APPROVED FOR AIR AND WATER INFILTRATION.

5. THESE WINDOWS COMPLY WITH SECTION 2406 OF THE FLORIDA BUILDING CODE.

6. ALL ALUMINUM EXTRUSIONS SHALL BE ALUMINUM ASSOCIATION 6063-T6 ALLOY AND TEMPER. THE THICKNESS OF ALL EXTRUSIONS SHALL BE AS SHOWN ON SHEET 2 OF THIS DRAWING.

7. ALL SCREWS USED FOR ASSEMBLY CONNECTIONS (METAL TO METAL) TO BE STAINLESS STEEL 304 OR 316 AISI SERIES OR CORROSION RESISTANT COATED CARBON STEEL AS PER DIN 50018 AND SECTION 2411.3.3.4 OF THE FLORIDA BUILDING CODE WITH 50 ksi YIELD STRENGTH AND 90 ksi TENSILE STRENGTH.

8. WOOD BUCKS NOT BY GENERAL IMPACT GLASS & WINDOWS, CORP. WOOD BUCKS MUST BE SOUTHERN PINE WITH G=0.55. AND SHALL COMPLY WITH SECTIONS 2411.3.3.3 & 2411.3.3.4 OF THE FLORIDA BUILDING CODE. MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

(8.1) 2 X WOOD BUCKS MUST BE PROPERLY ANCHORED TO EXISTING STRUCTURE TO TRANSFER LOADS TO IT. ANCHORAGE IS INDEPENDENT OF WINDOW FRAME ANCHORAGE. WINDOW FRAME MUST BE SEPARATELY ANCHORED TO 2 X WOOD BUCK FOLLOWING DETAILS ON THIS DRAWING.

(8.2) 1 X WOOD BUCK (OR ANY WOOD BUCK LESS THAN 2X) MUST BE PROPERLY ANCHORED TO EXISTING STRUCTURE TO TRANSFER LOADS TO IT. WINDOW FRAME ANCHOR SHALL BE USE TO ATTACH 1 X WOOD BUCK TO EXISTING STRUCTURE BY DRIVING ANCHOR THRU BOTH WINDOW FRAME & 1 X WOOD BUCK INTO EXISTING STRUCTURE W/ PROPER EMBEDMENT AND EDGE DISTANCE AS SHOWN ON THIS DRAWING.

(8.3) WINDOW FRAME MAY BE DIRECTLY CONNECTED TO EXISTING STRUCTURE WITH NO NEED OF WOOD BUCKS WHEN MASONRY OPENING IS NOT LARGER THAN ACTUAL WINDOW OVERALL DIMENSIONS. HOWEVER, SHIMS (SEE NOTE 10) MAY BE ALLOWED AT WINDOW FRAME ANCHOR LOCATION IF NEEDED.

9. ANCHOR NOTES: SEE SHEET 9 FOR MAXIMUM SPACING. EMBEDMENT AND EDGE DISTANCE ARE BEYOND ANY WALL FINISH.


- (A) TO EXISTING POURED CONCRETE: (Min. f'_c = 2730 psi.), MIN. EDGE DISTANCE = 2 1/2".
- 1/4"Ø ULTRACON 1 1/4" MIN. EMBEDMENT, AS MANUFACTURED BY ELCO CONSTRUCTION PRODUCTS. (COMPONENT 8), THRU 1" P.T. WOOD BUCK.
- (B) TO EXISTING HOLLOW BLOCK WALL (Min. f'_m = 1924 psi.), MIN. EDGE DISTANCE = 2 1/2".
- 1/4"Ø ULTRACON 1 1/4" MIN. EMBEDMENT, AS MANUFACTURED BY ELCO CONSTRUCTION PRODUCTS. (COMPONENT 8), THRU 1" P.T. WOOD BUCK.
- (C) TO EXISTING 2x P.T. WOOD BUCK. (MIN. G = 0.55) MIN. EDGE DISTANCE = 1".
- 1/4"Ø ULTRACON 1 1/2" MIN. THREADED PENETRATION, AS MANUFACTURED BY ELCO CONSTRUCTION PRODUCTS. (COMPONENT 8).
- (D) TO EXISTING MIN. 1/8" THICK ALUMINUM TUBE (6063-T5 ALLOY) MIN. EDGE DISTANCE = 1/2".
- 1/4"Ø-14 TEK SCREW, MIN. 3/4" LONG, AS MANUFACTURED BY ITW BUILDEX, INC. (COMPONENT 8A).
- (E) TO EXISTING MIN. 12 GAGE (0.106") STEEL MEMBER (ASTM A-500, A-653 OR A-36) MIN. EDGE DISTANCE = 3/8".
- 1/4"Ø-14 TEK SCREW, MIN. 3/4" LONG, AS MANUFACTURED BY ITW BUILDEX, INC. (COMPONENT 8A).

10. PROVIDE 1/4" MAX. LOAD BEARING SHIM SPACE (TYP.).

11. REMAINING COMPONENTS FOR THESE WINDOWS SHALL BE AS INDICATED ON BILL OF MATERIALS ON SHEET 2.

12. WINDOWS' MANUFACTURER LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION AT PRODUCT IN ACCORDANCE WITH SECTION 1709.5 OF THE FLORIDA BUILDING CODE. ONE LABEL SHALL BE PLACED FOR EVERY UNIT.

13. (A) THIS P.E.D. PREPARED BY THIS ENGINEER IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT; I.E. WHERE THE SITE CONDITIONS DEVIATE FROM THE P.E.D.
(B) CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION INCLUDING LIFE SAFETY OF THIS PRODUCT, BASED ON THIS P.E.D., PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT. CONSTRUCTION SAFETY AT SITE IS THE CONTRACTOR'S RESPONSIBILITY.
(C) THIS P.E.D. WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.
(D) SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS DELEGATED ENGINEER TO THE P.E.D., SHALL SUBMIT TO THIS LATTER SITE SPECIFIC DRAWING FOR REVIEW.
(E) ORIGINAL P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

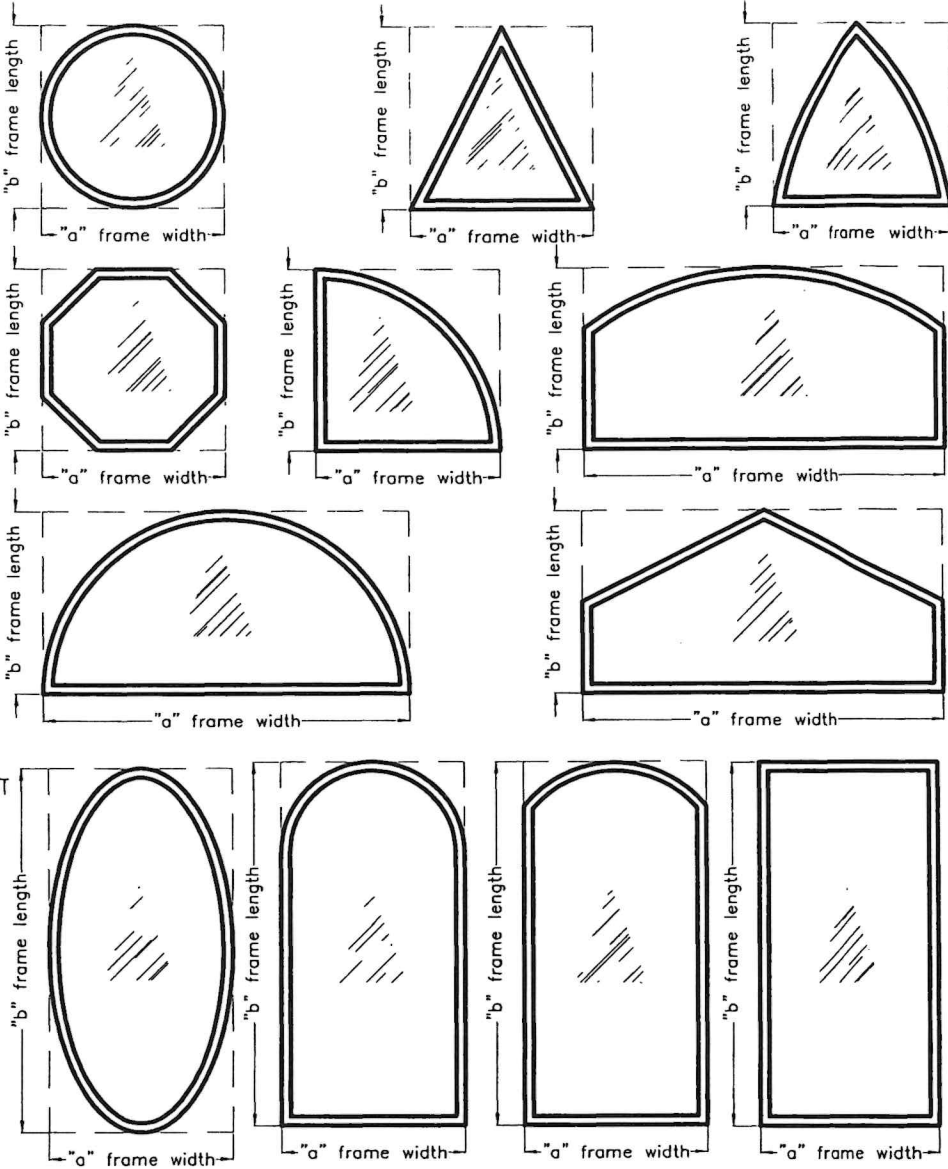

THIS DRAWING SHALL ONLY BE USED TO OBTAIN PERMITS IN THE STATE OF FLORIDA

* MAXIMUM A.S.D. DESIGN PRESSURE RATING (psf) FOR ALTERNATE SHAPES AS SHOWN ABOVE OR SIMILAR CAN BE DETERMINED BY INSCRIBING FIXED WINDOW SHAPE WITHIN SQUARE "a" x "b" OR RECTANGLE "a" x "b" AS SHOWN IN DOTTED LINES AND OBTAINING MAXIMUM A.S.D. DESIGN PRESSURE RATING (psf) FOR THOSE ALTERNATE SHAPES FROM SCHEDULES ON SHEETS 6, 7 & 8 FOR SERIES 21000 HIGH IMPACT FIXED LAMINATED GLASS WINDOWS.

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

WALTER A. TILLIT JR.
No. 44167
STATE OF FLORIDA
PROFESSIONAL ENGINEER
3/31/2023
P.E. SEAL/SIGNATURE/DATE

© 2023 TILTECO INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr., P.E.
FLORIDA Lic. 44167


SERIES 21000 HIGH IMPACT FIXED GLASS WINDOWS

GENERAL
IMPACT GLASS & WINDOWS
The Clear Solution

290 WEST 78 ROAD
HIALEAH, FL 33014
PHONE: (305) 558-8103
FAX: (305) 558-6665
www.generalimpact.com


REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-272	03/23/23	3		
2			4		

DRAWN BY: W.H
03/23/2023 DATE
23-041 DRAWING No
SHEET 1 OF 9

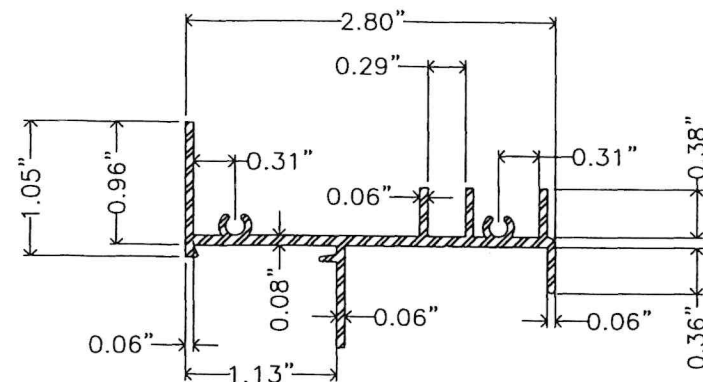


1 **FRAME HEAD & SILL**
6063-T6 ALLOY

2 **FRAME JAMB**
6063-T6 ALLOY




3A **GLAZING BEAD FOR CURVED AND COMBINATION CURVED & STRAIGHT FRAME WINDOWS**
6063-T6 ALLOY

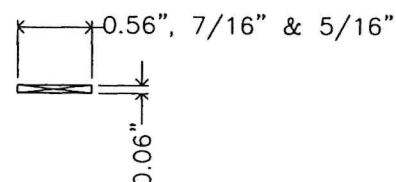


3A **SETTING BLOCK FOR**

10, 10A, 10B, 10C & 10D

COMPONENTS
N.T.S

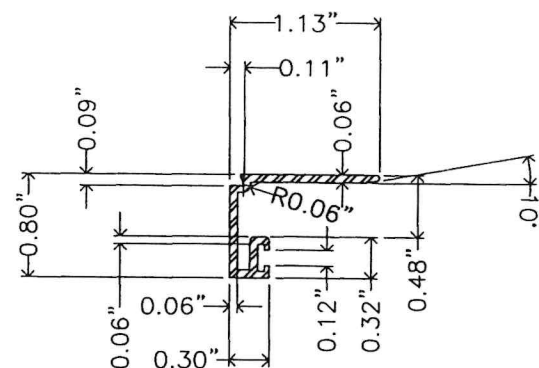

3 **GLAZING BEAD FOR FULLY STRAIGHT FRAME WINDOWS**
6063-T6 ALLOY

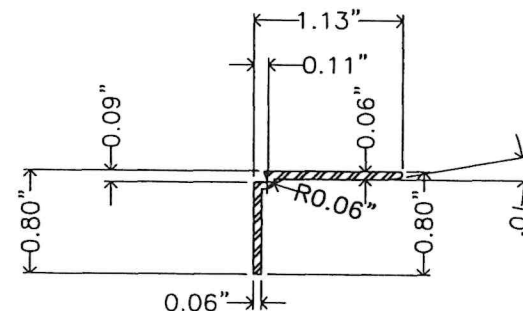


3B **GLAZING BEAD FOR STRAIGHT, CURVED AND COMBINATION CURVED & STRAIGHT FRAME WINDOWS ON INSULATED-LAMINATED GLASS**
6063-T6 ALLOY


BILL OF MATERIALS

ITEM #	DESCRIPTION	DIMENSIONS & REMARKS	MATERIAL
1	FRAME HEAD/SILL	(2) REQUIRED	6063-T6
2	FRAME JAMB	(2) REQUIRED	6063-T6
3	GLAZING BEAD FOR FULLY STRAIGHT FRAME WINDOWS	(4) REQUIRED	6063-T6
3A	GLAZING BEAD FOR CURVED AND COMBINATION CURVED/STRAIGHT FRAME WINDOWS	(4) REQUIRED	6063-T6
3B	GLAZING BEAD FOR STRAIGHT, CURVED AND COMBINATION CURVED/STRAIGHT FRAME WINDOWS ON INSULATED-LAMINATED GLASS	(4) REQUIRED	6063-T6
4	WEATHER STRIPING, ULTRAFAB E-271	(4) AT GLAZING BEAD	NEOPRENE
4A	WEATHER STRIPING SOLID RUBBER	(4) AT GLAZING BEAD	NEOPRENE
4B	WEATHER STRIPING 0.296" HEIGHT, SCHLEGEL SYSTEM, INC., Q375T190	(4) AT GLAZING BEAD	NEOPRENE
5	CORNER FRAME ASSEMBLY SCREWS	(2) #8 x 1" PH SMS REQ'D.	STEEL
6	DOW CORNING 995	-----	STRUCTURAL SILICONE
6A	DOW CORNING 795	-----	STRUCTURAL SILICONE
7	WHITE COLOR SILICONE AT FIXED PANEL FRAME AND FRAME CORNERS.	ALL AROUND (EXTERIOR)	SEALANT
8	1/4"Ø ULTRACON BY ELCO CONSTRUCTION PRODUCTS, TO POURED CONCRETE, HOLLOW BLOCK OR WOOD WALL REQ'D. (SEE SCHEDULE)	-----	CARBON STEEL
8A	1/4"Ø ITW BUILDDEX TEK SCREW TO METAL (SEE SCHEDULE)	-----	STEEL
9	0.145" HEIGHT BUMPER SPACER, CUT FROM 3/8"Ø SPHERE, CLEAR 3" FROM CORNERS MAX. AND 12" O.C. (MAX.) AT MID-GLASS BITE ELEVATION	FRANK LOWE RUBBEL, GASKET TLB-28, CLEAR.	SILICONE
9A	0.211" HEIGHT BUMPER SPACER, CUT FROM 3/8"Ø SPHERE, CLEAR 3" FROM CORNERS MAX. AND 12" O.C. (MAX.) AT MID-GLASS BITE ELEVATION	FRANK LOWE RUBBEL, GASKET FLB-38, CLEAR.	SILICONE
10	0.590" (9/16" NOMINAL) LAMINATED GLASS W/ 1/4" H.S. GLASS + 0.090" SENTRYGLAS® INTERLAYER + 1/4" H.S. GLASS	INTERLAYER BY: KURARAY AMERICA, INC.	GLASS
10A	0.484" (7/16" NOMINAL) LAMINATED GLASS W/ 3/16" H.S. GLASS + 0.090" TROSIFOL PVB. INTERLAYER + 3/16" H.S. GLASS	INTERLAYER BY: KURARAY AMERICA, INC.	GLASS
10B	0.326" (5/16" NOMINAL) LAMINATED GLASS W/ 1/8" H.S. GLASS + 0.090" TROSIFOL PVB. INTERLAYER + 1/8" H.S. GLASS	INTERLAYER BY: KURARAY AMERICA, INC.	GLASS
10C	0.6875" (11/16" NOMINAL) INSULATED-LAMINATED GLASS W/ 1/8" TEMPERED GLASS OUTBOARD + 1/4" ARGON SPACER + 1/8" H.S. GLASS + 0.090" TROSIFOL PVB. INTERLAYER + 1/8" H.S. GLASS	INTERLAYER BY: KURARAY AMERICA, INC.	GLASS
10D	0.875" (7/8" NOMINAL) INSULATED-LAMINATED GLASS W/ 3/16" TEMPERED GLASS OUTBOARD + 1/4" ARGON SPACER + 3/16" H.S. GLASS + 0.090" TROSIFOL PVB. INTERLAYER + 3/16" H.S. GLASS	INTERLAYER BY: KURARAY AMERICA, INC.	GLASS
11	SETTING BLOCK	1/16"x9/16" OR 7/16" OR 5/16" FOR 10, 10A, 10B, 10C & 10D	SILICONE

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

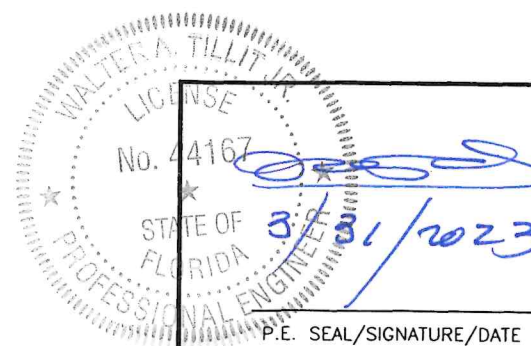


SERIES 21000 HIGH IMPACT FIXED GLASS WINDOWS				DRAWN BY: W.H	
 290 WEST 78 ROAD HIALEAH, FL 33014 PHONE: (305) 558-8103 FAX: (305) 558-6665 www.generalimpact.com				03/23/2023 DATE	
				23-041 DRAWING No	
REV. NO	DESCRIPTION	DATE	REV. NO	DESCRIPTION	DATE
1	OLD 20-272	03/23/23	3		
2			4		
				SHEET 2 OF 9	

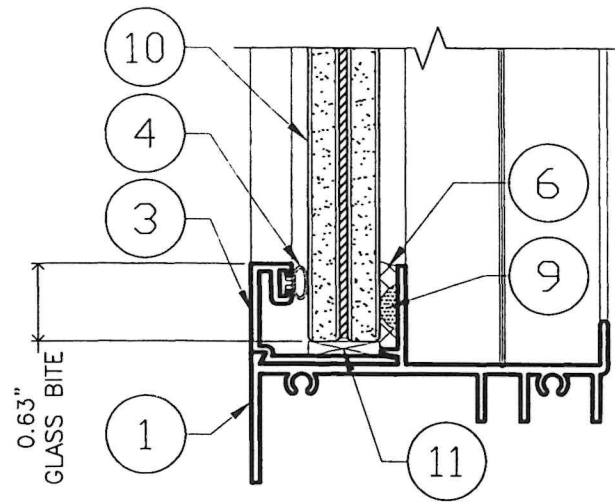


GLAZING DETAIL FOR

10 w/ 3

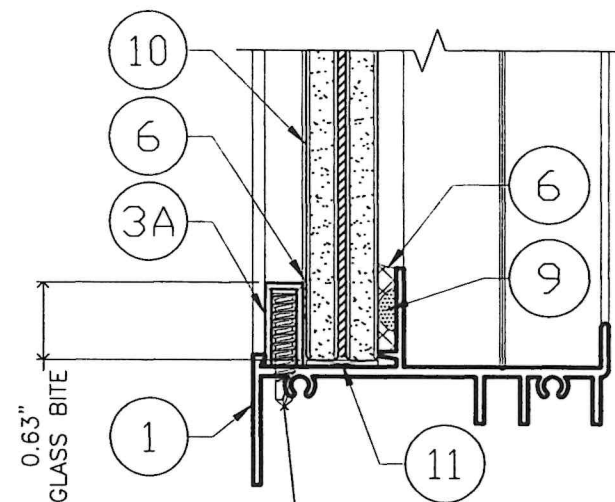


GLAZING DETAIL FOR

10 w/ 3A

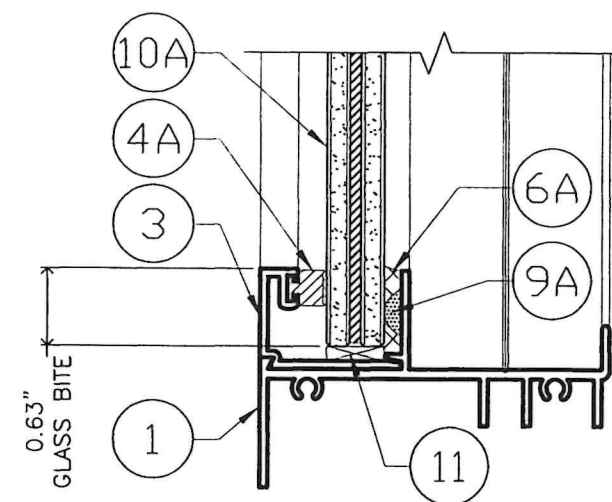


GLAZING DETAIL FOR

10A w/ 3

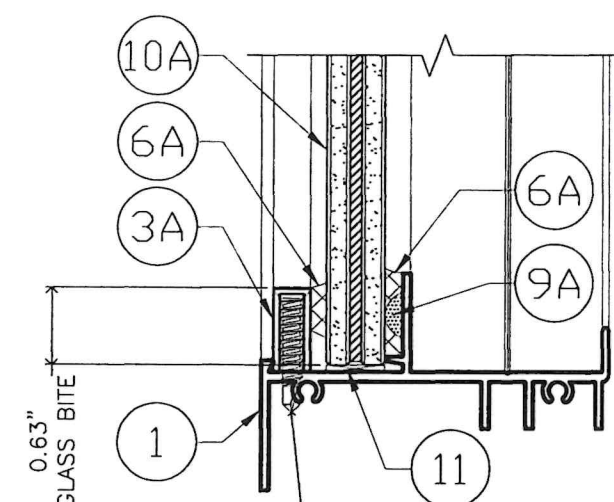


GLAZING DETAIL FOR

10A w/ 3A

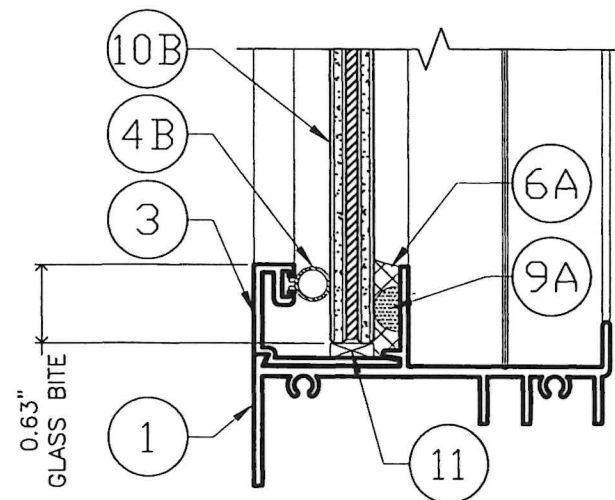


GLAZING DETAIL FOR

10B w/ 3

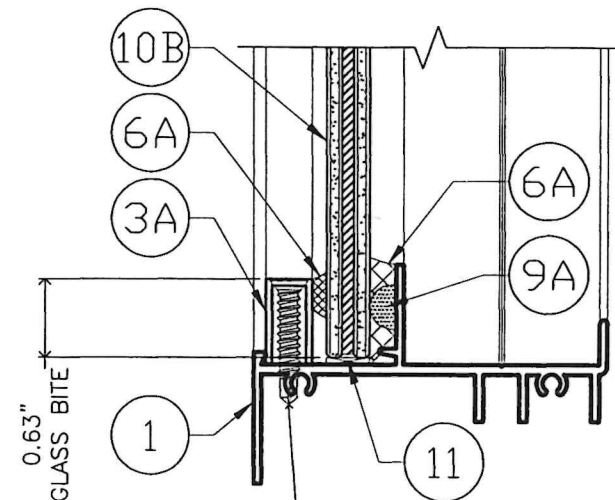


GLAZING DETAIL FOR

10B w/ 3A

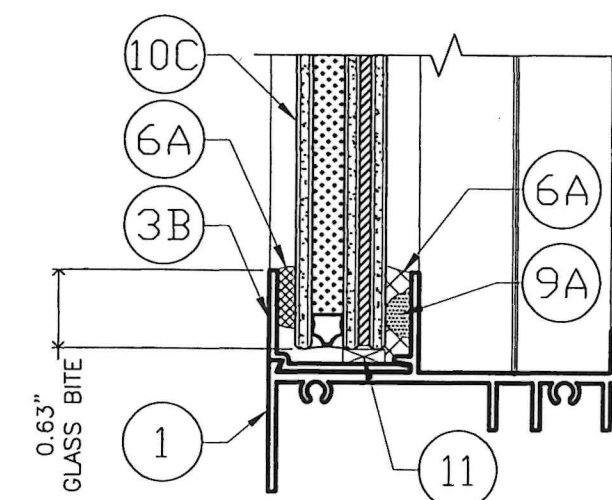

GLAZING DETAIL FOR


10C w/ 3B

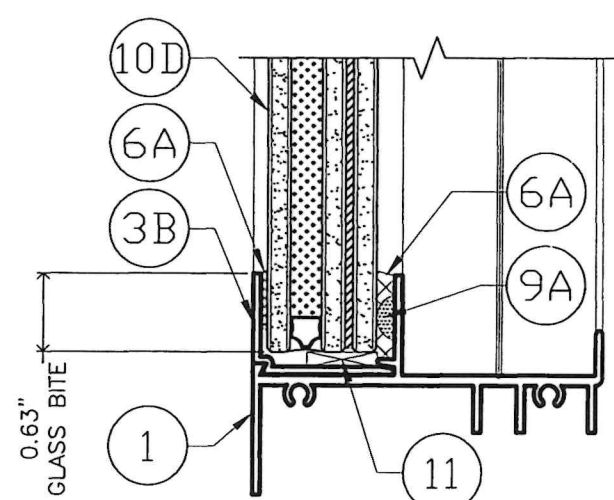

GLAZING DETAIL FOR

10D w/ 3B

GLAZING DETAILS
N.T.S

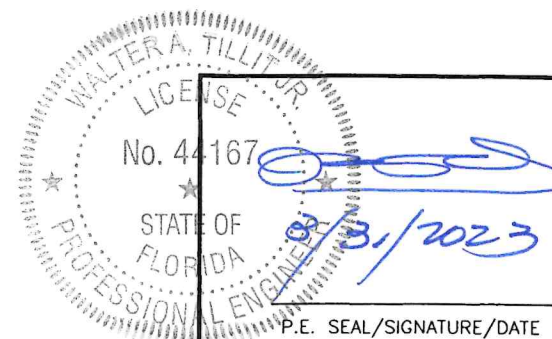

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

© 2023 TILTECO INC.

TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr., P.E.
FLORIDA Lic. 44167

SERIES 21000 HIGH IMPACT FIXED
GLASS WINDOWS



290 WEST 78 ROAD
HALEAH, FL 33014
PHONE: (305) 558-8103
FAX: (305) 558-6665
www.generalimpact.com


DRAWN BY:
W.H

03/23/2023
DATE


23-041
DRAWING No

SHEET 2A OF 9


REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-272	03/23/23	3		
2			4		

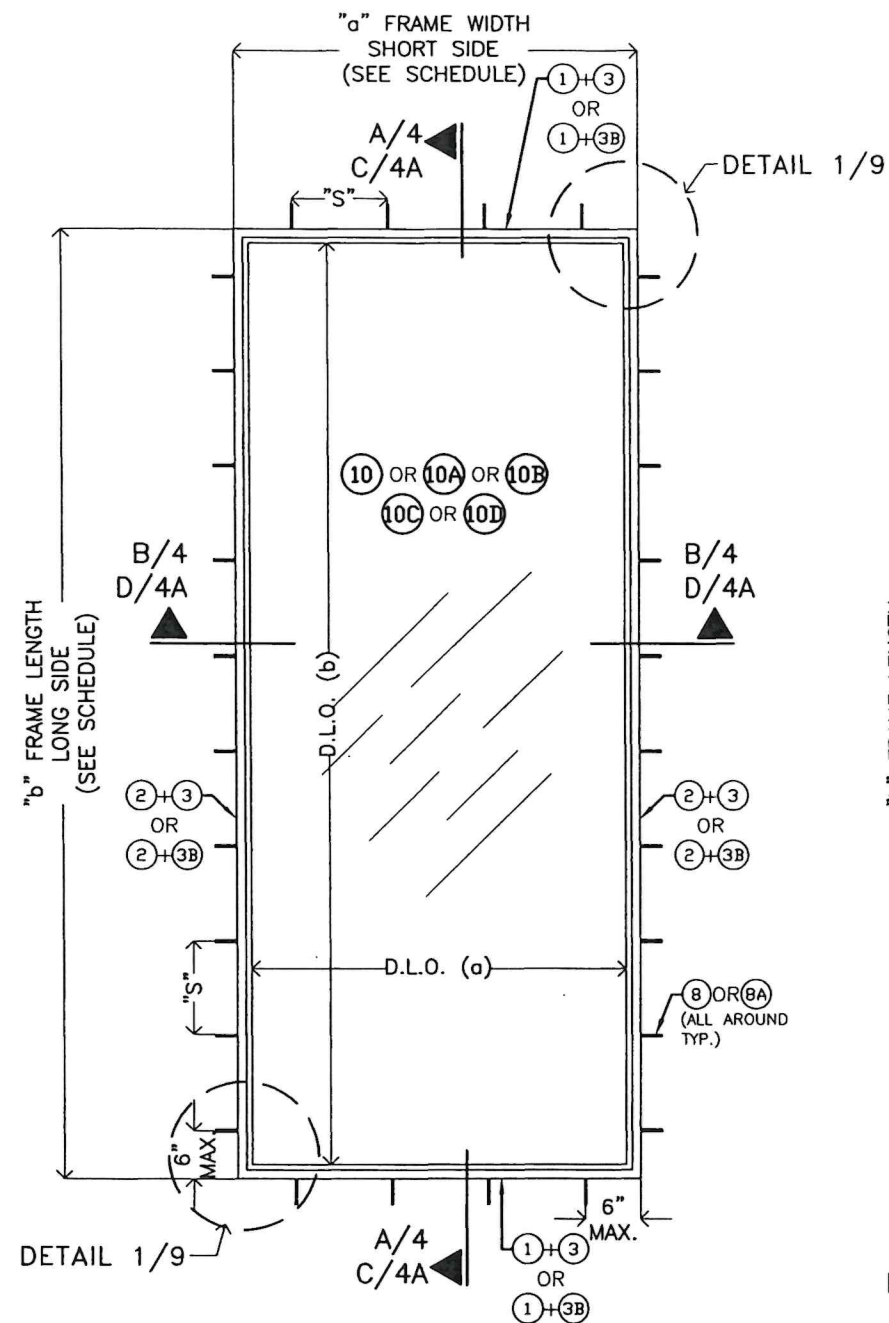

CASE 1: RECTANGULAR
N.T.S

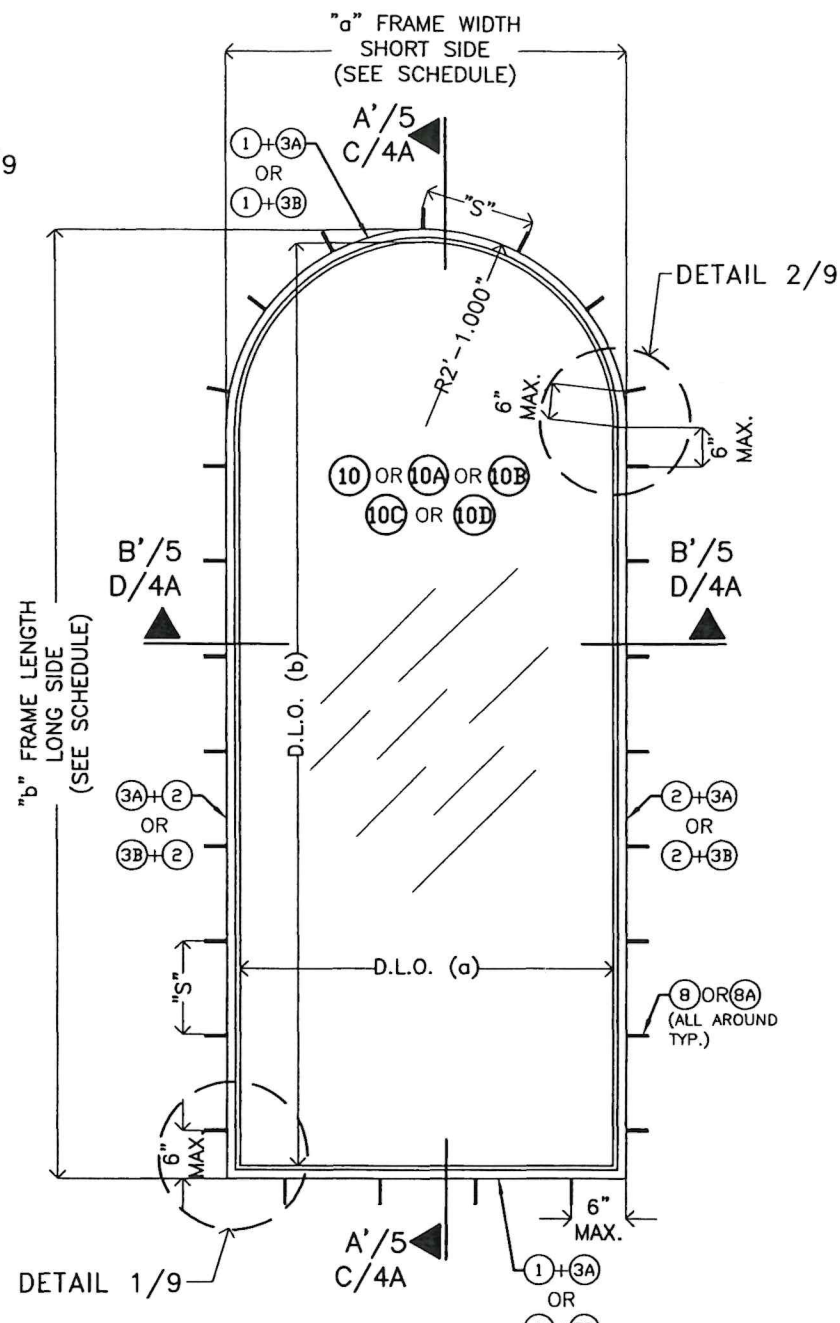

CASE 2: HALF ROUND TOP
N.T.S

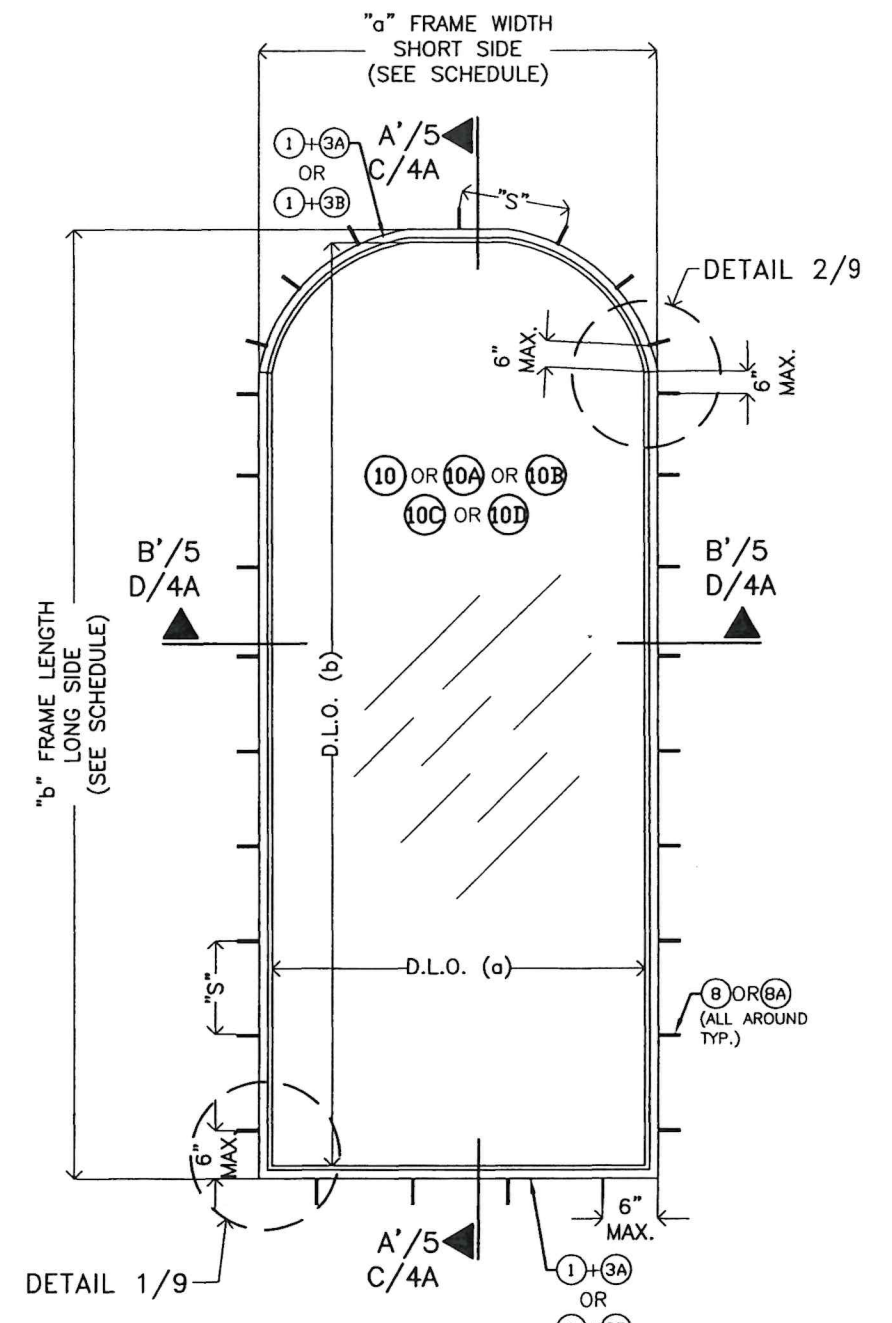


CASE 3: EYEBROW
N.T.S

"S" = MAX. ANCHOR SPACING
(SEE SCHEDULE ON SHEET 9)

FOR "a" FRAME WIDTH (SHORT SIDE), "b" FRAME LENGTH (LONG SIDE) AND MAX. D.L.O. (a) AND MAX. D.L.O. (b) SEE SCHEDULES ON SHEETS 6, 7 & 8.

TYPICAL EXTERIOR ELEVATIONS FOR SERIES 21000 HIGH IMPACT FIXED & INSULATED LAMINATED GLASS WINDOW
(SEE NOTE * ON SHEET 1)

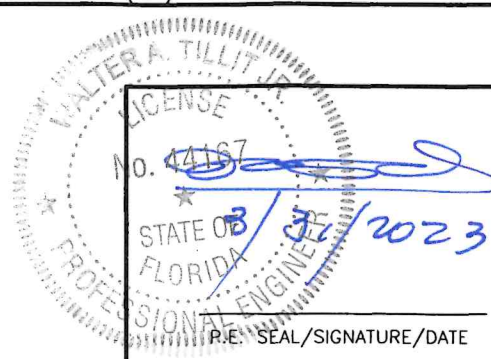


FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)



© 2023 TILTECO INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr., P.E.
FLORIDA Lic. 44167

SERIES 21000 HIGH IMPACT FIXED GLASS WINDOWS					
			290 WEST 78 ROAD HIALEAH, FL 33014 PHONE: (305) 558-8103 FAX: (305) 558-6665 www.generalimpact.com		
			DRAWN BY: W.H 03/23/2023 DATE 23-041 DRAWING No		
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-272	03/23/23	3		
2			4		


1/8" MINIMUM WALL THICKNESS
ALUMINUM ALLOY 6063-T5 MIAMI
DADE COUNTY APPROVED MULLION
(UNDER SEPARATE APPROVAL) OR
STEEL MEMBER BY OTHERS SHALL
CONFORM TO ASTM A500, A653
OR A36 WITH 12 GA (0.106")
MINIMUM WALL THICKNESS.

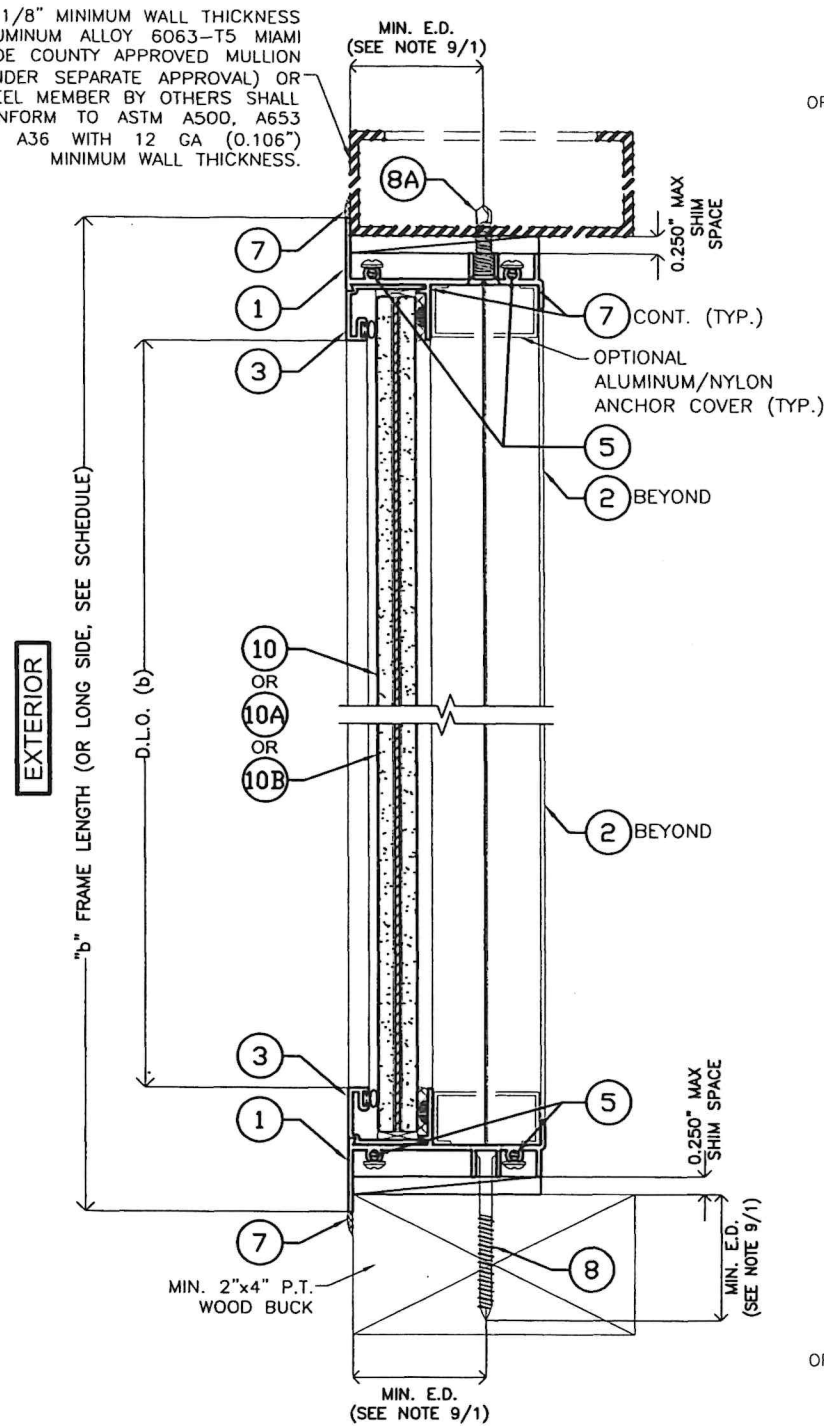

SECTION A-A
N.T.S

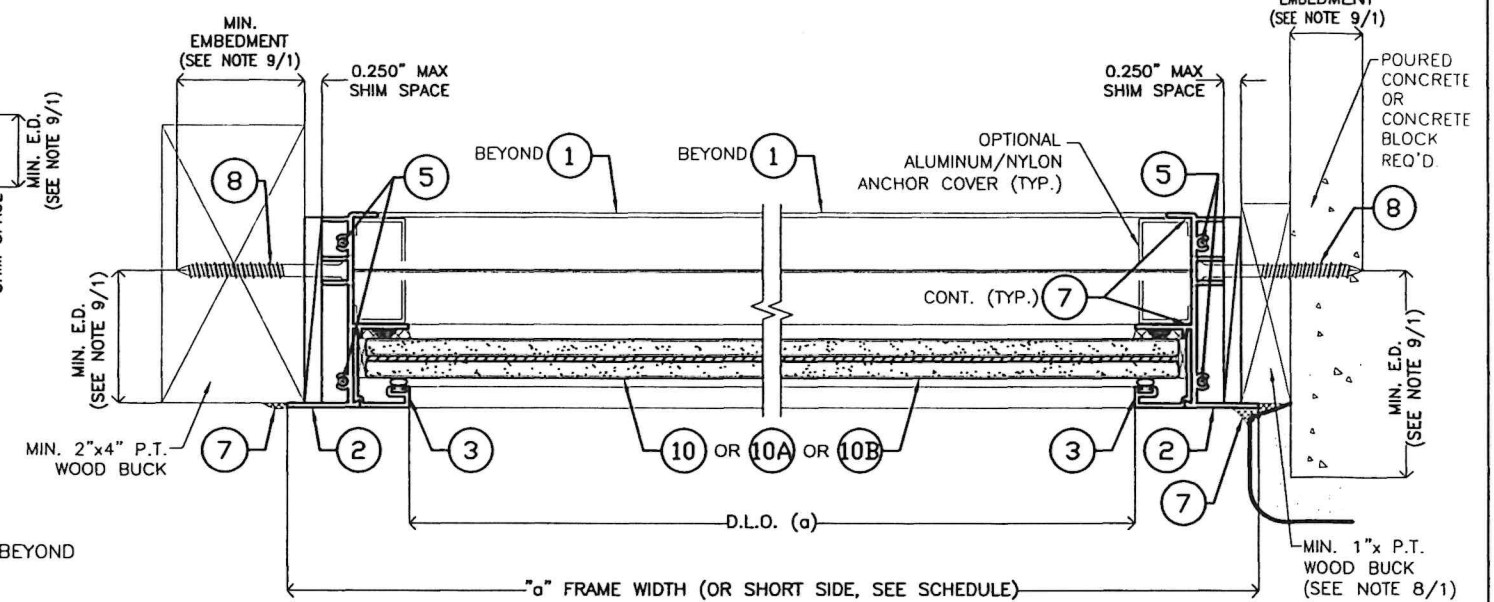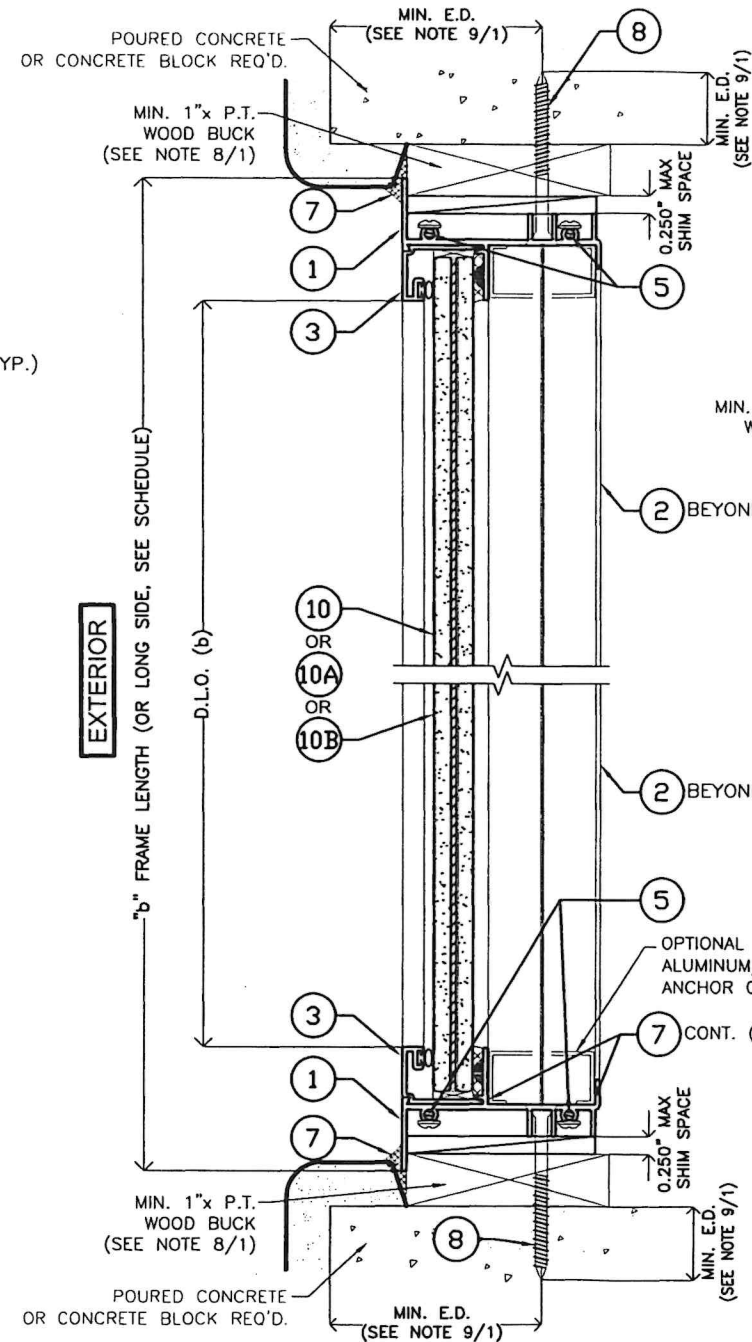

SECTION B-B
N.T.S

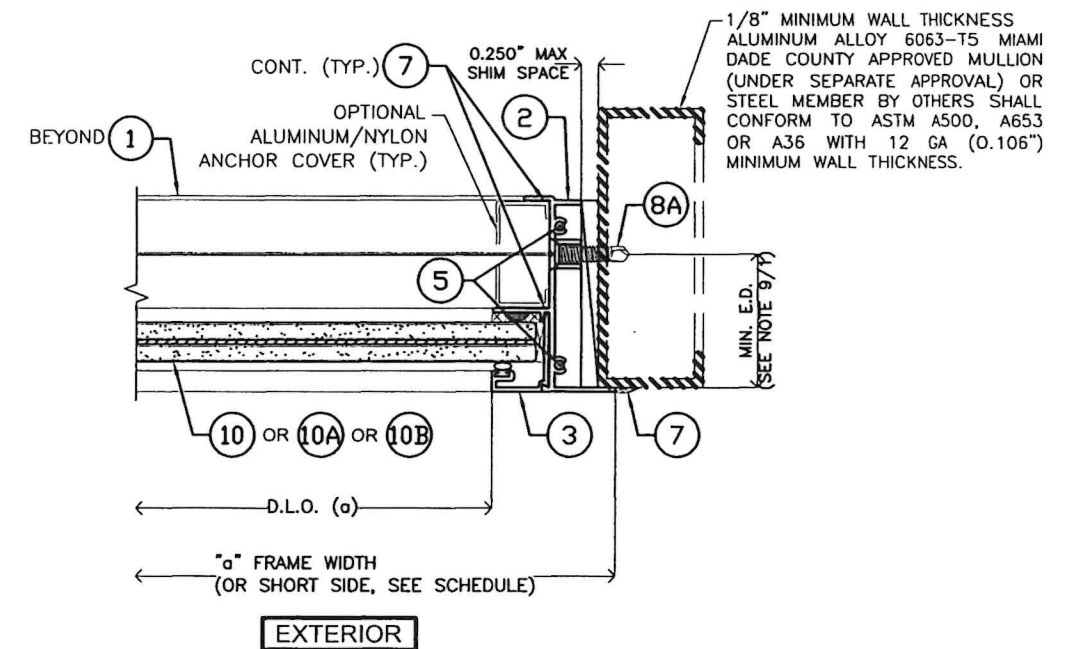


FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

WALTER A. TILLIT, JR.
LICENSE
No. 44167
STATE OF FLORIDA
PROFESSIONAL ENGINEER
P.E. SEAL/SIGNATURE/DATE



© 2023 TILTECO INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone: (305) 871-1530 Fax: (305) 871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT, JR., P.E.
FLORIDA Lic. 44167

SERIES 21000 HIGH IMPACT FIXED GLASS WINDOWS						DRAWN BY: W.H	
 290 WEST 78 ROAD HIALEAH, FL 33014 PHONE: (305) 558-8103 FAX: (305) 558-6665 www.generalimpact.com						03/23/2023 DATE	
						23-041 DRAWING No	
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE	SHEET 4 OF 9	
1	OLD 20-272	03/23/23	3				
2			4				


1/8" MINIMUM WALL THICKNESS
ALUMINUM ALLOY 6063-T5 MIAMI
DADE COUNTY APPROVED MULLION
(UNDER SEPARATE APPROVAL) OR
STEEL MEMBER BY OTHERS SHALL
CONFORM TO ASTM A500, A653
OR A36 WITH 12 GA (0.106")
MINIMUM WALL THICKNESS.

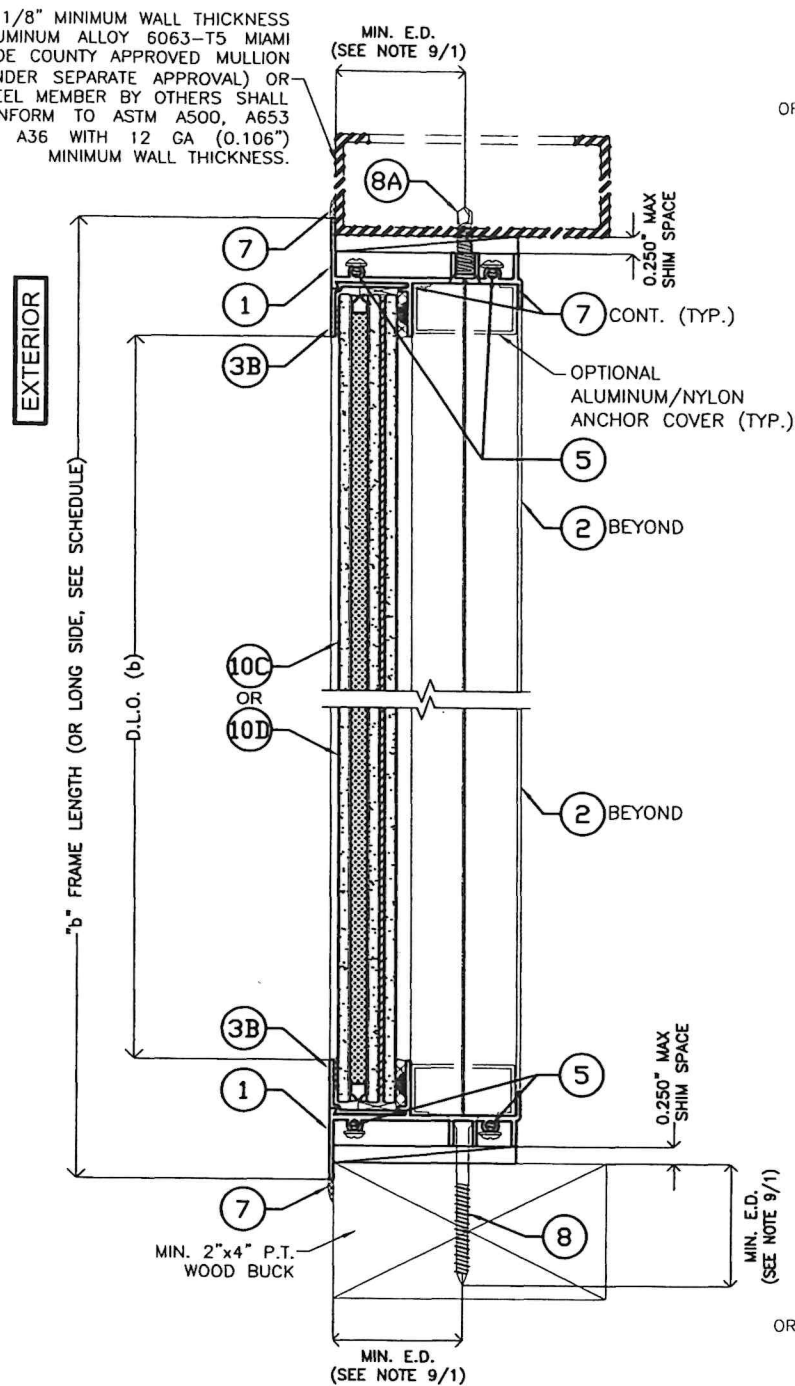

SECTION C-C
SCALE: 3/8"=1"

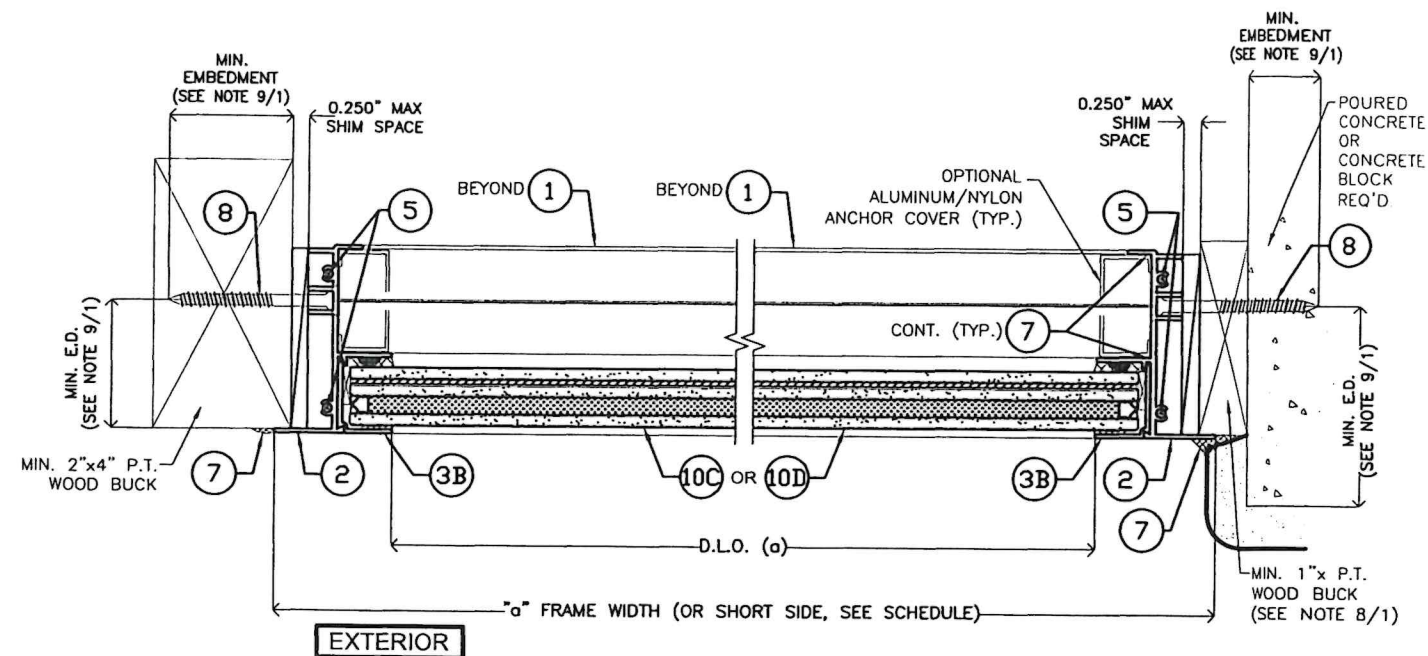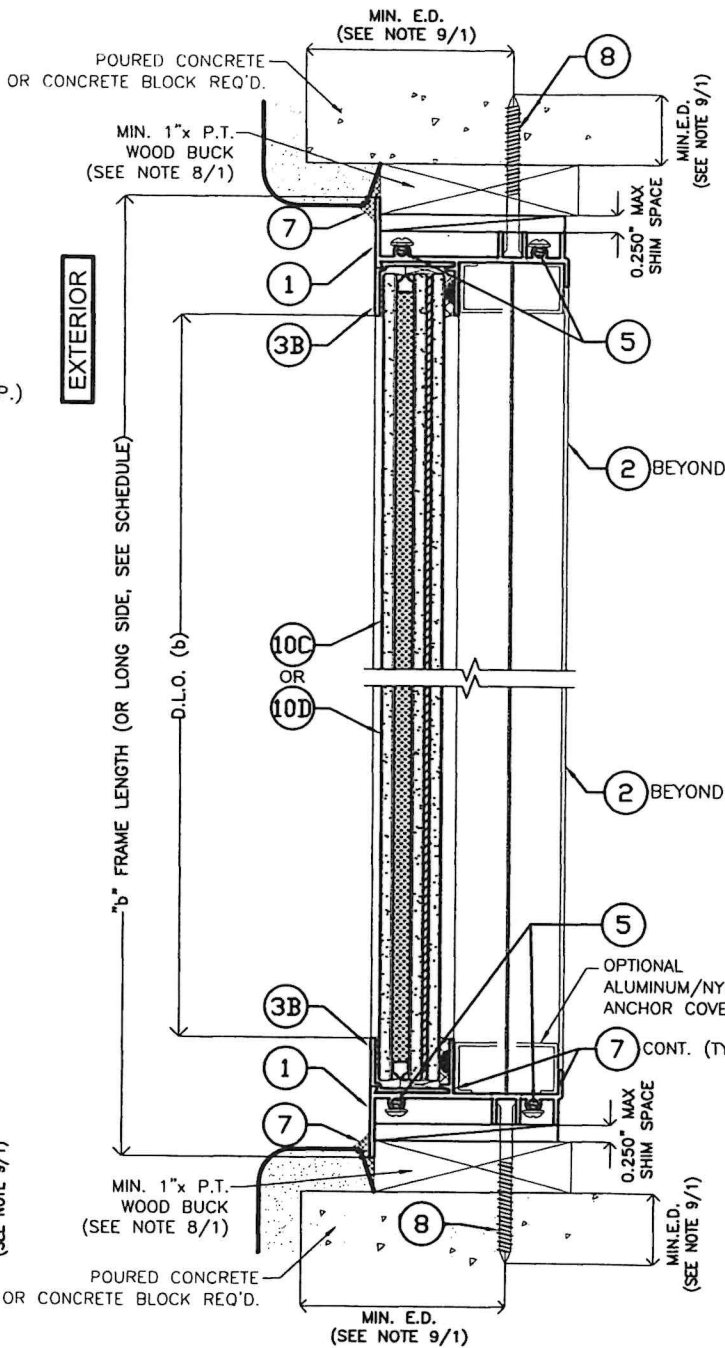

SECTION D-D
SCALE: 3/8"=1"




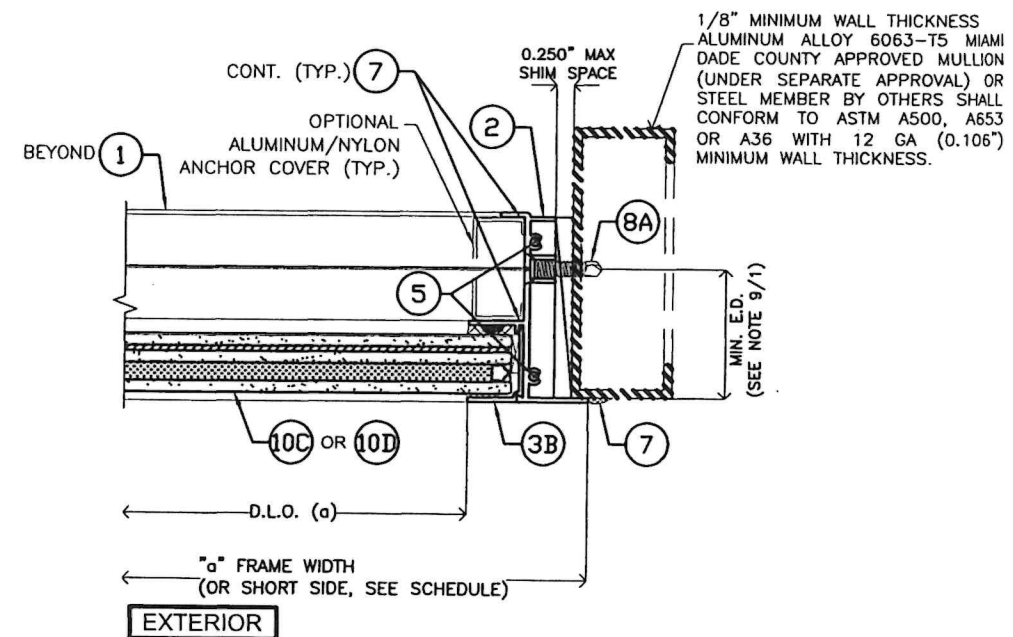


FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

WALTER A. TILLIT JR.
LICENSE
No. 44167
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
3/31/2023
P.E. SEAL/SIGNATURE/DATE

© 2023 TILTECO INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT JR., P.E.
FLORIDA Lic. 44167

SERIES 21000 HIGH IMPACT FIXED GLASS WINDOWS						DRAWN BY: W.H	
 290 WEST 78 ROAD HIALEAH, FL 33014 PHONE: (305) 558-8103 FAX: (305) 558-6665 www.generalimpact.com						03/23/2023 DATE	
						23-041 DRAWING No	
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE	SHEET 4A OF 9	
1	OLD 20-272	03/23/23	3				
2			4				

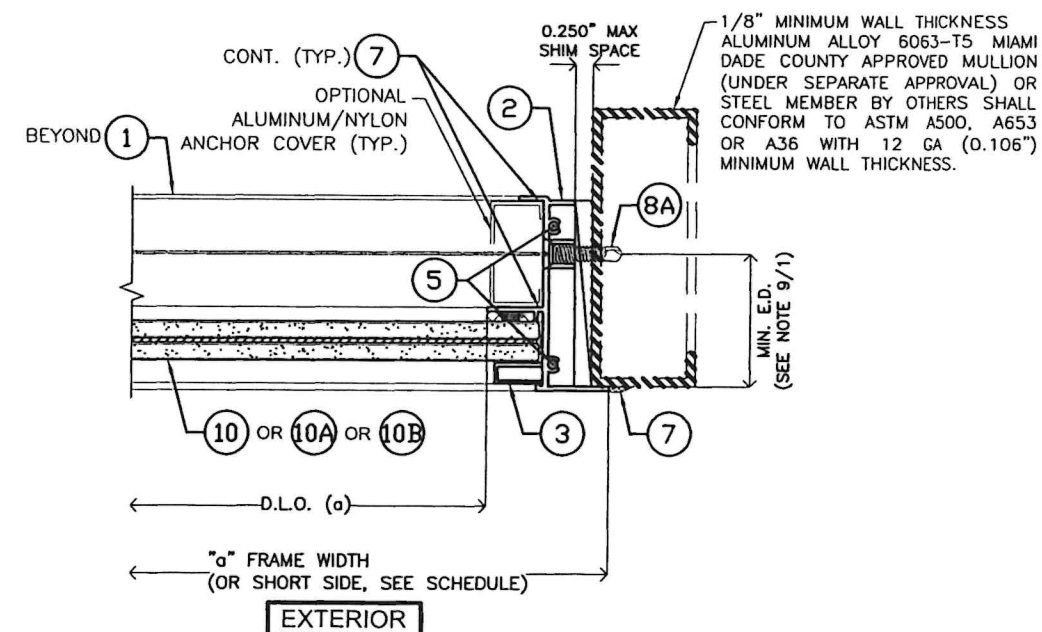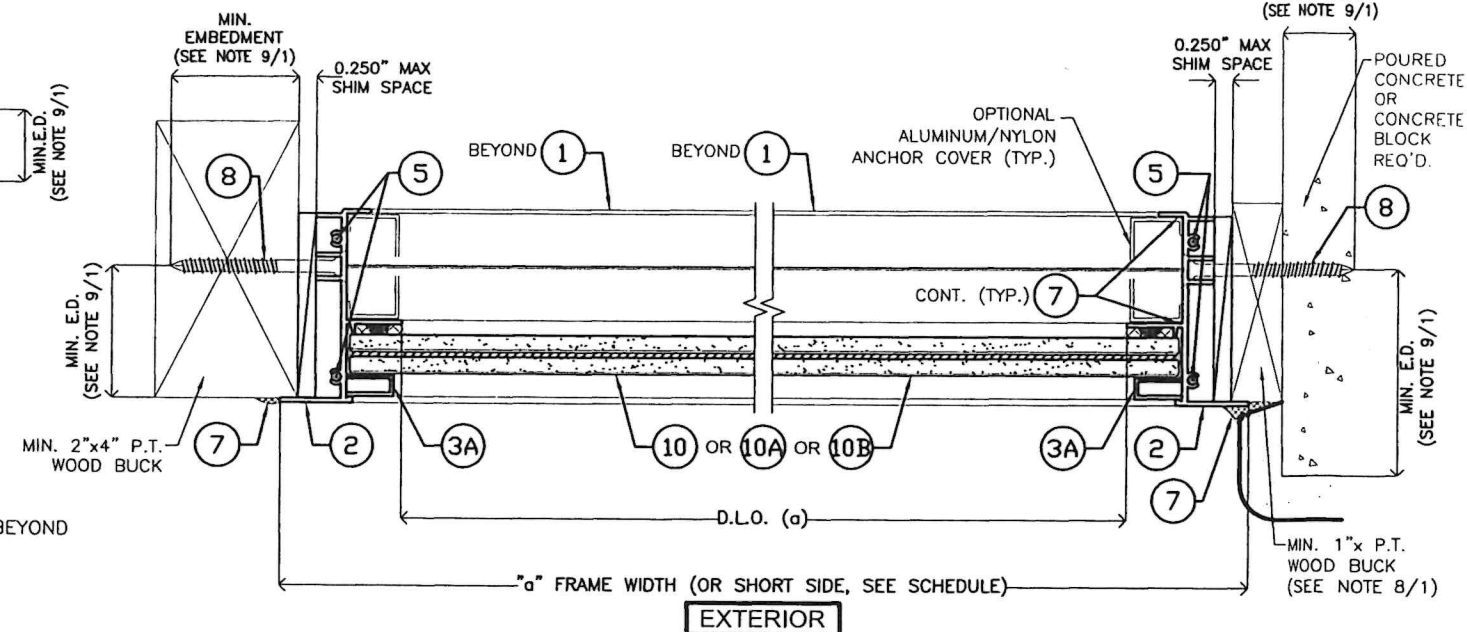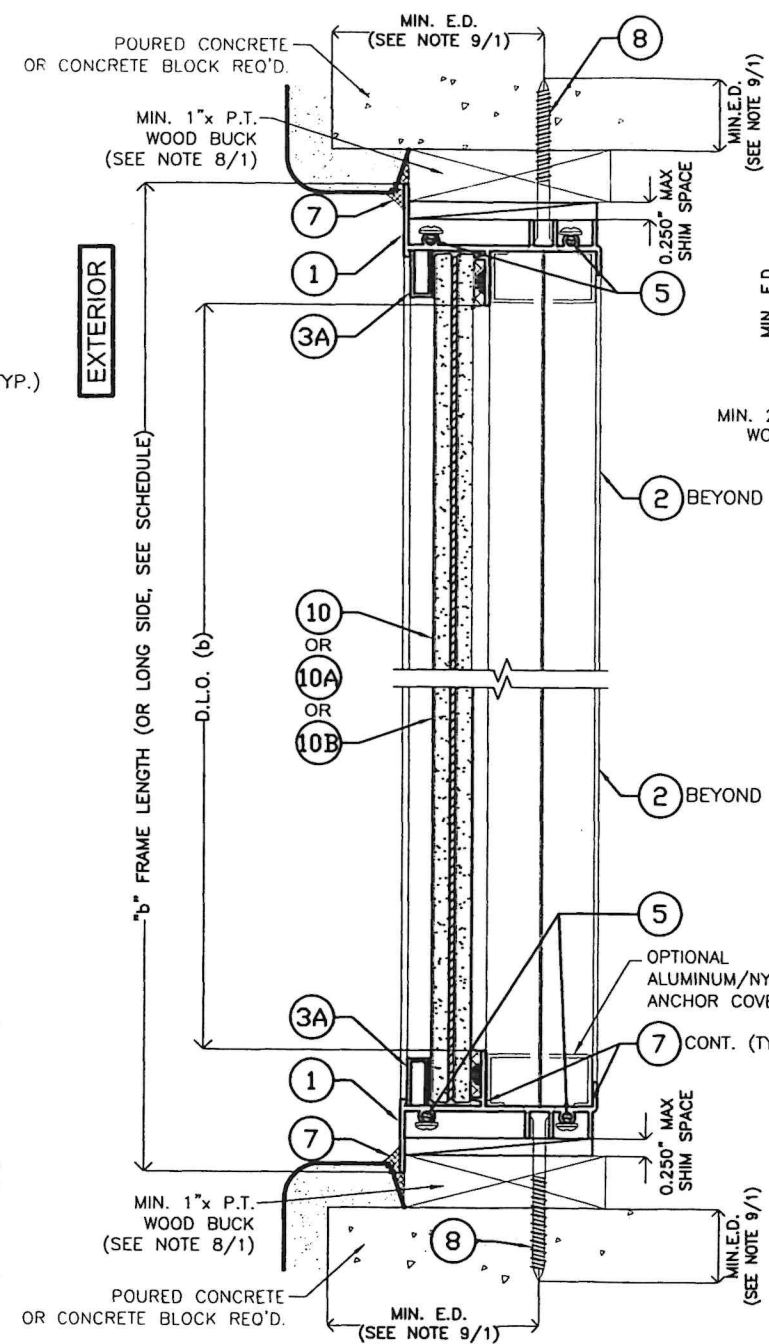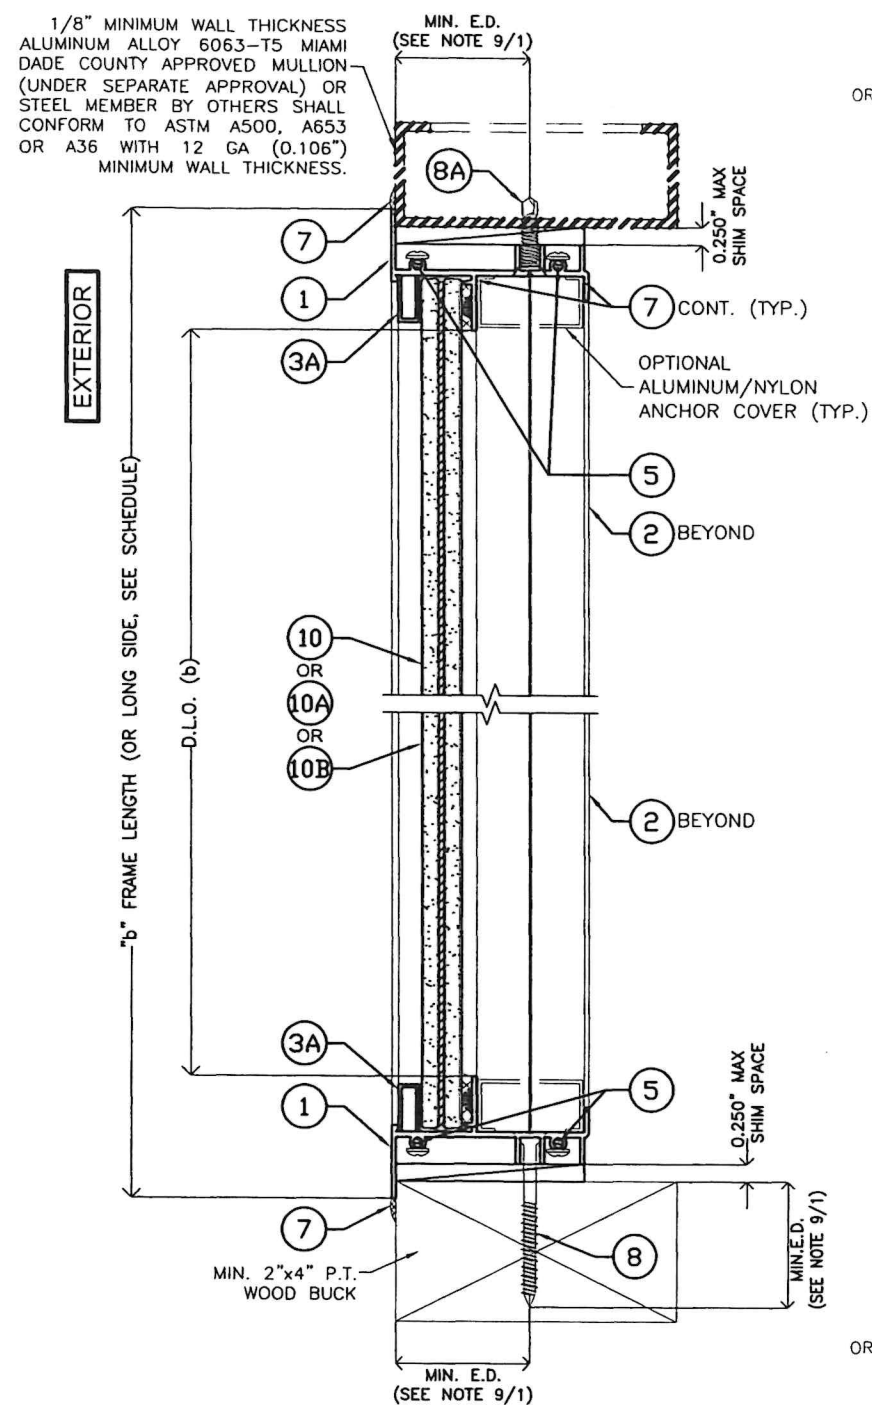

SECTION A'-A'

SCALE: 3/8"=1"

SECTION B'-B'
SCALE: 3/8"=1"

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

© 2023 TILTECO INC.

TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th, St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tiltenco@aol.com
CA-0006719
WALTER A. TILLIT Jr., P.E.
FLORIDA Lic. 44167

SERIES 21000 HIGH IMPACT FIXED
GLASS WINDOWS



GENERAL
IMPACT GLASS & WINDOW
The Clear Solution

290 WEST 78 ROAD
HIALEAH, FL 33014
PHONE: (305) 558-8103
FAX: (305) 558-6665
www.generalimpact.com

DRAWN BY:
W.H

03/23/2023
DATE

23-041
DRAWING No

SHEET 5 OF 9

REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-272	03/23/23	3		
2			4		

MAXIMUM FRAME WIDTH "a" AND LENGTH "b" VERSUS DESIGN PRESSURE

RATING "W" SCHEDULE VALID FOR ALL SHAPES WITH GLASS

10

"a"	"b"	W psf +	W psf -
18"	18'	130	154
	24'	130	154
	30'	130	154
	36'	130	154
	42'	130	154
	48'	130	154
	54'	130	154
	60'	130	154
	66'	130	154
	72'	130	154
	78'	130	154
	84'	130	154
	90'	130	154
	96'	130	154
	102'	130	154
	108'	130	154
	114'	130	154
	120'	130	154
	126'	130	154
	132'	130	154

"a"	"b"	W psf +	W psf -
24"	24'	130	154
	30'	130	154
	36'	130	154
	42'	130	154
	48'	130	154
	54'	130	154
	60'	130	154
	66'	130	154
	72'	130	154
	78'	130	154
	84'	130	154
	90'	130	154
	96'	130	154
	102'	130	154
	108'	130	154
	114'	130	154
	120'	130	154
	126'	130	154
	132'	130	154
	138'	130	154

"a"	"b"	W psf +	W psf -
30"	30'	130	154
	36'	130	154
	42'	130	154
	48'	130	154
	54'	130	154
	60'	130	154
	66'	130	154
	72'	130	154
	78'	130	154
	84'	130	154
	90'	130	154
	96'	130	154
	102'	130	154
	108'	130	154
	114'	130	154
	120'	130	154
	126'	130	154
	132'	130	154
	138'	130	154
	144'	130	154


"a"	"b"	W psf +	W psf -
36"	36'	130	154
	42'	130	154
	48'	130	154
	54'	130	154
	60'	130	154
	66'	130	154
	72'	130	154
	78'	130	154
	84'	130	154
	90'	130	154
	96'	130	154
	102'	130	154
	108'	130	154
	114'	130	154
	120'	130	154
	126'	130	154
	132'	130	154
	138'	130	154
	144'	130	154
	150'	130	154

"a"	"b"	W psf +	W psf -
42"	42'	130	154
	48'	130	154
	54'	130	154
	60'	130	154
	66'	130	154
	72'	130	154
	78'	130	154
	84'	130	154
	90'	130	154
	96'	130	154
	102'	130	154
	108'	130	154
	114'	130	154
	120'	130	154
	126'	130	154
	132'	130	154
	138'	130	154
	142'	130	154
	48'	130	154
	54'	130	154

"a"	"b"	W psf +	W psf -
54"	54'	120.3	142.5
	60'	120.3	142.5
	66'	120.3	142.5
	72'	120.3	142.5
	78'	120.3	142.5
	84'	120.3	142.5
	90'	120.3	142.5
	96'	120.3	142.5
	102'	120.3	142.5
	108'	120.3	142.5
	111'	120.3	139
	60'	108.3	128.3

MAXIMUM DAY LIGHT OPENING
(D.L.O.) FOR A GIVEN COMPONENT AT
EACH END OF GLASS

SIDE	COMPONENTS @ EACH END OF GLASS	MAX. DAY LIGHT OPENING (D.L.O.) Formula
MAX. D.L.O. (a) (SHORT SIDE)	(2)+(3), (2)+(3) OR (2)+(3A), (2)+(3A) OR (2)+(3B), (2)+(3B)	"a"-3.526"
MAX. D.L.O. (b) (LONG SIDE)	(1)+(3), (1)+(3) OR (1)+(3A), (1)+(3A) OR (1)+(3B), (1)+(3B)	"b"-3.526"

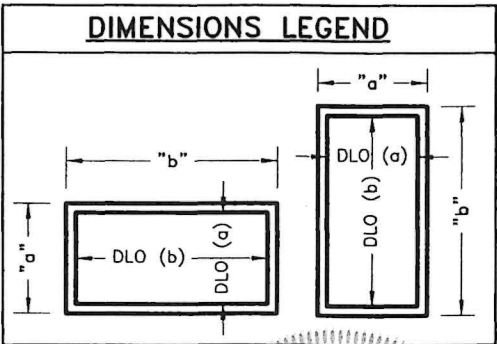

WALTER A. TILLIT JR.
LICENSE
No. 44167
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
P.E. SEAL/SIGNATURE/DATE

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

© 2023 TILTECO INC.

TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr., P.E.
FLORIDA Lic. 44167

SERIES 21000 HIGH IMPACT FIXED GLASS WINDOWS

GENERAL
IMPACT GLASS & WINDOWS
The Clear Solution

290 WEST 78 ROAD
HIALEAH, FL 33014
PHONE: (305) 558-8103
FAX: (305) 558-6665
www.generalimpact.com

DRAWN BY:
W.H

03/23/2023
DATE

23-041
DRAWING No

SHEET 6 OF 9

REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-272	03/23/23	3		
2			4		

MAXIMUM FRAME WIDTH "a" AND LENGTH "b" VERSUS DESIGN PRESSURE
RATING "W" SCHEDULE VALID FOR ALL SHAPES WITH GLASS (10A) & (10D)

"a"	"b"	W psf +	W psf -
18'	18'	90	90
	24'	90	90
	30'	90	90
	36'	90	90
	42'	90	90
	48'	90	90
	54'	90	90
	60'	90	90
	66'	90	90
	72'	90	90
	78'	90	90
	84'	90	90
	90'	90	90
	96'	90	90
	102'	90	90
	108'	90	90
	114'	90	90
	120'	90	90
	126'	90	90
	132'	90	90
	138'	90	90
	144'	90	90
	150'	90	90
	156'	90	90
	162'	90	90
	168'	90	90
	174'	90	90
	180'	90	90

"a"	"b"	W psf +	W psf -
24'	24'	90	90
	30'	90	90
	36'	90	90
	42'	90	90
	48'	90	90
	54'	90	90
	60'	90	90
	66'	90	90
	72'	90	90
	78'	90	90
	84'	90	90
	90'	90	90
	96'	90	90
	102'	90	90
	108'	90	90
	114'	90	90
	120'	90	90
	126'	90	90
	132'	90	90
	138'	90	90
	144'	90	90
	150'	90	90
	156'	90	90
	162'	90	90
	168'	90	90
	174'	90	90
	180'	90	90
	186'	90	90
	191'	90	90

"a"	"b"	W psf +	W psf -
30'	30'	90	90
	36'	90	90
	42'	90	90
	48'	90	90
	54'	90	90
	60'	90	90
	66'	90	90
	72'	90	90
	78'	90	90
	84'	90	90
	90'	90	90
	96'	90	90
	102'	90	90
	108'	90	90
	114'	90	90
	120'	90	90
	126'	90	90
	132'	90	90
	138'	90	90
	144'	90	90
	150'	90	90
	153'	90	90
	156'	90	90
	162'	90	90
	168'	90	90
	174'	90	90
	179	90	90


"a"	"b"	W psf +	W psf -
36'	36'	90	90
	42'	90	90
	48'	90	90
	54'	90	90
	60'	90	90
	66'	90	90
	72'	90	90
	78'	90	90
	84'	90	90
	90'	90	90
	96'	90	90
	102'	90	90
	108'	90	90
	114'	90	90
	120'	90	90
	126'	90	90
	132'	90	90
	138'	90	90
	144'	90	90
	150'	90	90
	152'	90	90

"a"	"b"	W psf +	W psf -
42'	42'	90	90
	48'	90	90
	54'	90	90
	60'	90	90
	66'	90	90
	72'	90	90
	78'	90	90
	84'	90	90
	90'	90	90
	96'	90	90
	102'	90	90
	108'	90	90
	114'	90	90
	120'	90	90
	126'	90	90
	130'	90	90
	48'	90	90
	54'	90	90
	60'	90	90
	66'	90	90
	72'	90	90
	78'	90	90
	84'	90	90
	90'	90	90
	95'	90	90
	96'	90	90
	102'	90	90
	108'	90	90
	114'	90	90

"a"	"b"	W psf +	W psf -
54'	54'	83.3	83.3
	60'	83.3	83.3
	66'	83.3	83.3
	72'	83.3	83.3
	78'	83.3	83.3
	84'	83.3	83.3
	90'	83.3	83.3
	96'	83.3	83.3
	101'	83.3	83.3
	60'	75	75
60'	66'	75	75
	72'	75	75
	76'	75	75
	78'	75	75
	84'	75	75
	90'	75	75
	66'	68.2	68.2
	72'	68.2	68.2
66'	76'	68.2	68.2
	78'	68.2	68.2
	83'	68.2	68.2
	72'	62.5	62.5
72'	76'	62.5	62.5

MAXIMUM DAY LIGHT OPENING (D.L.O.) FOR A GIVEN COMPONENT AT EACH END OF GLASS

SIDE	COMPONENTS @ EACH END OF GLASS	MAX. DAY LIGHT OPENING
		(D.L.O.) Formula
MAX. D.L.O. (a) (SHORT SIDE)	(2)+(3), (2)+(3) OR (2)+(3A), (2)+(3A) OR (2)+(3B), (2)+(3B)	"a" - 3.526"
MAX. D.L.O. (b) (LONG SIDE)	(1)+(3), (1)+(3) OR (1)+(3A), (1)+(3A) OR (1)+(3B), (1)+(3B)	"b" - 3.526"

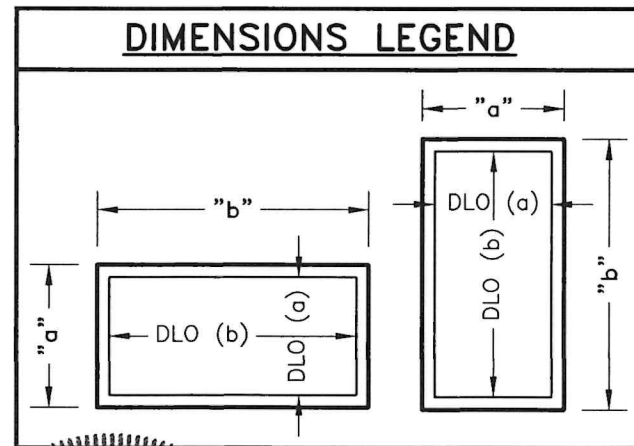

WALTER A. TILLIT JR.
 LICENSE
 No. 44167
 STATE OF FLORIDA
 PROFESSIONAL ENGINEER
 P.E. SEAL/SIGNATURE/DATE

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

© 2023 TILTECO INC.

TILTECO INC.
 TILLIT TESTING & ENGINEERING COMPANY
 6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33166
 Phone : (305)871-1530 . Fax : (305)871-1531
 e-mail: tiltco@aol.com
 CA-0006719
 WALTER A. TILLIT Jr., P.E.
 FLORIDA Lic. 44167

SERIES 21000 HIGH IMPACT FIXED GLASS WINDOWS



290 WEST 78 ROAD
 HIALEAH, FL 33014
 PHONE: (305) 558-8103
 FAX: (305) 558-6885
 www.generalimpact.com

DRAWN BY: W.H

03/23/2023
DATE

23-041
DRAWING No

REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-272	03/23/23	3		
2			4		

SHEET 7 OF 9

MAXIMUM FRAME WIDTH "a" AND LENGTH "b" VERSUS DESIGN PRESSURE
RATING "W" SCHEDULE VALID FOR ALL SHAPES WITH GLASS 10B & 10C

"a"	"b"	W psf +	W psf -
18'	18'	75	75
	24'	75	75
	30'	75	75
	36'	75	75
	42'	75	75
	48'	75	75
	54'	75	75
	60'	75	75
	66'	75	75
	72'	75	75
	78'	75	75
	84'	75	75
	90'	75	75
	96'	75	75
	102'	75	75
	108'	75	75
	114'	75	75
	120'	75	75
	126'	75	75
	132'	75	75
	138'	75	75


"a"	"b"	W psf +	W psf -
24'	24'	75	75
	30'	75	75
	36'	75	75
	42'	75	75
	48'	75	75
	54'	75	75
	60'	75	75
	66'	75	75
	72'	75	75
	78'	75	75
	84'	75	75
	90'	75	75
	96'	75	75
	102'	75	75
	108'	75	75
	114'	75	75
	120'	75	75
	126'	75	75
	132'	75	75
	138'	75	75

"a"	"b"	W psf +	W psf -
30'	30'	75	75
	36'	75	75
	42'	75	75
	48'	75	75
	54'	75	75
	60'	75	75
	66'	75	75
	72'	75	75
	78'	75	75
	84'	75	75
	90'	75	75
	96'	75	75
	102'	75	75
	108'	75	75
	114'	75	75
	120'	75	75
	126'	74	74
	132'	72	72
	138'	71	71
	144'	71	71

"a"	"b"	W psf +	W psf -
36'	36'	75	75
	42'	75	75
	48'	75	75
	54'	75	75
	60'	75	75
	66'	75	75
	72'	75	75
	78'	75	75
	84'	75	75
	90'	75	75
	96'	74	74
	102'	69	69
	108'	65	65
	114'	62	62
	120'	59	59
	123'	58	58

"a"	"b"	W psf +	W psf -
42'	42'	75	75
	48'	75	75
	54'	75	75
	60'	75	75
	66'	75	75
	72'	75	75
	78'	75	75
	84'	75	75
	90'	75	75
	96'	69	69
	102'	63	63
	105'	61	61

"a"	"b"	W psf +	W psf -
48'	48'	75	75
	54'	75	75
	60'	75	75
	66'	75	75
	72'	75	75
	78'	75	75
	84'	75	75
	90'	70	70
	92'	69	69
54'	54'	69.4	69.4
	60'	69.4	69.4
	66'	69.4	69.4
	72'	69.4	69.4
	78'	69.4	69.4
	82'	69.4	69.4
60'	60'	62.5	62.5
	66'	62.5	62.5
	72'	62.5	62.5
	74'	62.5	62.5

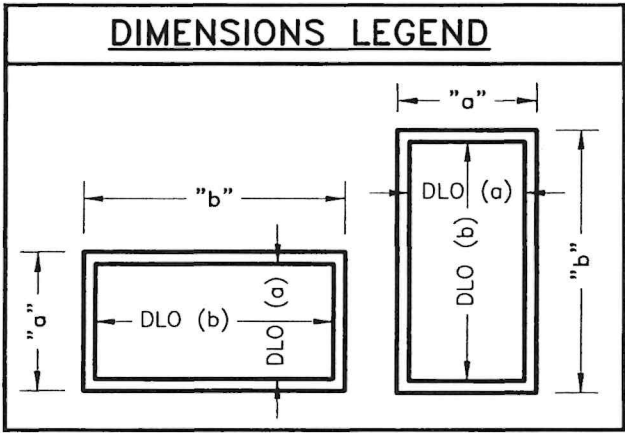

MAXIMUM DAY LIGHT OPENING
(D.L.O.) FOR A GIVEN COMPONENT
AT EACH END OF GLASS

SIDE	COMPONENTS @ EACH END OF GLASS	MAX. DAY LIGHT OPENING
		(D.L.O.) Formula
MAX. D.L.O. (a) (SHORT SIDE)	(2)+(3), (2)+(3) OR (2)+(3A), (2)+(3A) OR (2)+(3B), (2)+(3B)	"a" - 3.526"
MAX. D.L.O. (b) (LONG SIDE)	(1)+(3), (1)+(3) OR (1)+(3A), (1)+(3A) OR (1)+(3B), (1)+(3B)	"b" - 3.526"

WALTER A. TILLIT JR.
LICENSE
No. 44167
STATE OF FLORIDA
PROFESSIONAL ENGINEER
3/31/2023
P.E. SEAL/SIGNATURE/DATE

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

© 2023 TILTECO INC.

TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone: (305) 871-1530 • Fax: (305) 871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT JR., P.E.
FLORIDA Lic. 44167

SERIES 21000 HIGH IMPACT FIXED
GLASS WINDOWS



290 WEST 78 ROAD
HIALEAH, FL 33014
PHONE: (305) 558-8103
FAX: (305) 558-6665
www.generalimpact.com


DRAWN BY:
W.H

03/23/2023
DATE


23-041
DRAWING No

REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-272	03/23/23	3		
2			4		

SHEET 8 OF 9

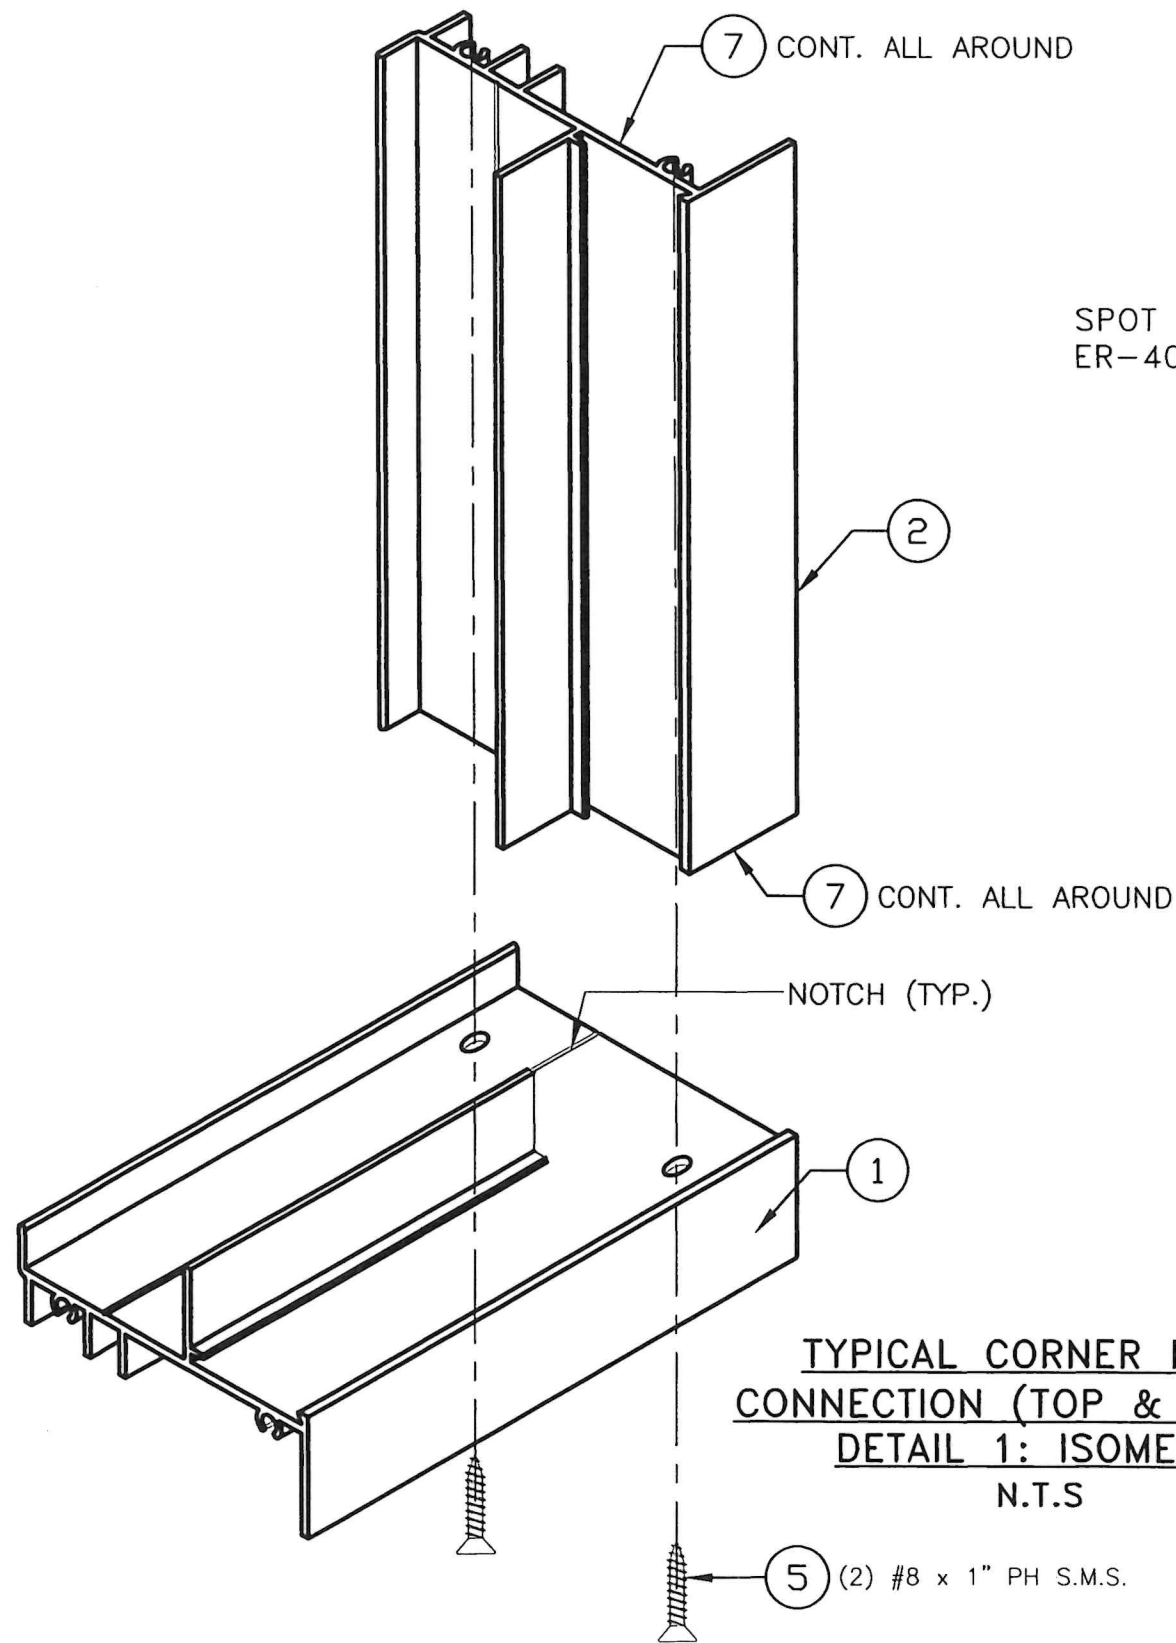

**TYPICAL CORNER FRAME
CONNECTION (TOP & BOTTOM)**
DETAIL 1: ISOMETRIC
N.T.S

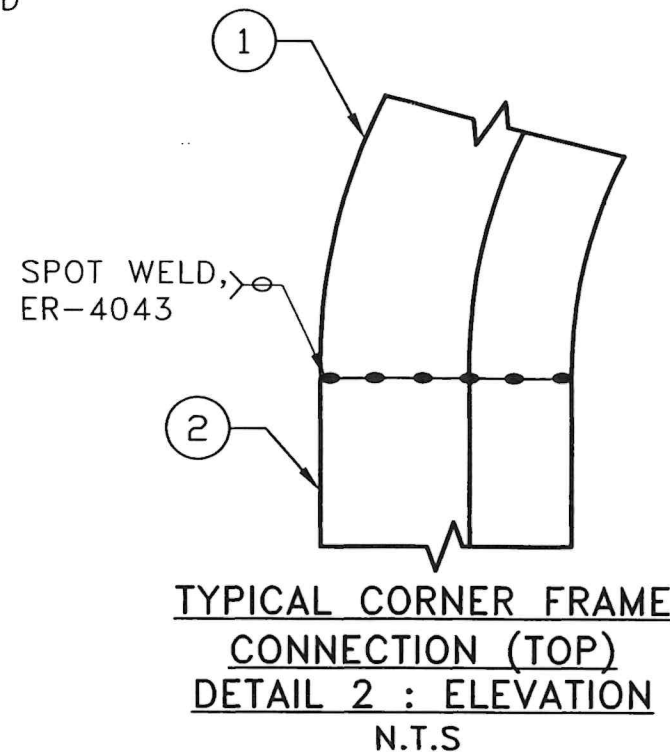

MAXIMUM ANCHOR SPACING SCHEDULE "S"

SUBSTRATE	ANCHOR TYPE	NEGATIVE DESIGN LOAD (psf)	HEAD/SILL	JAMB
CONCRETE OR BLOCK (SEE NOTE 9A & 9B/1)	1/4"Ø ULTRACON (8)	75 or less	9" O.C.	12" O.C.
		> 75 up to 90	9" O.C.	11 1/2" O.C.
		> 90 up to 130	8" O.C.	8" O.C.
		> 130 up to 154	6 1/2" O.C.	6 1/2" O.C.
WOOD (SEE NOTE 9C/1)	1/4"Ø ULTRACON (8)	75 or less	9" O.C.	9 1/2" O.C.
		> 75 up to 90	8" O.C.	8" O.C.
		> 90 up to 130	5 1/2" O.C.	5 1/2" O.C.
		> 130 up to 154	4 1/2" O.C.	4 1/2" O.C.
METAL (SEE NOTE 9D/1 & 9E/1)	1/4"Ø TEK SCREW (8A)	75 or less	9" O.C.	12" O.C.
		> 75 up to 90	9" O.C.	12" O.C.
		> 90 up to 130	8" O.C.	8" O.C.
		> 130 up to 154	7" O.C.	7" O.C.

FLORIDA BUILDING CODE (High & Non High Velocity Hurricane Zone)

WALTER A. TILLIT JR.
No. 44167
STATE OF FLORIDA
P.E. SEAL/SIGNATURE/DATE
8/31/2023

© 2023 TILTECO INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone: (305)871-1530 Fax: (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr., P.E.
FLORIDA Lic. 44167

SERIES 21000 HIGH IMPACT FIXED GLASS WINDOWS

GENERAL
IMPACT GLASS & WINDOWS
The Clear Solution

290 WEST 78 ROAD
HALEAH, FL. 33014
PHONE: (305) 558-8103
FAX: (305) 558-6665
www.generalimpact.com

DRAWN BY: W.H
03/23/2023
DATE
23-041
DRAWING No
SHEET 9 OF 9

REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-272	03/23/23	3		
2			4		