

ECO GLASS

SERIES S-3400 PVC XO or OX HORIZONTAL SLIDING WINDOW, IMPACT, HVHZ

INSTALLATION ANCHORAGE DETAILS

GENERAL NOTES:

1.

THIS PRODUCT HAS BEEN EVALUATED TO COMPLY WITH THE CURRENT PROVISIONS OF THE 8TH EDITION (2023) FLORIDA BUILDING CODE (FBC) INCLUDING THE HIGH VELOCITY HURRICANE ZONES (HVHZ) AND IS BASED ON TESTING CONDUCTED TO TAS 201-94, TAS202-94 AND TAS 203-94 DOCUMENTED IN PROJECT NO. 1924T0010, DATED 01/16/2026 TEST REPORT BY PRI CONSTRUCTION MATERIALS TECHNOLOGIES LLC.
2.

2X WOOD FRAMING, 1X OR 2X WOOD BUCK, METAL FRAMING AND CONCRETE/MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND CONCRETE/MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3.

1X BUCK OVER CONCRETE/MASONRY OR OTHER SUBSTRATE MATERIALS IS OPTIONAL. WHEN 1X BUCK IS USED, INSTALLATION ANCHORS WILL PASS THROUGH WINDOW FRAME AND 1X BUCK INTO SUPPORTING SUBSTRATE. WHEN USED, 1X BUCKS SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE AND IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD. DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
4.

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF THE INSTALLATION METHODS DEVIATE FROM THESE APPROVED DETAILS THIS WOULD REQUIRE FURTHER INVESTIGATION BY A LICENSED OR REGISTERED DESIGN PROFESSIONAL.
5.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED FOR IMPACT PROTECTION. THEREFORE, IN AREAS WHERE WINDBORNE DEBRIS PROTECTION REQUIREMENTS EXIST, USE OF AN IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED:
6.

MATERIALS:

6.1.

FRAME: EXTRUDED RIGID PVC BY PH TECH, INC. PER CURRENT MIAMI-DADE NOA.

6.2.

LAMINATE GLASS INTERLAYER: SAFLEX PVB INTERLAYER BY EASTMAN CHEMICAL CO. PER CURRENT MIAMI-DADE NOA.
7.

GLAZING:

7.1.

INSULATING GLASS UNIT 25 MM (1.0") O.A. THICKNESS

7.2.

SASH AND FIXED GLAZING CONFIGURATION

7.2.1.1.

GLASS THICKNESS:

7.2.1.1.1.

EXTERIOR: 3MM (1/8") ANNEALED X 2.3MM (0.090") SAFLEX PVB X 3MM (1/8") ANNEALED

7.2.1.1.2.

INTERIOR: 3MM (1/8") ANNEALED

7.2.1.2.

AIR GAP 16 MM (0.63")

7.2.1.3.

GLAZING BITE 1/2"

7.2.1.4.

IGU SPACER: RAMAPO LP BEND ALUMINUM SPACER

7.2.1.

GLAZING METHOD

7.2.2.

THE IGU WAS SET FROM THE INTERIOR ONTO A BED SIKAFLEX 552, BACKFILLED, AND SECURED WITH RIGID PVC GLAZING BEADS.

7.3.

ALL SETTING BLOCKS SHALL BE IN COMPLIANCE WITH THE 8TH EDITION (2023) FLORIDA BUILDING CODE. SETTING BLOCKS SHALL BE NEOPRENE WITH A 70 TO 90 SHORE A DUROMETER.

7.4.

GLASS MEETS THE REQUIREMENTS OF ASTM E1300-16.
8.

PANEL OPERABILITY DESIGNATIONS: X = OPERABLE AND O = FIXED
9.

PERIMETER AND JOINT SEALANT BY OTHERS TO BE DETAILED IN ACCORDANCE WITH THE FBC, RESIDENTIAL AND BUILDING VOLUMES AND WITH FMA/AAMA/WDMA PROTOCOLS. PERIMETER AND JOINT SEALANT IS SHOWN FOR ILLUSTRATIVE PURPOSES ONLY AND IS NOT PART OF THIS PRODUCT APPROVAL DOCUMENT.

INSTALLATION NOTES:

1.

INSTALL ONE (1) ANCHOR AS INDICATED IN THE SECTION DETAILS ON SHEETS 3 AND 4 AT EACH LOCATION SHOWN IN THE ELEVATION ON SHEET 2.

1.1.

LOCATION TOLERANCE IS +/- 1".

1.2.

FOR WINDOWS SMALLER THAN THAT SHOWN IN SHEET 2 ELEVATION, ANCHOR SPACING CAN BE REDUCED WHILE MAINTAINING THE ANCHOR QUANTITIES AND EDGE DISTANCE SHOWN.
2.

SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH A LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
3.

SEE INSTALLATION ANCHOR SCHEDULE ON SHEET 4 FOR ANCHOR TYPE, EMBEDMENT AND EDGE DISTANCE REQUIREMENTS.

3.1.

INSTALLATION ANCHORS SHALL BE CORROSION RESISTANT OR HAVE CORROSION RESISTANT COATING.

3.2.

SEE INSTALLATION NOTE 4 FOR MINIMUM SUBSTRATE PROPERTIES.

4.

INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:

4.1.

WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.

4.2.

CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 2500 PSI.

4.3.

MASONRY - STRENGTH CONFORMANCE TO ASTM C-90 MEDIUM WEIGHT WITH COMPRESSIVE STRENGTH OF 1900 psi (DENSITY > 117 PCF).

4.4.

STEEL STUD - STRENGTH CONFORMING TO MIN. Fty = 33 KSI AND Ftu = 45 KSI. MINIMUM THICKNESS 20 GA.

TABLE OF CONTENTS	
SHEET	DESCRIPTION
1	INSTALLATION AND GENERAL NOTES
2	EXTERIOR ELEVATION AND ANCHORAGE
3	VERTICAL SECTIONS - THROUGH FRAME INSTALLATION (WITH SILL CLIP)
4	HORIZONTAL SECTIONS - THROUGH FRAME INSTALLATION
5	COMPONENTS - BILL OF MATERIALS & VERTICAL SECTION
6	COMPONENTS - HORIZONTAL SECTIONS
7	COMPONENTS - CORNER CONSTRUCTION DETAIL, WEEP HOLES, SILL CLIP
8	COMPONENTS - PVC EXTRUSIONS
9	COMPONENTS - HARDWARE

This item has been digitally signed and sealed by Robert J. Amoruso, PE on the date adjacent to the seal. Signature must be verified on any electronic copies.

PROJECT NO. ACE-2025-305				BY
				DATE
				REV
				DESCRIPTION

ECO GLASS

144 HOPE STREET

LONGWOOD, FL 32750

SERIES S-3400 PVC HORIZONTAL SLIDING WINDOW, IMPACT, HVHZ

INSTALLATION AND GENERAL NOTES

DRAWN BY: RJA

DATE: 2/19/2026

SCALE: N.T.S.

DRAWING NO: ECOGLASS020-HVHZ

REV: ---

SHEET: 1 OF 9

 ECO GLASS
ADVANCED FLORIDA WINDOW SOLUTION

321-207-0507 | info@vk-ecoglass.com



Digitally signed by Robert J Amoruso

Date: 2026.02.24 10:13:42 -05'00'

ROBERT J. AMORUSO, P.E. #49752



AMORUSO CONSULTING ENG., LLC

FBPE REGISTRATION NO. 38327

226 N NOVA RD, NO. 142

ORMOND BEACH, FL 32174

RJAENGPE@GMAIL.COM

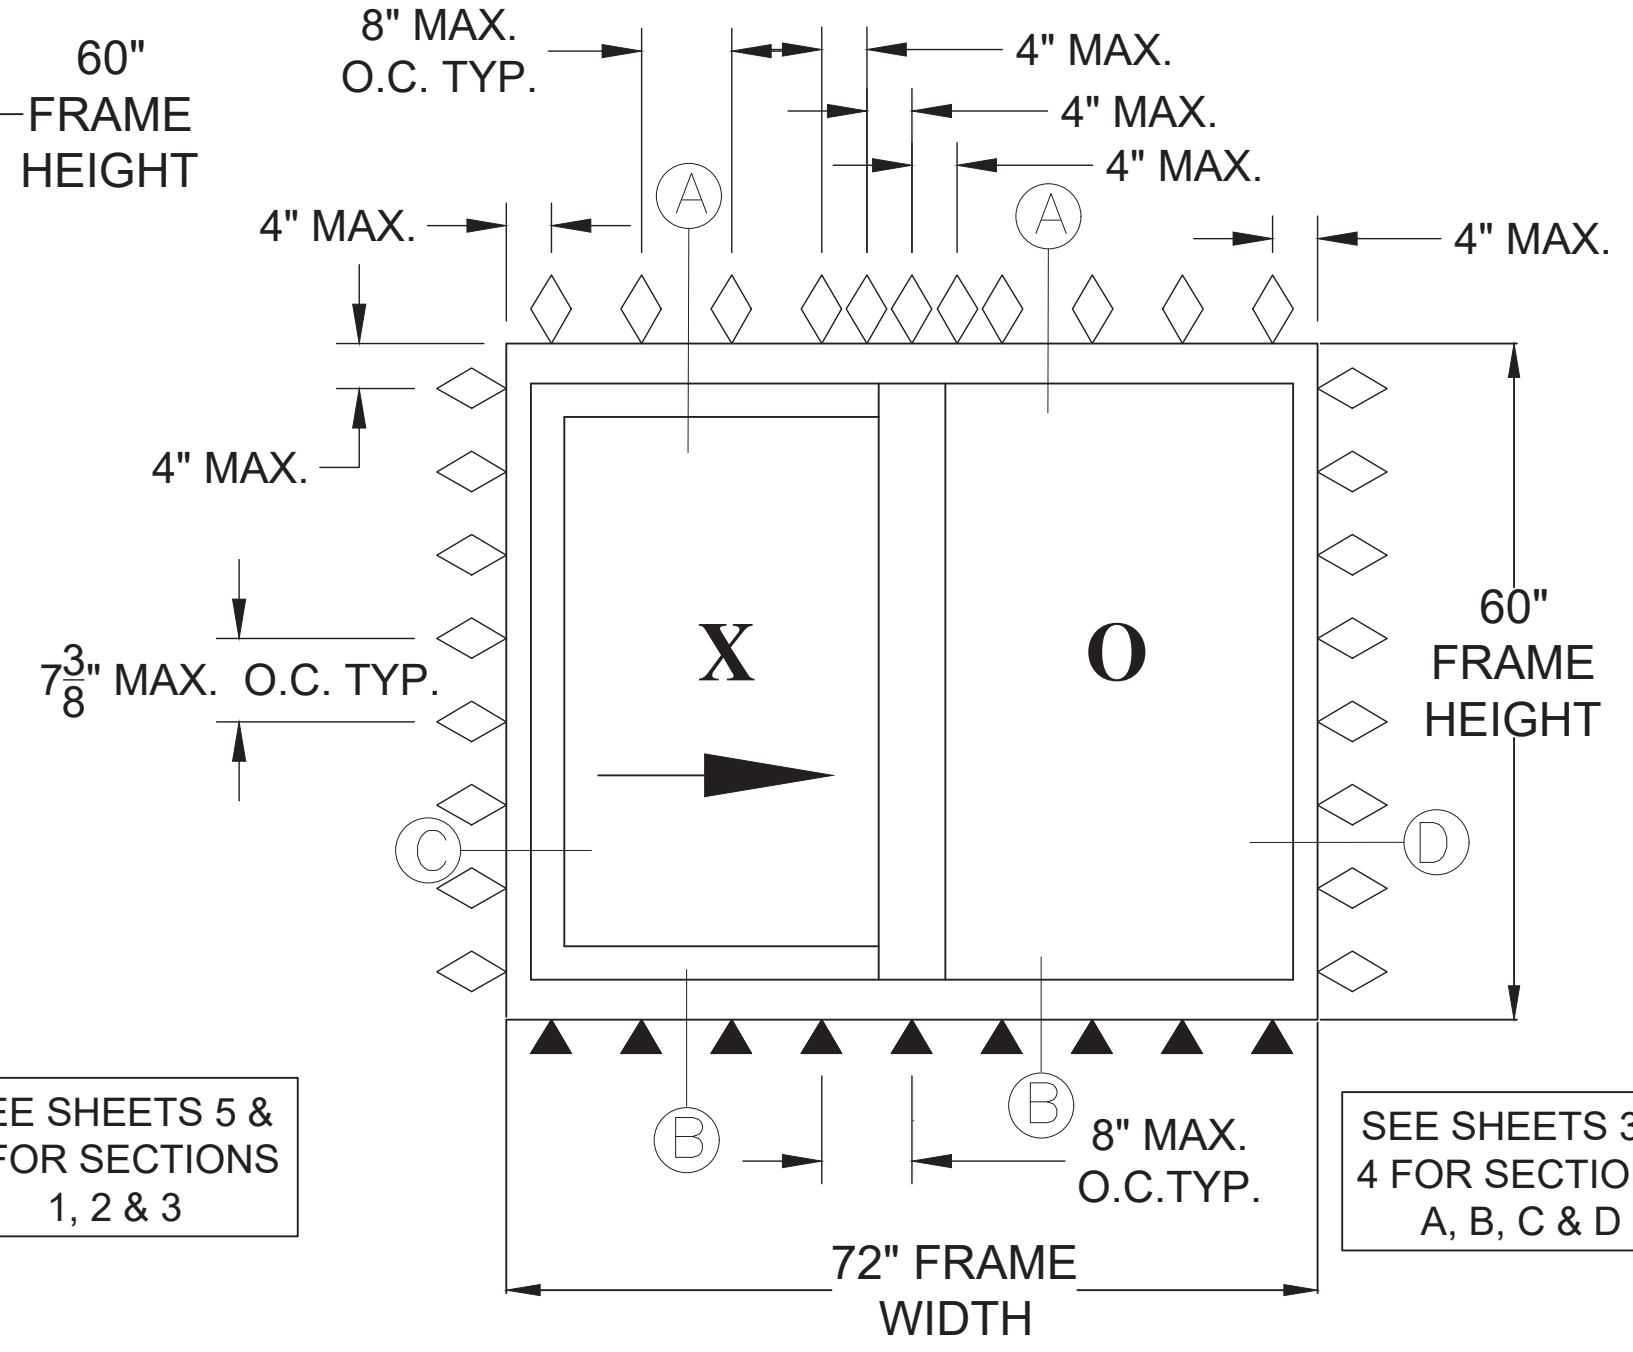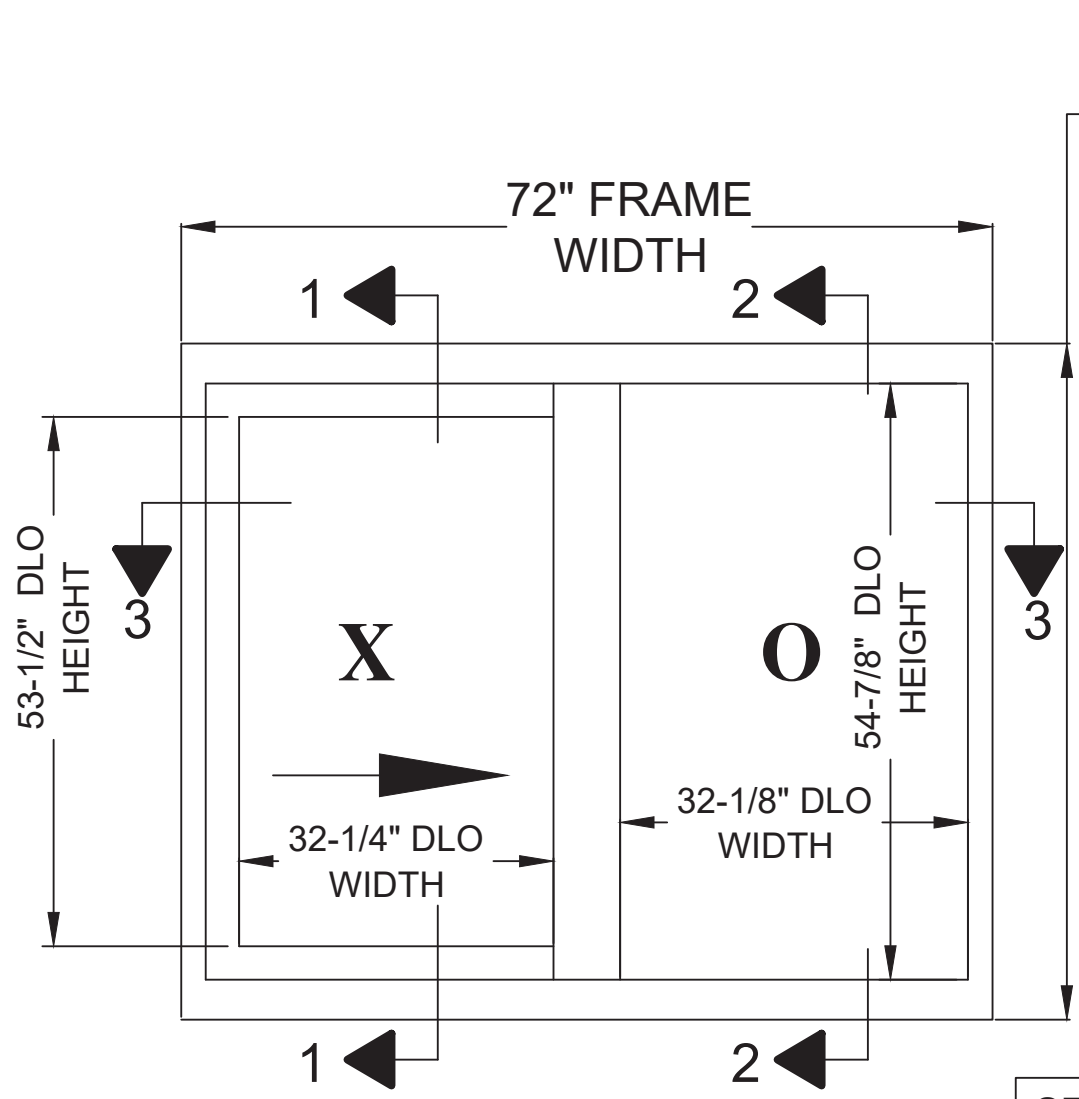

MAXIMUM SIZES	
FRAME	72" X 60"
SASH	35-5/8" X 57-1/4"
DLO - SASH	32-1/4" X 53-1/2"
DLO - FIXED	32-1/8" X 54-7/8"

SEE SHEETS 5 & 6 FOR SECTIONS 1, 2 & 3

SEE SHEETS 3 & 4 FOR SECTIONS A, B, C & D

- THRU-FRAME ANCHOR
- CLIP ANCHOR

**BLOCK/EQUAL LEG THROUGH FRAME
(HEAD & JAMBS) AND CLIP (SILL)
INSTALLATION**
EXTERIOR VIEW

**SERIES S-3400 HORIZONTAL SLIDING
WINDOW (XO SHOWN OR OX)**
EXTERIOR VIEW

PERFORMANCE RATING		
MAXIMUM WINDOW SIZE (IN)	DESIGN PRESSURE RATING (PSF)	IMPACT RATING
72 X 60	50	HVHZ - LARGE MISSILE IMPACT MISSILE LEVEL D

PROJECT NO. ACE-2025-305

				BY
				DATE
				DESCRIPTION
				REV

ECO GLASS
144 HOPE STREET
LONGWOOD, FL 32750

SERIES S-3400 PVC HORIZONTAL SLIDING WINDOW, IMPACT, HVHZ
EXTERIOR ELEVATION AND ANCHORAGE

DRAWN BY: RJA

DATE: 2/19/2026

SCALE: N.T.S.

DRAWING NO: ECOGLASS020-HVHZ

REV: ---

SHEET: 2 OF 9


ECO GLASS
ADVANCED FLORIDA WINDOW SOLUTION

321-207-0507 | info@vk-ecoglass.com

ROBERT J. AMORUSO
LICENSE
No 49752
STATE OF FLORIDA
PROFESSIONAL ENGINEER

Digitally signed
by Robert J
Amoruso
Date: 2026.02.24
10:13:59 -05'00'

ROBERT J. AMORUSO, P.E. #49752
AMORUSO CONSULTING ENG., LLC
FBPE REGISTRATION NO. 38327
226 N NOVA RD, NO. 142
ORMOND BEACH, FL 32174
RJAENGPE@GMAIL.COM

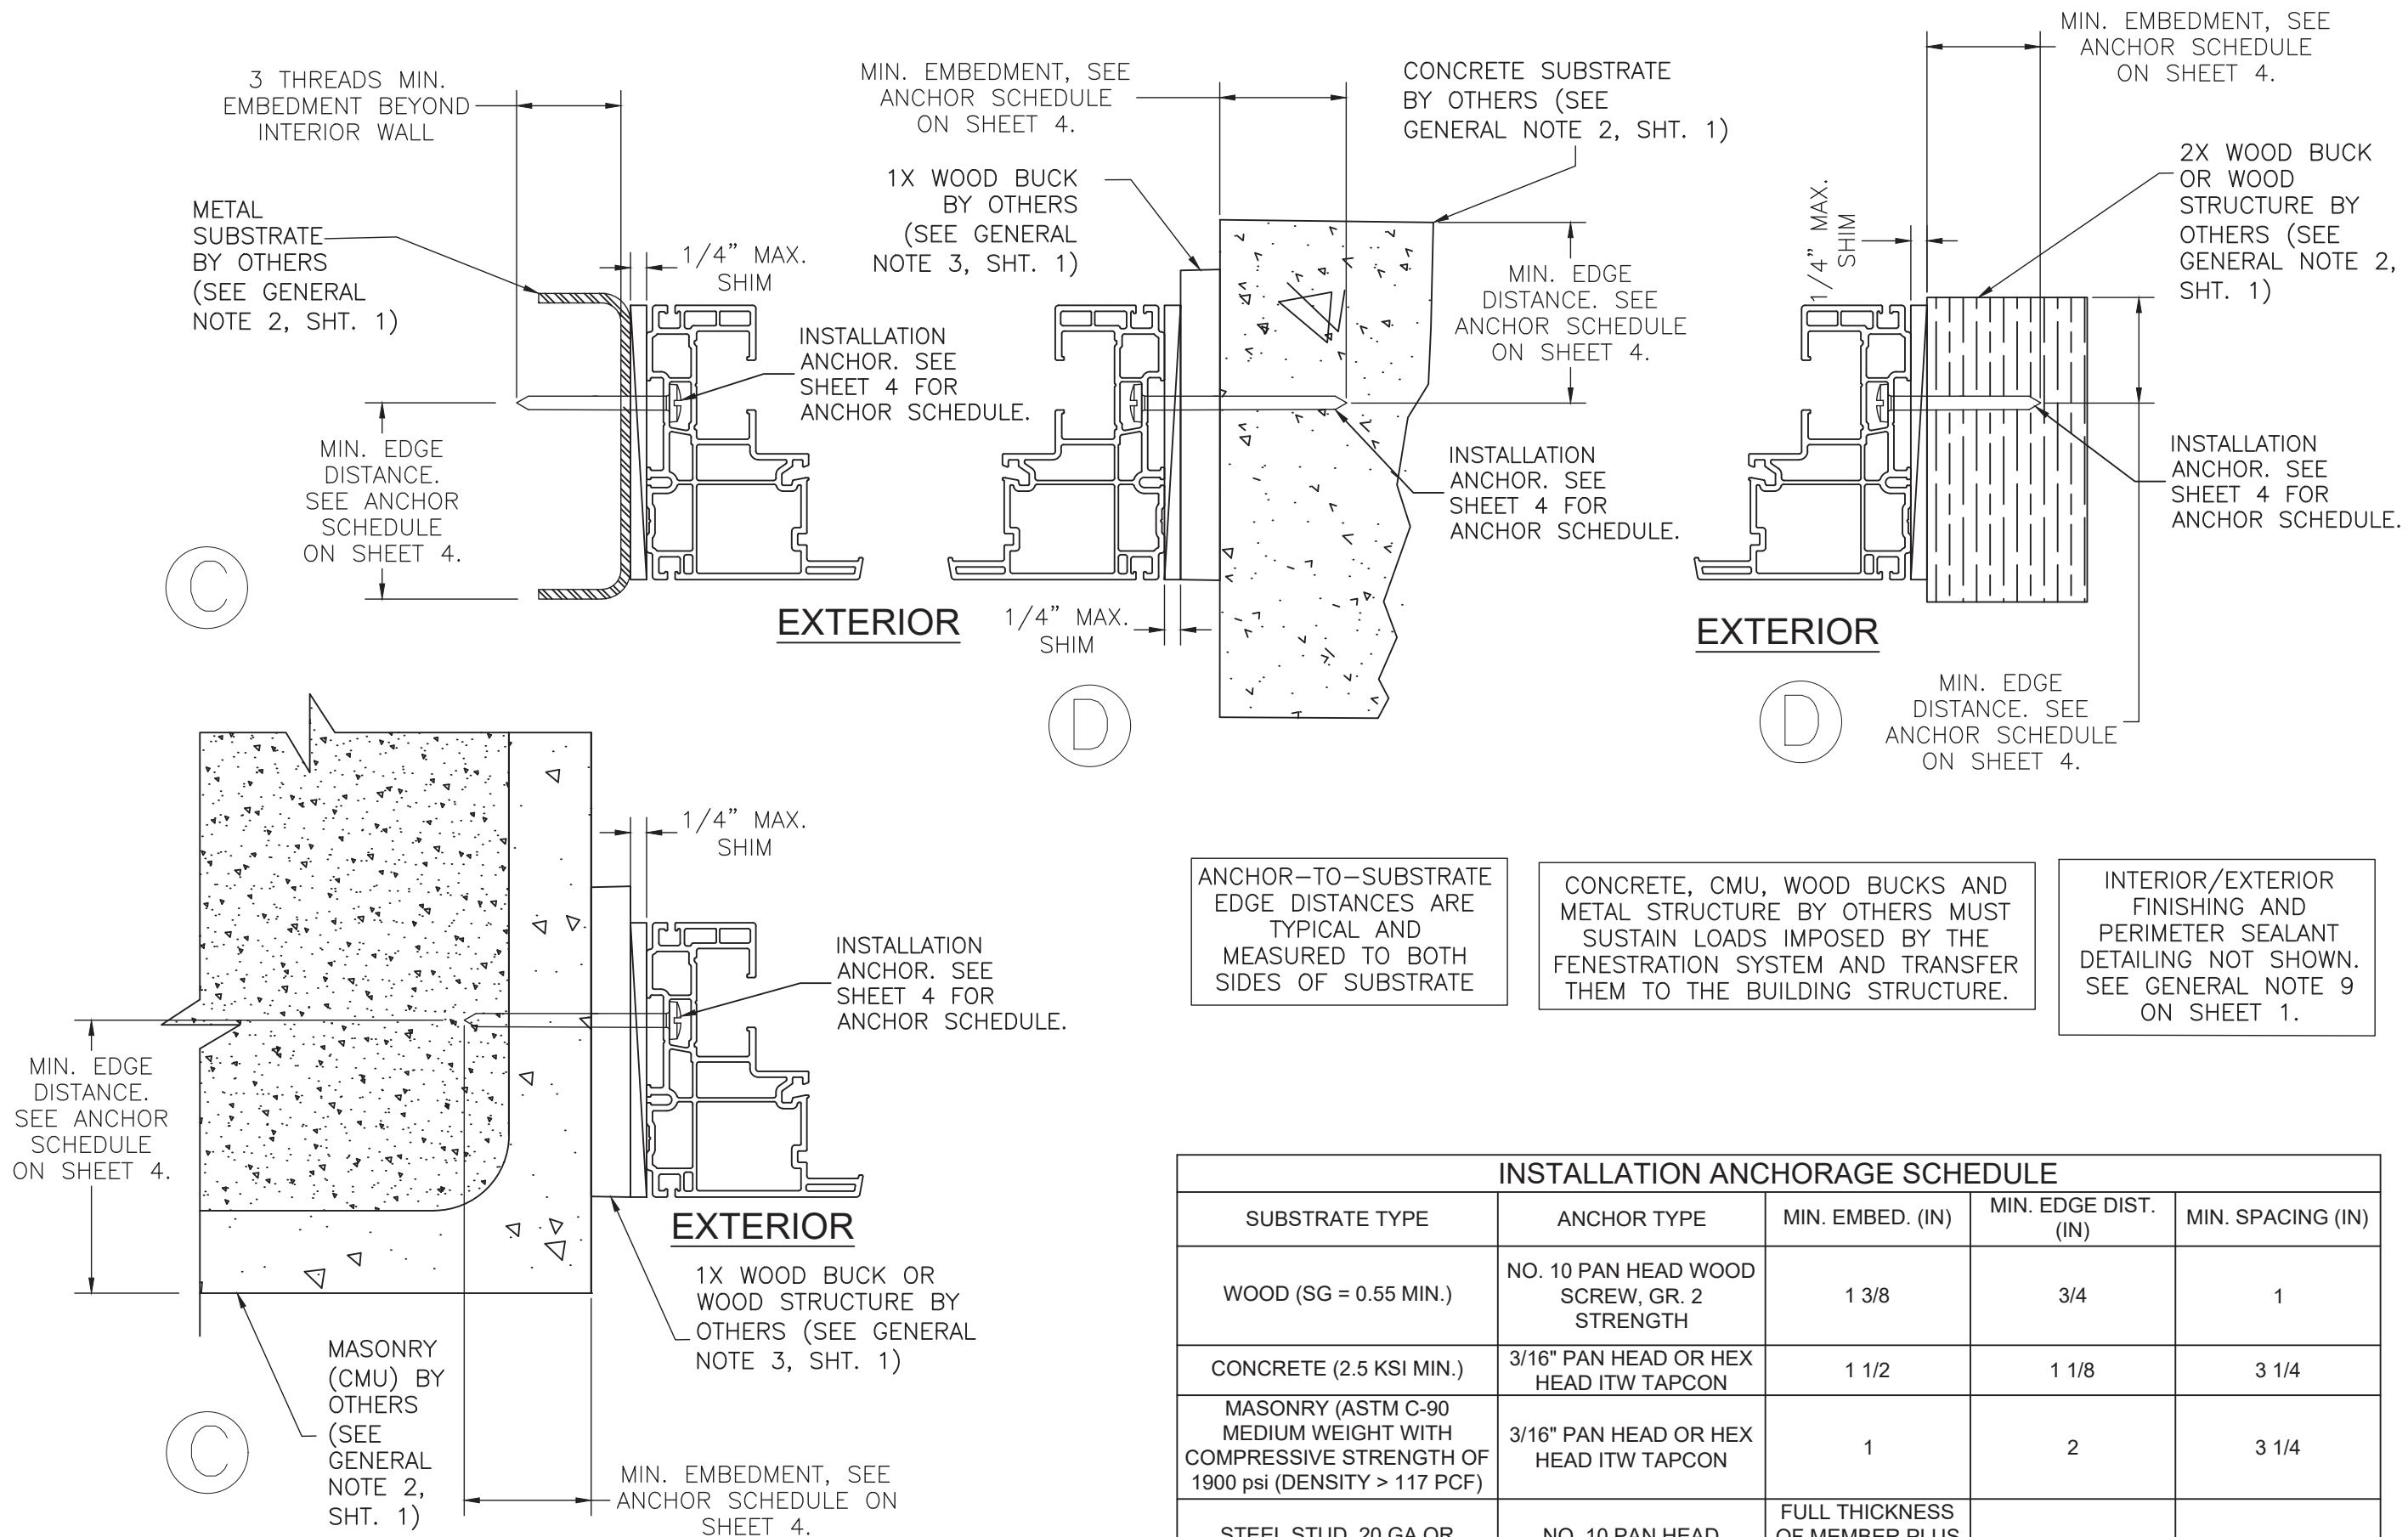

ANCHOR-TO-SUBSTRATE
EDGE DISTANCES ARE
TYPICAL AND
MEASURED TO BOTH
SIDES OF SUBSTRATE

CONCRETE, CMU, WOOD BUCKS AND
METAL STRUCTURE BY OTHERS MUST
SUSTAIN LOADS IMPOSED BY THE
FENESTRATION SYSTEM AND TRANSFER
THEM TO THE BUILDING STRUCTURE.

INTERIOR/EXTERIOR
FINISHING AND
PERIMETER SEALANT
DETAILING NOT SHOWN.
SEE GENERAL NOTE 9
ON SHEET 1.

INSTALLATION ANCHORAGE SCHEDULE				
SUBSTRATE TYPE	ANCHOR TYPE	MIN. EMBED. (IN)	MIN. EDGE DIST. (IN)	MIN. SPACING (IN)
WOOD (SG = 0.55 MIN.)	NO. 10 PAN HEAD WOOD SCREW, GR. 2 STRENGTH	1 3/8	3/4	1
CONCRETE (2.5 KSI MIN.)	3/16" PAN HEAD OR HEX HEAD ITW TAPCON	1 1/2	1 1/8	3 1/4
MASONRY (ASTM C-90 MEDIUM WEIGHT WITH COMPRESSIVE STRENGTH OF 1900 psi (DENSITY > 117 PCF)	3/16" PAN HEAD OR HEX HEAD ITW TAPCON	1	2	3 1/4
STEEL STUD, 20 GA OR GREATER THICKNESS, MIN. Fty = 33 ksi AND Ftu = 45 ksi	NO. 10 PAN HEAD SELF-DRILLING SHEET METAL SCREW, GRADE 5	FULL THICKNESS OF MEMBER PLUS 3 FULL THREAD LENGTHS PAST INTERIOR	1/2	1/2

PROJECT NO. ACE-2025-305					BY
					DATE
					DESCRIPTION
					REV

ECO GLASS
144 HOPE STREET
LONGWOOD, FL 32750

SERIES S-3400 PVC HORIZONTAL SLIDING WINDOW, IMPACT, HVHZ
HORIZONTAL SECTIONS - THROUGH FRAME INSTALLATION

DRAWN BY: RJA
SCALE: N.T.S.
REV: ---

DATE: 2/19/2026
DRAWING NO: ECOGLASS020-HVHZ
SHEET: 4 OF 9

ADVANCED FLORIDA WINDOW SOLUTION


321-207-0507 | info@vk-ecoglass.com

Digitally signed
by Robert J
Amoruso
Date: 2026.02.24
10:14:27 -05'00'

ROBERT J. AMORUSO, P.E. #49752
AMORUSO CONSULTING ENG., LLC
FBPE REGISTRATION NO. 38327
226 N NOVA RD, NO. 142
ORMOND BEACH, FL 32174
RJAENGPE@GMAIL.COM

Item	PART No.	ITEM DESCRIPTION	MANUFACTURERS
1	3420	Main frame	P.H. Tech
* 2	5827, 5832	Covering Cap (main, option)	P.H. Tech
3		Sealant	Various
4		Glass	Various
5	9828	Setting block	P.H. Tech
6	8744	wheel	P.H. Tech
7	9854	No. 10-12 x 5/8", special No. 7 flat head, Quadrex screw.	P.H. Tech
8	5752 (5751 with coex cut)	Sash profile	P.H. Tech
9	EGSR1	Sash retainer	Eco Glass
10	9873	Corner block	P.H. Tech
11	EGFB1	Frame bracket (head)	Eco Glass
12	9774	Weatherstrip	NAP #RPHF018726 Schlegel #HF-7625-187
13	9755	No. 8 x 5/8", truss head, Quadrex screw.	P.H. Tech
14	5810 (with coex cut)	Handle glazing bead	P.H. Tech
15	5800 (with coex cut)	Glazing bead	P.H. Tech
16	8943	No. 6 x 1 1/8", flat head, Quadrex, wood screw.	P.H. Tech
17	9778	Cam lock (1 at 8" of the both sash ends, and 1 in at the center of the sash)	P.H. Tech #9778 Truth #17.35.xx.xxxx
18	SR-300-ZD mod Part #1	Tilt latch assembly (Eco Glass modified)	Sullivan & Associates
19	SR-300-ZD Part #2	Tilt latch assembly / Retainer Bloc	Sullivan & Associates
20	5826	Meeting rail covering cap	P.H. Tech
* 21	9854	No. 10-12 x 1/2", special No. 7 flat head, Quadrex screw.	P.H. Tech
22	5960	Fixed meeting rail	P.H. Tech
23	9752	No. 6 x 1 1/2", flat head, Quadrex, wood screw.	P.H. Tech
24	9771	Keeper (1 at 8" of the both sash ends, and 1 in at the center of the sash)	P.H. Tech #9771 Truth #45070
25	EGMRA1-L	Meeting Rail Anchor (Left)	Eco Glass
26	EGMRA1-R	Meeting Rail Anchor (right)	Eco Glass
27	5872	Sash stopper	P.H. Tech
28	EGSCB2	Sash corner bracket (bottom)	Eco Glass
29	EGSCB3	Sash corner bracket (top)	Eco Glass
30		Screen	Various
31	5959	Screen clip	P.H. Tech
32	9536	Mullion and sash steel reinforcement	P.H. Tech
33	9753	No. 7-19 x 1/2", flat head, Quadrex, type camtap Z. screw.	P.H. Tech
34	8868	Weatherstrip	Amesbury #26018745GYAD1750 Schlegel #PBAB-8325-187
35	9532 cut	Weatherstrip (9532 cut 0.312" [7.9mm])	Eco Glass
36	9532	Weatherstrip	Amesbury #130875GYAD1750 Schlegel #BCDP20.79137
37	9858	SILL CLIP	

* = Options

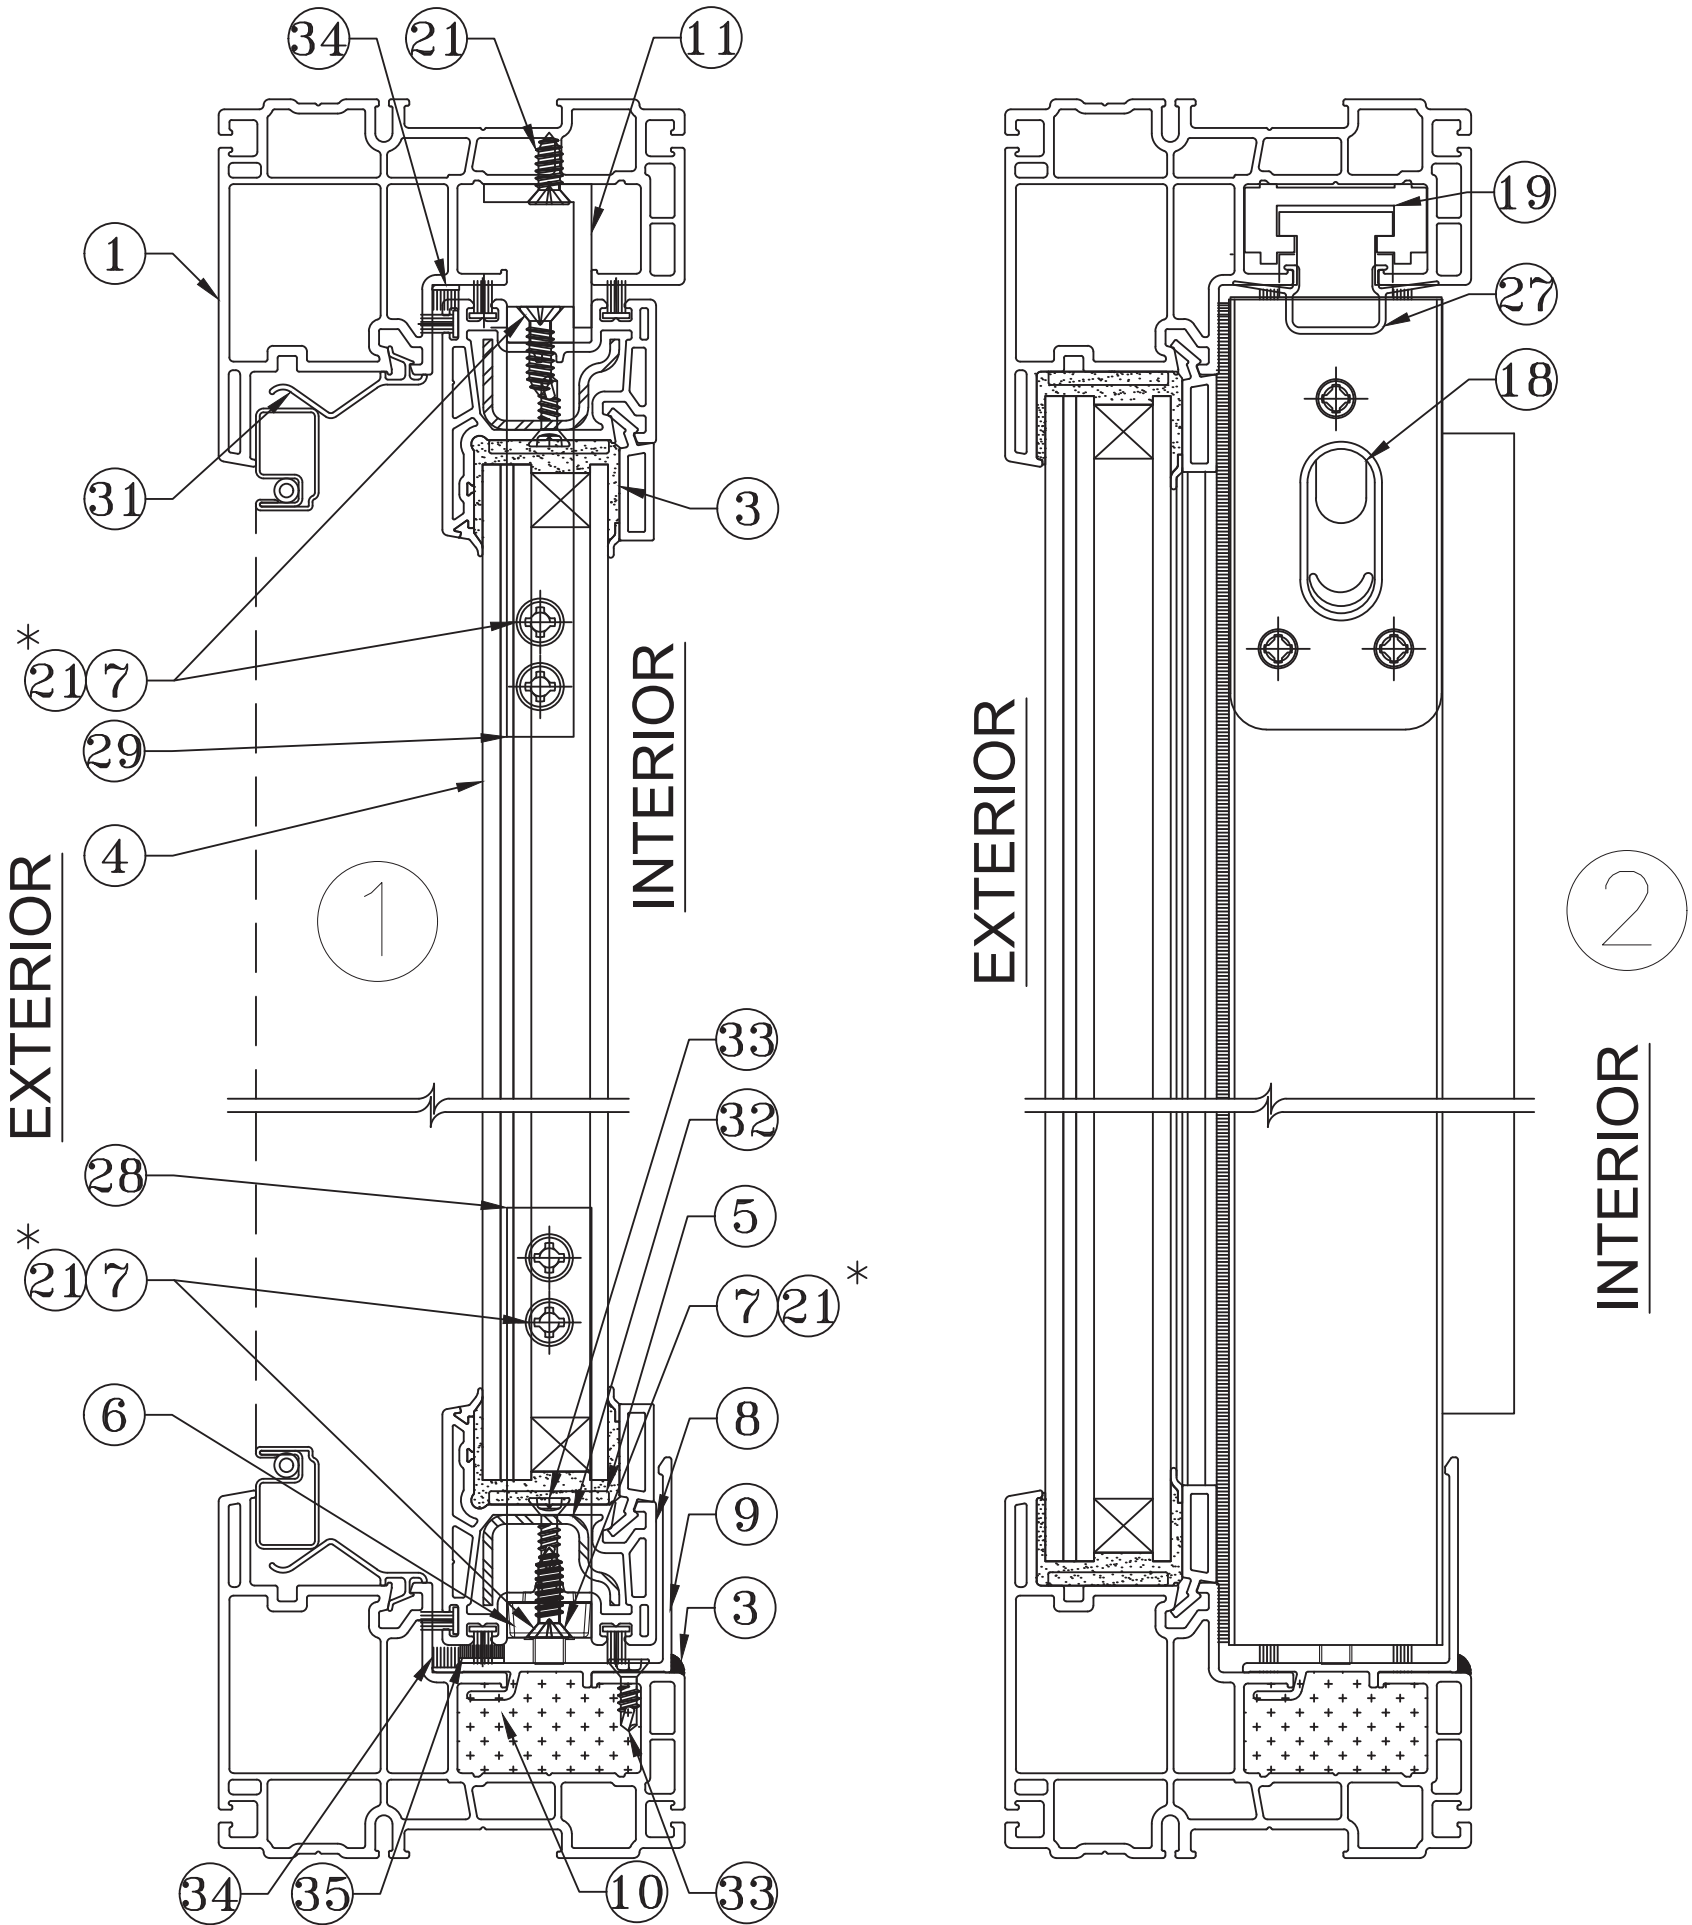

PROJECT NO. ACE-2025-305	REV	DESCRIPTION	DATE	BY

ECO GLASS

144 HOPE STREET

LONGWOOD, FL 32750

SERIES S-3400 PVC HORIZONTAL SLIDING WINDOW, IMPACT, HVHZ COMPONENTS - BILL OF MATERIALS & VERTICAL SECTION

DRAWN BY: RJA

SCALE: N.T.S.

REV: ---

DATE: 2/19/2026

DRAWING NO: ECOGLASS020-HVHZ

SHEET: 5 OF 9

Eco Glass

ADVANCED FLORIDA WINDOW SOLUTION


321-207-0507 | info@vk-ecoglass.com



Digitally signed
by Robert J
Amoruso

Date:
2026.02.24
10:14:39 -05'00'

ROBERT J. AMORUSO, P.E. #49752
AMORUSO CONSULTING ENG., LLC
FBPE REGISTRATION NO. 38327
226 N NOVA RD, NO. 142
ORMOND BEACH, FL 32174
RJAENGPE@GMAIL.COM

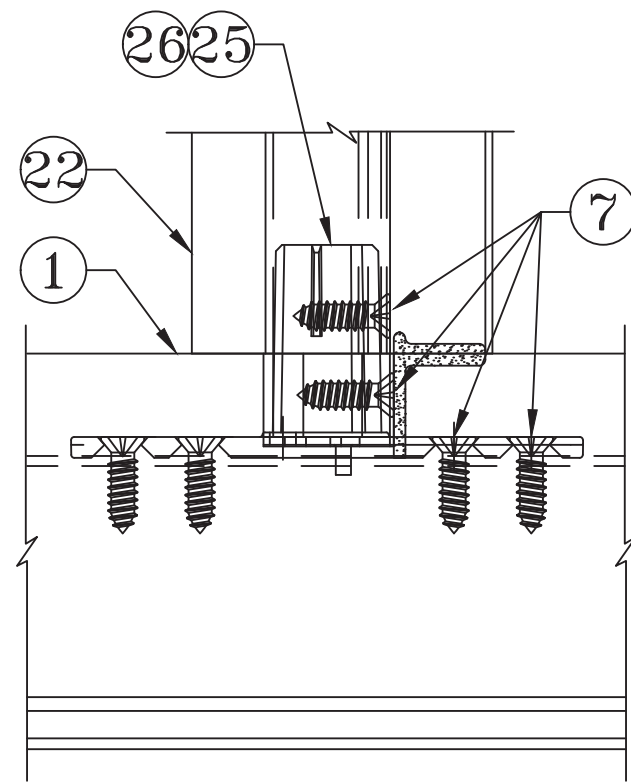


ANCHOR DETAIL AT MEETING RAIL

IGU GLAZING SHOWN. SEE
GENERAL NOTE 7 & DETAIL 1 FOR
GLAZING REQUIREMENTS.

INTERIOR

1/2"
GLASS
BITE

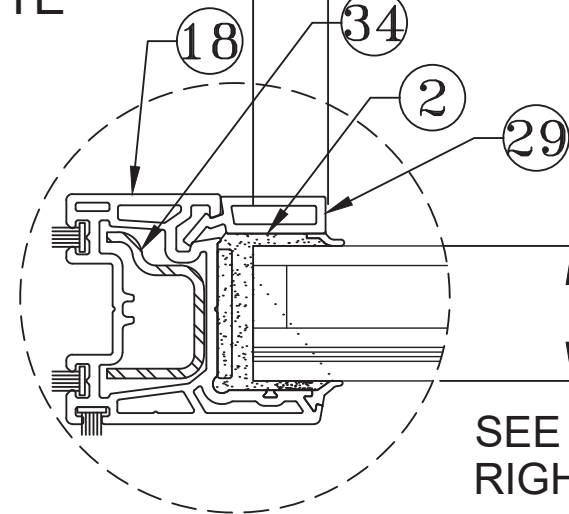


SEE AT
RIGHT.

1" O.A LAMINATED IGU: EXTERIOR
LAMINATED GLASS - (2) NOMINAL
1/8" ANNEALED GLASS W/ 0.090"
EASTMAN CHEMICAL SAFLEX PVB
INTERLAYER, 5/8" AIRSPACE W/
SPACER (RAMAPO LP BEND
ALUMINUM SPACER), INTERIOR
1/8" ANNEALED GLASS

EXTERIOR

GLAZING DETAIL 1

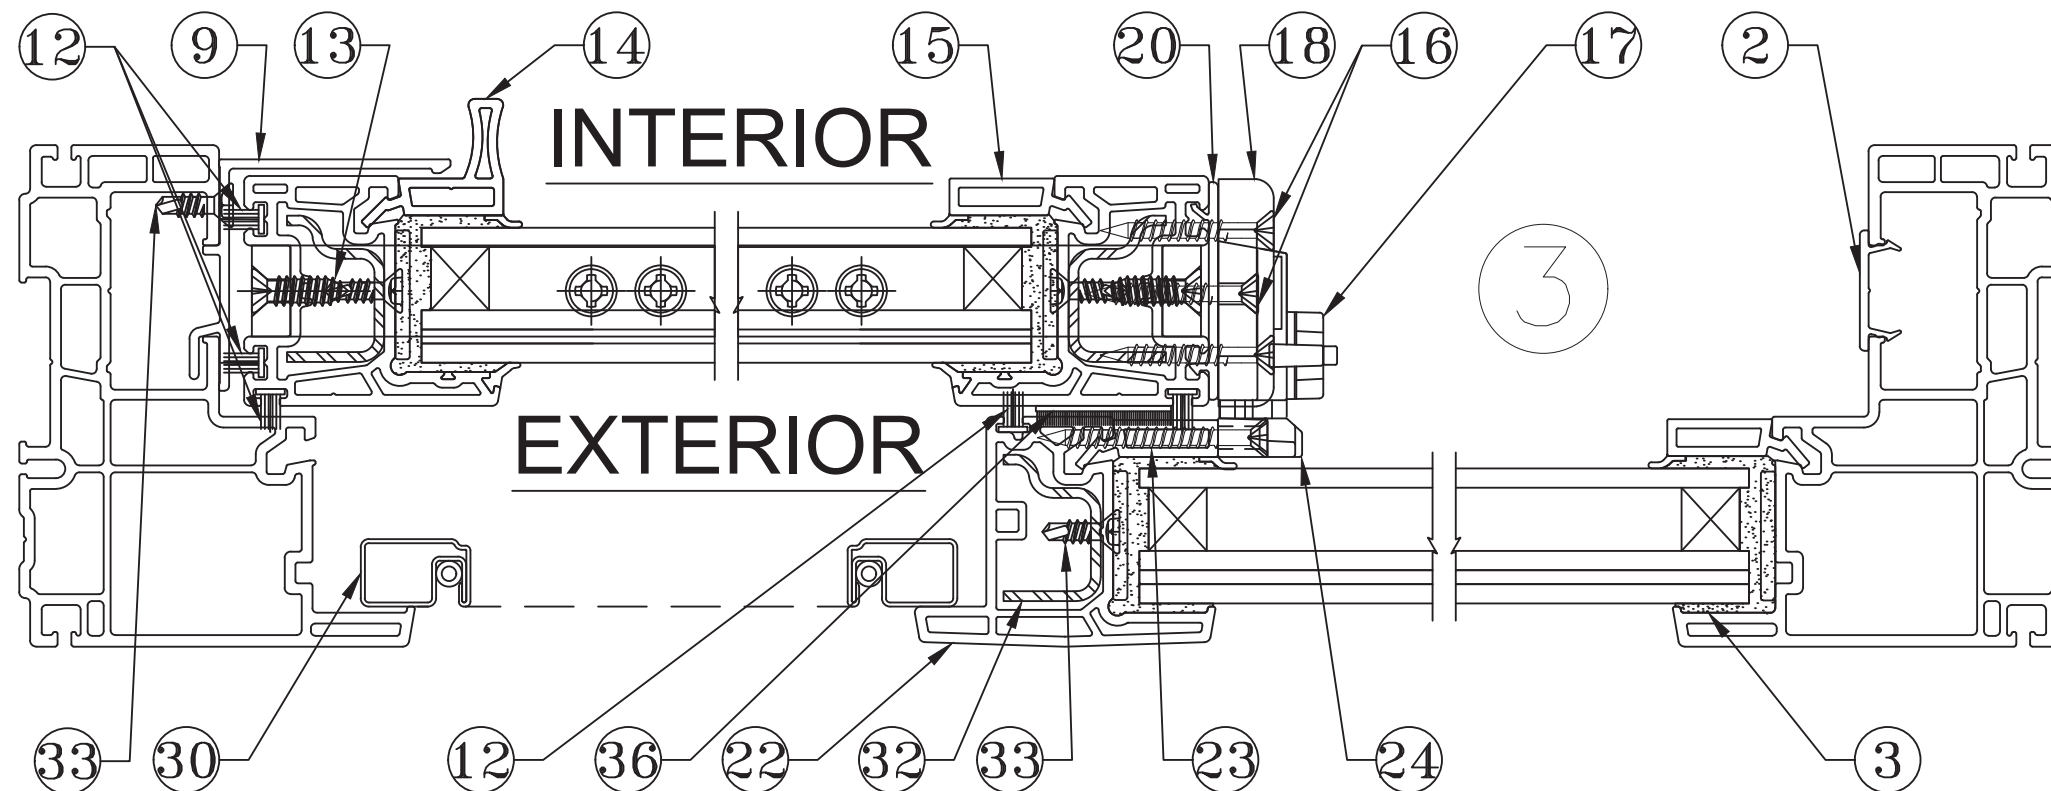

PROJECT NO. ACE-2025-305

ECO GLASS
144 HOPE STREET
LONGWOOD, FL 32750

SERIES S-3400 PVC HORIZONTAL SLIDING WINDOW, IMPACT, HVHZ
COMPONENTS - HORIZONTAL SECTIONS

DRAWN BY: RJA
SCALE: N.T.S.
REV: ---
DATE: 2/19/2026
DRAWING NO: ECOGLASS020-HVHZ
SHEET: 6 OF 9




Digitally signed
by Robert J
Amoruso
Date: 2026.02.24
10:14:59 -05'00'


ROBERT J. AMORUSO, P.E. #49752
AMORUSO CONSULTING ENG., LLC
FBPE REGISTRATION NO. 38327
226 N NOVA RD, NO. 142
ORMOND BEACH, FL 32174
RJAENGPE@GMAIL.COM

WEEP HOLE DETAILS

Drainage Type	Member Location	Location on Frame Member	Drainage Size	Quantity
Weep Slot	Sill exterior face draining to the exterior.	4-1/2" (114mm) from each end, draining to the exterior.	1" long x 0.09" tall (25mm x 2mm)	1 per end (2 Total)
Weep Hole	Sill exterior face draining to the exterior. (Thru 2 walls)	Centerline of exterior meeting stile	1/4" (6mm) Diameter	1
Weep Slot	Sill intermediate wall. Draining to the adjacent cavities. (Thru 2 walls)	4-1/2" (114mm) from each end, draining into the adjacent cavity.	5/16" wide x 0.09" tall (8mm x 2mm)	1 per end (2 Total)
Weep Hole	Sill Interior cavity pocket draining to the cavity below.	Centerline of exterior meeting stile	1/4" (6mm) Diameter	1
Weep Slot	Sill sash pocket	4-1/2" (114mm) from each end, draining to the cavity below.	3/16" long x 1/8" wide (5mm x 3mm)	1 per end (2 Total)
Weep Slot	Glazing pocket	4-1/2" (114mm) from each end, draining to the cavity below.	3/16" long x 1/8" wide (5mm x 3mm)	1 per end (2 Total)

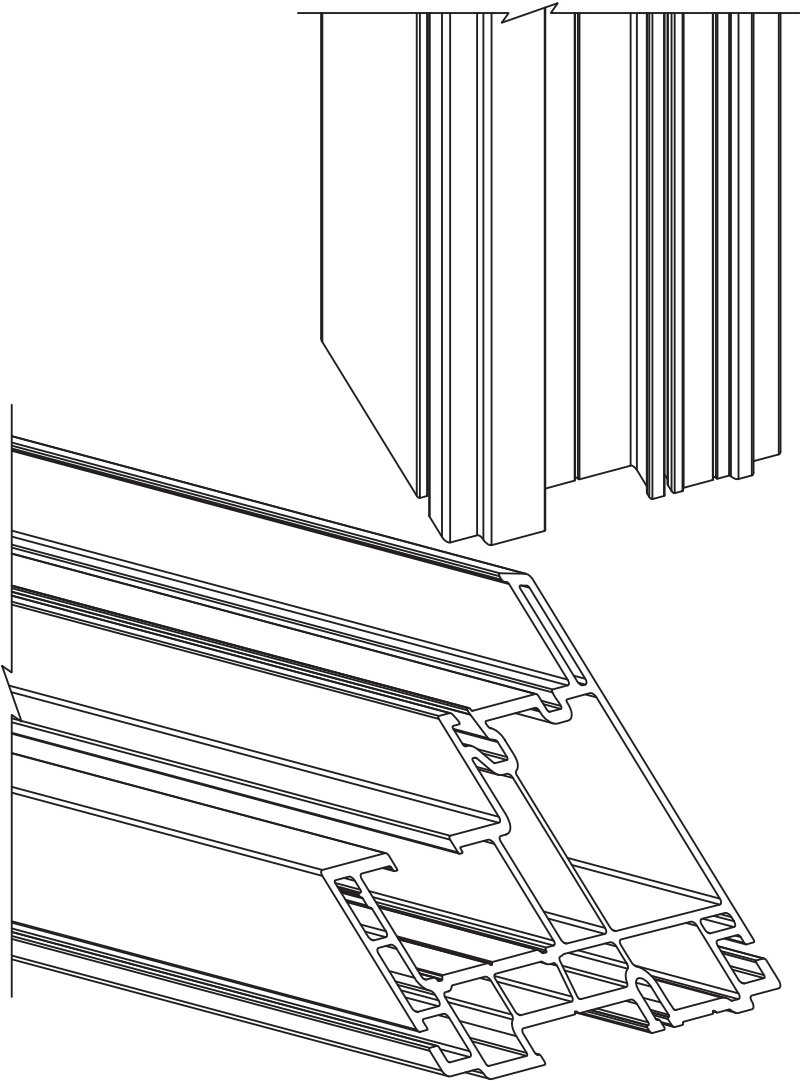

EXTRUDED PVC MITERED AND THERMALLY WELDED AT EACH CORNER.

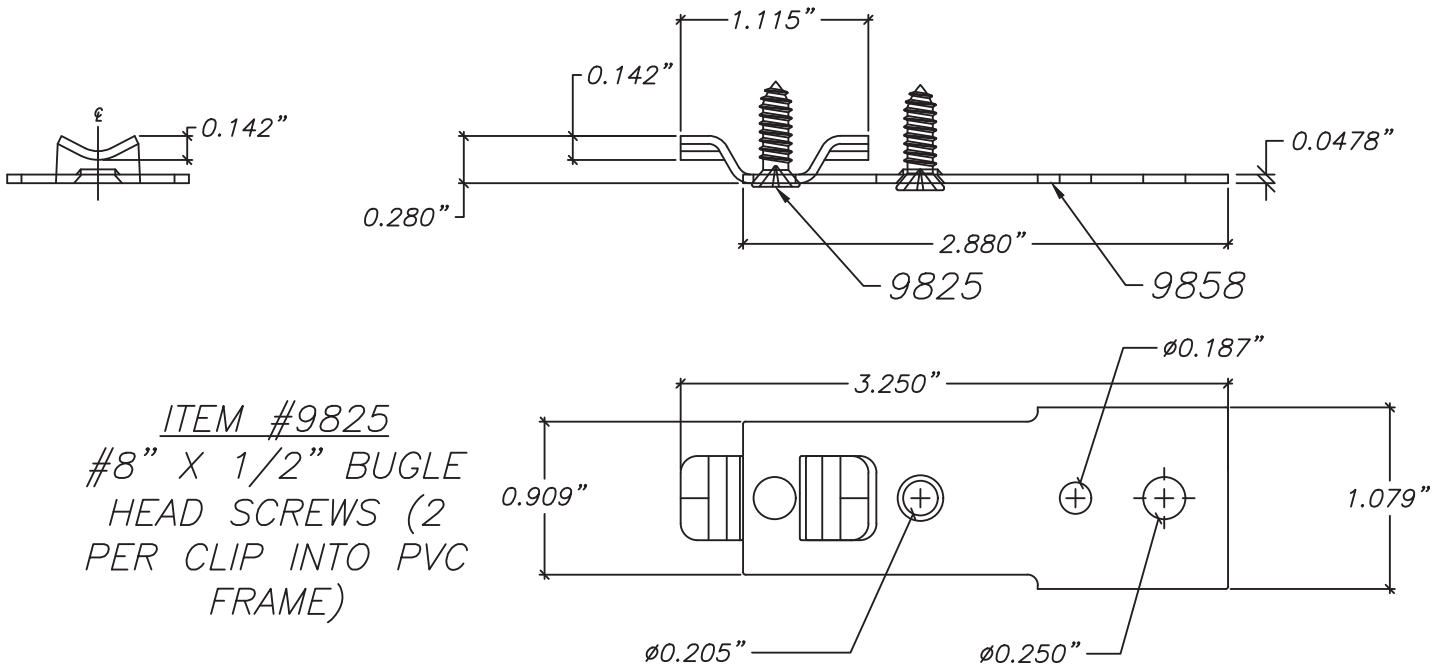

ITEM #9825
#8" X 1/2" BUGLE
HEAD SCREWS (2
PER CLIP INTO PVC
FRAME)

37

SILL CLIP (9858)
GALVANIZED STEEL
TYP. WALL THICKNESS
0.0478"

PROJECT NO. ACE-2025-305					BY
					DATE
					DESCRIPTION
					REV

ECO GLASS

144 HOPE STREET

LONGWOOD, FL 32750

SERIES S-3400 PVC HORIZONTAL SLIDING WINDOW, IMPACT, HVHZ COMPONENTS - CORNER CONSTRUCTION DETAIL, WEEP HOLES, SILL CLIP

DRAWN BY: RJA

SCALE: N.T.S.

REV: ---

DATE: 2/19/2026

DRAWING NO: ECOGLASS020-HVHZ

SHEET: 7 OF 9

ECO GLASS


ADVANCED FLORIDA WINDOW SOLUTION

321-207-0507 | info@vk-ecoglass.com




Digitally signed
by Robert J
Amoruso
Date: 2026.02.24
10:15:15 -05'00'


ROBERT J. AMORUSO, P.E. #49752
AMORUSO CONSULTING ENG., LLC
FBPE REGISTRATION NO. 38327
226 N NOVA RD, NO. 142
ORMOND BEACH, FL 32174
RJAENGPE@GMAIL.COM

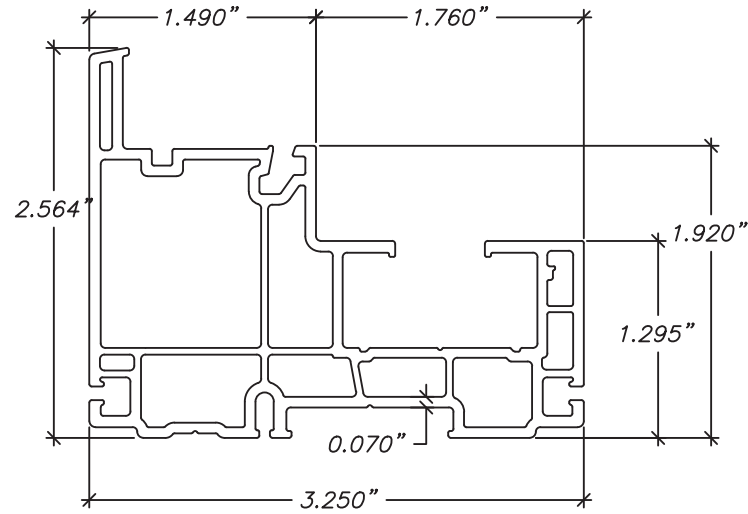


① **MAIN FRAME (3420)**
RIGID PVC
TYP. WALL THICKNESS 0.070"

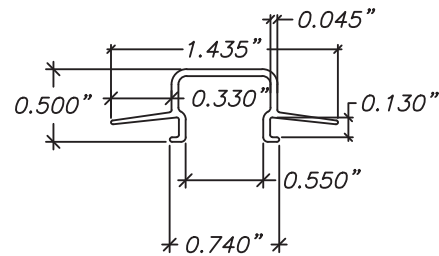


②⑦ **SASH STOPPER (5872)**
RIGID PVC
TYP. WALL THICKNESS 0.045"

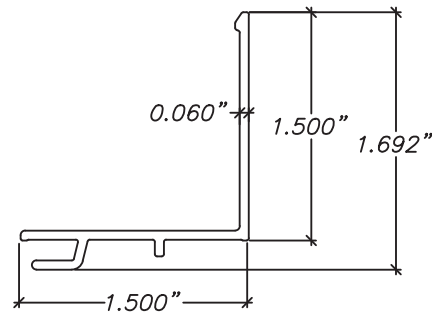


⑨ **SASH RETAINER (EGSR1)**
RIGID PVC
TYP. WALL THICKNESS 0.060"

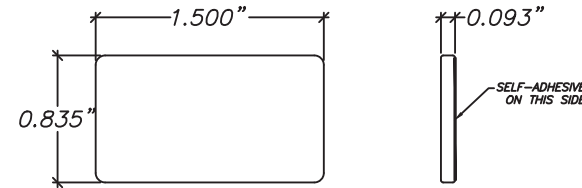


⑤ **SETTING BLOCK (9828)**
NEOPRENE
DURO 85 +/- 5

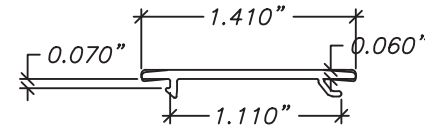


②⑩ **MEETING RAIL
COVERING CAPE (5826)**
RIGID PVC
TYP. WALL THICKNESS 0.060"

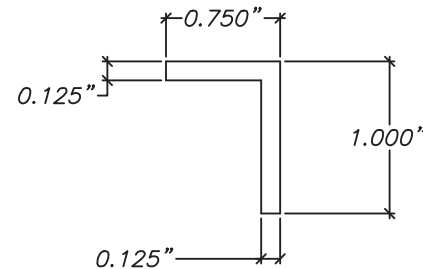


①① **FRAME BRACKET HEAD
(EGFB1)**

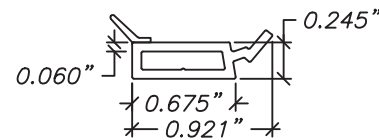


①⑤ **GLAZING BEAD (5800)**
RIGID PVC
TYP. WALL THICKNESS 0.060"

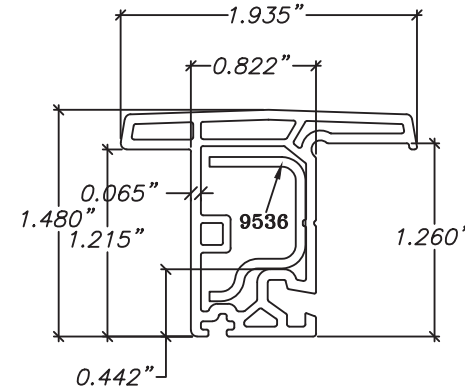


②② **FIXED MEETING RAIL (5960)**
RIGID PVC
TYP. WALL THICKNESS 0.065"
(REINFORCEMENT #9536 SHOWN)

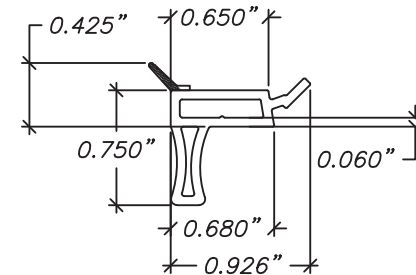


①④ **HANDLE GLAZING BEAD
(5810)**
RIGID PVC
TYP. WALL THICKNESS 0.060"

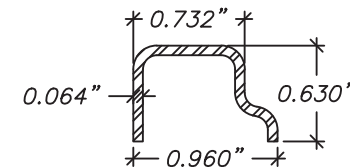

③② **REINFORCEMENT (9536)**
STEEL
TYP. WALL THICKNESS 0.064"

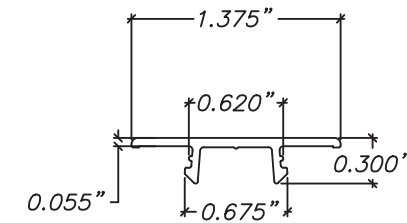

② **COVERING CAP (5827, 5832)**
RIGID PVC
TYP. WALL THICKNESS 0.055"

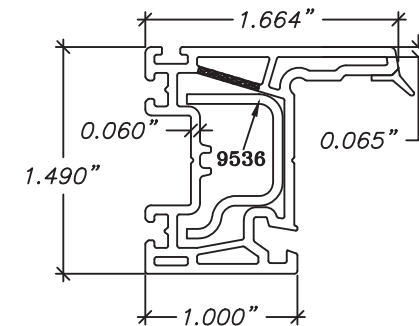

⑧ **SASH FRAME (5752)**
RIGID PVC
TYP. WALL THICKNESS 0.060\", 0.065"
(REINFORCEMENT #9536 SHOWN)



Digitally signed
by Robert J
Amoruso
Date: 2026.02.24
10:15:28 -05'00'

ROBERT J. AMORUSO, P.E. #49752
AMORUSO CONSULTING ENG., LLC
FBPE REGISTRATION NO. 38327
226 N NOVA RD, NO. 142
ORMOND BEACH, FL 32174
RJAENGPE@GMAIL.COM

ECO GLASS
144 HOPE STREET
LONGWOOD, FL 32750

SERIES S-3400 PVC HORIZONTAL SLIDING WINDOW, IMPACT, HVHZ
COMPONENTS - PVC EXTRUSIONS



DRAWN BY: RJA
SCALE: N.T.S.
REV: ---
DATE: 2/19/2026
DRAWING NO: ECOGLASS020-HVHZ
SHEET: 8 OF 9

PROJECT NO. ACE-2025-305

BY


DATE

DESCRIPTION


REV

HARDWARE COMPONENTS


Component	Description	Location	Quantity
Cam Lock w/ Keeper	Formed metal housing and lock w/ mating metal keeper	Each lock was mounted on the interior meeting stile approximately 8" (203mm) O.C. from each end and midspan. Each lock was anchored with two (2) #6 x 1-1/4" bugle screws. The mating keeper was mounted to the exterior meeting stile glazing bead with two (2) #6 x 1-1/4" bugle head screws.	3 Sets
Face Mount Impact Latch	Metal housing with spring loaded metal bolt	The latch was attached to the top of the interior meeting stile end with two (2) #8 x 1-1/4" & one (1) #8 x 1-1/2" bugle head screws.	1
Latch Retainer Block	Metal	Attached in the head cavity pocket at the latch location with one (1) #8 x 1-3/4" bugle head screw	
Tandem Roller	Formed nylon housing 1/2" (13mm) wide x 2-3/4" (70mm) long with metal rollers	Fitted into the bottom rail 5-3/8" (137mm) from each end and secured with two #8 x 3/4" screws.	2 sets

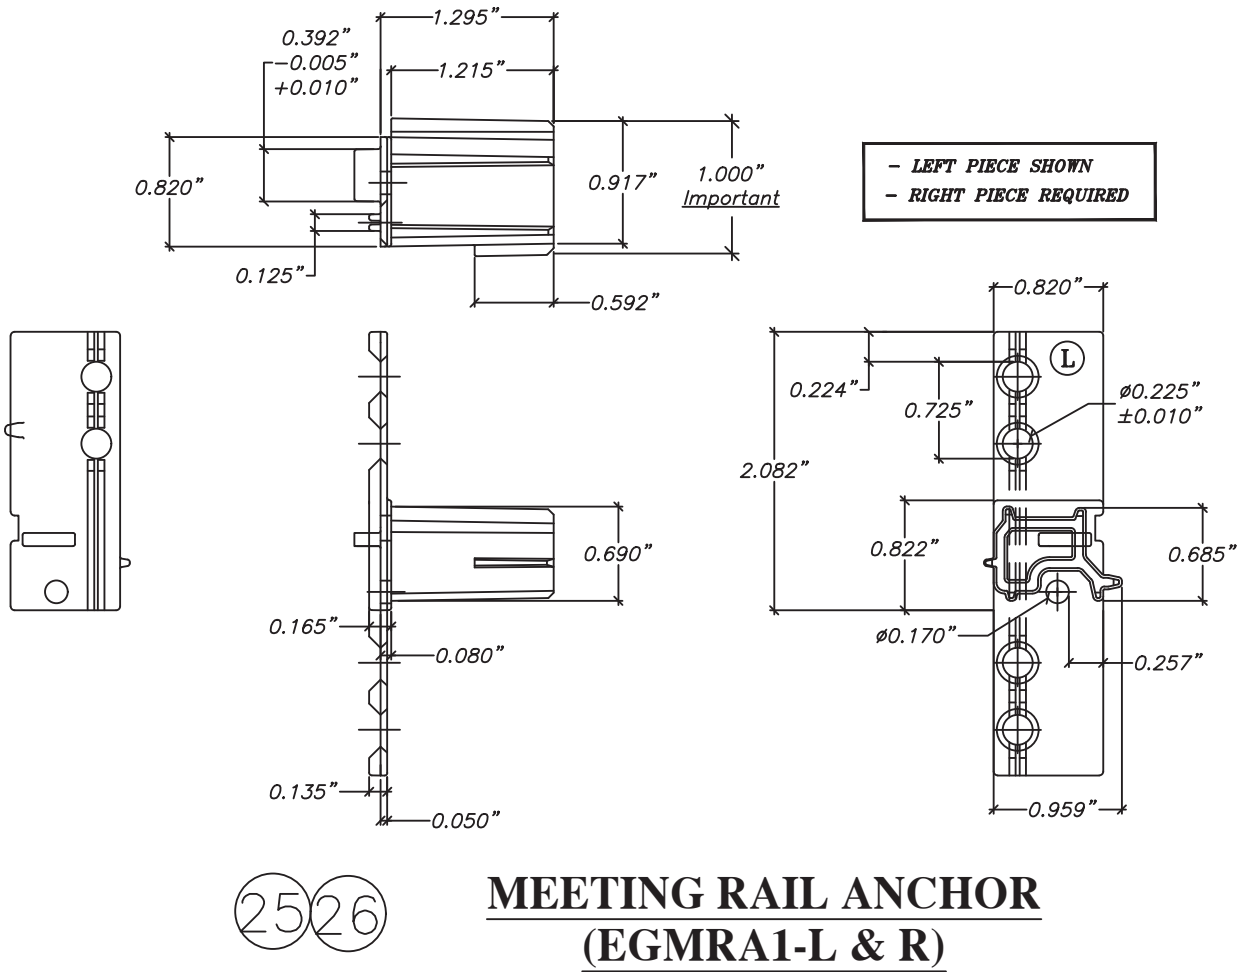

MEETING RAIL ANCHOR (EGMRA1-L & R)

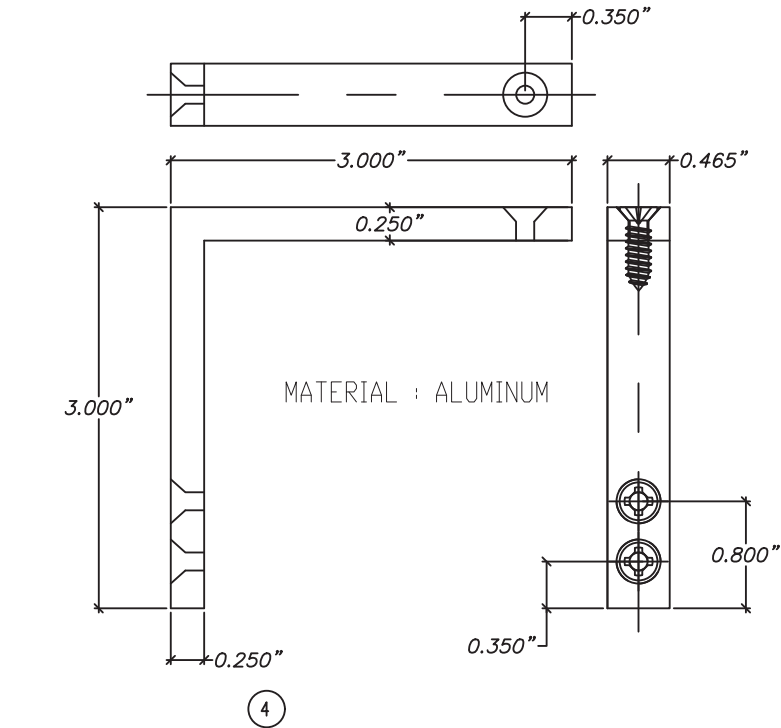

SASH CORNER BRACKET TOP (EGSCB3)

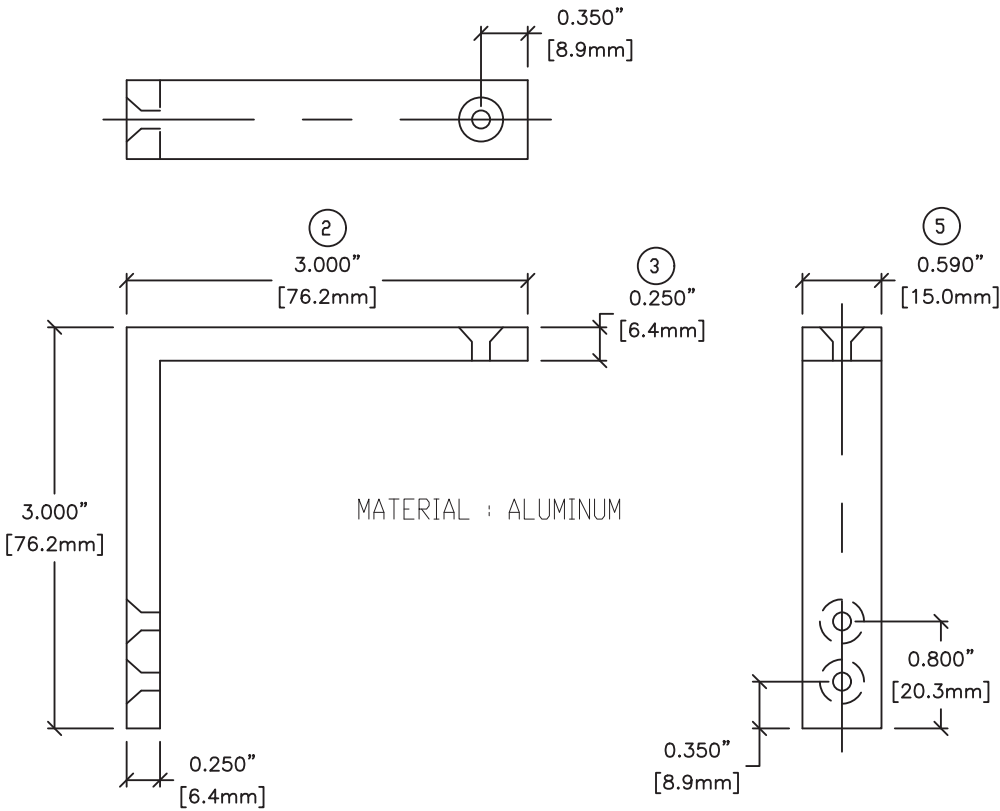

SASH CORNER BRACKET BOTTOM (EGSCB2)

PROJECT NO.	DATE	DESCRIPTION	REV
ACE-2025-305			

ECO GLASS
144 HOPE STREET
LONGWOOD, FL 32750

SERIES S-3400 PVC HORIZONTAL SLIDING WINDOW, IMPACT, HVHZ
COMPONENTS - HARDWARE

DRAWN BY: RJA

SCALE: N.T.S.

REV: ---

DATE: 2/19/2026

DRAWING NO: ECOGLASS020-HVHZ

SHEET: 9 OF 9

ECO GLASS
ADVANCED FLORIDA WINDOW SOLUTION

321-207-0507 | info@vk-ecoglass.com

ROBERT JAMES AMORUSO
LICENSE
No 49752
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

Digitally signed
by Robert J Amoruso
Date: 2026.02.24 10:15:39 -05'00'

ROBERT J. AMORUSO, P.E. #49752
AMORUSO CONSULTING ENG., LLC
FBPE REGISTRATION NO. 38327
226 N NOVA RD, NO. 142
ORMOND BEACH, FL 32174
RJAENGPE@GMAIL.COM