

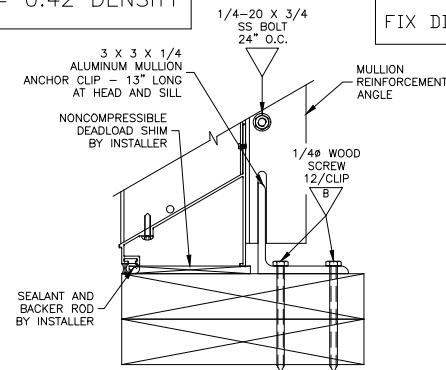


WOOD OPENING MINIMUM G = 0.42 DENSITY

(A) JAMB ANCHOR


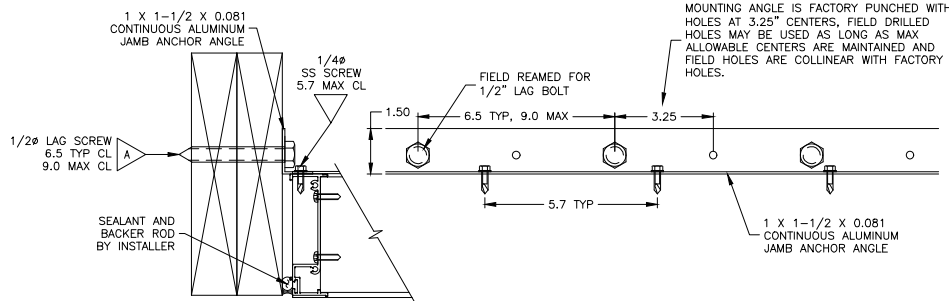


(C) MULLION ANCHOR

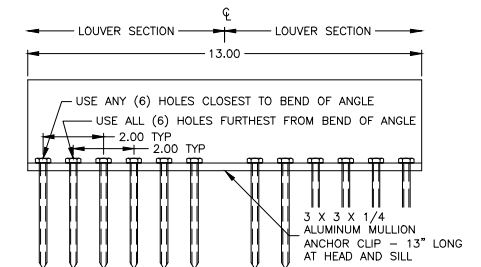


MASONRY OPENING

(A) JAMB ANCHOR

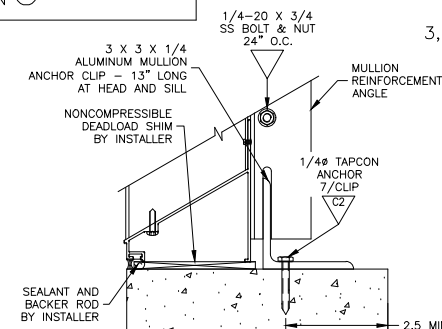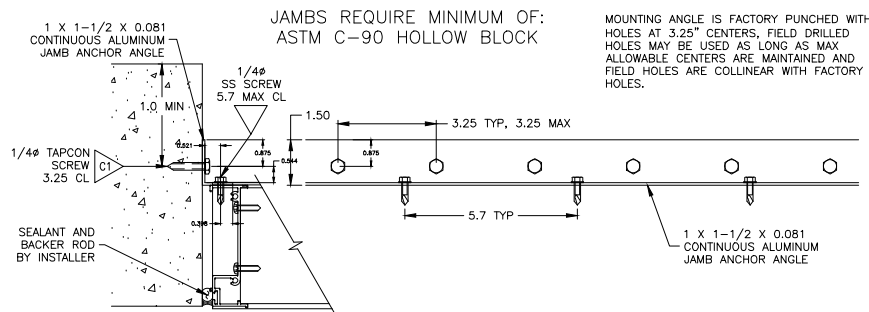


MULLION ANCHORS REQUIRE MINIMUM OF:
3,192 PSI CONCRETE OR
3,192 PSI GROUT FILLED ASTM C-90 HOLLOW BLOCK


(C) MULLION ANCHOR

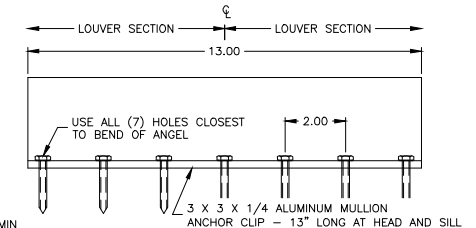


W/O SUPPORT ANGLE

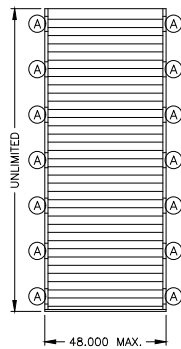


W/ SUPPORT ANGLE

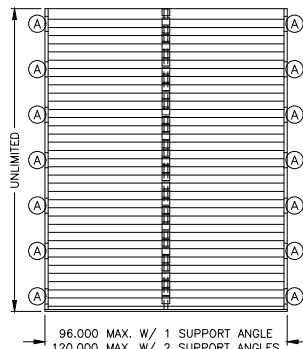

MULTIPLE SECTION W/ MULLION

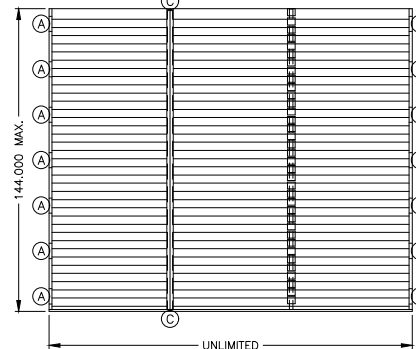

AVAILABLE SHAPES

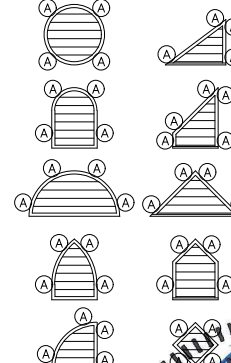

FIELD FASTENER SCHEDULE (BY INSTALLER)

TYPE	DESCRIPTION	MIN. EMBED.	MIN. EDGE DIST.	MIN. SPACING
A	1/2\" LAG SCREW	3"	2 1/2"	3"
B	1/4\" WOOD SCREW	3"	1 1/2"	1 1/2"
C1	1/4\" TAPCON ANCHOR	1 1/4"	1"	3.25" (MAX)
C2	1/4\" TAPCON ANCHOR	1 3/4"	2.5"	2" (MAX)

INSTALLER TO PROVIDE SEPARATION OF DISSIMILAR MATERIALS AS REQUIRED


INSTRUCTIONAL

PAINT	PART NO.	MAT'L	GAUGE	DESCRIPTION
				UTTECH
				DATE 03/18/2019
				ENGINEER IAN65091
				SUPERSEDES ESD-435X
				SCALE
				OM PART # 469319
				CAD DRAWING NO.
				618112

GREENHECK

ESD-435X
INSTALLATION DETAILS
1 OF 2

Digitally signed by Hermes F Norero
Reason: I am approving this document
Date: 2021.07.11 19:47:15 -04'00'

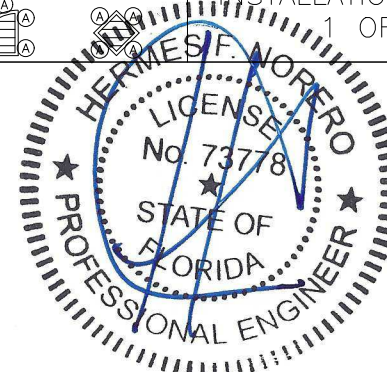

Hermes F. Norero, P.E.
FL PE No. 73778
Building Drops, Inc.
398 Dania Beach Blvd.
Suite 338
Dania Beach, FL 33004
FBPE Cert. of Auth. 29578

