


Co.Me.P Infissi SRL
OS2 75 & 65 FRENCH OUTSWING DOOR
(HVHZ) (IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
- TAS 201-94
 - TAS 202-94
 - TAS 203-94
 - ASTM E1886-19
 - ASTM E1996-17
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS. IN HVHZ AREAS, ONE TIME PRODUCT APPROVAL TO BE OBTAINED FROM MIAMI-DADE RER OR AHJ.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. FRAME MATERIAL: GALVANIZED STEEL, CORTEN STEEL, STAINLESS STEEL OR OT/67 (BRASS)
7. GLASS MEETS THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAILS.
8. TYPICAL FRENCH DOOR (XX) ELEVATIONS SHOWN, SINGLE DOOR (X) QUALIFIED TO MAX. LEAF SIZE SHOWN.

DESIGN PRESSURE TABLE			
SERIES	SIZE	CONFIGURATION	DESIGN PRESSURE
OS2 75	72" X 108"	RECTANGLE XX	+60 / -60 PSF
OS2 75	36" X 108"	RECTANGLE X	+60 / -60 PSF
OS2 75	72" X 108"	ROUND TOP XX	+60 / -60 PSF
OS2 75	72" X 108"	ARCH TOP XX	+60 / -60 PSF
OS2 65	72" X 96"	RECTANGLE XX	+60 / -60 PSF
OS2 65	72" X 96"	ROUND TOP XX	+60 / -60 PSF
OS2 65	72" X 72"	RECTANGLE XX	+75 / -75 PSF

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES & GLAZING DETAILS
2	ELEVATIONS
3	ANCHOR LAYOUTS
4	VERTICAL SECTIONS
5	HORIZONTAL SECTIONS
6	HORIZONTAL SECTIONS
7	INSTALLATION NOTES, ANCHOR DETAILS & SCHEDULE
8	APPROVED FRAME & GLAZING BEAD PROFILES

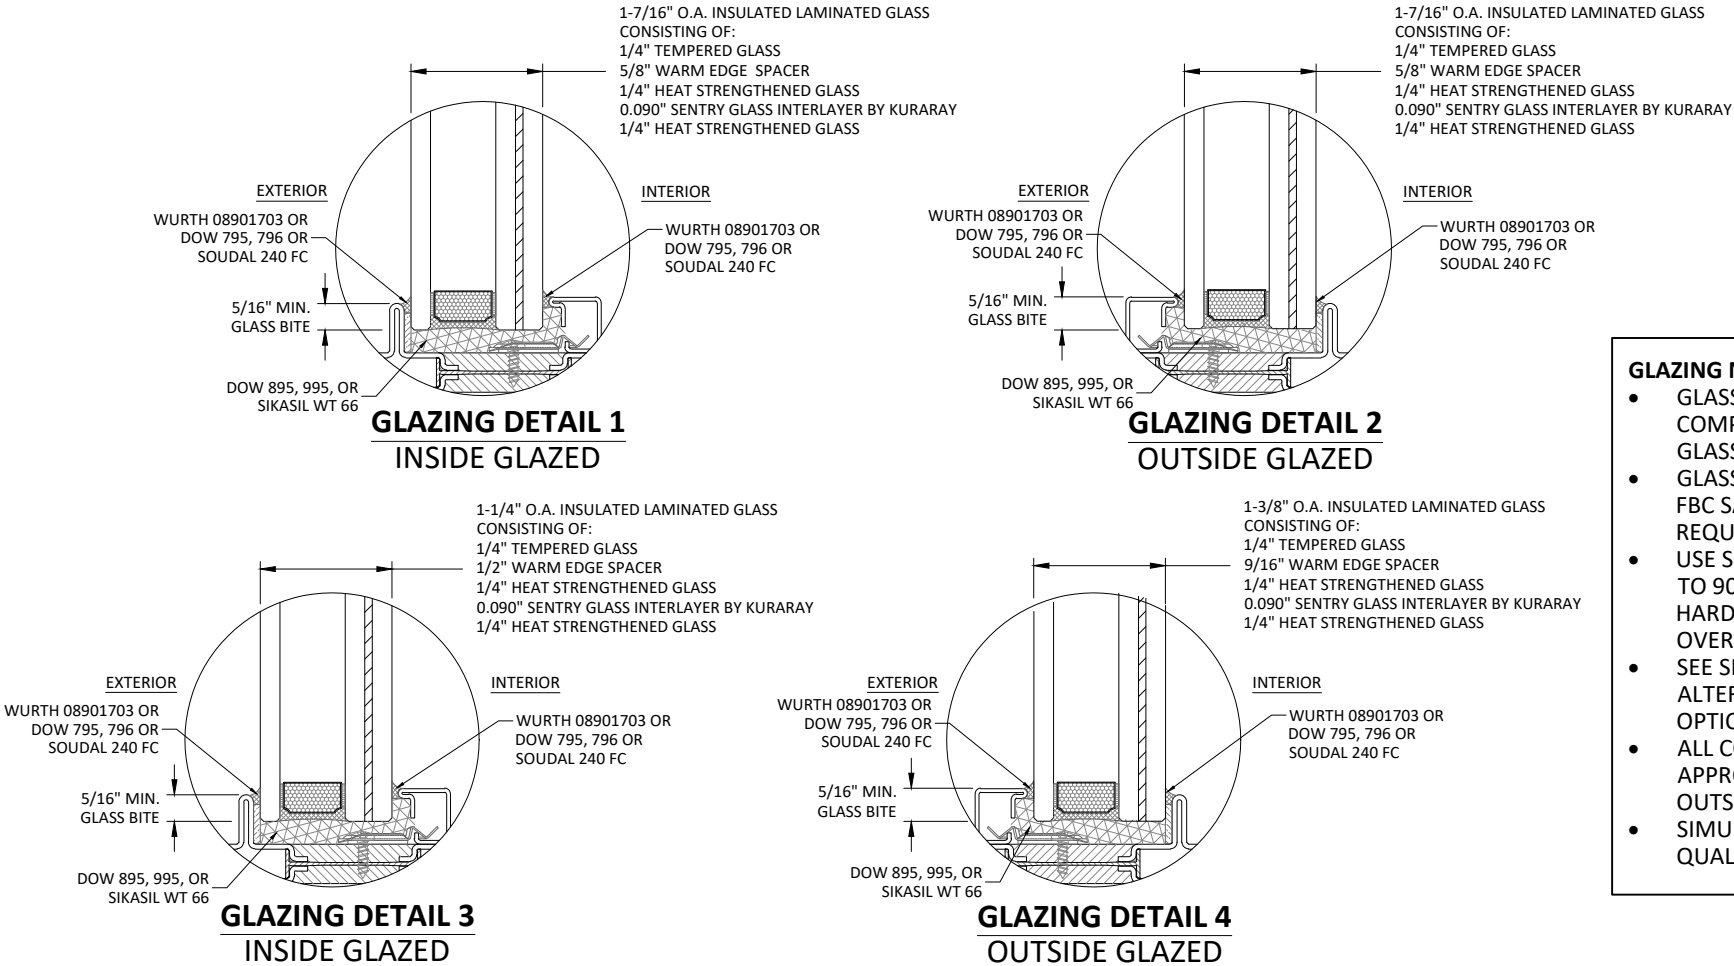

- GLAZING NOTES:**
- GLASS THICKNESS AND TYPE COMPLIES WITH ASTM E-1300 GLASS CHART REQUIREMENTS.
 - GLASS TYPE COMPLIES WITH FBC SAFETY GLAZING REQUIREMENTS.
 - USE SETTING BLOCKS WITH 70 TO 90 SHORE A DUROMETER HARDNESS AT SILL FOR UNITS OVER 3 FEET IN WIDTH
 - SEE SHEET 8 FOR DETAILS OF ALTERNATE GLAZING BEAD OPTIONS
 - ALL CONFIGURATIONS APPROVED AS INSIDE OR OUTSIDE GLAZED
 - SIMULATED DIVIDED LITE IS QUALIFIED



Co.Me.P Infissi SRL
51039 SANTONUOVO PT
PISTOIA, ITALIA

TITLE:
OS2 75 & 65 FRENCH OUTSWING DOOR
(HVHZ)(IMPACT)
GENERAL NOTES &
GLAZING DETAILS


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT UNIT 2-15
MIAMI, FLORIDA 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2025.04.22 18:46:57 -04'00'

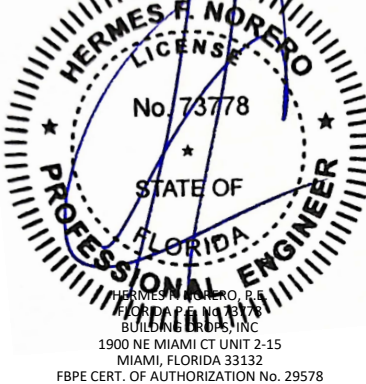


FL #:	FL36832
DATE:	03.17.2025
DWG. BY:	FB
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	COM015
SHEET:	1


c:\users\franciscobriceno\building drops, inc\building drops landing - common\projects\comep infissi\fb-c-24-1163.2 - fbc submittal - os2 & ebe product revisions\dwgs\os2 door\com015 - series os2outwing french door (02.05).dwg 4/17/2025 9:54 AM

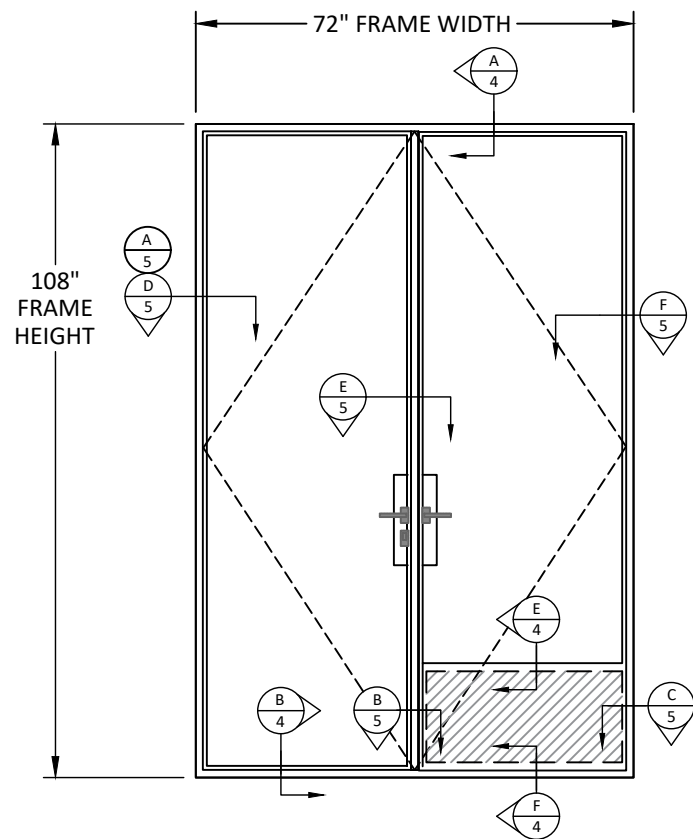


ELEVATION
X-X OS2 75

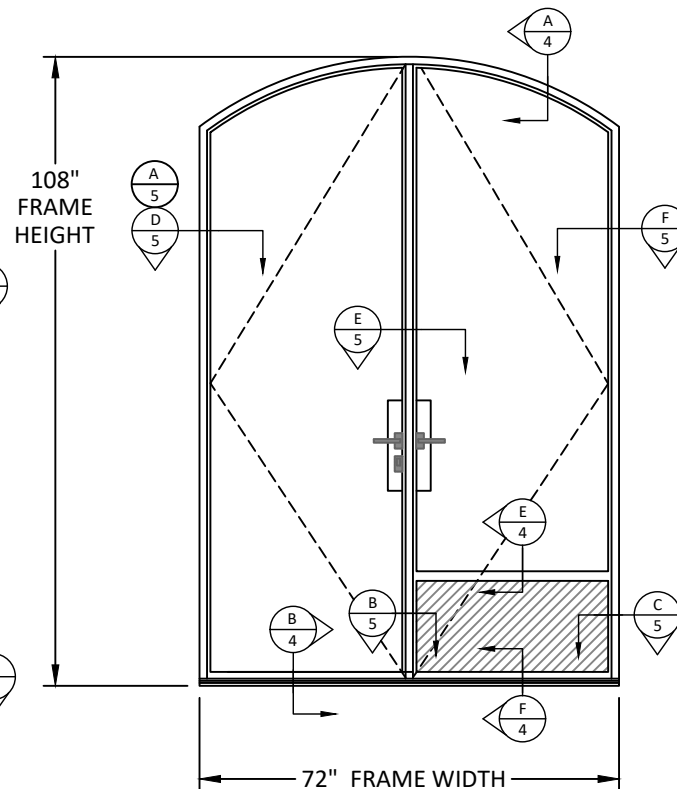


ELEVATION
X-X OS2 75

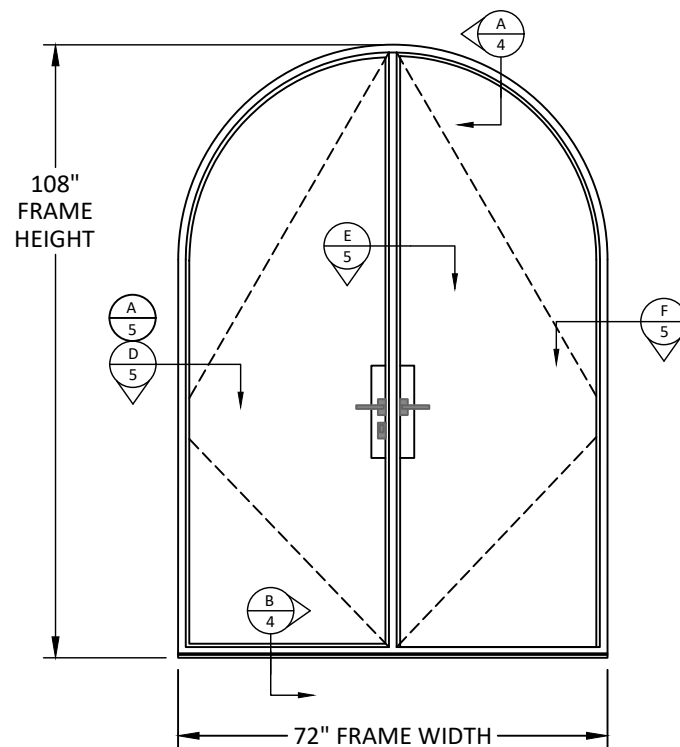


ELEVATION
X-X OS2 75

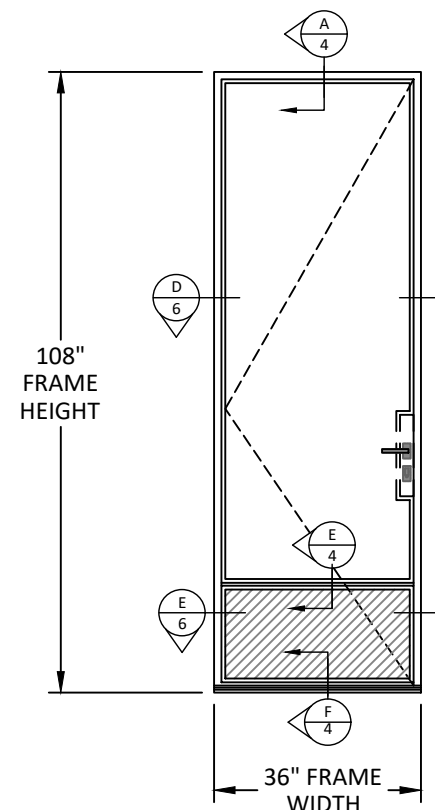


ELEVATION
X OS2 75

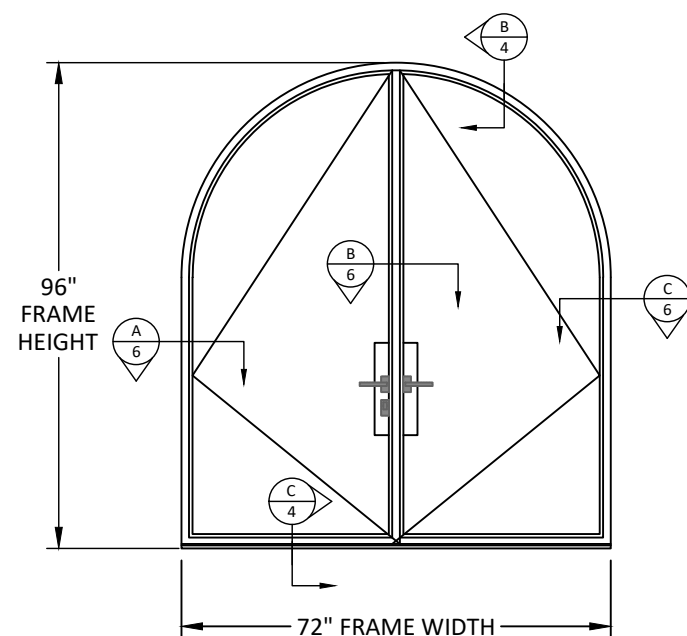

ELEVATION
X-X OS2 65

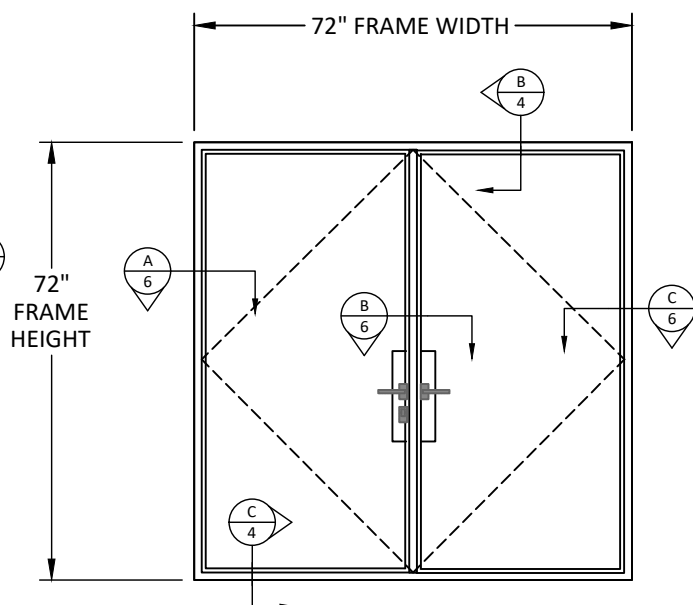

ELEVATION
X-X OS2 65

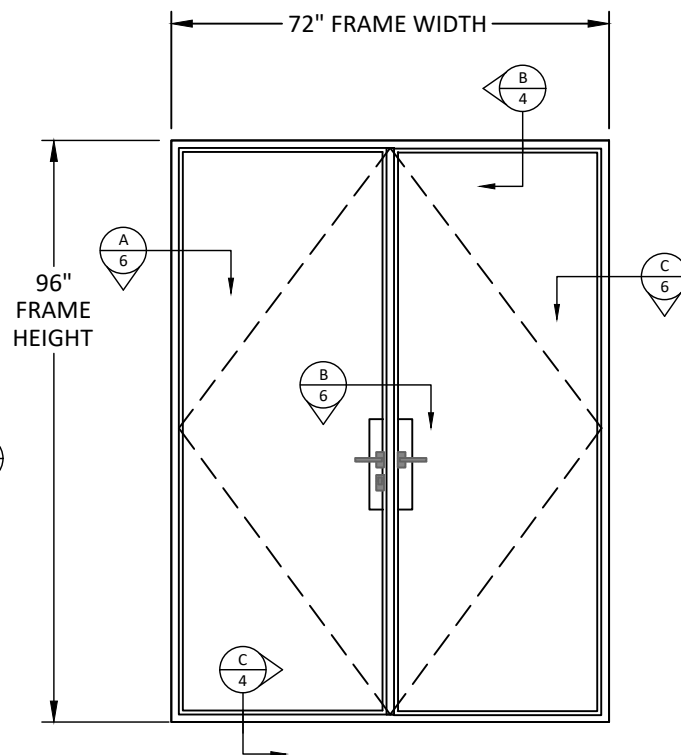

ELEVATION
X-X OS2 65

DOOR LEGEND:

SERIES 65:

D.L.O. WIDTH = $W/2 - 5.00"$
D.L.O. HEIGHT = $H - 4.34"$
LEAF WIDTH = $W/2 - 0.83"$
LEAF HEIGHT = $H - 2"$

SERIES 75:

D.L.O. WIDTH = $W/2 - 6.45"$
D.L.O. HEIGHT = $H - 5.22"$
LEAF WIDTH = $W/2 - 0.57"$
LEAF HEIGHT = $H - 2.5"$

FLUSH PANEL:
MAX. HEIGHT = 15.6"
MAX. WIDTH = 32.9"



Co.Me.P Infissi SRL
51039 SANTONUOVO PT
PISTOIA, ITALIA

TITLE:
OS2 75 & 65 FRENCH OUTSWING DOOR
(HVHZ)(IMPACT)

ELEVATIONS


PREPARED BY:
BUILDING DROPS, INC.

1900 NE MIAMI CT UNIT 2-15
MIAMI, FLORIDA 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

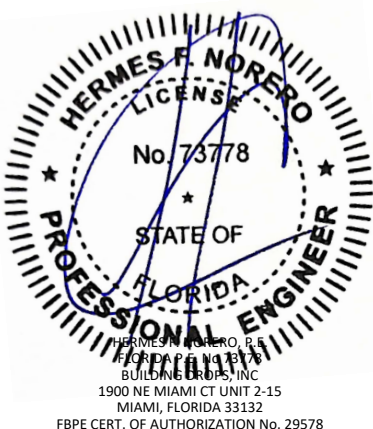

FL #:
FL36832

DATE: **03.17.2025**

DWG. BY: **FB** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **COM015**

SHEET:


2

OF 8


c:\users\franciscobriceno\building drops, inc\building drops landing - common\projects\comep infissi\fb-c-24-1163.2 - fbc submittal - os2 & ebe product revisions\dwgs\os2 door\comd15 - series os2outwing french door (02.05).dwg 4/17/2025 9:54 AM

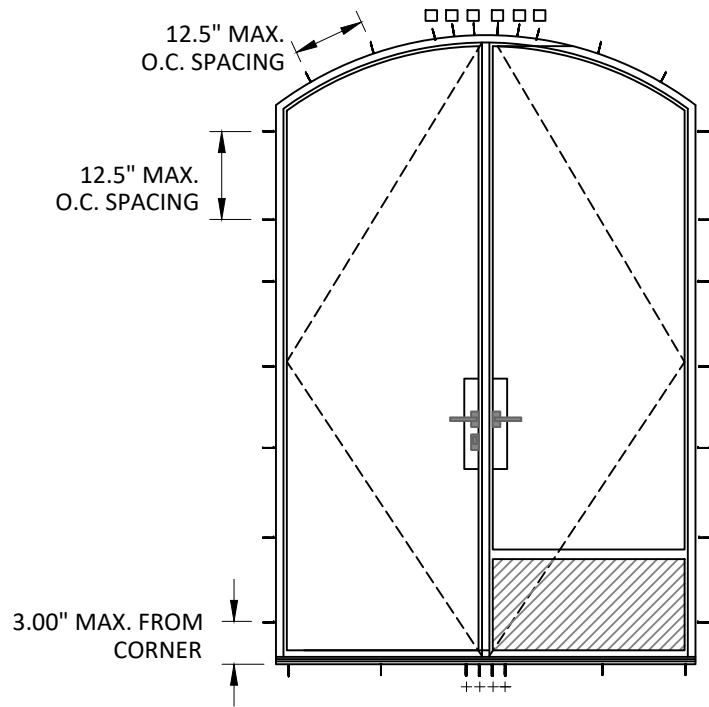


ANCHOR LAYOUT
THROUGH FRAME

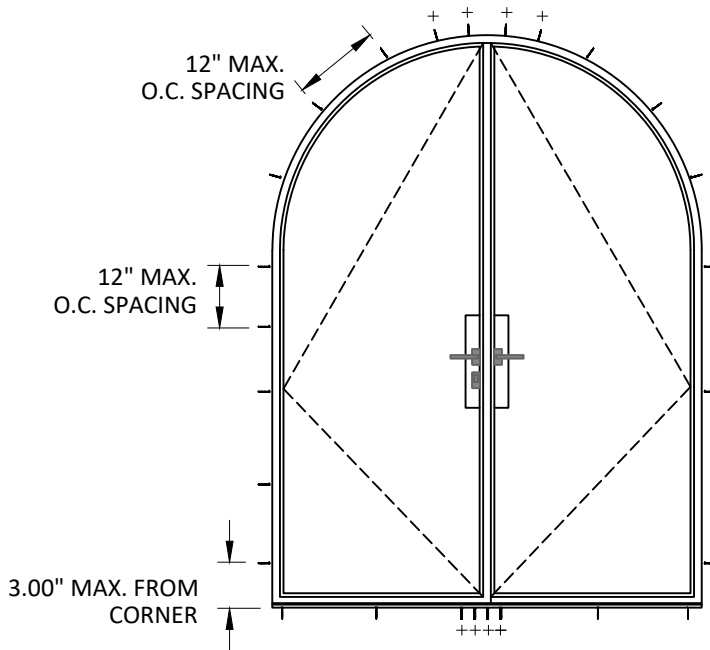

ANCHOR LAYOUT
THROUGH FRAME

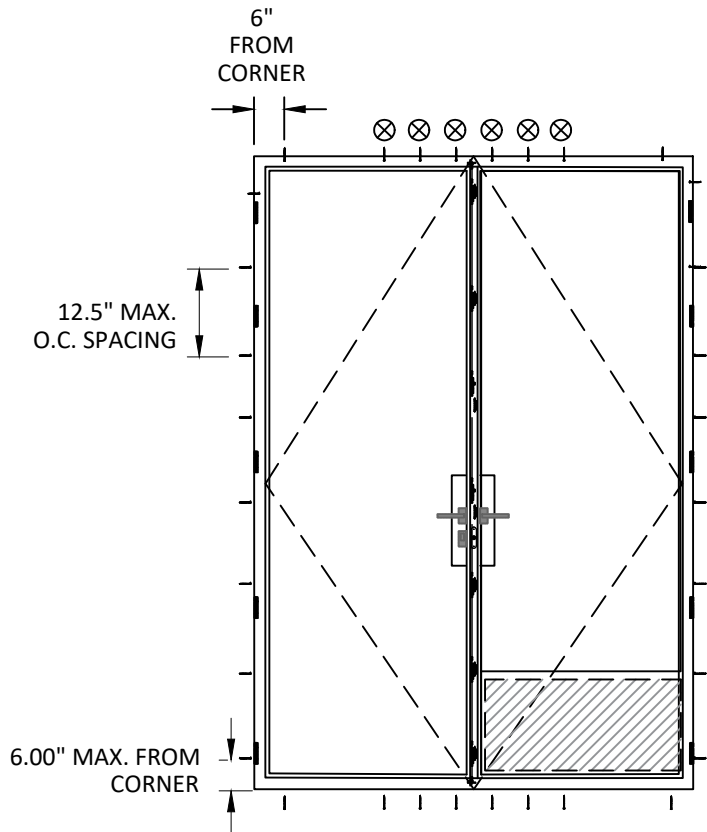

ANCHOR LAYOUT
THROUGH FRAME

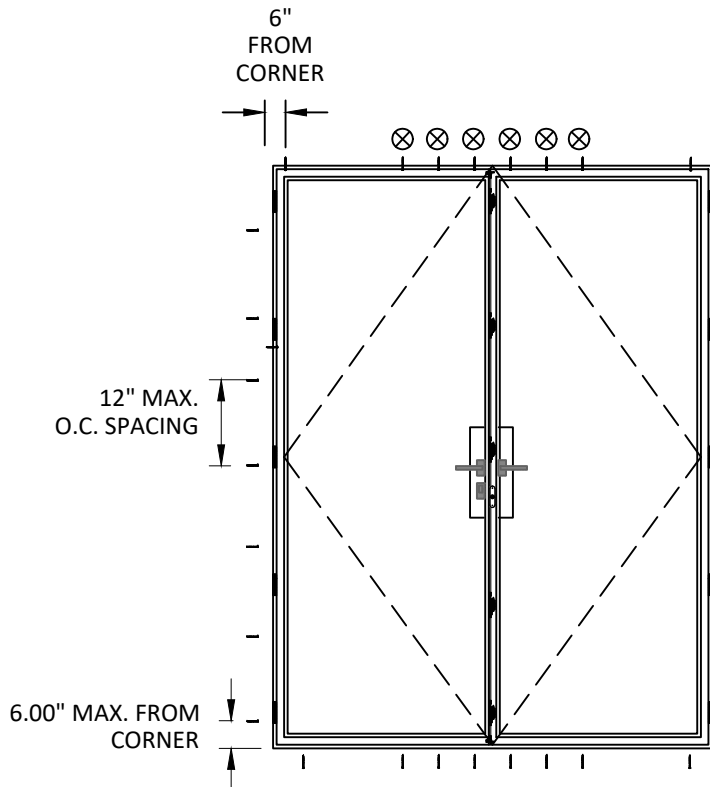

ANCHOR LAYOUT
THROUGH FRAME

ANCHOR LEGEND:

- + = ANCHOR CLUSTER, ANCHORS SPACED AT 3.50" O.C.
- = ANCHOR CLUSTER, ANCHORS SPACED AT 3.90" O.C.
- ⊗ = ANCHOR CLUSTER, ANCHORS SPACED AT 6.00" O.C.

- NOTE:
- ANCHOR SPACING AT SILL IS SIMILAR TO THAT AT HEAD.
 - SPACING IS CONSISTENT BETWEEN ANCHORING OPTIONS PRESENTED ON SHEET 7.



Co.Me.P Infissi SRL
51039 SANTONUOVO PT
PISTOIA, ITALIA

TITLE:
OS2 75 & 65 FRENCH OUTSWING DOOR
(HVHZ)(IMPACT)

ANCHOR LAYOUTS


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI CT UNIT 2-15
MIAMI, FLORIDA 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

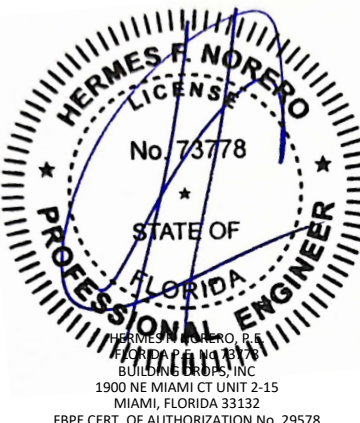


FL #:	FL36832
DATE:	03.17.2025
DWG. BY:	FB
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	COM015
SHEET:	3

c:\users\franciscobriceno\building drops, inc\building drops landing - common\projects\comep infissi\fb-c-24-1163.2 - fbc submittal - os2 & ebe product revisions\dwgs\os2 door\com015 - series os2outwing french door (02.05).dwg 4/17/2025 9:54 AM

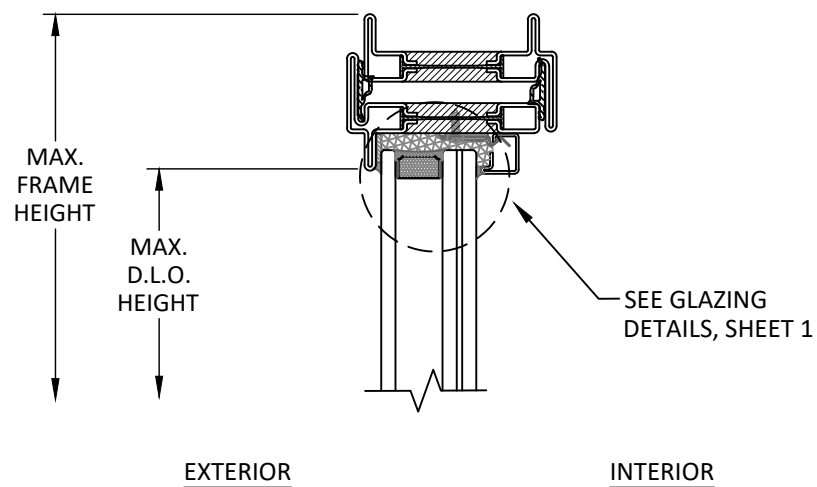


A
4 **VERTICAL SECTION**
TYP. (INSIDE GLAZED) HEAD
SERIES 75

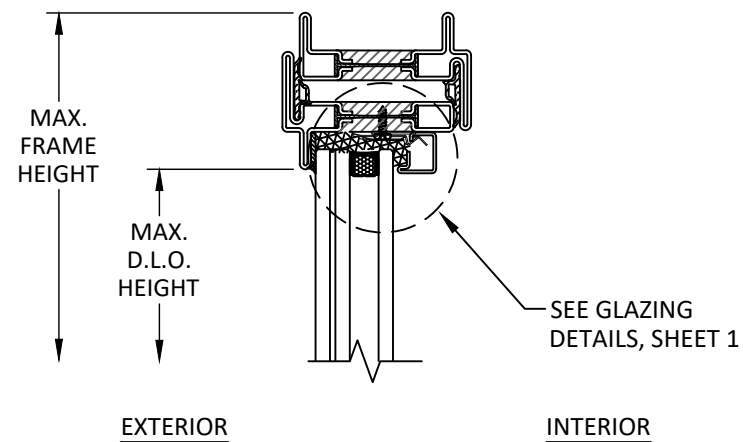


C
4 **VERTICAL SECTION**
TYP. (INSIDE GLAZED) HEAD
SERIES 65


NOTE:
INSIDE GLAZED SHOWN, ALL CONFIGURATIONS
APPROVED FOR INSIDE OR OUTSIDE GLAZED

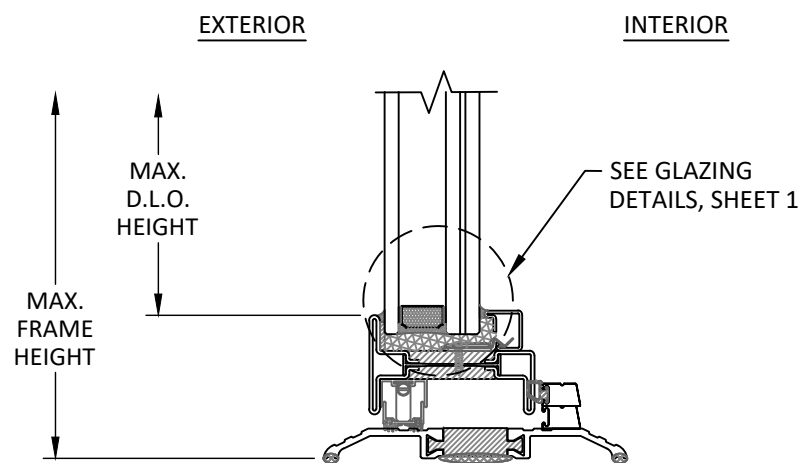


B
4 **VERTICAL SECTION**
TYP. (INSIDE GLAZED) SILL
SERIES 75

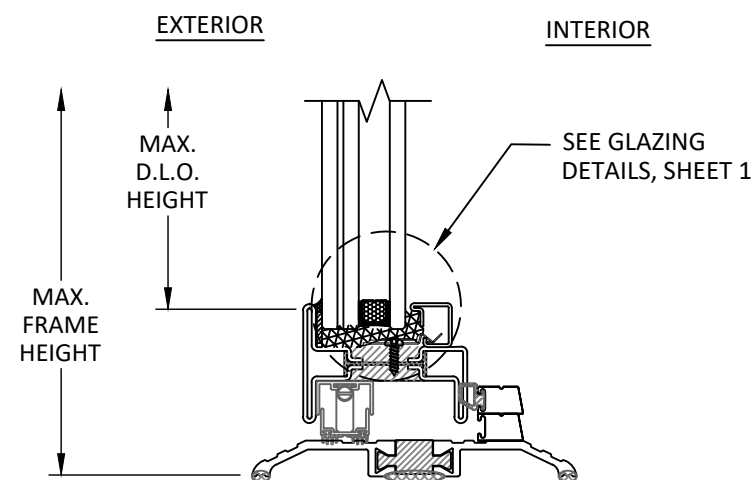

D
4 **VERTICAL SECTION**
TYP. (INSIDE GLAZED) SILL
SERIES 65

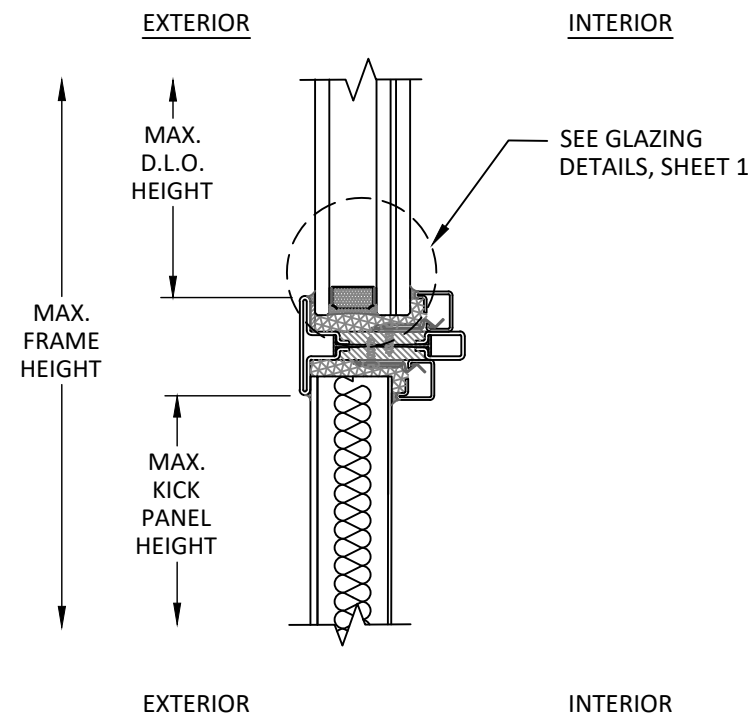

E
4 **VERTICAL SECTION**
MIDRAIL (INSIDE GLAZED) - KICK PANEL
SERIES 75

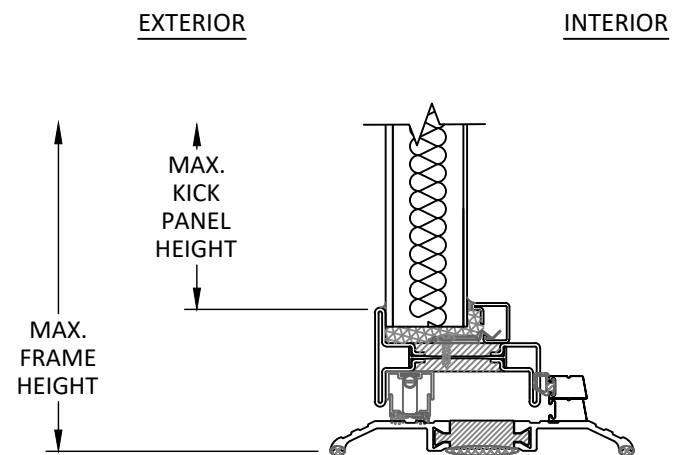

F
4 **VERTICAL SECTION**
TYP. (INSIDE GLAZED) SILL - KICK PANEL
SERIES 75



Co.Me.P Infissi SRL
51039 SANTONUOVO PT
PISTOIA, ITALIA

TITLE:
OS2 75 & 65 FRENCH OUTSWING DOOR
(HVHZ)(IMPACT)


VERTICAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT UNIT 2-15
MIAMI, FLORIDA 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

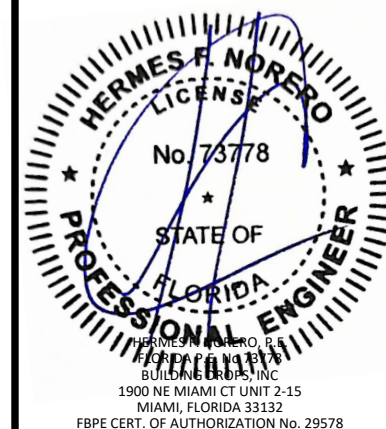

FL #:
FL36832

DATE: **03.17.2025**

DWG. BY: FB	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**


DWG. #: **COM015**

SHEET:

4

OF 8

c:\users\franciscobriceno\building drops, inc\building drops landing - common\projects\comep infissi\fb-c-24-1163.2 - fbc submittal - os2 & ebe product revisions\dwgs\os2 door\com015 - series os2outwing french door (02.05).dwg 4/17/2025 9:54 AM

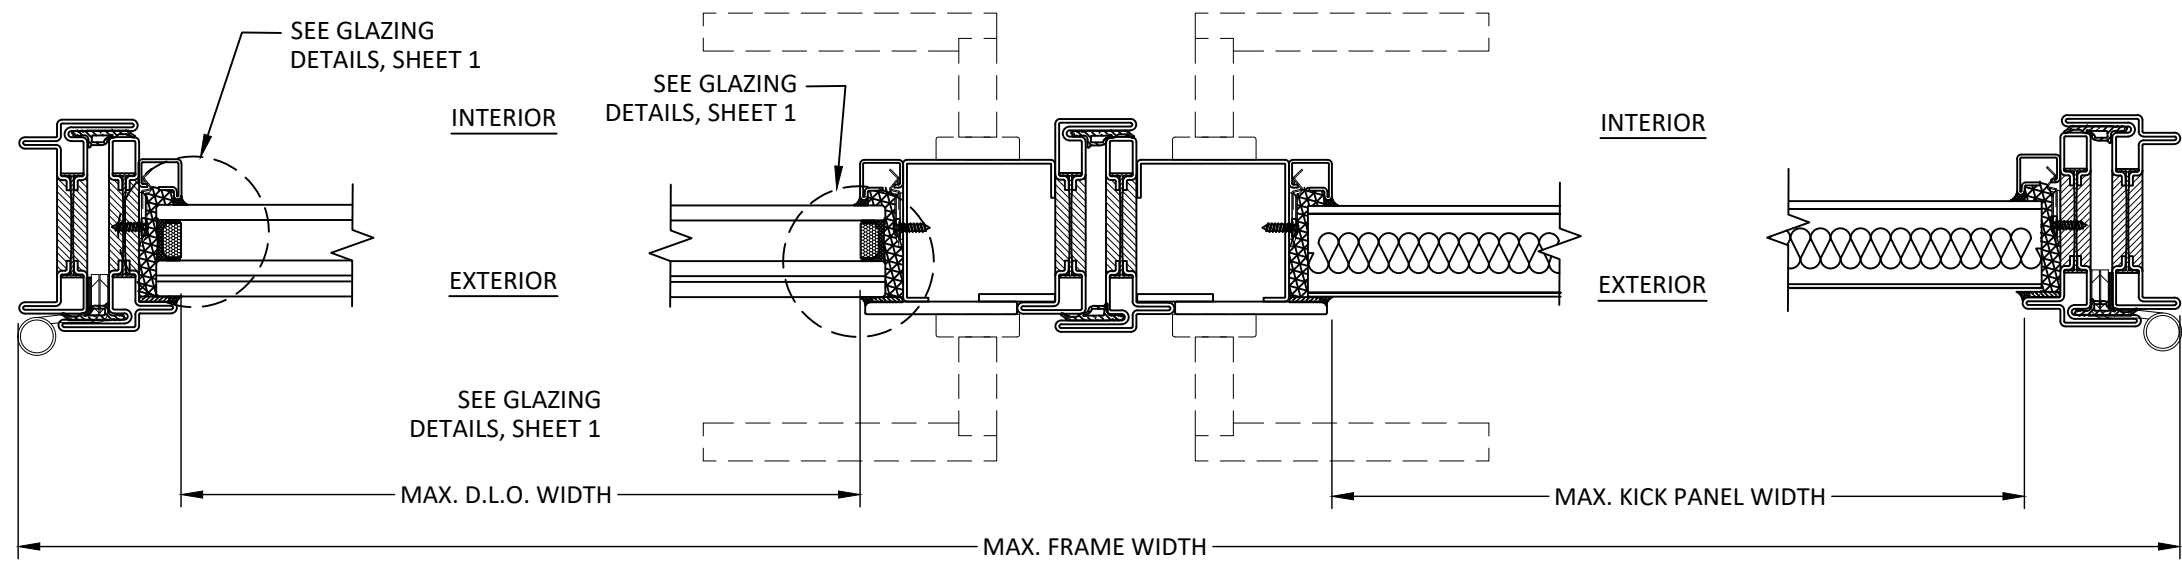


A
5 **HORIZONTAL SECTION**
JAMB TYP. - INSIDE GLAZED
SERIES 75

B
5 **HORIZONTAL SECTION**
ASTRAGAL TYP. - INSIDE GLAZED
SERIES 75

C
5 **HORIZONTAL SECTION**
JAMB - KICK PANEL TYP. - INSIDE GLAZED
SERIES 75

NOTE:
ALL CONFIGURATIONS APPROVED FOR INSIDE OR
OUTSIDE GLAZED

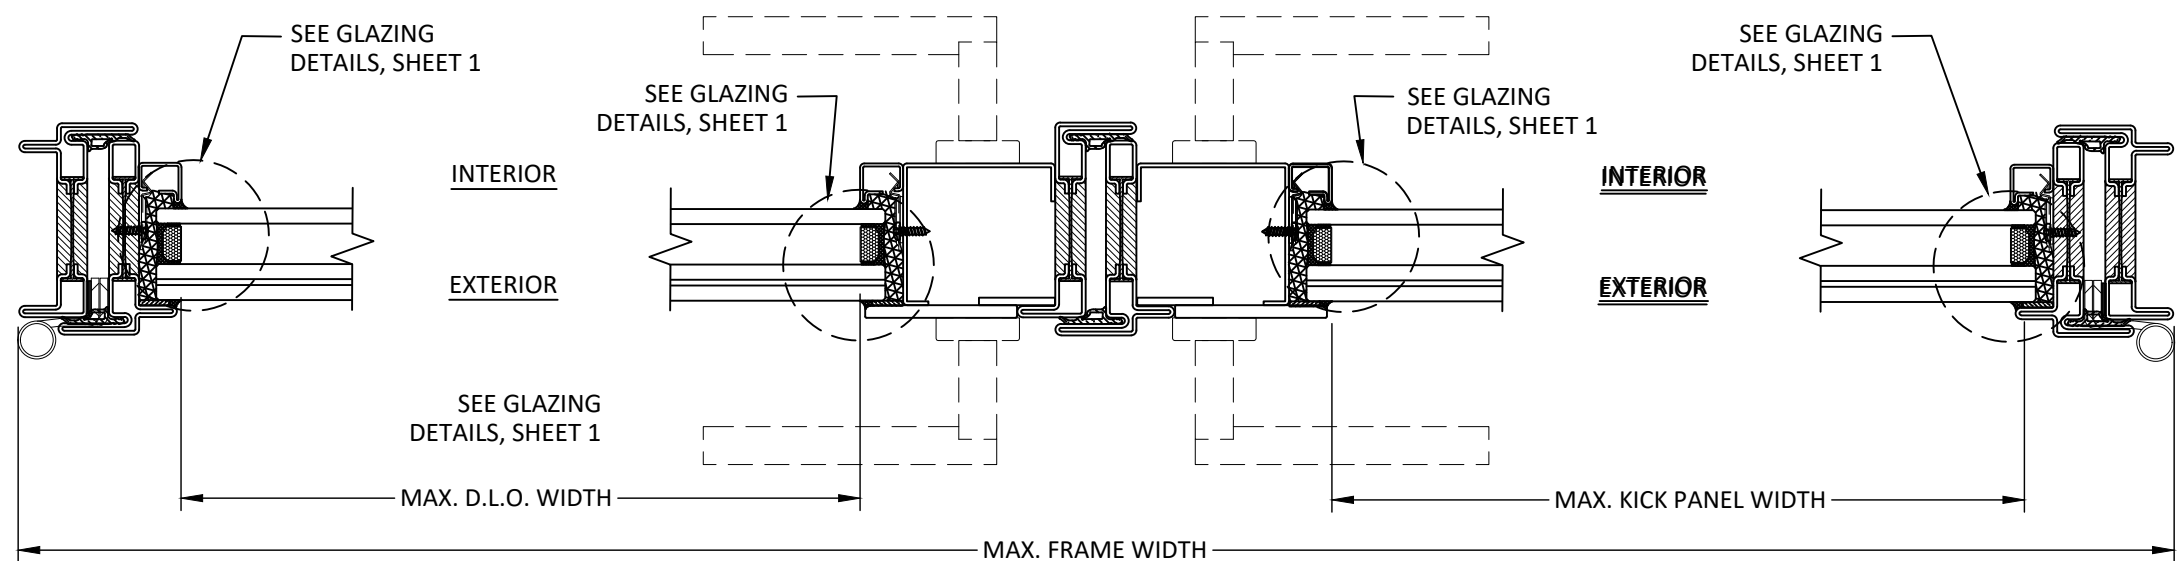

D
5 **HORIZONTAL SECTION**
JAMB TYP. - INSIDE GLAZED
SERIES 75

E
5 **HORIZONTAL SECTION**
ASTRAGAL TYP. - INSIDE GLAZED
SERIES 75

F
5 **HORIZONTAL SECTION**
JAMB TYP. - INSIDE GLAZED
SERIES 75

NOTE:
ALL CONFIGURATIONS APPROVED FOR INSIDE OR
OUTSIDE GLAZED



Co.Me.P Infissi SRL
51039 SANTONUOVO PT
PISTOIA, ITALIA

TITLE:
OS2 75 & 65 FRENCH OUTSWING DOOR
(HVHZ)(IMPACT)

HORIZONTAL SECTIONS


PREPARED BY:
BUILDING DROPS, INC.

1900 NE MIAMI CT UNIT 2-15
MIAMI, FLORIDA 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

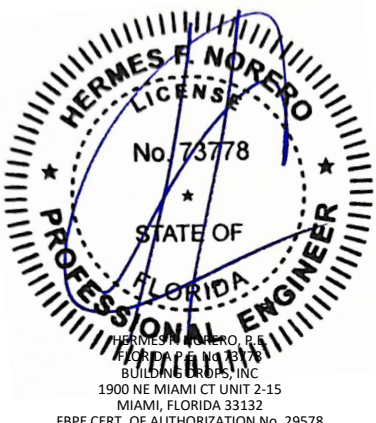

FL #:	FL36832
DATE:	03.17.2025
DWG. BY:	CHK. BY:
FB	HFN
SCALE:	NTS
DWG. #:	COM015
SHEET:	5

c:\users\franciscobriceno\building drops, inc\building drops landing - common\projects\comep infissi\fb-c-24-1163.2 - fbc submittal - os2 & ebe product revisions\dwg\os2 door\com015 - series os2outwing french door (02.05).dwg 4/17/2025 9:54 AM

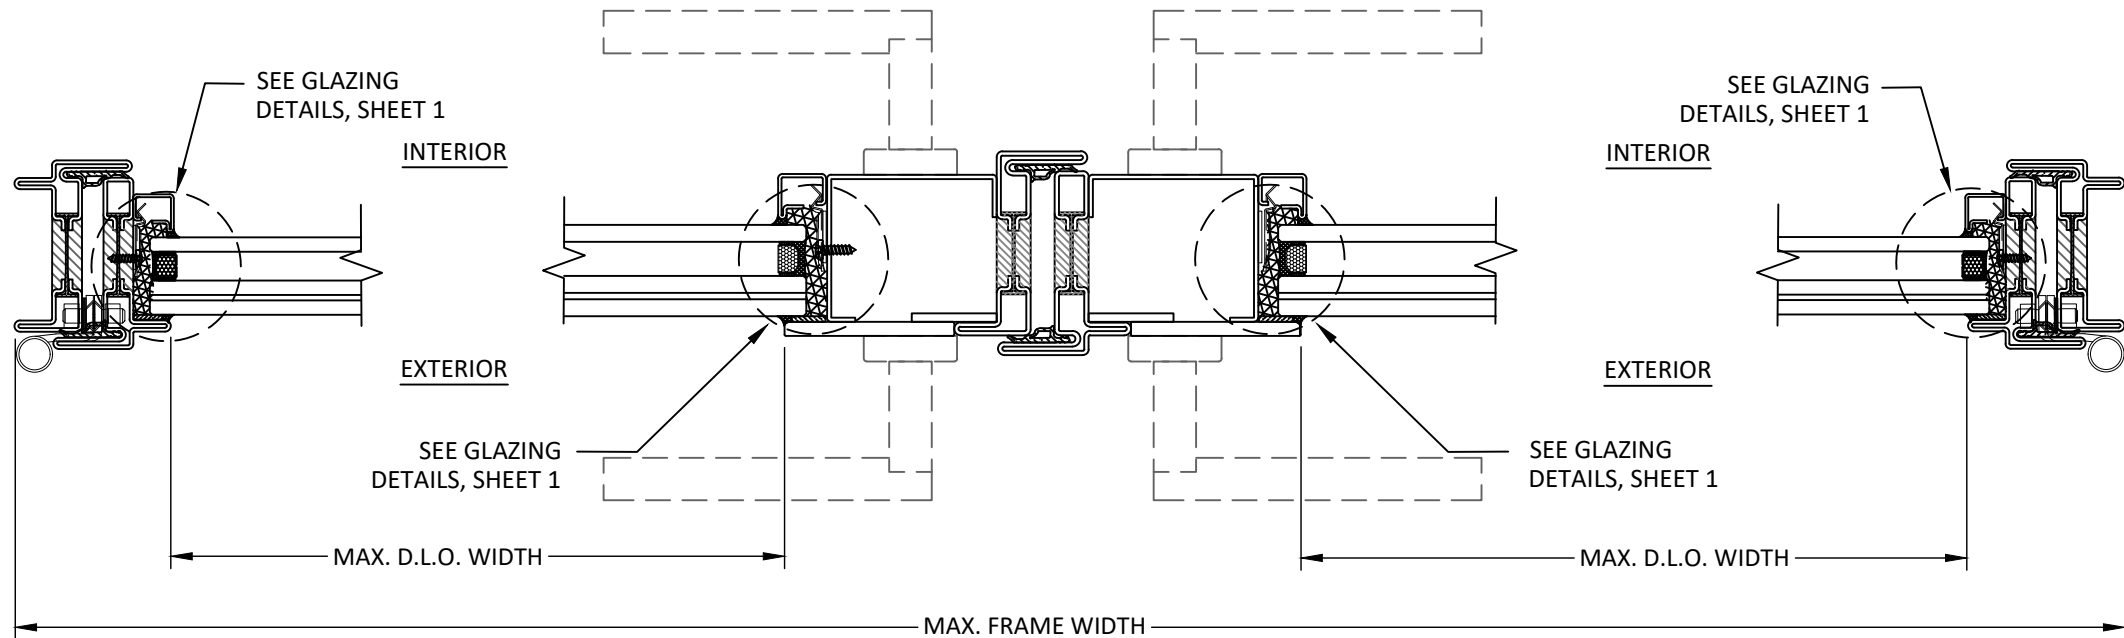


A
6 **HORIZONTAL SECTION**
JAMB TYP. - INSIDE GLAZED
SERIES 65

B
6 **HORIZONTAL SECTION**
ASTRAGAL TYP. - INSIDE GLAZED
SERIES 65


NOTE:
ALL CONFIGURATIONS APPROVED FOR INSIDE OR
OUTSIDE GLAZED

C
6 **HORIZONTAL SECTION**
JAMB TYP. - INSIDE GLAZED
SERIES 65

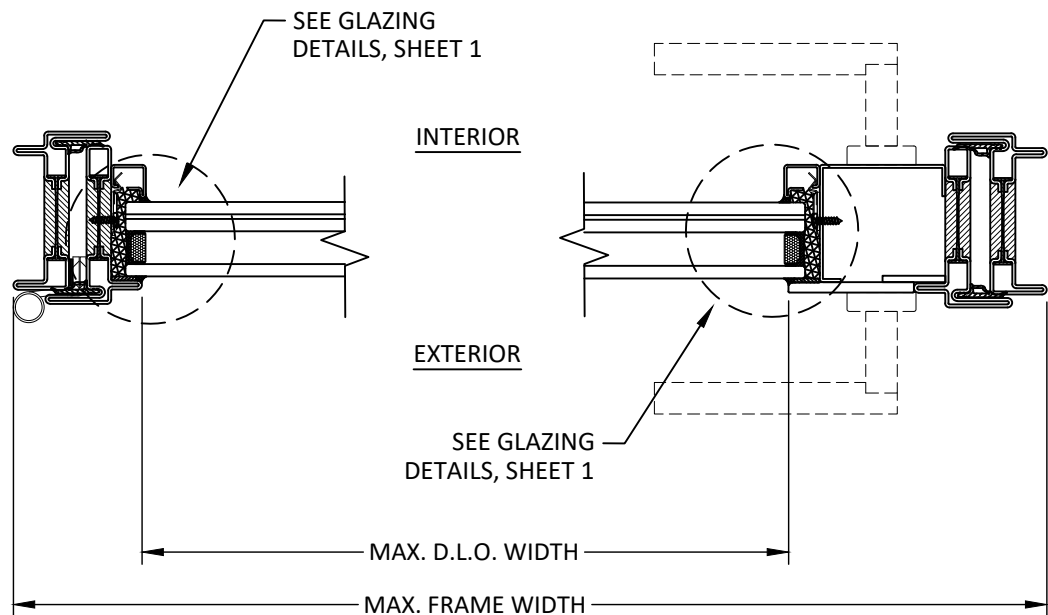

D
6 **HORIZONTAL SECTION**
JAMBS - INSIDE GLAZED
SERIES 75 - SINGLE DOOR

NOTE:
ALL CONFIGURATIONS APPROVED FOR INSIDE OR
OUTSIDE GLAZED

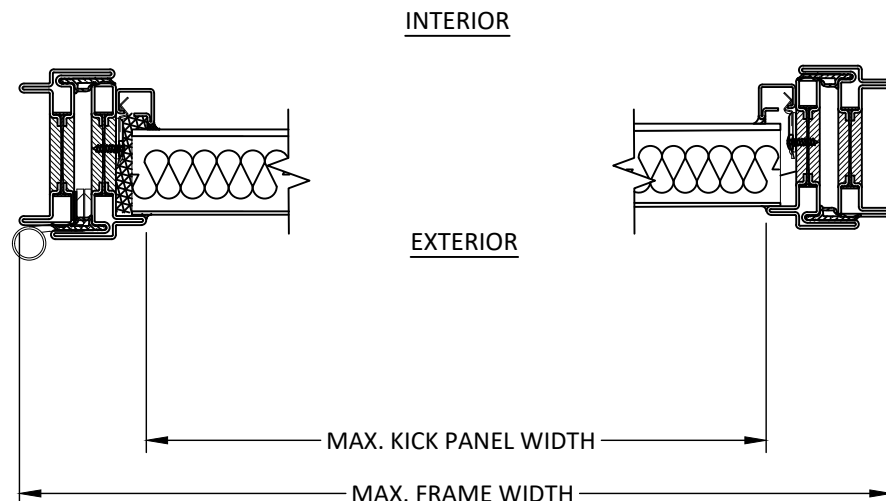

E
6 **HORIZONTAL SECTION**
JAMBS (KICK PANEL) TYP. - INSIDE GLAZED
SERIES 75 - SINGLE DOOR



Co.Me.P Infissi SRL
51039 SANTONUOVO PT
PISTOIA, ITALIA

TITLE:
OS2 75 & 65 FRENCH OUTSWING DOOR
(HVHZ)(IMPACT)

HORIZONTAL SECTIONS


PREPARED BY:
BUILDING DROPS, INC.

1900 NE MIAMI CT UNIT 2-15
MIAMI, FLORIDA 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

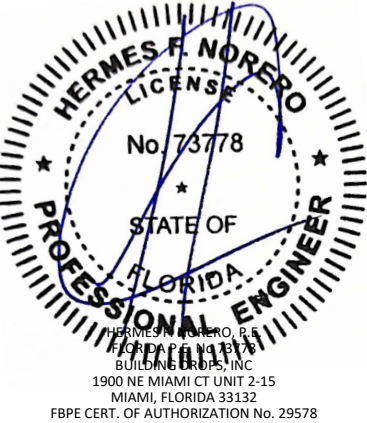

FL #:	FL36832
DATE:	03.17.2025
DWG. BY:	FB
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	COM015
SHEET:	6


c:\users\franciscobriceno\building drops, inc\building drops landing - common\projects\comep infissi\fb-c-24-1163.2 - fbc submittal - os2 & ebe product revisions\dwgs\os2 door\com015 - series os2outwing french door (02.05).dwg 4/17/2025 9:54 AM

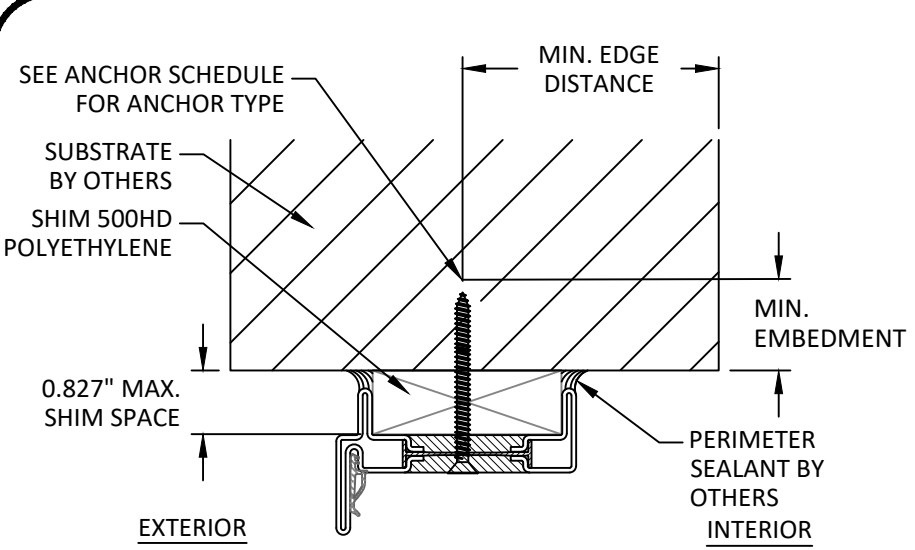

A
7


ANCHOR DETAIL
THROUGH FRAME
MANUFACTURER RECOMMENDED

EXTERIOR INTERIOR

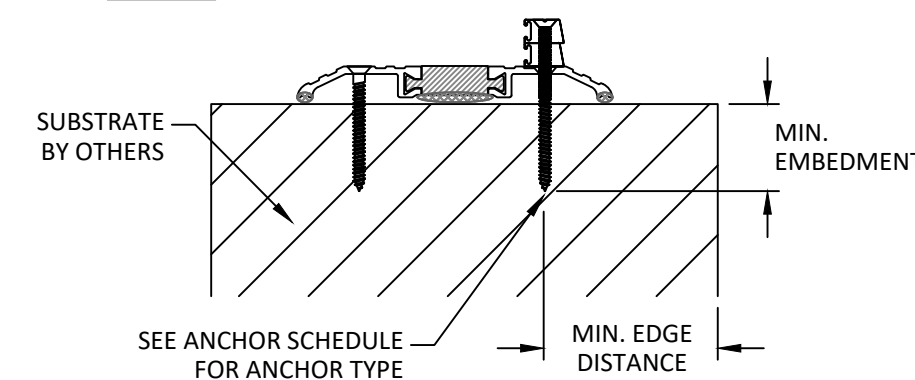

B
7

ANCHOR DETAIL
THRESHOLD

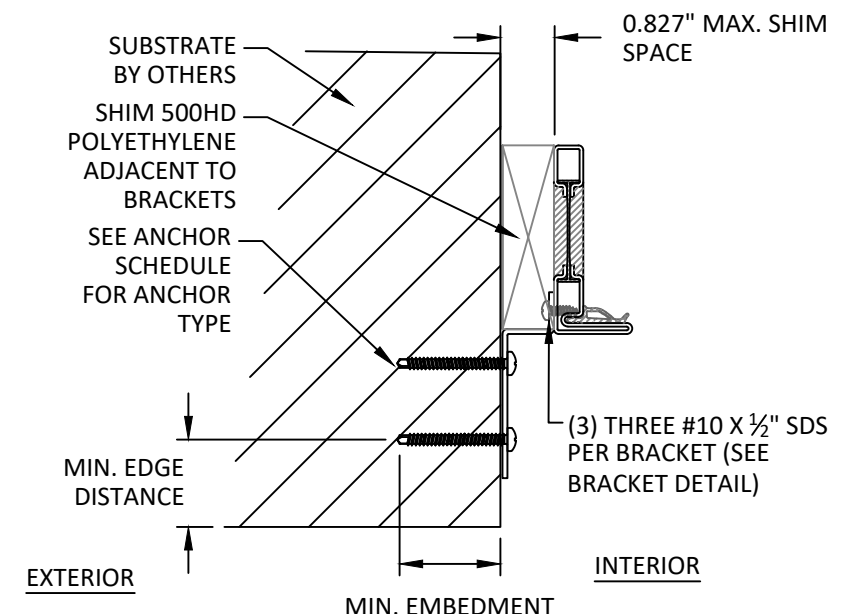


C
7

ANCHOR DETAIL
BRACKET
OPTIONAL

EXTERIOR INTERIOR

BRACKET DETAIL
14 GAUGE STEEL

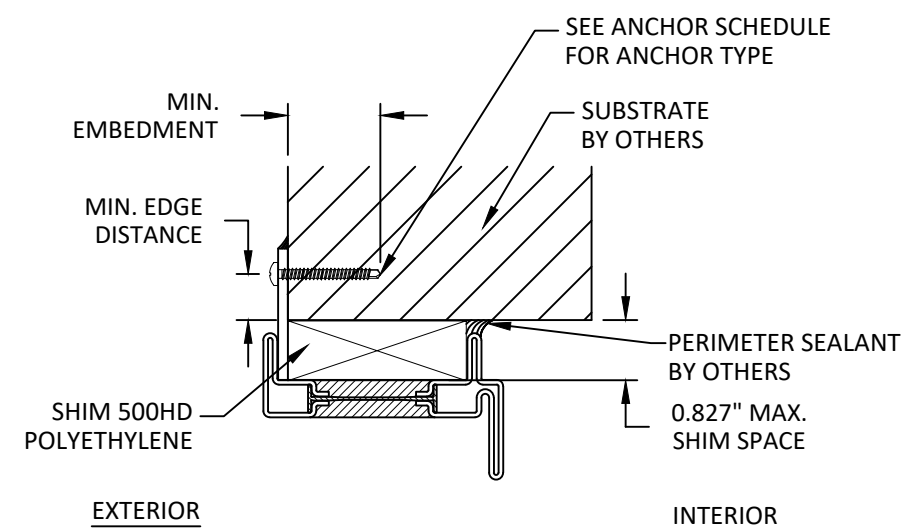

D
7

ANCHOR DETAIL
NAIL FIN
OPTIONAL

EXTERIOR INTERIOR

NOTE:
SECTION DETAIL SHOWN FOR
EACH INSTALLATION TYPE,
HEAD AND JAMB ARE SIMILAR.

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN ON SHEET 3, UNLESS OTHERWISE STATED (SEE TABLE).
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). SEE ABOVE FOR MAXIMUM ALLOWABLE SHIM STACK PER INSTALLATION METHOD. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- FOR MASONRY OR CONCRETE OPENINGS, 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE					
METHOD	SUBSTRATE	ANCHOR TYPE	MIN EMBEDMENT	MIN. EDGE DISTANCE	QUANTITY PER LOCATION
BRACKET	WOOD: MIN. SG = 0.55	#14 WOOD SCREW	1.5"	0.75"	2
	METAL: 18 GA. STEEL, MIN. Fy = 33KSI	1/4" GR. 5 SELF-DRILLING OR SELF-TAPPING SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.75"	2
	CONCRETE: MIN F'c = 3000 PSI OR MASONRY: MIN F'c = 2000 PSI	1/4" ITW TAPCON	1.5"	2.5"	2
THROUGH FRAME	WOOD: MIN. SG = 0.55	#14 WOOD SCREW	1.5"	0.75"	1
	METAL: 18 GA. STEEL, MIN. Fy = 33KSI	1/4" GR. 5 SELF-DRILLING OR SELF-TAPPING SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.75"	1
	CONCRETE: MIN F'c = 3000 PSI OR MASONRY: MIN F'c = 2000 PSI	1/4" ITW TAPCON	1.5"	2.5"	1
NAIL FIN	WOOD: MIN. SG = 0.55	#12 WOOD SCREW	1.5"	0.75"	1
	METAL: 18 GA. STEEL, MIN. Fy = 33KSI	#12 GR. 5 SELF-DRILLING OR SELF-TAPPING SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.75"	1

Co.Me.P Infissi SRL
51039 SANTONUOVO PT
PISTOIA, ITALIA

TITLE:
OS2 75 & 65 FRENCH OUTSWING DOOR
(HVHZ)(IMPACT)

INSTALLATION NOTES, ANCHOR
DETAILS & SCHEDULE

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT UNIT 2-15
MIAMI, FLORIDA 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI CT UNIT 2-15
MIAMI, FLORIDA 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL36832

DATE: **03.17.2025**

DWG. BY: FB	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**


DWG. #: **COM015**

SHEET:

7

OF 8

c:\users\franciscobriceno\building drops, inc\building drops landing - common\projects\comep infissi\thc-24-1163.2 - fbc submittal - os2 & ebe product revisions\dwg\os2 door\com015 - series os2outwing french door (02.05).dwg
4/17/2025 9:54 AM

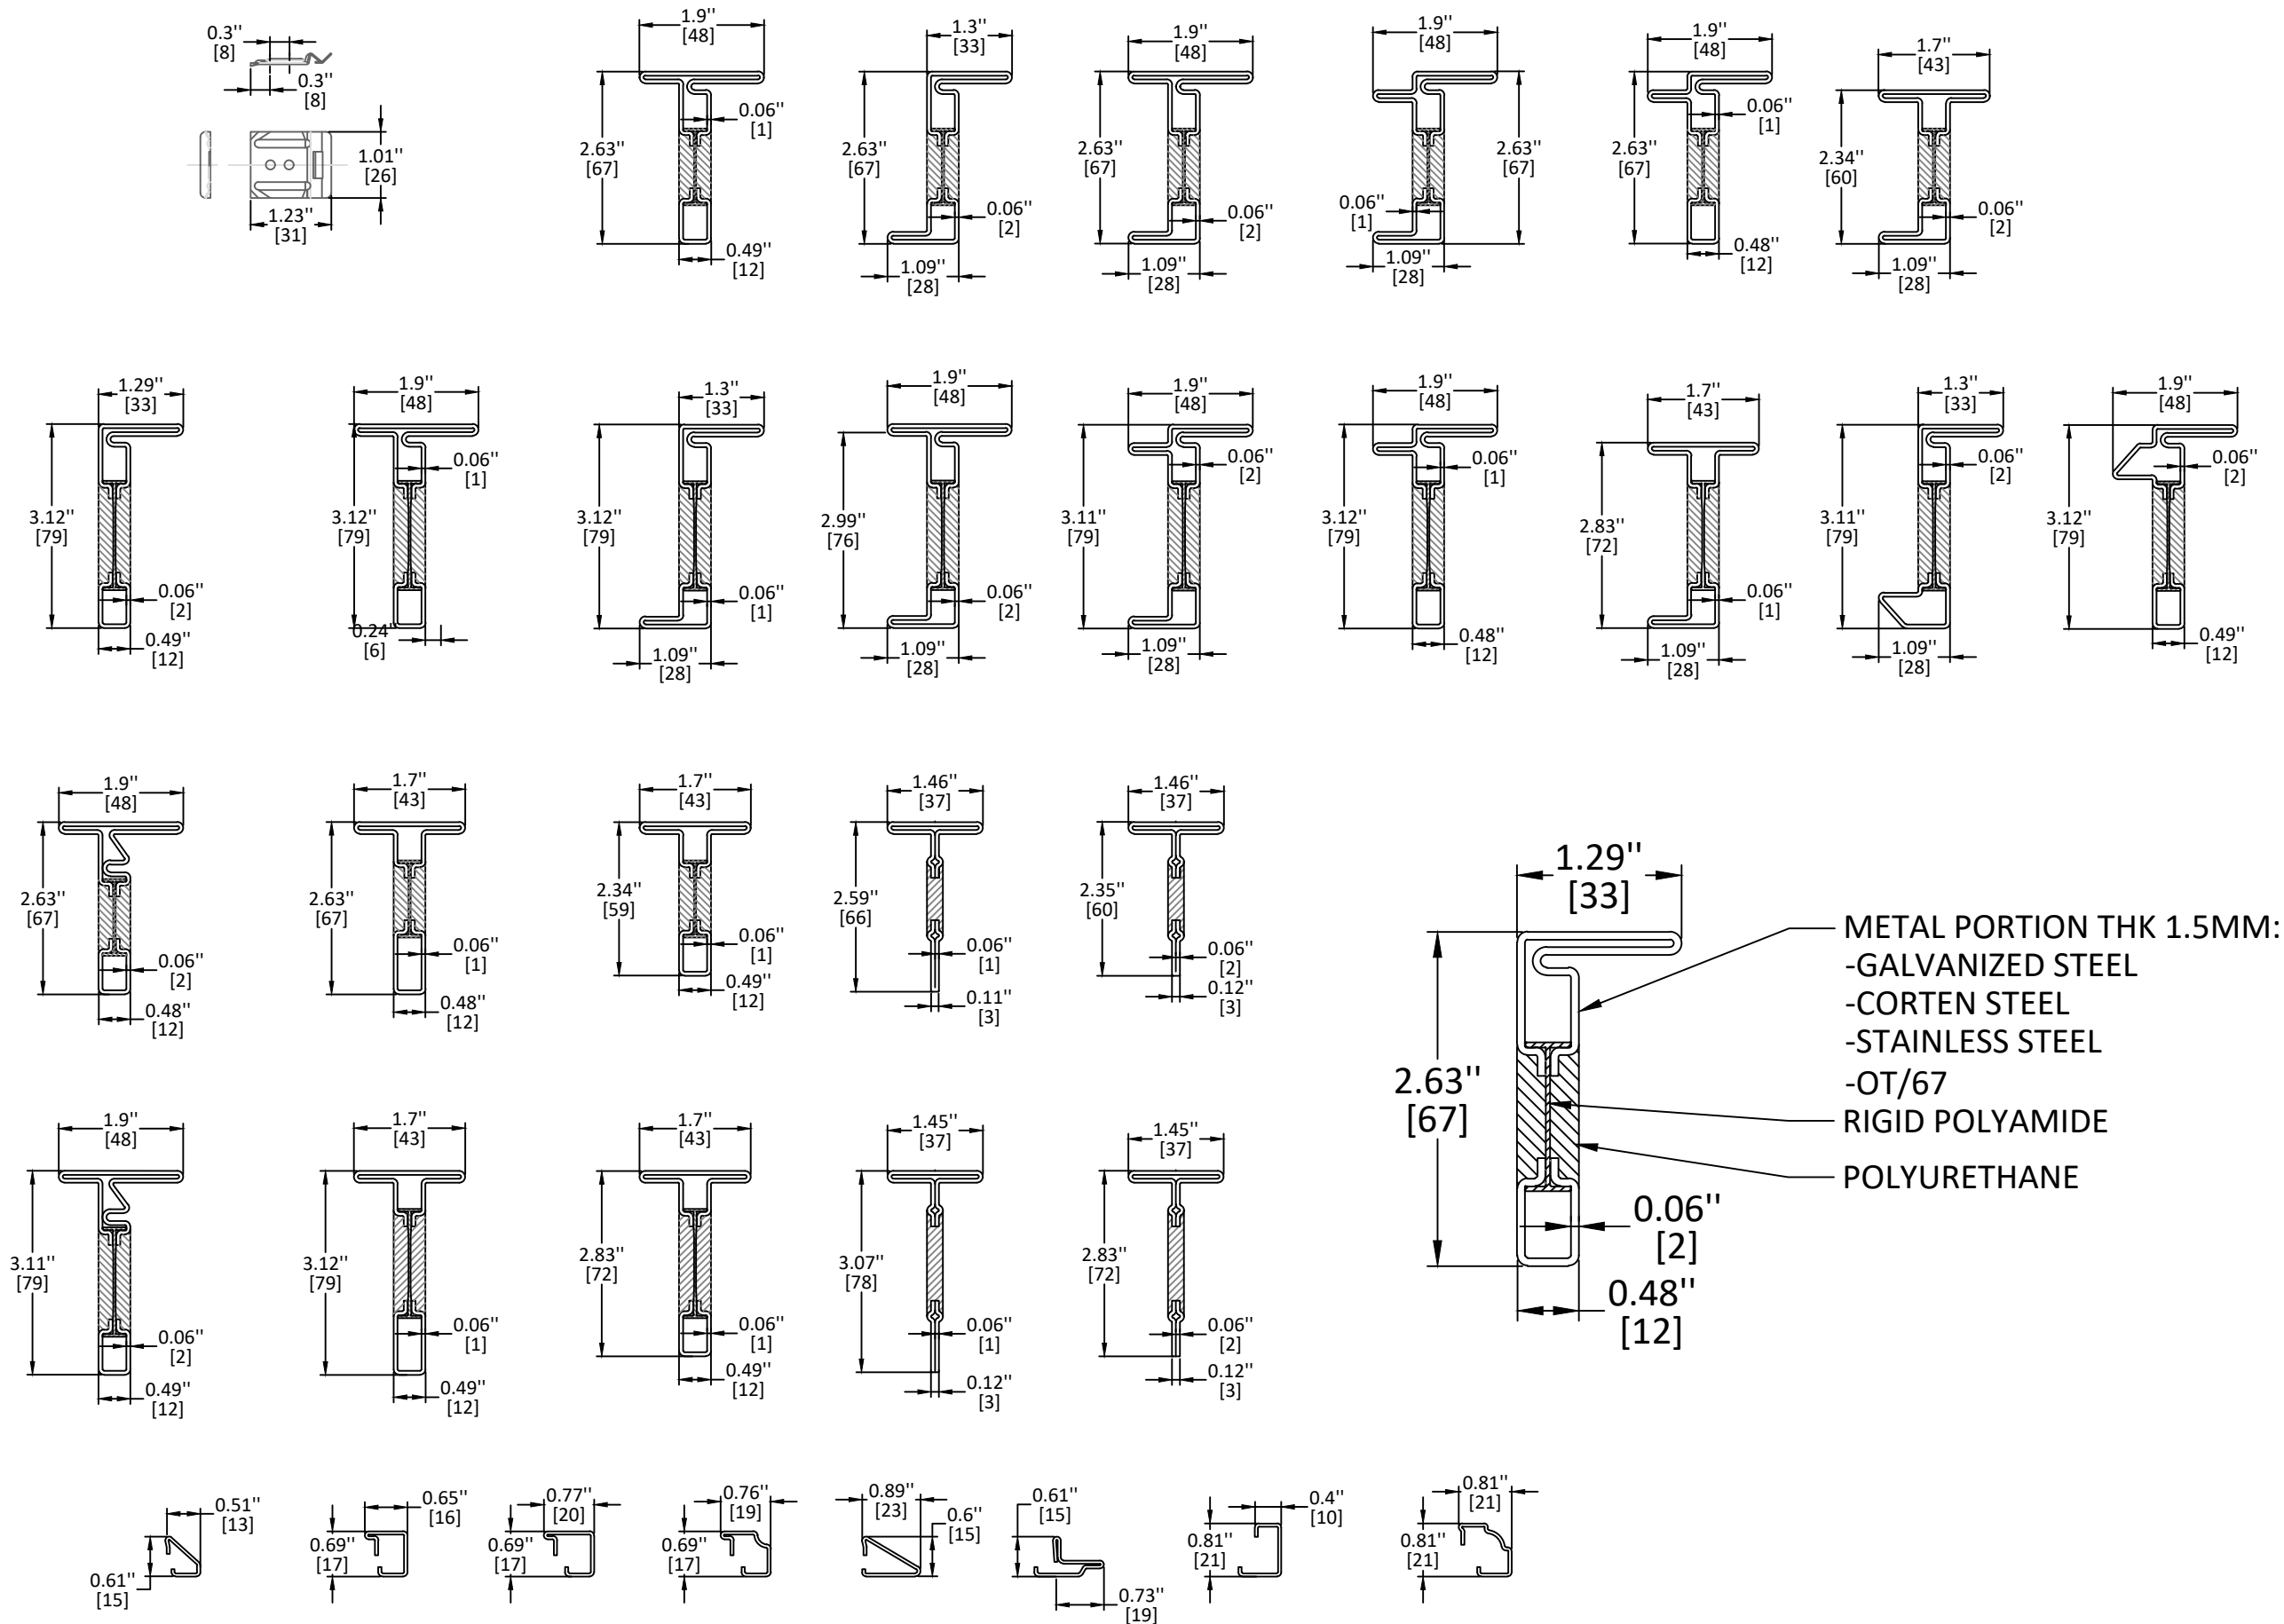

Co.Me.P Infissi SRL
51039 SANTONUOVO PT
PISTOIA, ITALIA

TITLE:
OS2 75 & 65 FRENCH OUTSWING DOOR
(HVHZ)(IMPACT)

APPROVED FRAME AND GLAZING
BEAD PROFILE OPTIONS

PREPARED BY:


BUILDING DROPS, INC.

1900 NE MIAMI CT UNIT 2-15
MIAMI, FLORIDA 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

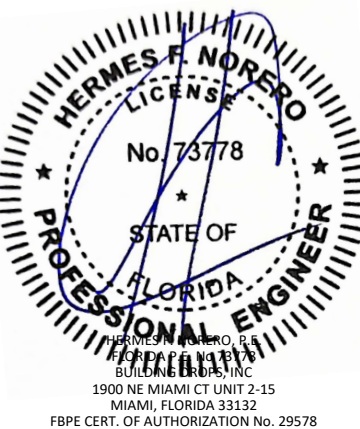

FL #:	FL36832
DATE:	03.17.2025
DWG. BY:	FB
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	COM015
SHEET:	8