


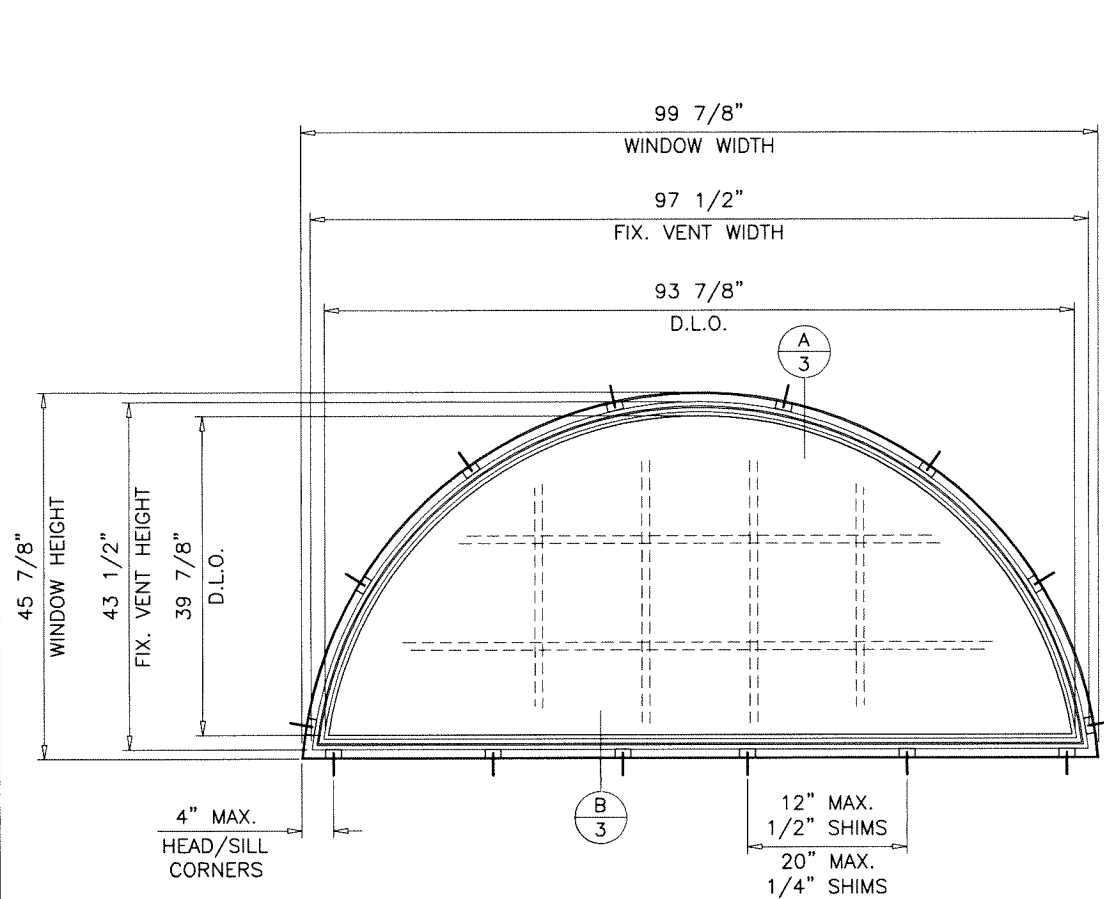

THERMALLY BROKEN ST. STEEL FIXED WDW.

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEET 2.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF FIX./FIX. OR FIXED WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING F.B.C. APPROVED MULLIONS IN BETWEEN.

LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2020 (7TH EDITION)/2023 (8TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.


MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2020/2023 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC.

CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.


DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE. LABELING TO COMPLY WITH SECTION 1709.9.2.

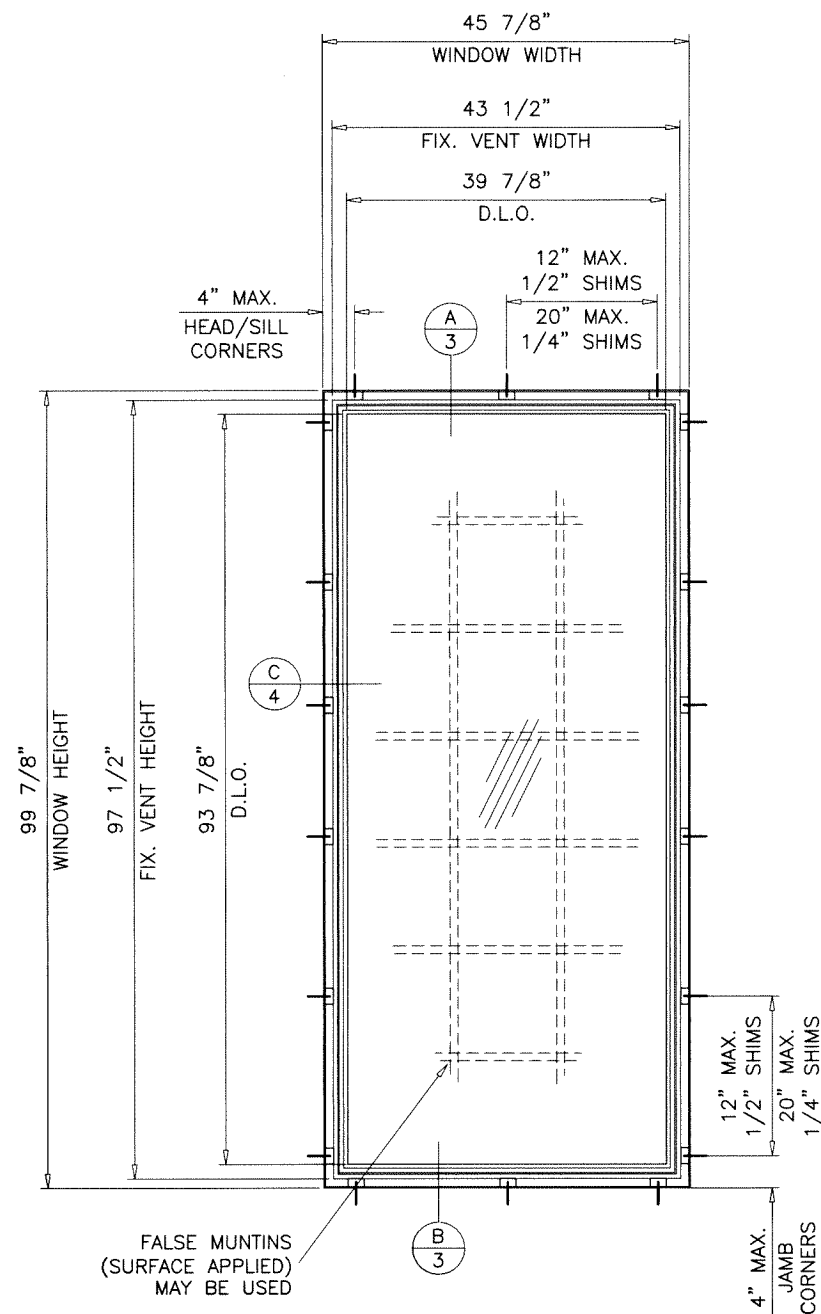

TYPICAL ELEVATIONS

(TESTED UNITS)

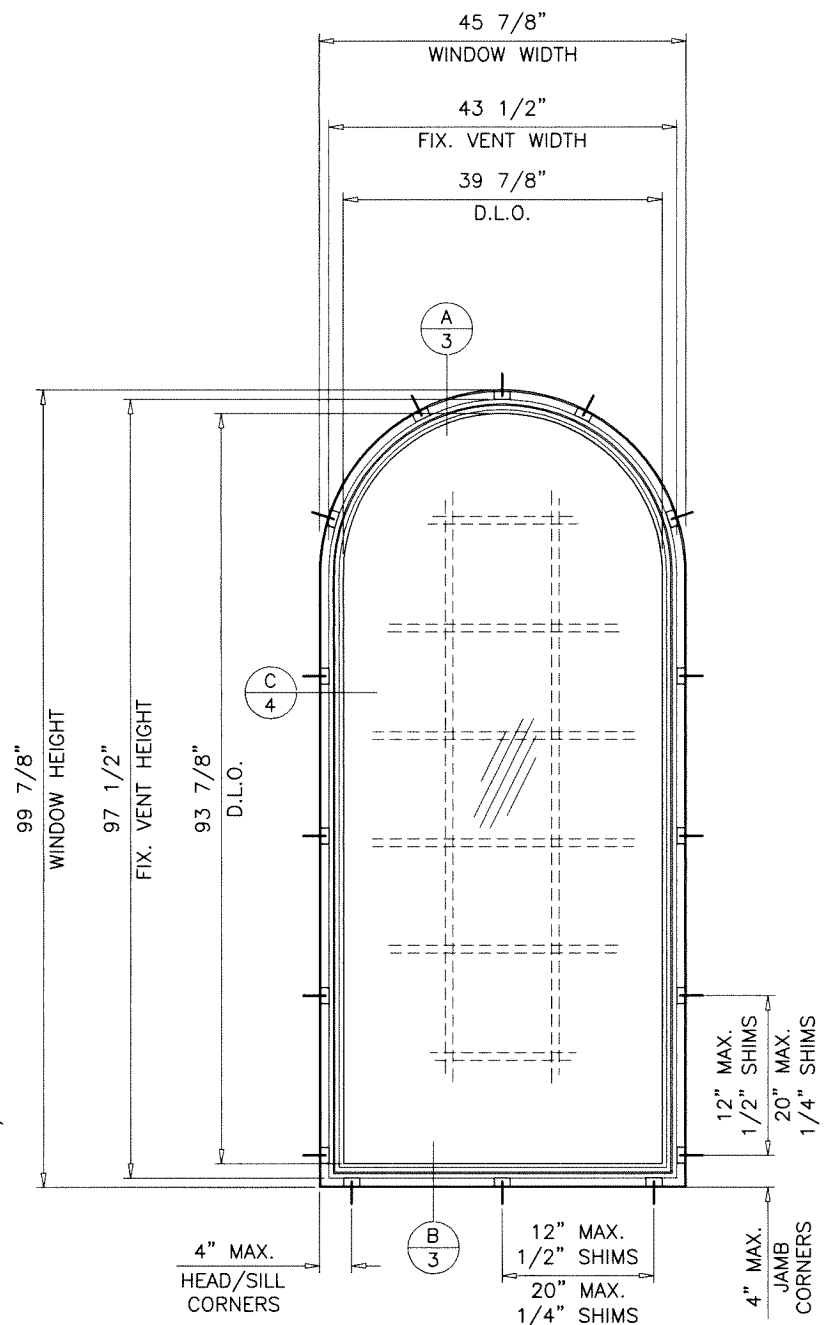

THESE WINDOWS ARE NOT RATED FOR IMPACT.


INSTALLATION OF THIS PRODUCT IN THE HVHZ AREA REQUIRES THE USE OF APPROVED SHUTTERS OR EXTERNAL PROTECTION DEVICES COMPLYING WITH HVHZ REQUIREMENTS.

INSTALLATION OF THIS SYSTEM OUTSIDE THE HVHZ AREA MUST MEET THE APPLICABLE REQUIREMENTS FOR WIND BORNE DEBRIS PROTECTION.

Sealed: 9/20/2023

FL #37878

- A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT.
- B- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.
- C- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC DRAWINGS FOR REVIEW.
- D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

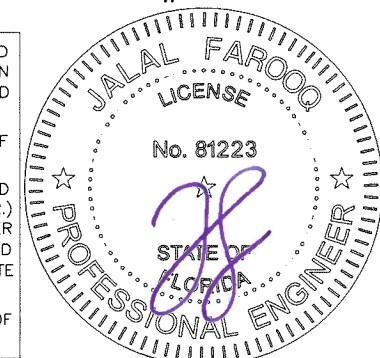

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220 (C.A.N. 3538)
 MIAMI, FLORIDA 33173 FAX. (305) 262-6978
 TEL. (305) 264-8100


THERMALLY BROKEN ST. STEEL FIXED WDW. (N.I.)

Riviera Bronze


1895 N. Ventura Ave.
 Ventura, CA. 93001
 Tel: (805) 653-1943 Fax: (805) 653-1942

revisions:	no	date	by	description
	A	09.06.23		UPDATED TO 2023 FBC
date:	02-08-21			
scale:	1/2"=1'-0"			
dr. by:	TARIQ			
chk. by:				
drawing no.	21-13F			
sheet	1 of 5			


DESIGN LOAD CAPACITY – PSF			
FRAME DIMS.		INSULATED GLASS	
WIDTH	LENGTH	EXT.(+)	INT.(–)
24"	48"	75.0	100.0
30"		75.0	100.0
32"		75.0	100.0
36"		75.0	89.1
42"		75.0	76.4
48"		66.9	66.9
54"		66.9	66.9
60"		66.9	66.9
24"	60"	75.0	100.0
30"		75.0	100.0
32"		75.0	100.0
36"		75.0	89.1
42"		75.0	76.4
48"		66.9	66.9
54"		59.4	59.4
60"		53.5	53.5
24"	72"	75.0	100.0
30"		75.0	100.0
32"		75.0	99.3
36"		75.0	89.1
42"		75.0	76.4
48"		66.9	66.9
54"		59.4	59.4
60"		53.5	53.5
24"	84"	75.0	100.0
30"		75.0	100.0
32"		75.0	95.4
36"		75.0	87.4
42"		75.0	76.4
48"		66.9	66.9
54"		59.4	59.4
24"	96"	75.0	100.0
30"		75.0	97.7
32"		75.0	92.7
36"		75.0	84.5
42"		75.0	75.3
45–7/8"	99–7/8"	70.0	70.0
24"	102"	75.0	100.0
30"		75.0	96.6
32"		75.0	91.6
36"		75.0	83.4
42"		74.1	74.1
24"	108"	75.0	100.0
30"		75.0	95.7
32"		75.0	90.7
36"		75.0	82.4
42"		73.1	73.1

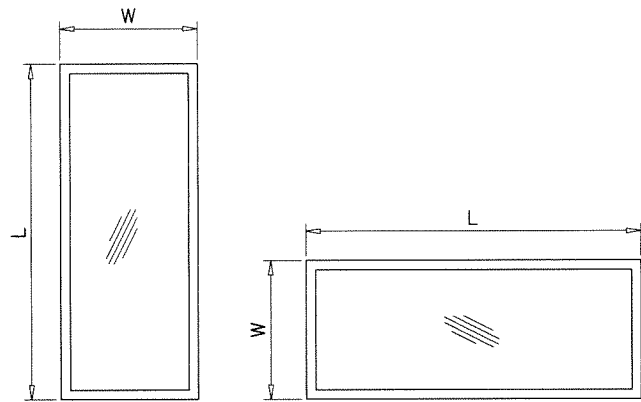

NOTE:
WIDTH AND LENGTH DIMENSIONS CAN BE
ORIENTED VERTICALLY OR HORIZONTALLY
AS SHOWN ABOVE.

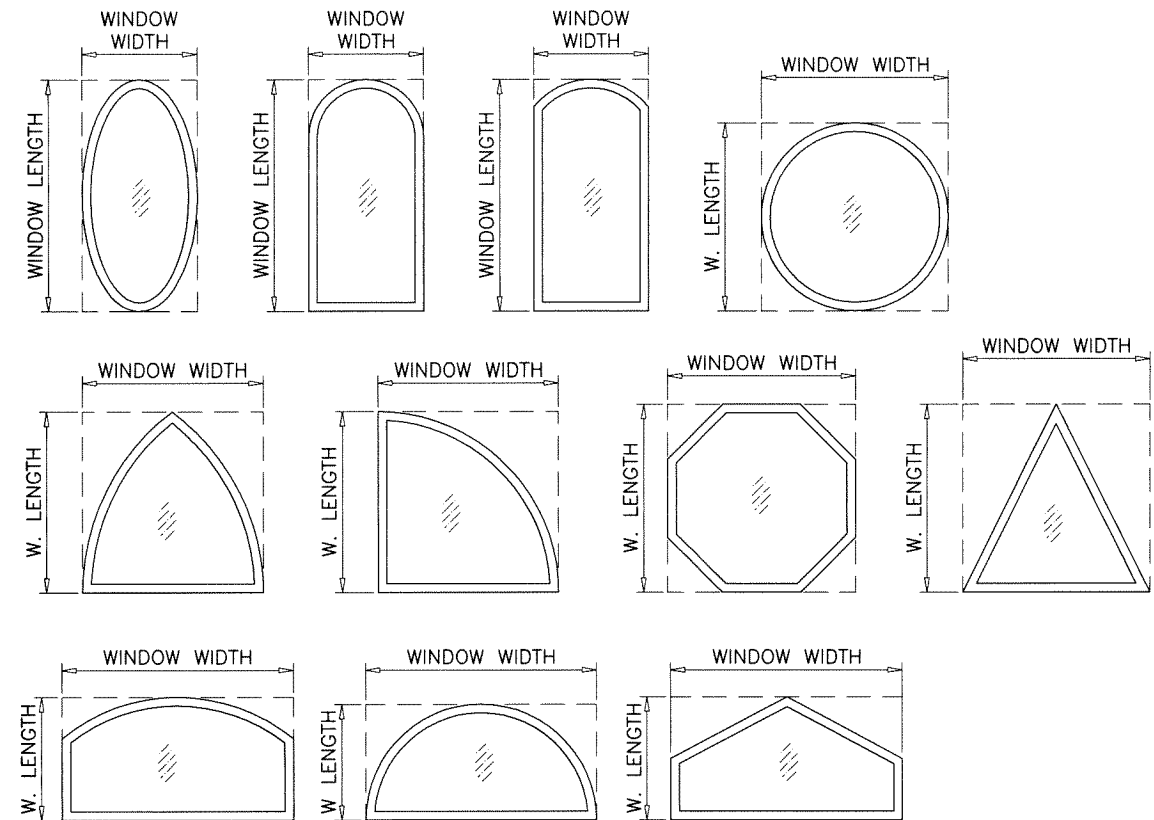


ALLOWABLE LOADS FOR ALTERNATE SHAPES AS SHOWN ABOVE OR SIMILAR CAN BE
VERIFIED BY INSCRIBING PICTURE WINDOW SHAPE WITHIN SQUARE OR RECTANGLE AS
SHOWN IN DOTTED LINES AND OBTAINING ALLOWABLE LOADS FROM THOSE SHAPES.

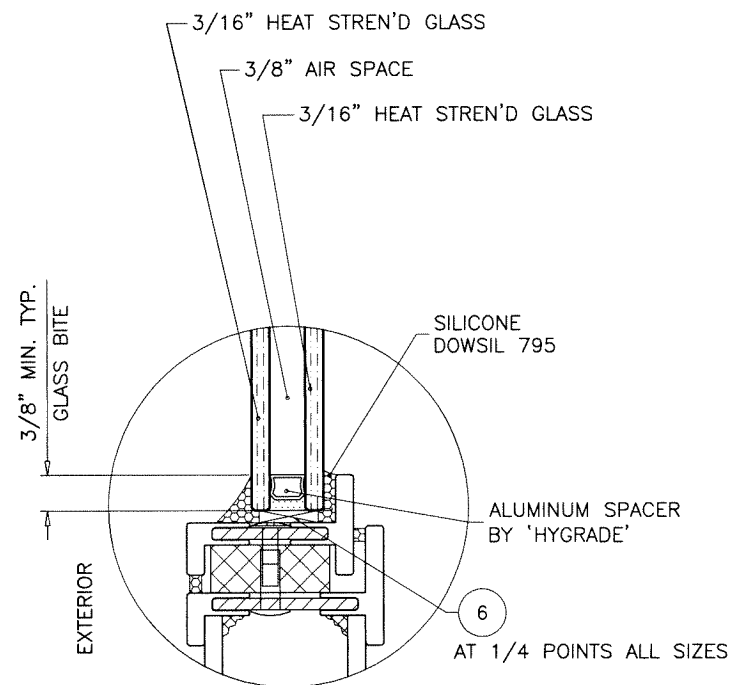

GLAZING DETAIL
3/4" OVERALL INSUL. GLASS

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS).

Sealed: 9/20/2023

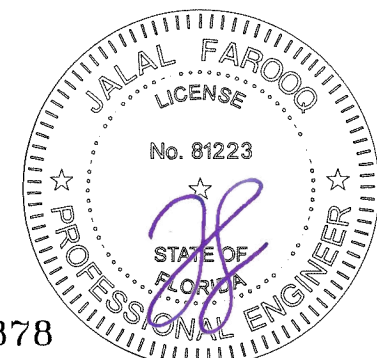

FL #37878

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\21-13F-RB






Thermally Broken ST. Steel Fixed WDW. (N.I.)

Riviera Bronze
1895 N. Ventura Ave.
Ventura, CA. 93001
Tel: (805) 653-1943 Fax: (805) 653-1942

21-13F

Revisions:	
no	date by description

date: 02-08-21	scale: 1/2" = 1"	dr. by: TARIQ	chk. by:	drawing no.
				21-13F
				sheet 2 of 5

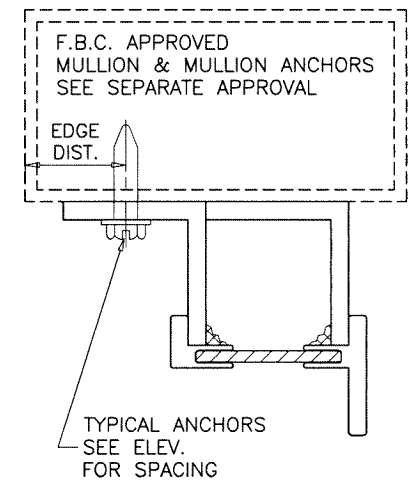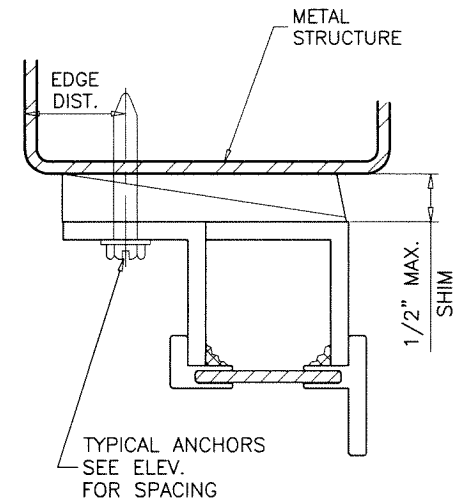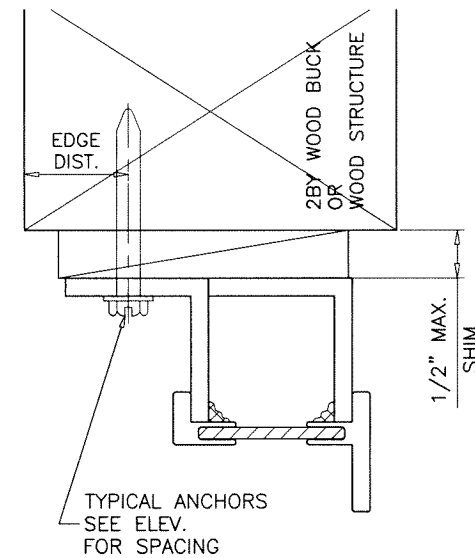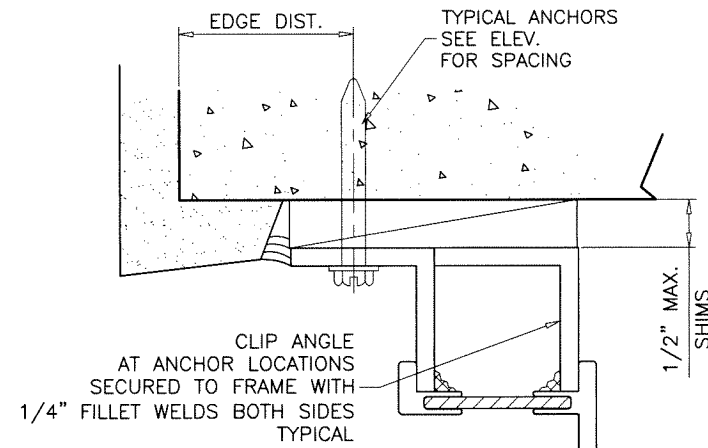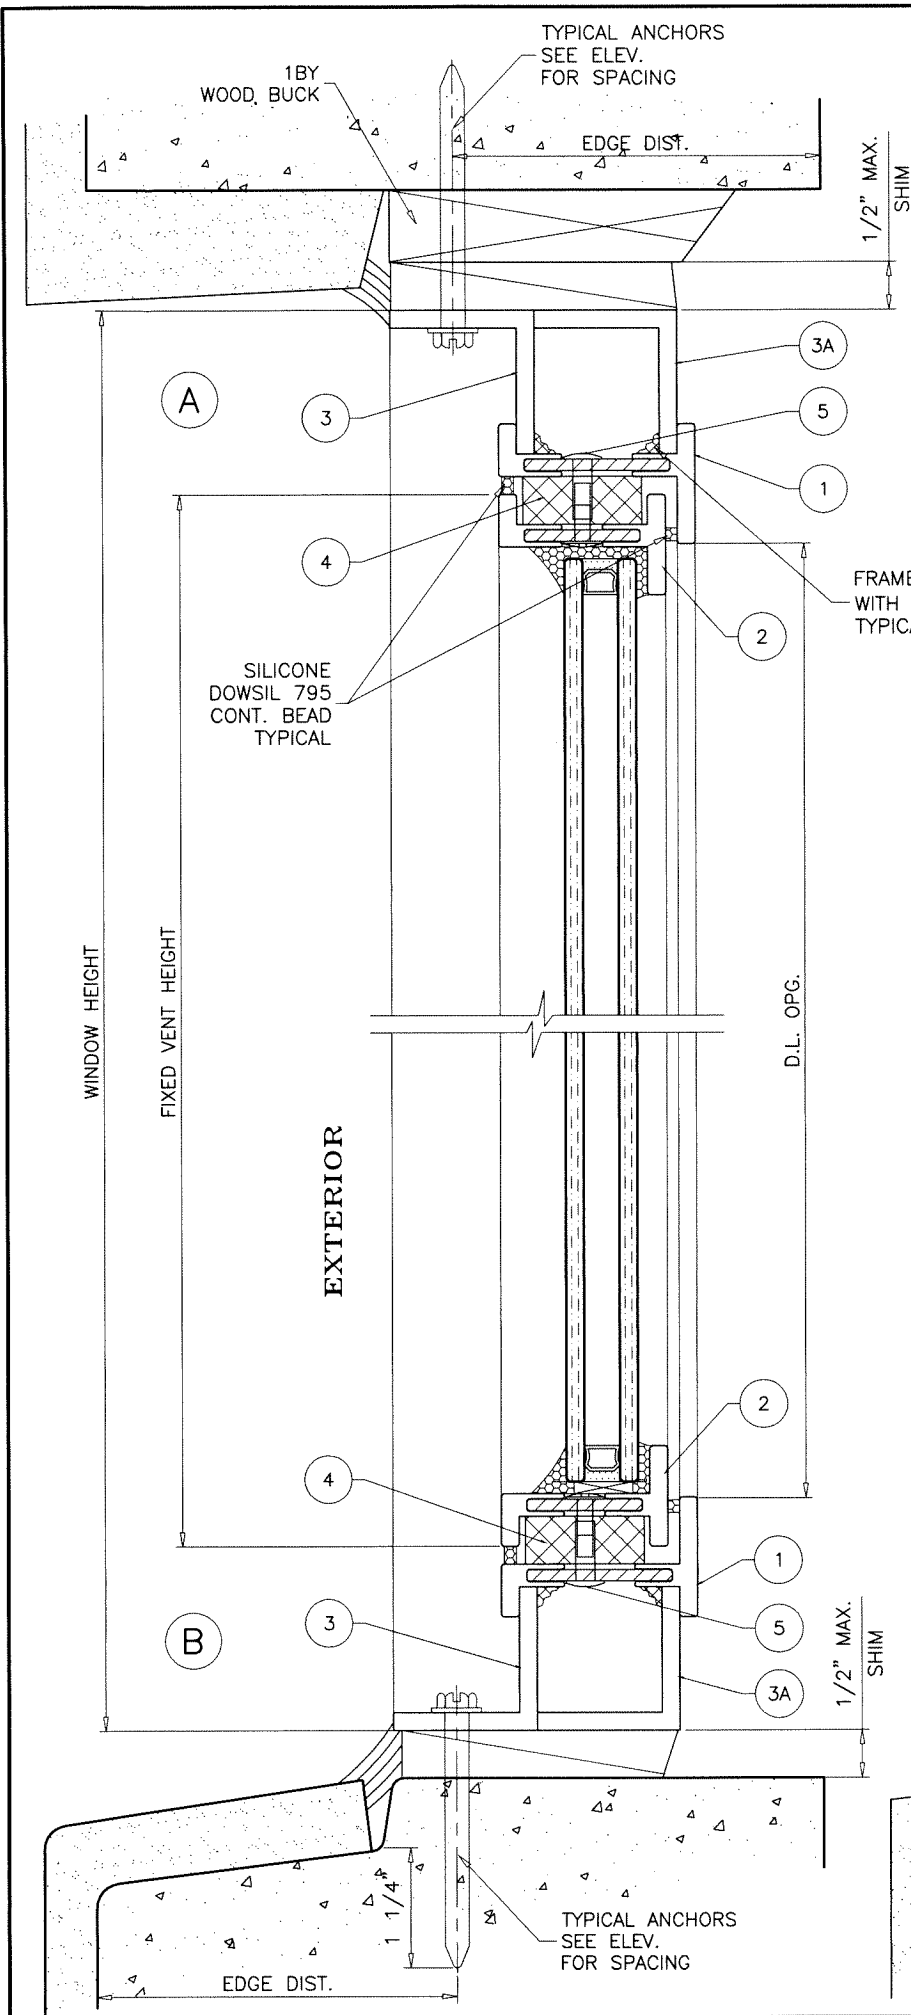

WOOD BUCKS AND METAL STRUCTURE NOT BY 'RIVIERA BRONZE' MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4" DIA. ULTRACON+ BY 'DEWALT' ($F_u=164$ KSI, $F_y=148$ KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD (HEAD/SILL/JAMBS)

THRU 1BY BUCKS INTO CONC. OR BLOCKS
 1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
 1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)


DIRECTLY INTO CONCRETE OR BLOCKS
 1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
 1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)

1/4" DIA. TEKS OR SELF-DRILLING SCREWS (GRADE 5 CRS)
 INTO F.B.C. APPROVED MULLIONS
 AND
 INTO METAL STRUCTURES (HEAD/SILL/JAMBS)
 (3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS
 ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
 STEEL: 1/8" THK. MIN. ($F_y = 36$ KSI MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

CRITICAL EDGE DISTANCE


INTO CONCRETE AND BLOCKS = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.
 CONCRETE AT HEAD, SILL OR JAMBS $f'_c = 3000$ PSI MIN.
 C-90 HOLLOW/FILLED BLOCK AT JAMBS $f'_m = 2000$ PSI MIN.

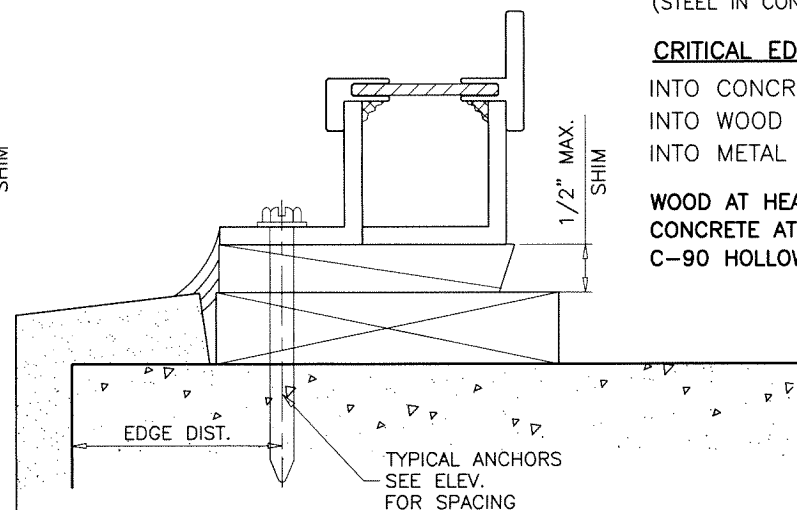

Sealed: 9/20/2023

FL #37878

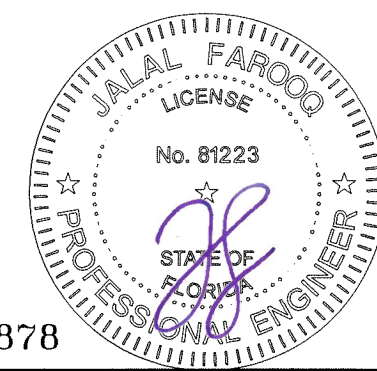

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL (305) 264-8100 FAX (305) 262-6978

COMP-ANL\21-13F-RB

THERMALLY BROKEN ST. STEEL FIXED WDW. (N.I.)







Riviera Bronze
 1895 N. Ventura Ave.
 Ventura, CA. 93001
 Tel: (805) 653-1943 Fax: (805) 653-1942

revisions:		date:	no	date	by	description
		02-08-21				

date: 02-08-21
 scale: 1/2" = 1"
 dr. by: TARIQ
 chk. by:

drawing no.
21-13F

sheet 3 of 5

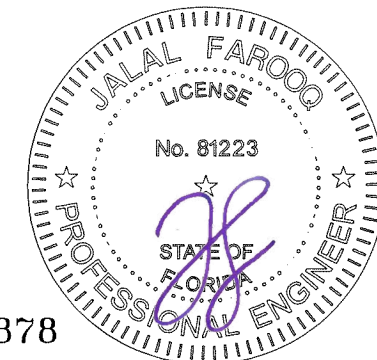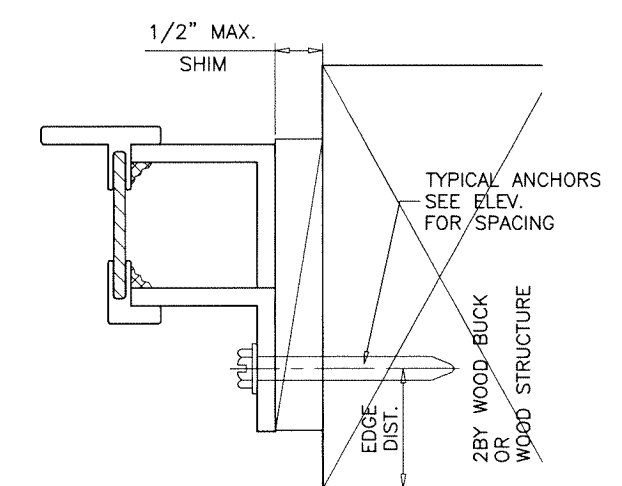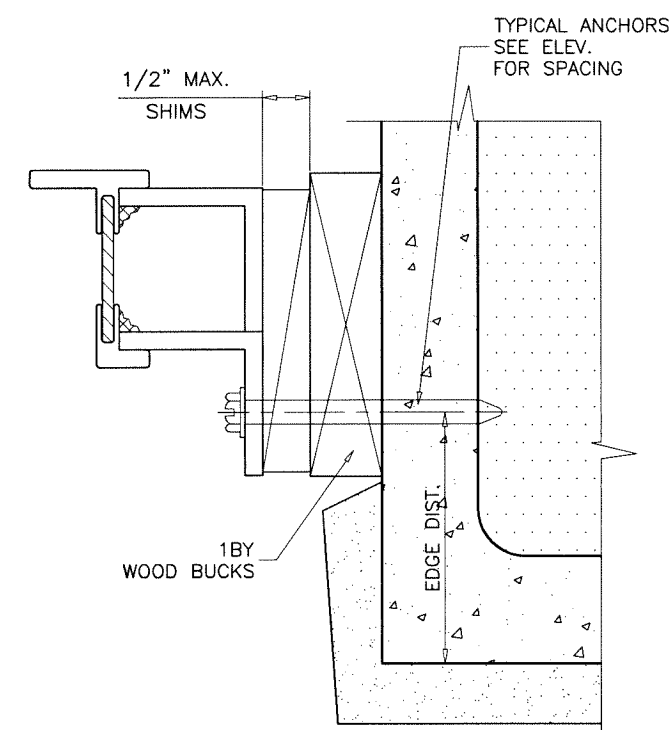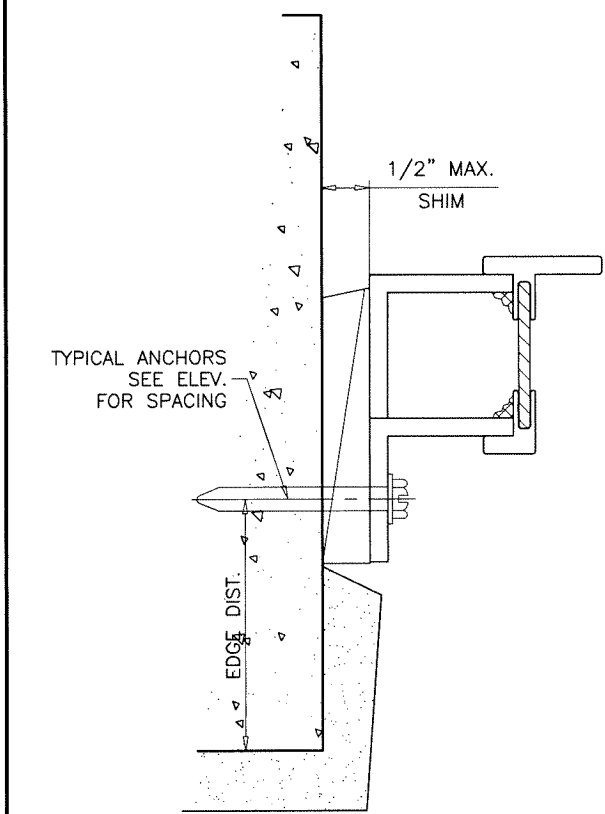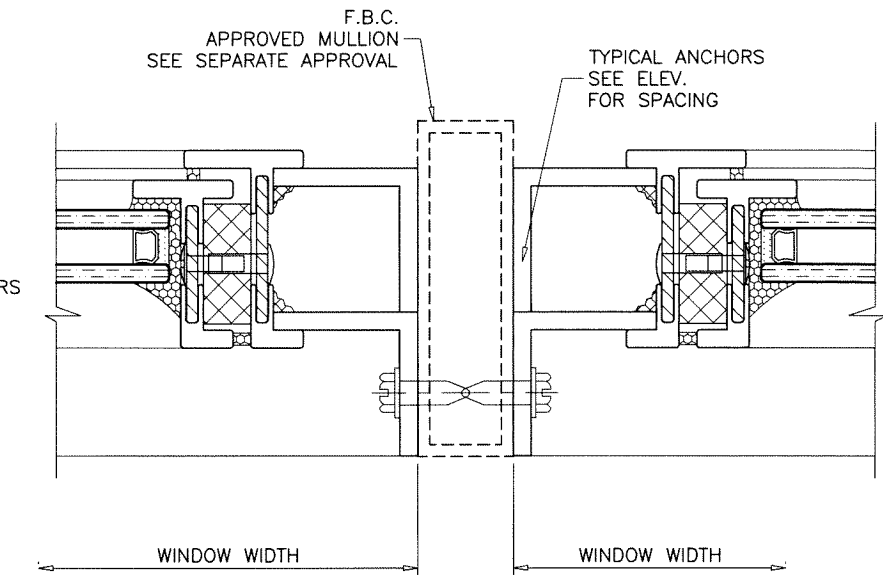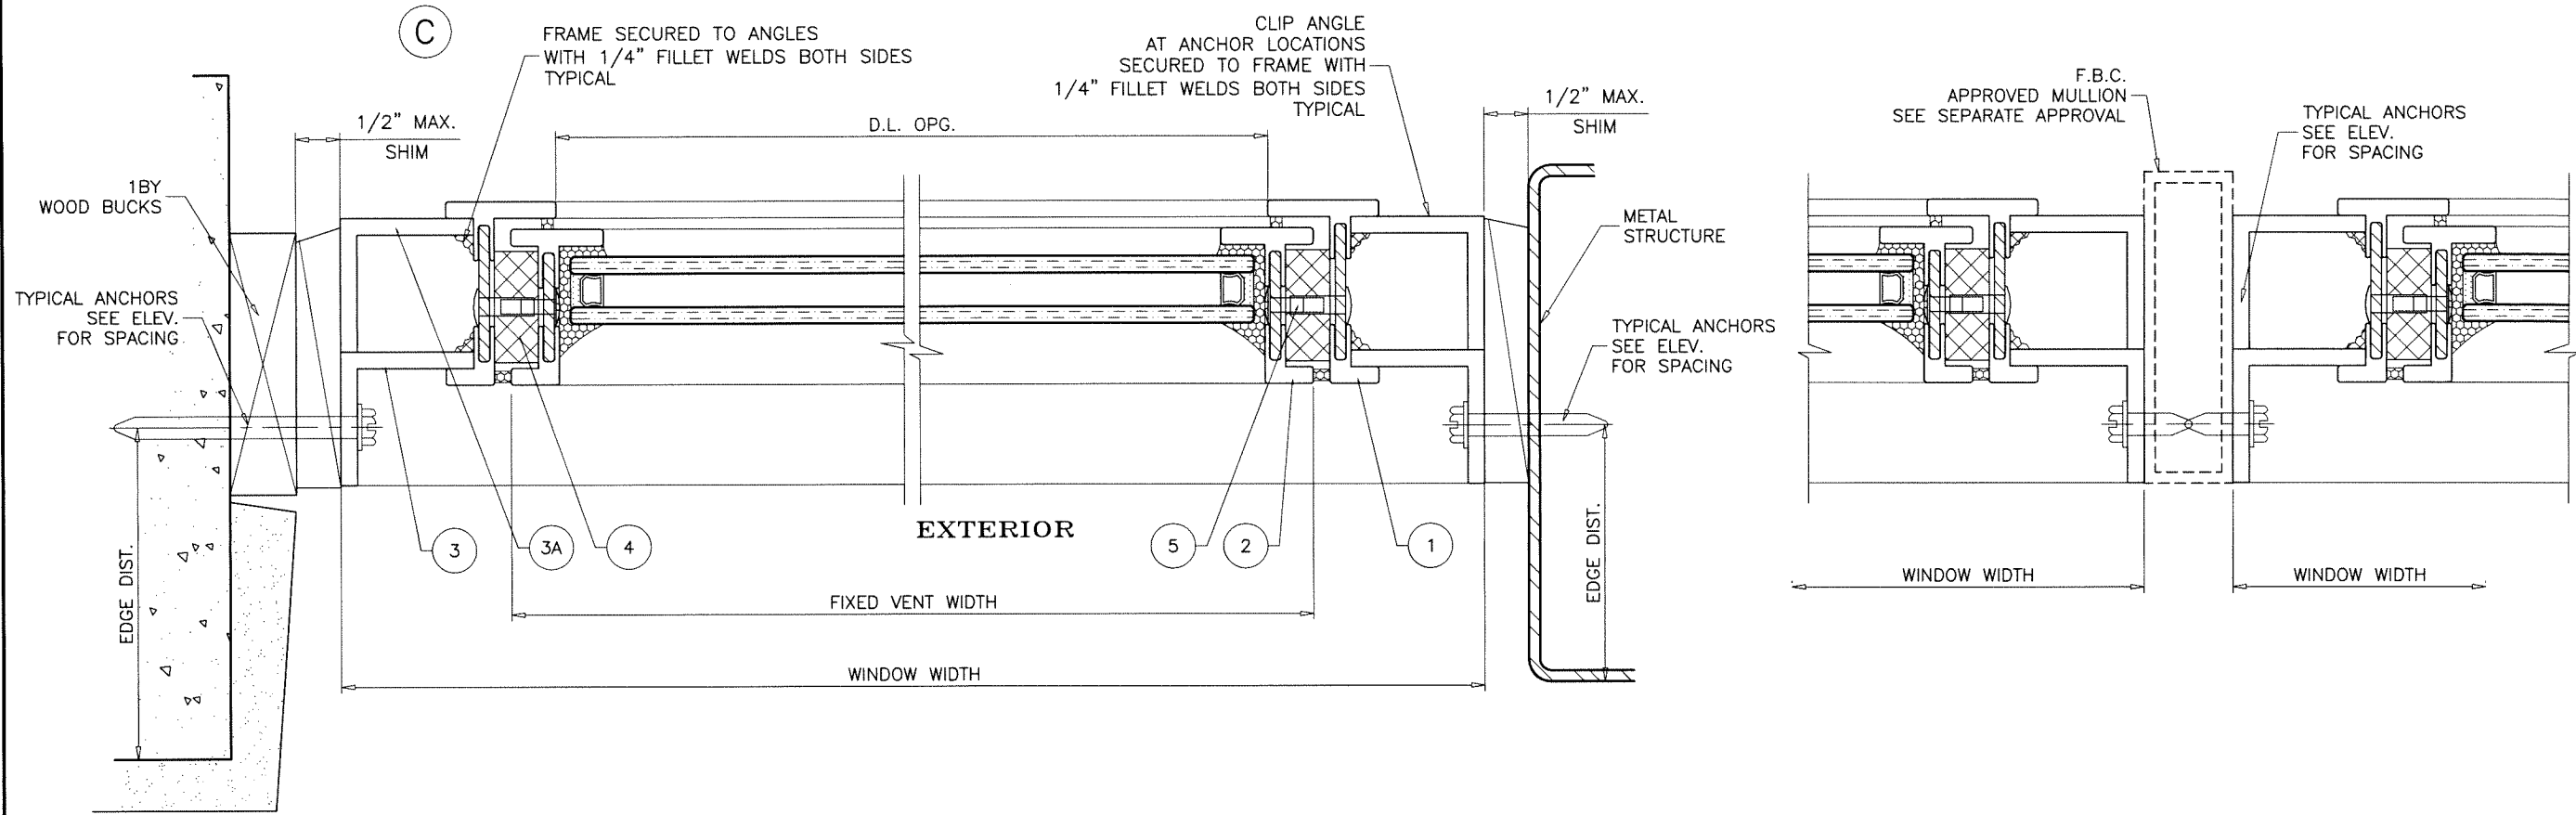

Sealed: 9/20/2023

FL #37878

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\21-13F-RB

THERMALLY BROKEN ST. STEEL FIXED WDW. (N.I.)

Riviera Bronze
1895 N. Ventura Ave.
Ventura, CA. 93001
Tel: (805) 653-1943 Fax: (805) 653-1942

revisions:	
no	date by description

date: 02-08-21

scale: 1/2" = 1"

dr. by: TARIQ

chk. by:

drawing no.

21-13F

sheet 4 of 5

