

THESE WINDOWS ARE RATED FOR LARGE & SMALL MISSILE IMPACT.
SHUTTERS ARE NOT REQUIRED.

THERMALLY BROKEN ST. STEEL FIXED WDW.

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEET 2.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF FIX./FIX. OR FIXED WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING F.B.C. APPROVED MULLIONS IN BETWEEN.

LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2020 (7TH EDITION)/2023 (8TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.


ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2020/2023 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC. CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE. LABELING TO COMPLY WITH SECTION 1709.9.2.

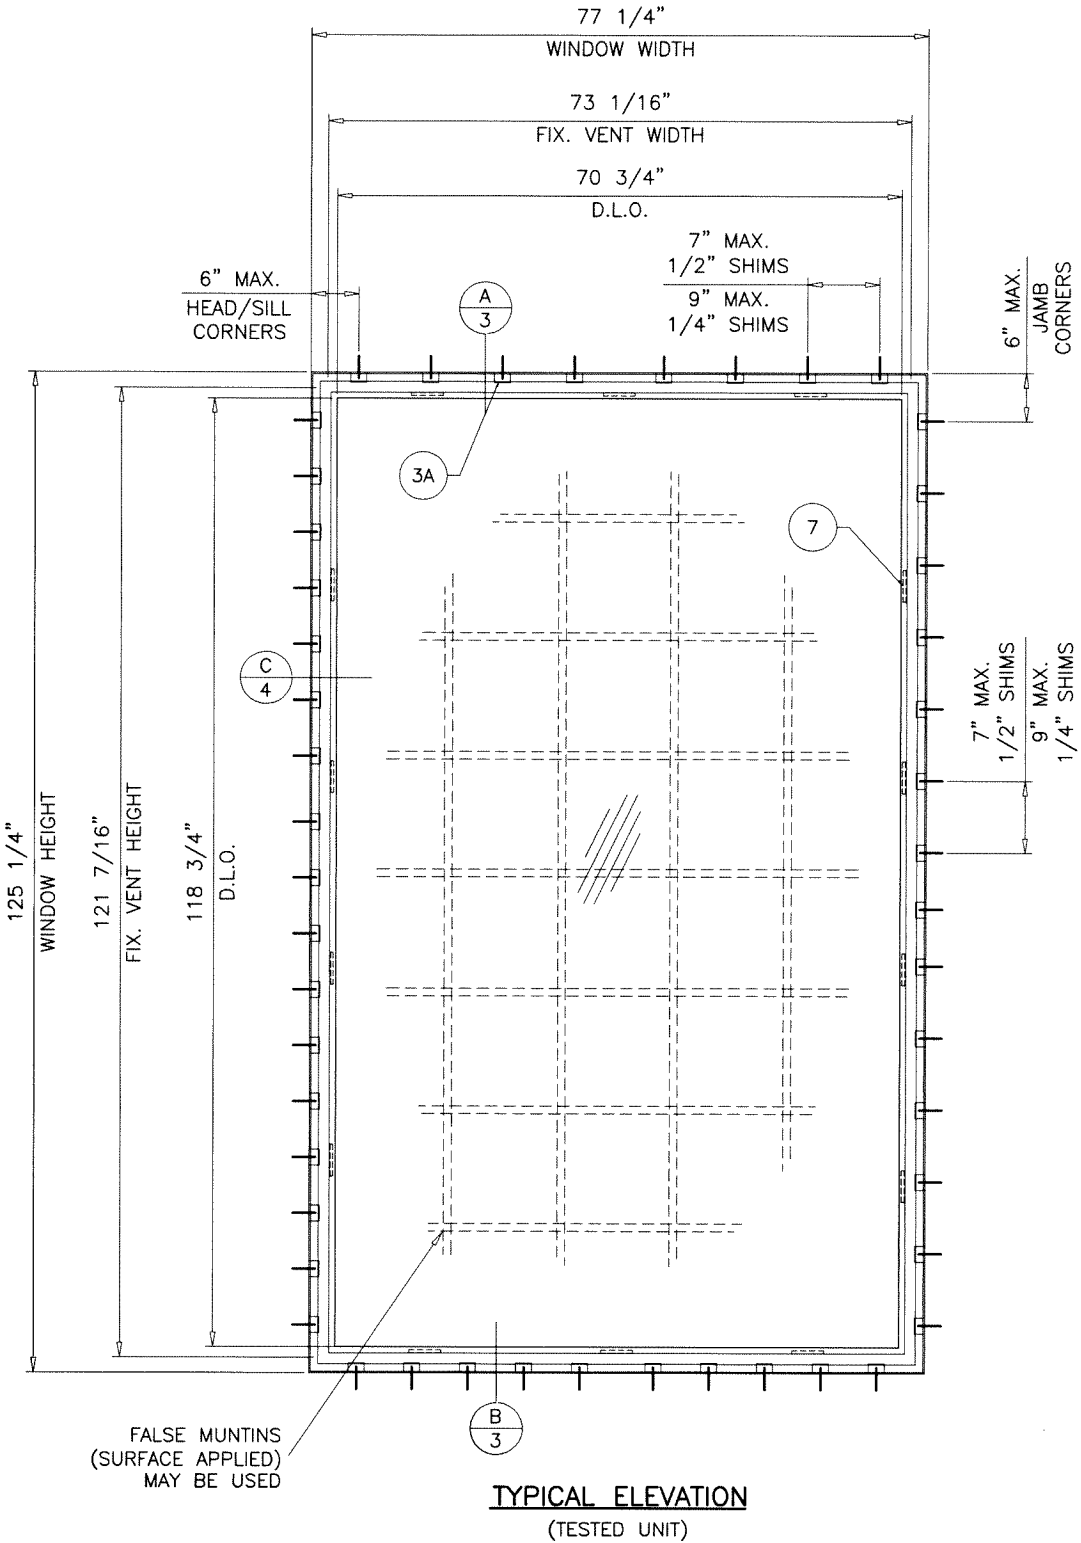

Sealed: 9/20/2023

FL #37878

- A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT.
- B- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.
- C- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC DRAWINGS FOR REVIEW.
- D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.



af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538
COMP-ANL\22-09F-RB


THERMALLY BROKEN ST. STEEL FIXED WDW. (L.M.I.)
Riviera Bronze
1895 N. Ventura Ave.
Ventura, CA. 93001
Tel: (805) 653-1943 Fax: (805) 653-1942

revisions:	no	date	by	description
	A	09.06.23		UPDATED TO 2023 FBC
date:	03-24-22			
scale:	1/2"=1'-0"			
dr. by:	TARQ			
chk. by:				
drawing no.	22-09F			
sheet	1 of 5			


DESIGN LOAD CAPACITY - PSF			
FRAME DIMS.		INSUL. LAM. GLASS	
WIDTH	LENGTH	EXT.(+)	1NT.(-)
30"	48"	70.2	70.2
36"		70.2	70.2
42"		70.2	70.2
48"		70.2	70.2
54"		70.2	70.2
60"		70.2	70.2
66"		70.2	70.2
72"		70.2	70.2
77-1/4"		70.2	70.2
84"		70.2	70.2
90"		70.2	70.2
96"		70.2	70.2
102"		70.2	70.2
30"	60"	70.2	70.2
36"		70.2	70.2
42"		70.2	70.2
48"		70.2	70.2
54"		70.2	70.2
60"		70.2	70.2
66"		70.2	70.2
72"		70.2	70.2
77-1/4"		70.2	70.2
84"		70.2	70.2
90"		70.2	70.2
96"		70.2	70.2
102"		70.2	70.2
30"	72"	70.2	70.2
36"		70.2	70.2
42"		70.2	70.2
48"		70.2	70.2
54"		70.2	70.2
60"		70.2	70.2
66"		70.2	70.2
72"		70.2	70.2
77-1/4"		70.2	70.2
84"		70.2	70.2
90"		70.2	70.2
96"		70.2	70.2
102"		70.2	70.2
30"	84"	70.2	70.2
36"		70.2	70.2
42"		70.2	70.2
48"		70.2	70.2
54"		70.2	70.2
60"		70.2	70.2
66"		70.2	70.2
72"		70.2	70.2
77-1/4"		70.2	70.2
84"		64.6	64.6
90"		64.6	64.6
96"		64.6	64.6
102"		64.6	64.6

DESIGN LOAD CAPACITY - PSF			
FRAME DIMS.		INSUL. LAM. GLASS	
WIDTH	LENGTH	EXT.(+)	1NT.(-)
30"	96"	70.2	70.2
36"		70.2	70.2
42"		70.2	70.2
48"		70.2	70.2
54"		70.2	70.2
60"		70.2	70.2
66"		70.2	70.2
72"		70.2	70.2
77-1/4"		70.2	70.2
84"		64.6	64.6
90"		60.3	60.3
96"		56.5	56.5
30"	108"	70.2	70.2
36"		70.2	70.2
42"		70.2	70.2
48"		70.2	70.2
54"		70.2	70.2
60"		70.2	70.2
66"		70.2	70.2
72"		70.2	70.2
77-1/4"		70.2	70.2
84"		64.6	64.6
30"	120"	70.2	70.2
36"		70.2	70.2
42"		70.2	70.2
48"		70.2	70.2
54"		70.2	70.2
60"		70.2	70.2
66"		70.2	70.2
72"		70.2	70.2
77-1/4"		70.2	70.2
84"		70.2	70.2
90"		70.2	70.2
96"		70.2	70.2
102"		70.2	70.2
30"	125-1/4"	70.2	70.2
36"		70.2	70.2
42"		70.2	70.2
48"		70.2	70.2
54"		70.2	70.2
60"		70.2	70.2
66"		70.2	70.2
72"		70.2	70.2
77-1/4"		70.2	70.2
84"		70.2	70.2
90"		70.2	70.2
96"		70.2	70.2
102"		70.2	70.2

DESIGN LOAD CAPACITY - PSF			
FRAME DIMS.		INSUL. LAM. GLASS	
WIDTH	LENGTH	EXT.(+)	1NT.(-)
30"	132"	70.2	70.2
36"		70.2	70.2
42"		70.2	70.2
48"		70.2	70.2
54"		70.2	70.2
60"		70.2	70.2
66"		70.2	70.2
72"		70.2	70.2
77-1/4"		70.2	70.2
84"		64.6	64.6
90"		60.3	60.3
96"		56.5	56.5
30"	144"	70.2	70.2
36"		70.2	70.2
42"		70.2	70.2
48"		70.2	70.2
54"		70.2	70.2
60"		70.2	70.2
66"		70.2	70.2
72"		70.2	70.2
77-1/4"		70.2	70.2
84"		64.6	64.6
90"		60.3	60.3
96"		56.5	56.5

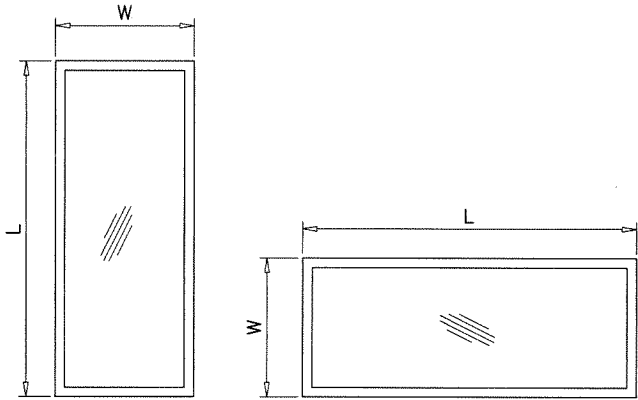


NOTE:
WIDTH AND LENGTH DIMENSIONS CAN BE
ORIENTED VERTICALLY OR HORIZONTALLY
AS SHOWN ABOVE.

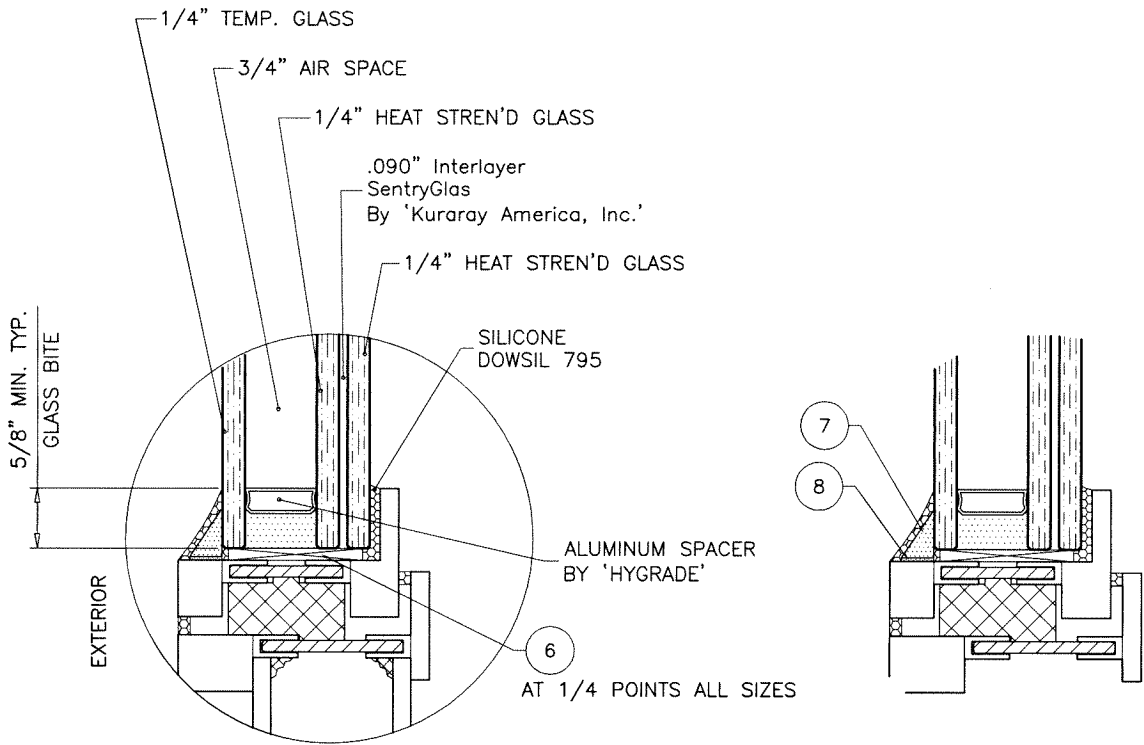

GLAZING DETAIL
1-1/2" OVERALL INSUL. LAM. GLASS

Sealed: 9/20/2023

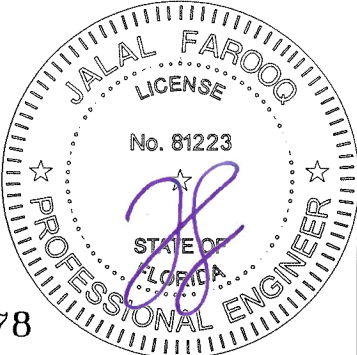

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM

COMP-ANL\22-09F-RB

revisions:

no	date	by	description

date: 03-24-22






scale: 1/2" = 1"

dr. by: TARIQ

chk. by:


drawing no. 22-09F

sheet 2 of 5

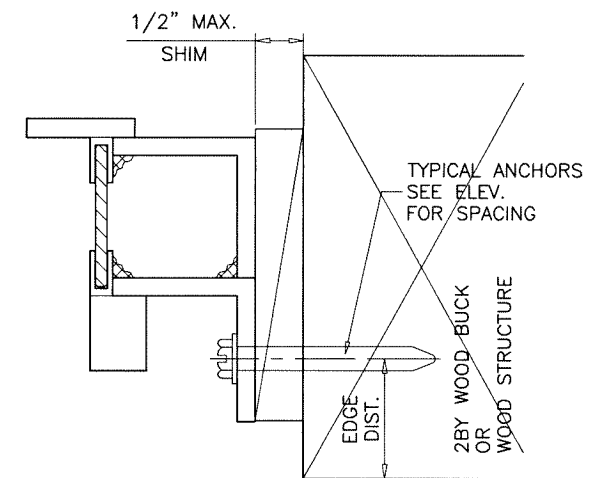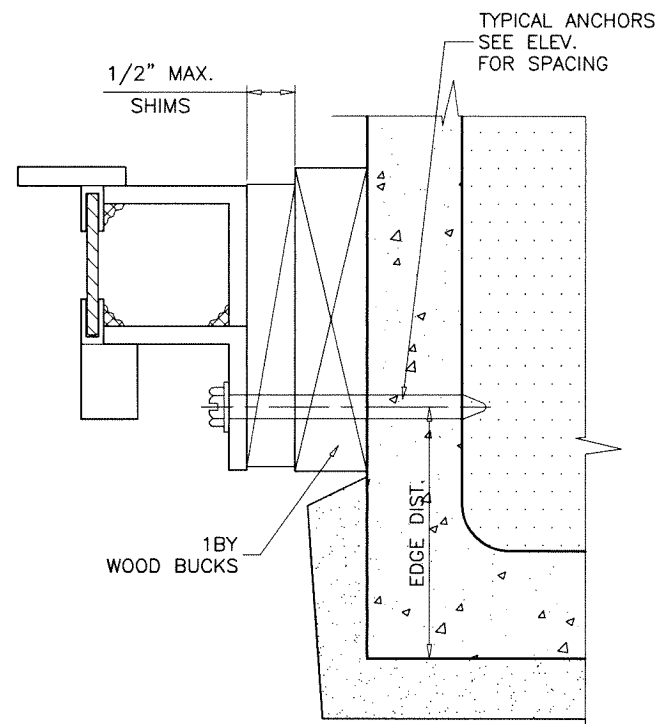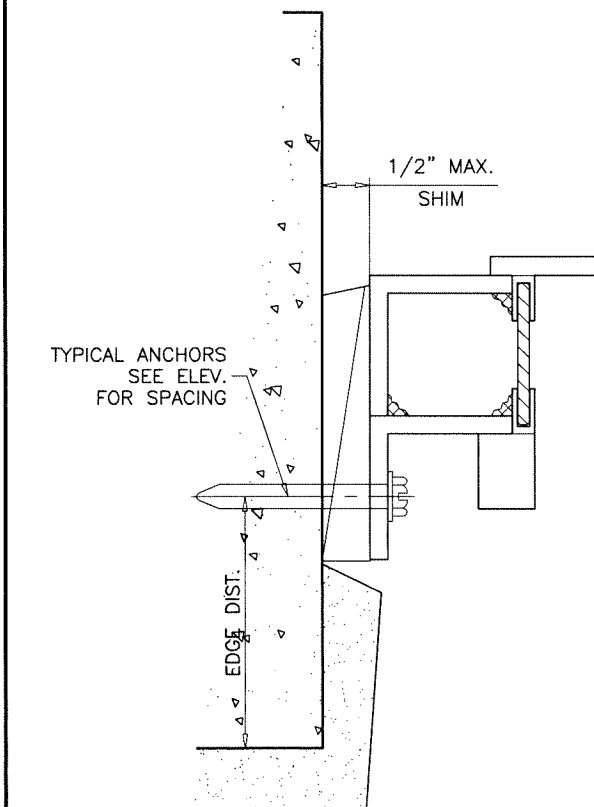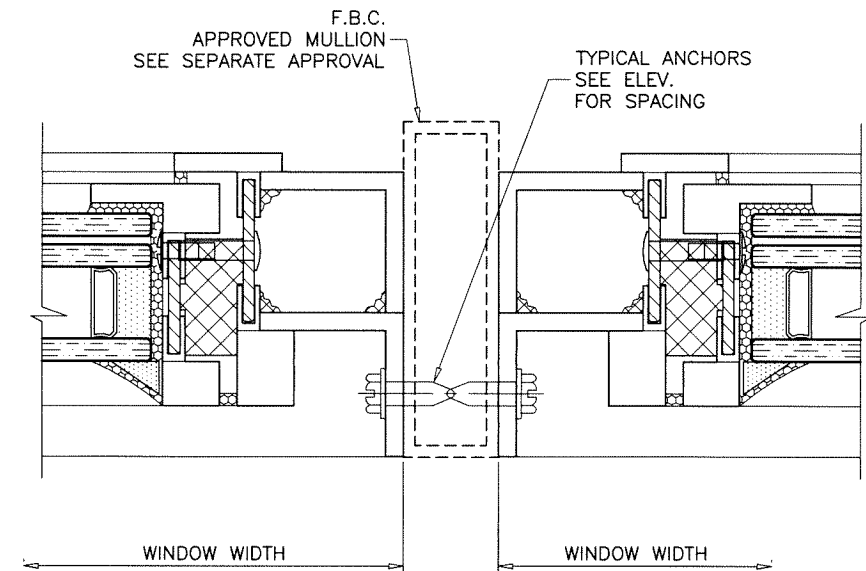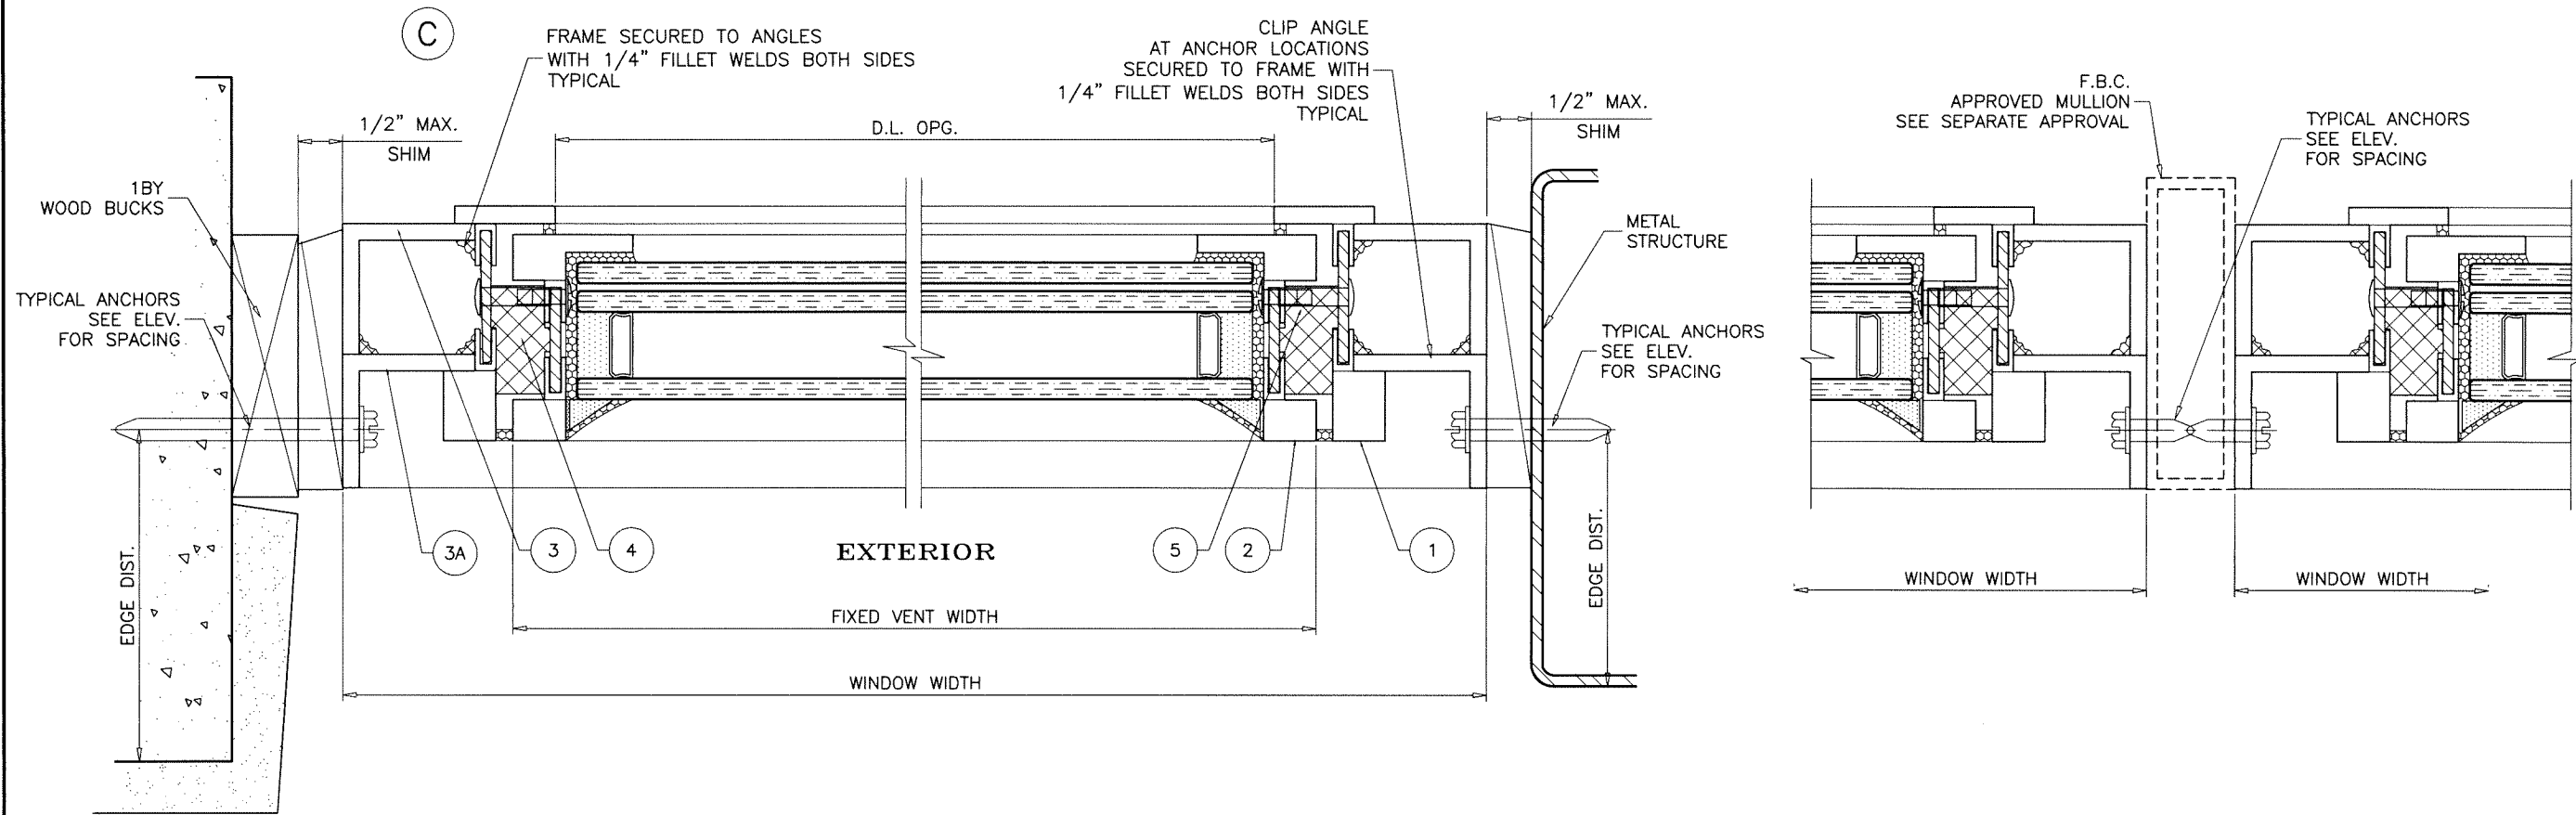

Sealed: 9/20/2023

FL #37878

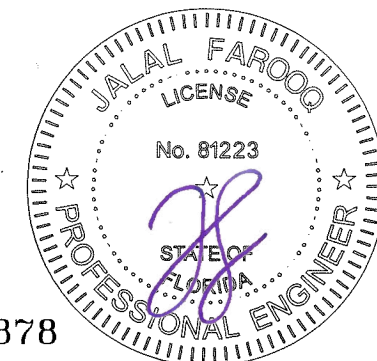

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #5538

COMP-ANL\22-09F-RB

THERMALLY BROKEN ST. STEEL XL FIXED WDW. (L.M.I.)

Riviera Bronze
1895 N. Ventura Ave.
Ventura, CA. 93001
Tel: (805) 653-1943 Fax: (805) 653-1942

revisions:

no	date	by	description

date: 03-24-22

scale: 1/2" = 1"


dr. by: TARIQ

chk. by:

drawing no.

22-09F

sheet 4 of 5

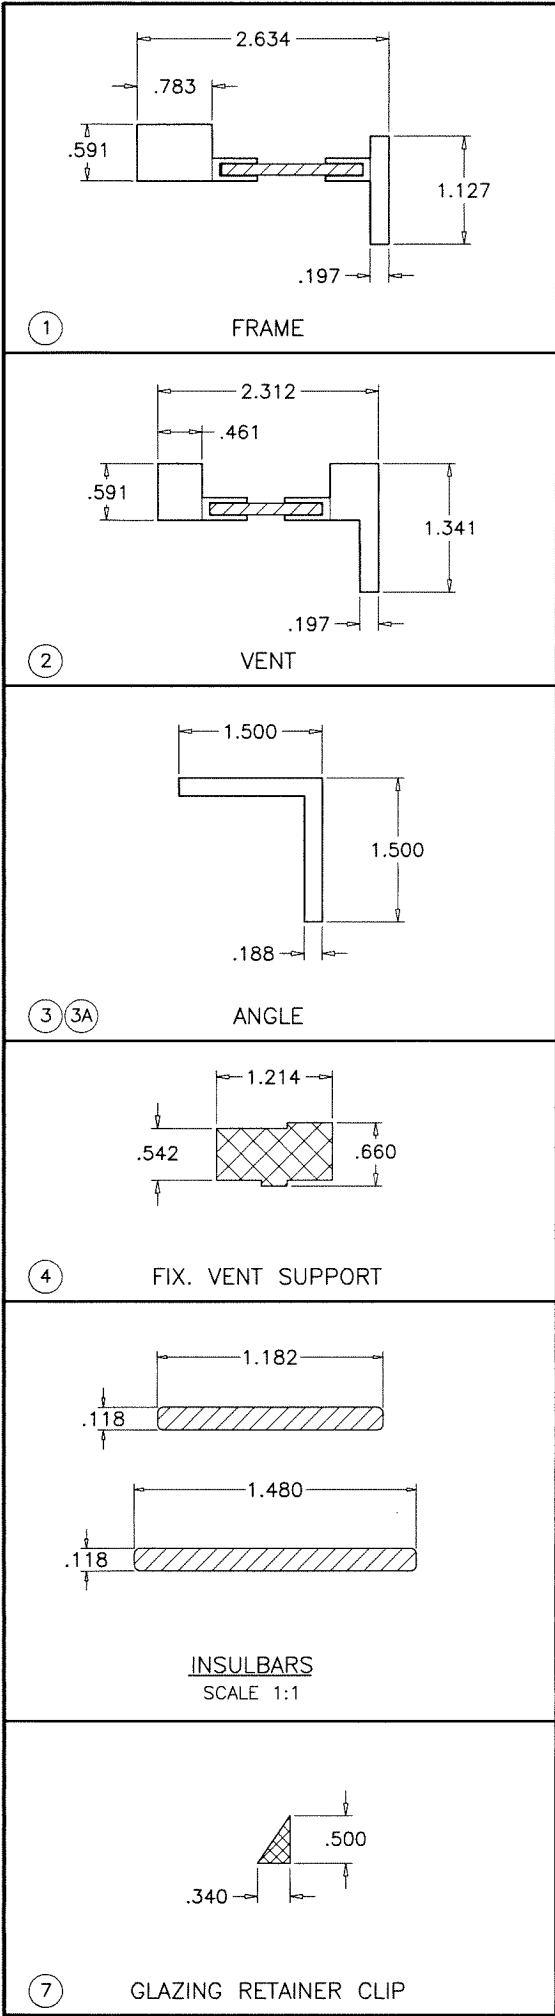

ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	-	4/ WDW.	FRAME	ST. STEEL	-
2	-	4/ WDW.	VENT	ST. STEEL	-
3	-	4/ WDW.	CONTINUOUS ANGLE	ST. STEEL	-
3A	-	AS REQD.	CLIP ANGLE, 2" LONG AT ANCHOR LOCATIONS	ST. STEEL	-
4	-	AS REQD.	FIXED VENT SUPPORT, 1" LONG, AT 10-1/2" O.C. MAX.	DELIN	-
5	#8 X 1"	AS REQD.	VENT FASTENERS, BARREL BOLTS AT 2" FROM ENDS AND 10-1/2" O.C.	STEEL	-
6	-	2/ LITE	SETTING BLOCKS, AT 1/4 POINTS	EPDM	DUROMETER 80±5 SHORE A
7	-	AS REQD.	GLAZING RETAINER CLIP, 4" LONG AT 24" O.C. MAX.	DELIN	-
8	EA E-40FL	AS REQD.	EPOXY ADHESIVE	-	LOCTITE


SEALANT:

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH DOWSIL 795 SILICONE.

WELDS:

ALL VERTICAL AND HORIZONTAL MEMBERS TO BE SECURED WITH WELDS PER AWS SPECIFICATIONS
WELDING ELECTRODE = E70 MIN.

Sealed: 9/20/2023

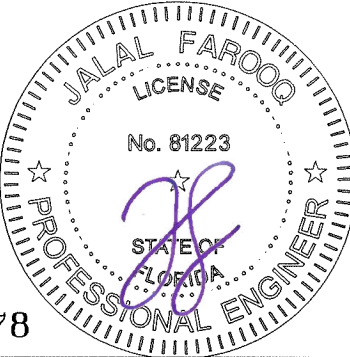

FL #37878

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538
COMP-ANL 22-09F-RB

THERMALLY BROKEN ST. STEEL XL FIXED WDW. (L.M.I.)
Riviera Bronze
1895 N. Ventura Ave.
Ventura, CA. 93001
Tel: (805) 653-1943 Fax: (805) 653-1942

revisions:		no		date		by		description	
date:		03-24-22		scale:		1/2" = 1"		dr. by: TARIQ	
drawing no.		22-09F		sheet		5 of 5		chk. by:	