

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL.
4. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" WINDOW UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
5. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. WINDOW UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
6. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
7. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
8. SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
9. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
10. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
11. FRAME MATERIAL: EXTRUDED RIGID PVC.
12. UNITS MUST BE GLAZED PER ASTM E1300, SEE SHEET 2 FOR GLASS DETAILS.
13. APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
14. FOR ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
15. FOR ANCHORING INTO METAL STRUCTURE USE #8 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. FOR ANCHORING INTO MASONRY/CONCRETE USE 3/16" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2 1/2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
17. ALL FASTENERS TO BE CORROSION RESISTANT.
18. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:

A. WOOD – MINIMUM SPECIFIC GRAVITY OF G=0.42

B. CONCRETE – MINIMUM COMPRESSIVE STRENGTH OF 3,192 PSI.

C. MASONRY – STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER).

D. METAL STRUCTURE: STEEL 18GA, 33KSI OR ALUMINUM 6063-T5 .125" THICK MINIMUM.
18. UNITS MAY BE INSTALLED WITH OR WITHOUT FLANGE.

SIGNED: 01/25/2021

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2	ELEVATION
3 – 5	INSTALLATION DETAILS
6	COMPONENTS



EASTERN ARCHITECTURAL SYSTEMS
A DIVISION OF
EASTERN METAL SUPPLY

16341 DOMESTIC AVE
FORT MYERS, FL 33912
800-432-2204

2561 VINYL DOUBLE HUNG WINDOW
48" x 72" IMPACT
NOTES

DRAWN:
A.R.

DWG NO.
08-03666


REV
-

SCALE NTS

DATE 01/18/21

SHEET 1 OF 6


L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@lrlomaspe.com

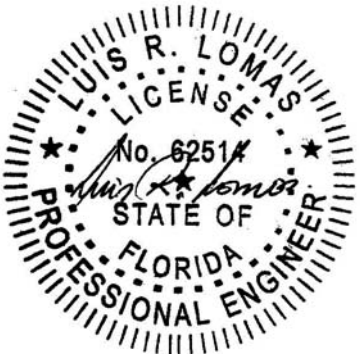

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

- NOTES:
1. MAXIMUM SASH SIZE: 44 3/8" X 35 3/4"
 2. MAXIMUM D.L.O.: 43 50" X 34 1/4"

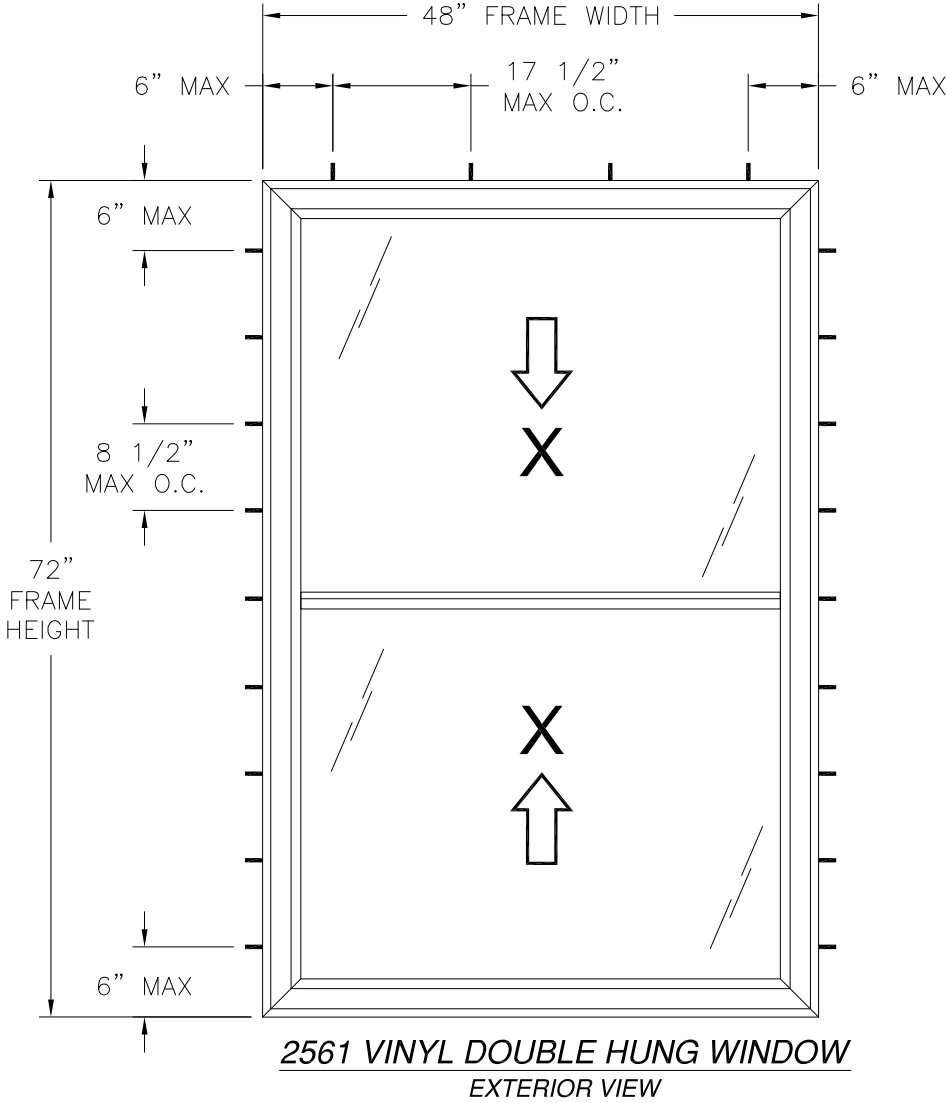

DESIGN PRESSURE RATING	IMPACT RATING
±50.0PSF	LARGE MISSILE IMPACT


48" X 72" UNIT SHOWN. OTHER SIZES APPROVED AS LONG AS
FRAME AREA DOES NOT EXCEED 24.0 FT²
SEE CHART, THIS SHEET FOR OTHER SIZES

HARDWARE SCHEDULE

A.	(2) FOUR JAKS, INC. 1/2 COIL SPRING BALANCE SYSTEM, ONE PER EACH FRAME JAMB
B.	(2) METALLIC SPRING LOADED TILT LATCHES, ONE 1 1/2" C/L FROM EACH BOTTOM SASH TOP RAIL CORNER
C.	(2) PLASTIC SPRING LOADED TILT LATCHES, ONE 1 1/2" C/L FROM EACH UPPER SASH BOTTOM RAIL CORNER
D.	(4) FS PIVOT BAR, TWO EACH END OF EACH OPERABLE SASH BOTTOM RAIL
E.	(1) ALUMINUM IMPACT CLIP REINFORCEMENT, 1 1/2" C/L FROM EACH SASH BOTTOM LOCK RAIL CORNER UNDER METALLIC TILT LATCH
F.	(2) DIE-CAST ZINC CAM LOCKS, ONE 8" C/L FROM EACH JAMB CORNER ON SASH TOP RAIL LOCKING INTO KEEPERS IN KEEPER RAIL
G.	ALUMINUM REINFORCEMENT (10300082) AT ACTIVE SASH STILES AND TOP RAILS
H.	ALUMINUM REINFORCEMENT (10300083) AT LOCK RAIL
I.	ALUMINUM REINFORCEMENT (10300096) AT SILL

Design pressure rating (psf)

Frame Height (in)	Frame width (in)													
	36.00		39.00		42.00		45.00		48.00		51.00		53.00	
	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg
24.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0
30.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0
36.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0
42.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0
48.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	47.7	47.7
54.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	49.1	49.1	43.4	43.4
60.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	45.5	45.5	40.1	40.1
62.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	44.5	44.5	39.1	39.1
66.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	42.7	42.7	-	-
72.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	-	-	-	-
78.0	50.0	50.0	50.0	50.0	50.0	50.0	-	-	-	-	-	-	-	-
84.0	50.0	50.0	50.0	50.0	-	-	-	-	-	-	-	-	-	-
90.0	50.0	50.0	-	-	-	-	-	-	-	-	-	-	-	-
96.0	50.0	50.0	-	-	-	-	-	-	-	-	-	-	-	-

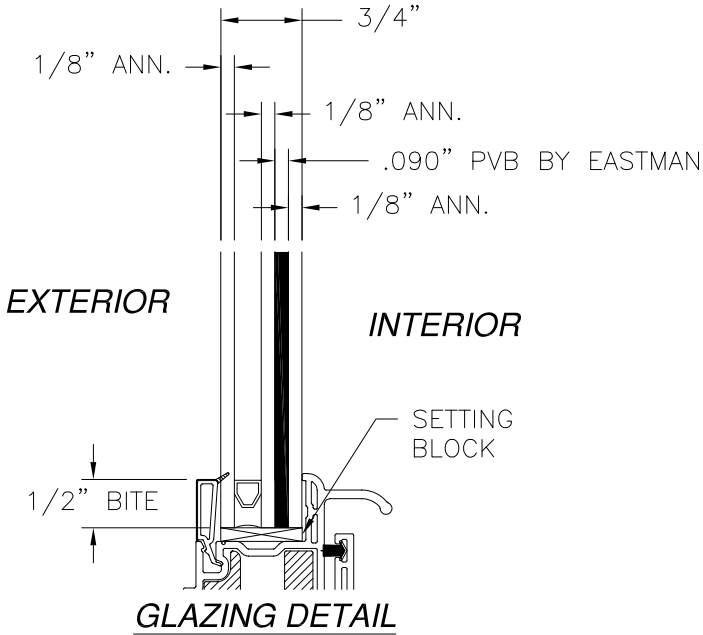

SIGNED: 01/25/2021



EASTERN ARCHITECTURAL SYSTEMS
A DIVISION OF
EASTERN METAL SUPPLY

16341 DOMESTIC AVE
FORT MYERS, FL 33912
800-432-2204

2561 VINYL DOUBLE HUNG WINDOW
48" x 72" IMPACT
ELEVATION


DRAWN: A.R.	DWG NO. 08-03666	REV -
SCALE NTS	DATE 01/18/21	SHEET 2 OF 6

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@lrlomaspe.com




Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

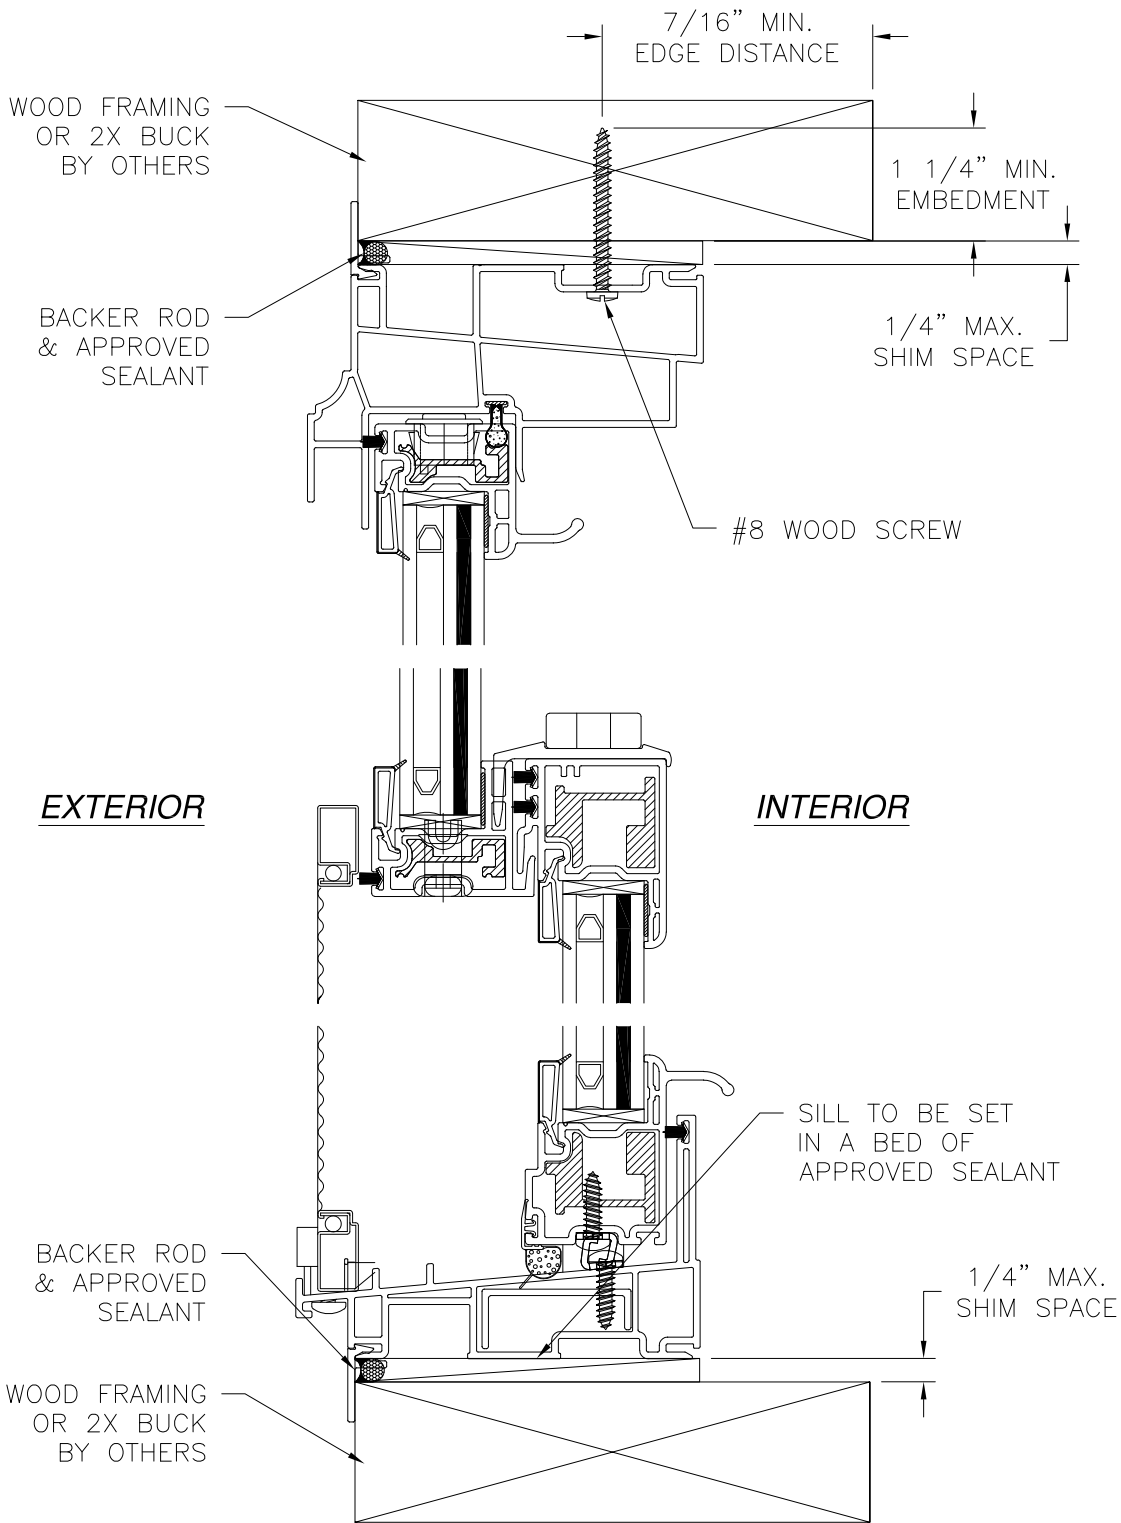

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

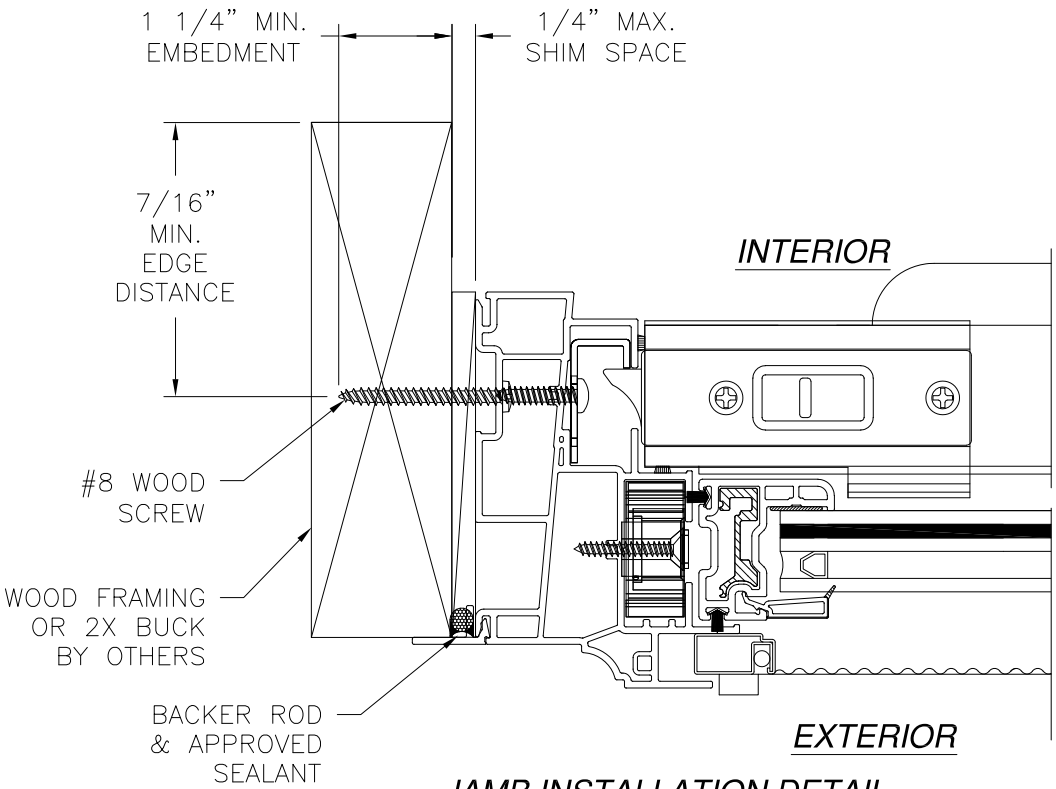

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

- NOTES:**
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 01/25/2021



EASTERN ARCHITECTURAL SYSTEMS

A DIVISION OF

EASTERN METAL SUPPLY

16341 DOMESTIC AVE

FORT MYERS, FL 33912

800-432-2204

2561 VINYL DOUBLE HUNG WINDOW

48" x 72" IMPACT


INSTALLATION DETAILS

DRAWN:	DWG NO.	REV
A.R.	08-03666	-
SCALE NTS	DATE 01/18/21	SHEET 3 OF 6

L. ROBERTO LOMAS P.E.


1432 WOODFORD RD LEWISVILLE, NC 27023

434-688-0609 rllomas@lrlomaspe.com

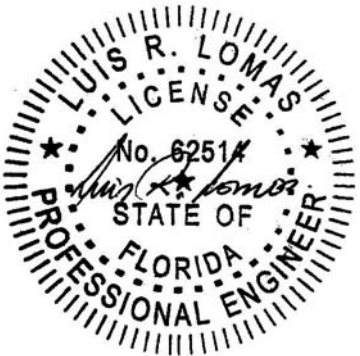


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

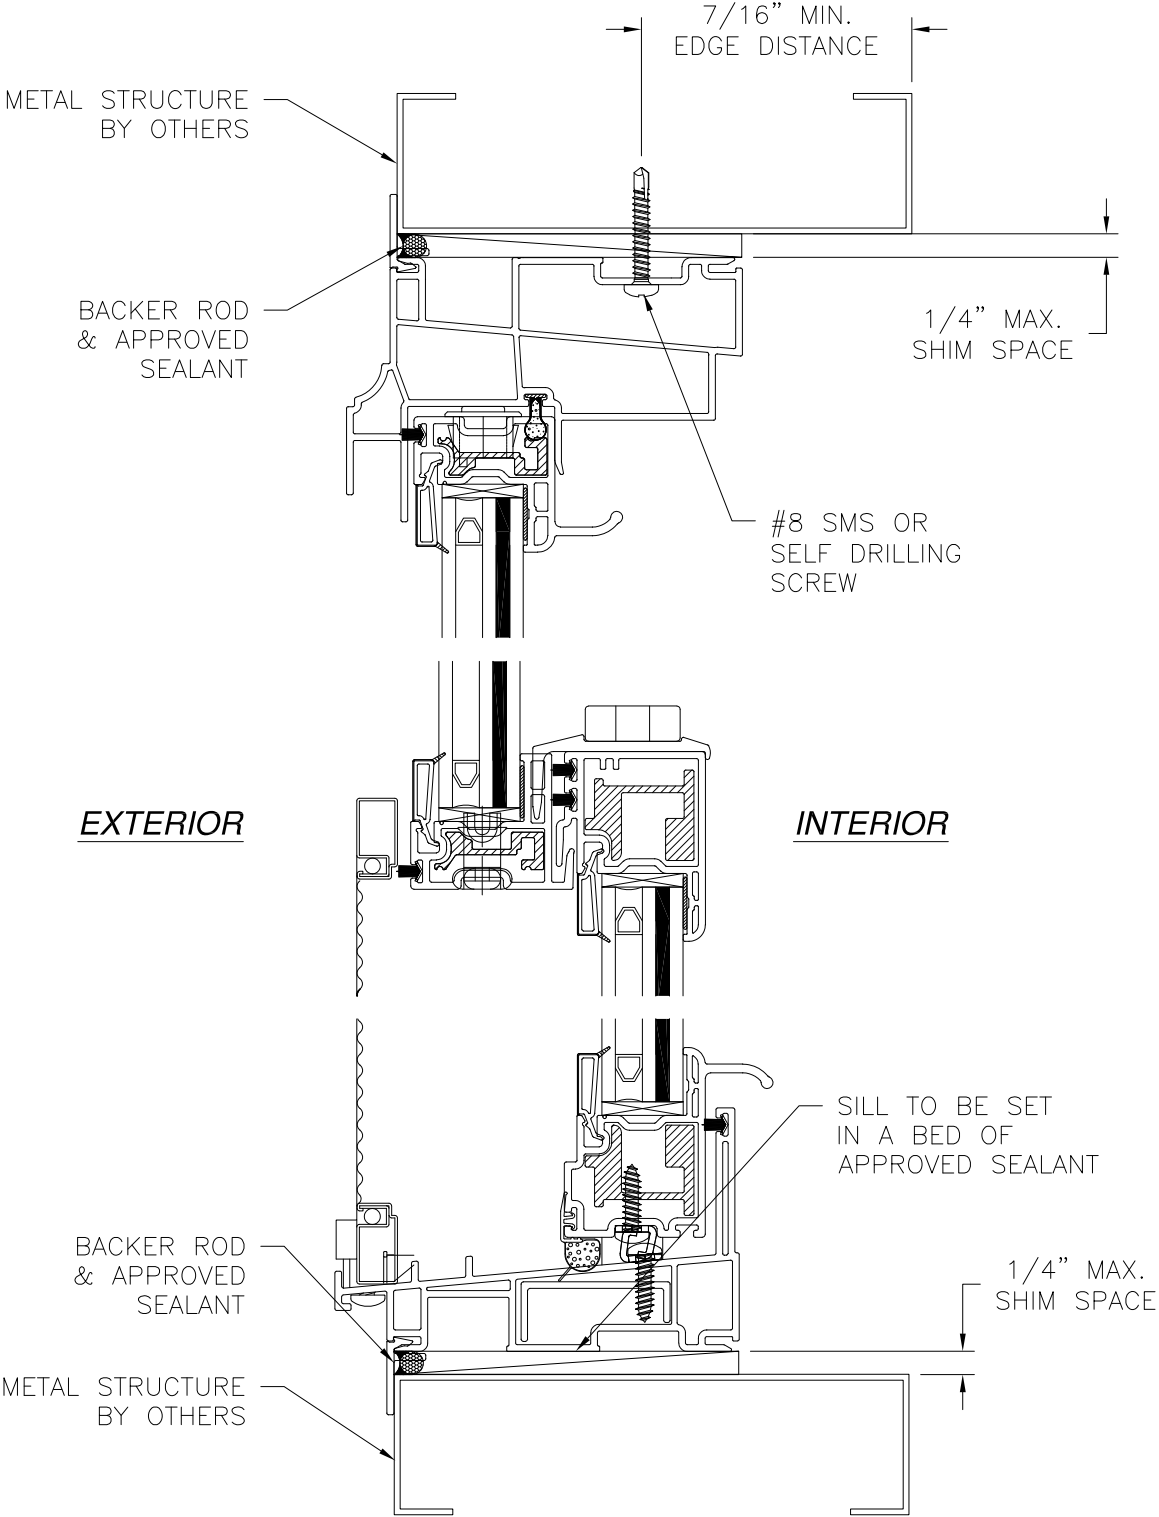

VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

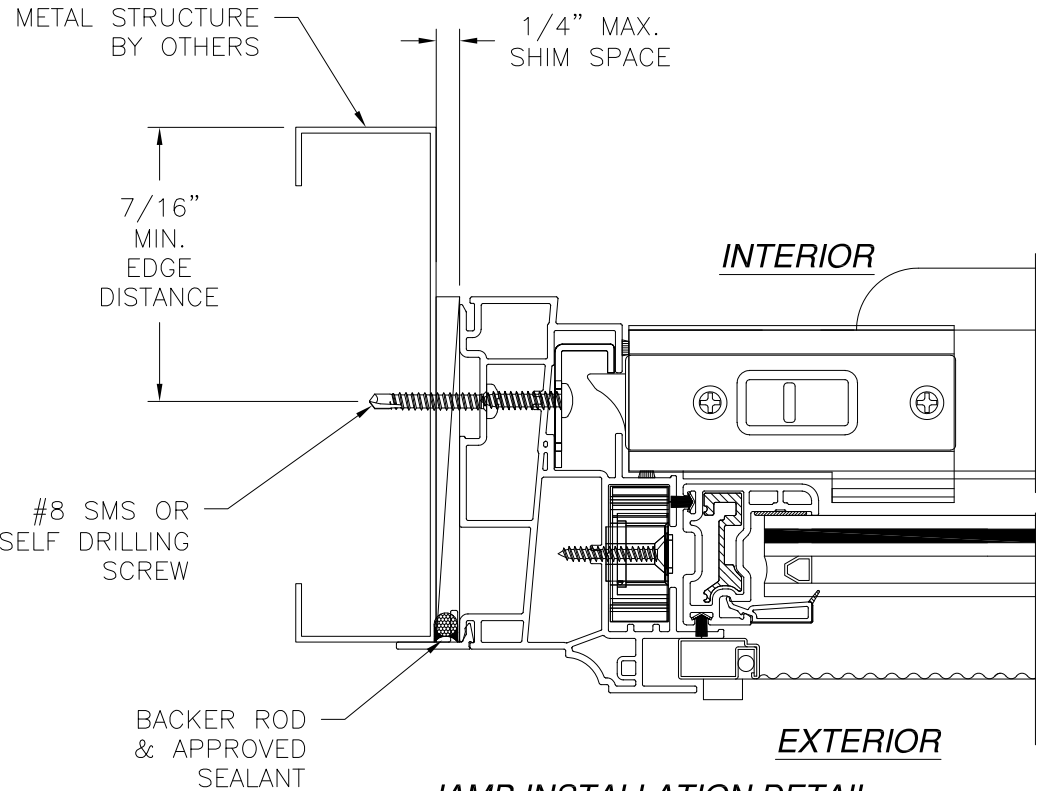

JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION

- NOTES:**
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 01/25/2021



EASTERN ARCHITECTURAL SYSTEMS

A DIVISION OF

EASTERN METAL SUPPLY

16341 DOMESTIC AVE

FORT MYERS, FL 33912

800-432-2204

2561 VINYL DOUBLE HUNG WINDOW

48" x 72" IMPACT

INSTALLATION DETAILS

DRAWN:	DWG NO.	REV
A.R.	08-03666	-
SCALE NTS	DATE 01/18/21	SHEET 4 OF 6




L. ROBERTO LOMAS P.E.

1432 WOODFORD RD LEWISVILLE, NC 27023

434-688-0609 rllomas@lrlomaspe.com



Luis R. Lomas P.E.
FL No.: 62514

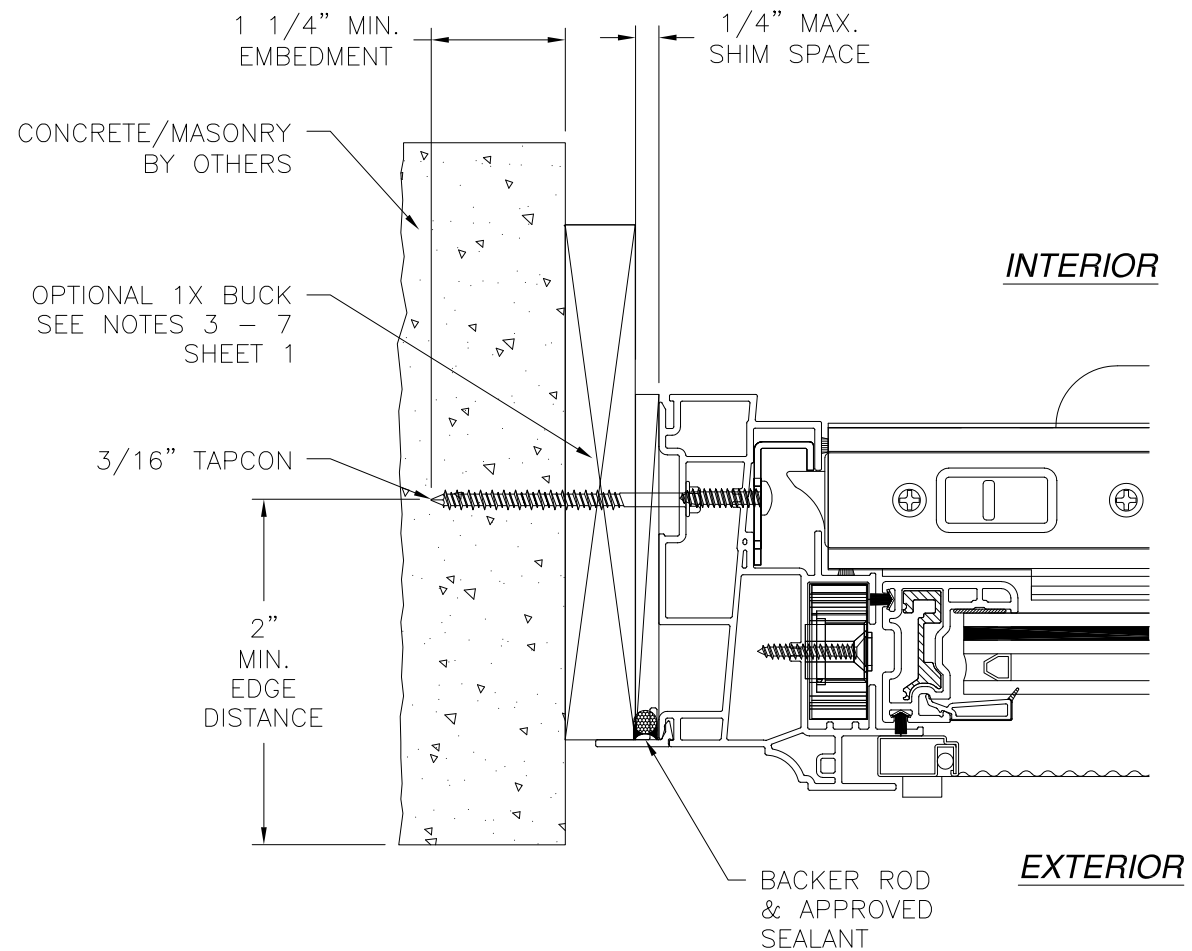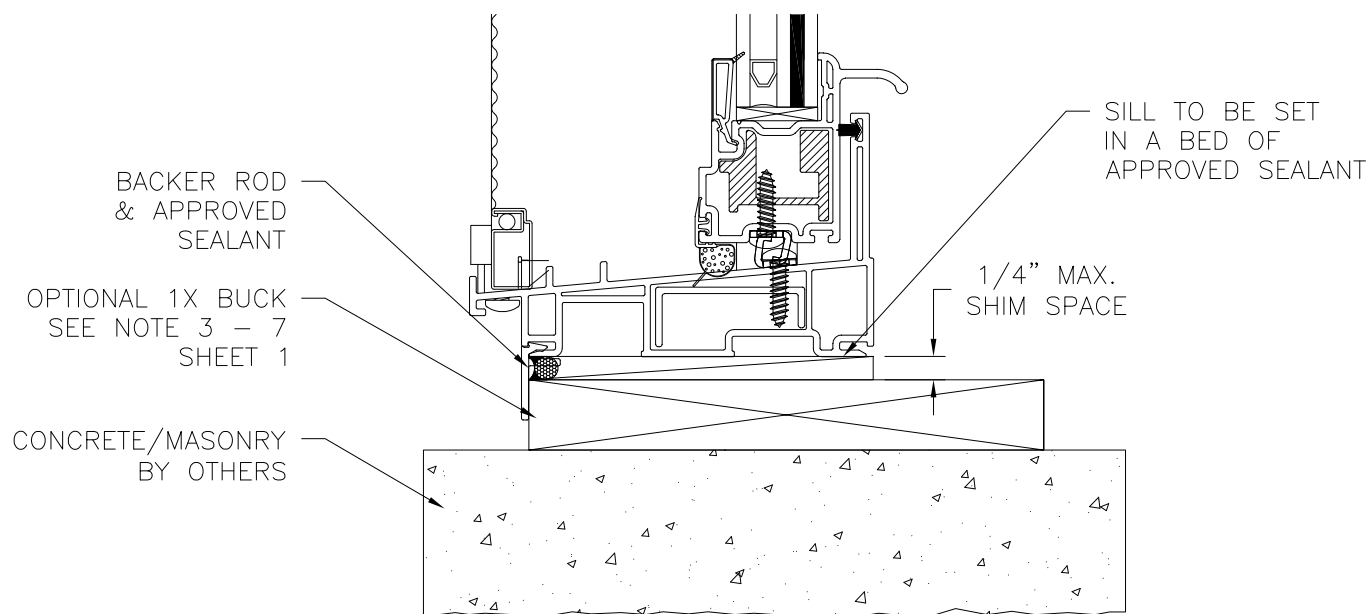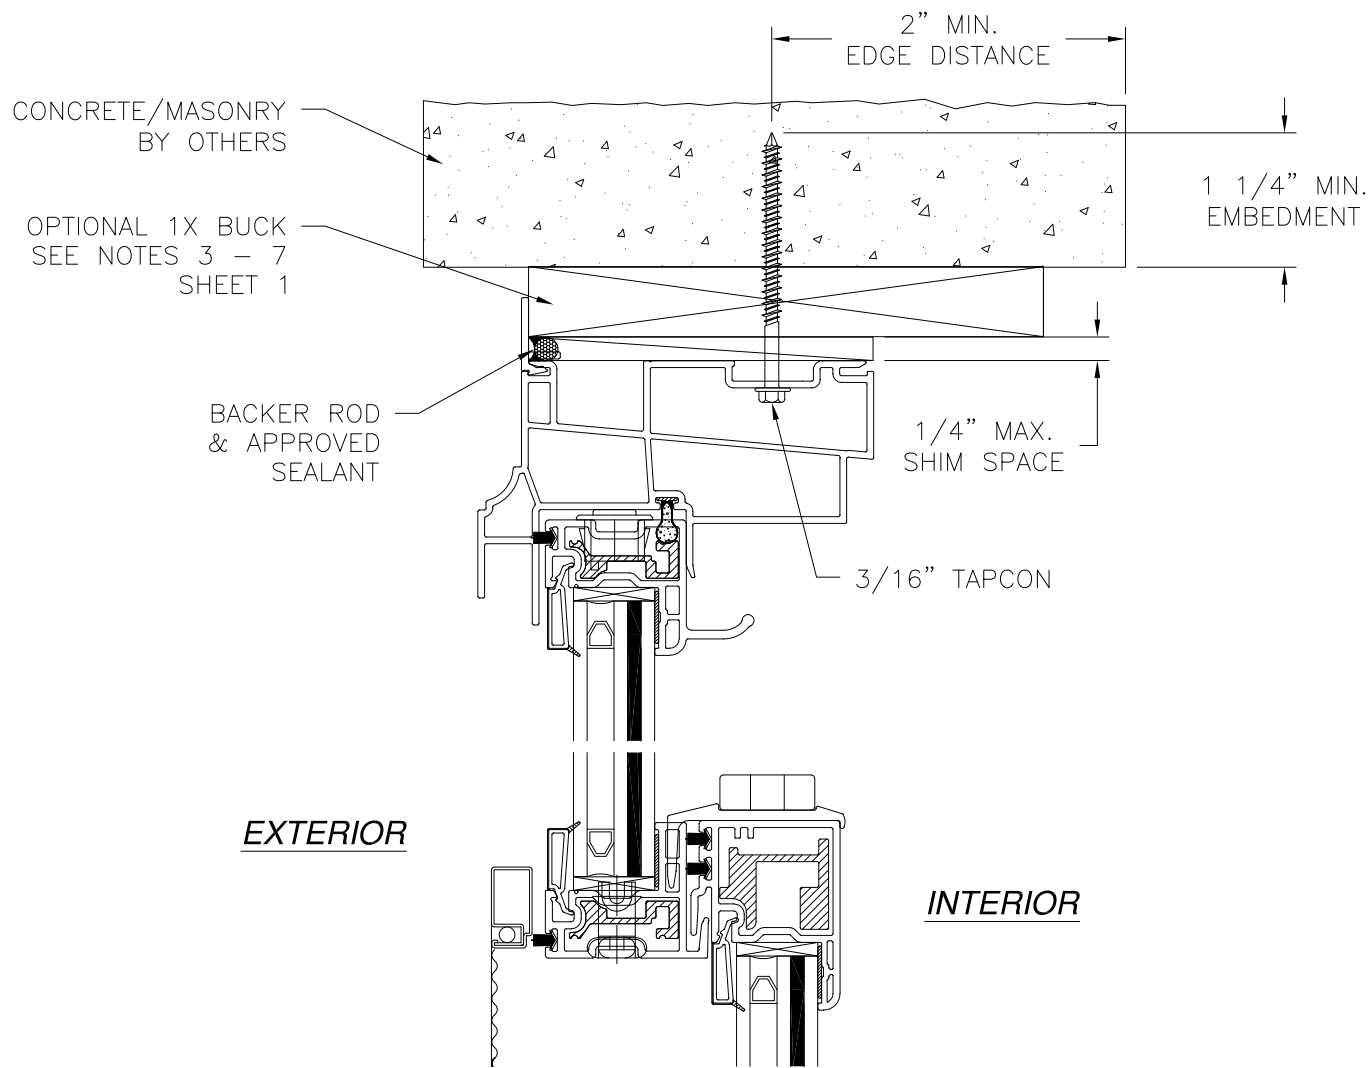

JAMB INSTALLATION DETAIL
CONCRETE/MASONRY INSTALLATION

- NOTES:**
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112



EASTERN ARCHITECTURAL SYSTEMS
A DIVISION OF
EASTERN METAL SUPPLY


16341 DOMESTIC AVE
FORT MYERS, FL 33912
800-432-2204

2561 VINYL DOUBLE HUNG WINDOW
48" x 72" IMPACT
INSTALLATION DETAILS

DRAWN: A.R.	DWG NO. 08-03666	REV -
SCALE NTS	DATE 01/18/21	SHEET 5 OF 6


L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 01/25/2021

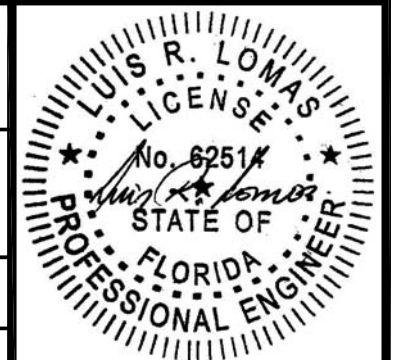


Luis R. Lomas P.E.
FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

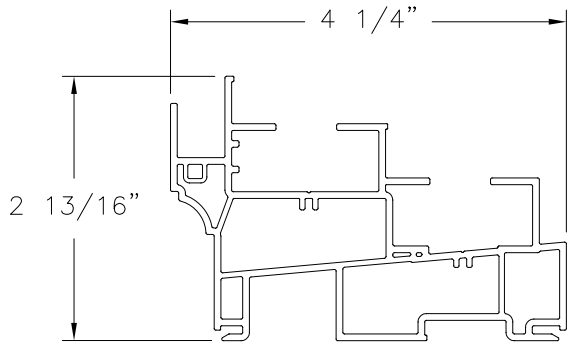


JAMB FRAME (10008690)
EXTRUDED VINYL PVC

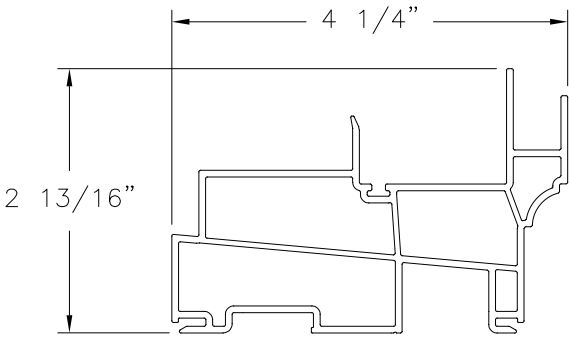


HEAD FRAME (10008691)
EXTRUDED VINYL PVC

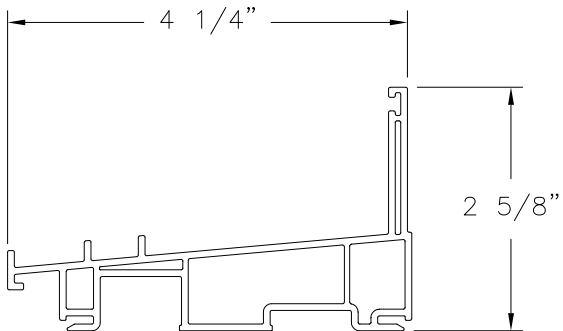


SILL FRAME (10008692)
EXTRUDED VINYL PVC

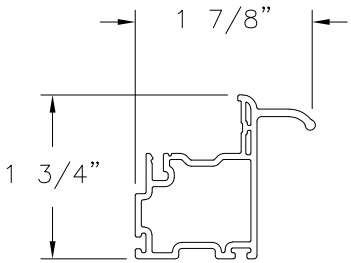


BOTTOM LIFT RAIL (8893)
EXTRUDED VINYL PVC

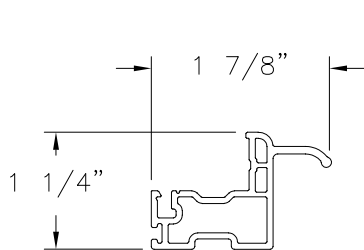


TOP LIFT RAIL (8894)
EXTRUDED VINYL PVC

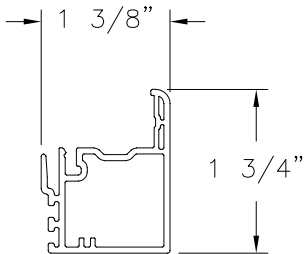


LOCK RAIL (8896)
EXTRUDED VINYL PVC

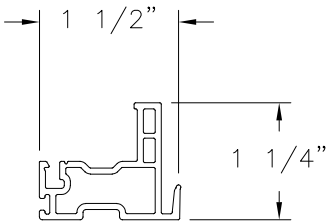


KEEPER RAIL (8890)
EXTRUDED VINYL PVC

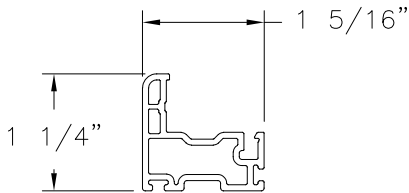


TOP STILE (8875)
EXTRUDED VINYL PVC




GLAZING BEAD (5470)
EXTRUDED VINYL PVC



REINFORCEMNT (10300082)
EXTRUDED VINYL PVC



REINFORCEMENT (10300083)
ALUMINUM 6005-T5, 6061-T6 OR 6105-T5

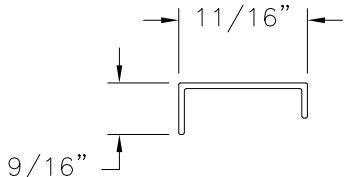

REINFORCEMENT (10300096)
ALUMINUM 6005-T5, 6061-T6 OR 6105-T5



EASTERN ARCHITECTURAL SYSTEMS

A DIVISION OF

EASTERN METAL SUPPLY

16341 DOMESTIC AVE

FORT MYERS, FL 33912

800-432-2204

2561 VINYL DOUBLE HUNG WINDOW

48" x 72" IMPACT COMPONENTS

DRAWN:	DWG NO.	REV
A.R.	08-03666	-
SCALE NTS	DATE 01/18/21	SHEET 6 OF 6

L. ROBERTO LOMAS P.E.

1432 WOODFORD RD LEWISVILLE, NC 27023

434-688-0609 rllomas@lrlomaspe.com

SIGNED: 01/25/2021



Luis R. Lomas P.E.
FL No.: 62514