

SERIES MG-1500 (L.M.I.)
ALUMINUM SLIDING GLASS DOOR

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2023 (8TH EDITION)/2026 (9TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.


ALL SHIMS TO BE LOAD-BEARING, (HIGH DENSITY PLASTIC/COMPOSITE, METAL OR OTHER RIGID MATERIALS).

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2023/2026 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC. CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE. LABELING TO COMPLY WITH SECTION 1709.9.2.

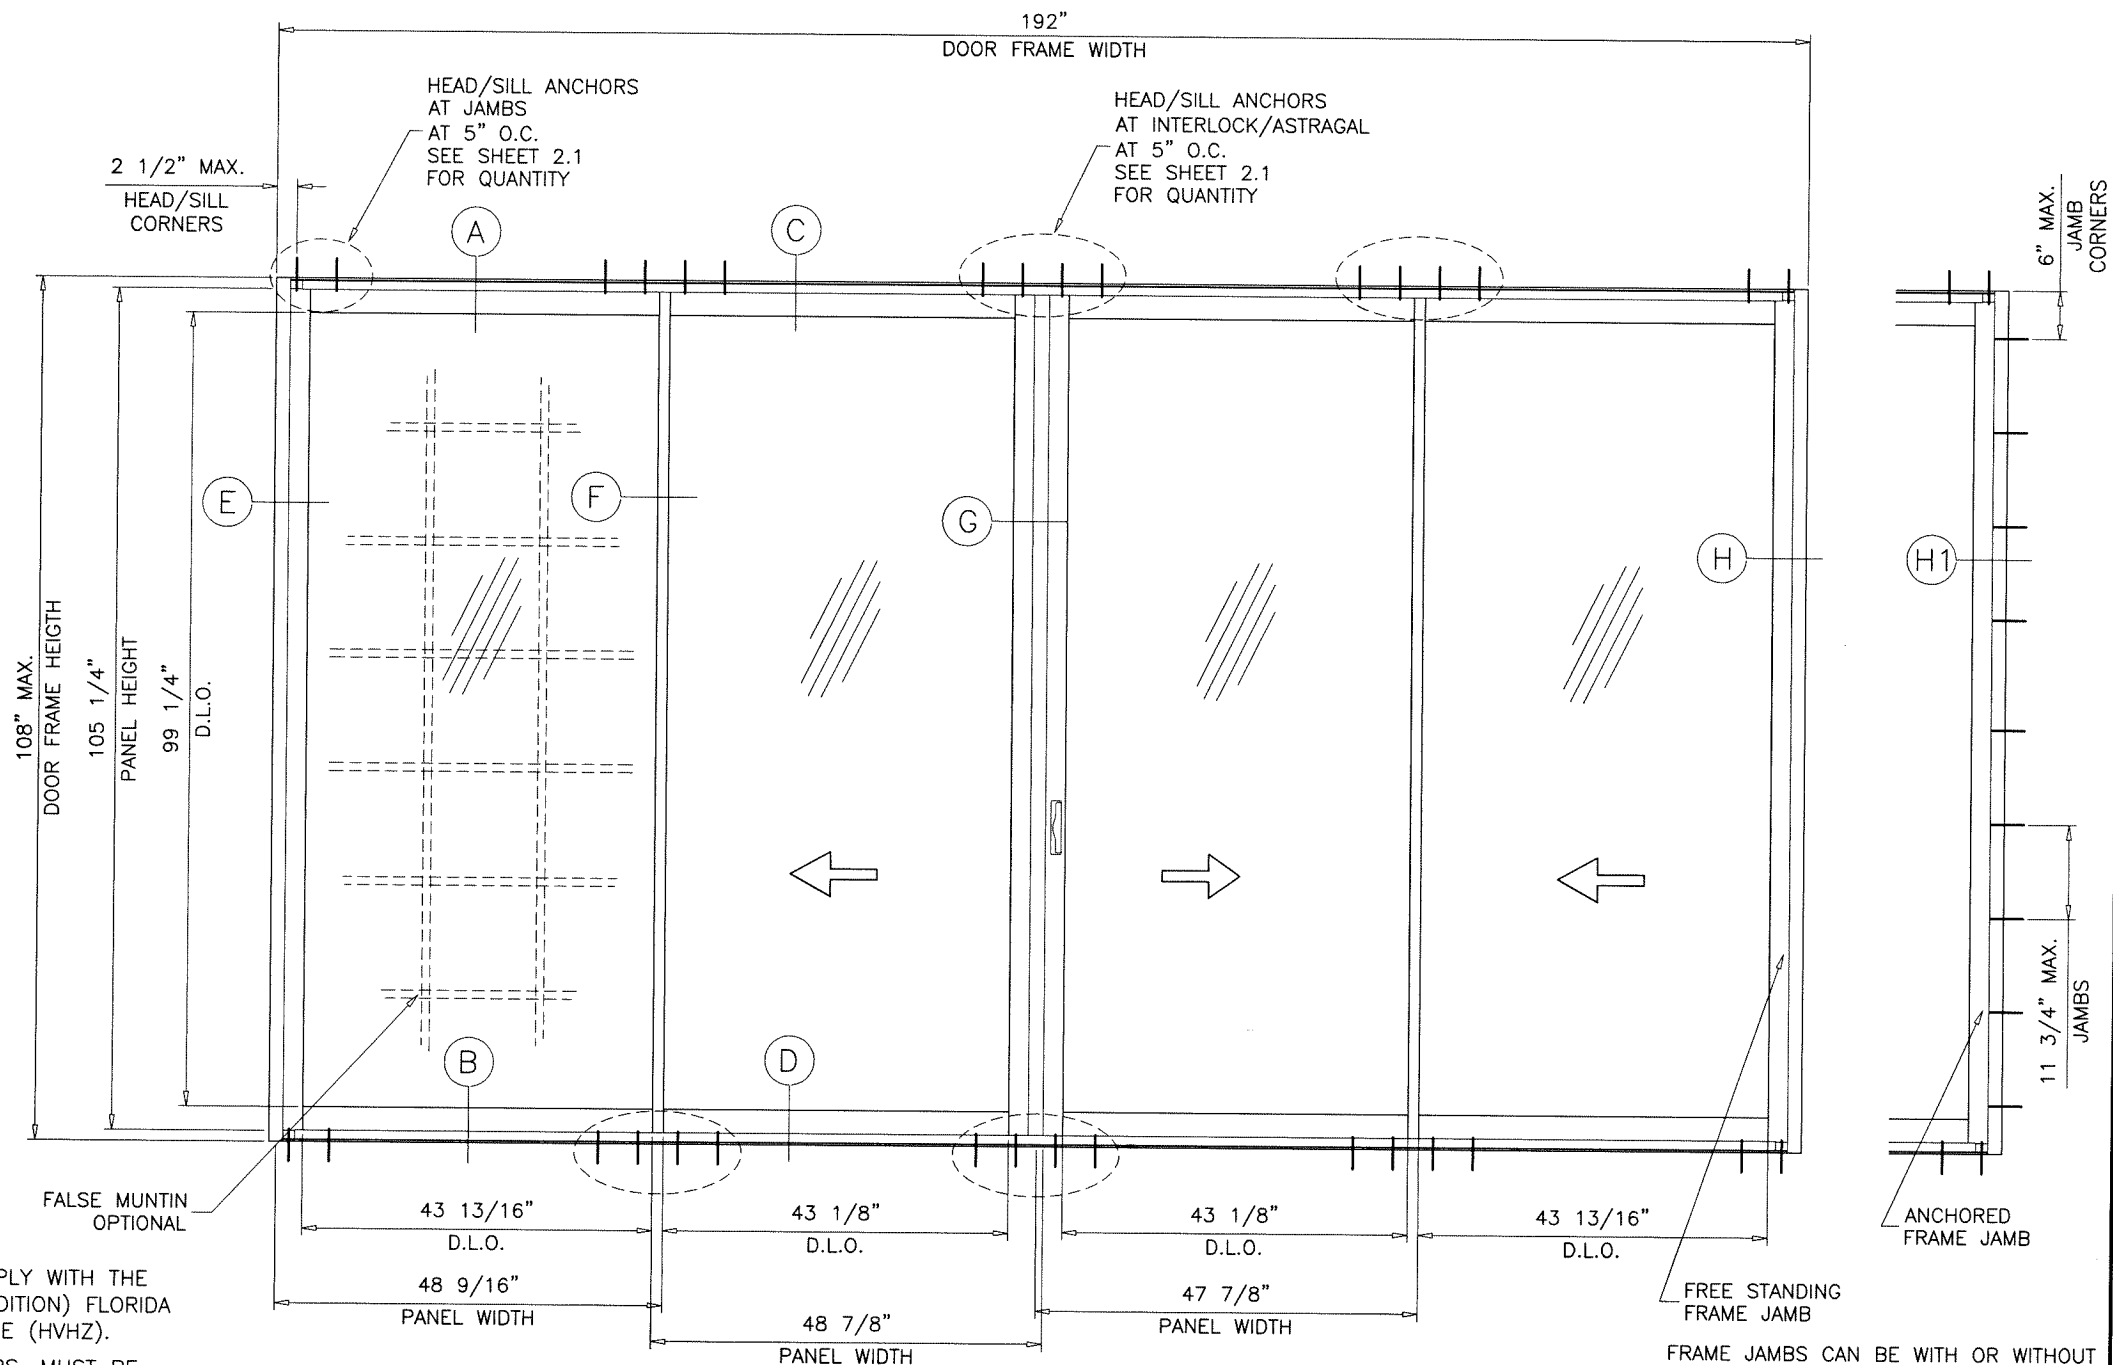

TYPICAL ELEVATION
 TESTED UNIT

THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

FASTENERS AND CONNECTORS (AS APPLICABLE) SHOWN IN THIS APPROVAL MAY NOT MEET CORROSION RESISTANCE REQUIREMENTS FOR COASTAL OR SALT WATER EXPOSURE ZONES. COMPLIANCE WITH THESE CONDITIONS TO BE CHECKED PER FBC 1711.

INSTRUCTIONS:

USE CHARTS AS FOLLOWS

- STEP 1** DETERMINE DESIGN WIND LOAD REQUIREMENT BASED ON WIND VELOCITY, BLDG. HEIGHT, WIND ZONE USING APPLICABLE ASCE 7 STANDARD.
- STEP 2** DETERMINE DOOR CAPACITY FROM TABLE ON SHEET 2 FOR INTERLOCK AND ASTRAGAL STILES USED.
- STEP 3** USING CHARTS ON SHEET 2.1 SELECT ANCHOR OPTION WITH DESIGN RATING MORE THAN DESIGN LOAD SPECIFIED IN STEP 1 ABOVE.
- STEP 4** FOR DOORS WITH FREE STANDING JAMBS SEE SHEET 6 TO VERIFY MIN. & MAX. GAP DIMENSIONS.
- STEP 5** THE LOWEST VALUE RESULTING FROM STEPS 2 THRU 4 SHALL APPLY TO ENTIRE SYSTEM.

Sealed: 8/7/2026


FL #38057

A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT.

B- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.

C- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC DRAWINGS FOR REVIEW.

D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

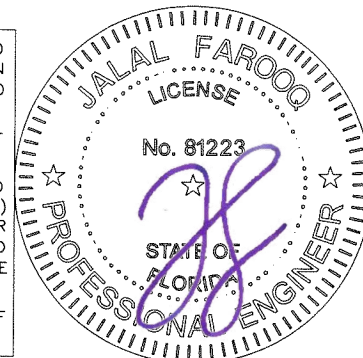

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\21-16F-MG

MG-1500 ALUM SLIDING GLASS DOOR (L.M.I.)

MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC
 8051 N.W. 79th Place
 Medley, FL. 33166
 Tel. (305) 764-3963 Fax. (305) 470-8285

revisions:	no.	date	description	by
	A	07.01.21	GLASS TYPE B ADDED	
	B	01.12.23	STILES OPTIONS ADDED	
	C	06.07.23	STD. ASTRAGAL ADDED	
	D	07.18.23	UPDATED TO 2023 FBC	
	E	07.29.26	UPDATED TO 2026 FBC	

date: 02-25-21
 scale: 1/2"=1'-0"
 dr. by: TARIQ
 chk. by:

drawing no.
 21-16F
 sheet 1 of 10



DESIGN LOAD CAPACITY - PSF							
AVERAGE PANEL WIDTH INCHES	DOOR FRAME HEIGHT INCHES	GLASS TYPES 'A' & 'A1'		GLASS TYPE 'A1'		GLASS TYPE 'B'	
		STD. INTERLOCKS STD. ASTRAGAL		H.D. INTERLOCKS H.D. ASTRAGAL		H.D. INTERLOCKS H.D. ASTRAGAL	
		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
30	82	60.0	65.0	65.0	80.0	60.0	65.0
36		60.0	65.0	65.0	80.0	60.0	65.0
42		60.0	65.0	65.0	80.0	60.0	65.0
48		60.0	65.0	65.0	80.0	60.0	65.0
54		-	-	65.0	80.0	60.0	65.0
60		-	-	65.0	80.0	60.0	65.0
63		-	-	65.0	80.0	60.0	65.0
30	84	60.0	65.0	65.0	80.0	60.0	65.0
36		60.0	65.0	65.0	80.0	60.0	65.0
42		60.0	65.0	65.0	80.0	60.0	65.0
48		60.0	65.0	65.0	80.0	60.0	65.0
54		-	-	65.0	80.0	60.0	65.0
61		-	-	65.0	80.0	60.0	65.0
30	90	-	-	65.0	80.0	60.0	65.0
36		-	-	65.0	80.0	60.0	65.0
42		-	-	65.0	80.0	60.0	65.0
48		-	-	65.0	80.0	60.0	65.0
54		-	-	65.0	80.0	60.0	65.0
57		-	-	65.0	80.0	60.0	65.0
30	96	-	-	65.0	80.0	60.0	65.0
36		-	-	65.0	80.0	60.0	65.0
42		-	-	65.0	80.0	60.0	65.0
48		-	-	65.0	80.0	60.0	65.0
50		-	-	60.0	65.0	60.0	65.0
54		-	-	60.0	65.0	60.0	65.0
30	102	-	-	60.0	65.0	60.0	65.0
36		-	-	60.0	65.0	60.0	65.0
42		-	-	60.0	65.0	60.0	65.0
48		-	-	60.0	65.0	60.0	65.0
50		-	-	60.0	65.0	60.0	65.0
54		-	-	60.0	65.0	60.0	65.0
30	108	-	-	60.0	65.0	60.0	65.0
36		-	-	60.0	65.0	60.0	65.0
42		-	-	60.0	65.0	60.0	65.0
48		-	-	60.0	65.0	60.0	65.0

SEE CHART ABOVE FOR DESIGN LOAD CAPACITY OF DESIRED GLASS SIZE.


SEE CHART ON SHEET 2.1 FOR HEAD/SILL ANCHOR CAPACITY. LOWER DESIGN PRESSURES FROM DESIGN LOAD CHART OR ANCHOR CHART WILL APPLY TO ENTIRE SYSTEM.

DOOR HEIGHT AND WIDTH SIZE MUST COMPLY EGRESS REQUIREMENTS PER FBC AS REQUIRED.


$$\text{AVERAGE PANEL WIDTH} = \frac{\text{DOOR FRAME WIDTH}}{\text{NUMBER OF PANELS}}$$

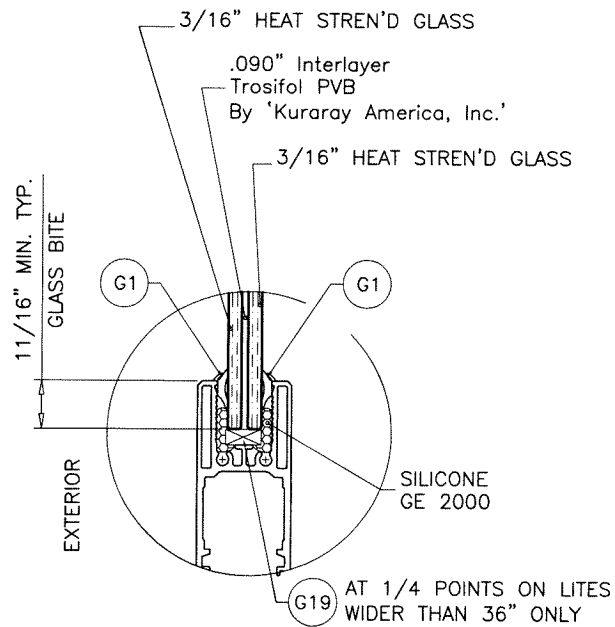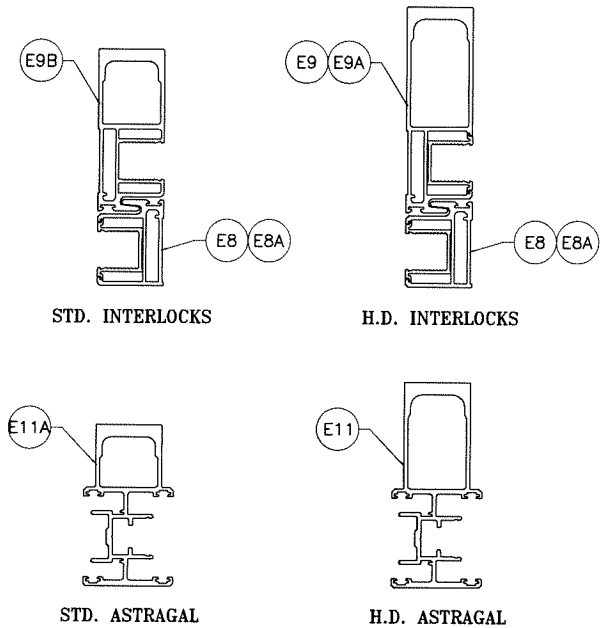

GLASS TYPE 'A'
7/16" OVERALL LAM. GLASS

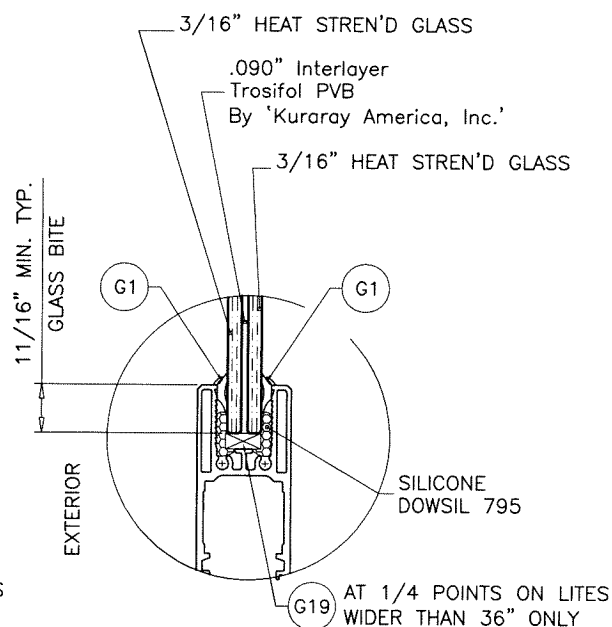

GLASS TYPE 'A1'
7/16" OVERALL LAM. GLASS

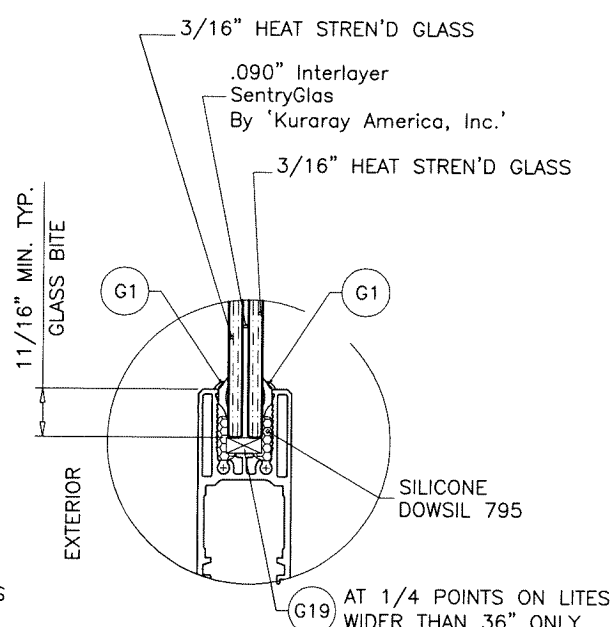


GLASS TYPE 'B'
7/16" OVERALL LAM. GLASS

GLAZING OPTIONS

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-16 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

Sealed: 8/7/2026

FL #38057

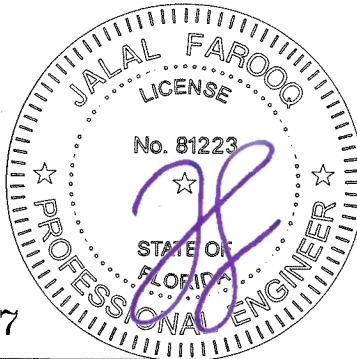

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

MG-1500 ALUM SLIDING GLASS DOOR (L.M.I.)
MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC
8051 N.W. 79th Place
Medley, FL. 33166
Tel. (305) 764-3963 Fax. (305) 470-8285

revisions:	no	date	by	description

date: 02-25-21	scale: 3/8" = 1"	dr. by: TARIQ	chk. by:
drawing no. 21-16F		sheet 2 of 10	

HEAD/SILL ANCHOR LOAD CAPACITY - PSF																								
AVERAGE PANEL WIDTH INCHES	DOOR FRAME HEIGHT INCHES	1/4" MAX. SHIM SPACE						3/8" MAX. SHIM SPACE						1/2" MAX. SHIM SPACE				3/4" MAX. SHIM SPACE						
		ANCHOR TYPE 'A'		ANCHOR TYPE 'B'		ANCHOR TYPE 'C'		ANCHOR TYPE 'A'		ANCHOR TYPE 'B'		ANCHOR TYPE 'C'		ANCHOR TYPE 'A' & 'B'		ANCHOR TYPE 'C'		ANCHOR TYPE 'A' & 'B'			ANCHOR TYPE 'C'			
		2 ANCHORS AT JAMBS	3 ANCHORS AT JAMBS	2 ANCHORS AT JAMBS	3 ANCHORS AT JAMBS	2 ANCHORS AT JAMBS	3 ANCHORS AT JAMBS	2 ANCHORS AT JAMBS	3 ANCHORS AT JAMBS	2 ANCHORS AT JAMBS	3 ANCHORS AT JAMBS	2 ANCHORS AT JAMBS	3 ANCHORS AT JAMBS	2 ANCHORS AT JAMBS	3 ANCHORS AT JAMBS	2 ANCHORS AT JAMBS	3 ANCHORS AT JAMBS	2 ANCHORS AT JAMBS	3 ANCHORS AT JAMBS	4 ANCHORS AT JAMBS	2 ANCHORS AT JAMBS	3 ANCHORS AT JAMBS	4 ANCHORS AT JAMBS	
		4 ANCHORS STILE ENDS	6 ANCHORS STILE ENDS	4 ANCHORS STILE ENDS	6 ANCHORS STILE ENDS	4 ANCHORS STILE ENDS	6 ANCHORS STILE ENDS	4 ANCHORS STILE ENDS	6 ANCHORS STILE ENDS	4 ANCHORS STILE ENDS	6 ANCHORS STILE ENDS	4 ANCHORS STILE ENDS	6 ANCHORS STILE ENDS	4 ANCHORS STILE ENDS	6 ANCHORS STILE ENDS	4 ANCHORS STILE ENDS	6 ANCHORS STILE ENDS	4 ANCHORS STILE ENDS	6 ANCHORS STILE ENDS	8 ANCHORS STILE ENDS	4 ANCHORS STILE ENDS	6 ANCHORS STILE ENDS	8 ANCHORS STILE ENDS	
		EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)
30	82	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	76.5	80.0	80.0	
36		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	63.8	80.0	80.0	
42		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	54.7	80.0	80.0	
48		78.1	80.0	80.0	80.0	80.0	80.0	78.1	80.0	80.0	80.0	72.2	80.0	68.4	80.0	61.7	80.0	52.6	78.9	80.0	47.8	71.7	80.0	
54		69.5	80.0	80.0	80.0	77.2	80.0	69.5	80.0	71.6	80.0	64.2	80.0	60.8	80.0	54.8	80.0	46.8	70.1	80.0	42.5	63.8	80.0	
60		62.5	80.0	78.3	80.0	69.5	80.0	62.5	80.0	64.4	80.0	57.7	80.0	54.7	80.0	49.4	74.0	42.1	63.1	80.0	38.3	57.4	76.5	
63		59.5	80.0	74.6	80.0	66.2	80.0	59.5	80.0	61.4	80.0	55.0	80.0	52.1	78.2	47.0	70.5	40.1	60.1	80.0	36.4	54.7	72.9	
30	84	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	74.7	80.0	80.0	
36		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	62.2	80.0	80.0		
42		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	76.3	80.0	68.8	80.0	58.7	80.0	80.0	53.4	80.0	80.0	
48		76.3	80.0	80.0	80.0	80.0	80.0	76.3	80.0	78.6	80.0	70.5	80.0	66.8	80.0	60.2	80.0	51.3	77.0	80.0	46.7	70.0	80.0	
54		67.8	80.0	80.0	80.0	75.4	80.0	67.8	80.0	69.9	80.0	62.6	80.0	59.4	80.0	53.5	80.0	45.6	68.5	80.0	41.5	62.2	80.0	
61		60.0	80.0	75.2	80.0	66.8	80.0	60.0	80.0	61.9	80.0	55.4	80.0	52.6	78.8	47.4	71.1	40.4	60.6	80.0	36.7	55.1	73.5	
30	90	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	76.7	80.0	80.0	69.7	80.0	80.0	
36		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	75.0	80.0	63.9	80.0	80.0	58.1	80.0	80.0	
42		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	75.2	80.0	71.3	80.0	64.2	80.0	54.8	80.0	80.0	49.8	74.7	80.0	
48		71.2	80.0	80.0	80.0	79.2	80.0	71.2	80.0	73.4	80.0	65.8	80.0	62.3	80.0	56.2	80.0	47.9	71.9	80.0	43.6	65.4	80.0	
54		63.3	80.0	79.3	80.0	70.4	80.0	63.3	80.0	65.2	80.0	58.5	80.0	55.4	80.0	50.0	75.0	42.6	63.9	80.0	38.7	58.1	77.5	
57		60.0	80.0	75.1	80.0	66.7	80.0	60.0	80.0	61.8	80.0	55.4	80.0	52.5	78.8	47.3	71.0	40.4	60.5	80.0	36.7	55.0	73.4	
30	96	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	71.9	80.0	80.0	65.4	80.0	80.0	
36		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	77.9	80.0	70.3	80.0	59.9	80.0	80.0	54.5	80.0	80.0	
42		76.3	80.0	80.0	80.0	80.0	80.0	76.3	80.0	78.6	80.0	70.5	80.0	66.8	80.0	60.2	80.0	51.3	77.0	80.0	46.7	70.0	80.0	
48		66.8	80.0	80.0	80.0	74.2	80.0	66.8	80.0	68.8	80.0	61.7	80.0	58.5	80.0	52.7	79.1	44.9	67.4	80.0	40.9	61.3	80.0	
50		64.1	80.0	80.0	80.0	71.3	80.0	64.1	80.0	66.0	80.0	59.2	80.0	56.1	80.0	50.6	75.9	43.1	64.7	80.0	39.2	58.8	78.4	
54		59.3	80.0	74.4	80.0	66.0	80.0	59.3	80.0	61.2	80.0	54.8	80.0	52.0	77.9	46.8	70.3	39.9	59.9	80.0	36.3	54.5	72.6	
30	102	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	79.4	80.0	67.7	80.0	80.0	61.5	80.0	80.0	
36		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	77.4	80.0	73.3	80.0	66.1	80.0	56.4	80.0	80.0	51.3	76.9	80.0	
42		71.8	80.0	80.0	80.0	79.8	80.0	71.8	80.0	74.0	80.0	66.3	80.0	62.9	80.0	56.7	80.0	48.3	72.5	80.0	43.9	65.9	80.0	
48		62.8	80.0	78.7	80.0	69.9	80.0	62.8	80.0	64.8	80.0	58.0	80.0	55.0	80.0	49.6	74.4	42.3	63.4	80.0	38.4	57.7	76.9	
50		60.3	80.0	75.6	80.0	67.1	80.0	60.3	80.0	62.2	80.0	55.7	80.0	52.8	79.2	47.6	71.4	40.6	60.9	80.0	36.9	55.4	73.8	
30	108	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	75.0	80.0	63.9	80.0	80.0	58.1	80.0	80.0	
36		79.1	80.0	80.0	80.0	80.0	80.0	79.1	80.0	80.0	80.0	73.1	80.0	69.3	80.0	62.5	80.0	53.2	79.9	80.0	48.4	72.6	80.0	
42		67.8	80.0	80.0	80.0	75.4	80.0	67.8	80.0	69.9	80.0	62.6	80.0	59.4	80.0	53.5	80.0	45.6	68.5	80.0	41.5	62.2	80.0	
48		59.3	80.0	74.4	80.0	66.0	80.0	59.3	80.0	61.2	80.0	54.8	80.0	52.0	77.9	46.8	70.3	39.9	59.9	79.9	36.3	54.5	72.6	

SEE CHART ON SHEET 2 FOR DESIGN LOAD CAPACITY OF DESIRED GLASS SIZE.


SEE CHART ABOVE FOR HEAD/SILL ANCHOR CAPACITY.

FOR FREE STANDING JAMB CAPACITY SEE CHART ON SHEET 6.

LOWER DESIGN PRESSURES FROM DOOR DESIGN LOAD CHART OR ANCHOR CHARTS WILL APPLY TO ENTIRE SYSTEM.

Sealed: 8/7/2026

FL #38057

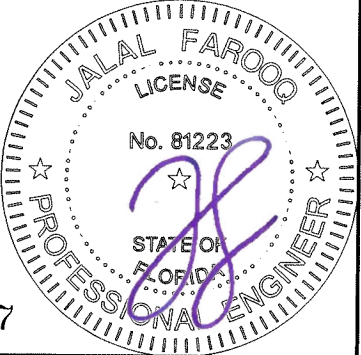

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP - ANL \ 21 - 16F - MG

MG-1500 ALUM SLIDING GLASS DOOR (L.M.I.)

MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC
8051 N.W. 79th Place
Medley, FL. 33166
Tel. (305) 764-3963

revisions:

no	date	by	description

date: 02-25-21

scale: -


dr. by: TARIQ

chk. by:


drawing no.

21-16F


sheet 2.1 of 10




OX (SHOWN)
XO




XX (SHOWN)



XOX (SHOWN)








XXO (SHOWN)
OXX

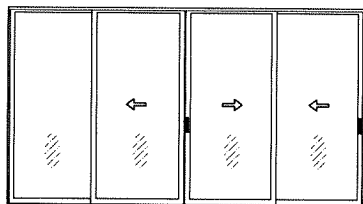

OXXX (SHOWN)
XXXO
OXXO


APPROVED CONFIGURATIONS

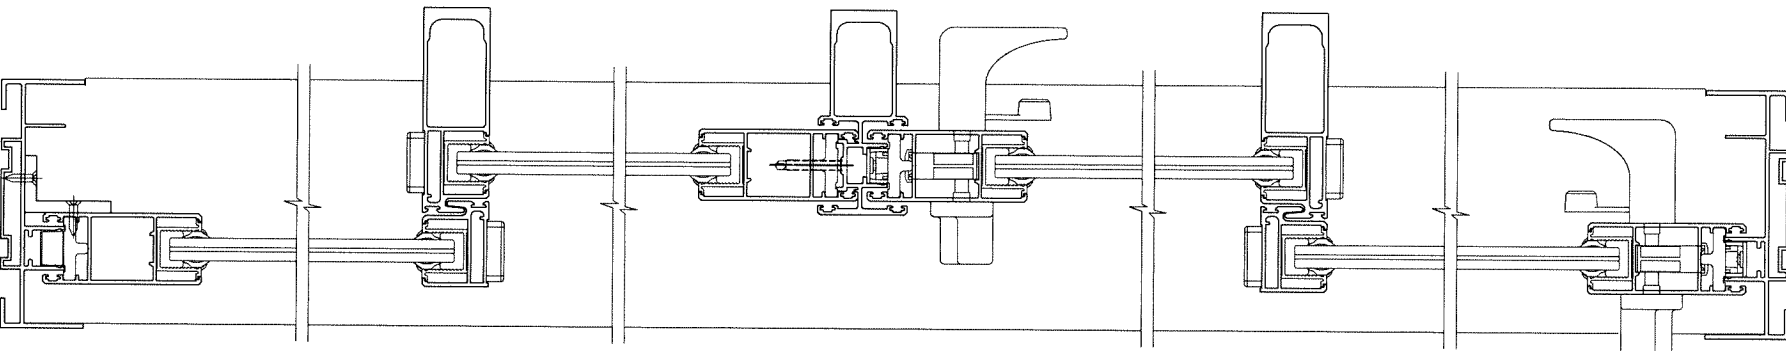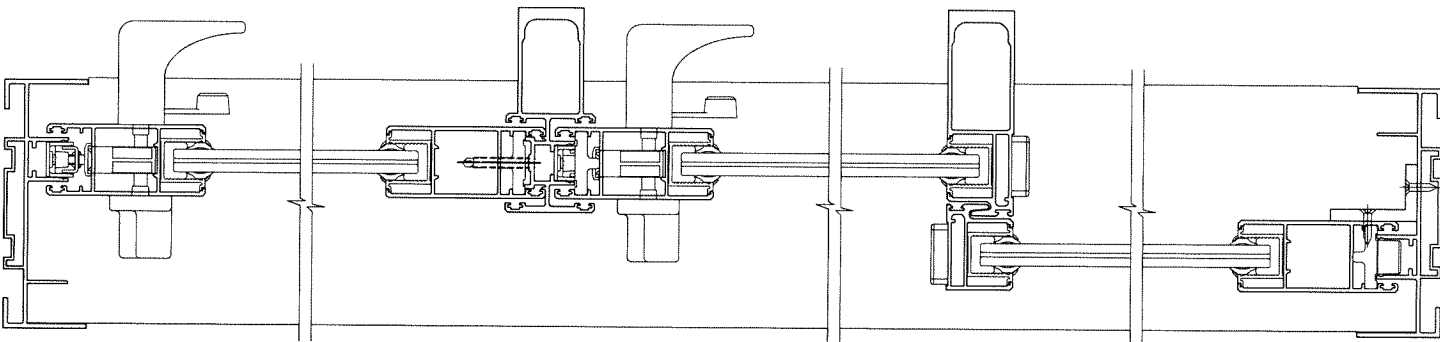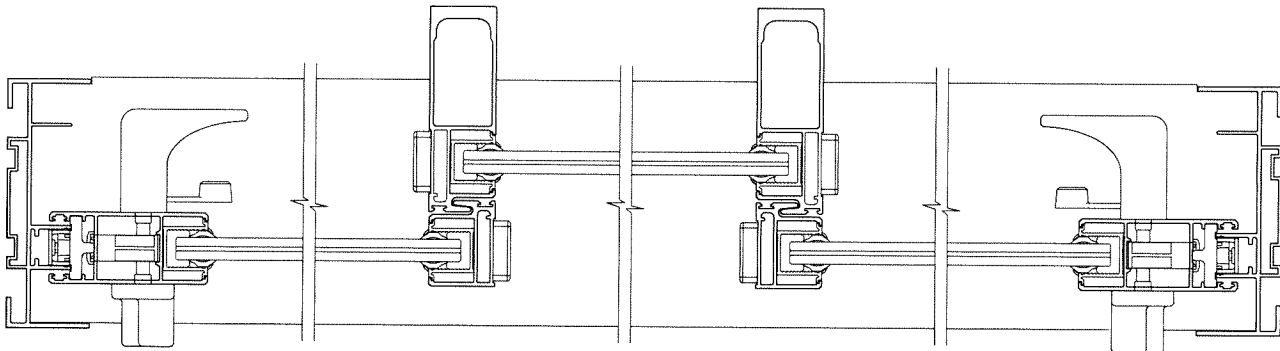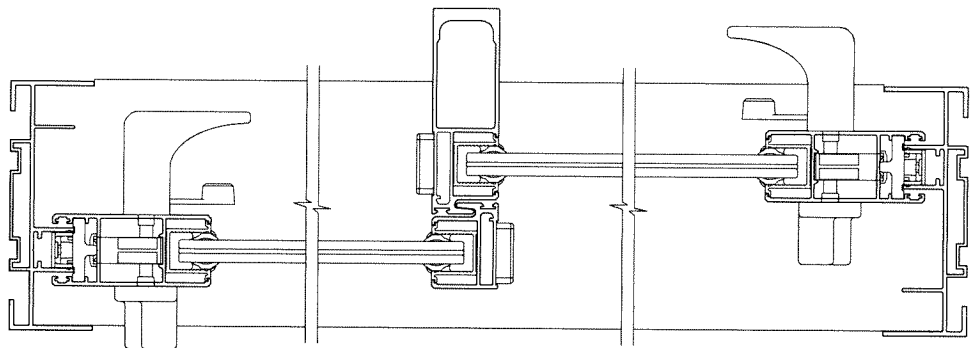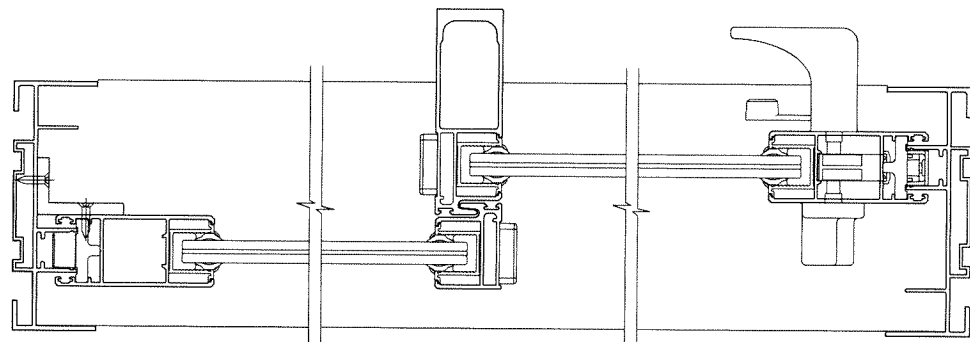

NOTE:

1. CONFIGURATIONS SHOWN FOR ILLUSTRATION PURPOSES ONLY.
2. FOR APPLICABLE DESIGN PRESSURES SEE SHEETS 2 & 2.1.
3. FOR ANCHOR DETAILS SEE SHEETS 4 THRU 7.

Sealed: 8/7/2026

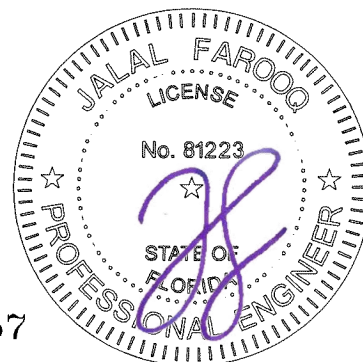

FL #38057

af c



AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

MG-1500 ALUM SLIDING GLASS DOOR (L.M.I.)

MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC
8051 N.W. 79th Place
Medley, FL. 33166
Tel. (305) 764-3963 Fax. (305) 470-8285

revisions:		no date by description	
date:	02-25-21	scale:	3/8" = 1"
dr. by:	TARIQ	chk. by:	
drawing no.	21-16F	sheet	3 of 10

COMP-ANL\21-16F-MG

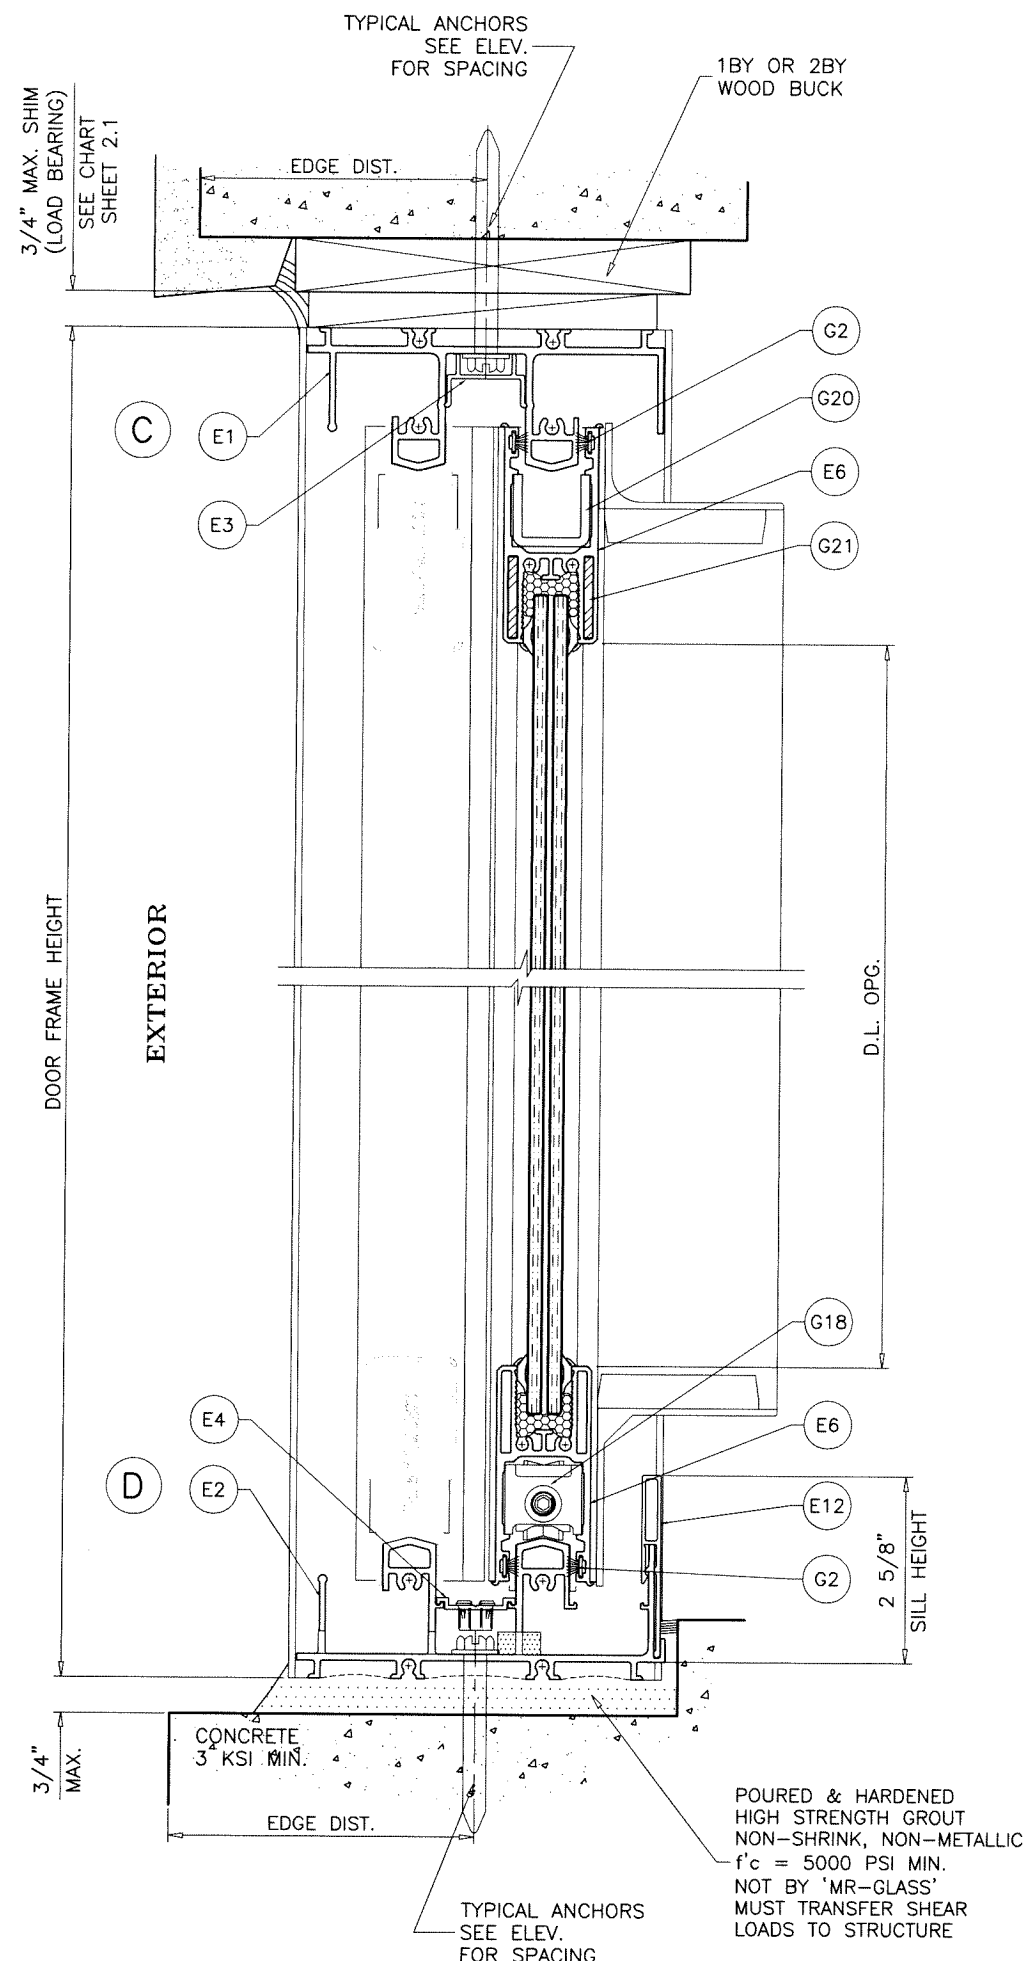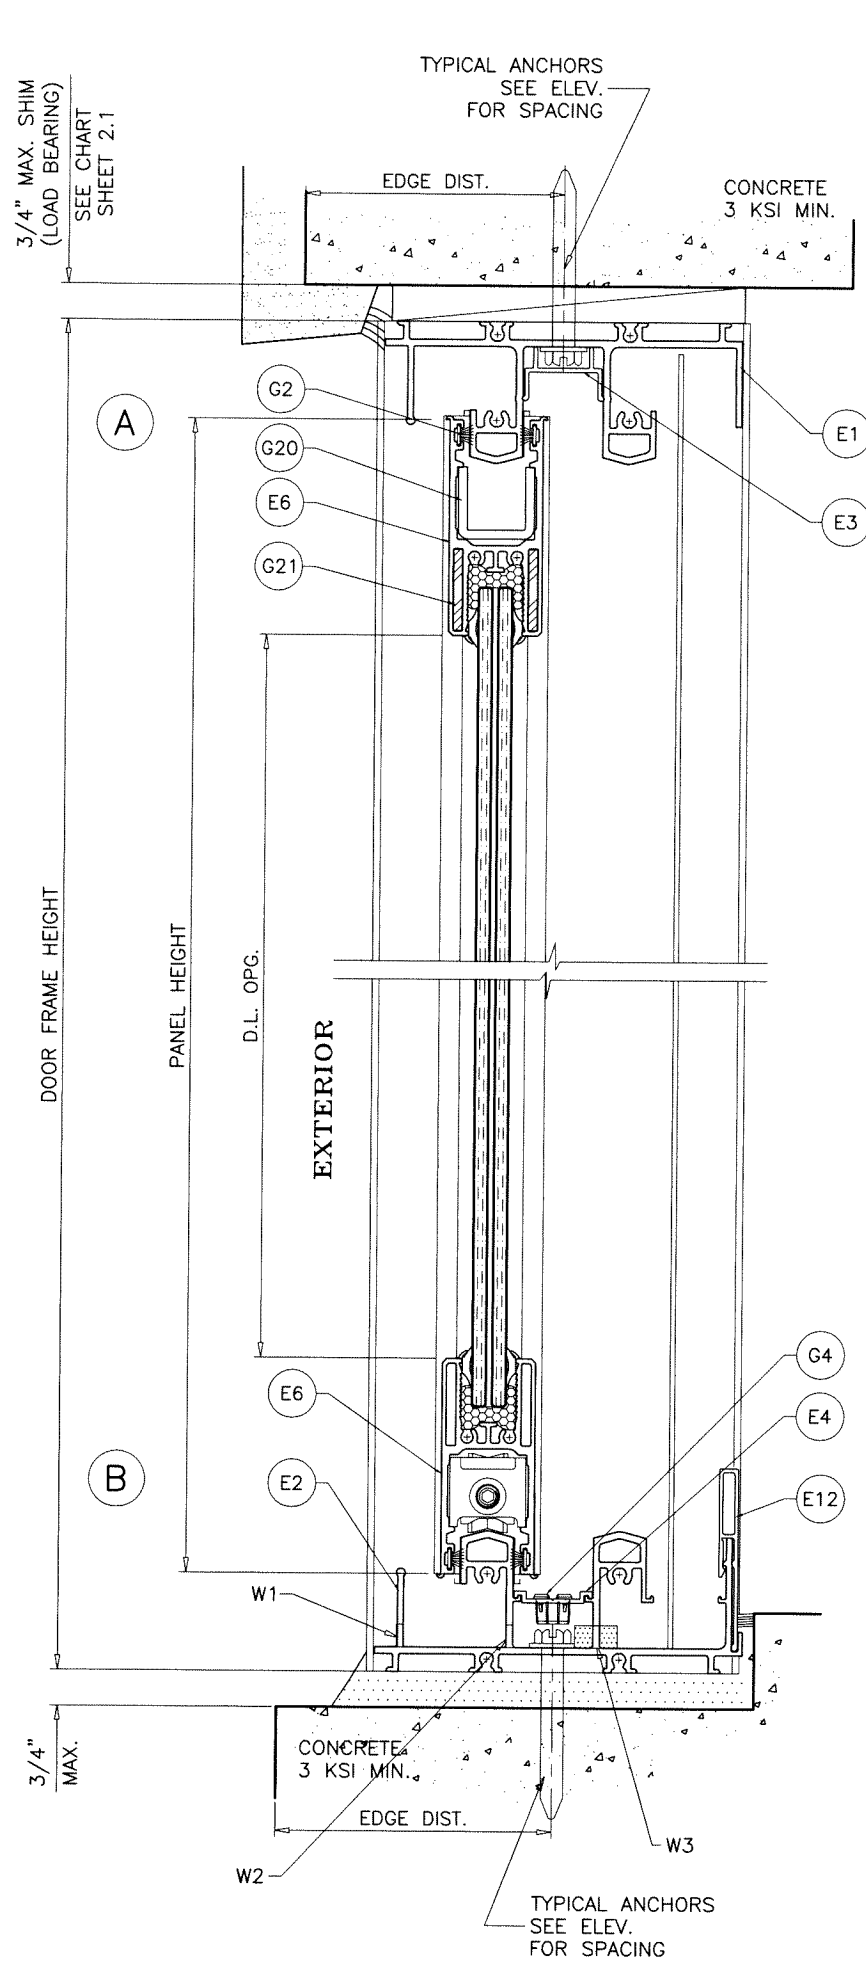


WEEPHOLES:

- W1 = EXTERIOR LEG CUT 3-1/2" ON EACH END
3"W X 1/4"H WEEP SLOTS AT 24" O.C.
- W2 = 1-3/8"W X 1/4"H WEEP SLOTS AT 12" O.C.
- W3 = 1-3/8"W X 1/4"H WEEP SLOTS AT 12" O.C.
WITH RETICULATED FOAM.

Sealed: 8/7/2026

FL #38057

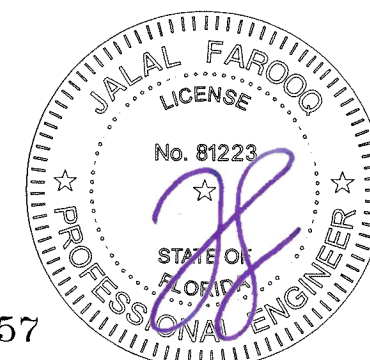

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

MG-1500 ALUM SLIDING GLASS DOOR (L.M.I.)

MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC
8051 N.W. 79th Place
Medley, FL. 33166
Tel. (305) 764-3963 Fax. (305) 470-8285




revisions:		no	date	by	description
date:	02-25-21	scale:	3/8" = 1"	dr. by:	TARIQ
		chk. by:			

drawing no.

21-16F

sheet 4 of 10

COMP-ANL\21-16F-MG

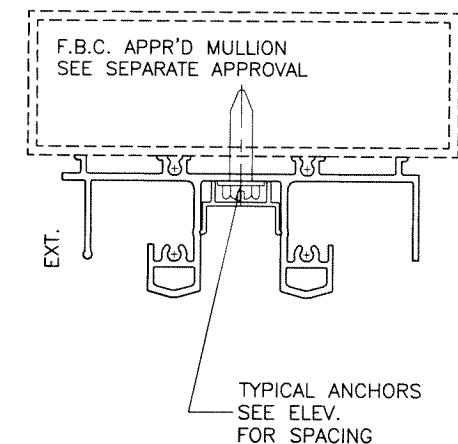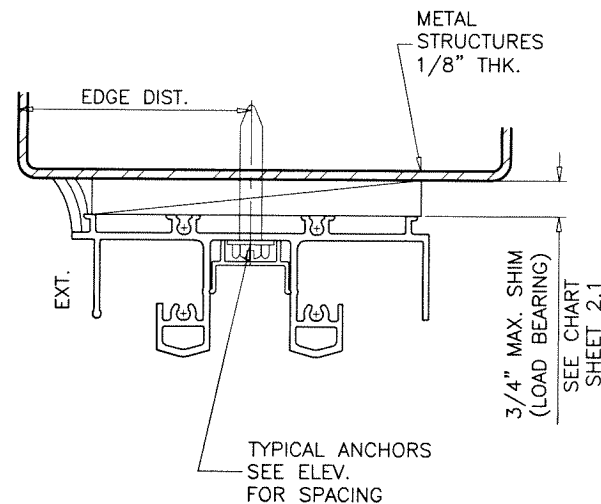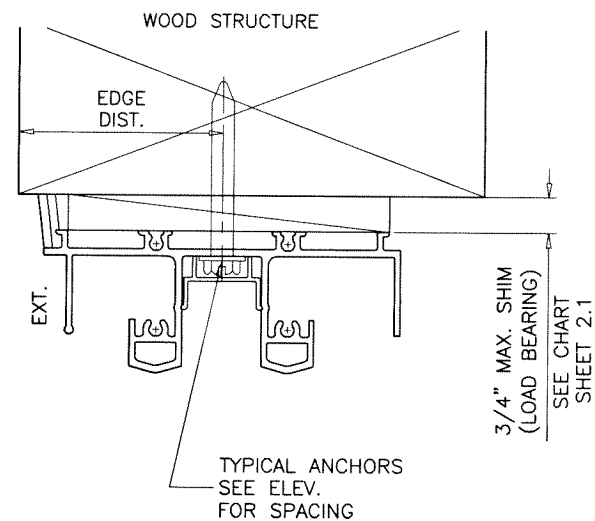

1BY OR 2BY WOOD BUCKS AND METAL STRUCTURE NOT BY 'MR-GLASS'
MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM
AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

TYPE 'A'— 5/16" DIA. ULTRACON BY 'DEWALT' ($F_u=177$ KSI, $F_y=155$ KSI)
INTO WOOD STRUCTURES
1-7/8" MIN. PENETRATION INTO WOOD (HEAD/JAMBS)
THRU 1BY OR 2BY BUCKS INTO CONC. OR BLOCKS
1-1/4" MIN. EMBED INTO CONCRETE (HEAD)
1-1/4" MIN. EMBED INTO CONC. OR BLOCKS (JAMBS)
DIRECTLY INTO CONC. OR BLOCKS
1-3/4" MIN. EMBED INTO CONCRETE (JAMBS)
1-3/4" MIN. EMBED INTO GROUT-FILLED BLOCKS (JAMBS)

TYPE 'B'— 5/16" DIA. ULTRACON BY 'DEWALT' ($F_u=177$ KSI, $F_y=155$ KSI)
DIRECTLY INTO CONCRETE
1-3/4" MIN. EMBED (HEAD/SILL)

TYPE 'C'— 5/16" DIA. TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)
INTO F.B.C. APPROVED MULLIONS
OR
INTO METAL STRUCTURES (HEAD/JAMBS)
(3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS
ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
STEEL: 1/8" THK. MIN. ($F_y = 36$ KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)


TYPICAL EDGE DISTANCE

INTO CONCRETE AT HEAD/SILL = 2-3/16" MIN.
INTO CONCRETE AND BLOCKS AT JAMBS = 2-1/2" MIN.
INTO WOOD STRUCTURE = 1-1/4" MIN.
INTO METAL STRUCTURE = 3/4" MIN.




WOOD AT HEAD OR JAMBS SG = 0.55 MIN.
CONCRETE AT HEAD, SILL OR JAMBS $f'_c = 3000$ PSI MIN.
C-90 HOLLOW/FILLED BLOCK AT JAMBS $f'_m = 2000$ PSI MIN.

Sealed: 8/7/2026

FL #38057

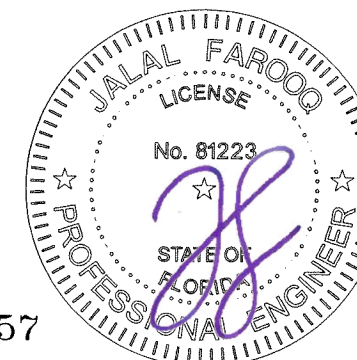

AL-FAROOQ CORPORATION ENGINEERS & PRODUCT DEVELOPMENT 9360 SUNSET DRIVE, SUITE 220 MIAMI, FLORIDA 33173 TEL. (305) 264-8100 FAX. (305) 262-6978 (C.A.N. 3538) COMP-ANL\21-16F-MG																					
MG-1500 ALUM SLIDING GLASS DOOR (L.M.I.) MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC 8051 N.W. 79th Place Medley, FL. 33166 Tel. (305) 764-3963 Fax. (305) 470-8285																					
date: 02-25-21 scale: 3/8" = 1" dr. by: TARIO chk. by:	revisions: <table border="1"> <tr> <th>no</th> <th>date</th> <th>by</th> <th>description</th> </tr> <tr> <td> </td> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> <td> </td> </tr> </table>	no	date	by	description																
no	date	by	description																		
drawing no. 21-16F sheet 5 of 10																					

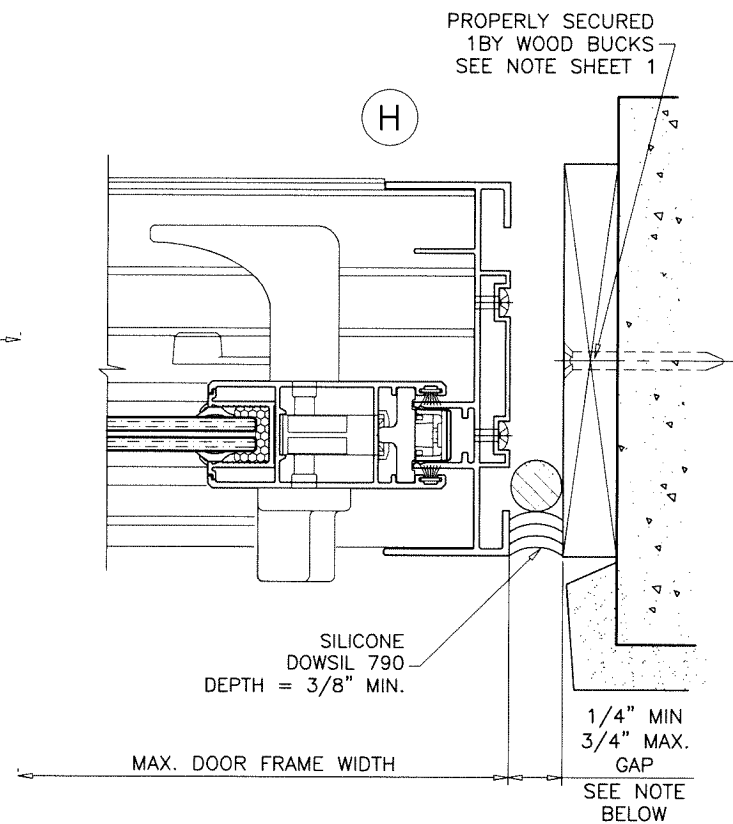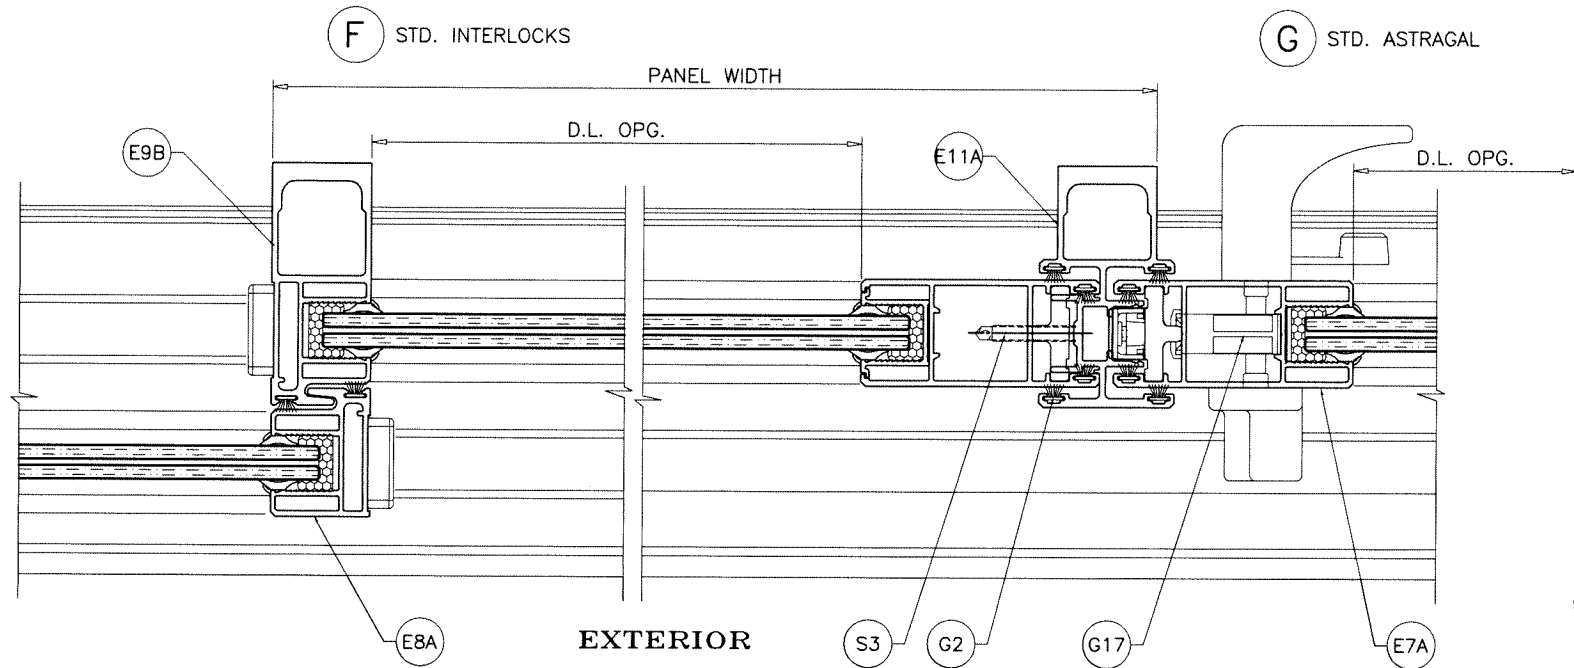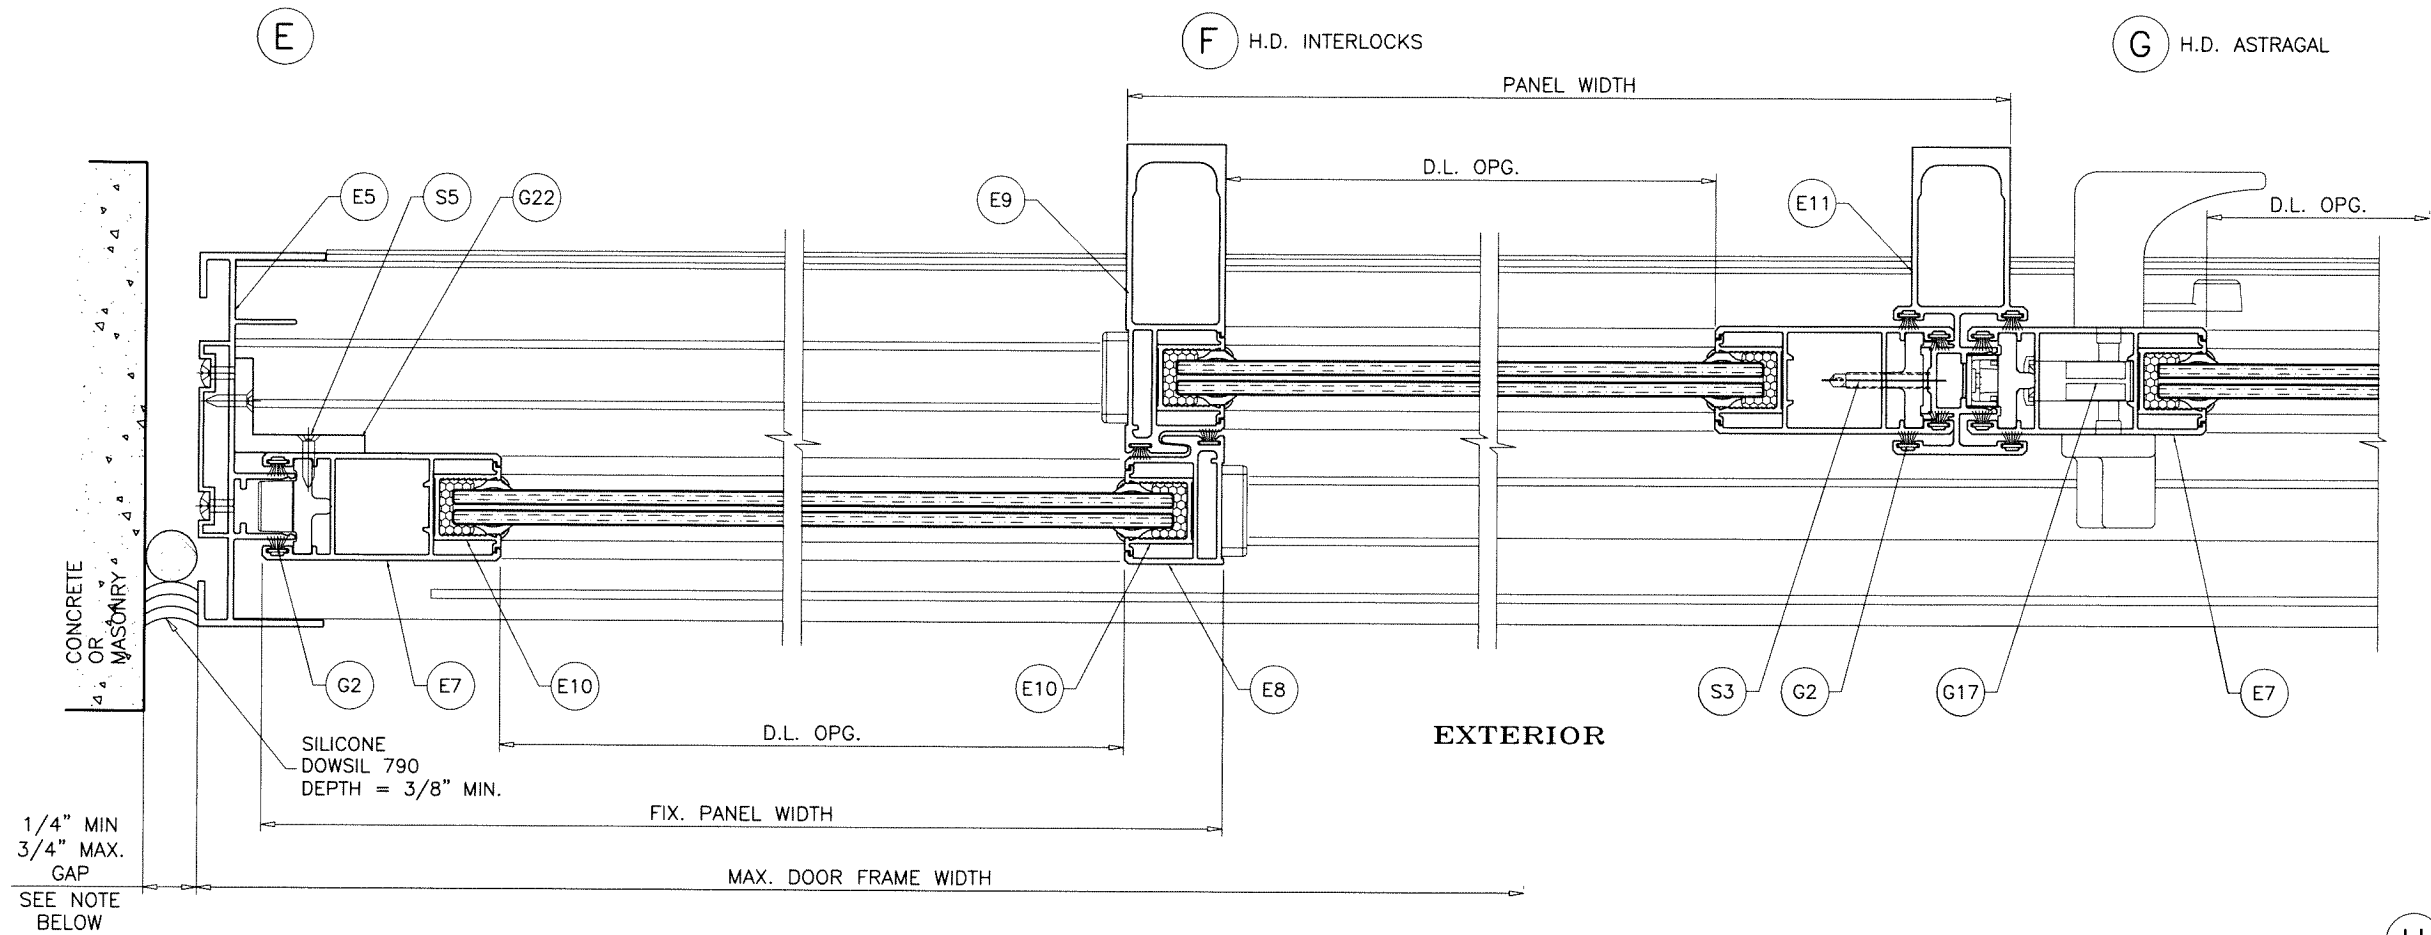

MAX. FRAME HEIGHT	GAP	
	MIN.	MAX.
84"	1/4"	3/4"
96"	5/16"	3/4"
108"	3/8"	3/4"


NOTE:
 MAX. MOVEMENT CONSIDERED=100% STRETCH.
 PLEASE REFER TO SEALANT MANUFACTURER'S DATA AND APPLICATION MANUAL FOR COMPATABILITY OF SEALANT TO SUBSTRATE & WINDOWALL MATERIAL/FINISH AND COMPLIANCE FOR WARRANTY.
 REFER TO ACI-117-10 FOR CONSTRUCTION TOLERANCES.

ALTERNATE SEALANTS AT JAMB GAPS CAN BE DESIGNED BY ENGINEER OF RECORD BASED ON MANUFACTURER GUIDE LINES.

GAPS LESS THAN 1/4" MAY BE DESIGNED BY ENGINEER OF RECORD BY THE USE OF BOND BREAKER TAPE OR 15% OF GAP ALLOWED MOVEMENT.

Sealed: 8/7/2026

FL #38057

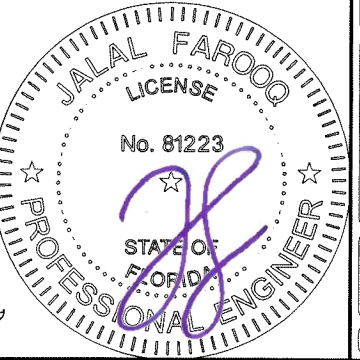

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173 (C.A.N. 3538)
 TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL 21-16F-MG

MG-1500 ALUM SLIDING GLASS DOOR (L.M.I.)

MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC
 8051 N.W. 79th Place
 Medley, FL. 33166
 Tel. (305) 764-3963 Fax. (305) 470-8285






revisions:

no	date	by	description

date: 02-25-21
 scale: 3/8" = 1"
 dr. by: TARIQ
 chk. by:

drawing no.
21-16F

sheet 6 of 10

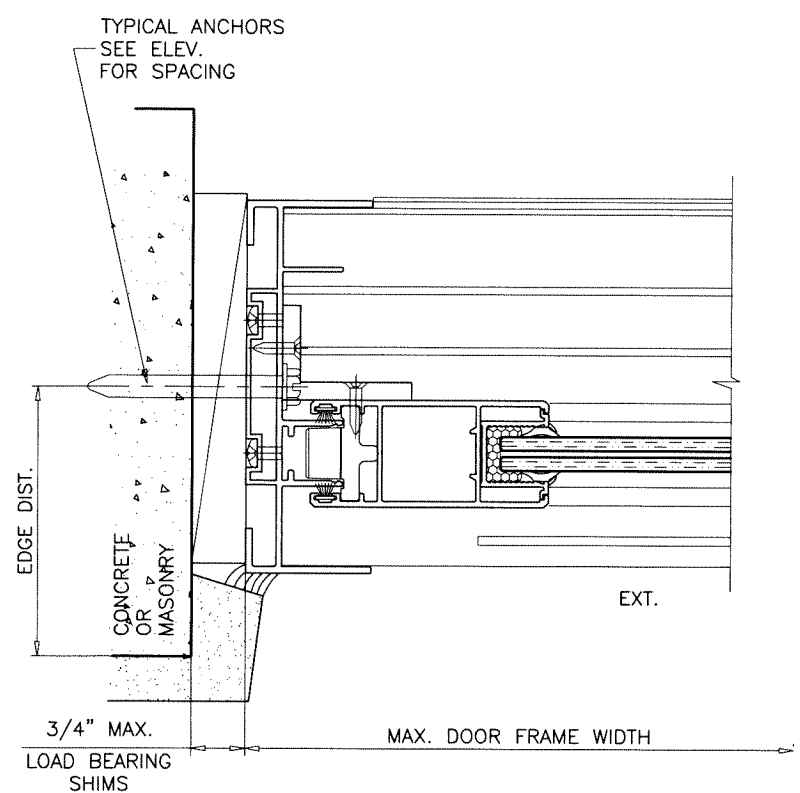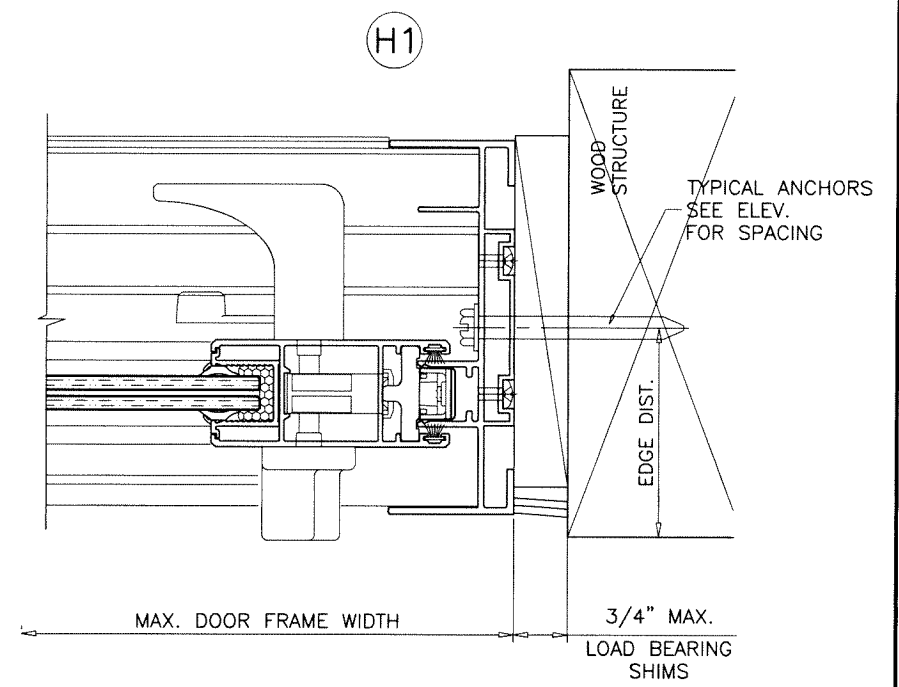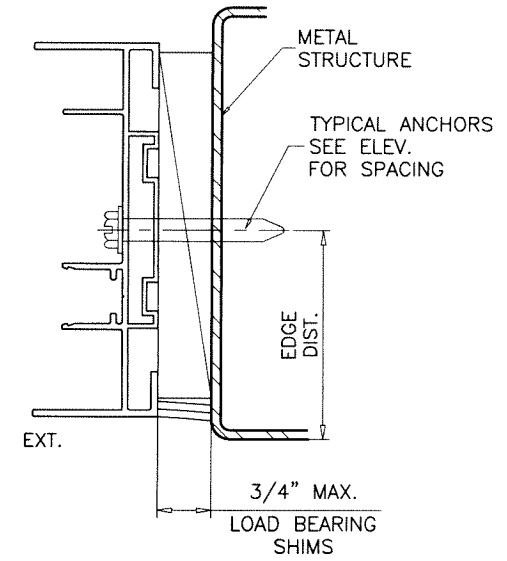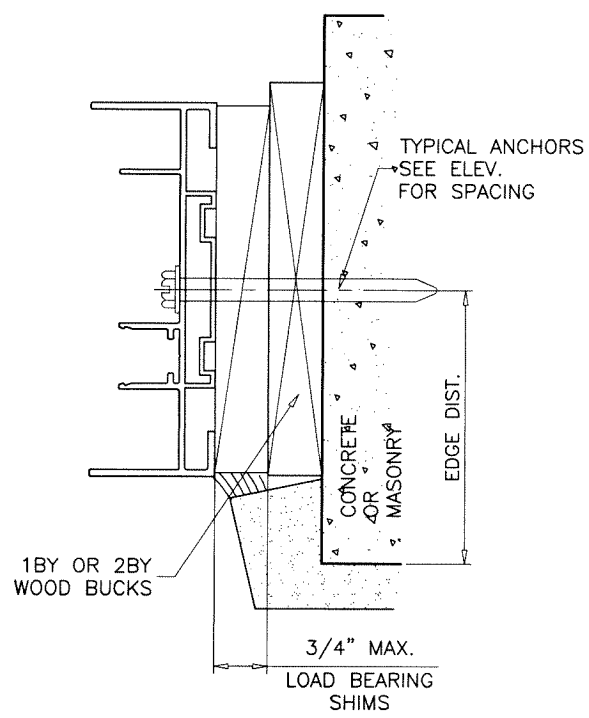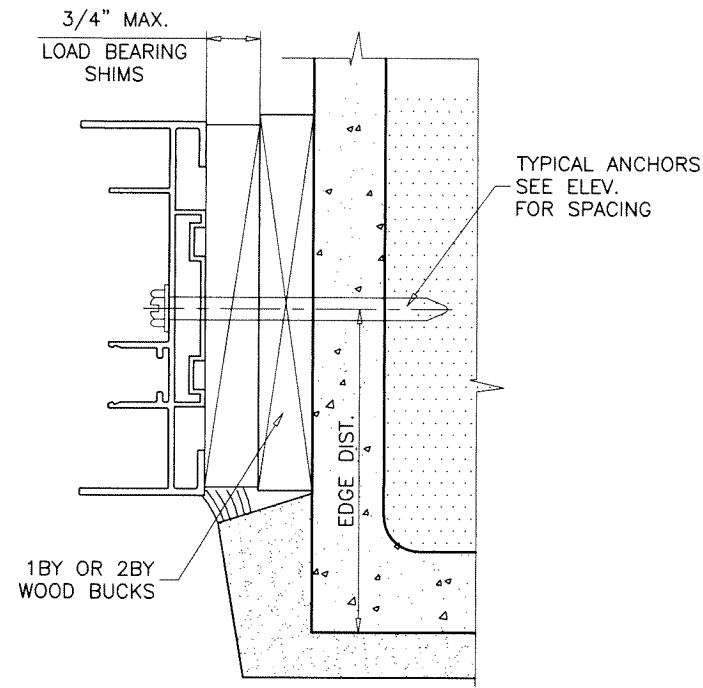

Sealed: 8/7/2026

FL #38057



AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

af c

COMP-ANL\21-16F-MG

MG-1500 ALUM SLIDING GLASS DOOR (L.M.I.)

MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC
8051 N.W. 79th Place
Medley, FL. 33166
Tel. (305) 764-3963 Fax. (305) 470-8285

COMP-ANL\21-16F-MG

revisions:	
no	date by description

date: 02-25-21

scale: 3/8" = 1"




















dr. by: TARIQ

chk. by:

drawing no.


21-16F

sheet 7 of 10

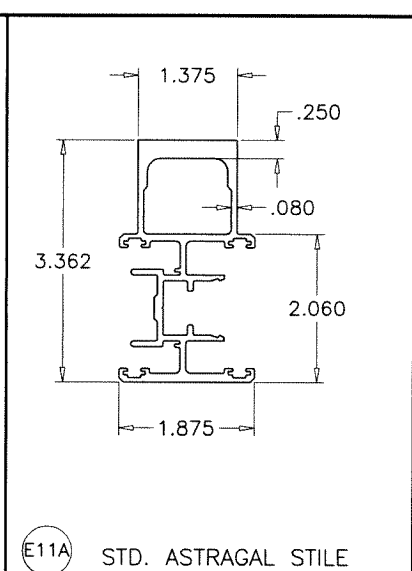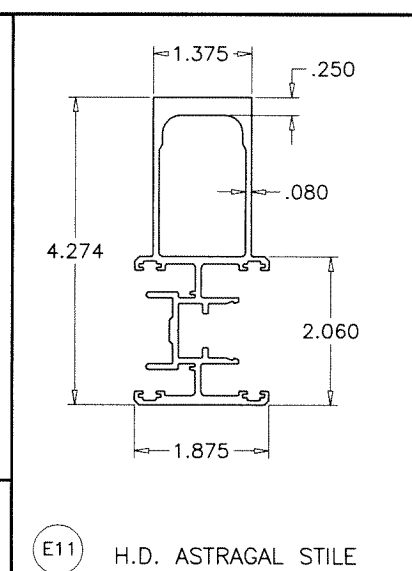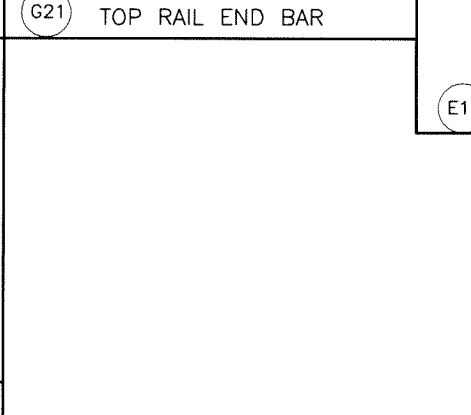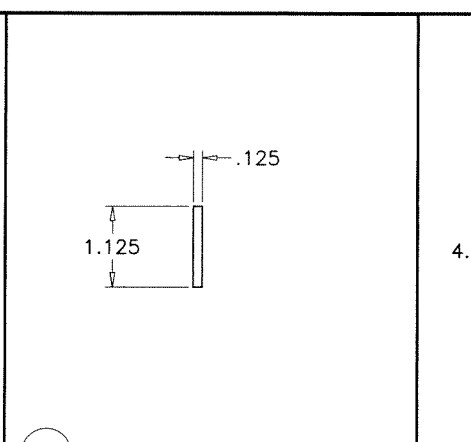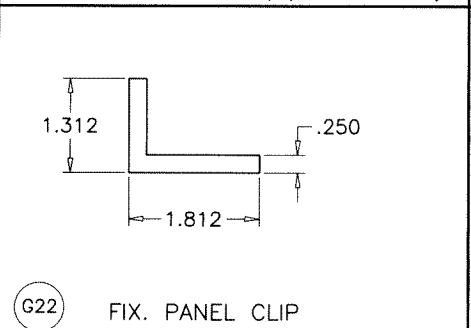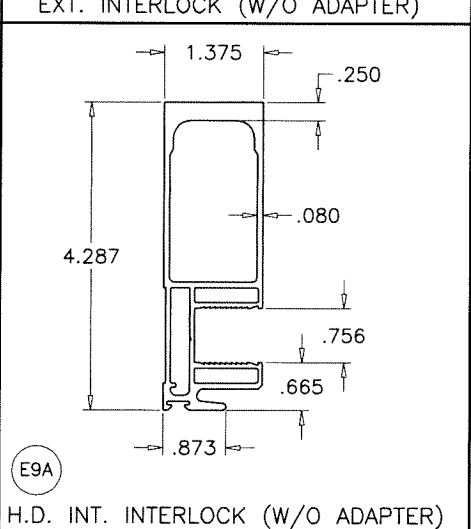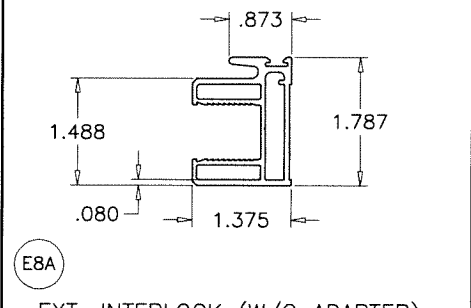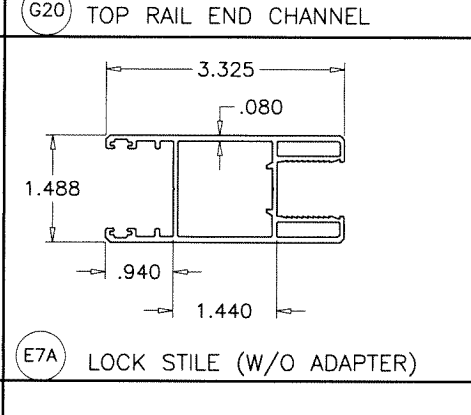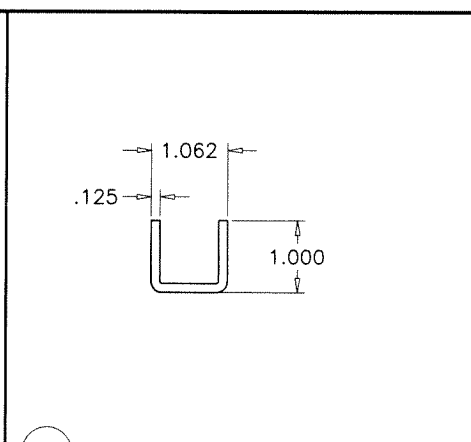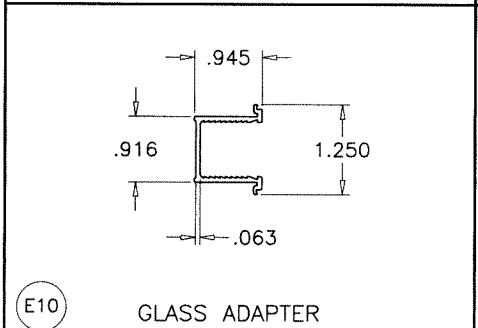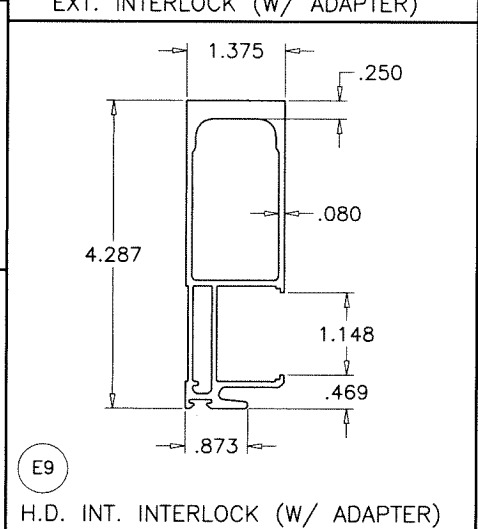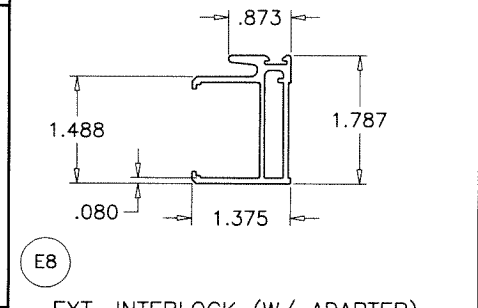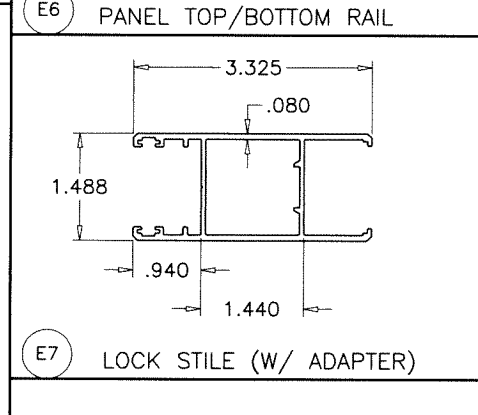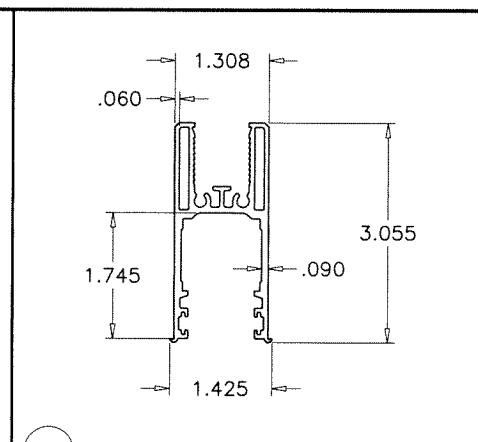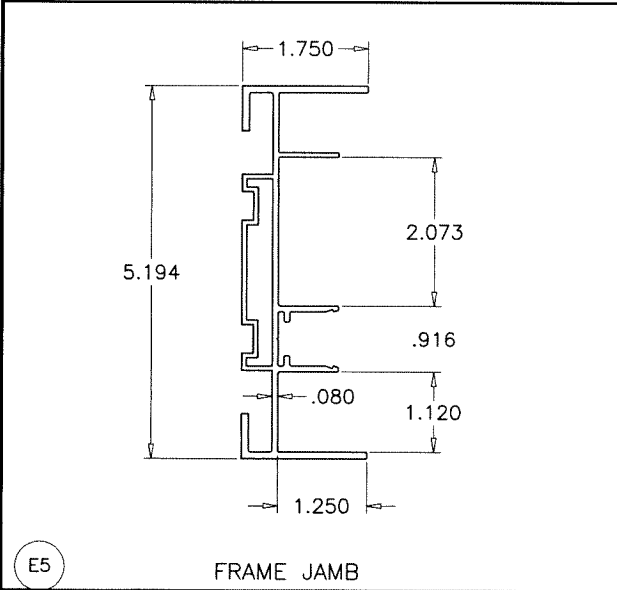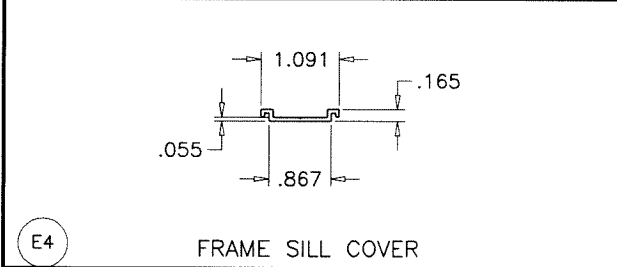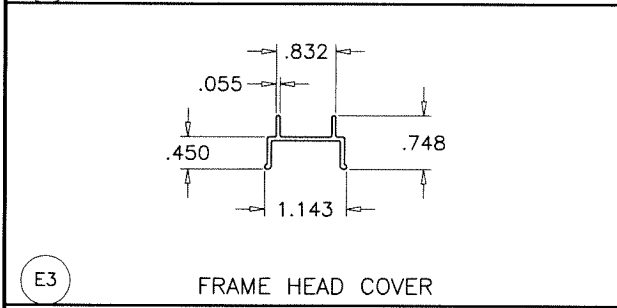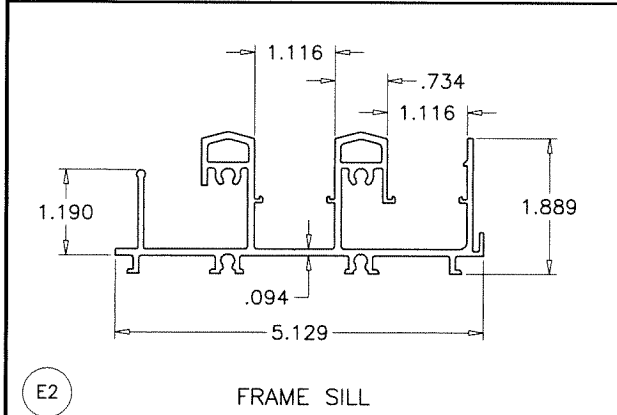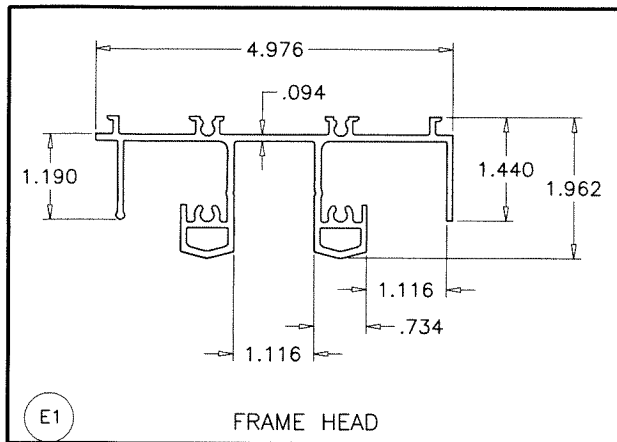

Sealed: 8/7/2026

FL #38057

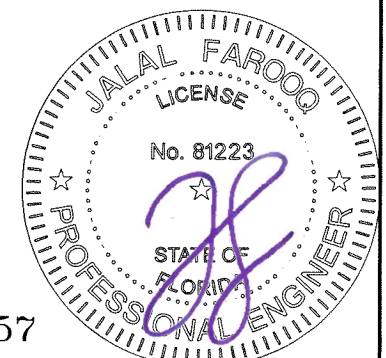

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

af c
(C.A.N. 3538)
COMP-ANL\21-16F-MG

MG-1500 ALUM SLIDING GLASS DOOR (L.M.I.)

MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC
8051 N.W. 79th Place
Medley, FL. 33166
Tel. (305) 764-3963 Fax. (305) 470-8285

revisions:

no	date	by	description

date: 02-25-21
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
21-16F

sheet 8 of 10

Sealed: 8/7/2026

FL #38057

ITEM #	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
E1	E1503	1	FRAME HEAD	6063-T6	-
E2	E1501	1	FRAME SILL	6063-T6	-
E3	E1522	AS REQD.	FRAME HEAD COVER	6063-T5	OPTIONAL
E4	E1520	AS REQD.	FRAME SILL COVER	6063-T5	OPTIONAL
E5	E1502	2	FRAME JAMB	6063-T6	-
E6	E1510	2/ PANEL	PANEL TOP/BOTTOM RAIL	6063-T6	-
E7	E1511	AS REQD.	LOCK STILE (WITH GLASS ADAPTER)	6063-T6	-
E7A	E1511A	AS REQD.	LOCK STILE (WITHOUT GLASS ADAPTER)	6063-T6	-
E8	E1512	AS REQD.	EXTERIOR INTERLOCK (WITH GLASS ADAPTER)	6063-T6	-
E8A	E1512A	AS REQD.	EXTERIOR INTERLOCK (WITHOUT GLASS ADAPTER)	6063-T6	-
E9	E1513	AS REQD.	H.D. INTERIOR INTERLOCK (WITH GLASS ADAPTER)	6063-T6	-
E9A	E1513A	AS REQD.	H.D. INTERIOR INTERLOCK (WITHOUT GLASS ADAPTER)	6063-T6	-
E9B	E1515A	AS REQD.	STD. INTERIOR INTERLOCK (WITHOUT GLASS ADAPTER)	6063-T6	-
E10	E1517	AS REQD.	GLASS ADAPTER	6063-T6	-
E11	E1514	AS REQD.	H.D. ASTRAGAL STILE	6063-T6	-
E11A	E1516	AS REQD.	STD. ASTRAGAL STILE	6063-T6	-
E12	E1521	AS REQD.	SILL RISER	6063-T5	-
G1	G15-01L	AS REQD.	WEDGE GASKET	EPDM	DUROMETER 65±5 SHORE A
G2	G15-02	AS REQD.	PILE W'STRIPPING	POLYETHYLENE/YARN	-
G3	G15-12	AS REQD.	BALL VALVE	-	-
G4	G15-12	AS REQD.	HOLE PLUG	PVC	-
G5	G15-15	AS REQD.	GASKET	NEOPRENE	-
G6	M10-05	AS REQD.	EXTERIOR BUMPER	-	-
G7	M15-01	AS REQD.	LOCK STILE COVER	POLYAMIDE	-
G8	M15-02	AS REQD.	-	-	-
G9	M15-03	AS REQD.	LOCK STILE GUIDE	POLYAMIDE	-
G10	-	AS REQD.	PANEL BUMPER	NEOPRENE	-
G11	M15-04	AS REQD.	INTERLOCK COVER	POLYAMIDE	-
G12	M15-05	AS REQD.	INTERLOCK COVER	POLYAMIDE	-
G13	M15-06	AS REQD.	INTERLOCK COVER/GUIDE	POLYAMIDE	-
G14	M15-07	AS REQD.	INTERLOCK CAP	POLYAMIDE	-
G15	M15-09	AS REQD.	ASTRAGAL CAP	POLYAMIDE	-
G16	M15-11	AS REQD.	ASTRAGAL COVER	POLYAMIDE	-
G17	L15-01	-	2 POINT MORTISE LOCK & HANDLE	ZAMAK	INTERLOCK
G18	M15-20	2/ MOV. PANEL	ROLLER ASSEMBLY AT 9" FROM ENDS	ST. STEEL/ACETAL	FASTENED WITH (2) 12-24 X 3/4" PH MS
G19	-	AS REQD.	SETTING BLOCKS	EPDM	DUROMETER 80±5 SHORE A
G20	-	AS REQD.	TOP RAIL END CHANNEL, 4" LONG AT PANEL ENDS	6063-T6	-
G21	-	AS REQD.	TOP RAIL END BAR, 4" LONG AT PANEL ENDS	6063-T6	-
G22	-	2/ FIX. PANEL	FIXED PANEL CLIP, 1-7/8" LONG, AT 4" FROM TOP & BOTTOM	6063-T6	-
S1	#12 X 1 1/2"	4/ CORNER	FRAME ASSEMBLY FASTENERS	ST. STEEL	PH SDS
S2	#10 X 1 1/2"	4/ CORNER	PANEL ASSEMBLY FASTENERS	ST. STEEL	PH SDS
S3	#12 X 1 1/2"	AS REQD.	ASTRAGAL FASTENERS, AT 3-1/2" FROM ENDS & 8" O.C.	ST. STEEL	FH SDS
S4	#10 X 1"	AS REQD.	BALL VALVE FASTENERS	ST. STEEL	PH SMS
S5	#10 X 1"	2/ CLIP	FIX. CLIP FASTENERS	ST. STEEL	FH SMS

SEALANT:

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH WHITE/ALUMINUM COLORED SILICONE.

LOCKS:

SURFACE MOUNT METALLIC THREE PLY DUAL HOOK LOCK AT 38-1/2" FROM BOTTOM FASTENED TO LOCK STILE WITH (2) 10-24 X 1/2" FH TC MS

SURFACE MOUNT METALLIC HANDLE AT 38-1/2" FROM BOTTOM FASTENED TO LOCK STILE WITH (2) 8-32 X 2-5/8" FH MS

SURFACE MOUNT METALLIC KEEPER FACING LOCK AT 38 1/2" FROM BOTTOM FASTENED WITH (1) #14 X 2-7/8" FH SDS AND (1) 12-24 X 1/2" PH MS

Sealed: 8/7/2026



FL #38057

af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
FAX. (305) 262-6978
COMP-ANL\21-16F-MG

MG-1500 ALUM SLIDING GLASS DOOR (L.M.I.)

MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC
8051 N.W. 79th Place
Medley, FL. 33166
Tel. (305) 764-3963
Fax. (305) 470-8285

revisions:

no	date	by	description

date: 02-25-21

scale: 3/8" = 1"


dr. by: TARIQ

chk. by:


drawing no.

21-16F


sheet 9 of 10

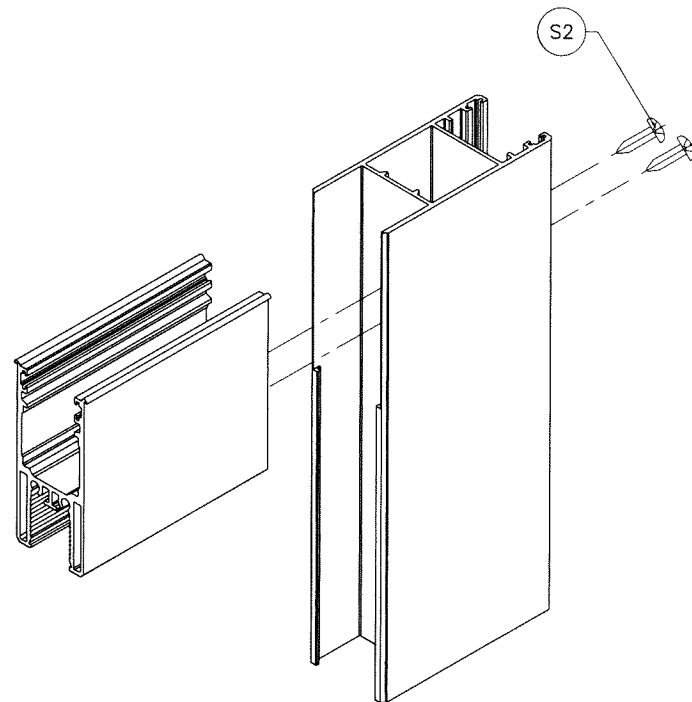

PANEL TOP/BOTTOM CORNER

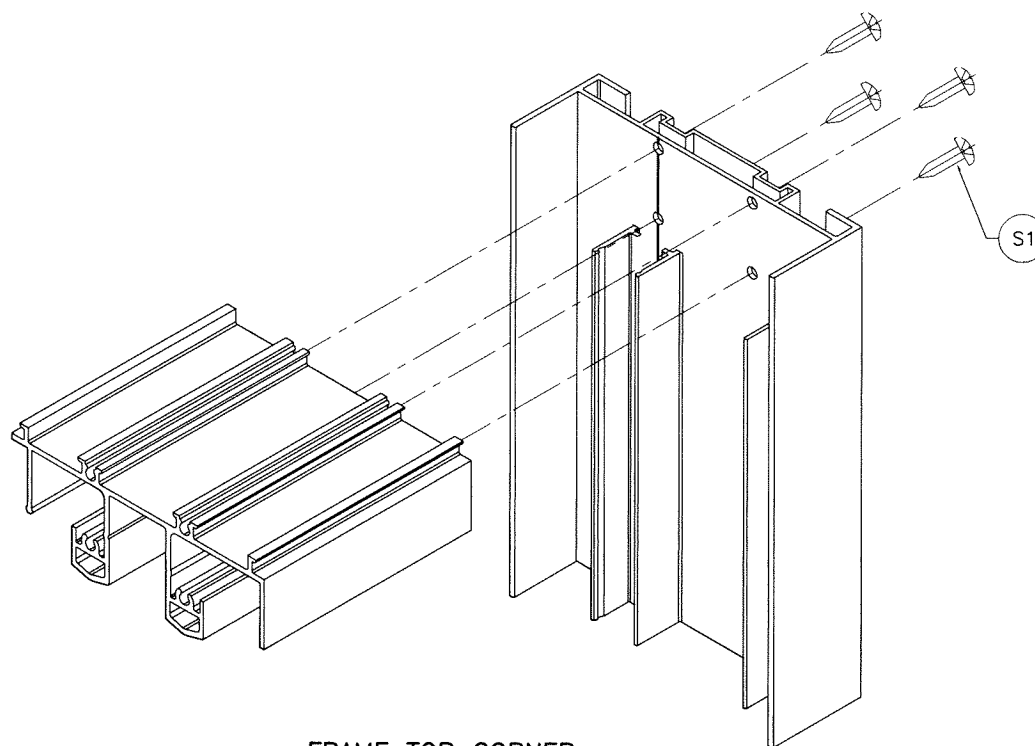


FRAME TOP CORNER

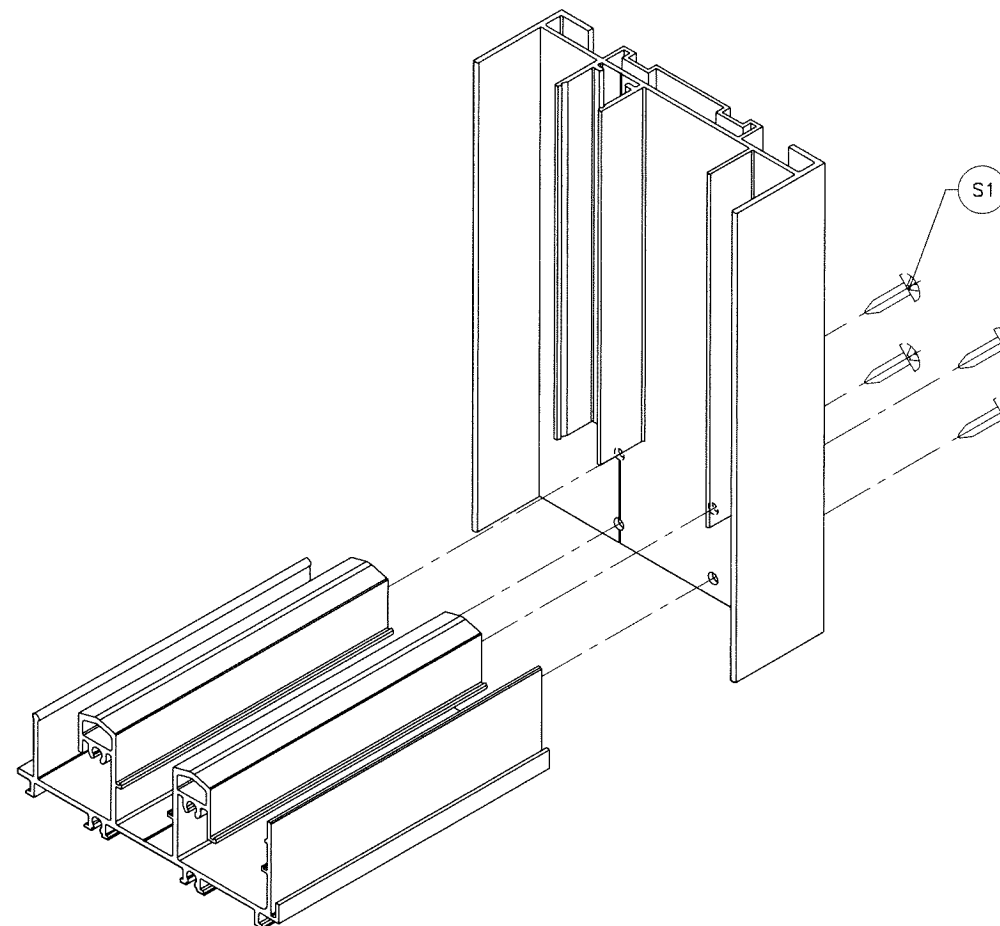

FRAME BOTTOM CORNER

Sealed: 8/7/2026

FL #38057

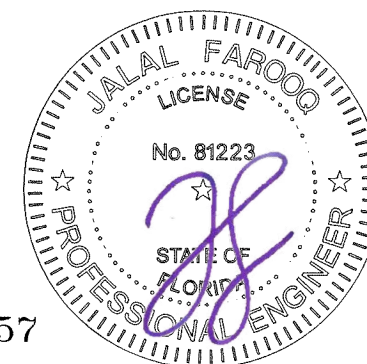

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

af c
COMP-ANL\21-16F-MG

MG-1500 ALUM SLIDING GLASS DOOR (L.M.I.)	
MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC	
8051 N.W. 79th Place Medley, FL. 33166 Tel. (305) 764-3963 Fax. (305) 470-8285	

revisions:	
no	date by description

date: 02-25-21	scale: 3/8" = 1"	dr. by: TARIQ	chk. by:
drawing no.		no.	
21-16F			
sheet 10 of 10			