


DP RATING	NON-IMPACT RESISTANT
SEE TABLE 1	

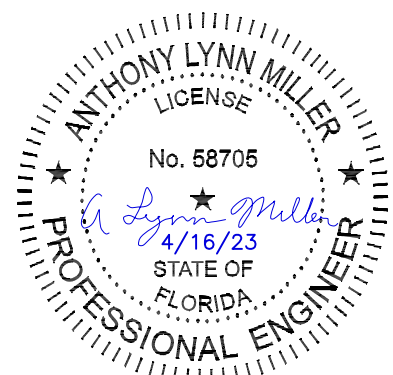

A. LYNN MILLER, P.E., P.E.# 58705

REGISTRATION #29296


COPYRIGHT © 2023
CGI WINDOWS AND DOORS
LIMITED LICENSE TO MAKE
COPIES FOR PERMITTING

PREPARED BY: A. LYNN MILLER, P.E.
1070 TECHNOLOGY DR
N. VENICE, FL 34275
(941)-480-1600


SH800V SINGLE HUNG, NI
GEN. NOTES, DESIGN PRESSURES AND
ANCHOR ELEVATIONS
CGI WINDOWS & DOORS
3780 W. 104TH STREET
HIALEAH, FL 33018

BY:				
REVISION:				
DATE:				
#:				


DATE: 04/14/2023
SCALE: NTS
BY: LOGAN YODER
DRAWING #: SH800V-FPA-NI
SHEET: 1 OF 6

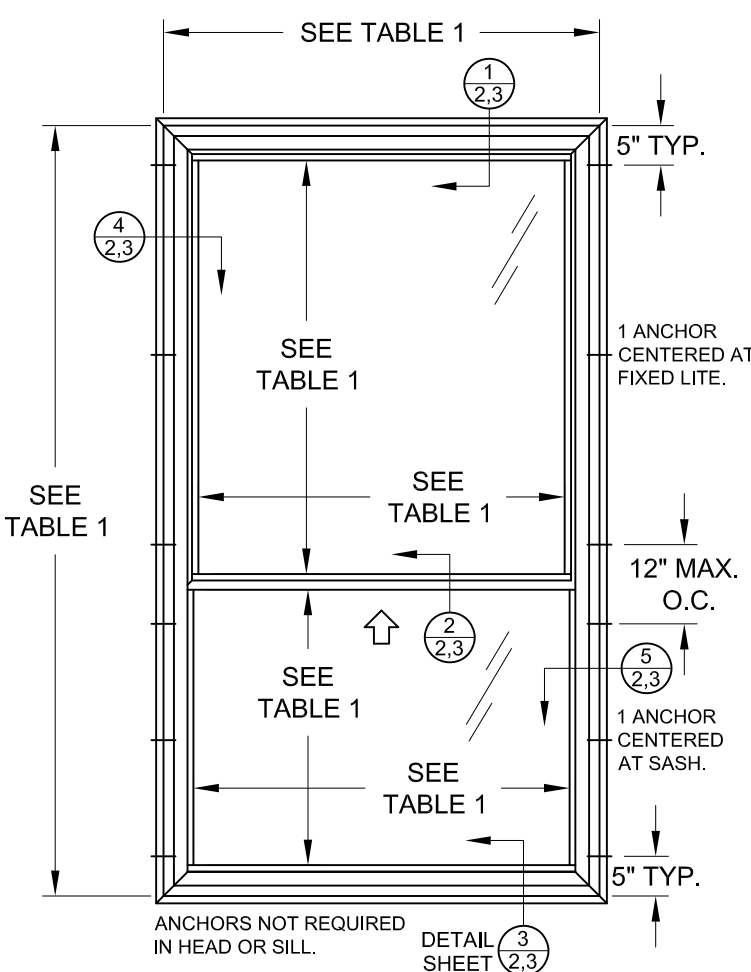

TYP. ANCHOR LOCATIONS
(FLANGED FRAME SHOWN, EQUAL-LEG SIM.)
(ORIEL SHOWN, EQUAL-LITE SIMILAR)

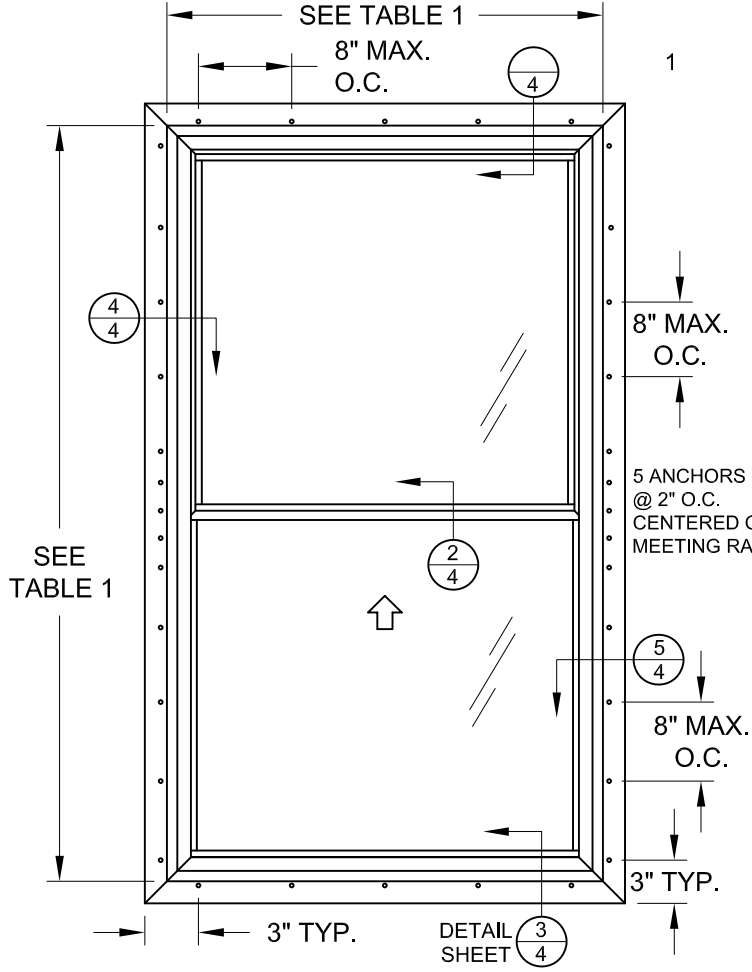

TYP. FIN ANCHOR LOCATIONS (A)
(INTEGRAL FIN FRAME, EQUAL-LITE SHOWN,
ORIEL SIMILAR)

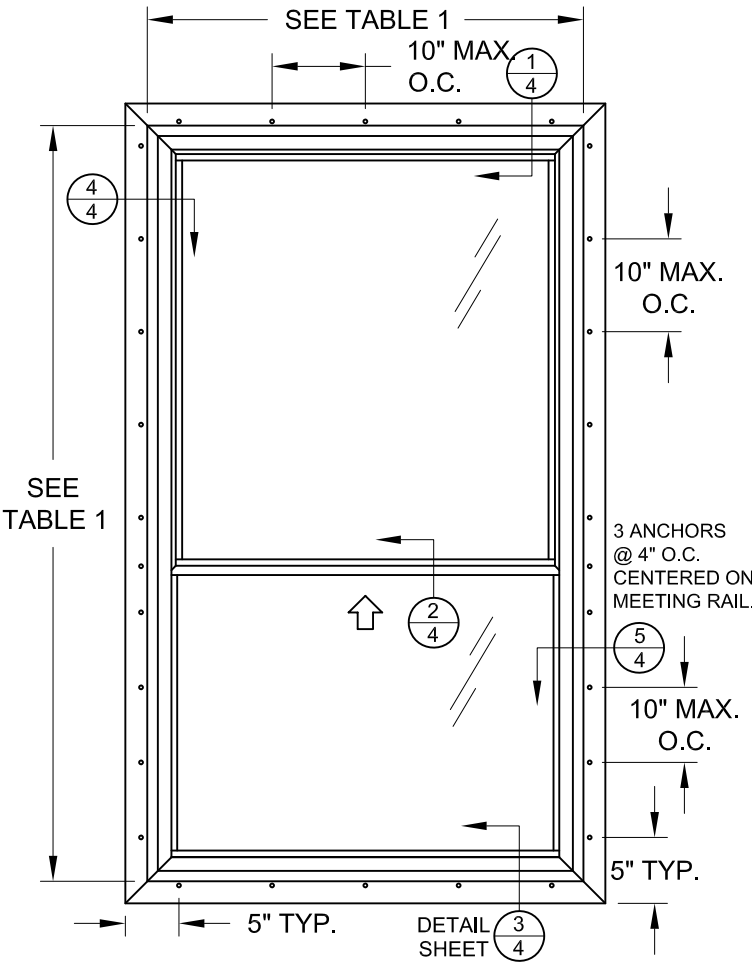


TYP. FIN ANCHOR LOCATIONS (B)
(INTEGRAL FIN FRAME,
MAX. SIZE ORIEL CONFIG.)

TABLE 1: DESIGN PRESSURES

Buck Width	Buck Height	Max. Sash DLO Size (Width x Height)	Max. Fixed DLO Size (Width x Height)	Configuration	Frame Type	Glass Type	Design Pressure	
							(+) psf	(-) psf
54"	76"	47.25" x 34.44"	49.75" x 34.44"	Equal-lite	All	1	50.0	50.0
36"	72"	29.25" x 32.44"	31.75" x 32.44"	Equal-lite	All	1	65.0	75.0
48"	84"	41.25" x 38.25"	43.75" x 38.63"	Equal-lite	Flange, Equal-Leg	1	45.0	45.0
48"	84"	41.25" x 38.25"	43.75" x 38.63"	Equal-lite	Fin (A)	1	50.0	55.0
54"	92"	47.25" x 34.19"	49.81" x 50.75"	Oriel	Flange, Equal-Leg	2	30.0	30.0
54"	92"	47.25" x 34.19"	49.81" x 50.75"	Oriel	Fin (B)	2	40.0	40.0

FOR SIZES NOT SHOWN,
ROUND UP TO THE NEXT
AVAILABLE WIDTH OR
HEIGHT DIMENSION.

FOR GLASS TYPES,
SEE SHEET 6.

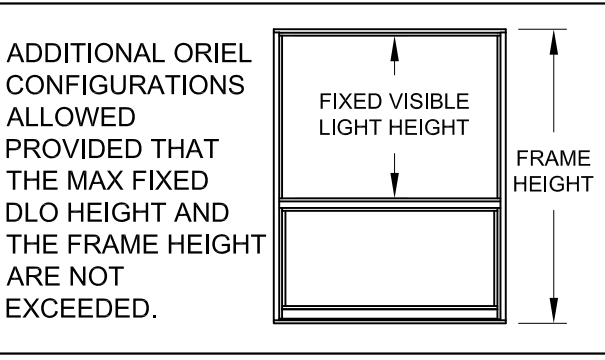

ADDITIONAL ORIEL
CONFIGURATIONS
ALLOWED
PROVIDED THAT
THE MAX FIXED
DLO HEIGHT AND
THE FRAME HEIGHT
ARE NOT
EXCEEDED.



SH800V SINGLE HUNG,
TILT WINDOW,
NON-IMPACT RESISTANT,
FLANGE, EQUAL-LEG & FIN FRAMES

- 1) THIS PRODUCT HAS BEEN DESIGNED & TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE, EXCLUDING THE HIGH VELOCITY HURRICANE ZONE (HVHZ).
- 2) SHUTTERS ARE REQUIRED WHEN USED IN WIND-BORNE DEBRIS REGIONS.
- 3) MASONRY ANCHORS MAY BE USED INTO WOOD. ALL WOOD BUCKS LESS THAN 1-1/2" THICK ARE TO BE CONSIDERED 1X INSTALLATIONS. 1X WOOD BUCKS ARE OPTIONAL IF UNIT IS INSTALLED DIRECTLY TO SUBSTRATE. WOOD BUCKS DEPICTED AS 2X ARE 1-1/2" THICK OR GREATER.
- 4) ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO. USE ANCHORS OF SUFFICIENT LENGTH.

- 5) MAX. 1/4" SHIMS ARE REQUIRED AT EACH ANCHOR LOCATION WHERE THE PRODUCT IS NOT FLUSH TO THE SUBSTRATE. USE SHIMS CAPABLE OF TRANSFERRING APPLIED LOADS.
- 6) THE ANCHORAGE METHODS SHOWN HAVE BEEN DESIGNED TO RESIST THE WIND LOADS CORRESPONDING TO THE REQUIRED DESIGN PRESSURE. THE 33-1/3% STRESS INCREASE HAS NOT BEEN USED IN THE DESIGN OF THIS PRODUCT. THE 1.6 LOAD DURATION FACTOR WAS USED FOR THE EVALUATION OF ANCHORS INTO WOOD. ANCHORS THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE FOR CORROSION RESISTANCE.

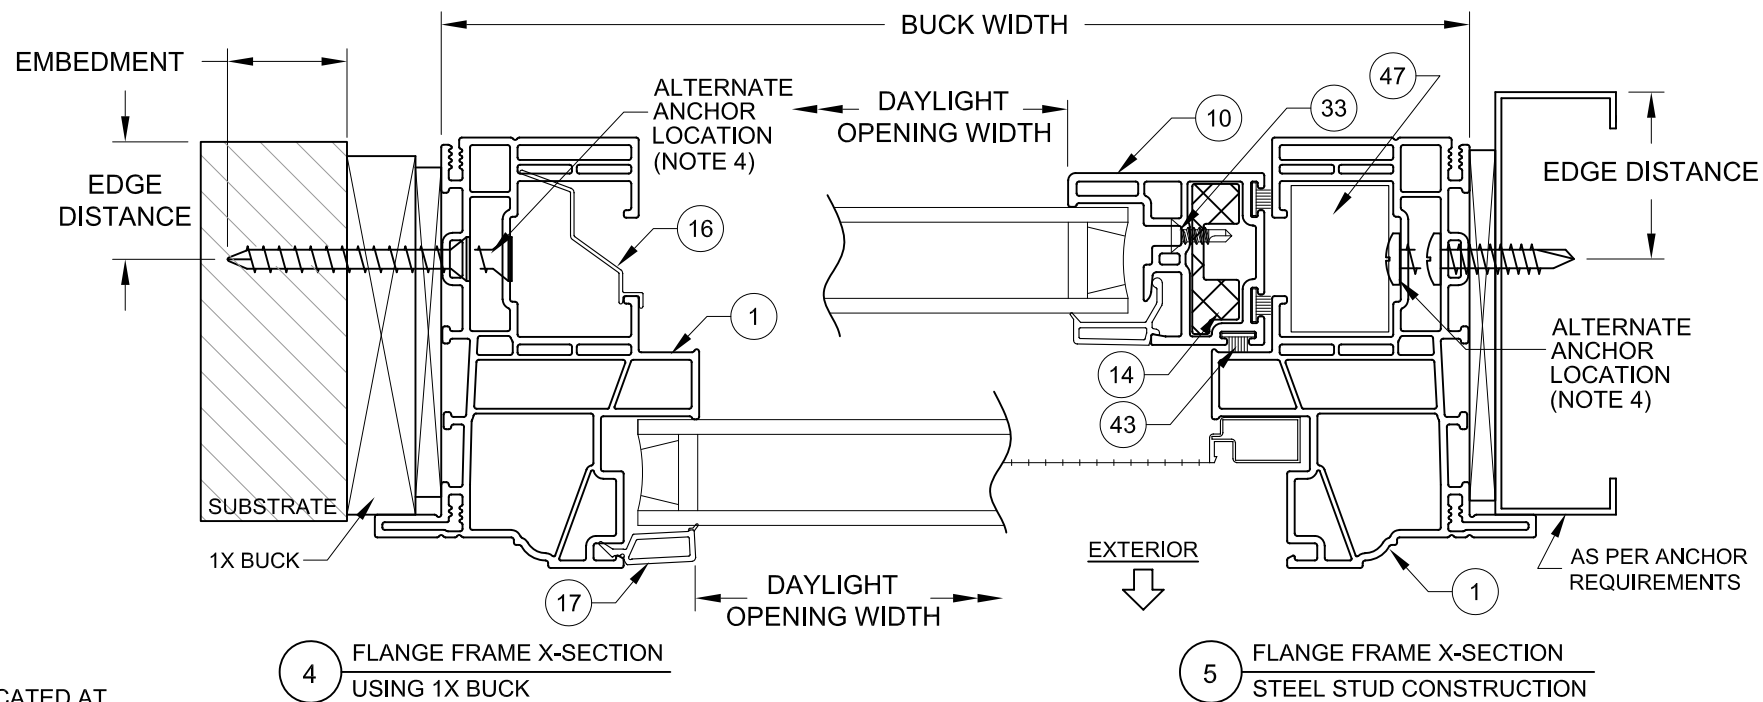
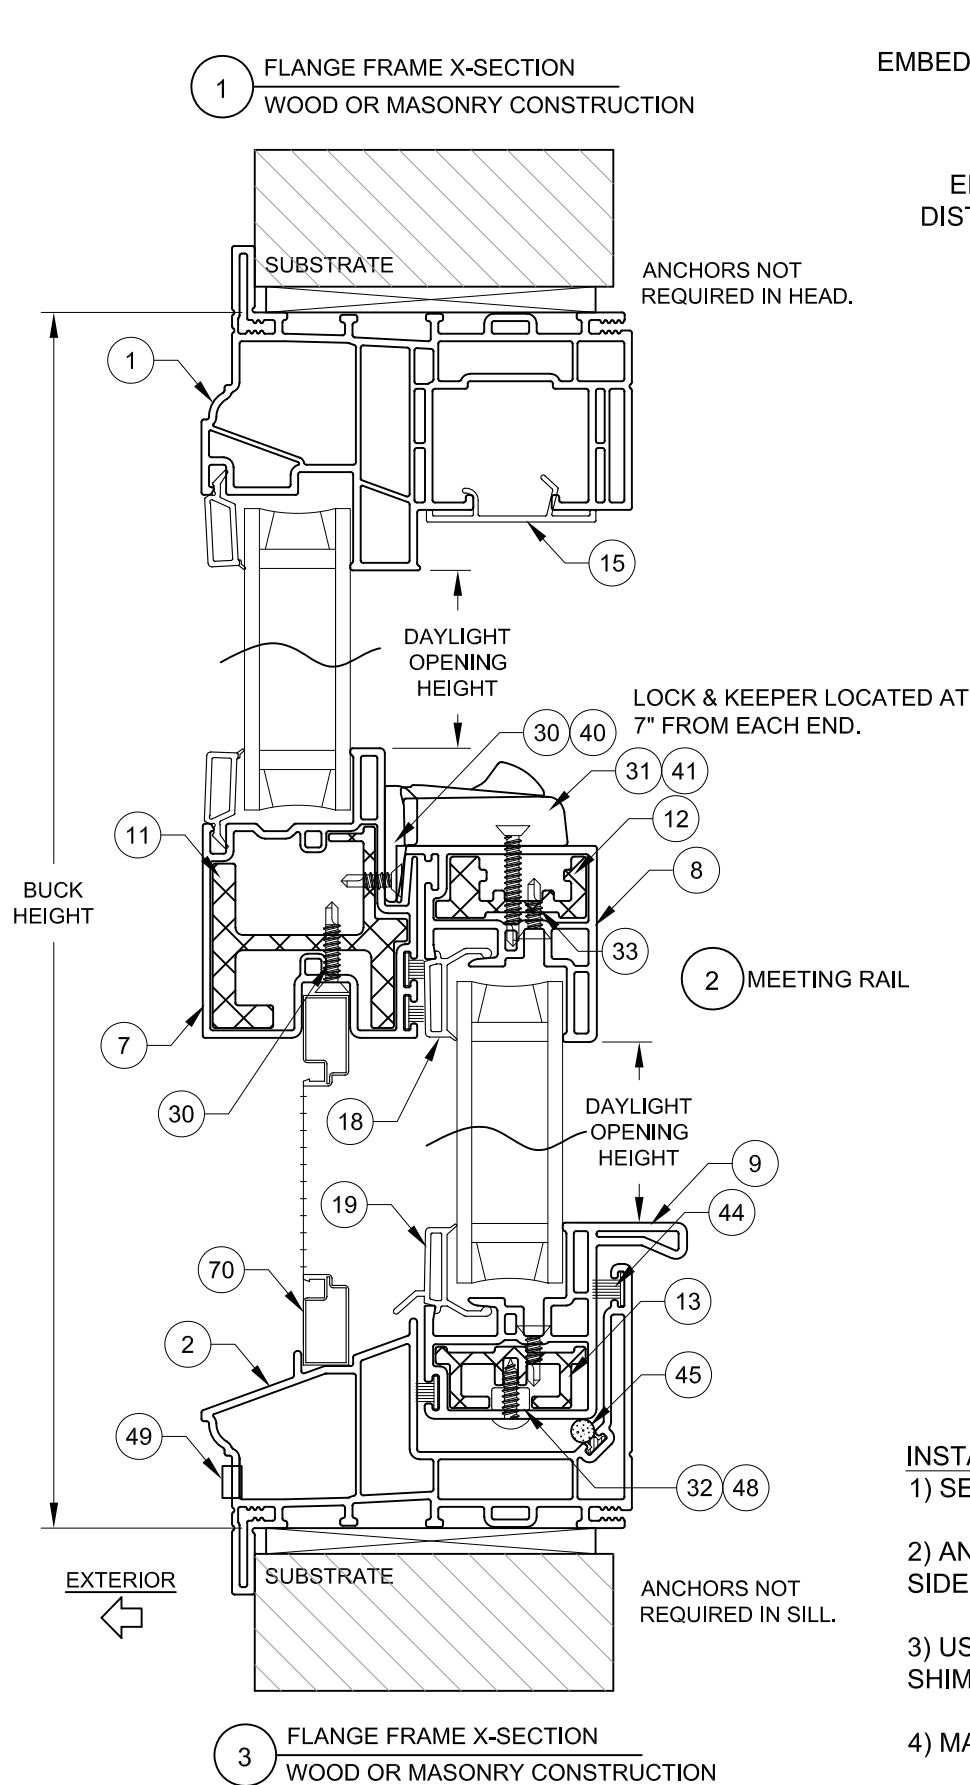



TABLE 2: INSTALLATION ANCHORS

Anchor	Substrate	Minimum Edge Distance	Minimum Embedment
#10 or #12 Steel or 410 SS Screw	Southern Pine (SG = .55)	1/2"	1-3/8"
	Aluminum, 6063-T5 min.	5/16"	0.050"
	Steel Stud, Gr. 33 min.	5/16"	0.045" (20 Ga)
	A36 Steel	5/16"	0.050"
3/16" Steel Ultracon+	Concrete (min. 2.9 ksi)	1"	1-3/4"
	UngROUTED CMU, (ASTM C-90)	1-1/16"	1-1/4"
	Southern Pine (SG = .55)	1"	1-3/8"
1/4" Steel Ultracon+	Concrete (min. 3.0 ksi)	1"	1-3/8"
	UngROUTED CMU, (ASTM C-90)	1"	1-1/4"
	Southern Pine (SG = .55)	1"	1-3/8"

- 1) ANCHOR MUST EXTEND A MINIMUM OF 3 THREADS BEYOND ANY METAL SUBSTRATE.
- 2) "UNGROUTED CMU" VALUES MAY BE USED FOR GROUTED CMU APPLICATIONS.
- 3) ALL ANCHOR HEAD TYPES ARE APPLICABLE.

INSTALLATION NOTES:

- 1) SEE SHEET 1 FOR ANCHOR SPACING REQUIREMENTS.
- 2) ANY INSTALLATION OPTION SHOWN (2X BUCK OR WOOD FRAMING, 1X BUCK, DIRECT TO MASONRY, STEEL STUD) MAY BE USED ON ANY SIDE OF THE WINDOW.
- 3) USE ONLY SUBSTRATE APPROPRIATE ANCHORS LISTED IN ANCHOR TABLE 2. FOLLOW EMBEDMENT AND EDGE DISTANCE LIMITS. MAX. SHIM THICKNESS TO BE 1/4".
- 4) MAXIMUM DESIGN PRESSURE LIMITED TO +/- 50 PSF FOR ALTERNATE ANCHOR LOCATION.

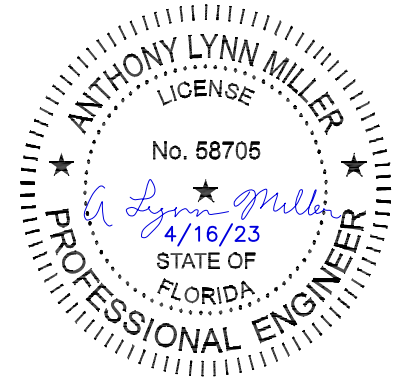

A. LYNN MILLER, P.E., P.E.# 58705

REGISTRATION #29296

COPYRIGHT © 2023
CGI WINDOWS AND DOORS
LIMITED LICENSE TO MAKE
COPIES FOR PERMITTING

PREPARED BY: A. LYNN MILLER, P.E.

1070 TECHNOLOGY DR
N. VENICE, FL 34275
(941)-480-1600

SH800V SINGLE HUNG, NI

FLANGE INSTALLATION SECTION VIEWS

CGI WINDOWS & DOORS
3780 W. 104TH STREET
HIALEAH, FL 33018

REVISION:

DATE:

#:

DATE: 04/14/2023

SCALE: NTS

BY: LOGAN YODER

DRAWING # :
SH800V-FPA-NI

SHEET: 2 OF 6

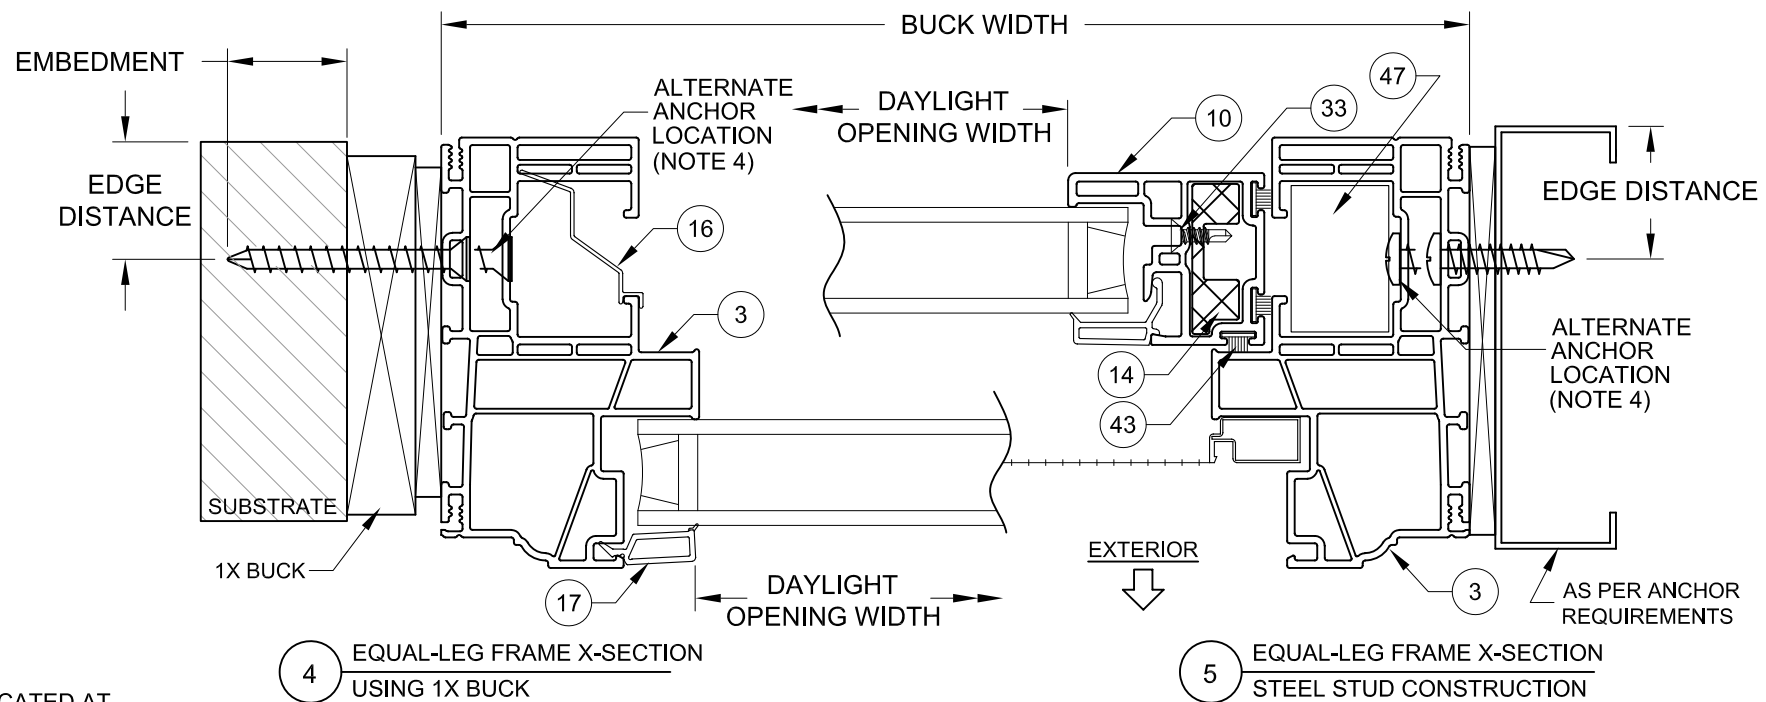
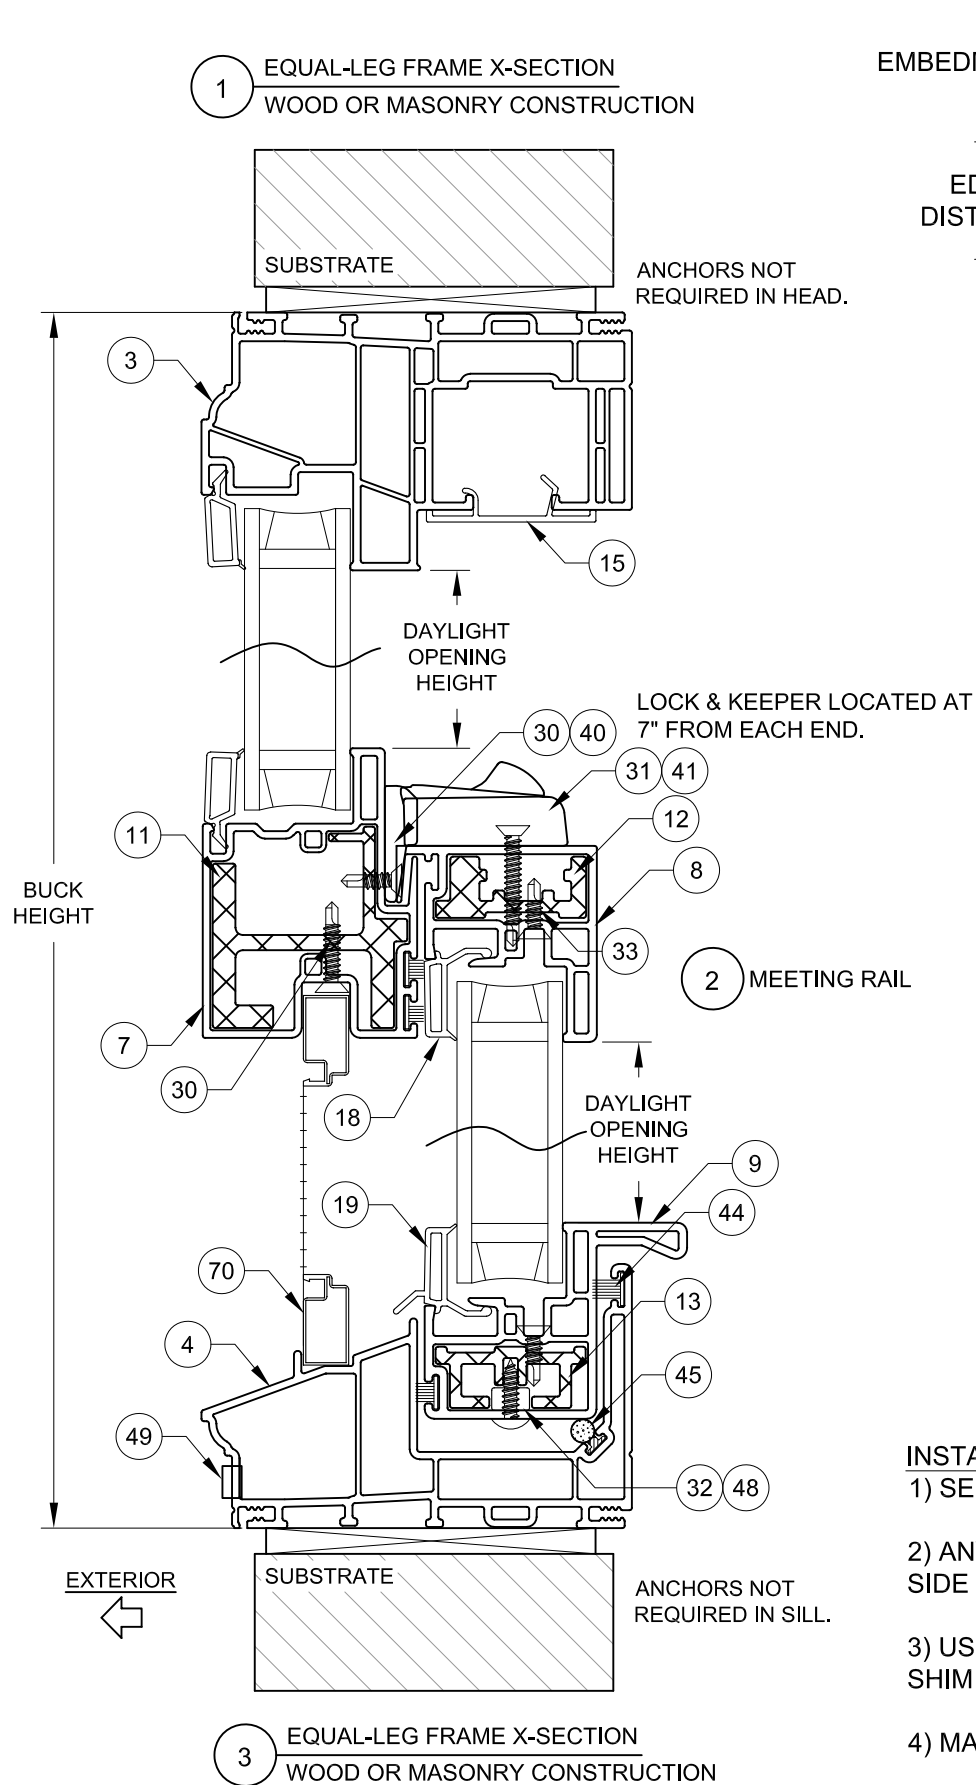



TABLE 3: INSTALLATION ANCHORS

Anchor	Substrate	Minimum Edge Distance	Minimum Embedment
#10 or #12 Steel or 410 SS Screw	Southern Pine (SG = .55)	1/2"	1-3/8"
	Aluminum, 6063-T5 min.	5/16"	0.050"
	Steel Stud, Gr. 33 min.	5/16"	0.045" (20 Ga)
	A36 Steel	5/16"	0.050"
3/16" Steel Ultracon+	Concrete (min. 2.9 ksi)	1"	1-3/4"
	UngROUTED CMU, (ASTM C-90)	1-1/16"	1-1/4"
	Southern Pine (SG = .55)	1"	1-3/8"
1/4" Steel Ultracon+	Concrete (min. 3.0 ksi)	1"	1-3/8"
	UngROUTED CMU, (ASTM C-90)	1"	1-1/4"
	Southern Pine (SG = .55)	1"	1-3/8"

- 1) ANCHOR MUST EXTEND A MINIMUM OF 3 THREADS BEYOND ANY METAL SUBSTRATE.
- 2) "UNGROUTED CMU" VALUES MAY BE USED FOR GROUTED CMU APPLICATIONS.
- 3) ALL ANCHOR HEAD TYPES ARE APPLICABLE.

INSTALLATION NOTES:

- 1) SEE SHEET 1 FOR ANCHOR SPACING REQUIREMENTS.
- 2) ANY INSTALLATION OPTION SHOWN (2X BUCK OR WOOD FRAMING, 1X BUCK, DIRECT TO MASONRY, STEEL STUD) MAY BE USED ON ANY SIDE OF THE WINDOW.
- 3) USE ONLY SUBSTRATE APPROPRIATE ANCHORS LISTED IN ANCHOR TABLE 3. FOLLOW EMBEDMENT AND EDGE DISTANCE LIMITS. MAX. SHIM THICKNESS TO BE 1/4".
- 4) MAXIMUM DESIGN PRESSURE LIMITED TO +/- 50 PSF FOR ALTERNATE ANCHOR LOCATION.

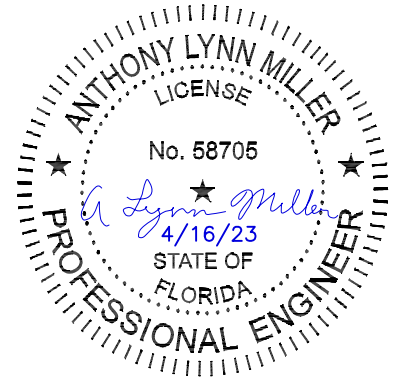

A. LYNN MILLER, P.E., P.E.# 58705

REGISTRATION #29296

COPYRIGHT © 2023
CGI WINDOWS AND DOORS
LIMITED LICENSE TO MAKE
COPIES FOR PERMITTING

PREPARED BY: A. LYNN MILLER, P.E.

1070 TECHNOLOGY DR
N. VENICE, FL 34275
(941)-480-1600

SH800V SINGLE HUNG, NI

EQUAL-LEG INSTALLATION
SECTION VIEWS

CGI WINDOWS & DOORS
3780 W. 104TH STREET
HIALEAH, FL 33018

BY:

REVISION:

DATE:

#:

DATE: 04/14/2023

SCALE: NTS

BY: LOGAN YODER

DRAWING # :
SH800V-FPA-NI

SHEET: 3 OF 6

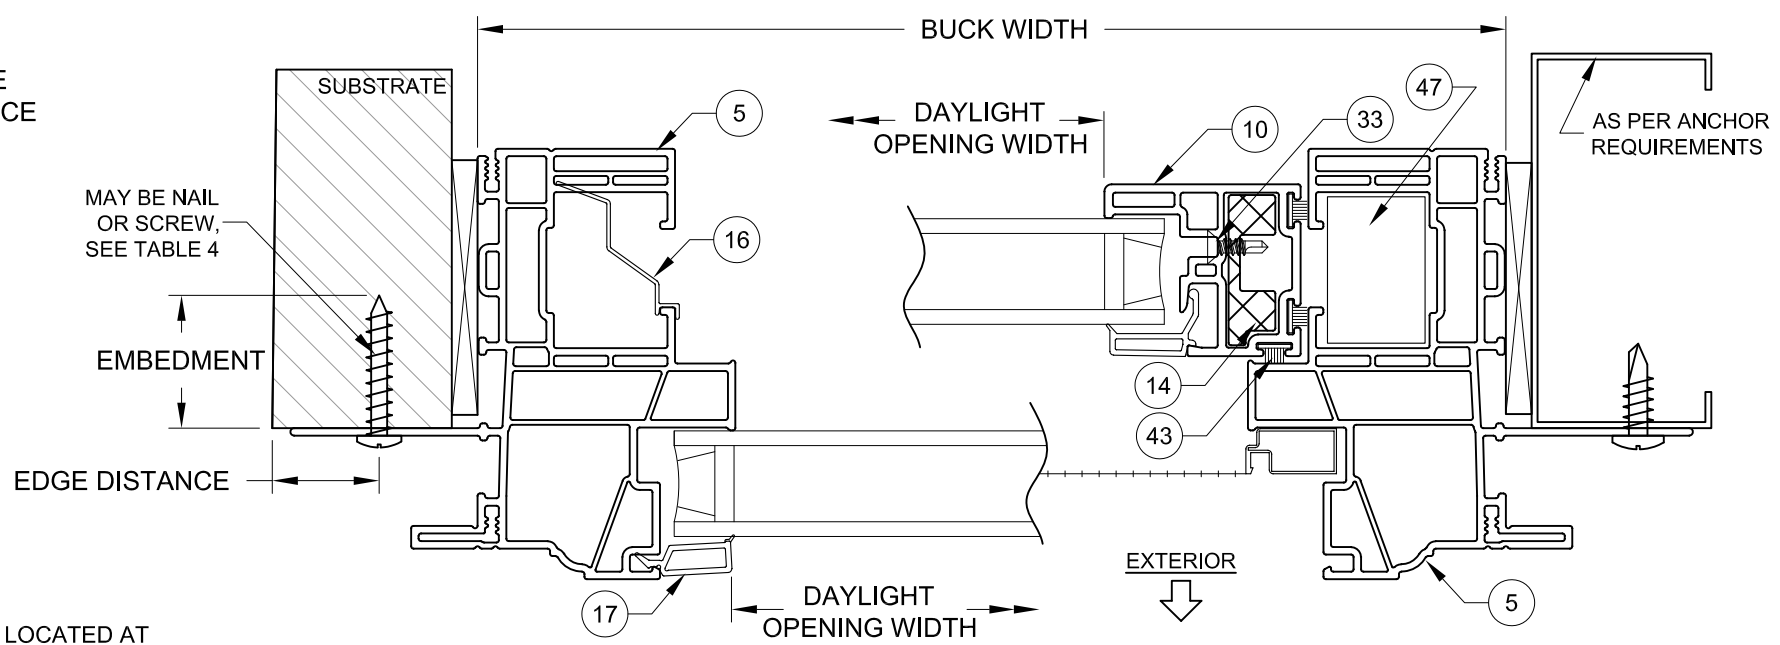
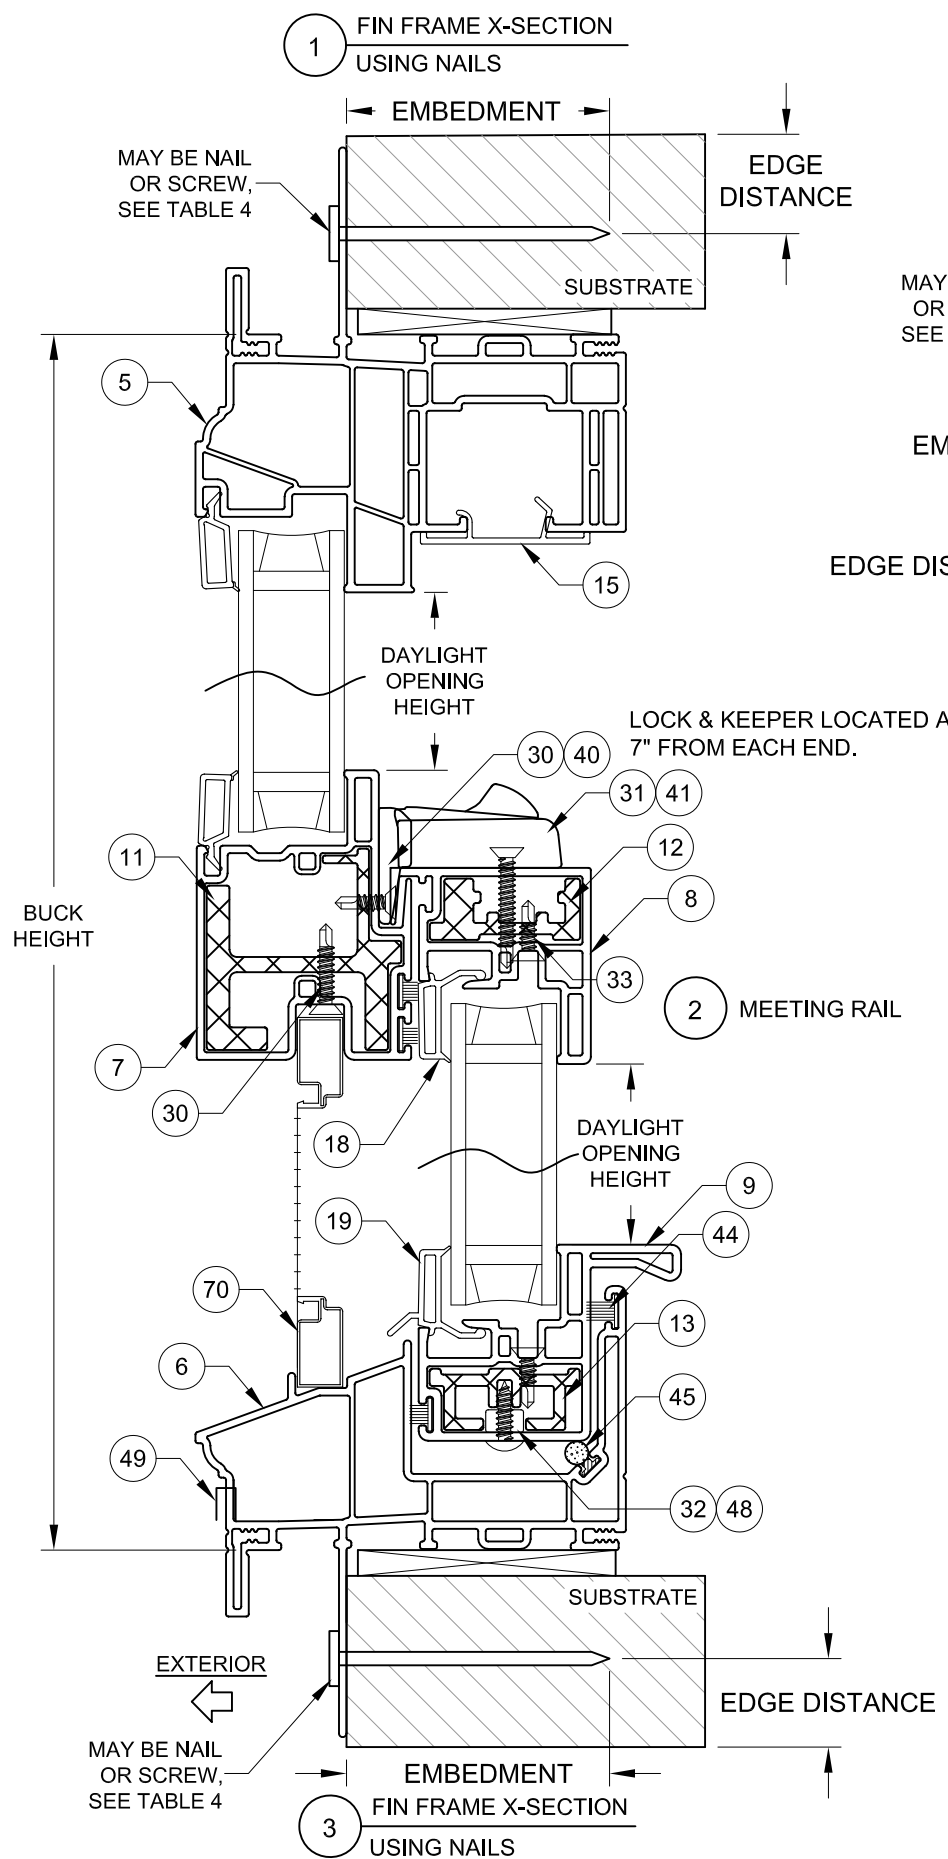



TABLE 4: INSTALLATION ANCHORS

Anchor	Substrate	Min. Edge Distance	Min. Embedment
2-1/2" x .113" Box Nail	P.T. Southern Pine (SG = .55)	5/16"	2-7/16"
2-1/2" x .131" Common Nail	P.T. Southern Pine (SG = .55)	3/8"	2-7/16"
2-1/2" x .145" Roofing Nail	P.T. Southern Pine (SG = .55)	3/8"	2-7/16"
#10 Steel SMS	P.T. Southern Pine (SG = .55)	1/2"	1-3/8"
	Aluminum, 6063-T5 min.	3/8"	1/8"
	Steel Stud, Gr. 33 min.	3/8"	0.036
	A36 Steel	3/8"	1/8"

1) ANCHOR MUST EXTEND A MINIMUM OF 3 THREADS BEYOND ANY METAL SUBSTRATE.
 2) ALL ANCHOR HEAD TYPES ARE APPLICABLE.

INSTALLATION NOTES:

- 1) SEE SHEET 1 FOR ANCHOR SPACING REQUIREMENTS.
- 2) FLANGE AND/OR FIN MAY BE REMOVED TO CREATE OTHER FRAME TYPES.
- 3) USE ONLY SUBSTRATE APPROPRIATE ANCHORS LISTED IN ANCHOR TABLE 4. FOLLOW EMBEDMENT AND EDGE DISTANCE LIMITS.
- 4) MAX SHIM THICKNESS TO BE 1/4". MAX SHIM SPACING TO BE 18".

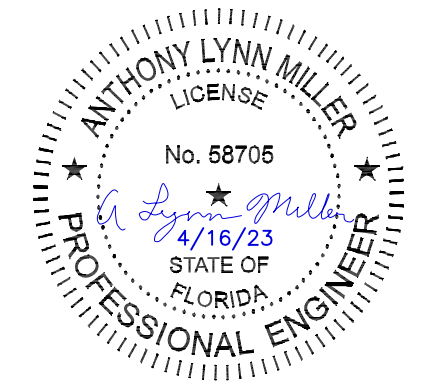

A. LYNN MILLER, P.E., P.E.# 58705

REGISTRATION #29296 COPYRIGHT © 2023 CGI WINDOWS AND DOORS LIMITED LICENSE TO MAKE COPIES FOR PERMITTING	PREPARED BY: A. LYNN MILLER, P.E. 1070 TECHNOLOGY DR N. VENICE, FL 34275 (941)-480-1600		SH800V SINGLE HUNG, NI		FIN INSTALLATION SECTION VIEWS		CGI WINDOWS & DOORS 3780 W. 104TH STREET HIALEAH, FL 33018	
	BY:		REVISION:		DATE:		#:	
DATE: 04/14/2023			SCALE: NTS			BY: LOGAN YODER		
DRAWING #: SH800V-FPA-NI			SHEET: 4 OF 6					


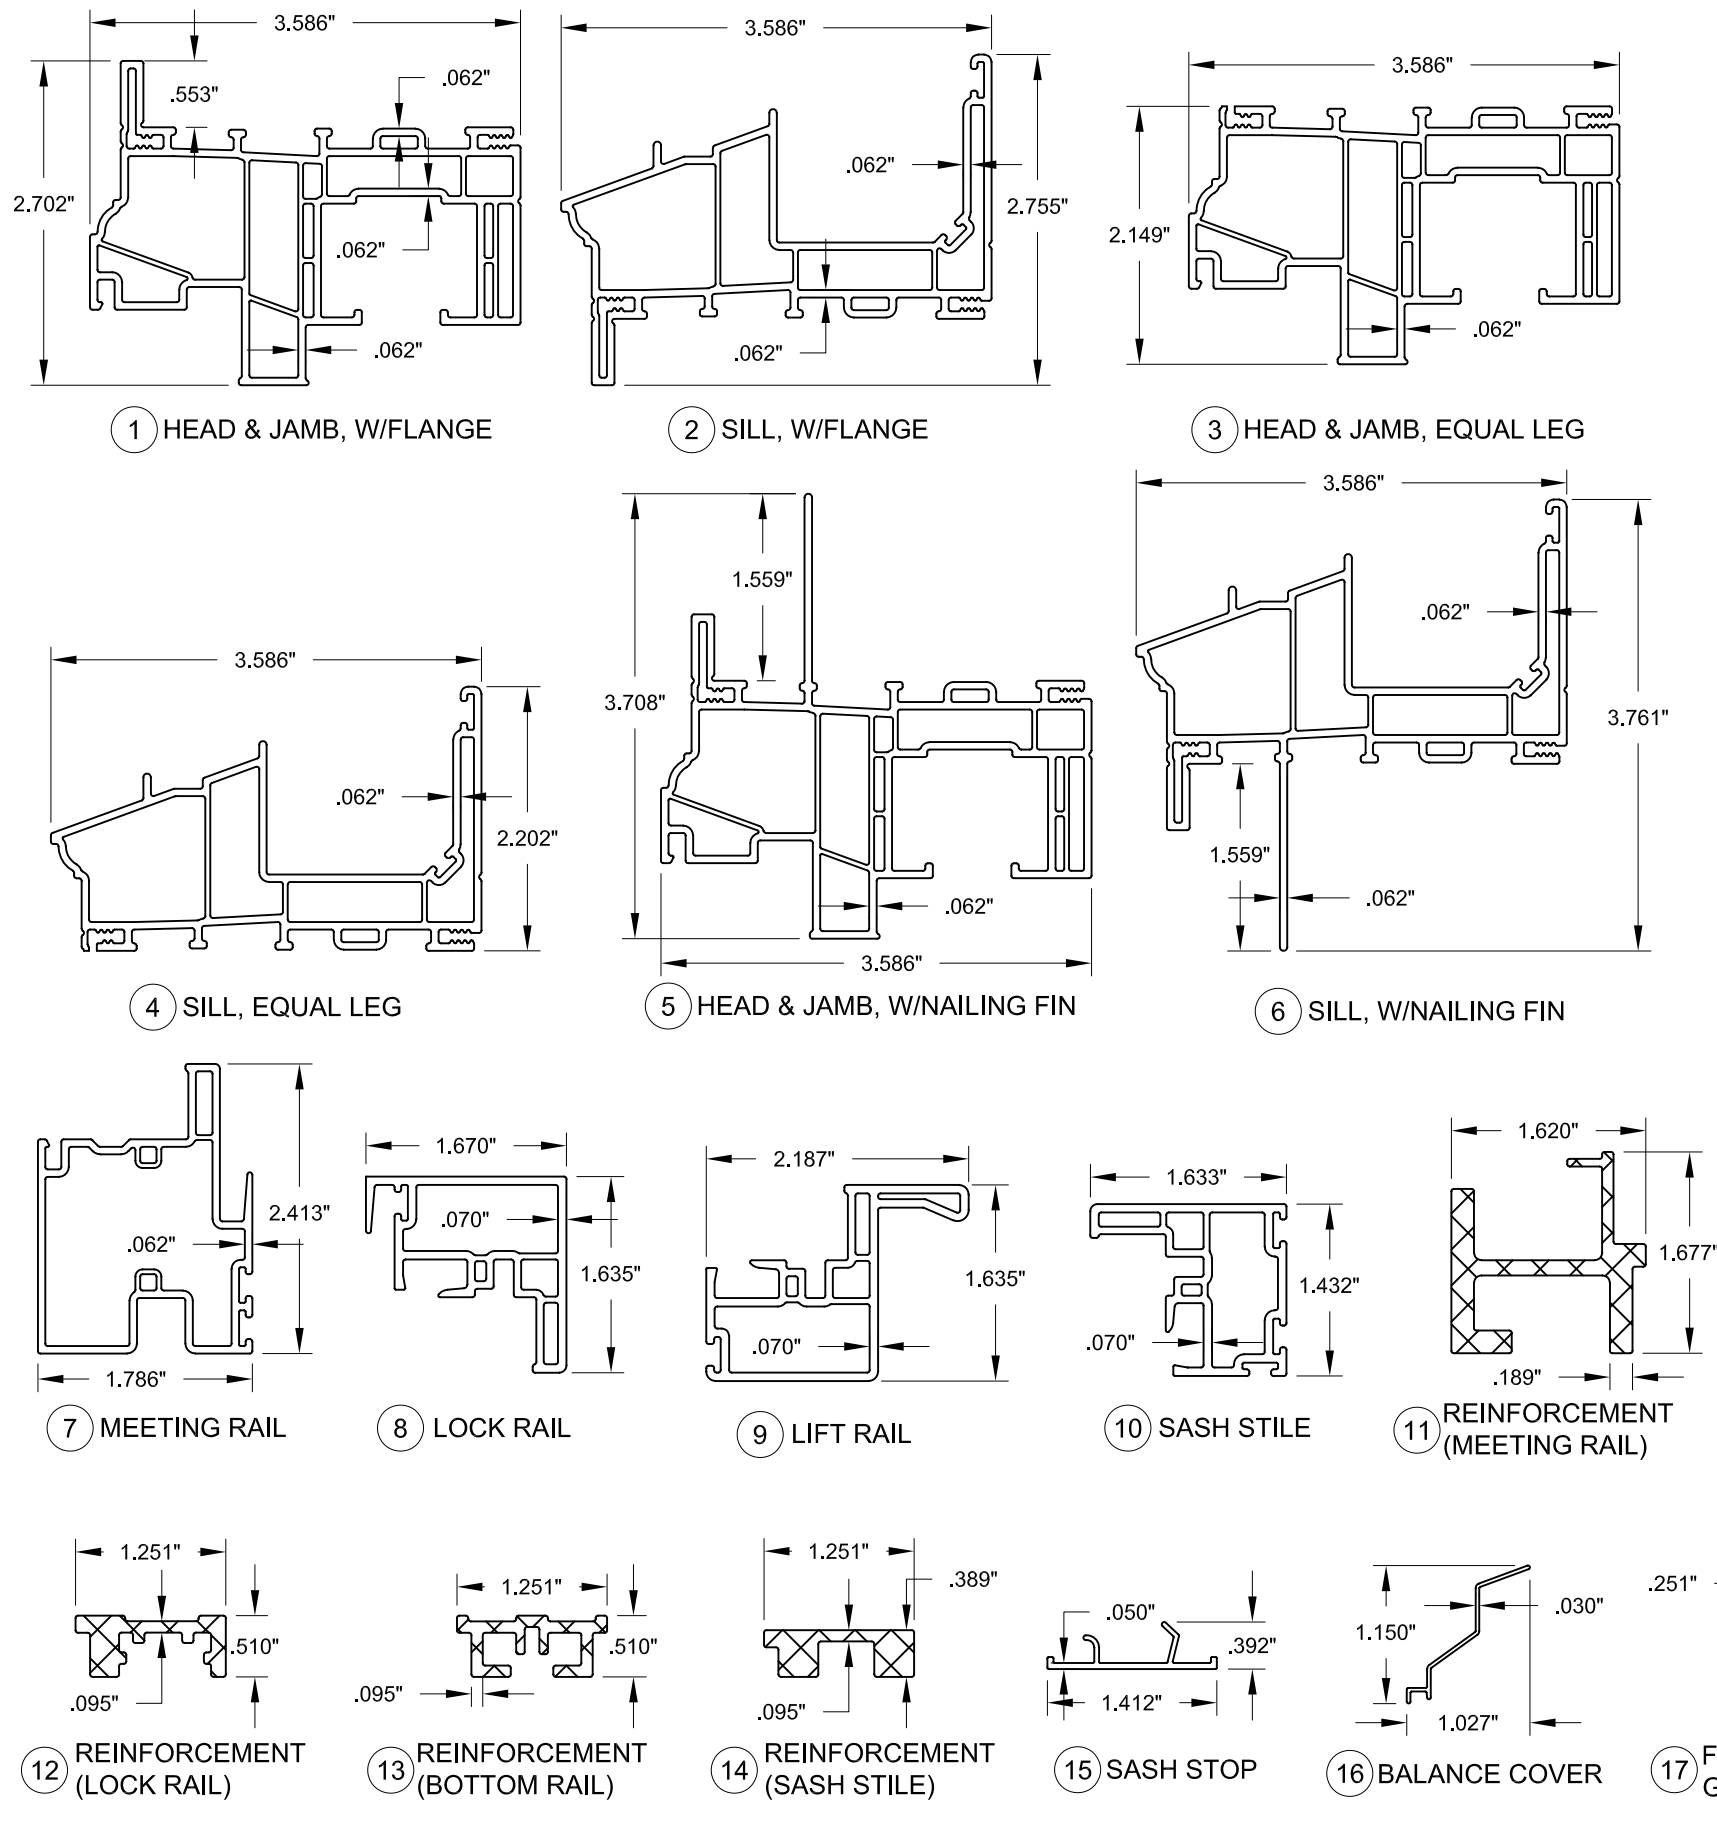


TABLE 5:			
#	Part #	Description	Material
1	9465	Head & Jamb, w/Flange	PVC
2	9469	Sill, w/Flange	PVC
3	9465	Head & Jamb, Equal Leg	PVC
4	9469	Sill, Equal Leg	PVC
5	9455	Head & Jamb, w/Nailing Fin	PVC
6	9459	Sill, w/Nailing Fin	PVC
7	9477	Meeting Rail	PVC
8	9485	Lock Rail	PVC
9	9476	Sash Lift Rail	PVC
10	9438	Sash Stiles	PVC
11	6166	Reinf. - Meeting Rail	6063-T5
12	6165	Reinf. - Lock Rail	6063-T5
13	6163	Reinf. - Lift Rail	6063-T5
14	6164	Reinf. - Stiles	6063-T5
15	9473	Sash Stop	PVC
16	9468	Balancer Cover	PVC
17	9736	Fixed Lite Glazing Bead	PVC
18	9425	Sash Glazing Bead	PVC
19	9467	Sash Glazing Bead w/Drip Edge	PVC
30	1012	Screw, #6 x 3/4" PFH	Steel
31	1007	Screw, #6 x 1-1/8" PFH	Steel
32	1015	Screw, #8 x 1/2" PTRUSS	Steel
33	1003	Screw, #6 x 1/2" PFH	Steel
40	8096	Keeper	Zinc
41		Lock	
42	8121	MR Backing Plate	SS
43	4006	WSTP, .270" x .220" Polyfin	
44	4008	WSTP, .270" x .320" Polyfin	
45	4012	WSTP, Bulb Vinyl, .187" x .300"	Steel
46	8205/8206	Tilt Latch, L&R	Zinc
47		Balance	
48	8148	Pivot Bar	SS
49	8223	Weep Cover	Nylon
60	RGS 7700, Pecora 895, SikaFlex 552, Dow 791, 983 or 995		
61		Insulated Glass Spacer	
62	7061	Setting Block, 1/8" x 7/8" x 2"	EPDM
70	6244	Screen Frame	Aluminum

THE APPROVED, RIGID PVC EXTERIOR EXTRUSIONS ARE TO BE PRODUCED BY EXTRUDERS' LICENSEES UNDER "AAMA CERTIFICATION PROGRAMS FOR RIGID PVC EXTRUSIONS".

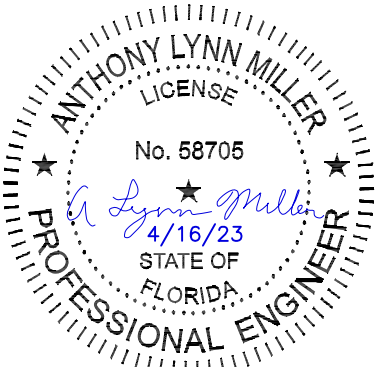

A. LYNN MILLER, P.E., P.E.# 58705

REGISTRATION #29296

COPYRIGHT © 2023
CGI WINDOWS AND DOORS
LIMITED LICENSE TO MAKE
COPIES FOR PERMITTING

PREPARED BY: A. LYNN MILLER, P.E.

1070 TECHNOLOGY DR
N. VENICE, FL 34275
(941)-480-1600

SH800V SINGLE HUNG, NI

EXTRUSIONS & BOM

CGI WINDOWS & DOORS
3780 W. 104TH STREET
HIALEAH, FL 33018

REVISION:

DATE:

#:


DATE: 04/14/2023

SCALE: NTS

BY: LOGAN YODER

DRAWING # :
SH800V-FPA-NI

SHEET: 5 OF 6

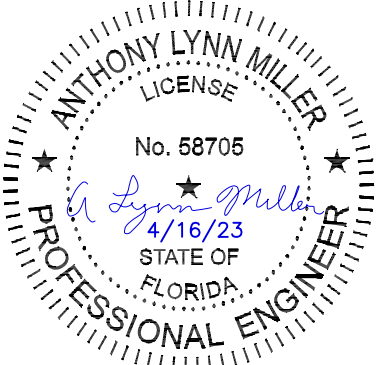

A. LYNN MILLER, P.E., P.E.# 58705

REGISTRATION #29296

COPYRIGHT © 2023
CGI WINDOWS AND DOORS
LIMITED LICENSE TO MAKE
COPIES FOR PERMITTING

PREPARED BY: A. LYNN MILLER, P.E.

1070 TECHNOLOGY DR
N. VENICE, FL 34275
(941)-480-1600

SH800V SINGLE HUNG, NI

GLASS DETAILS

CGI WINDOWS & DOORS
3780 W. 104TH STREET
HIALEAH, FL 33018

BY:

REVISION:

DATE:

#:


DATE: 04/14/2023

SCALE: NTS


BY: LOGAN YODER

DRAWING # :
SH800V-FPA-NI

SHEET: 6 OF 6

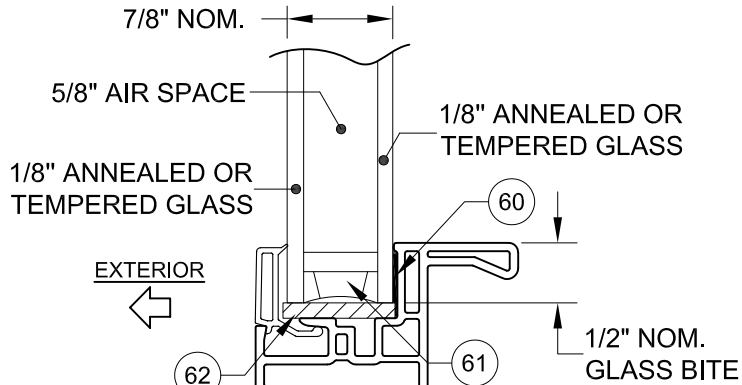

GLASS TYPE 1

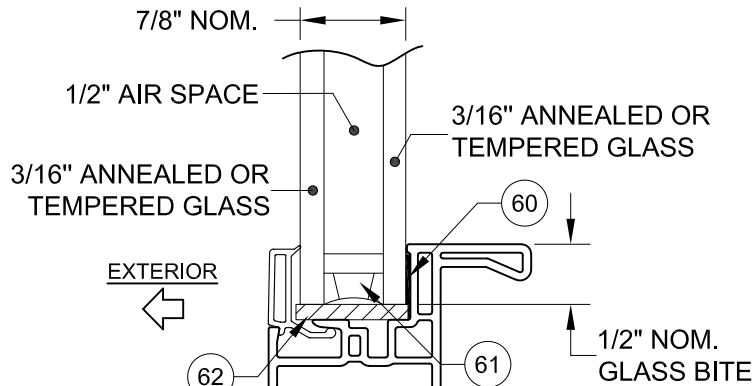

GLASS TYPE 2