

RENAISSANCE WINDOWS AND DOORS

SERIES 9500 VINYL POCKET SLIDING GLASS DOOR - PXXXXP

THROUGH-FRAME INSTALLATION ANCHORAGE DETAILS

GENERAL NOTES:

1. THIS PRODUCT HAS BEEN TESTED, EVALUATED AND DESIGNED TO THE DESIGN PRESSURE(S) STATED HEREIN IN ACCORDANCE WITH THE REQUIREMENTS OF THE CURRENT EDITION OF THE FLORIDA BUILDING CODE.
- 1.1. PERFORMANCE STANDARDS USING IN TESTING:
- 1.1.1. AAMA/WDMA/CSA 101/I.S.2/A440-08
- 1.1.2. AAMA/WDMA/CSA 101/I.S.2/A440-11
2. THE PRODUCT DETAILS CONTAINED HEREIN ARE BASED UPON SIGNED AND SEALED TEST REPORT NO. C9930.18-550-14 AND C9930.19-550-14AND ASSOCIATED LABORATORY DRAWINGS BY INTERTEK/ARCHITECTURAL TESTING INC.
3. THIS PRODUCT EVALUATION DOCUMENT IS NOT FOR USE IN THE HIGH VELOCITY HURRICANE ZONE (HVHZ).
4. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE / MASONRY AND 2X FRAMING FRAMING SUBSTRATES AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE LICENSED PROFESSIONAL ENGINEER OR REGISTERED ARCHITECT ACTING AS THE DESIGN PROFESSIONAL OF RECORD FOR THE PROJECT OF INSTALLATION.
5. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE LICENSED PROFESSIONAL ENGINEER OR REGISTERED ARCHITECT ACTING AS THE DESIGN PROFESSIONAL OF RECORD FOR THE PROJECT OF INSTALLATION.
6. WHEN INSTALLED IN LOCATIONS WHERE WINDBORNE DEBRIS PROTECTION REQUIREMENTS EXIST,THIS PRODUCT REQUIRES OPENING PROTECTION IN ACCORDANCE WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE USING AN APPROVED IMPACT PROTECTION DEVICE.
7. SITE CONDITIONS NOT COVERED IN THIS PRODUCT EVALUATION DOCUMENT ARE SUBJECT TO ADDITIONAL ENGINEERING ANALYSIS BY A LICENSED PROFESSIONAL ENGINEER OR REGISTERED ARCHITECT AS REQUIRED BY THE AUTHORITY HAVING JURISDICTION.
8. MATERIALS
- 8.1. DOOR FRAME MATERIAL: VINYL (PVC).
- 8.2. REINFORCEMENT EXTRUSIONS: 6063-T5 ALUMINUM.
9. GLASS MEETS THE REQUIREMENTS OF ASTM E1300-16.
10. DESIGNATION "X" STANDS FOR OPERABLE PANEL.
11. INTERIOR AND EXTERIOR FINISHING AND SEALING ARE FOR ILLUSTRATIVE PURPOSES ONLY. THESE DRAWINGS CERTIFY THE DOOR INSTALLATION ONLY IN SUPPORTING STRUCTURAL SUBSTRATE. WATER PROOFING OF THE INSTALLED DOOR IS NOT PART OF THIS INSTALLATION CERTIFICATION. THAT RESPONSIBILITY SHALL BE THAT OF THE MANUFACTURER AND/OR THE INSTALLER.

PERFORMANCE RATING			
MAXIMUM DOOR SIZE	GLAZING DETAIL (SEE SHEET 9)	DESIGN PRESSURE (PSF)	IMPACT RATING
288" X 96" PXXXXP	A	+/- 50	NONE. SEE GENERAL NOTE 6.

INSTALLATION NOTES:

1. PRODUCT ANCHORS SHALL BE AS DESIGNATED AND LOCATED AS SHOWN IN THIS PRODUCT EVALUATION DOCUMENT. ANCHOR EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER AND SIDING.
2. SEE *INSTALLATION ANCHOR SCHEDULE* ON SHEET 2 FOR TYPE AND GRADE OF ANCHOR, AND/OR MANUFACTURER'S ANCHOR SPECIFICATIONS, INCLUDING MINIMUM NOMINAL SIZE, MINIMUM EMBEDMENT INTO SUBSTRATE AND MINIMUM EDGE DISTANCES.
- 2.1. EDGE DISTANCES SHALL BE MEASURED FROM CENTERLINE OF ANCHOR TO EDGE OF STRUCTURAL SUBSTRATE EITHER TO THE INTERIOR OR EXTERIOR OF THE FENESTRATION PRODUCT.
- 2.2. MINIMUM EMBEDMENT SHALL BE BASED ON PENETRATION INTO MAIN WIND FORCE RESISTING SYSTEM SUBSTRATE.
3. SEE SHEETS 4 THROUGH 6 FOR SPECIFIC ANCHOR INSTALLATION DETAILS.
4. TWO (2) INSTALLATION ANCHORS ARE REQUIRED AT EACH ANCHOR LOCATION SHOWN ON SHEET 3 EXCEPT AS FOLLOWS.
- 4.1. 2X WOOD BUCK FOR HOOK STRIP INSTALLATION SHALL BE ATTACHED USING 1/4' TAPCON OR LAG SCREWS AS SHOWN IN SECTION I ON SHEET 5.
- 4.2. 2X WOOD BUCK FOR HOOK STRIP INSTALLATION IS OPTION IF STRUCTURAL WOOD SUBSTRATE IS PRESENT.
- 4.3. HOOK STRIP TO 2X WOOD BUCK/STRUCTURAL WOOD SUBSTRATE INSTALLATION SHALL BE MADE USING NO. 10 WOOD SCREWS AS SHOWN IN SECTION I ON SHEET 5.
5. ANCHOR QUANTITIES AND SPACING / EMBEDMENT AND EDGE DISTANCE
- 5.1. THE NUMBER OF INSTALLATION ANCHORS IS BASED ON THE MAXIMUM END DISTANCE (ED) AND THE MAXIMUM ON CENTER (O.C.) SPACING PLACEMENT OF ANCHORS IN ACCORDANCE WITH ELEVATIONS ON SHEET 3.
- 5.2. END DISTANCES AND O.C. SPACINGS LESS THAN THAT SHOWN IN THE ELEVATION ON SHEET 3 SRE ACCEPTABLE.
- 5.3. FOR DOOR SIZES SMALLER THAN THOSE SHOWN, ANCHOR QUANTITIES CAN BE REDUCED WHILE MAINTAINING EDGE DISTANCE AND O.C. SPACING REQUIREMENTS.
- 5.4. ANCHOR QUANTITIES AND SPACINGS SHOWN ARE BASED ON THE LOWER OF ANCHOR SPACING USED IN TESTING OR REQUIRED BY LOADING AT DESIGN PRESSURE.
- 5.5. SEE EMBEDMENT AND EDGE DISTANCE DESCRIPTION ON SHEET 2.
6. MAXIMUM ALLOWABLE SHIM THICKNESS IS 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF WOOD COMPOSITE, HIGH DENSITY PLASTIC OR SIMILAR LOAD BEARING MATERIAL.
7. FOR CONCRETE BLOCK APPLICATIONS DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS.
8. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED IN THE *INSTALLATION ANCHOR SCHEDULE* ON SHEET 2.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES, INSTALLATION NOTES, TABLE OF CONTENTS
2	ANCHOR SCHEDULE - EMBEDMENT AND EDGE DISTANCE
3	ELEVATION & ANCHORING LAYOUT
4	VERTICAL CROSS SECTIONS
5	HORIZONTAL CROSS SECTIONS
6	VERTICAL & HORIZONTAL CROSS SECTIONS AT POCKET OPENING
7	GLAZING DETAIL AND GLAZING NOTES /BILL OR MATERIALS

RENAISSANCE WINDOWS AND DOORS

13340 INTERNATIONAL PARKWAY

JACKSONVILLE, FL 32218

SERIES 9500 VINYL POCKET SLIDING GLASS DOOR - PXXXXP

ANCHORAGE DETAILS

DATE: 09/26/2024

DWN BY: RJA

CHK BY: n/a

SCALE: NONE

ROBERT J. AMORUSO, P.E.

FL P.E. No. 49752

226 N NOVA RD, NO. 142,

ORMOND BEACH, FL 32174

RJAENGPE@GMAIL.COM



Digitally signed by Robert J Amoruso®

Date: 2024.10.29 11:25:22 -04'00'

PROJECT#: ACE-2024-136

DWG/REV: RWD025, Rev A

SHT: 1 of 7

INSTALLATION ANCHOR SCHEDULE									
INSTALLATION TYPE	SECTION VIEW	FASTENER HEAD TYPE	FASTENER SIZE	SUBSTRATE	MANUFACTURER AND/OR SPECIFICATION	MIN. EMBEDMENT	MIN. EDGE DISTANCE (IN)	MIN. SPACING (IN) BETWEEN FRAME	ANCHOR CAPACITIES BASED ON
THROUGH FRAME ANCHOR	SECTIONS A THRU H & J (SHEETS 4 TO 6)	HEX HEAD	3/16"	CONCRETE	ITW TAPCONS (1)	1	1-1/8	3	MIN. 2000 PSI CONCRETE
				MASONRY (BLOCK/CMU)	ITW TAPCONS (1)	1	2	3	STRENGTH CONFORMANCE TO ASTM C-90, MEDIUM WEIGHT
		PAN HEAD (SHOWN)	No. 10	WOOD	ANSI B18.6.1 (WOOD SCREW) (2) GRADE 2 EQUIVALENT	1-3/8	3/4	2 1/2	WOOD WITH A MINIMUM SPECIFIC GRAVITY OF 0.42.
					ASME B18.6.4 (TAPPING SCREW) (2) GRADE 2 EQUIVALENT				
2x BUCK ANCHOR	SECTION I (SHEET 5)	HEX HEAD	1/4"	CONCRETE	ITW TAPCONS (1) (4)	1-1/2	1-1/2	4	MIN. 2000 PSI CONCRETE
				MASONRY (BLOCK/CMU)	ITW TAPCONS (1) (4)	1	2	4	STRENGTH CONFORMANCE TO ASTM C-90, MEDIUM WEIGHT
	SECTION I (SHEET 5)	HEX HEAD	1/4"	WOOD	ANSI/ASME B18.2.1 (LAG SCREW) (4) GRADE 2 EQUIVALENT	1-1/2	1	1	WOOD WITH A MINIMUM SPECIFIC GRAVITY OF 0.42.

NOTES:


1) WHEN ITW TAPCONS ARE USED FOR CONCRETE/MASONRY INSTALLATION, THEY SHALL BE THE ADVANCED THREADFORM TECHNOLOGY TYPE.

2) FOR WOOD SCREW INSTALLATION INTO WOOD SUBSTRATE; IF SPLITTING IS A CONCERN, DRILL 0.112" PILOT HOLE (DRILL SIZE 34). FOR TAPPING SCREW INSTALLATION INTO WOOD SUBSTRATE; IF SPLITTING IS A CONCERN,

3) TWO (2) ANCHORS PER LOCATION ALLOWED TO HAVE 2.45" SEPARATION. 3" SPACING IS BETWEEN ANCHOR LOCATIONS SHOWN IN ELEVATION.

4) 1/4" ANCHOR HEADS SHALL BE EMBEDDED IN 2X BUCK SO TOP OF HEAD IS FLUSH WITH 2X BUCK TO ALLOW FOR FINISHING. FOR WOOD INSTALLATION; IF SPLITTING IS A CONCERN, DRILL 0.112" PILOT HOLE (DRILL SIZE 37).

FRAME ANCHORAGE
MINIMUM EMBEDMENT
AND EDGE DISTANCE
THROUGH-FRAME INSTALLATION
OPERABLE AND FIXED DOOR PANELS
(OPERABEL HEAD PANEL SHOWN)

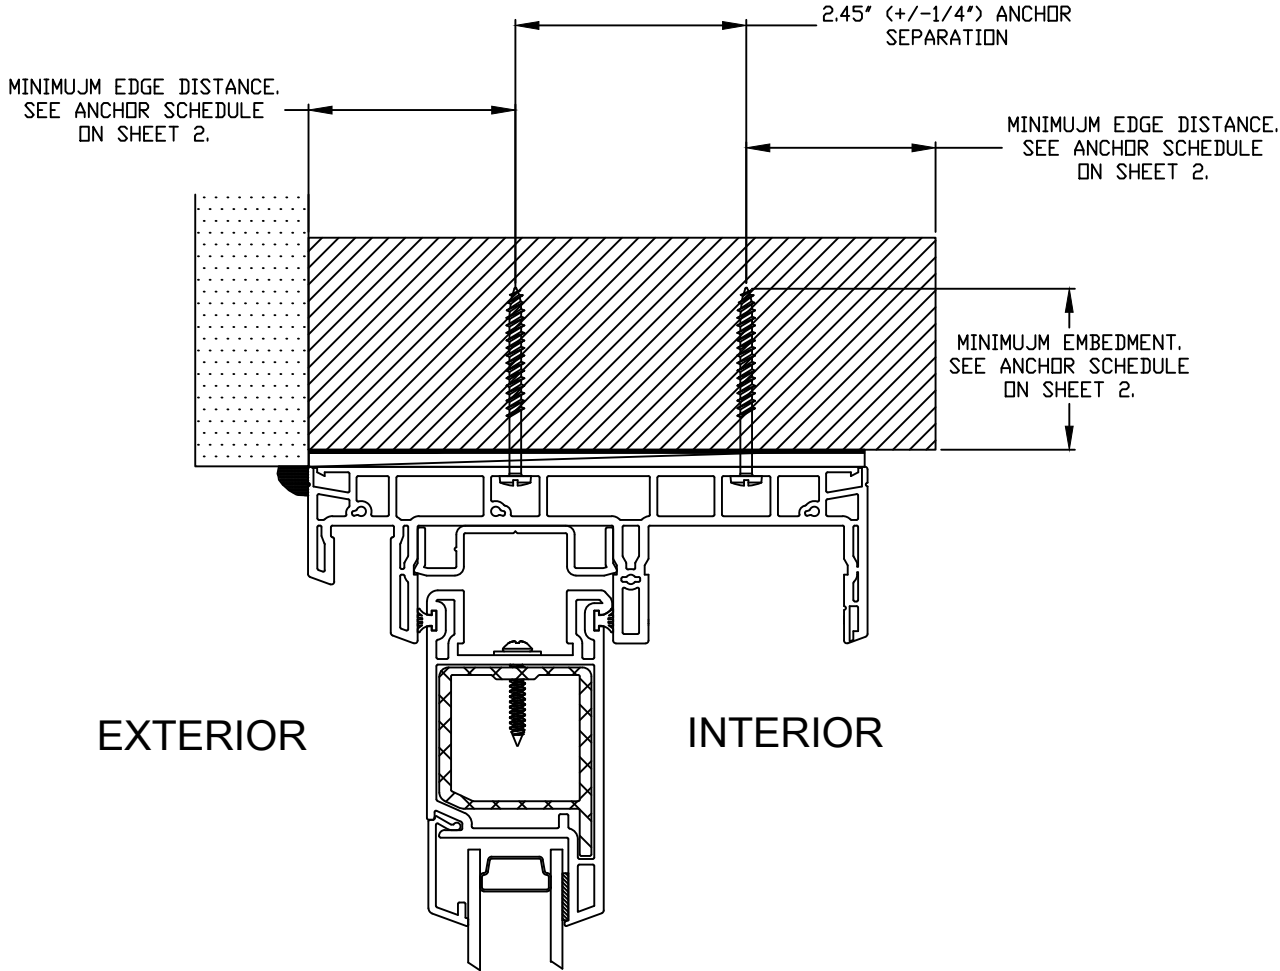

RENAISSANCE WINDOWS
AND DOORS
13340 INTERNATIONAL
PARKWAY
JACKSONVILLE, FL 32218

SERIES 9500 VINYL POCKET SLIDING GLASS DOOR - PXXXXP
ANCHORAGE DETAILS

DATE	BY	REVISION DESCRIPTION	NO.

DATE: 09/26/2024	DWN BY: RJA	CHK BY: n/a	SCALE: NONE
---------------------	----------------	----------------	----------------

ROBERT J. AMORUSO, P.E.
FL P.E. No. 49752
226 N NOVA RD, NO. 142,
ORMOND BEACH, FL 32174
RJAENGPE@GMAIL.COM

ROBERT JAMES AMORUSO
LICENSE
No 49752
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

Digitally signed by
Robert J Amoruso®
Date: 2024.10.29
11:25:37 -04'00'

PROJECT#:	ACE-2024-136
DWG/REV:	RWD025, Rev A
SHT:	2 of 7

NO.	REVISION DESCRIPTION	BY	DATE			

DATE: 09/26/2024	DWN BY: RJA	CHK BY: n/a	SCALE: NONE
---------------------	----------------	----------------	----------------

ROBERT J. AMORUSO, P.E.
FL P.E. No. 49752
226 N NOVA RD, NO. 142,
ORMOND BEACH, FL 32174
RJAENGPE@GMAIL.COM




Digitally signed by
Robert J Amoruso®
Date: 2024.10.29
11:25:49 -04'00'

PROJECT#: ACE-2024-136


DWG/REV: RWD025, Rev A

SHT: 3 of 7

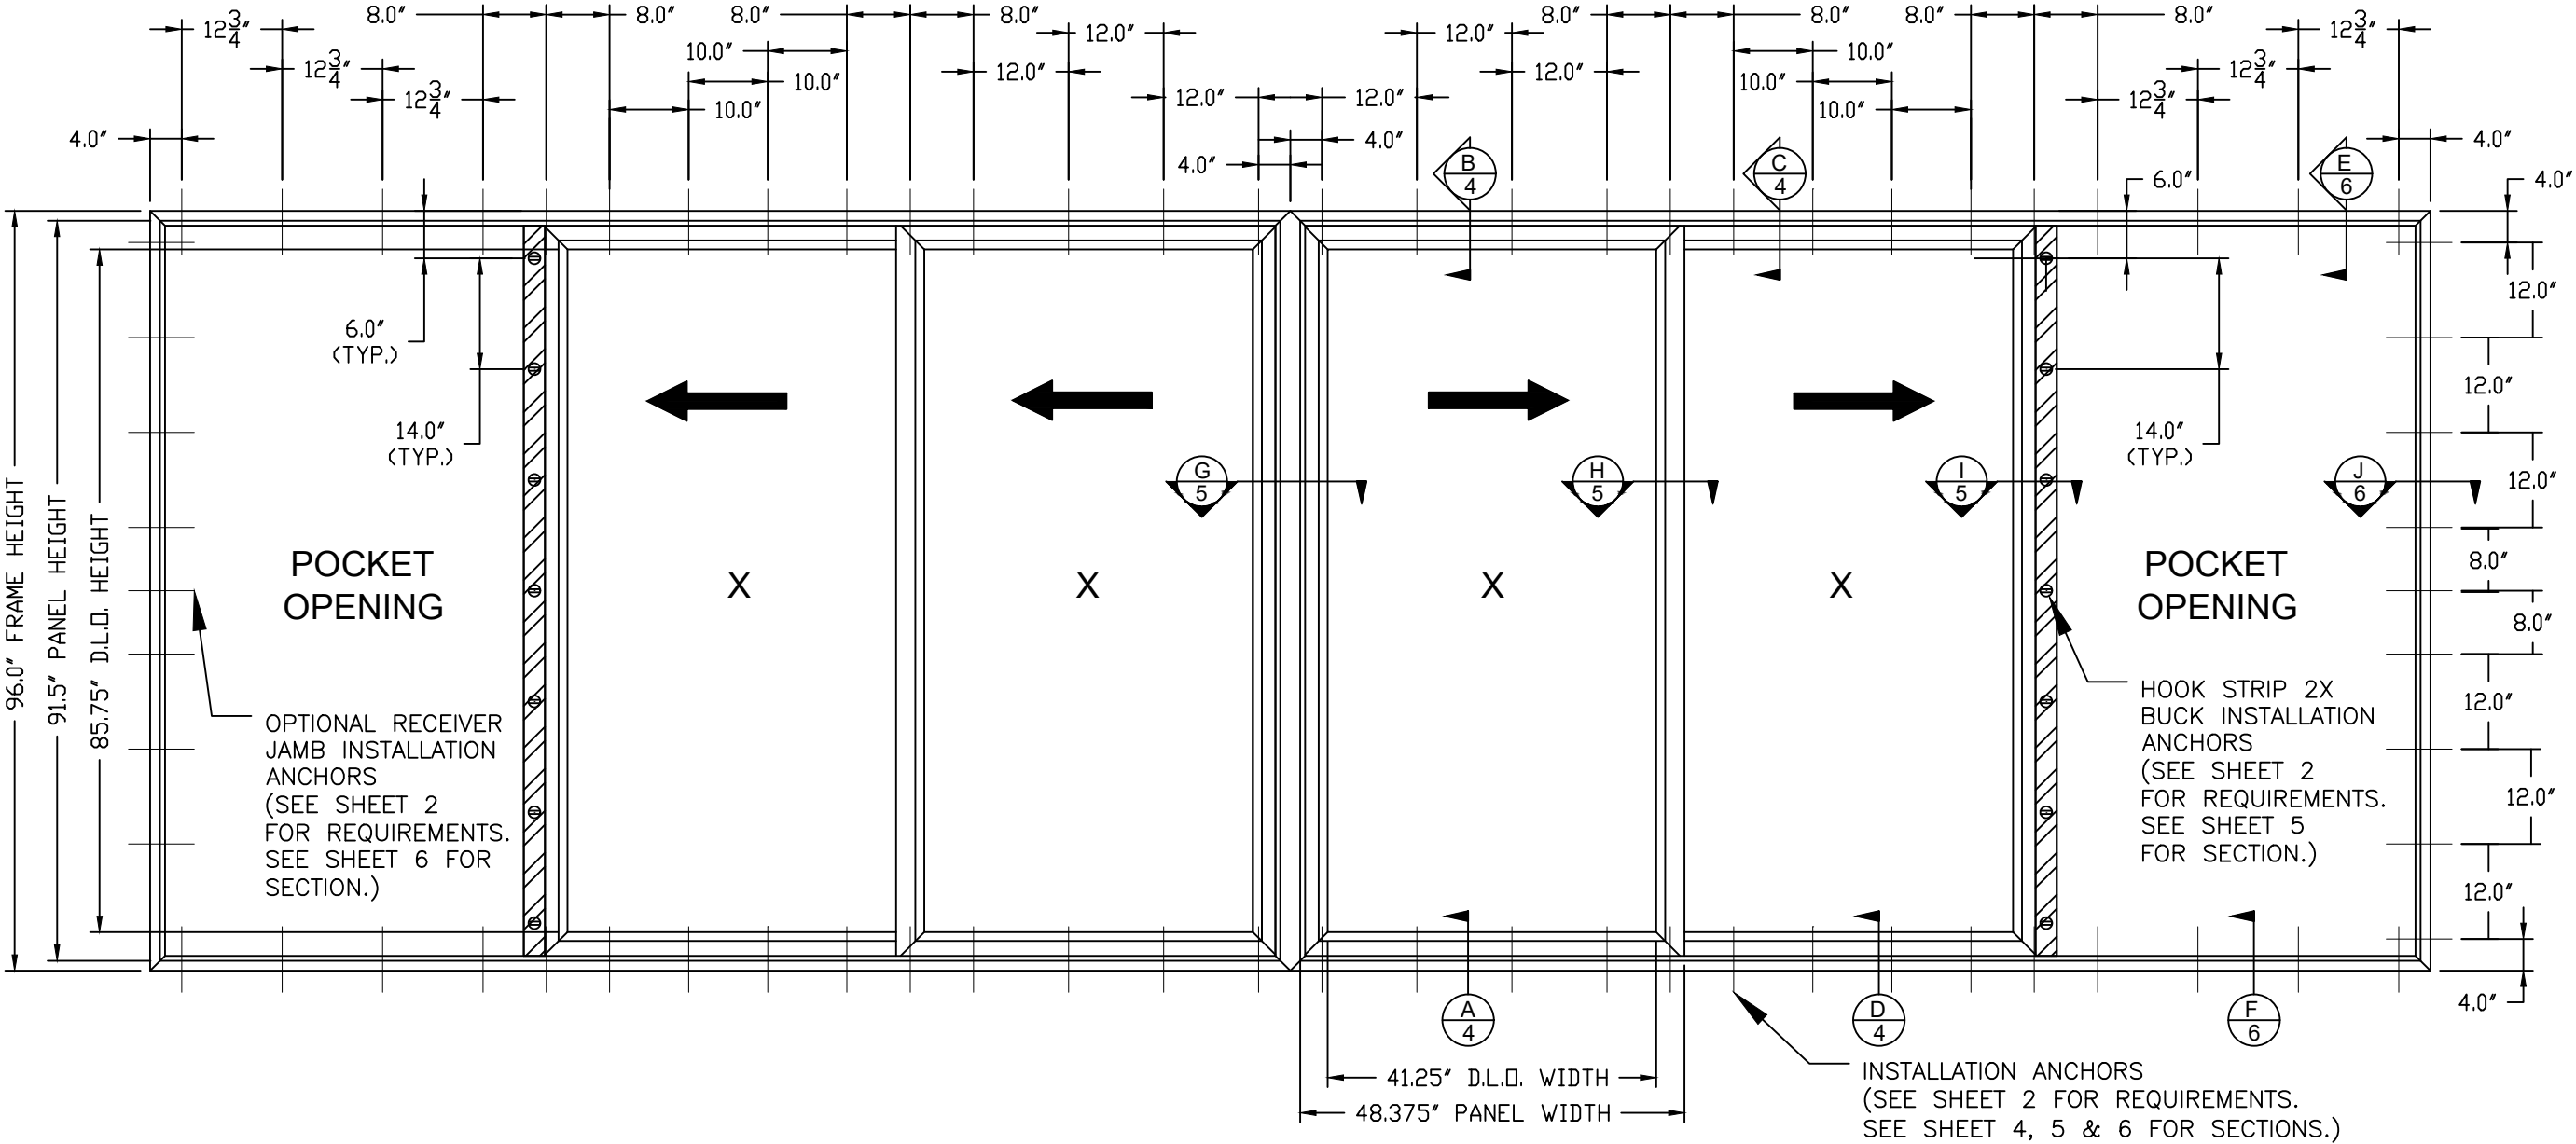


SERIES 9500 VINYL PXXXXP POCKET SLIDING GLASS DOOR
EXTERIOR VIEW (288" X 96" NOMINAL SIZE SHOWN)


POCKET DOOR
VERTICAL CROSS SECTIONS
THROUGH-FRAME INSTALLATION

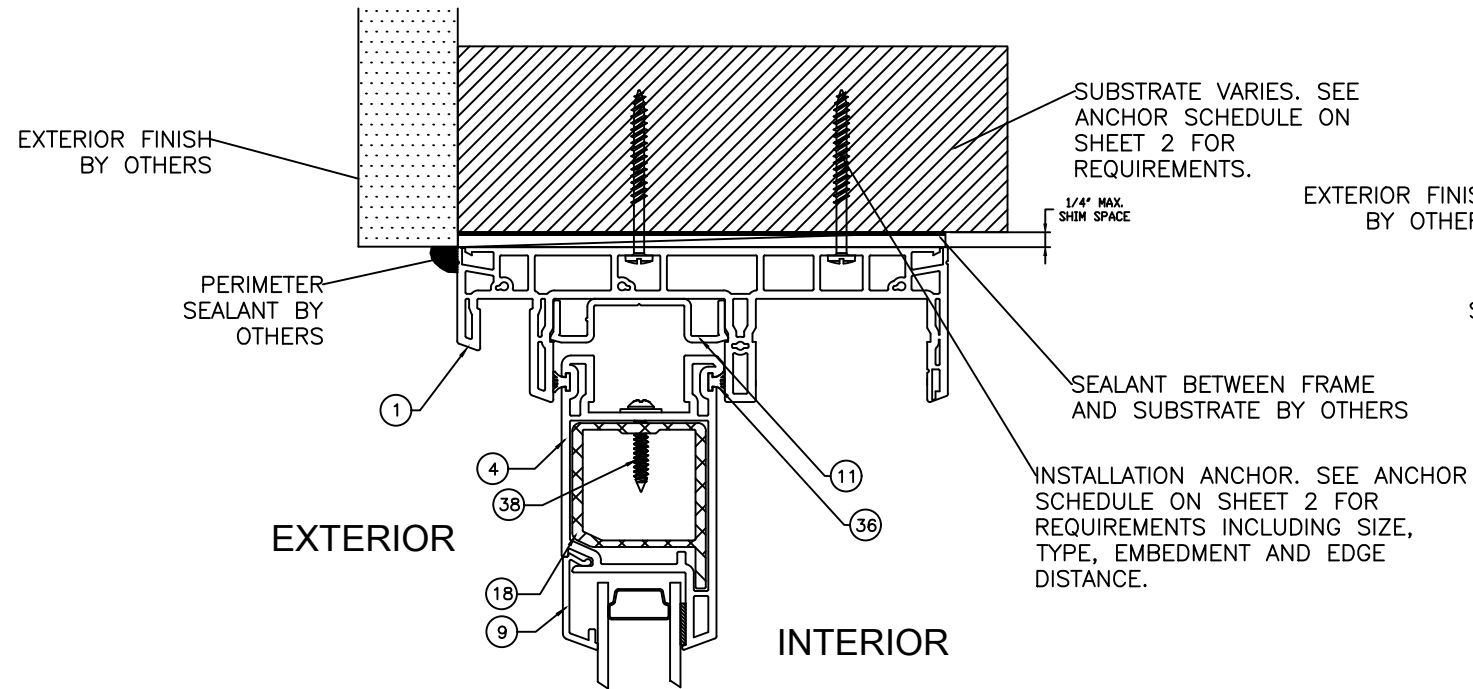


B
4
HEAD CROSS SECTION
THROUGH-FRAME INSTALLATION
OPERABLE DOOR PANEL

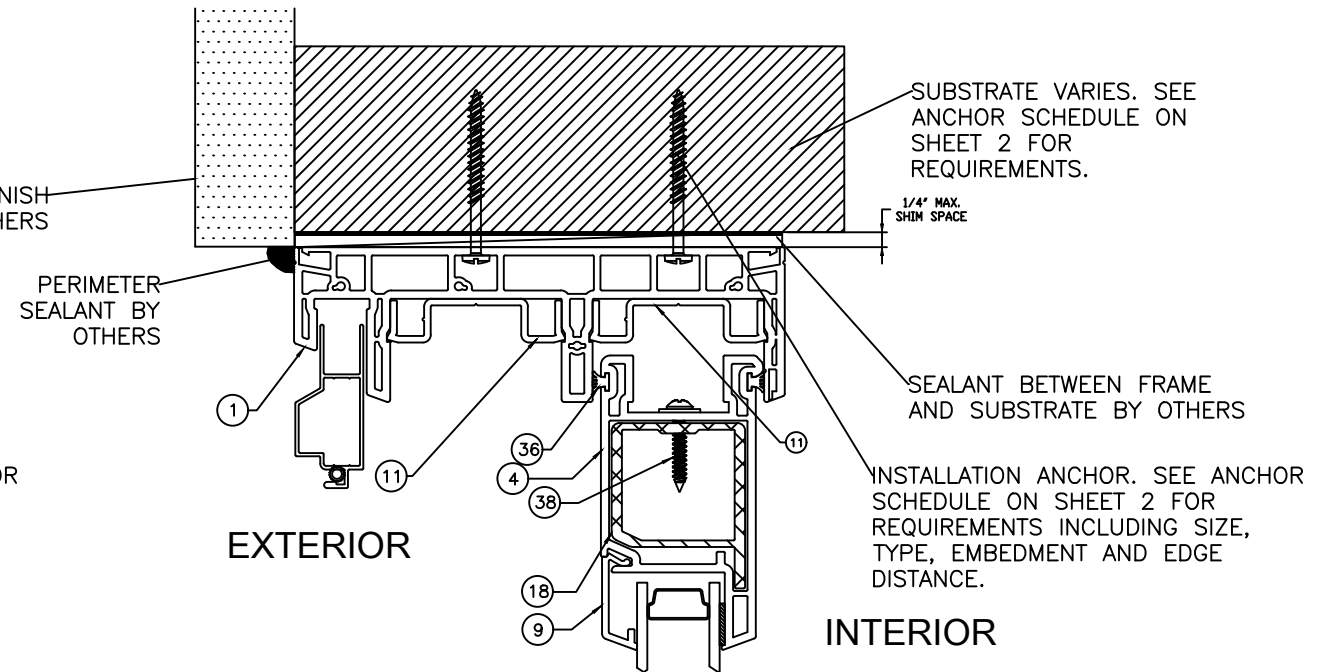

C
4
HEAD CROSS SECTION
THROUGH-FRAME INSTALLATION
OPERABLE DOOR PANEL

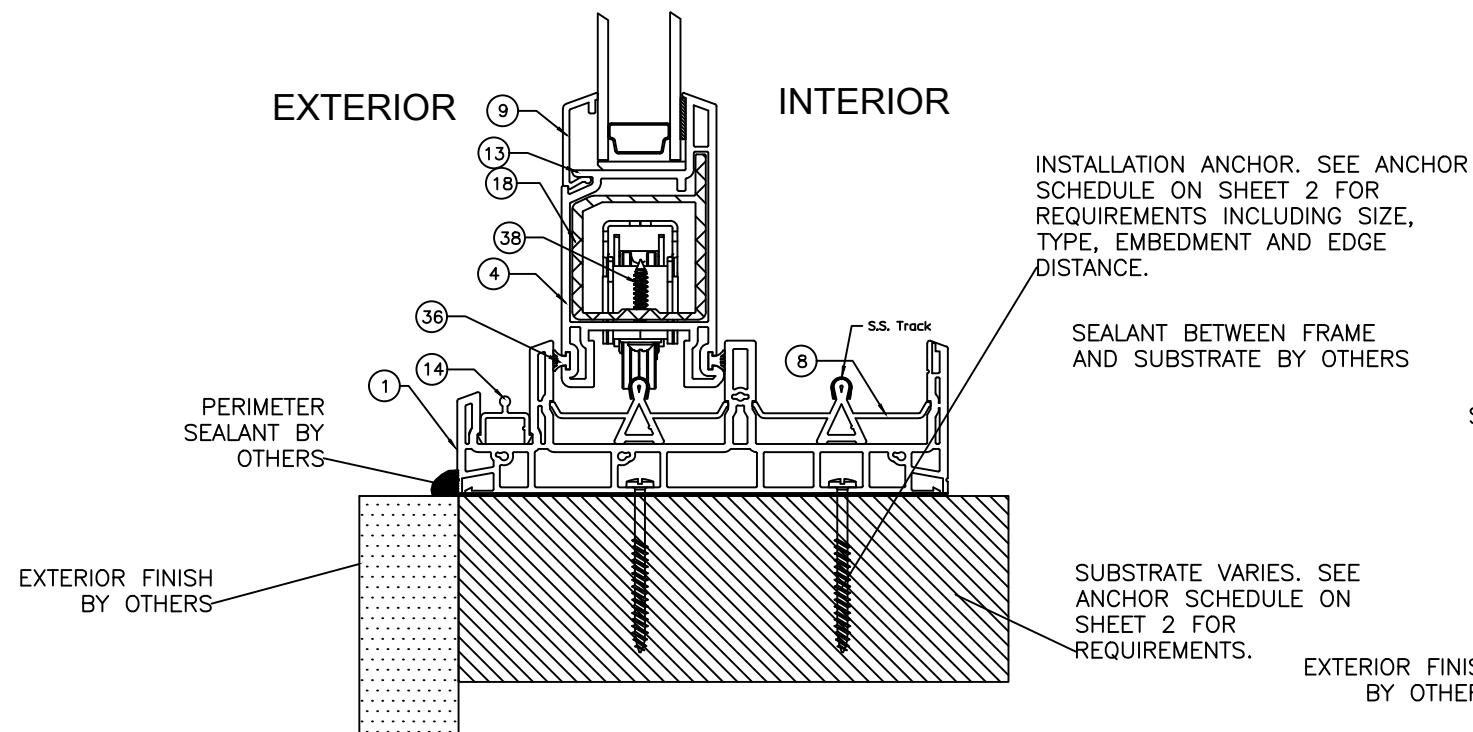

A
4
SILL CROSS SECTION
THROUGH-FRAME INSTALLATION
OPERABLE DOOR PANEL

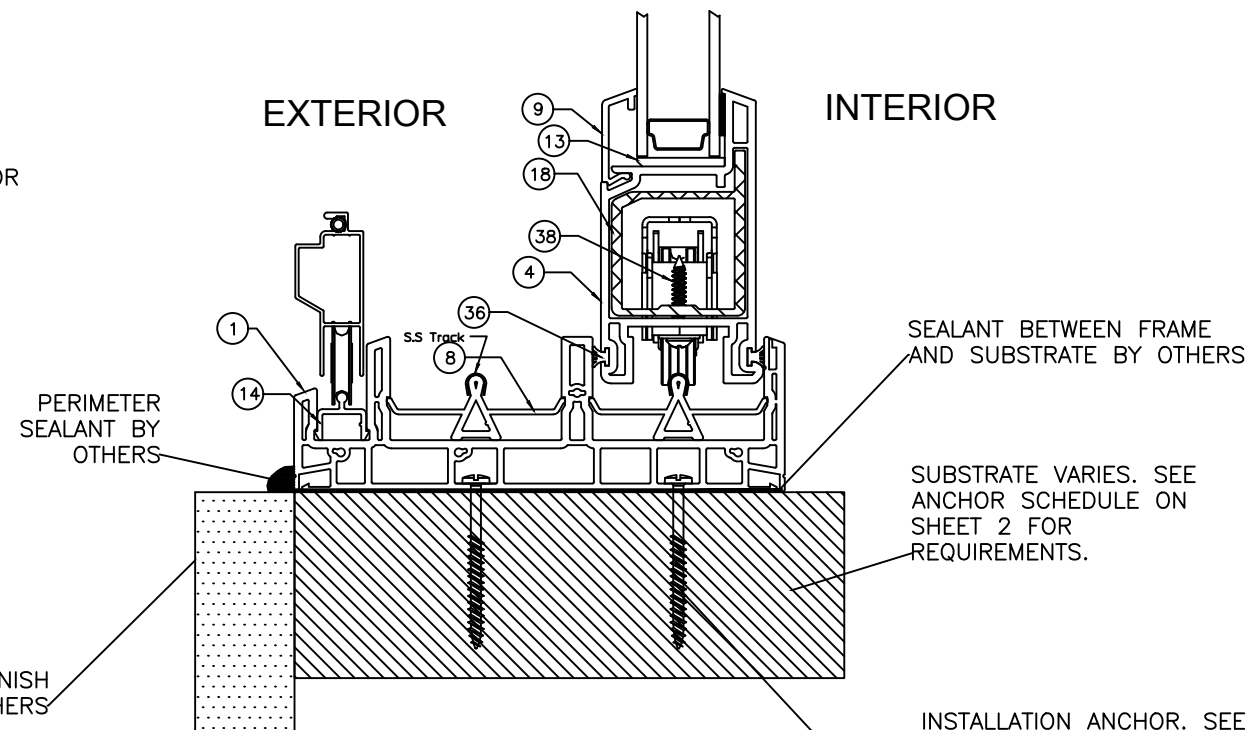

D
4
SILL CROSS SECTION
THROUGH-FRAME INSTALLATION
OPERABLE DOOR PANEL

RENAISSANCE WINDOWS
AND DOORS
13340 INTERNATIONAL
PARKWAY
JACKSONVILLE, FL 32218

SERIES 9500 VINYL POCKET SLIDING GLASS DOOR - PXXXXP ANCHORAGE DETAILS	DATE				
	BY				
	REVISION DESCRIPTION				
NO.					

DATE: 09/26/2024	DWN BY: RJA	CHK BY: n/a	SCALE: NONE
---------------------	----------------	----------------	----------------

ROBERT J. AMORUSO, P.E.
FL P.E. No. 49752
226 N NOVA RD, NO. 142,
ORMOND BEACH, FL 32174
RJAENGPE@GMAIL.COM



Digitally signed by
Robert J Amoruso
Date: 2024.10.29
11:26:01 -04'00'

PROJECT#: ACE-2024-136
DWG/REV: RWD025, Rev A
SHT: 4 of 7

Technical drawing of a window frame cross-section, showing various components labeled with circled numbers:

- 4: Outer frame profile
- 9: Inner frame profile
- 11: Glass pane
- 12: Insulation layer
- 16: Drainage channel
- 18: Drainage pipe
- 20: Drainage pipe
- 24: Drainage pipe
- 38: Drainage pipe
- 39: Drainage pipe

Technical drawing of a window frame assembly in cross-section, showing two views. The top view shows a frame with a multi-paneled glass unit (6) and a seal (19). The bottom view shows a similar frame with a single-paneled glass unit (36) and a seal (19). Various components are labeled with numbers: 5, 7, 9, 19, and 36.

SUBSTRATE VARIES. SEE ANCHOR SCHEDULE ON SHEET 2 FOR REQUIREMENTS.
 HOOKSTRIP 2X BUCK INSTALLATION ANCHORS (SEE SHEET 2 FOR REQUIREMENTS. SEE SHEET 3 - ELEVATION FOR SPACING.)
 2X WOOD BUCK. SEE ANCHOR SCHEDULE ON SHEET 2 FOR REQUIREMENTS. 2X WOOD BUCK OPTIONAL IF STRUCTURAL WOOD SUBSTRATE IS PRESENT.
 MAX. SPACE
 STRIP
 HORS
 GERED
 ACING
 HOWN
 ELLOW.
 EDULE
 R FOR
 MENTS
 TYPE,
 EDGE
 ANCE.
 4
 49
 50
 52
 51
 18
 9
 QUANTITY: FIVE (5)
 SPACING: 6" FROM EACH END AND 21" THEREAFTER.
 QUANTITY: FIVE (6)
 SPACING: 4" FROM EACH END AND 17-5/8" THEREAFTER.
 HOOKSTRIP
 ANCHOR
 SPACING

**RENAISSANCE WINDOWS
AND DOORS
13340 INTERNATIONAL
PARKWAY
JACKSONVILLE, FL 32218**

SERIES 9500 VINYL POCKET SLIDING GLASS DOOR - PXXXXXP ANCHORAGE DETAILS			
NO.	REVISION DESCRIPTION	BY	DATE

DATE: 09/26/2024	DWN BY: RJA	CHK BY: n/a	SCALE: NONE
---------------------	----------------	----------------	----------------

ROBERT J. AMORUSO, P.E.
FL P.E. No. 49752
226 N NOVA RD, NO. 142,
ORMOND BEACH, FL 32174
RJAENGPE@GMAIL.COM



Digitally signed by
Robert J Amoruso[®]
Date: 2024.10.29
11:26:14 -04'00'



HORIZONTAL SECTION ABOVE SHOWS RIGHT EXTERIOR VIEW. LEFT OF ADAPTER IS MIRROR IMAGE.

PROJECT#: ACE-2024-136



DWG/REV: RWD025, Rev A

SHT: 5 of 7

POCKET DOOR
VERTICAL CROSS SECTIONS
AT POCKET OPENING
THROUGH-FRAME INSTALLATION

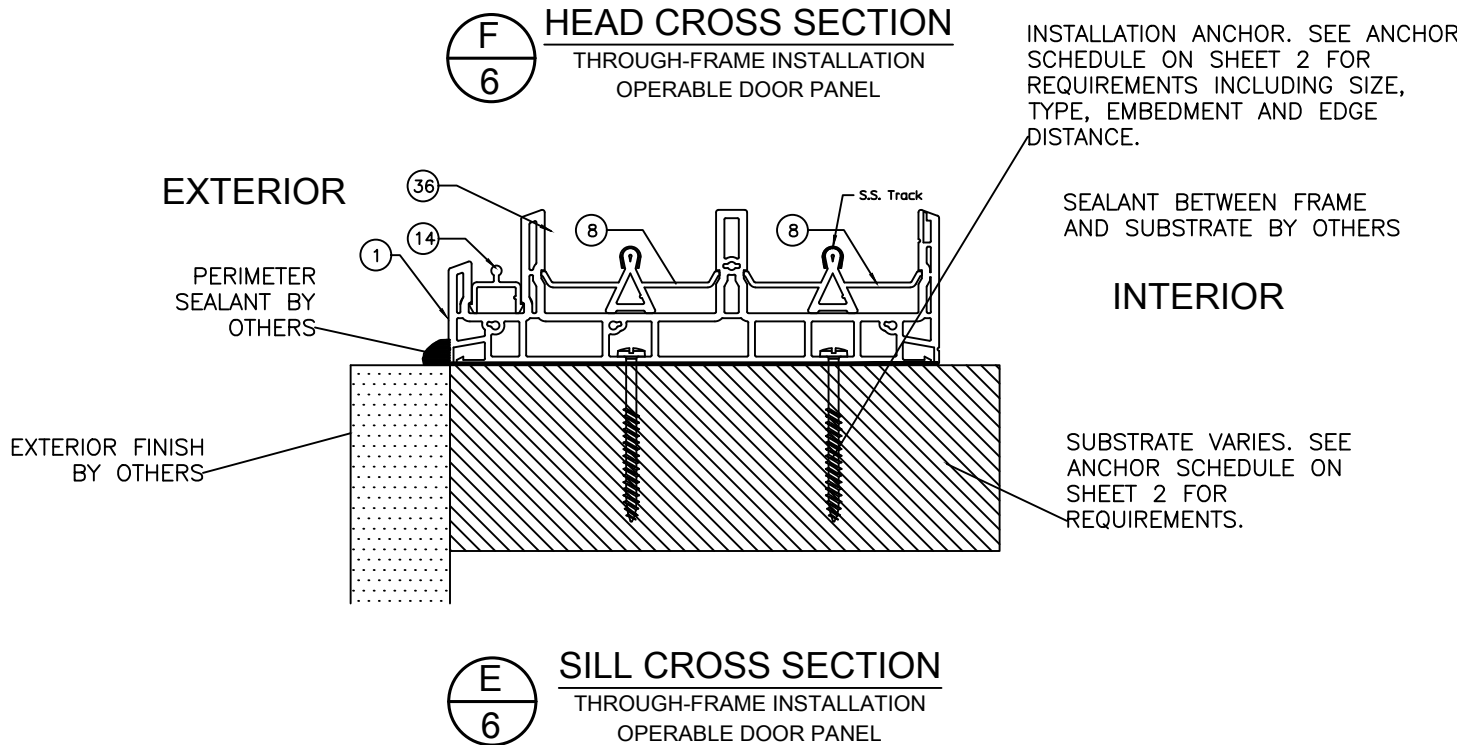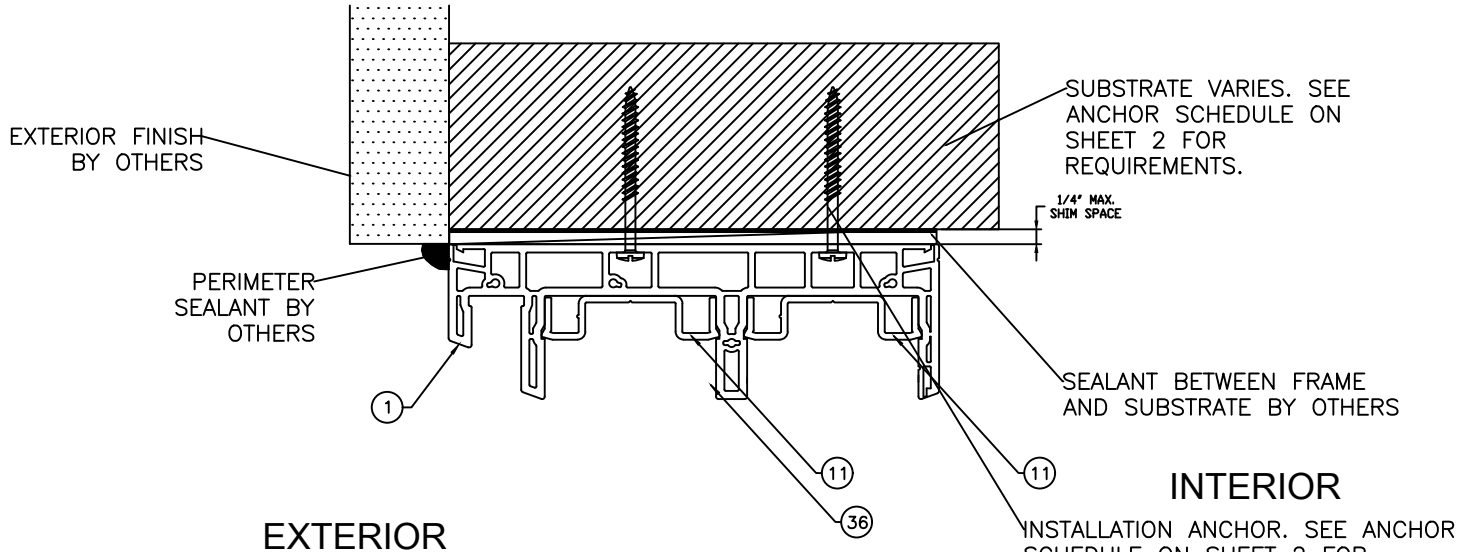

POCKET DOOR
HORIZONTAL CROSS SECTIONS
AT POCKET OPENING
THROUGH-FRAME INSTALLATION

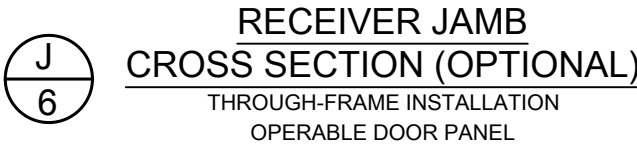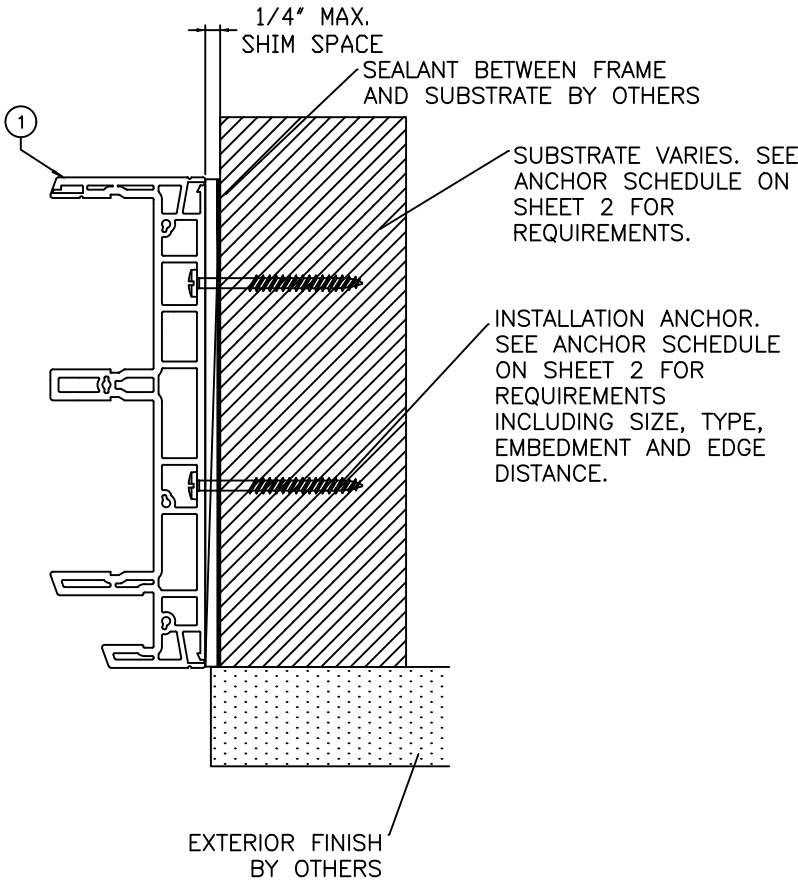

RENAISSANCE WINDOWS
AND DOORS
13340 INTERNATIONAL
PARKWAY
JACKSONVILLE, FL 32218

SERIES 9500 VINYL POCKET SLIDING GLASS DOOR - PXXXXP	REVISION DESCRIPTION	DATE			
		BY			
NO.					

DATE: 09/26/2024	DWN BY: RJA	CHK BY: n/a	SCALE: NONE
---------------------	----------------	----------------	----------------


ROBERT J. AMORUSO, P.E.
FL P.E. No. 49752
226 N NOVA RD, NO. 142,
ORMOND BEACH, FL 32174
RJAENGPE@GMAIL.COM



Digitally signed
by Robert J
Amoruso
Date: 2024.10.29
11:26:27 -04'00'

PROJECT#:	ACE-2024-136
DWG/REV:	RWD025, Rev A
SHT:	6 of 7

BILL OF MATERIALS				
BOMNO.	PARTNO.	PARTDESCRIPTION	COMPANY	REMARKS
VINYL COMPONENTS				
1	8591	FRAME	MIKRON IND. INC.	
2	8036	BRACKET	MIKRON IND. INC.	
3	8037	SCREEN ADAPTOR	MIKRON IND. INC.	
4	7701	PANEL STILE/RAIL	MIKRON IND. INC.	
5	7702	FIXED INTERLOCK PANEL INTERLOCK	MIKRON IND. INC.	
6	7703	PANEL INTERLOCK	MIKRON IND. INC.	
7	7704	INTERLOCK	MIKRON IND. INC.	
8	7705	PANEL TRACK	MIKRON IND. INC.	
9	7706	GLAZING BEAD	MIKRON IND. INC.	
11	7708	ANTI-LIFT	MIKRON IND. INC.	
12	7709	THRESHOLD	MIKRON IND. INC.	
13	6152	SETTING BLOCK	MIKRON IND. INC.	
14	7556	SCREEN TRACK	MIKRON IND. INC.	
16	7964	ADAPTER	MIKRON IND. INC.	
REINFORCEMENT				
18	7701.1.1	REINFORCEMENT - ALUMINUM	ONTARIO EXTRUSIONS	6063-T5
19	7703.1	REINFORCEMENT - ALUMINUM	ONTARIO EXTRUSIONS	6063-T5
20	7964.1.1	REINFORCEMENT - ALUMINUM	ONTARIO EXTRUSIONS	6063-T5
COMMERCIAL DOOR HANDLE SET				
24	6635-1038-01	COMMERCIAL DOOR HANDLE SET COMPRISED OF THE FOLLOWING	AMESBURY	WHITE
25	1988-PRN166MRSS	ROLLER	AMESBURY	
26	6541-1061	SINGLE POINT LOCK	AMESBURY	COMMERCIAL
27	6991-10XX	FACE PLATE	AMESBURY	
28	6635-10XX	INSIDE HANDLE	AMESBURY	C-SHAPE SOLID TUBE
29	6636-10XX	OUTSIDE HANDLE	AMESBURY	C-SHAPE SOLID TUBE
30	6000-074-01KD1	CYLINDER - MORTISE	AMESBURY	.800 CAM
31	6000-082-01	THUMBTURN - MORTISE	AMESBURY	.800 CAM
32	6990-10XX	STRIKE - COMMERCIAL	AMESBURY	COLLAPSIBLE
33		SCREW PACKAGE	AMESBURY	
GLAZING				
34		1" OVERLL THICKNESS IGU: 3/16" TEMPERED x AIR SPACE x 3/16" TEMPERED		
35		WET GLAZING COMPOUND		SILICONE
MISC.				
36		QUIET FIN WEATHERSTRIP	AMESBURY	.270 High x .187 Back
38	#8 X 1"	WASHER HEAD TEK SCREW - PHILLIPS		
39	#8 X 3"	PAN HEAD SCREW		
41	#10 X 1-1/2"	FLAT HEAD SCREW		
OPTIONAL LOCK & HANDLE SET - NOT SHOWN				
42	191014	SEMI 2 POINT MORTICE LOCK	INTERLOCK	
43	PS01-0031	MOUNTING PLATE ASSEMBLY	INTERLOCK	
44	PS01-3035	EXTENDED PINION GEAR	INTERLOCK	
45	PS01-0030	INTUITION HANDLE ASSEMBLY	INTERLOCK	
46	PS01-3040	EXTERIOR PULL	INTERLOCK	

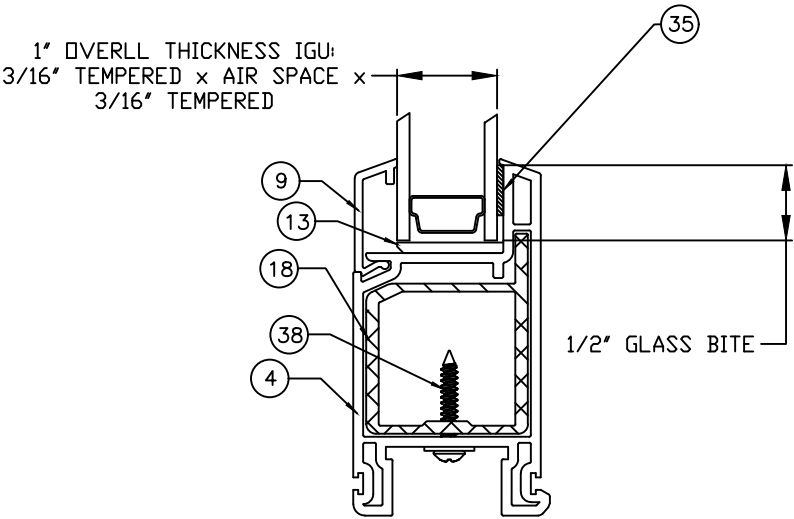

GLAZING DETAIL A

- NOTES:
- A MINIMUM OF TWO (2) NEOPRENE SETTING BLOCKS WITH 70 TO 90 SHORE A DUROMETER HARDNESS ARE REQUIRED AT BOTTOM (SILL) OF GLAZING LITES MORE THAN 3 FEET IN WIDTH.
 - FIXED PANEL RAIL SHOWN. ALL OTHER GLAZING DETAILS SAME FOR FIXED AND OPERABLE PANEL RAIL AND STILE GLAZING.

BILL OF MATERIALS				
BOMNO.	PARTNO.	PART DESCRIPTION	COMPANY	REMARKS
HOOK STRIP COMPONENTS				
49	W43361NV0000	QUIET FIN WEATHERSTRIP	AMESBURY	.360 High x .187 Back
50	8591.1	HOOK STRIP	MIKRON IND. INC.	ALUMINUM
51	8591.1.1	HOOK STRIP INTERLOCK	MIKRON IND. INC.	ALUMINUM
52	#8 X 1"	HOOK STRIP INTERLOCK/STILE SCREW/ WASHER HEAD TEK SCREW - PHILLIPS	---	SCREWS ARE SPACED 4" FROM END AND 12" ON CENTER

RENAISSANCE WINDOWS
AND DOORS
13340 INTERNATIONAL
PARKWAY
JACKSONVILLE, FL 32218

SERIES 9500 VINYL POCKET SLIDING GLASS DOOR - PXXXXP
ANCHORAGE DETAILS

DATE				
BY				
REVISION DESCRIPTION				
NO.				

DATE: 09/26/2024
DWN BY: RJA
CHK BY: n/a
SCALE: NONE

ROBERT J. AMORUSO, P.E.
FL P.E. No. 49752
226 N NOVA RD, NO. 142,
ORMOND BEACH, FL 32174
RJAENGPE@GMAIL.COM

Robert J. Amoruso
Professional Engineer
State of Florida
License No. 49752

Digitally signed by
Robert J Amoruso®
Date: 2024.10.29
11:26:40 -04'00'

PROJECT#: ACE-2024-136
DWG/REV: RWD025, Rev A
SHT: 7 of 7