




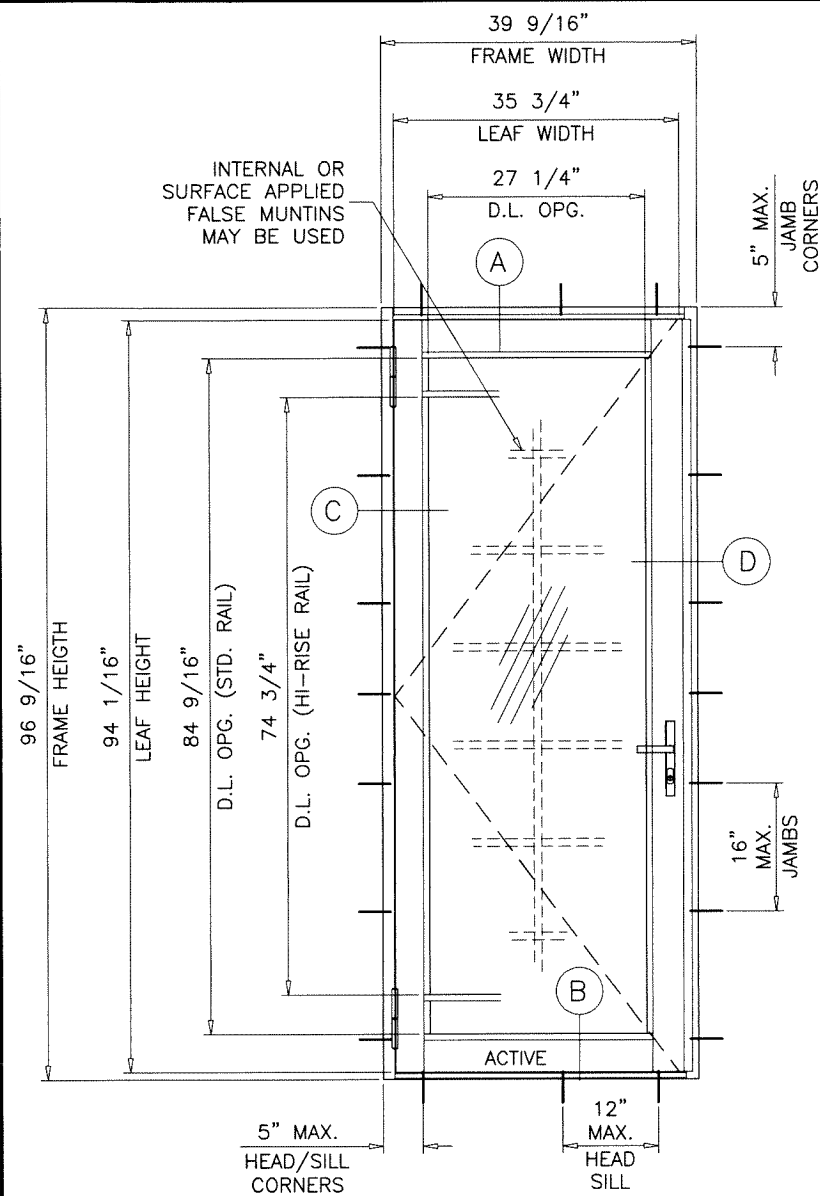

STD. SILL
TYPICAL ELEVATION
(X)

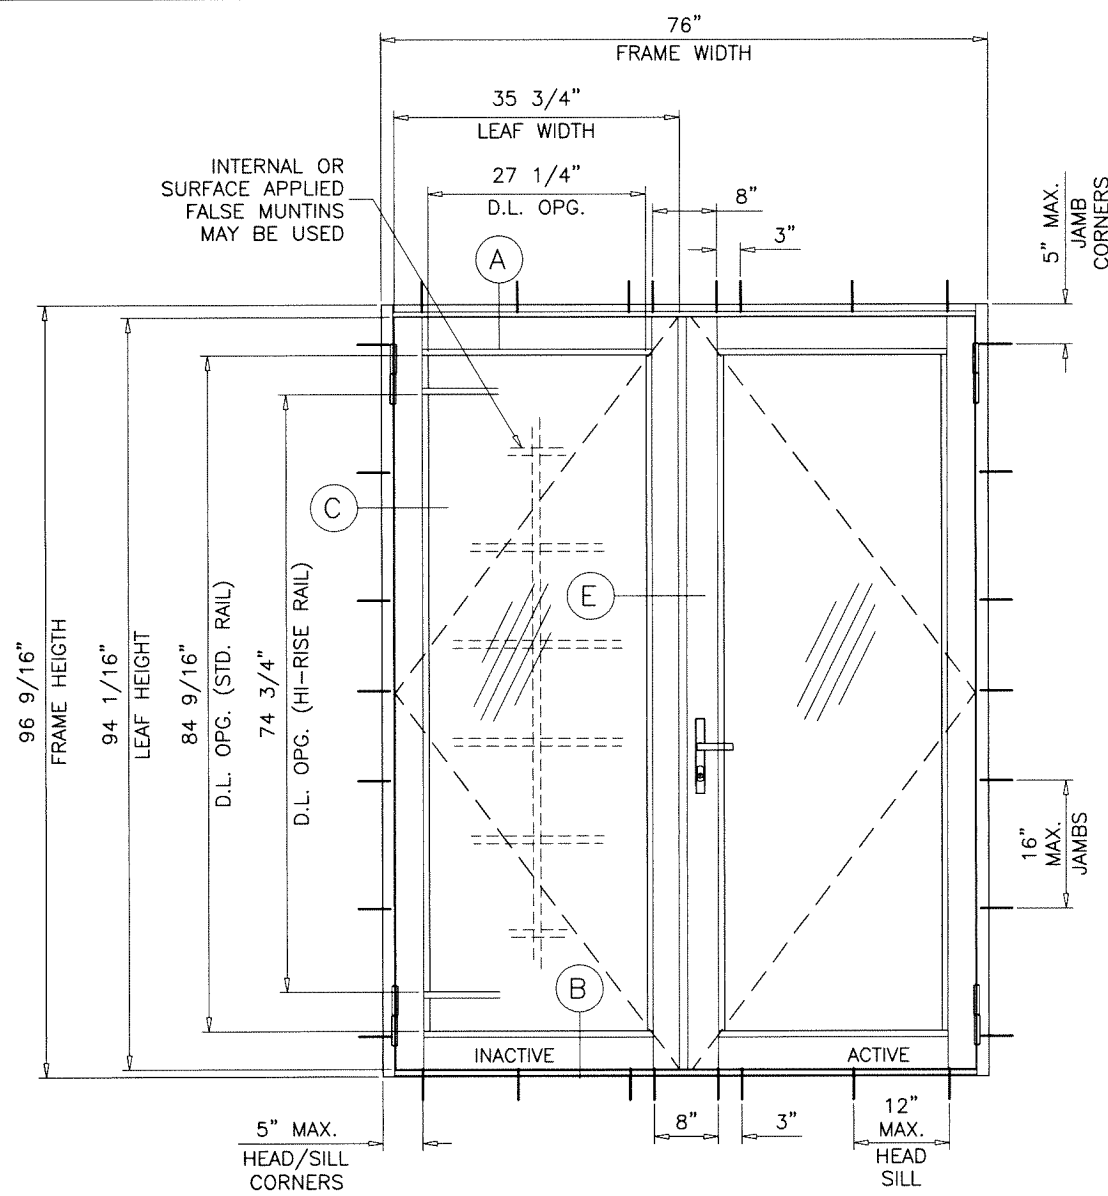

STD. SILL
TYPICAL ELEVATION
(XX)

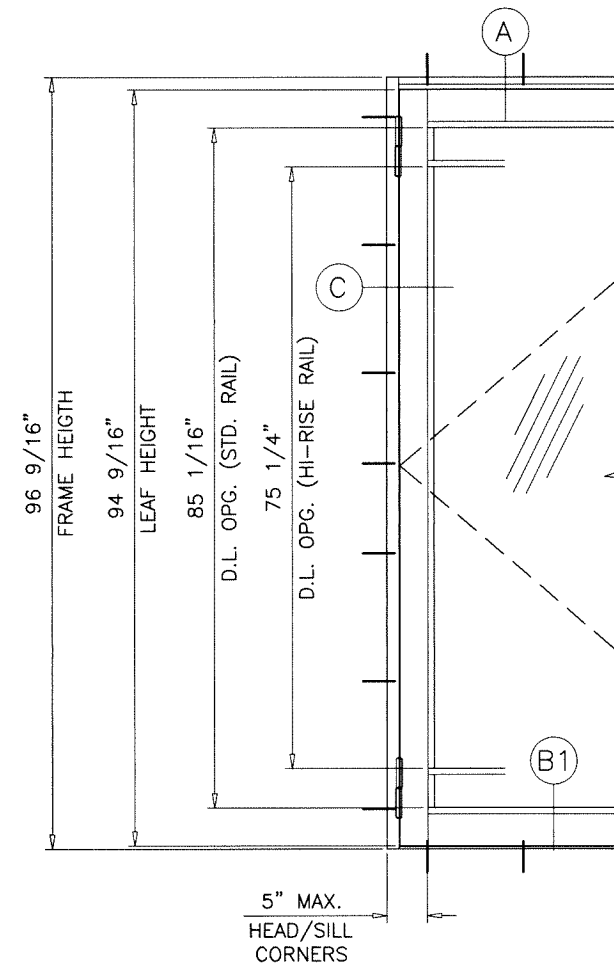

SINGLE OR DOUBLE DOORS
WITH ADA SILL

SINGLE DOORS (X) LOAD CAPACITY - PSF											
GLASS TYPES 'A' & 'Ai'											
FRAME WIDTH	LEAF WIDTH	FRAME HEIGHTS									
		80"		84"		88"		92"		96-9/16"	
		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
24"	21-3/4"	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0
30"	27-3/4"	100.0	100.0	100.0	100.0	100.0	100.0	99.7	100.0	95.0	100.0
32"	29-3/4"	100.0	100.0	100.0	100.0	97.7	100.0	93.5	99.7	89.1	95.0
36"	33-3/4"	95.5	100.0	91.0	82.8	86.9	92.5	83.1	88.6	79.1	84.4
39-9/16"	35-3/4"	86.9	92.7	82.8	88.3	79.0	84.3	75.6	80.6	75.0	80.0
		78-1/16"		82-1/16"		86-1/16"		90-1/16"		94-1/16"	
		78-9/16"		82-9/16"		86-9/16"		90-9/16"		94-9/16"	


DOUBLE DOORS (XX) LOAD CAPACITY – PSF											
GLASS TYPES 'A' & 'Ai'											
FRAME WIDTH	LEAF WIDTH	FRAME HEIGHTS									
		80"		84"		88"		92"		96–9/16"	
		EXT.(+)	INT.(–)	EXT.(+)	INT.(–)	EXT.(+)	INT.(–)	EXT.(+)	INT.(–)	EXT.(+)	INT.(–)
48"	21–3/4"	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0
60"	27–3/4"	100.0	100.0	100.0	100.0	100.0	100.0	99.7	100.0	95.0	100.0
64"	29–3/4"	100.0	100.0	100.0	100.0	97.7	100.0	93.5	99.7	89.1	95.0
72"	33–3/4"	95.5	100.0	91.0	97.6	86.9	92.5	83.1	88.6	79.1	84.4
76"	35–3/4"	90.5	96.5	86.2	91.9	82.2	87.8	78.7	83.9	75.0	80.0
L	LEAF	78–1/16"		82–1/16"		86–1/16"		90–1/16"		94–1/16"	
		78–9/16"		82–9/16"		86–9/16"		90–9/16"		94–9/16"	

DOOR D.L.O. FORMULAE:
D.L.O. WIDTH = FRAME WIDTH - 12.3125" (X DOORS)
= (FRAME WIDTH - 21.50")/2 (XX DOORS)
D.L.O. HEIGHT = FRAME HEIGHT - 12.0" (STD. BOT. RAIL) (STD. SILL)
= FRAME HEIGHT - 16.875" (HI-RISE BOT. RAIL) (STD. SILL)
D.L.O. HEIGHT = FRAME HEIGHT - 11.50" (STD. BOT. RAIL) (ADA SILL)
= FRAME HEIGHT - 16.375" (HI-RISE BOT. RAIL) (ADA SILL)

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

Sealed: 10/5/2023

FL #39596

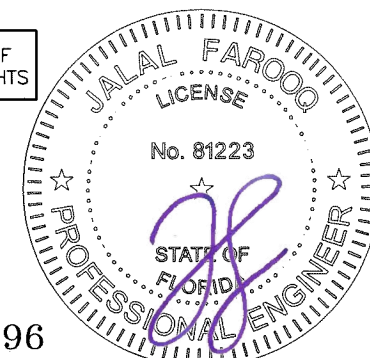


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)


SERIES 2100 ALUMINUM OUTSWING DOOR (N.I.)
Lawson Industries Inc.
8501 N.W. 90th Street
Medley, FL. 33166
Tel. (305) 696-8660 FAX.

revisions:	no	date	by	description
date:	04-08-21	scale:	1/2"=1'-0"	
dr. by:	TARIQ	chk. by:		
drawing no.	21-32F			
sheet	2 of 14			

COMP-ANL\21-32F-LI

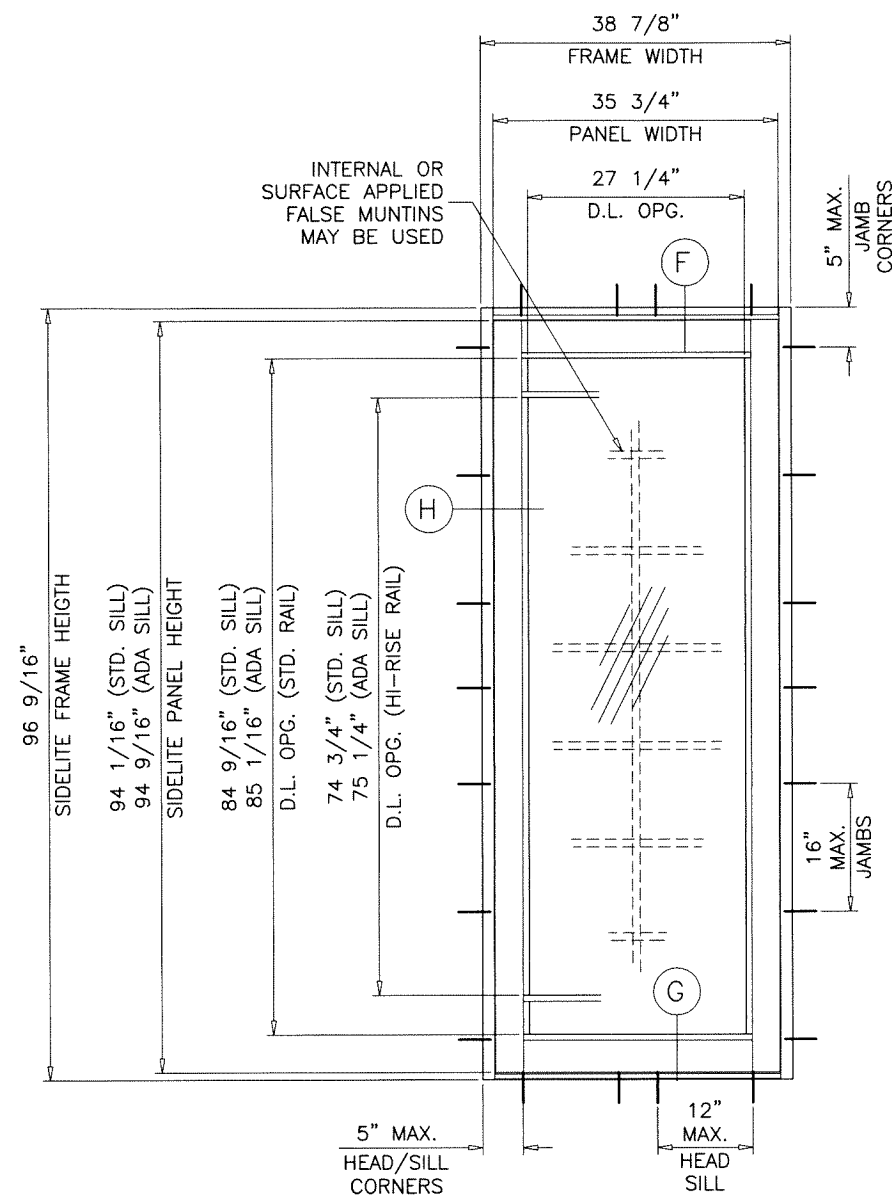

TYPICAL ELEVATION
(O)

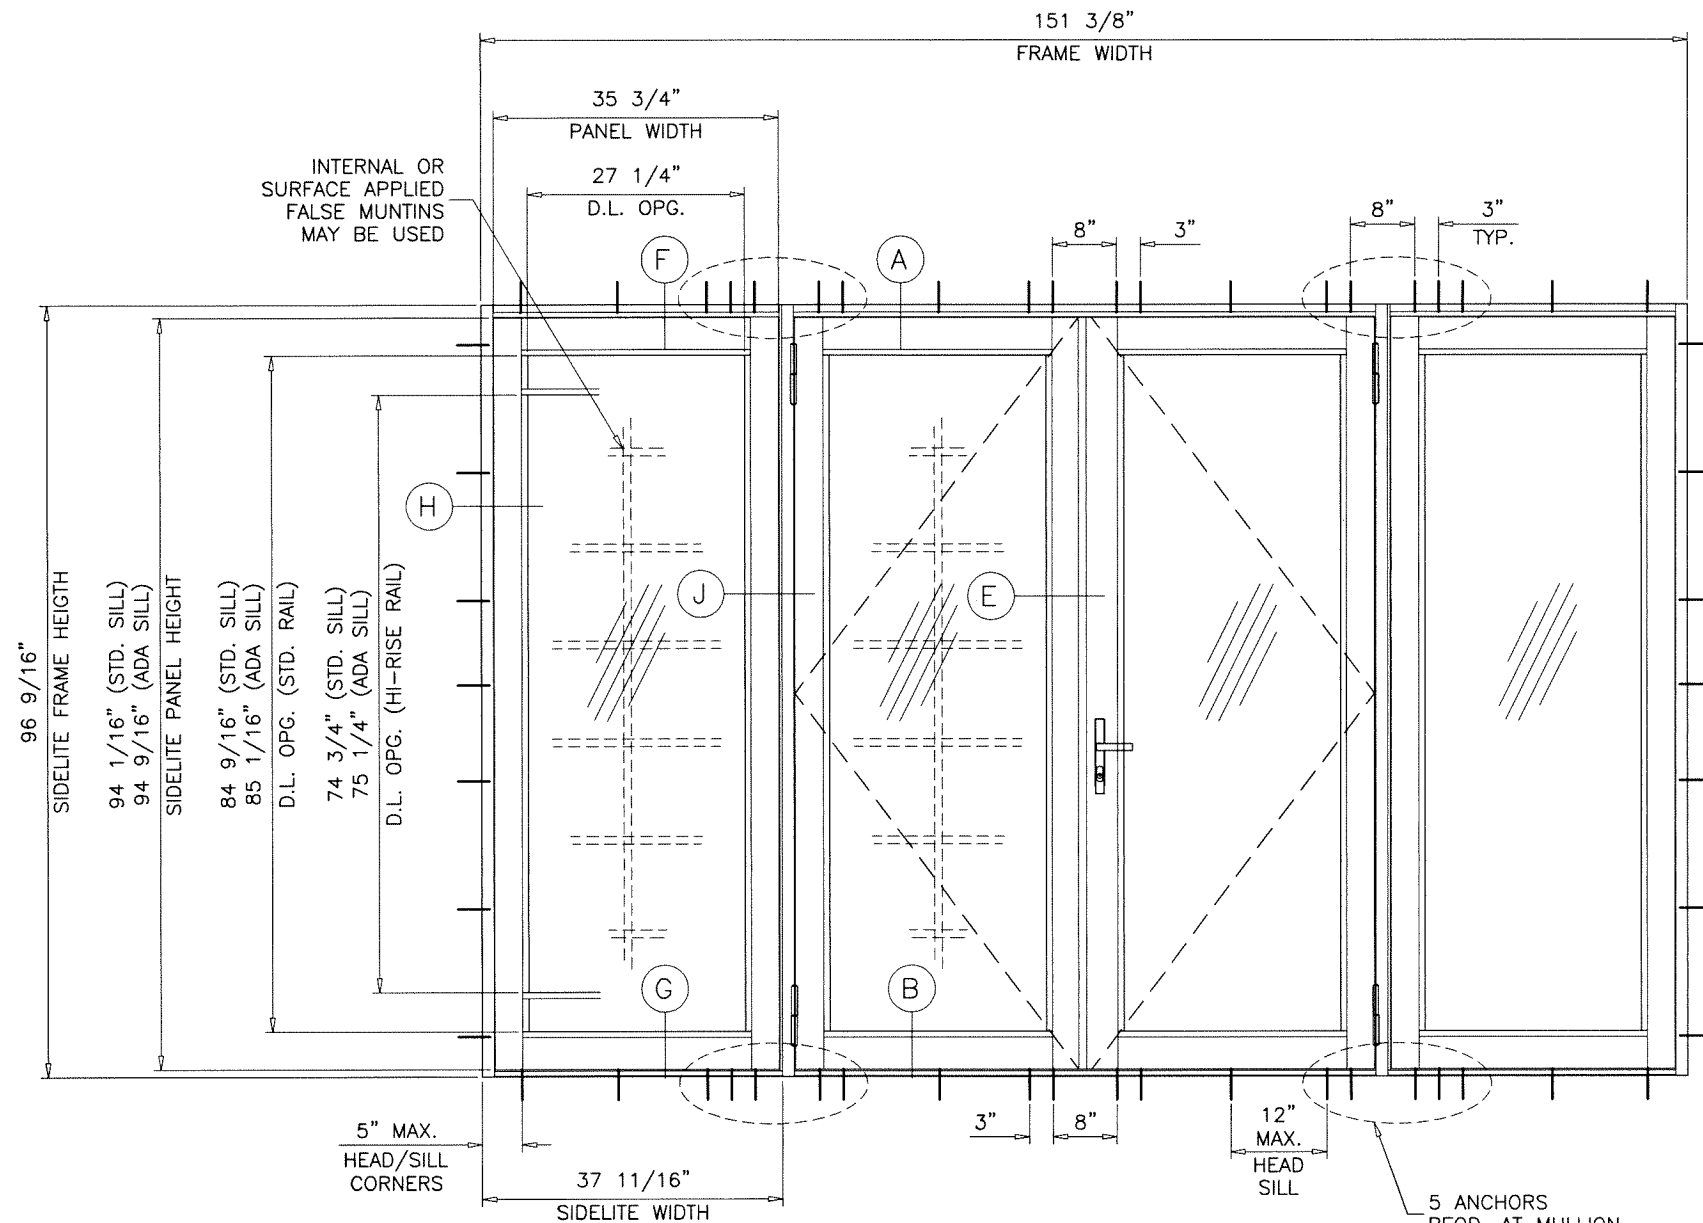


TYPICAL ELEVATION
(O-XX-O)

SIDELITE OR STAND ALONE STATIONARY PANEL (O) LOAD CAPACITY - PSF											
GLASS TYPES 'A' & 'Ai'											
FRAME WIDTH	PANEL WIDTH	FRAME HEIGHTS									
		80"		84"		88"		92"		96-9/16"	
		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
24"	21-3/4"	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0
30"	27-3/4"	100.0	100.0	100.0	100.0	100.0	100.0	99.7	100.0	95.0	100.0
32"	29-3/4"	100.0	100.0	100.0	100.0	97.7	100.0	93.5	99.7	89.1	95.0
36"	33-3/4"	95.5	100.0	91.0	82.8	86.9	92.5	83.1	88.6	79.1	84.4
38-7/8"	35-3/4"	86.9	92.7	82.8	88.3	79.0	84.3	75.6	80.6	75.0	80.0
	78-1/16"			82-1/16"		86-1/16"		90-1/16"		94-1/16"	
	78-9/16"			82-9/16"		86-9/16"		90-9/16"		94-9/16"	
										STD. SILL	PANEL HEIGHTS
										ADA SILL	

SIDELITE D.L.O. FORMULAE:
D.L.O. WIDTH = FRAME WIDTH - 11.625"
D.L.O. HEIGHT = FRAME HEIGHT - 12.0" (STD. BOT. RAIL) (STD. SILL)
= FRAME HEIGHT - 16.875" (HI-RISE BOT. RAIL) (STD. SILL)
D.L.O. HEIGHT = FRAME HEIGHT - 11.5" (STD. BOT. RAIL) (ADA SILL)
= FRAME HEIGHT - 16.375" (HI-RISE BOT. RAIL) (ADA SILL)

Sealed: 10/5/2023

FL #39596

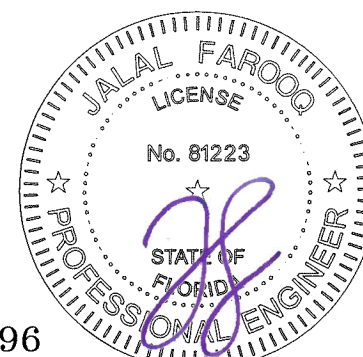

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\21-32F-LI

SERIES 2100 ALUMINUM OUTSWING DOOR (N.I.)

Lawson Industries Inc.
8501 N.W. 90th Street
Medley, FL. 33166
Tel. (305) 696-8660 FAX.

revisions:

no	date	description

date: 04-08-21

scale: 1/2" = 1'-0"

dr. by: TARIQ

chk. by:


drawing no.

21-32F

sheet 3 of 14




NOTE:
THE FRAME AREA OF ALTERNATE SIZE MUST NOT
EXCEED TESTED FRAME AREA = 160.2 SQ. FT.

DESIGN LOAD CAPACITY - PSF DOOR TO SIDELITE MULLION							
SIDELITE WIDTH INCHES	FRAME HEIGHT INCHES	MULL 'M1'		MULL 'M2'		MULL 'M3'	
		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
24	80-9/16	89.8	89.8	100.0	100.0	100.0	100.0
30		82.1	82.1	100.0	100.0	100.0	100.0
36		75.6	75.6	100.0	100.0	100.0	100.0
42		70.0	70.0	100.0	100.0	100.0	100.0
47-11/16		65.4	65.4	100.0	100.0	100.0	100.0
24	84	79.3	79.3	100.0	100.0	100.0	100.0
30		72.4	72.4	100.0	100.0	100.0	100.0
36		66.7	66.7	100.0	100.0	100.0	100.0
42		61.8	61.8	100.0	100.0	100.0	100.0
47-11/16		57.7	57.7	94.3	94.3	100.0	100.0
24	90	64.4	64.4	100.0	100.0	100.0	100.0
30		58.9	58.9	96.1	96.1	100.0	100.0
36		54.2	54.2	88.5	88.5	100.0	100.0
42		50.2	50.2	82.0	82.0	100.0	100.0
47-11/16		-	-	76.7	76.7	100.0	100.0
24	96-9/16	52.2	52.2	85.2	85.2	100.0	100.0
30		47.7	47.7	77.8	77.8	100.0	100.0
36		43.9	43.9	71.7	71.7	100.0	100.0
37-11/16		42.9	42.9	70.1	70.1	75.0	80.0

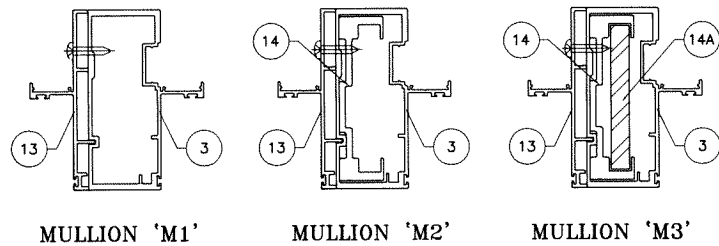


DOOR TO SIDELITE MULLION

NOTE:
FOR DOORS CAPACITY SEE SHEET 2
FOR SIDELITE CAPACITIES SEE SHEET 3.
FOR SIDELITE MULLION CAPACITY SEE CHART ABOVE
LOWER VALUES FROM DOORS, SIDELITE, DOOR/SIDELITE
OR DOOR/DOOR MULLION CHART WILL APPLY TO ENTIRE SYSTEM.

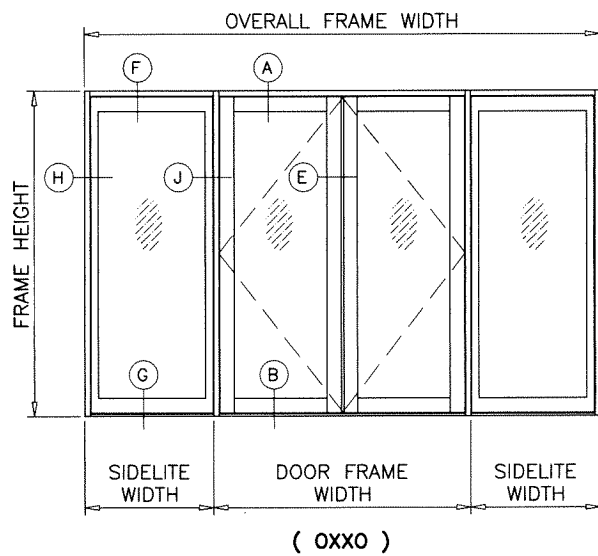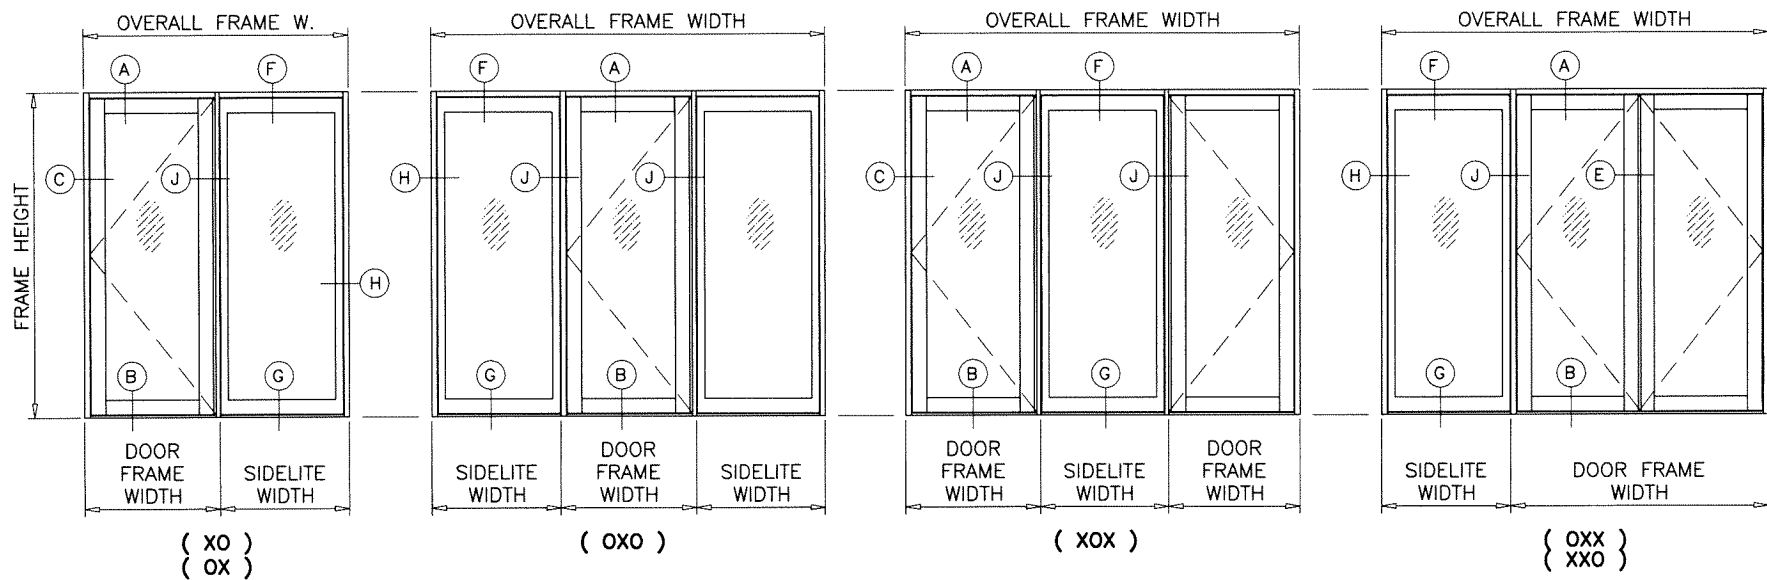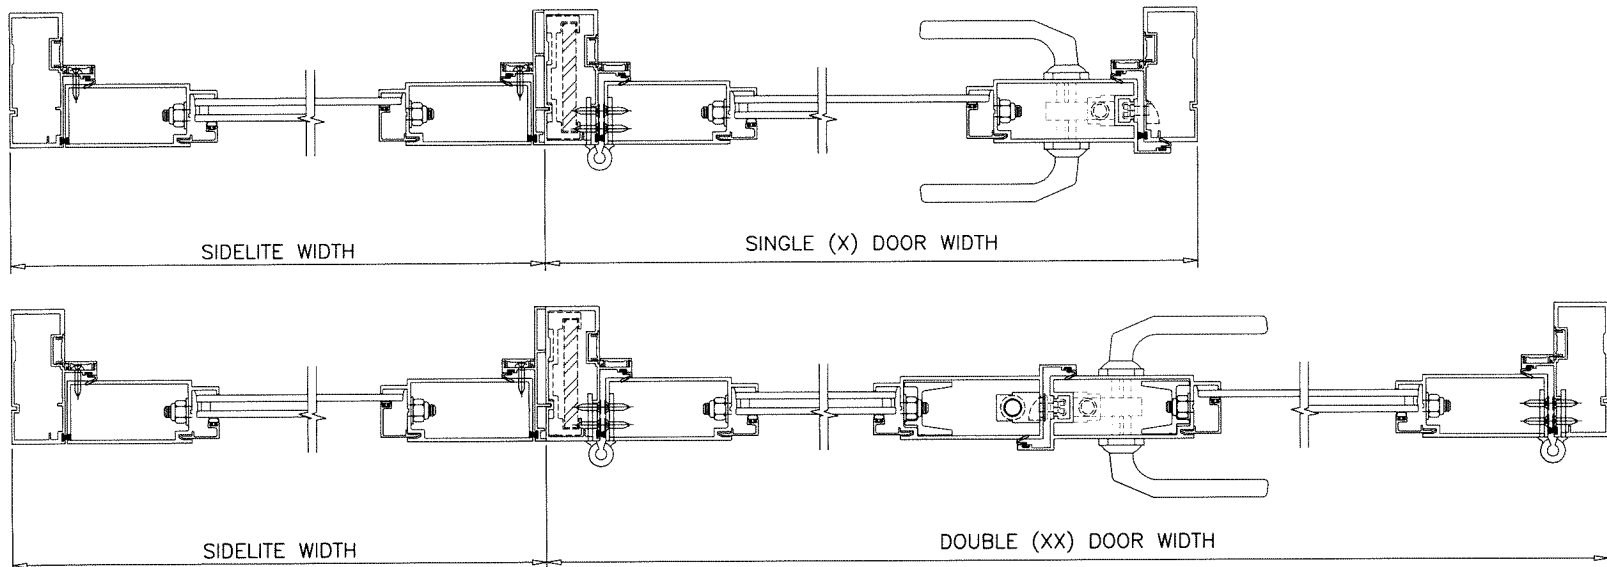

APPROVED CONFIGURATIONS

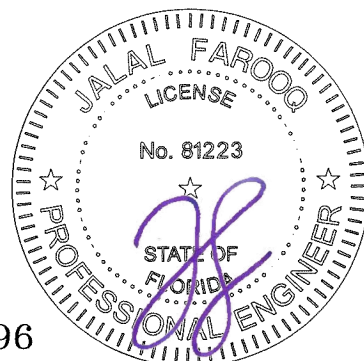

Sealed: 10/5/2023

FL #39596

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\21-32F-LI

SERIES 2100 ALUMINUM OUTSWING DOOR (N.I.)

Lawson Industries Inc.
8501 N.W. 90th Street
Medley, FL. 33166
Tel. (305) 696-8660 FAX.

revisions:

no	date	by	description

date: 04-08-21


scale: -

dr. by: TARIQ

chk. by:


drawing no.
21-32F

sheet 4 of 14

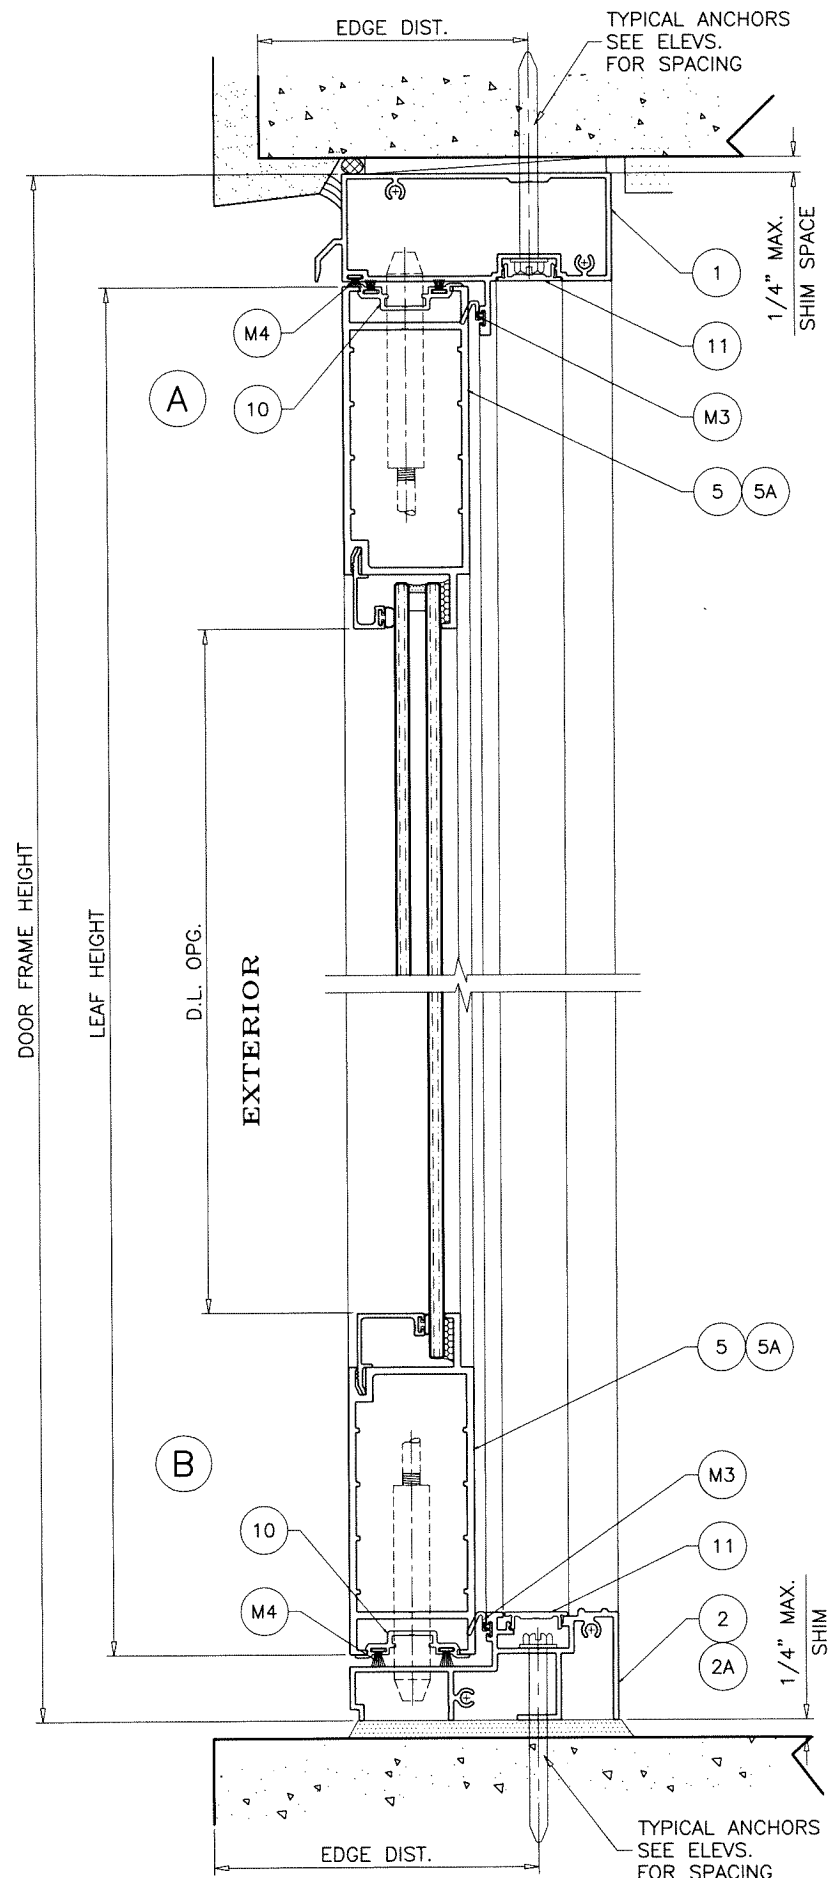

STD. THRESHOLD

APPROVED FOR WATER INFILTRATION RESISTANCE
LIMIT EXT.(+) LOADS TO 75.0 PSF MAX.

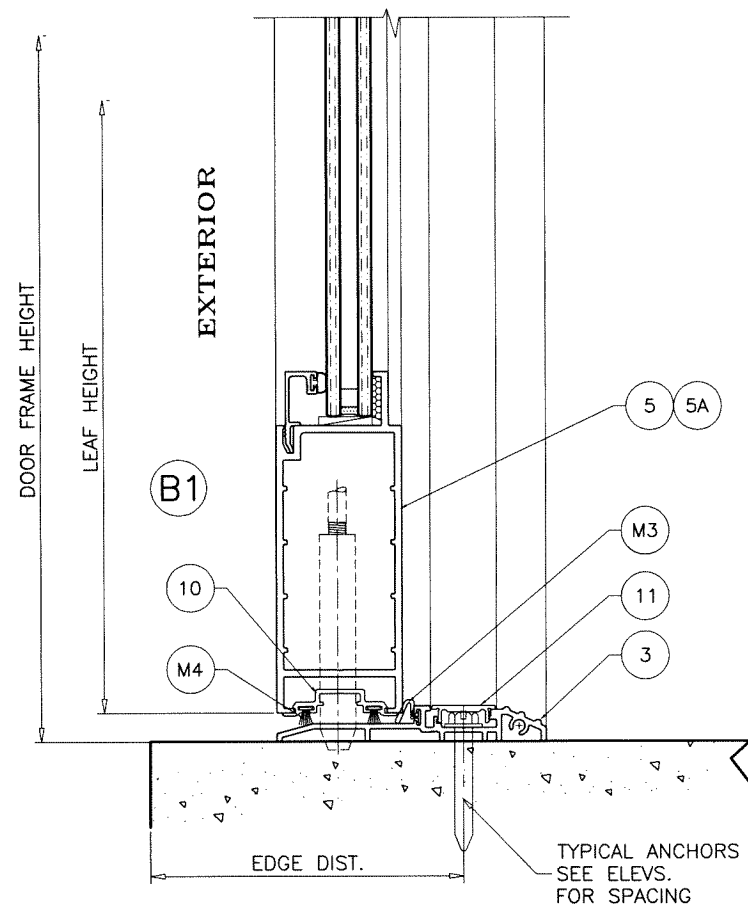


ADA THRESHOLD

NOT APPROVED FOR WATER INFILTRATION RESISTANCE

Sealed: 10/5/2023

FL #39596

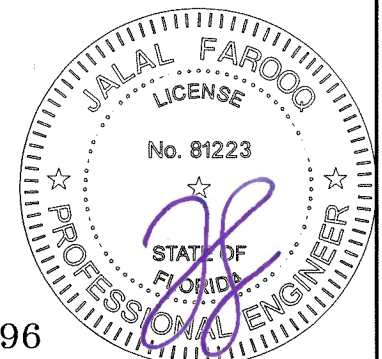

DOOR DETAILS

SERIES 2100 ALUMINUM OUTSWING DOOR (N.I.)

Lawson Industries Inc.

8501 N.W. 90th Street

Medley, FL. 33166

FAX.

Tel. (305) 696-8660

revisions:

no date by description

date: 04-08-21

scale: 3/8" = 1"

dr. by: TARIQ

chk. by:





drawing no.

21-32F

sheet 5 of 14

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

COMP-ANL\21-32F-LI

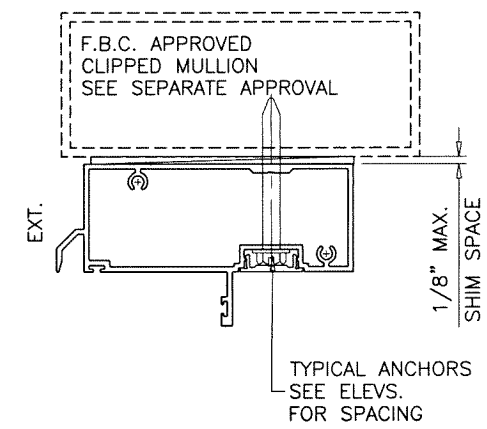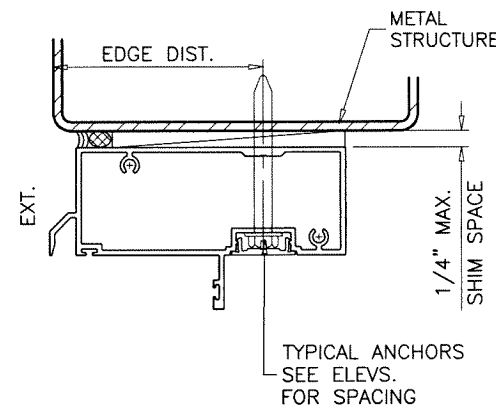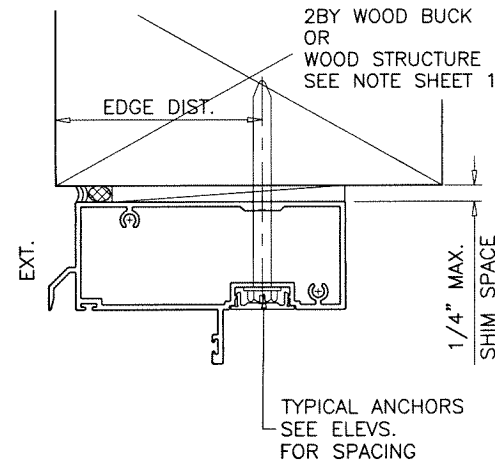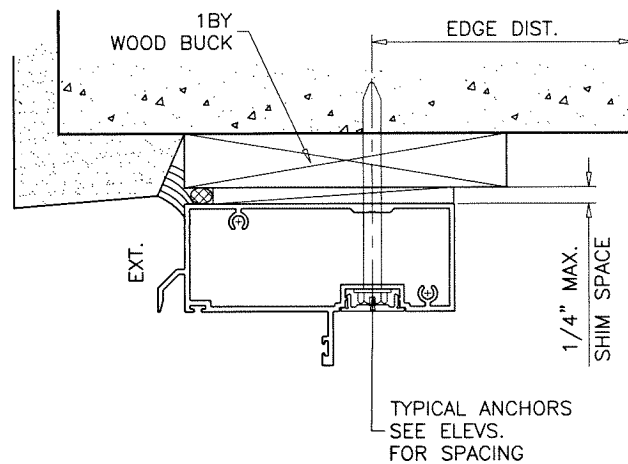

WOOD BUCKS AND METAL STRUCTURE NOT BY 'LAWSON IND.'
MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM
AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD (HEAD/JAMBS)

THRU 1BY BUCKS INTO CONC. OR BLOCKS
1-3/4" MIN. EMBED INTO CONCRETE (HEAD/JAMBS)
1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)

DIRECTLY INTO CONCRETE OR GROUT FILLED BLOCKS
1-3/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
1-3/4" MIN. EMBED INTO GROUT-FILLED BLOCKS (JAMBS)

1/4" DIA. TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)


INTO F.B.C. APPROVED MULLIONS
OR
INTO METAL STRUCTURES (HEAD/JAMBS)
(3) THREADS MIN. PENETRATION BEYOND SUBSTRATE
ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 2-1/2" MIN.
INTO WOOD STRUCTURE = 1" MIN.
INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD OR JAMBS SG = 0.55 MIN.
CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
C-90 GROUT FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

Sealed: 10/5/2023

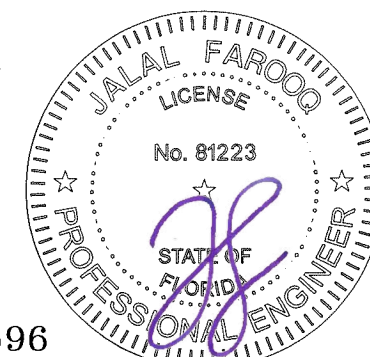

FL #39596

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\21-32F-LJ


SERIES 2100 ALUMINUM OUTSWING DOOR (N.I.)

Lawson Industries Inc.
8501 N.W. 90th Street
Medley, FL. 33166
Tel. (305) 696-8660 FAX.


revisions:		no	date	by	description

date: 04-08-21
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
21-32F
sheet 6 of 14

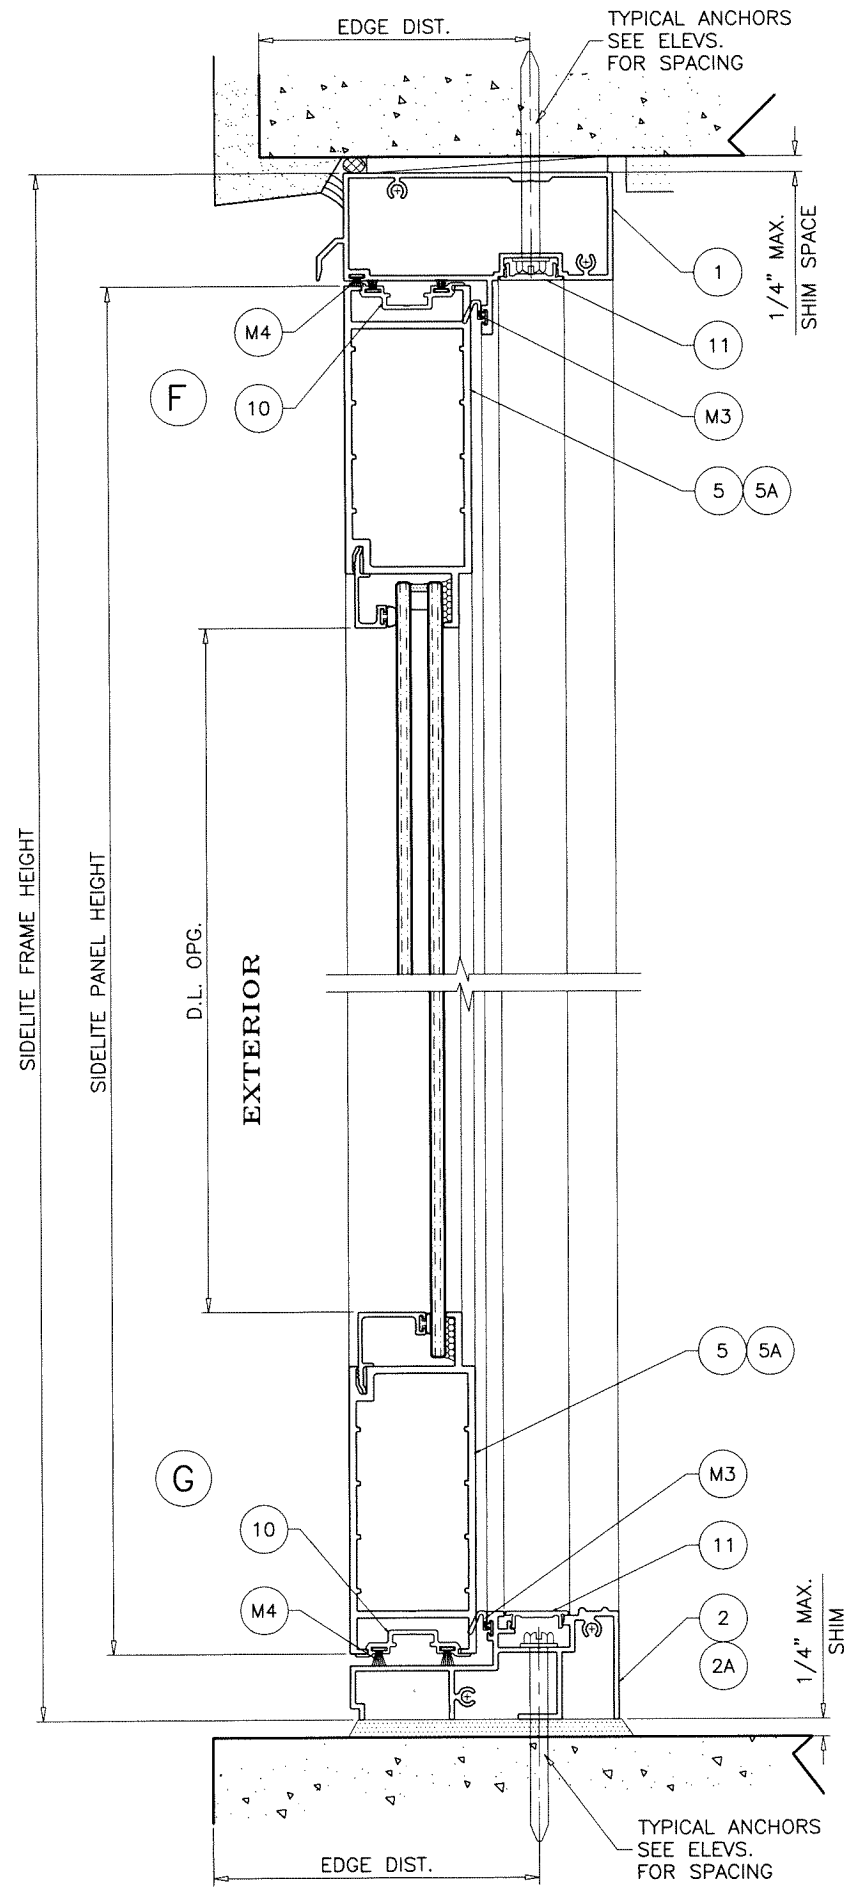


STD. THRESHOLD
APPROVED FOR WATER INFILTRATION RESISTANCE

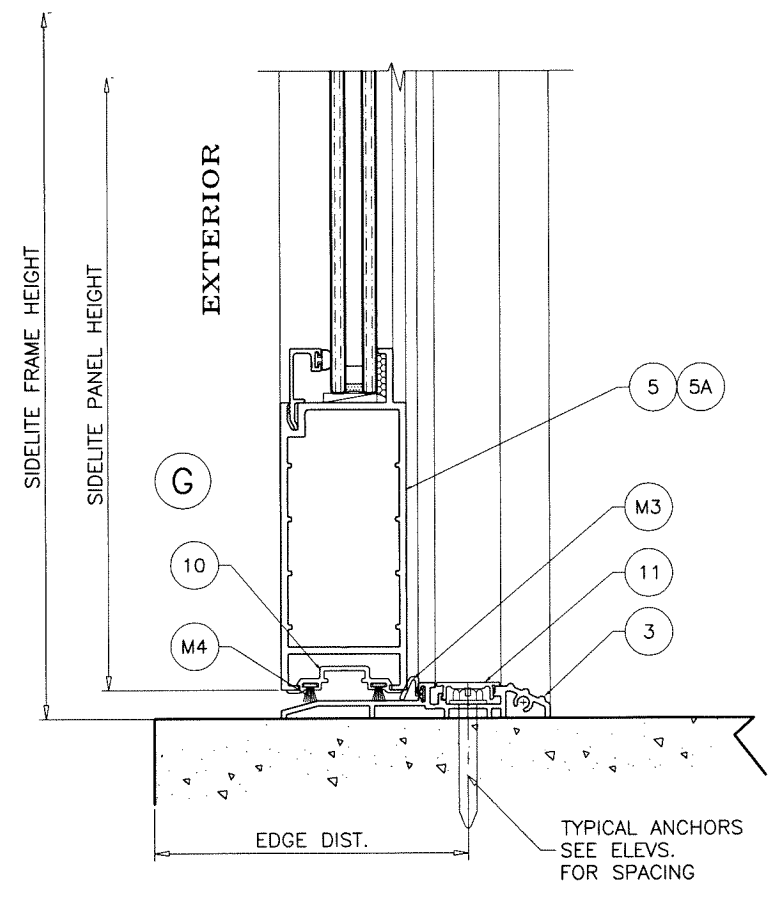

ADA THRESHOLD
NOT APPROVED FOR WATER INFILTRATION RESISTANCE


Sealed: 10/5/2023

FL #39596

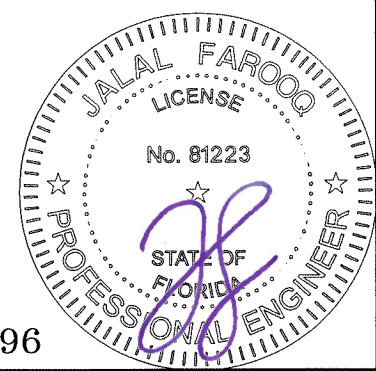


SIDELITE DETAILS

AL-FAROOQ CORPORATION ENGINEERS & PRODUCT DEVELOPMENT 9360 SUNSET DRIVE, SUITE 220 MIAMI, FLORIDA 33173 TEL. (305) 264-8100 FAX. (305) 262-6978 COMP-ANL\21-32F-LI	
SERIES 2100 ALUMINUM OUTSWING DOOR (N.I.) Lawson Industries Inc. 8501 N.W. 90th Street Medley, FL. 33166 Tel. (305) 696-8660 FAX.	
revisions: no. date by description	drawing no. 21-32F sheet 9 of 14
date: 04-08-21 scale: 3/8" = 1" dr. by: TARIQ chk. by:	

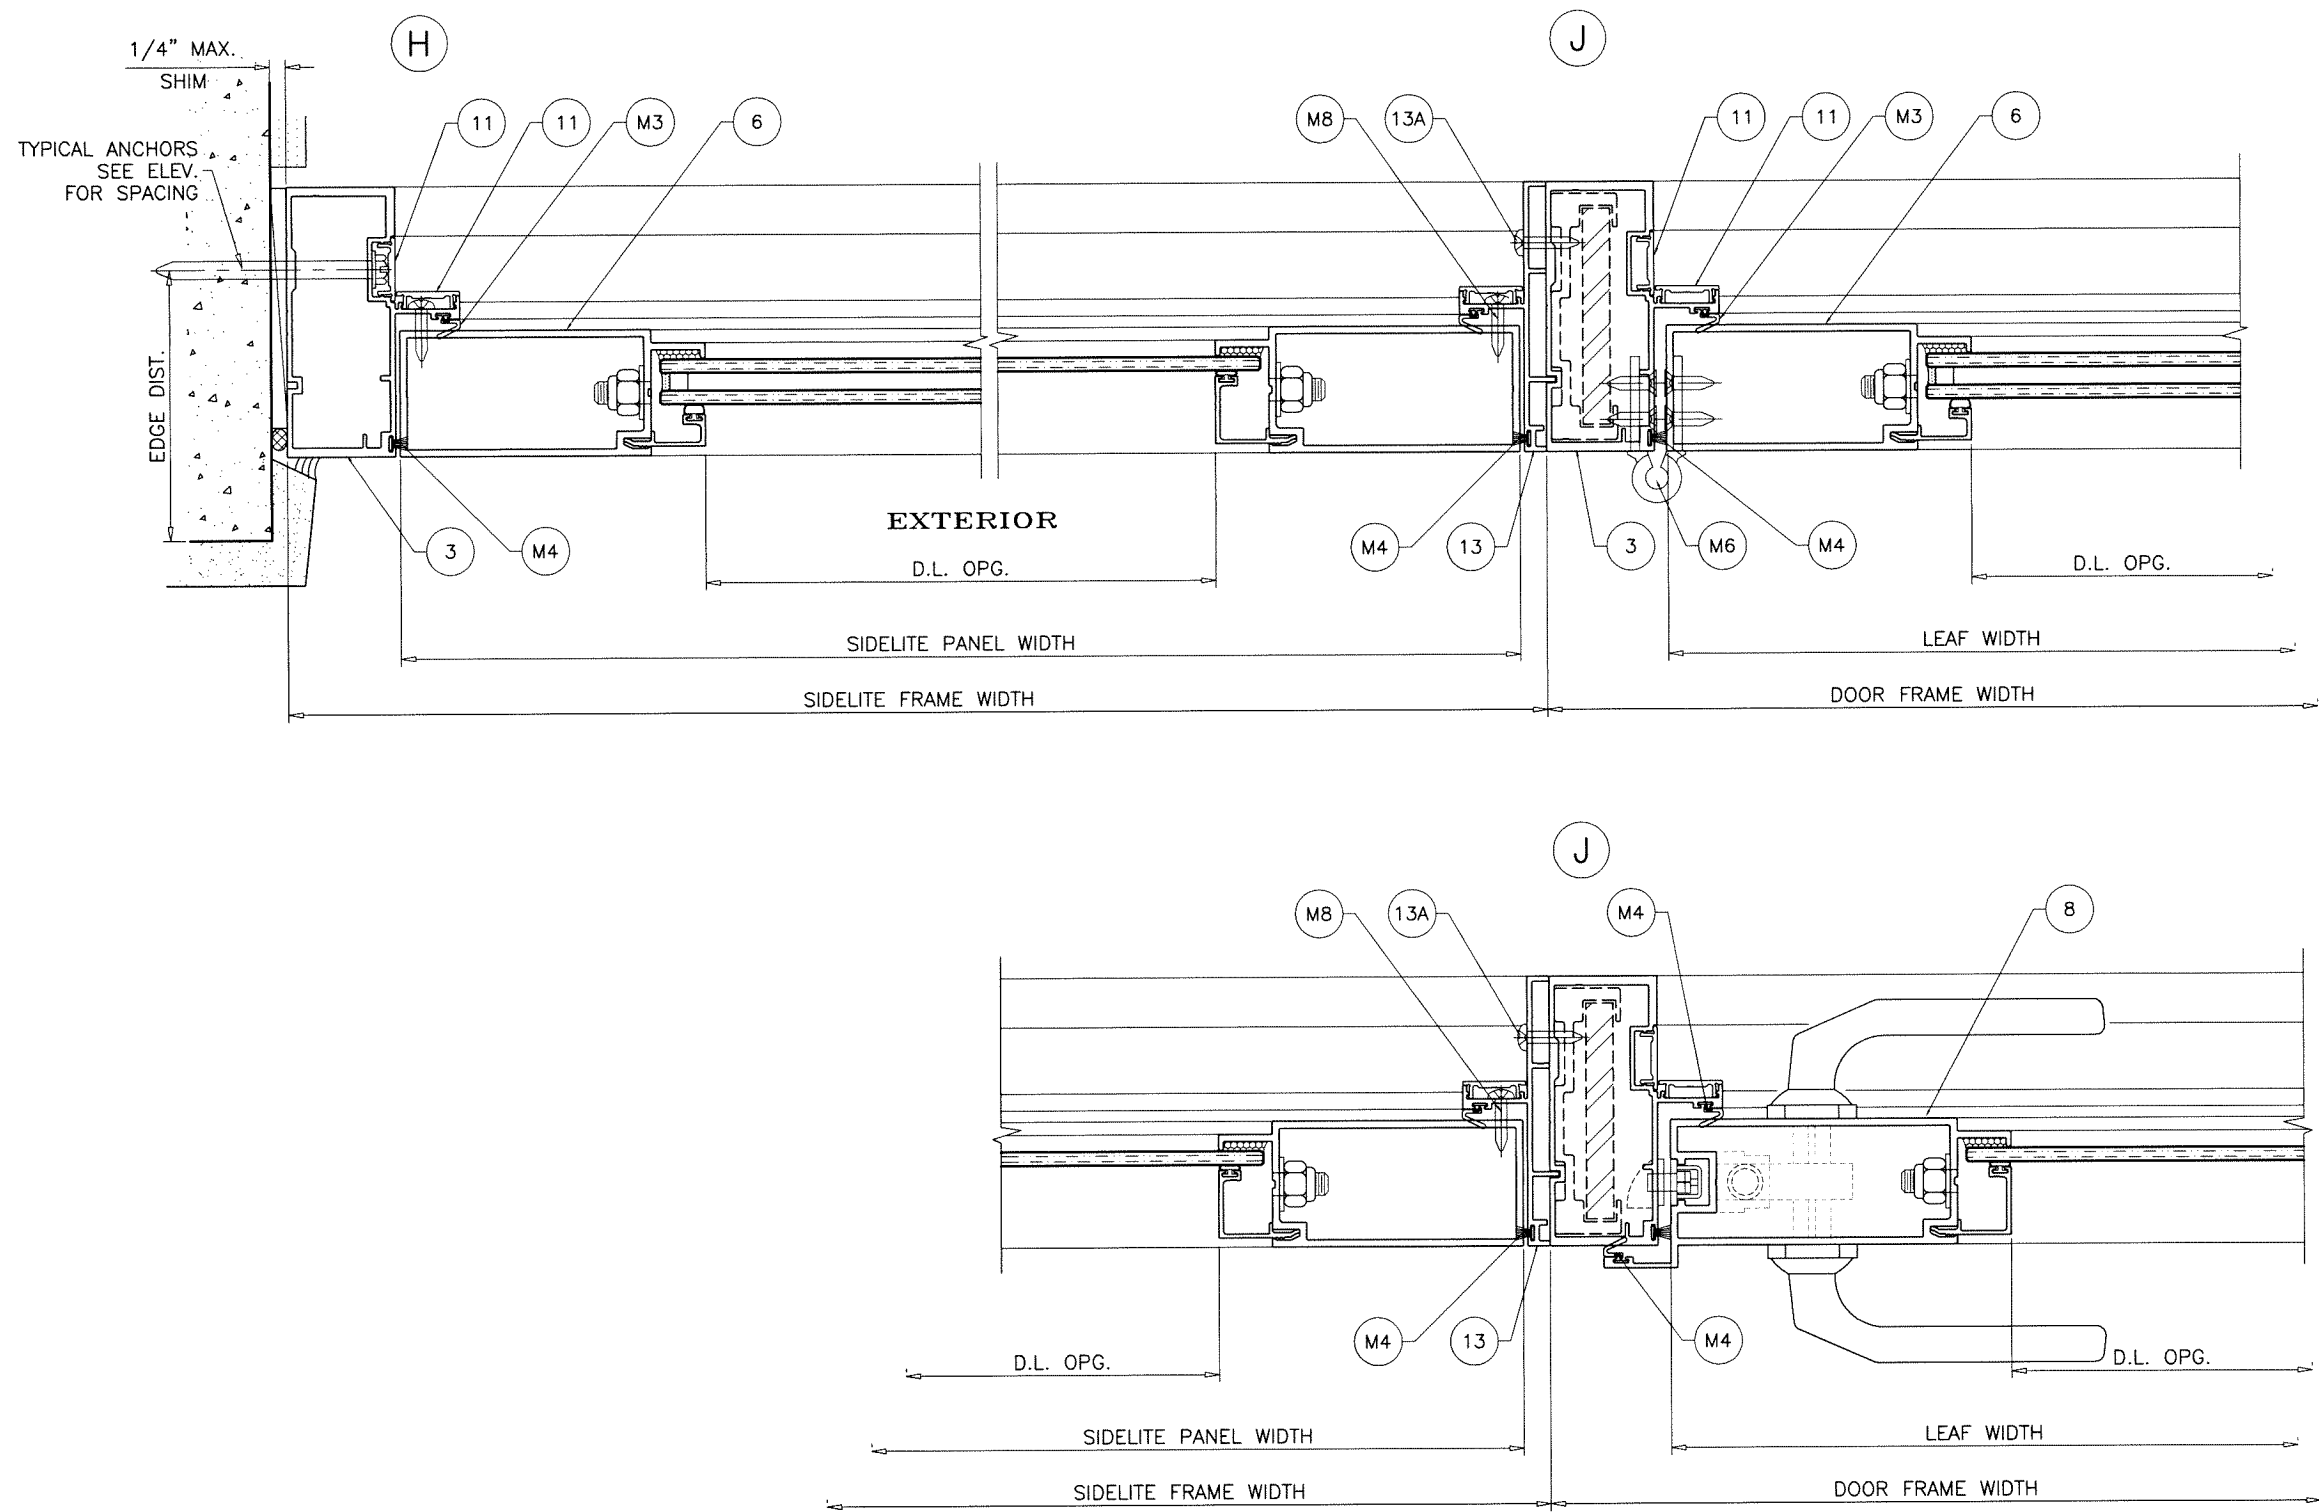

SIDELITE DETAILS

Sealed: 10/5/2023

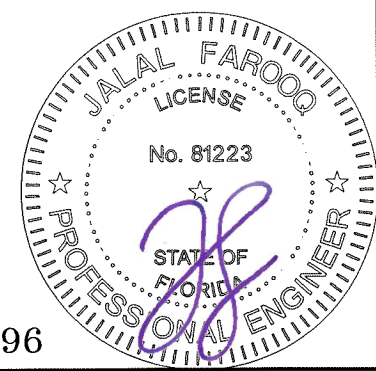

FL #39596

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\21-32F-LJ

SERIES 2100 ALUMINUM OUTSWING DOOR (N.I.)

Lawson Industries Inc.
8501 N.W. 90th Street
Medley, FL. 33166
Tel. (305) 696-8660 FAX.

revisions:	
no	date

date: 04-08-21
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
21-32F
sheet 10 of 14

OPTION #4:

MAX. FRAME HEIGHT = 96 IN.
MAX. LEAF WIDTH = 35-3/4 IN.
MAX. DESIGN LOAD = + 75.0
- 80.0 PSF


ACTIVE LEAF:

CONVENTIONAL DOOR LOCKSET WITH HANDLE BY 'SCHLAGE/KWIKSET'
LOCATED AT 39-1/4" FROM BOTTOM
KEY OPERATED ON EXTERIOR AND THUMB TURN ON
INTERIOR THROW BOLT LOCATED AT 37-3/4" FROM BOTTOM

CONCEALED FLUSH BOLTS
1/2" X 2" THROW BOLTS ENGAGING FRAME AT HEAD AND SILL
MANUALLY OPERATED LEVERS MOUNTED ON STILE FACE
LOCATED AT 10-5/8" FROM TOP AND BOTTOM
LOCK FASTENED TO STILE WITH (2) #8-32 X 1/2" FH MS

INACTIVE LEAF:

CONCEALED FLUSH BOLTS
1/2" X 2" THROW BOLTS ENGAGING FRAME AT HEAD AND SILL
MANUALLY OPERATED LEVERS MOUNTED ON INSIDE FACE
OF LEAF STILE LOCATED AT 10-5/8" FROM TOP AND BOTTOM
LOCK FASTENED TO STILE WITH (2) #8-32 X 1/2" FH MS

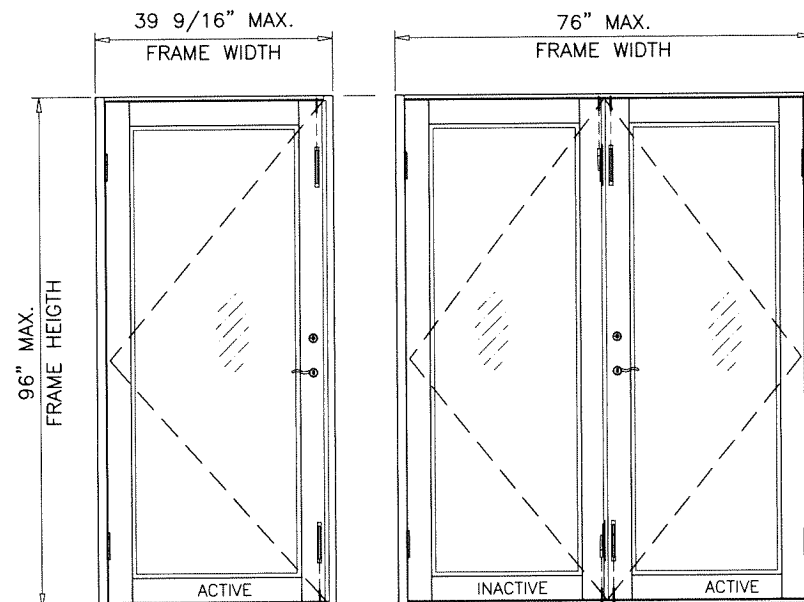


HINGES:









.122" THK. EXTRUDED ALUM HINGE BY 'LAPORTE'
2 HINGES PER LEAF
BOTTOM HINGE AT 7-1/2" FROM BOTTOM
TOP HINGE AT 8-1/2" FROM TOP
HINGES FASTENED WITH #10 X 3/4" FH SMS
(4) SCREWS AT HINGE STILE
(4) SCREWS AT FRAME JAMB

Sealed: 10/5/2023


FL #39596

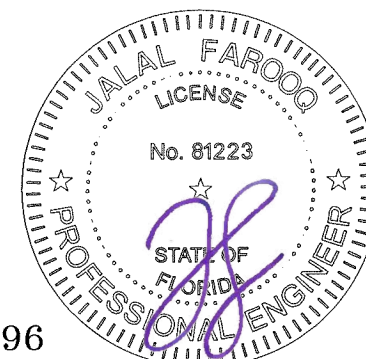

AL-FAROOQ CORPORATION ENGINEERS & PRODUCT DEVELOPMENT 9360 SUNSET DRIVE, SUITE 220 MIAMI, FLORIDA 33173 TEL. (305) 264-8100 FAX. (305) 262-6978 COMP-ANL 21-32F-LI	
SERIES 2100 ALUMINUM OUTSWING DOOR (N.I.)	
Lawson Industries Inc. 8501 N.W. 90th Street Medley, FL. 33166 Tel. (305) 696-8660 FAX.	
revisions:	
no	date
by description	
date: 04-08-21	
scale: 3/8" = 1"	dr. by: TARIO
chk. by:	
drawing no.	
21-32F	
sheet 11.1 of 14	



Sealed: 10/5/2023

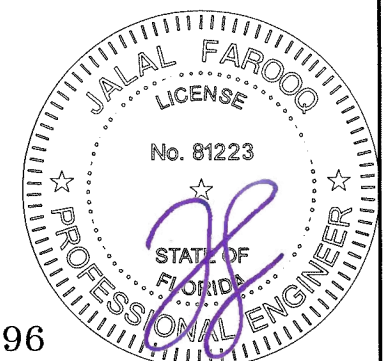

FL #39596

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES 2100 ALUMINUM OUTSWING DOOR (N.I.)

Lawson Industries Inc.
8501 N.W. 90th Street
Medley, FL 33166
Tel. (305) 696-8660 FAX.

[illegible]

date: 04-08-21
scale: $3/8" = 1"$
dr. by: TARIQ
chk. by:

drawing no.
21-32F


sheet 12 of 14

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	LAW-2401	1	FRAME HEAD	6063-T6	-
2	LAW-2402	1	STD. FRAME SILL (1-1/2" HT.)	6063-T6	-
2A	LAW-2403	1	HI-RISE FRAME SILL (2" HT.)	6063-T6	-
3	LAW-2421	1	FRAME SILL (ADA)	6063-T6	-
4	LAW-2404	2	FRAME JAMB	6063-T6	-
5	LAW-2406	2/ LEAF	TOP AND BOTTOM RAIL	6063-T6	-
5A	LAW-2407	2/ LEAF	HI-RISE TOP AND BOTTOM RAIL	6063-T6	-
6	LAW-2408	1/ LEAF	JAMB STILE	6063-T6	-
7	LAW-2410	1	ASTRAGAL STILE (INACTIVE)	6063-T6	-
8	LAW-2411	1	ASTRAGAL STILE (ACTIVE) (EURO LOCK)	6063-T6	-
8A	LAW-2409	1	ASTRAGAL STILE (ACTIVE)	6063-T6	-
9	LAW-2414	4/ LEAF	GLASS STOP (3/16" MONOLITHIC GLASS)	6063-T6	-
9A	LAW-2425	4/ LEAF	GLASS STOP (5/8" INSUL. GLASS)	6063-T6	-
10	LAW-2425	2/ LEAF	W'STRIP ADAPTER	6063-T5	-
11	LAW-2418	AS REQD.	FRAME COVER	6063-T6	-
12	LAW-2424	AS REQD.	'C' STIFFENER, 29" LONG	6063-T6	-
13	LAW-2405	AS REQD.	SIDELITE JAMB ADAPTER	6063-T6	-
13A	#10 X 1"	AS REQD.	ADAPTER FASTENERS, AT 6" FROM ENDS & 12" O.C.	ST/ST	PH SMS
14	LAW-2423	AS REQD.	MULLION STIFFENER	6063-T6	-
14A	-	AS REQD.	MULLION STIFFENER	STEEL	A36, Fu MIN. = 56 KSI
M1	-	AS REQD.	GLAZING GASKET	SILICONE	DUROMETER 65±5 SHORE A
M2	-	2/ LITE	SETTING BLOCKS AT 1/4 POINTS	SILICONE	DUROMETER 80±5 SHORE A
M3	-	AS REQD.	Q-LON FLAP W'STRIPPING	-	-
M4	150	AS REQD.	FRAME PERIMETER PILE W'STRIPPING	POLYPROPYLENE	-
M5	210	AS REQD.	PILE W'STRIPPING	WOOL	-
M6	-	AS REQD.	HINGE ASSEMBLY	-	HAGER
M6A	#10 X 3/4"	8/ HINGE	HINGE FASTENERS	ST/ST	FH SMS
M7	#12 X 3/4"	AS REQD.	FRAME ASSEMBLY FASTENERS	ST/ST	PH SMS
M8	#10 X 1"	AS REQD.	FIX. PANEL FASTENERS, AT 6" FROM ENDS & 12" O.C.	ST/ST	PH SMS
M9	-	2/ LEAF	3/8" DIA. THREADED ROD	STEEL	-
-	-	-	-	-	-

SEALANTS:

ALL FRAME AND LEAF JOINTS AND SEAMS SEALED
WITH SM 5504 SEALANT.

Sealed: 10/5/2023

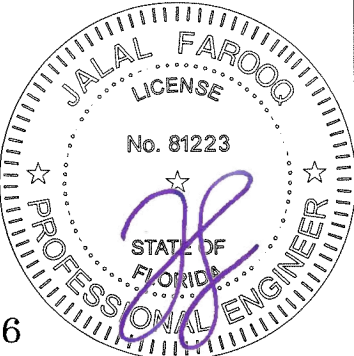

FL #39596

a f c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978


SERIES 2100 ALUMINUM OUTSWING DOOR (N.I.)

Lawson Industries Inc.
8501 N.W. 90th Street
Medley, FL. 33166
Tel. (305) 696-8660 FAX.


revisions:
no | date | by | description

date: 04-08-21
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:


drawing no.
21-32F
sheet 13 of 14

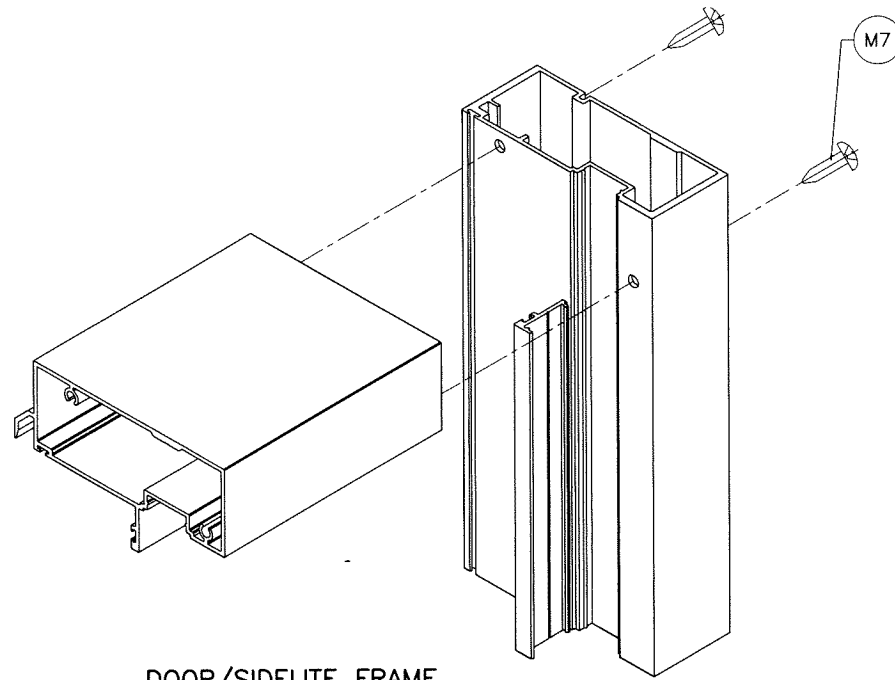


DOOR/SIDELITE FRAME
TOP CORNER

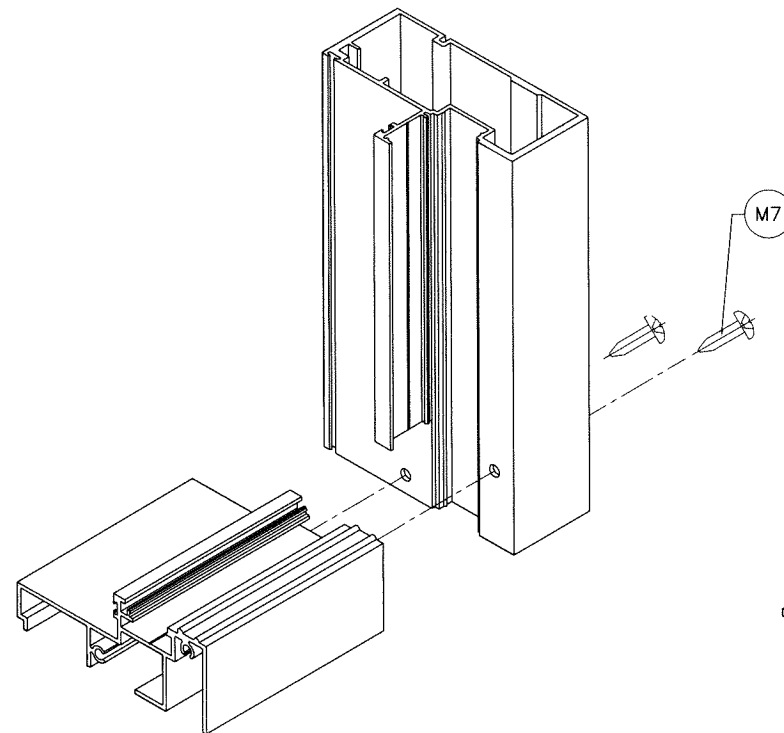

DOOR/SIDELITE FRAME
BOTTOM CORNER

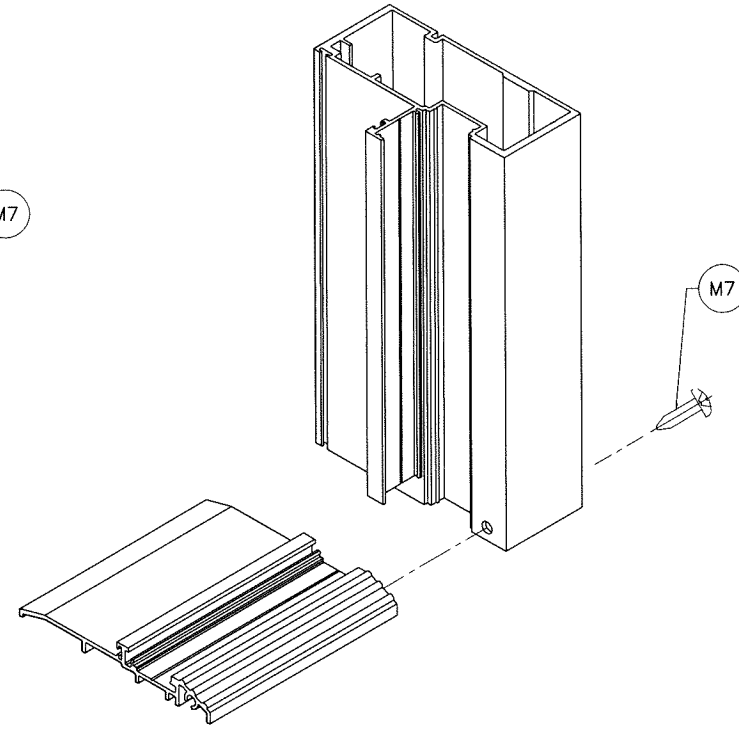


DOOR/SIDELITE FRAME
BOTTOM CORNER

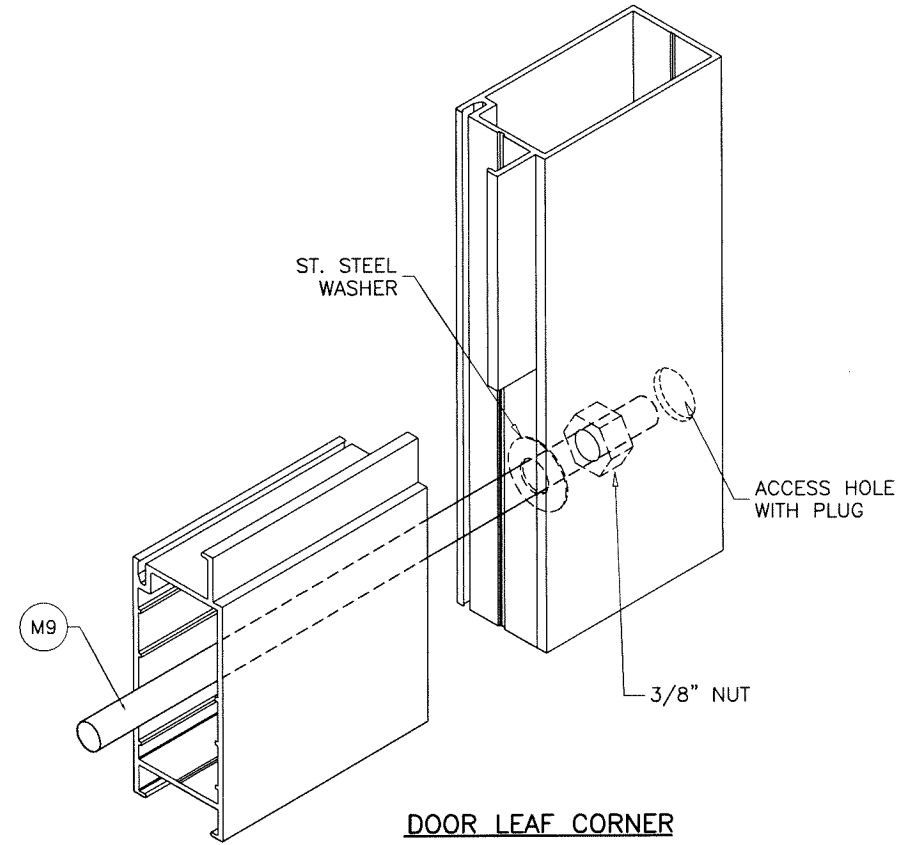

DOOR LEAF CORNER
SIDELITE PANEL CORNER

Sealed: 10/5/2023

FL #39596

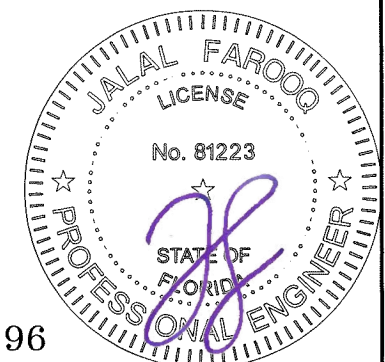

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

a f c
COMP-ANL 21-32F-LI

SERIES 2100 ALUMINUM OUTSWING DOOR (N.I.)

Lawson Industries Inc.
8501 N.W. 90th Street
Medley, FL. 33166
Tel. (305) 696-8660 FAX.

date: 04-08-21
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

revisions:

no	date	by	description

drawing no.
21-32F
sheet 14 of 14