

SIMONTON WINDOWS

- 07-09 / 07-10 / 07-20 3-LITE SLIDING WINDOW

w/SAFEPOINT IMPACT - MISSILE C

- NOTES:
1. THIS INSTALLATION HAS BEEN EVALUATED FOR USE IN LOCATIONS ADHERING TO THE FLORIDA BUILDING CODES AND WHERE PRESSURE REQUIREMENTS AS DETERMINED BY ASCE 7 MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES DO NOT EXCEED THE DESIGN PRESSURE RATINGS HEREIN, FOR USE OUTSIDE THE H.V.H.Z.

2. THIS PRODUCT IS MISSILE LEVEL C, WIND ZONE 2 IMPACT RESISTANT. WHEN USED IN WINDOW ZONE 2 OR BELOW AREAS, THIS PRODUCT DOES NOT REQUIRE THE USE OF APPROVED IMPACT PROTECTIONS DEVICES (SHUTTERS).

3. ALL INTERIOR AND EXTERIOR PERIMETER SURFACES OF THE WINDOW MUST BE CAULKED.

4. ANCHOR TYPE, SIZE, SPACING, AND EMBEDMENT SHALL BE AS SPECIFIED IN THESE DRAWINGS. USE APPROPRIATE ANCHORAGE FROM TABLE I ACCORDING TO SUBSTRATE TYPE. A MINIMUM CENTER-TO-CENTER SPACING OF 4" SHALL BE MAINTAINED BETWEEN ALL INSTALLATION FASTENERS IN ANY DIRECTION.

5. ANCHOR EMBEDMENT TO SUBSTRATE SHALL BE BEYOND WALL DRESSING OR STUCCO. WOOD BUCKS WITH CONCRETE/CMU ARE OPTIONAL; IF USED, FOR WOOD BUCKS LESS THAN 1-1/2" THICK, INSTALLATION ANCHOR EMBEDMENT SHALL BE BEYOND WOOD BUCKS AND INTO CONCRETE/CMU. FOR WOOD BUCKS 1-1/2" THICK OR GREATER, INSTALLATION ANCHOR EMBEDMENT SHALL BE INTO WOOD BUCKS.

6. WOOD, METAL, OR MASONRY OPENINGS, BUCKS, AND BUCK FASTENERS, BY OTHERS, SHALL BE PROPERLY DESIGNED AND INSTALLED BY OTHERS TO TRANSFER SUPERIMPOSED LOADS TO THE STRUCTURE. ADEQUACY OF THE STRUCTURE TO RECEIVED THESE LOADS SHALL BE VERIFIED BY THE CONTRACTOR OR AUTHORITY HAVING JURISDICTION (AHJ).

7. IT IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD OR AS APPROVED BY THE AHJ TO SELECT SIMONTON PRODUCTS TO MEET ALL APPLICABLE LOCAL LAWS, BUILDING CODES, ORDINANCES, OR OTHER SAFETY REQUIREMENTS FOR EACH INSTALLATION.

8. MAX. SHIM STACK IS 1/4", AND SHIMS SHOULD BE USED WHERE GAPS OF GREATER THAN 1/16" EXISTING BETWEEN THE OPENING AND FRAME IN THE FOLLOWING LOCATIONS: FOR THROUGH-FRAME AT EACH INSTALLATION ANCHOR, AND FOR FIN AT THE JAMBS MAX. 6" FROM CORNERS AND AT MID-SPAN. SHIMS SHALL BE LOAD-BEARING AND CAPABLE OF TRANSFERRING LOADS TO THE SUBSTRATE.

9. SEALING AND FLASHING BY OTHERS SHOULD BE APPLIED USING THE ASTM E 2112 METHODOLOGY APPROPRIATE FOR THE OPENING INTO WHICH THE WINDOW IS BEING INSTALLED. OVERALL WATER PENETRATION RESISTANCE OF THE INSTALLED PRODUCT IS THE RESPONSIBILITY OF OTHERS.

10. GLAZING SHALL COMPLY WITH ASTM E 1300.

11. A WIND LOAD DURATION FACTOR Cd = 1.6 WAS USED FOR THE ANALYSIS OF WOOD SCREWS ONLY.

12. ALL FASTENERS PENETRATING INTO PRESSURE TREATED WOOD SHALL BE COATED OR CONSTRUCTED OF MATERIAL CAPABLE OF PREVENTING CORROSION DUE TO REACTION WITH PRESSURE TREATMENT CHEMICALS. ANY DISSIMILAR MATERIALS THAT COME INTO CONTACT SHALL BE PROTECTED TO PREVENT REACTIONS IN ACCORDANCE WITH CODE REQUIREMENTS.

13. WINDOWS SHALL BE CONSTRUCTED AS SPECIFIED IN TEST REPORTS I10-24312-I-R0 AND I10-24445-I-R0 BY NATIONAL CERTIFIED TESTING LABORATORIES AND D2294.01-501-47-R0 BY ARCHITECTURAL TESTING, INC.

14. DESIGNATION "X" IS FOR OPERABLE PANEL AND "O" IS FOR FIXED PANEL.

15. USE A BACKER ROD ON ALL JOINTS >3/4". FINISHED CAULK JOINT SHOULD BE A MINIMUM OF 3/8".

DESIGN PRESSURE TABLE							
PRODUCT MODEL	STYLE	OVERALL SIZE		PERFORMANCE RATING	DESIGN PRESSURE	INSTALLATION METHOD	MISSILE IMPACT RATING
		WIDTH	HEIGHT				
07-09 07-10 07-20	EQUAL	105"	63"	R-PG40	+40/-40 PSF	NAIL FIN	MISSILE C WIND ZONE 2
07-09 07-10 07-20	EQUAL	105"	63"	R-PG40	+40/-40 PSF	THROUGH FRAME	
07-09 07-10 07-20	QHQ	105"	63"	R-PG40	+40/-40 PSF	NAIL FIN	
07-09 07-10 07-20	QHQ	105"	63"	R-PG40	+40/-40 PSF	THROUGH FRAME	

TABLE OF CONTENTS	
SECTION	SHEET DESCRIPTION
1	NOTES, DESIGN PRESSURE & INSTALLATION FASTENER TABLES
2	ELEVATION & ANCHOR LAYOUTS
3	ELEVATION & ANCHOR LAYOUTS
4	VERTICAL SECTIONS
5	HORIZONTAL SECTIONS & GLAZING DETAILS

Lucas Turner

2026.04.02

11:46:56

-05'00'


TABLE I: INSTALLATION FASTENERS TABLE				
ID	SUBSTRATE TYPE	ANCHOR TYPE	MIN. EMBED.	MIN. EDGE DISTANCE
FIN INSTALLATION				
A	2X MIN. SOUTHERN PINE WOOD (G=0.55)	#8 GRADE 5 WOOD SCREW	1-1/2"	3/8"
B	16 GAUGE (0.060"), STEEL 36 KSI MIN. OR 1/8" ALUM. 6063-T5 MIN.	#10 GRADE 5 SELF-TAPPING/DRILLING SCREW	FULL, PLUS 3 THREADS MIN.	3/8"
FRAME INSTALLATION				
C	2X MIN. SOUTHERN PINE WOOD (G=0.55)	3/16" DEWALT ULTRACON+	1-3/8"	7/8"
D	CONCRETE (3.05 KSI MIN.)	3/16" DEWALT ULTRACON+	1-3/4"	1-1/8"
E	HOLLOW OR GROUT-FILLED CMU (ASTM C-90)	3/16" DEWALT ULTRACON+	1-1/4"	2-1/2"
F	2X MIN. SOUTHERN PINE WOOD (G=0.55)	#10 GRADE 5 WOOD SCREW	1-3/8"	7/8"
G	16 GAUGE (0.060"), STEEL 36 KSI MIN. OR 1/8" ALUM. 6063-T5 MIN.	#10 GRADE 5 SELF-TAPPING/DRILLING SCREW	FULL, PLUS 3 THREADS MIN.	1/2"

*NOTE: ALL SCREWS SHALL HAVE MOD. TRUSS, PAN, OR HEX WASHER HEAD, 0.42" MIN. HEAD OR WASHER DIAMETER.




I COCHRANE AVENUE
PENNSBORO, WV 26415
PH: 800-542-9118

DATE: 07.23.21		TITLE: 07-09/07-10/07-20 3-LITE SLIDER W/SAFEPOINT NOTES, DESIGN PRESSURE & INSTALLATION FASTENER TABLES			
DWN BY: LMH		NO.	REVISION DESCRIPTION	BY	DATE
CHK BY:		A	UPDATED PAGE 3 VIEW	LMH	10.26.21
		B	UPDATED TO CURRENT FBC	LMH	03.11.26
SCALE: NTS					

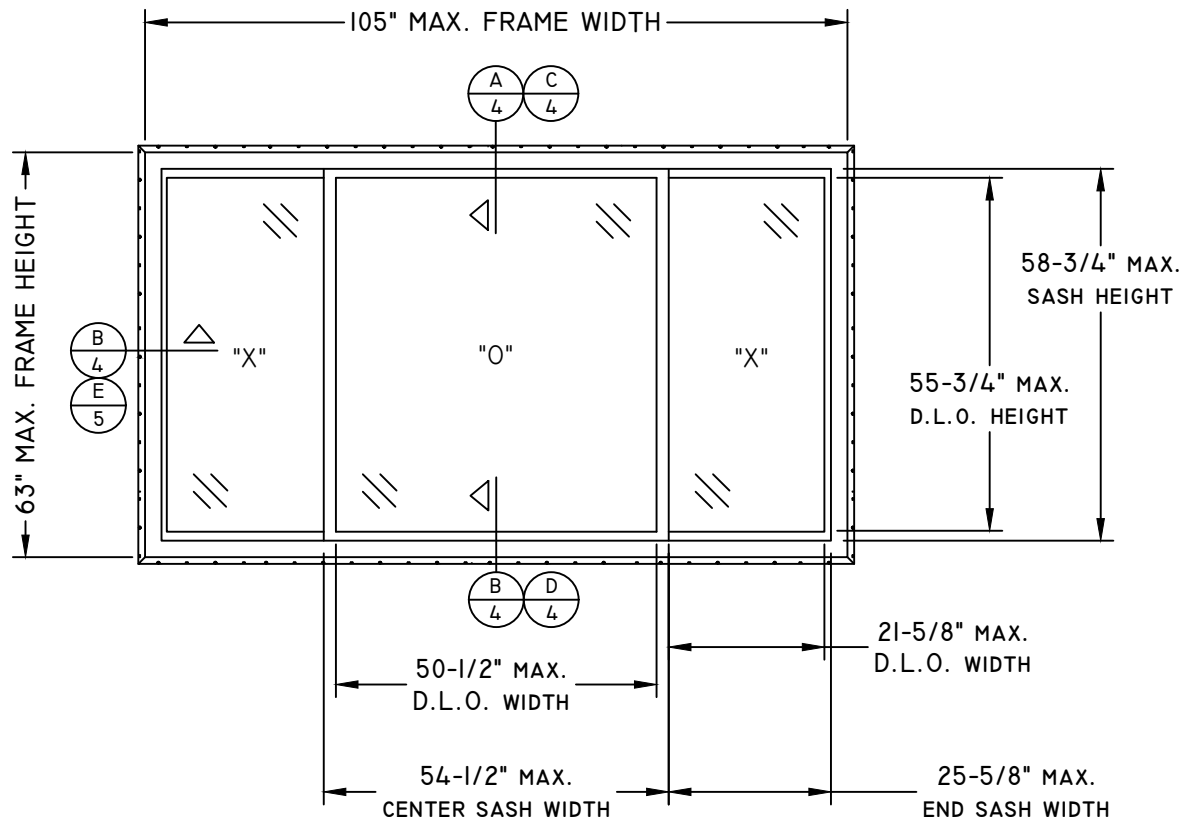


ELEVATION VIEW

3-LITE SLIDING WINDOW (1/4-1/2-14)

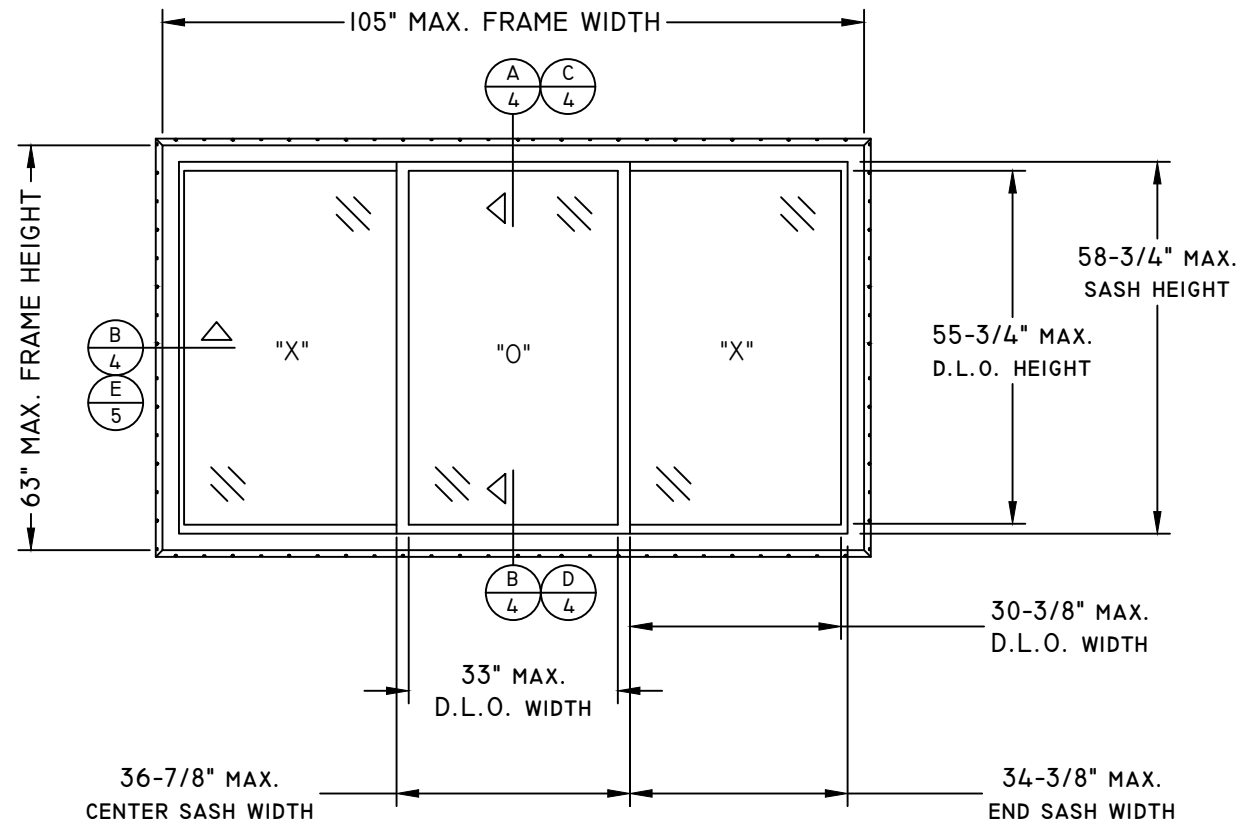


ELEVATION VIEW

3-LITE SLIDING WINDOW (EQUAL)

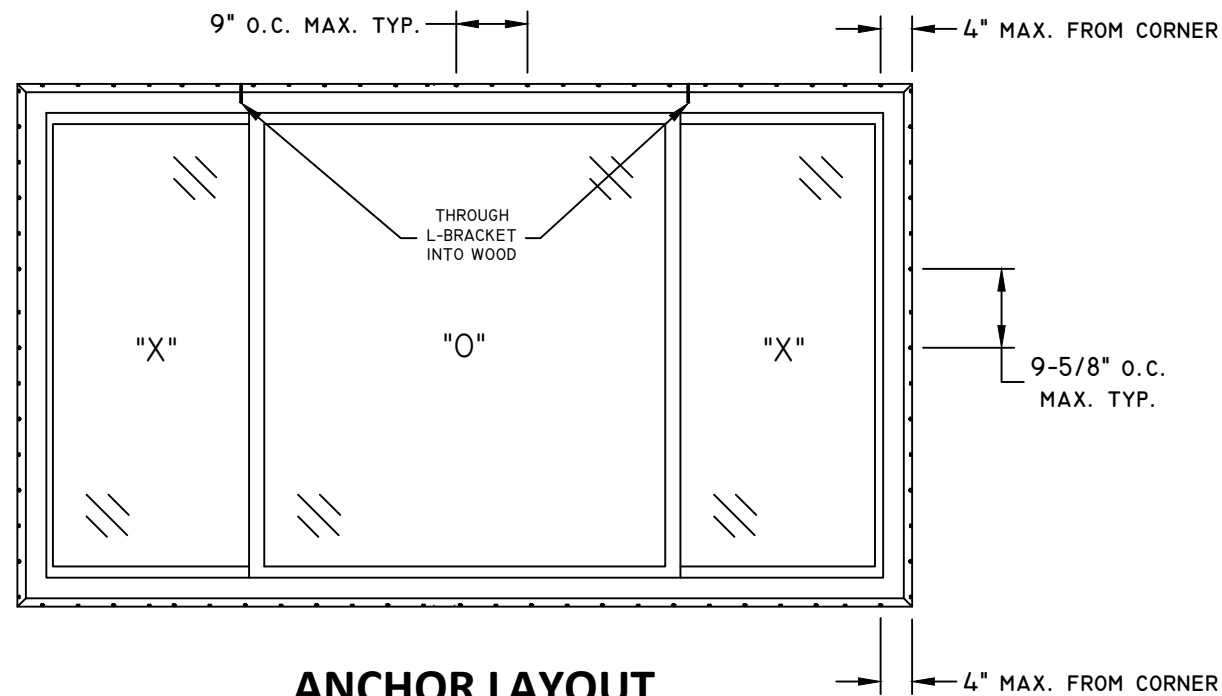

ANCHOR LAYOUT

NAIL FIN - (QHQ)

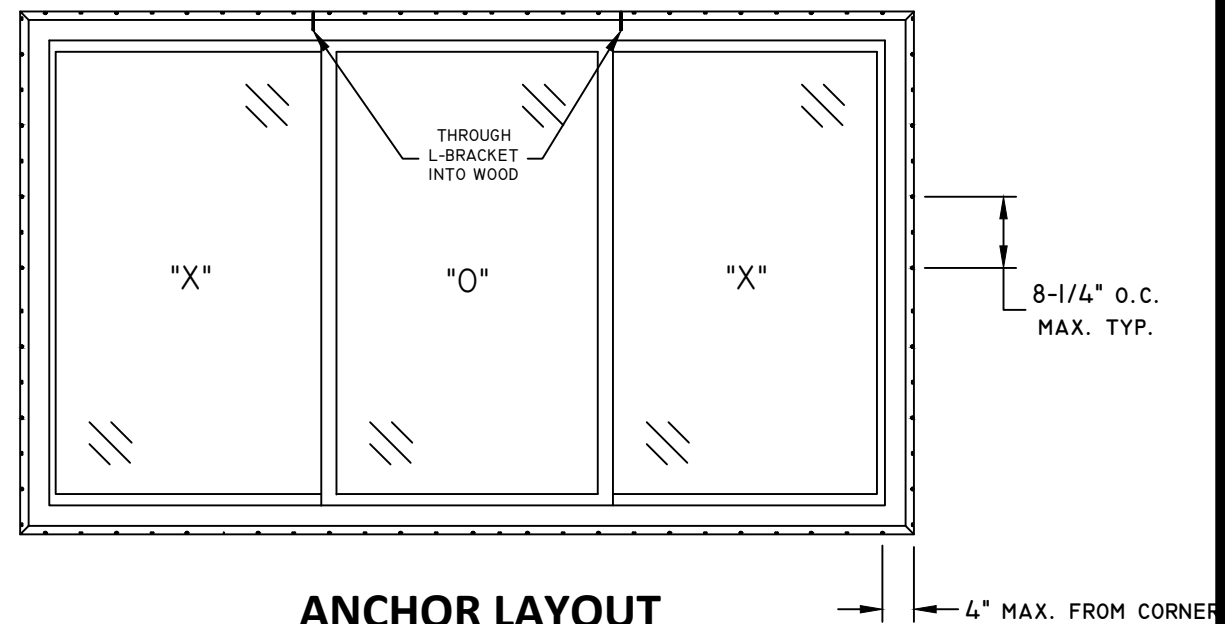

ANCHOR LAYOUT

NAIL FIN - (EQUAL)

TITLE: 07-09/07-10/07-20 3-LITE SLIDER W/SAFEPOINT
ELEVATIONS AND ANCHOR LAYOUTS

DATE: 07.23.21	DWN BY: LMH	CHK BY: .	SCALE: NTS
-------------------	----------------	--------------	---------------




03/11/2026
LUCAS A. TURNER, P.E.
FL PE # 58201
TURNER ENGINEERING &
CONSULTING, INC.
(COA # 29779)
2428 OLD NATCHEZ TRACE
TRAIL, CAMDEN, TN 38320
PH. 941-380-1574


FL#: **39620**

DWG #: **IN0599**


SHEET: **2 OF 5**

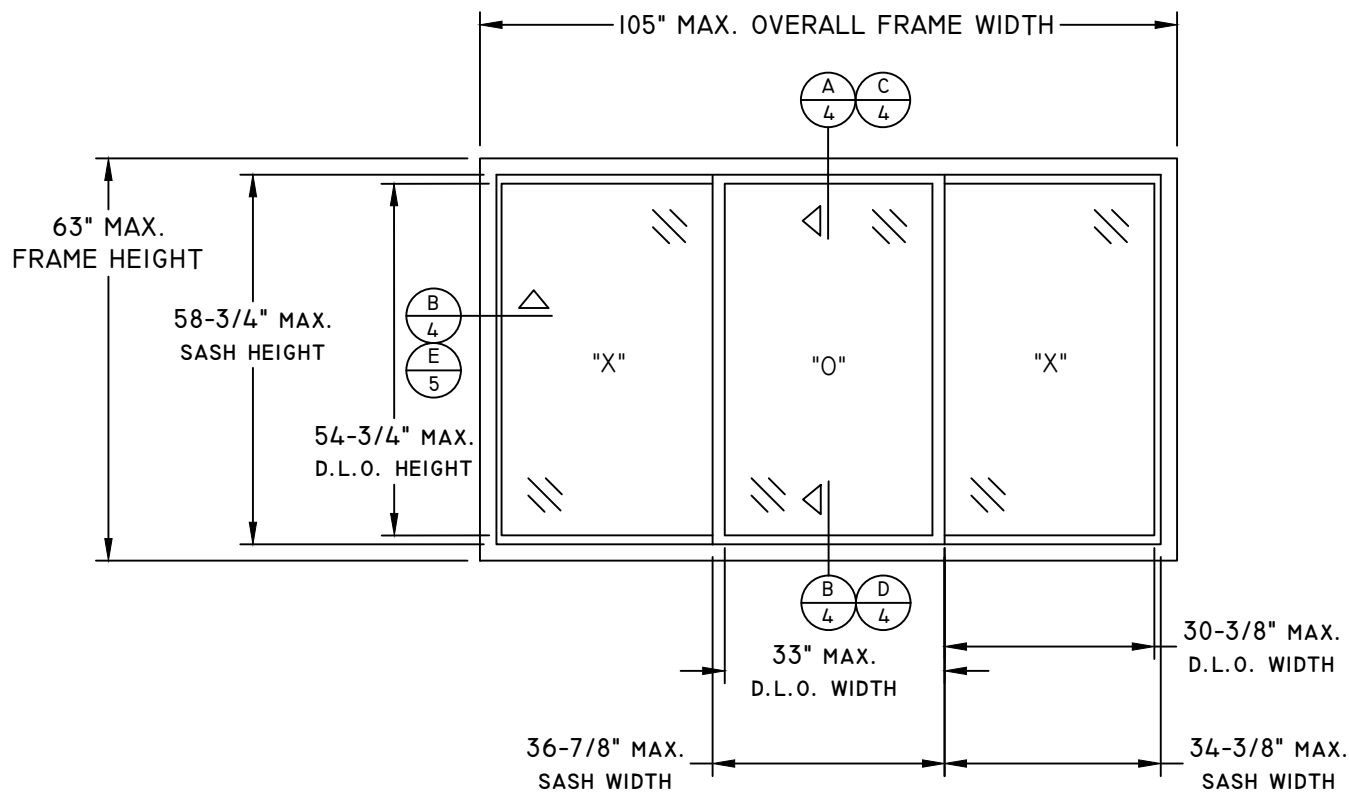


ELEVATION VIEW
3-LITE SLIDING WINDOW (EQUAL)

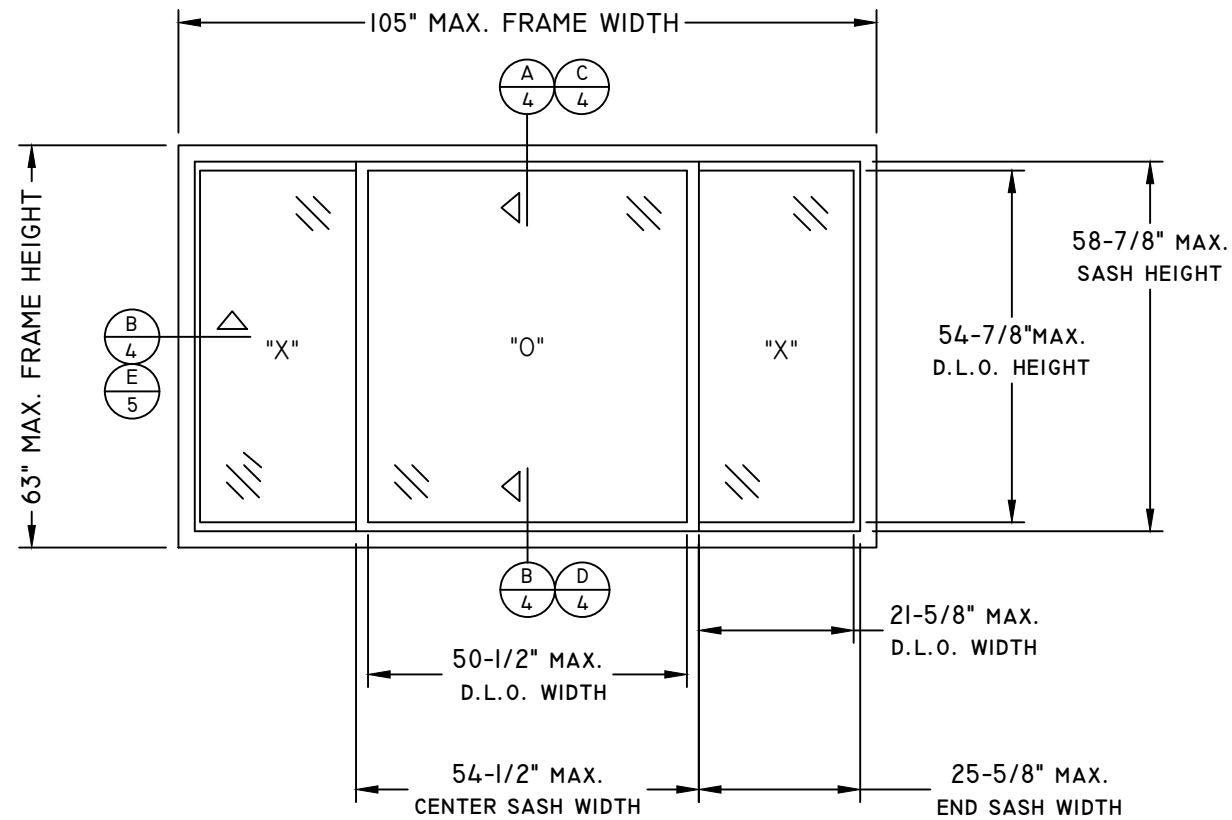

ELEVATION VIEW
3-LITE SLIDING WINDOW (1/4-1/2-14)

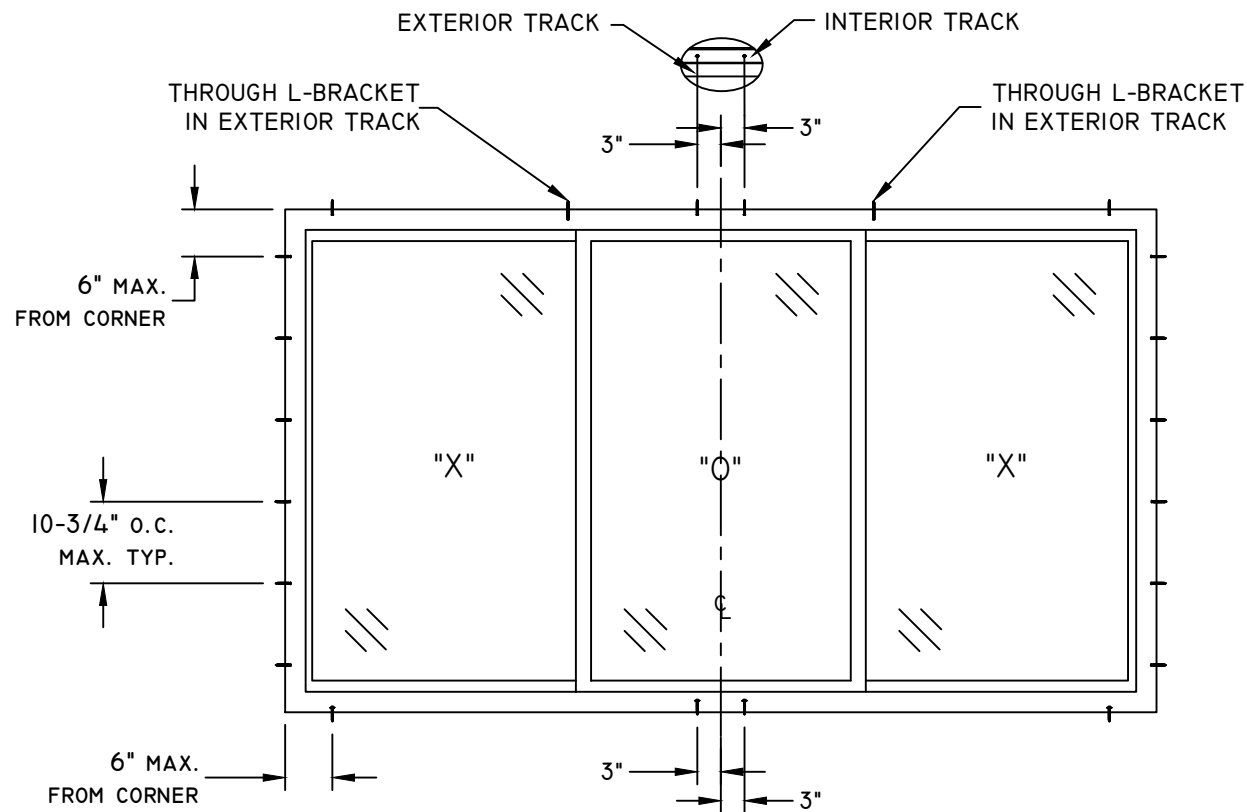

ANCHOR LAYOUT
FINLESS - (EQUAL)

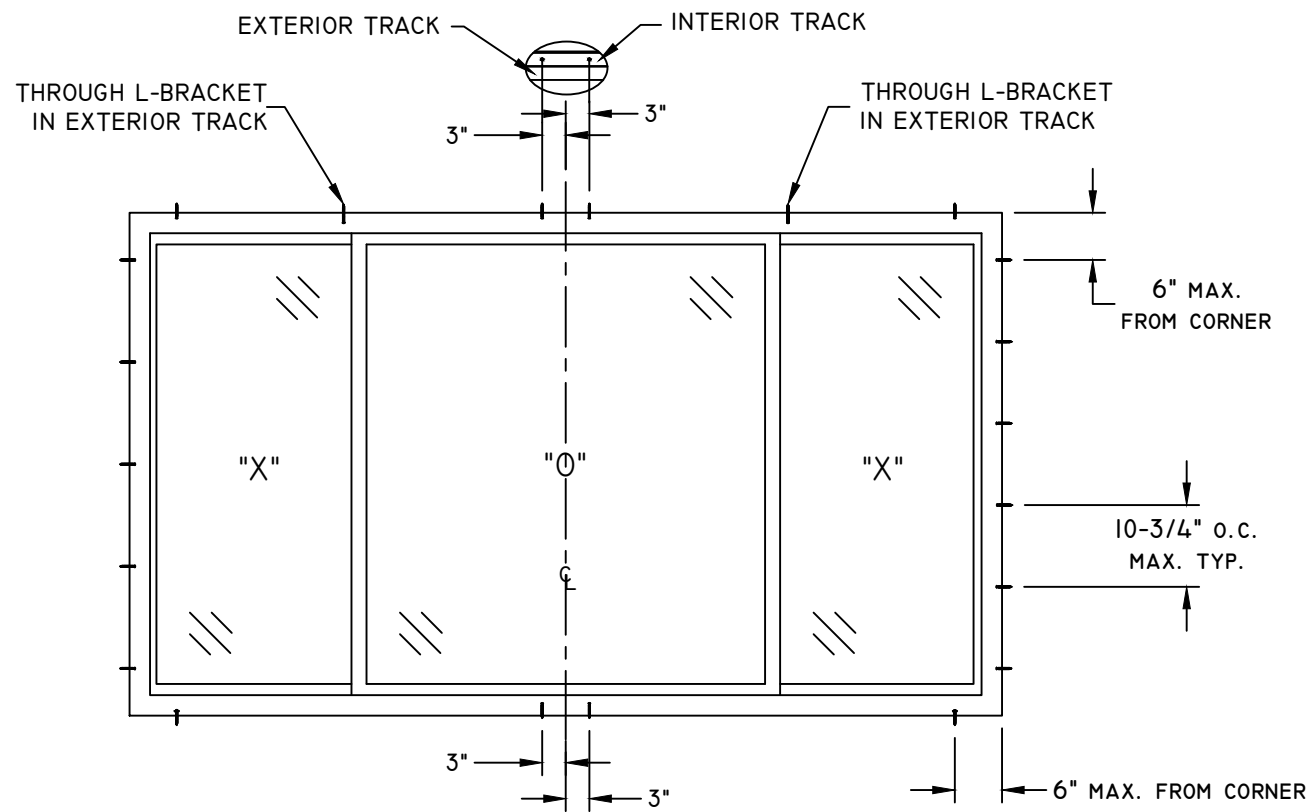

ANCHOR LAYOUT
FINLESS- (QHQ)

TITLE: 07-09/07-10/07-20 3-LITE SLIDER W/SAFEPOINT ELEVATIONS AND ANCHOR LAYOUTS					
DATE: 07.23.21		NO.	REVISION DESCRIPTION	BY	DATE
		A	UPDATED PAGE 3 VIEW	LMH	10.26.21
		B	UPDATED TO CURRENT FBC	LMH	03.11.26
DWN BY: LMH					
CHK BY:					
SCALE: NTS					




03/11/2026
LUCAS A. TURNER, P.E.
FL PE # 58201
TURNER ENGINEERING & CONSULTING, INC.
(COA # 29779)
2428 OLD NATCHEZ TRACE
TRAIL, CAMDEN, TN 38320
PH. 941-380-1574


FL#: **39620**

DWG #: **IN0599**


SHEET: **3 OF 5**

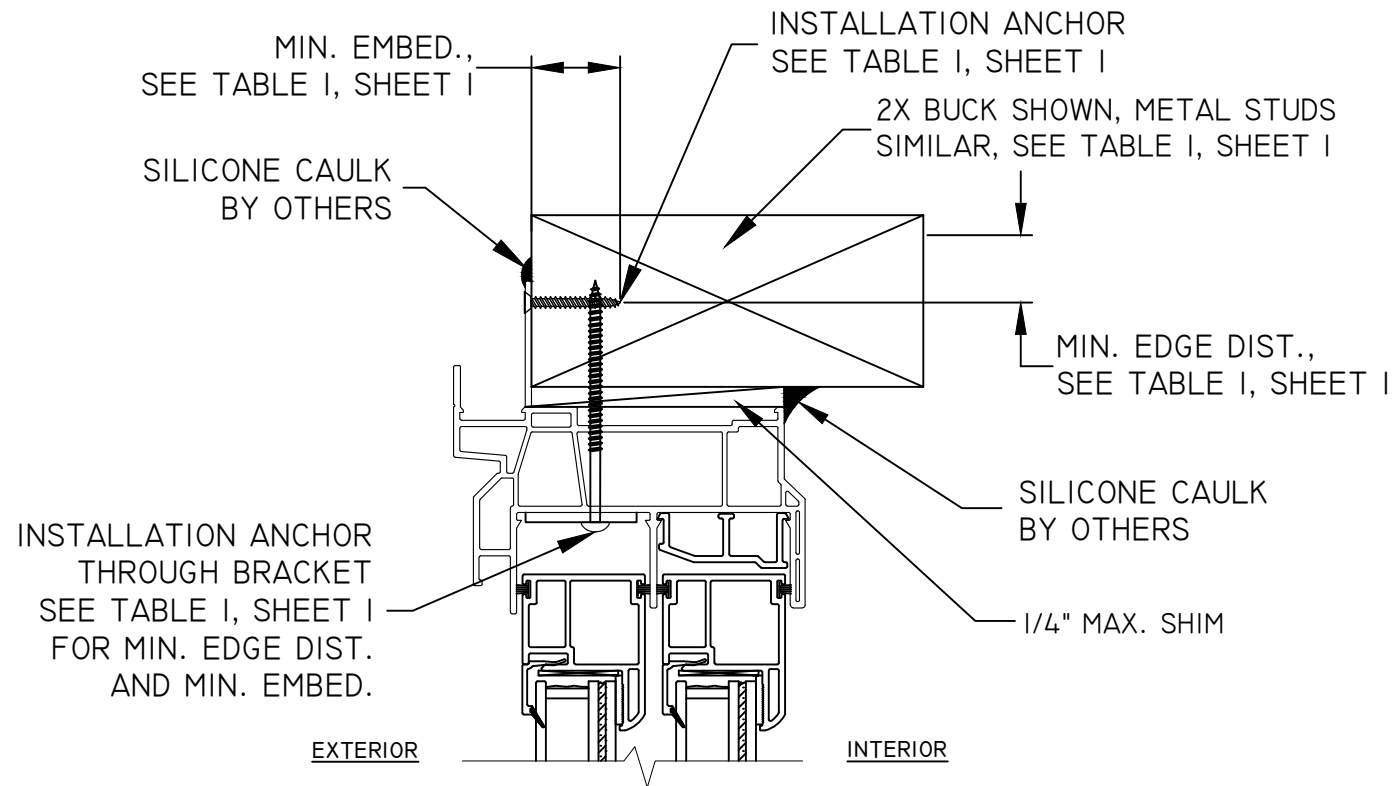


A
3 VERTICAL SECTION
HEAD AND JAMBS
FIN INSTALLATION

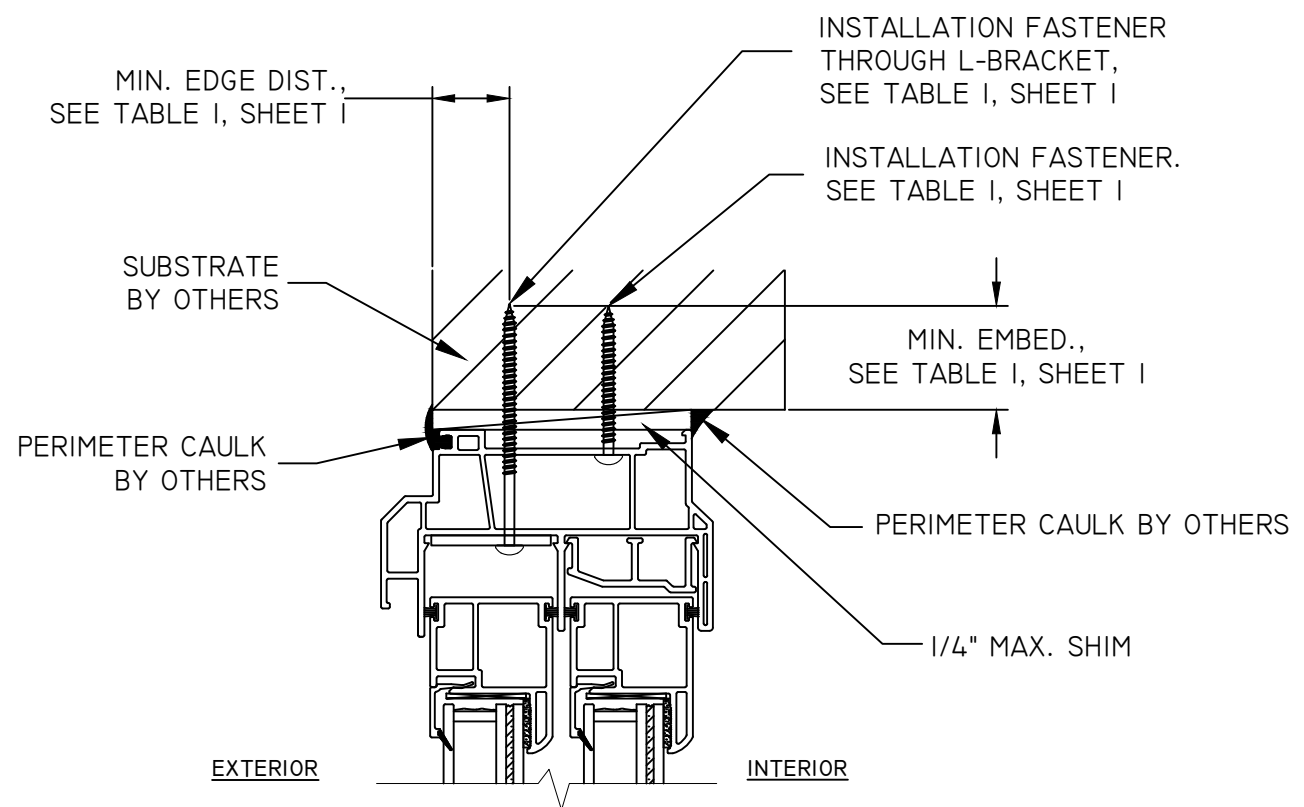

C
3 VERTICAL SECTION
HEAD
FINLESS INSTALLATION

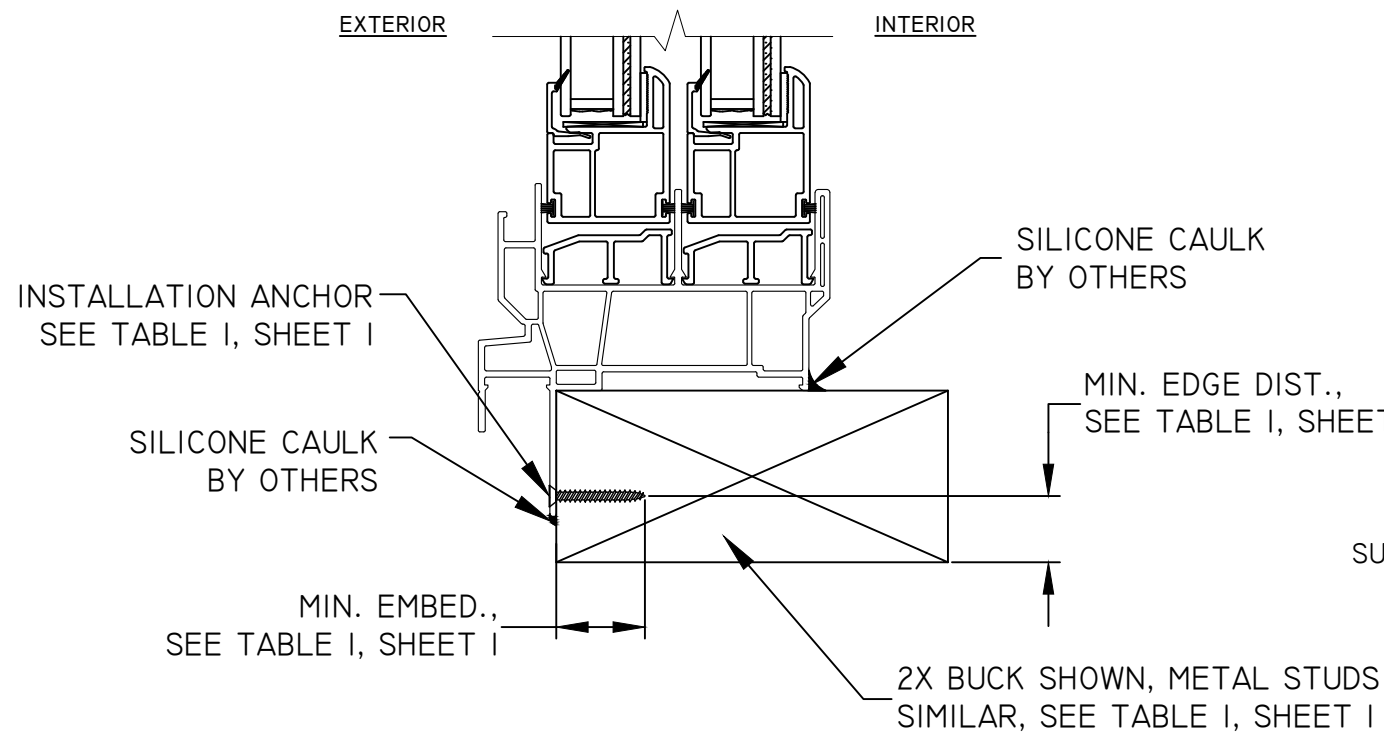

B
3 VERTICAL SECTION
SILL
FIN INSTALLATION

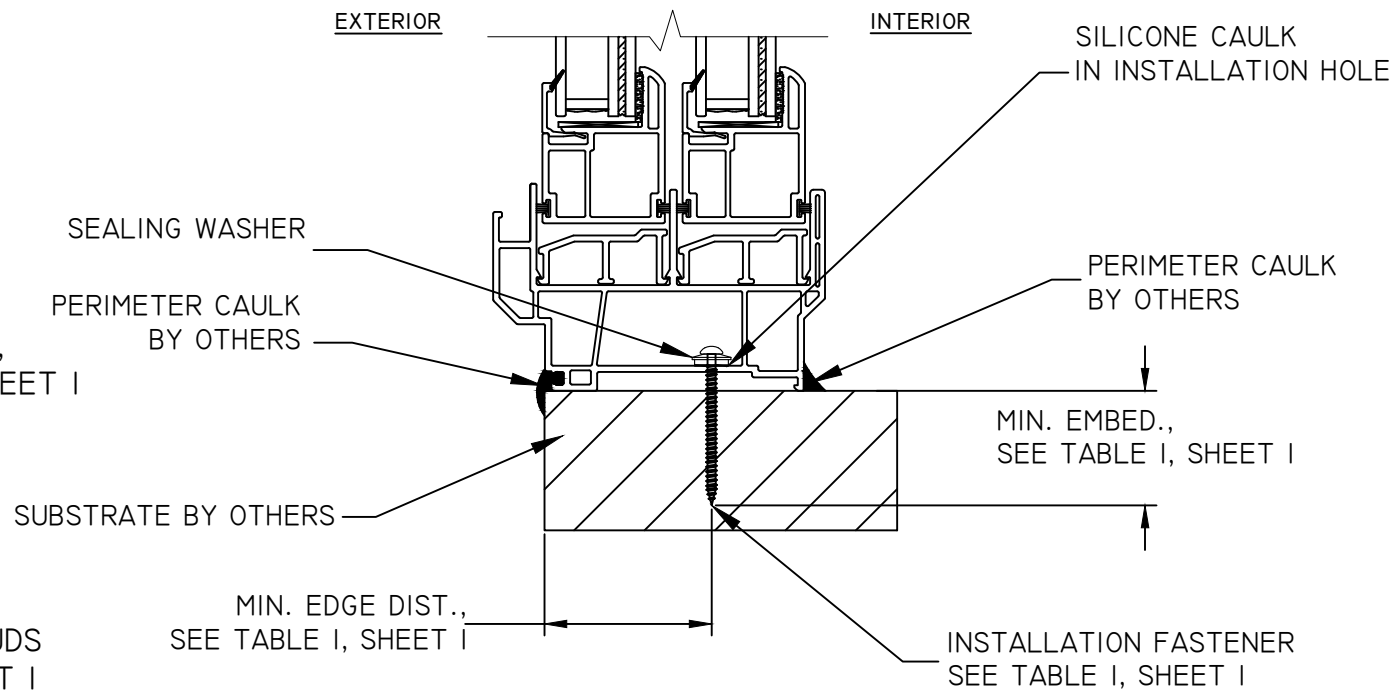

D
3 VERTICAL SECTION
SILL
FINLESS INSTALLATION




03/11/2026
LUCAS A. TURNER, P.E.
FL PE # 58201
TURNER ENGINEERING &
CONSULTING, INC.
(COA # 29779)
2428 OLD NATCHEZ TRACE
TRAIL, CAMDEN, TN 38320
PH. 941-380-1574

FL#: **39620**


DWG #: **IN0599**

SHEET: **4 OF 5**


TITLE: 07-09/07-10/07-20 3-LITE SLIDER W/SAFEPOINT VERTICAL SECTIONS			
DATE:	BY:	REVISION DESCRIPTION	NO.
07.23.21	LMH	UPDATED PAGE 3 VIEW	A
DWN BY:	LMH	UPDATED TO CURRENT FBC	B
CHK BY:			
SCALE:	NTS		

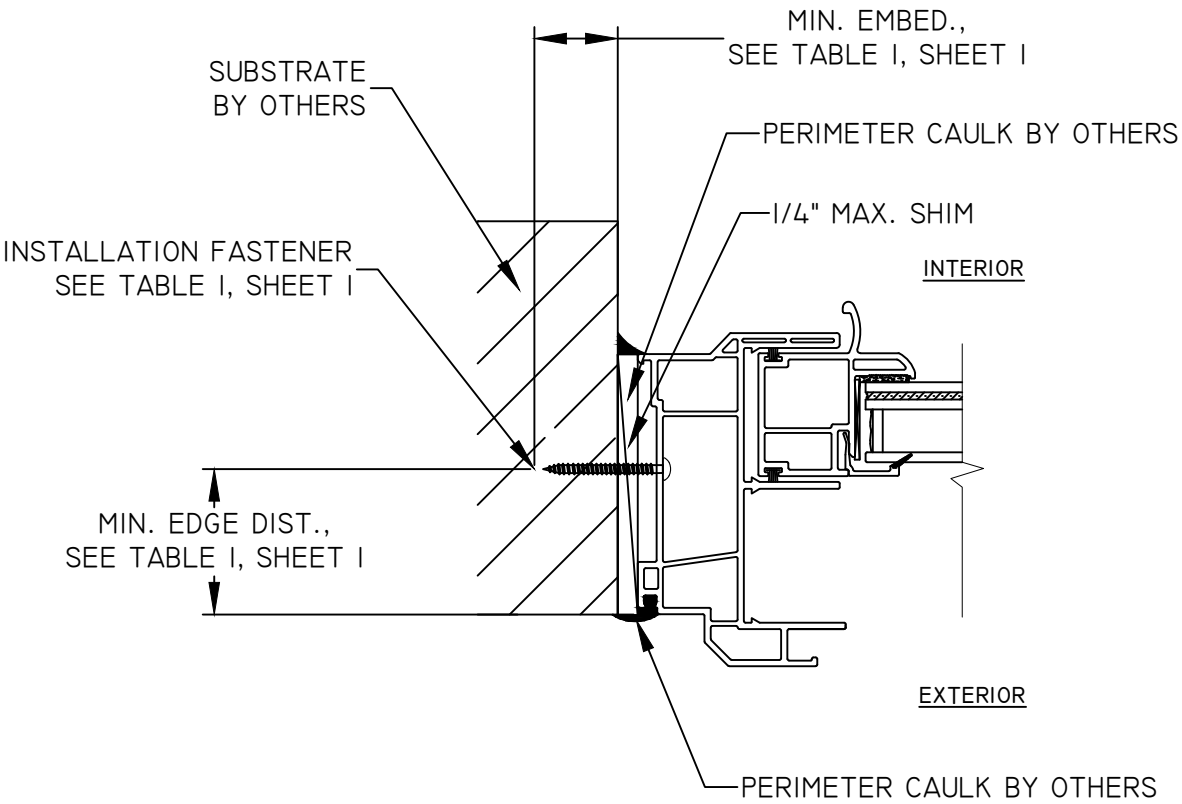


E
4 **HORIZONTAL SECTION**
JAMBS
FINLESS INSTALLATION

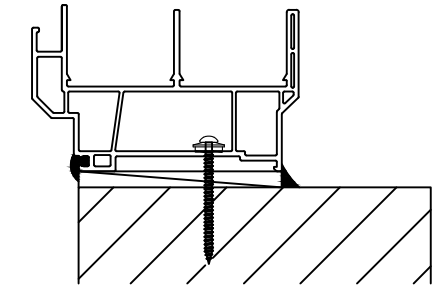


07-09 BLOCK FRAME (FINLESS)
(FOR ANCHORAGE SEE SHEET 3)

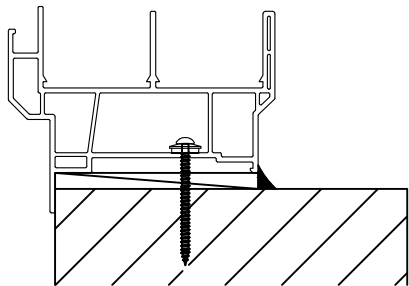

07-10 FRAME WITH
INTEGRAL MASONRY FLANGE
(ANCHORAGE SIMILAR TO FINLESS)

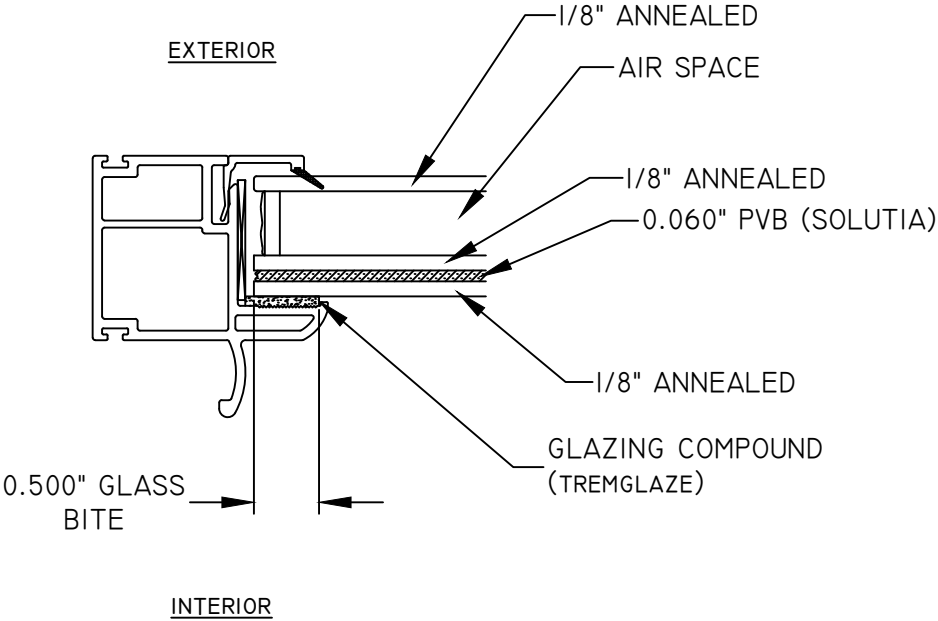


7/8\" INSULATED ANNEALED IMPACT RESISTANT
GLASS WITH 0.060\" PVB INTERLAYER

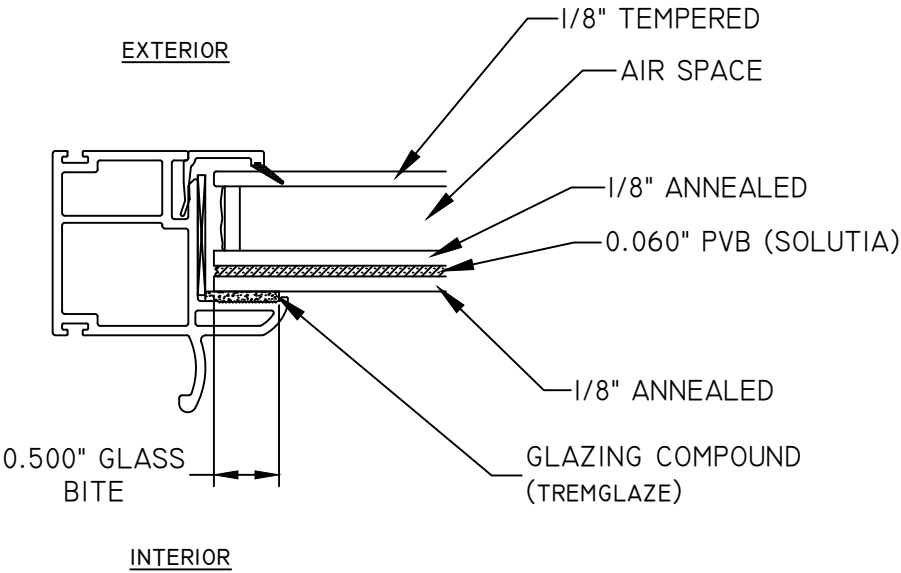

7/8\" INSULATED TEMPERED/ANNEALED IMPACT RESISTANT
GLASS WITH 0.060\" PVB INTERLAYER (OPTIONAL)

TITLE: 07-09/07-10/07-20 3-LITE SLIDER W/SAFEPOINT HORIZONTAL SECTIONS & GLAZING OPTIONS	NO.	REVISION DESCRIPTION	BY	DATE
	A	UPDATED PAGE 3 VIEW	LMH	10.26.21
	B	UPDATED TO CURRENT FBC	LMH	03.11.26
DATE: 07.23.21	DWN BY: LMH	CHK BY:	SCALE: NTS	

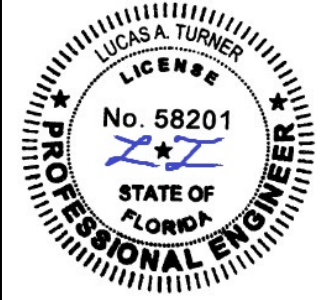

03/11/2026
LUCAS A. TURNER, P.E.
FL PE # 58201
TURNER ENGINEERING &
CONSULTING, INC.
(COA # 29779)
2428 OLD NATCHEZ TRACE
TRAIL, CAMDEN, TN 38320
PH. 941-380-1574

FL#: **39620**

DWG #: **IN0599**

SHEET: **5 OF 5**