
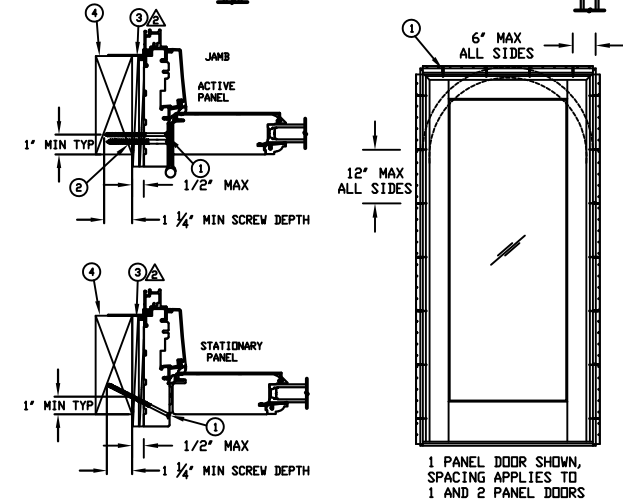


JAMB SCREW INSTALLATION

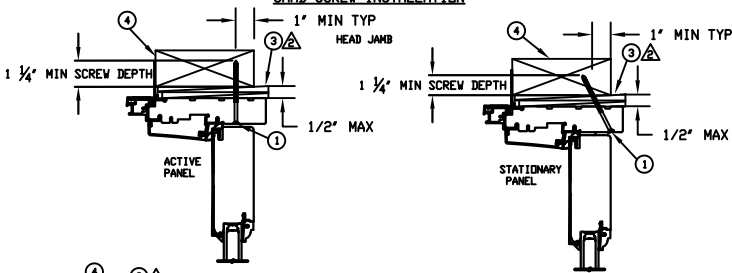

JAMB SCREW INSTALLATION METHOD:

- UNIT MUST NOT BE IN DIRECT CONTACT WITH EITHER CONCRETE OR TREATED BUCK MATERIAL. IF SHIM SPACE IS LESS THAN 1/8" WRAPPING THE JAMBS AND HEAD JAMB WITH WINDOW FLASHING TAPE IS REQUIRED AS A BARRIER BETWEEN THE UNIT AND CONCRETE OR TREATED LUMBER.
- SECURE THE HEAD JAMB WITH #8 X 3" SCREWS.
- MINIMUM OF 2 PER SIDE.
- SHIM AT EACH SCREW LOCATION.
- REPLACE 1 SCREW IN EACH HINGE WITH A #10 X 2 1/2" SCREW.
- REPLACE BOTH SCREWS IN EACH HEAD JAMB STRIKE WITH A #8HD-10 X 3" SCREWS.

NOTES:




1. THIS PRINT IS FOR STRUCTURAL PERFORMANCE ONLY. FOR FLASHING & SEALING REQUIREMENTS, REFER TO THE INSTALLATION INSTRUCTIONS.
2. SHIMS:
 - A SHIM MUST BE PLACED 4-6" FROM EACH CORNER.
 - ALL OTHERS MUST BE PLACED A MAX OF 15 INCHES APART.
3. IF CHEMICALLY TREATED LUMBER IS USED FOR BUCK MATERIAL, FASTENERS INTO THE BUCK MUST BE A MINIMUM OF 0.90 OZ/FT² ZINC HOT DIPPED GALVANIZED OR STAINLESS STEEL TYPE 304 OR 316.
4. GLASS COMPLIES WITH ASTM E1300

UNIT	MAX PANEL WIDTH	MAX FRAME SIZE	DP RATING
UFD AT RT6	35 1/16	72 5/8 X 95 1/2	+40/-40

CATEGORY:
SWINGING FRENCH DOOR

UNIT TYPE:
UFD AT

STRUCTURAL BRACKET INSTALLATION

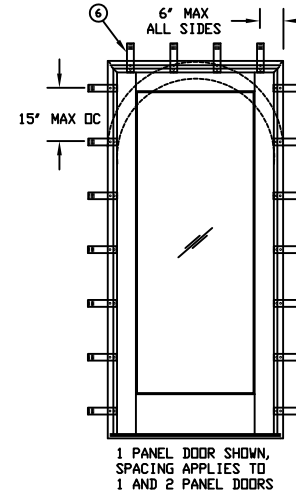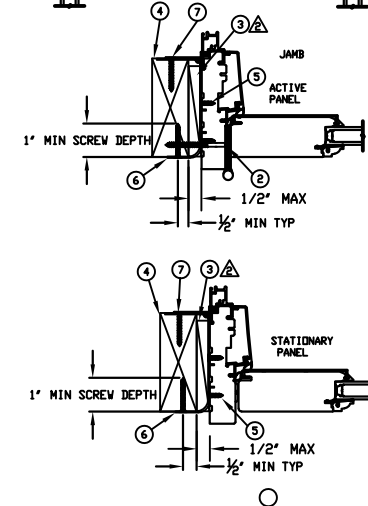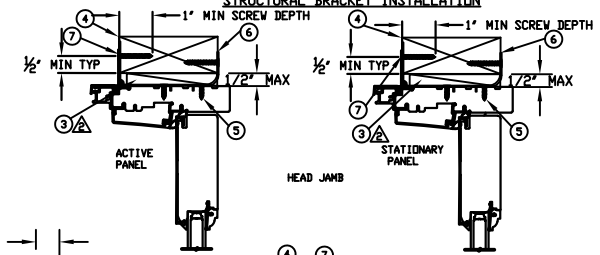

STRUCTURAL BRACKET INSTALLATION METHOD:

- UNIT MUST NOT BE IN DIRECT CONTACT WITH EITHER CONCRETE OR TREATED BUCK MATERIAL. IF SHIM SPACE IS LESS THAN 1/8" WRAPPING THE JAMBS AND HEAD JAMB WITH WINDOW FLASHING TAPE IS REQUIRED AS A BARRIER BETWEEN THE UNIT AND CONCRETE OR TREATED LUMBER.
- MINIMUM OF 2 BRACKETS PER SIDE.
- REPLACE 1 SCREW IN EACH HINGE WITH A #10 X 2 1/2" SCREW.
- REPLACE BOTH SCREWS IN EACH HEAD JAMB STRIKE WITH A #8HD-10 X 3" SCREWS.
- SCREWS LISTED ABOVE MUST BE FULLY EMBEDDED.
- ATTACH TO THE UNIT WITH TWO #8 X 3/4" SCREWS.
- ATTACH TO THE BUCK WITH TWO #8 X 1 1/2" SCREWS ON EACH SIDE OF THE BUCK.

MARVIN

RESEARCH & DEVELOPMENT

COLLECTION: ULTIMATE

DWG TYPE: INSTALLATION
DESCRIPTION: INSTALLATION UFD ARCH TOP ROUND TOP NON-CONTINUOUS

CHK: **SIZE:** B **CLASS:** MISC **DWG NO:** 00142063

APP: **SCALE:** NA **DATE:** 12/09/10 **DWG BY:** MARVIN\r_ryang **SHEET:** 1 OF 1

Template Version 12.0

NOTICE - CONFIDENTIAL INFORMATION

The information in this document is privileged and strictly confidential. The information contained herein shall be used only by Marvin Windows and Doors employees and by those agents or suppliers granted official written permission. If the reader of this document is not the intended recipient, or the employee or agent of the intended recipient, please delete this document from all data storage devices, and destroy all hard copies. Any unauthorized dissemination, distribution, copying or other use of the information contained in this document is strictly prohibited.