




**OPAQUE FIBERGLASS
SINGLE DOOR
INSWING / OUTSWING
"IMPACT"**


GENERAL NOTES

1. This product has been evaluated and is in compliance with the 8th Edition (2023) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection, this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and excludes Wind Zone 4 as defined in ASTM E 1996 and FBC Sections 1609.1.2.2 & R301.2.1.2.1.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS	
SHEET#	DESCRIPTION
1	Typical elevations, design pressures & general notes
2	Door panel details
3	Horizontal & vertical cross sections (2x buck)
4	Horizontal & vertical cross sections (1x buck)
5	Horizontal & vertical cross sections (Direct to Masonry)
6	Vertical cross sections
7	Buck & frame anchoring
8	Bill of materials & Components

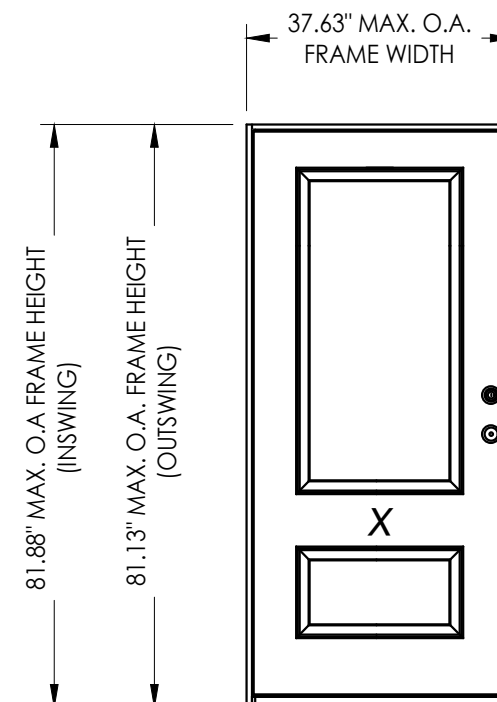

CONFIGURATION	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
	POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
X	+60.0	-65.0	+60.0	-60.0

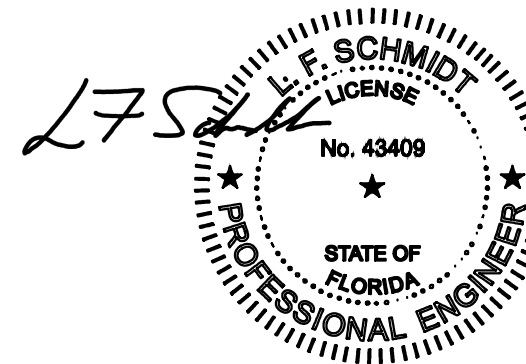

Digitally signed by
Lyndon F Schmidt
Date: 2024.09.23
★ 11:43:33 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: GLASSCRAFT DOOR CO.

PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES

[illegible]

DATE: 9/18/24

SCALE: *N.T.S.*


DWG. BY: *LFS*

CHK. BY: RW


DRAWING NO.:

FL-39764.5

© 2024 R.W. BUILDING CONSULTANTS INC.

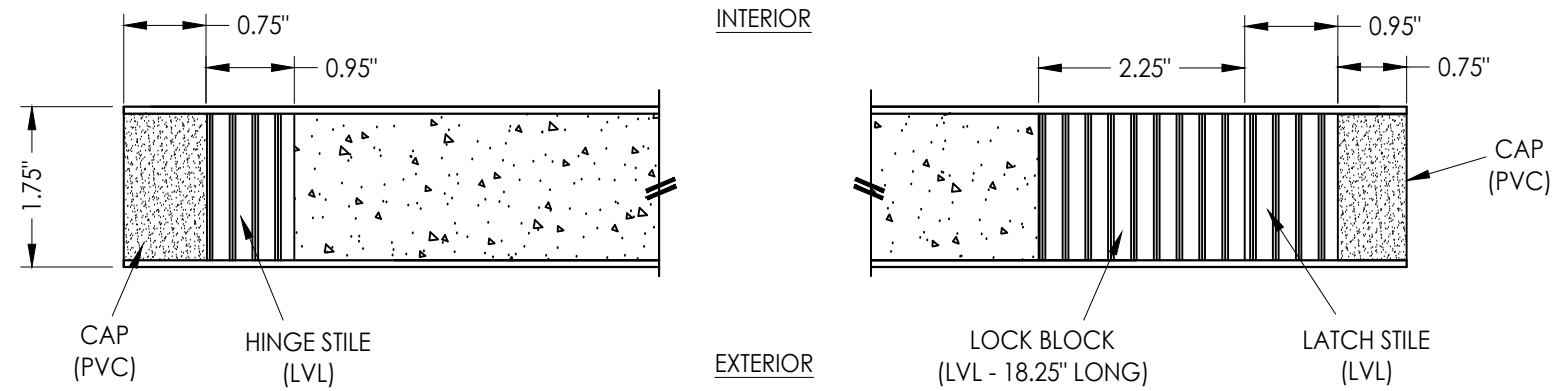


1 HORIZONTAL CROSS SECTION

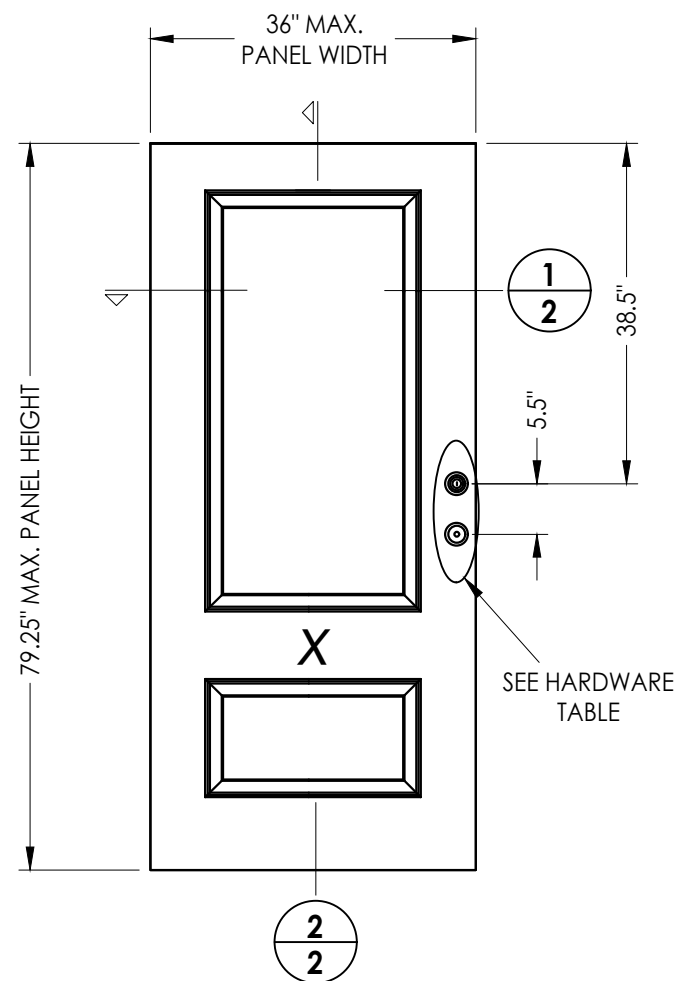

40 FIBERGLASS DOOR PANEL

DOOR SKIN: 0.080" MIN. THK. FIBERGLASS
CORE MATERIAL: POLYURETHANE FOAM

HARDWARE CHART		
MANUFACTURER	MODEL	
Kwikset	Knob:	Signature Series
	Deadbolt:	Signature Series (980)
Schlage	Knob:	F Series
	Deadbolt:	B60 Series

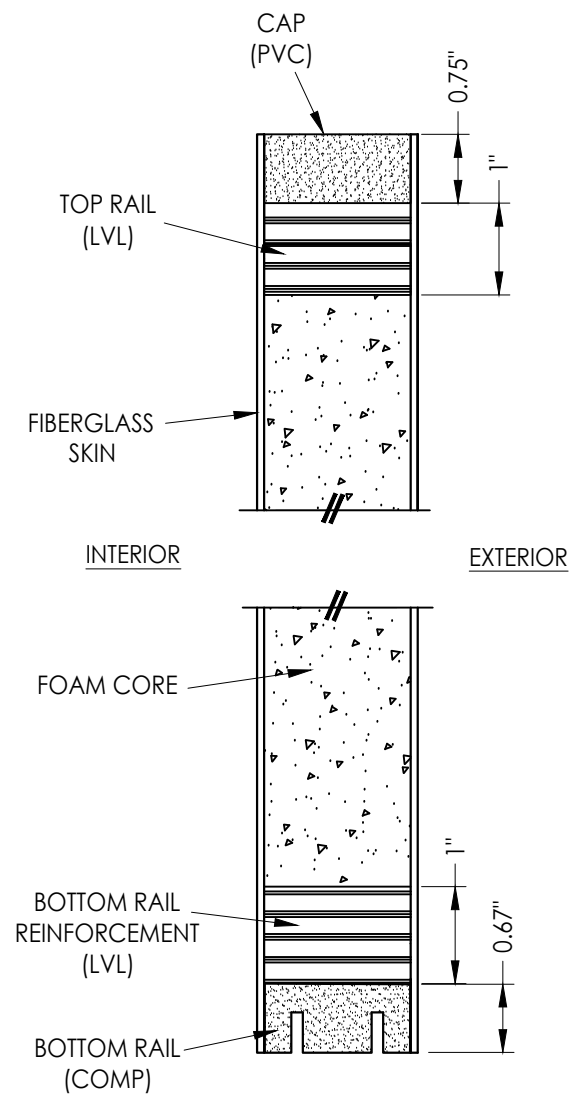





2 VERTICAL CROSS SECTION

PRODUCT:		GLASSCRAFT DOOR CO.	
PART OR ASSEMBLY:		DOOR PANEL DETAILS	
NO.		DATE	
BY		REVISIONS	
DATE: 9/18/24			
SCALE: N.T.S.			
DWG. BY: LFS			
CHK. BY: RW			
DRAWING NO.: FL-39764.5			
SHEET 2 OF 8			

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\GlassCraft Door Corp\FL-39764 R3\FL-39764.5.dwg

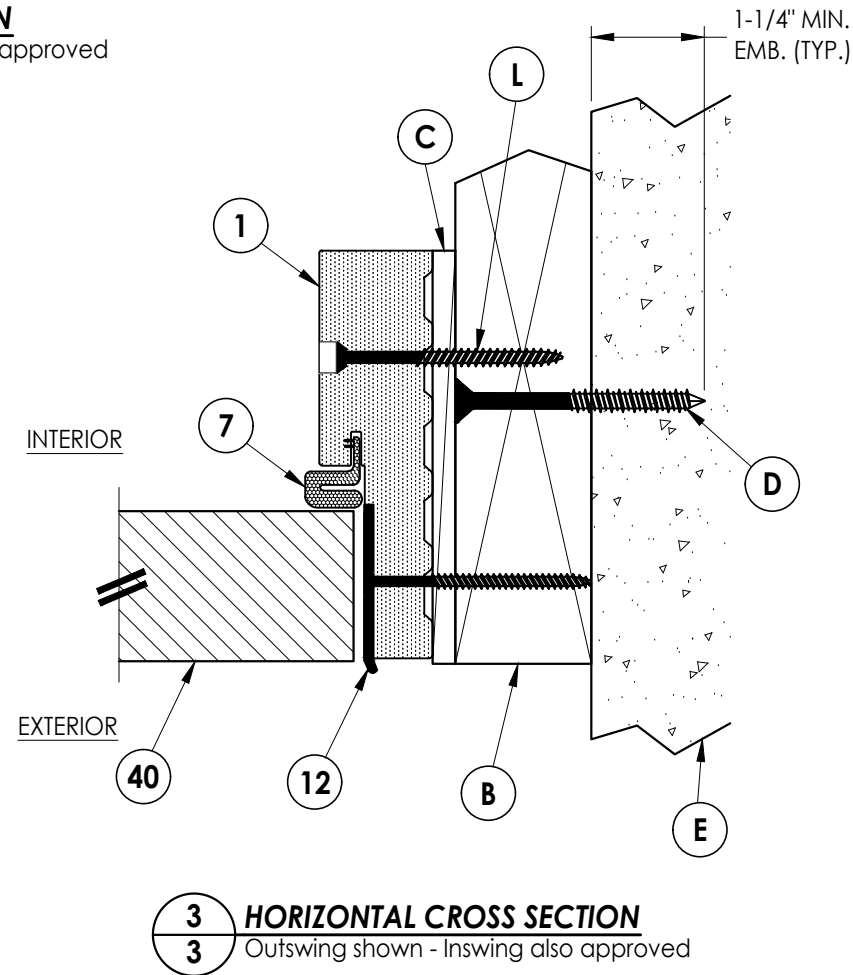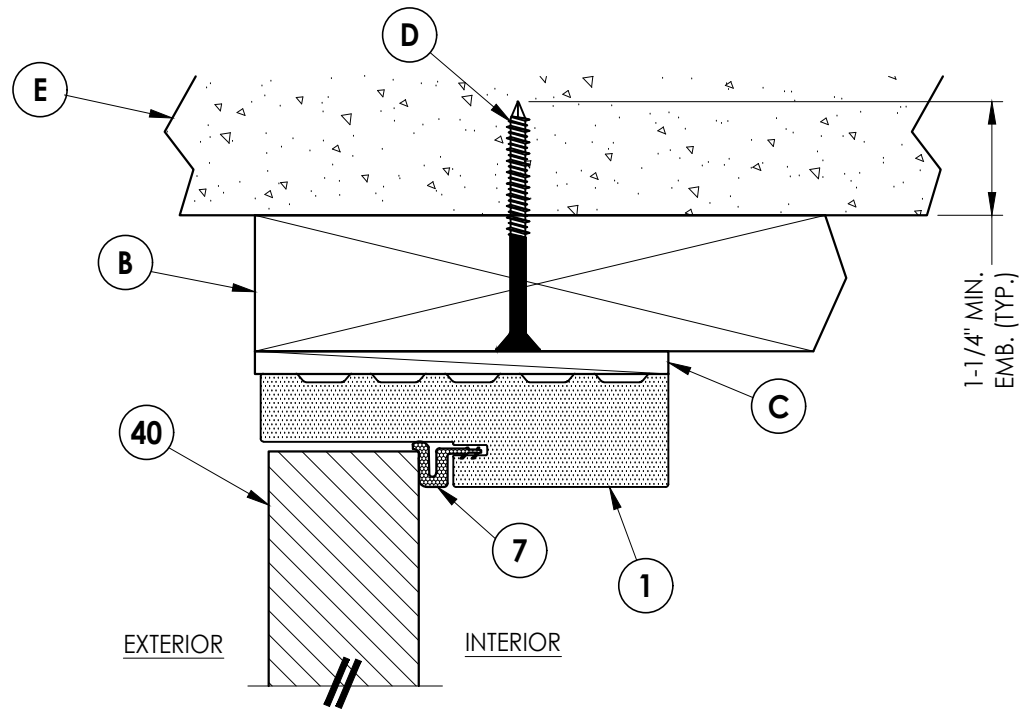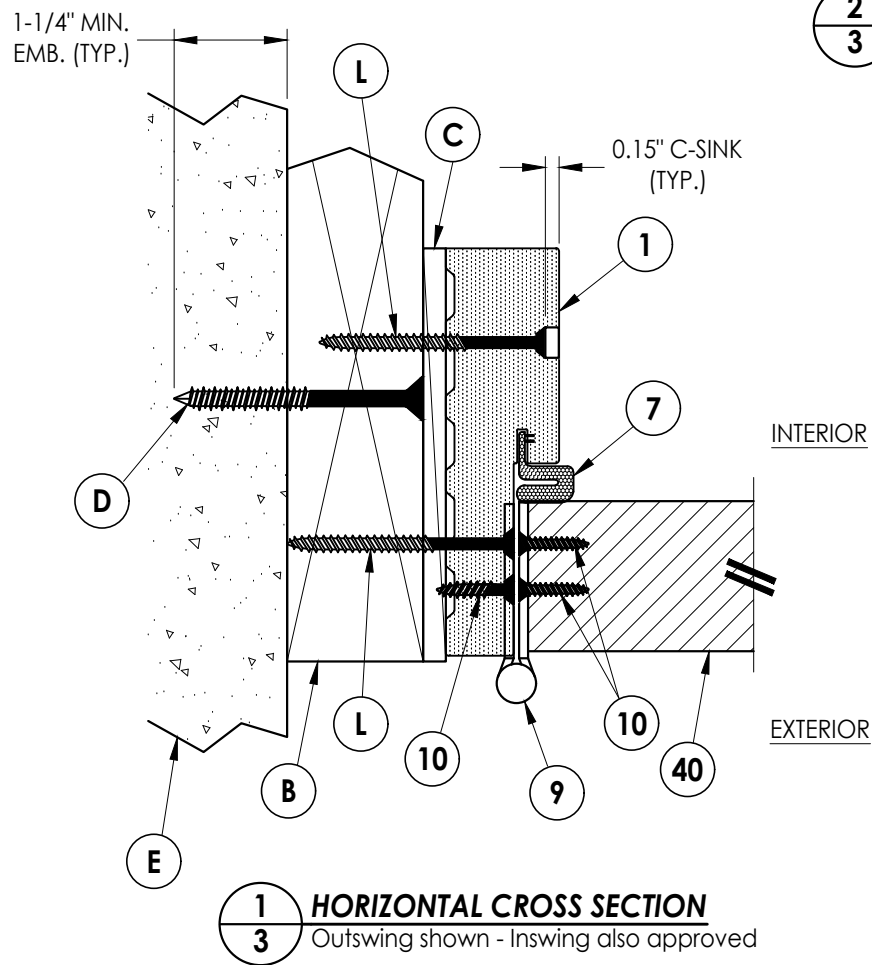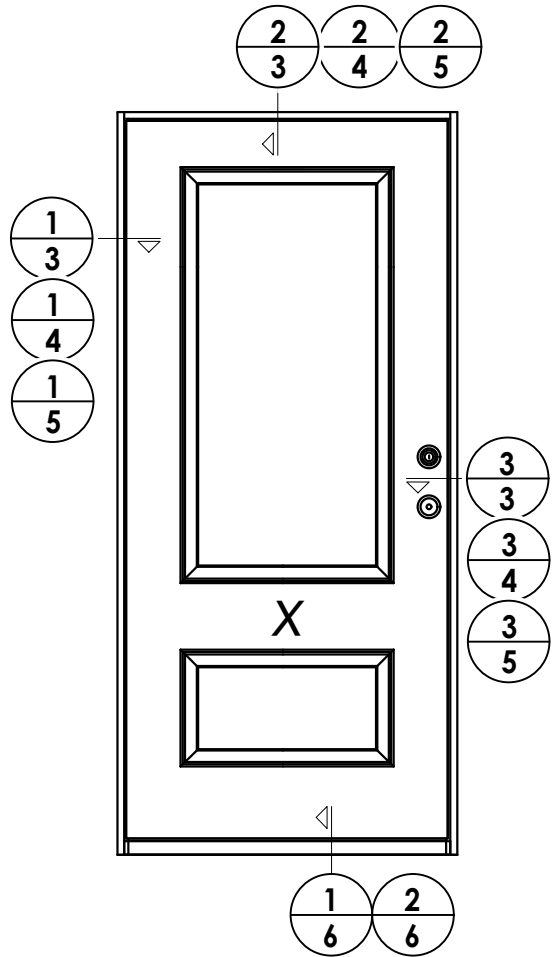


Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409				<i>RW</i> BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813			
PRODUCT: GLASSCRAFT DOOR CO.				PART OR ASSEMBLY: HORIZONTAL AND VERTICAL CROSS SECTIONS (2X BUCK)			
						NO.	DATE
						REVISIONS	
						BY	
DATE: 9/18/24							
SCALE: N.T.S.							
DWG. BY: LFS							
CHK. BY: RW							
DRAWING NO.: FL-39764.5							
SHEET 3 OF 8							


Z:\2023 FBC Drawings\GlassCraft Door Corp\FL-39764 R3\FL-39764.5.dwg

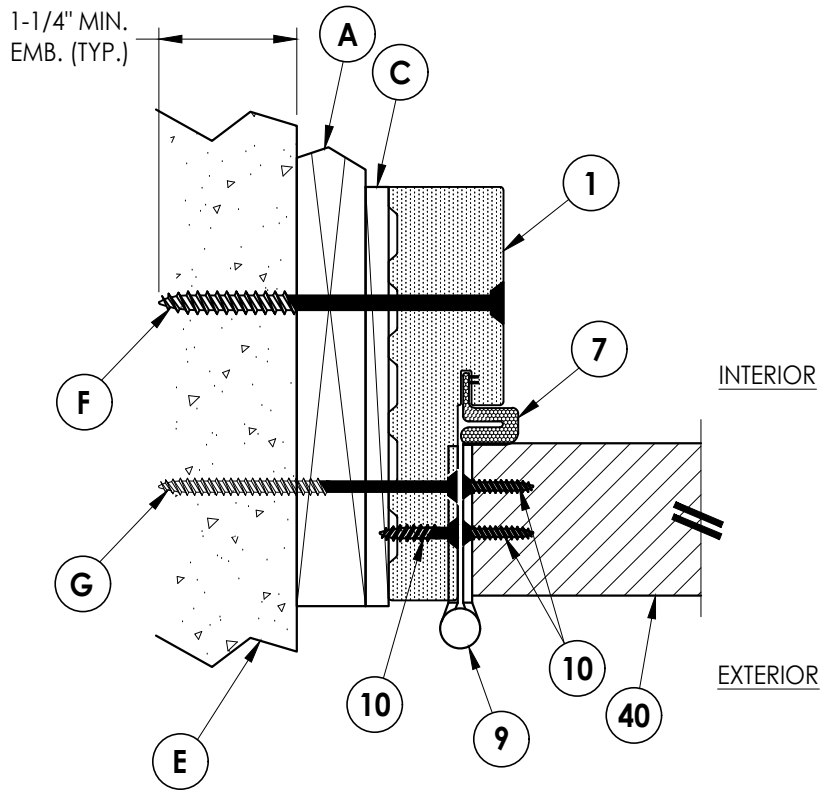

1
4 **HORIZONTAL CROSS SECTION**
Outswing shown - Inswing also approved

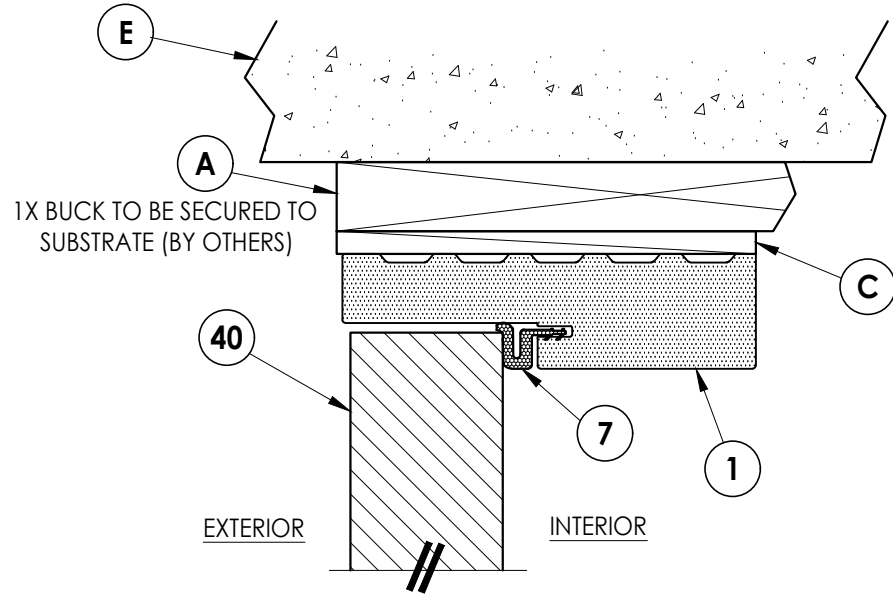


2
4 **VERTICAL CROSS SECTION**
Outswing shown - Inswing also approved

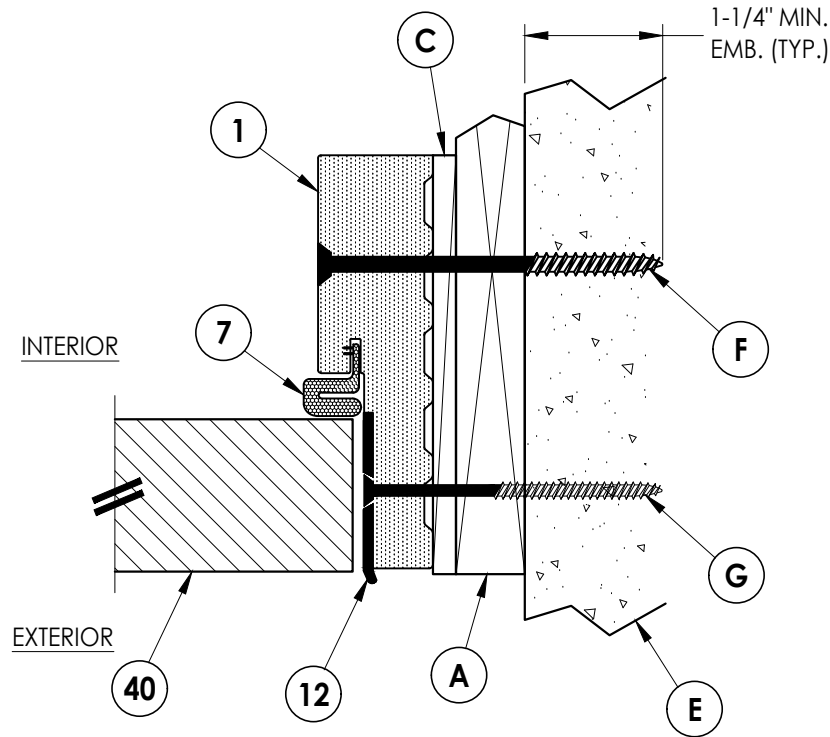


3
4 **HORIZONTAL CROSS SECTION**
Outswing shown - Inswing also approved

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409				BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813			
PRODUCT: GLASSCRAFT DOOR CO.				PART OR ASSEMBLY: HORIZONTAL AND VERTICAL CROSS SECTIONS (1X BUCK)			
				REVISIONS			
				BY			
				NO. DATE			
DATE: 9/18/24							
SCALE: N.T.S.							
DWG. BY: LFS							
CHK. BY: RW							
DRAWING NO.: FL-39764.5							
SHEET 4 OF 8							


Z:\2023 FBC Drawings\GlassCraft Door Corp\FL-39764 R3\FL-39764.5.dwg

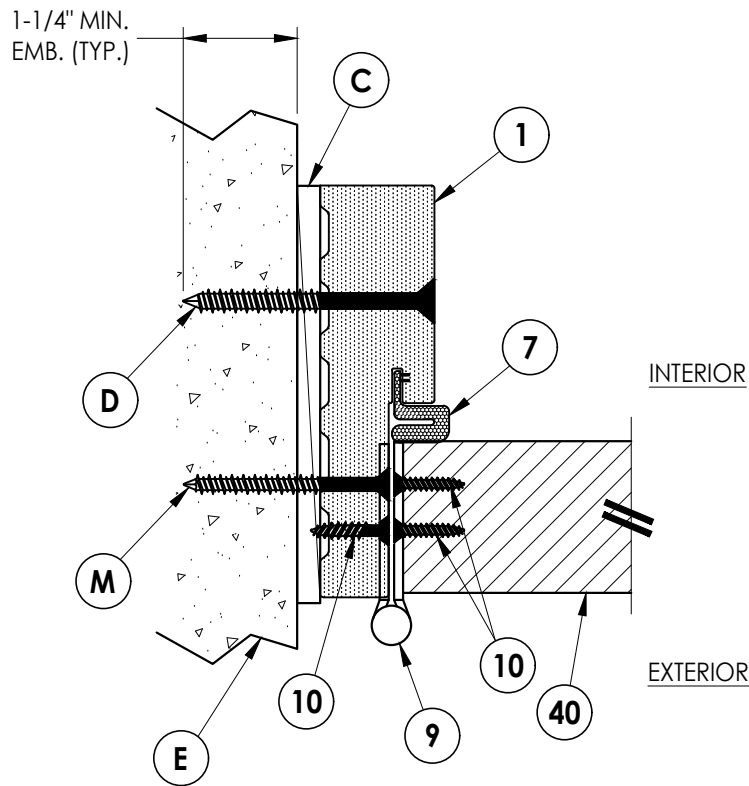

1
5 **HORIZONTAL CROSS SECTION**
Outswing shown - Inswing also approved

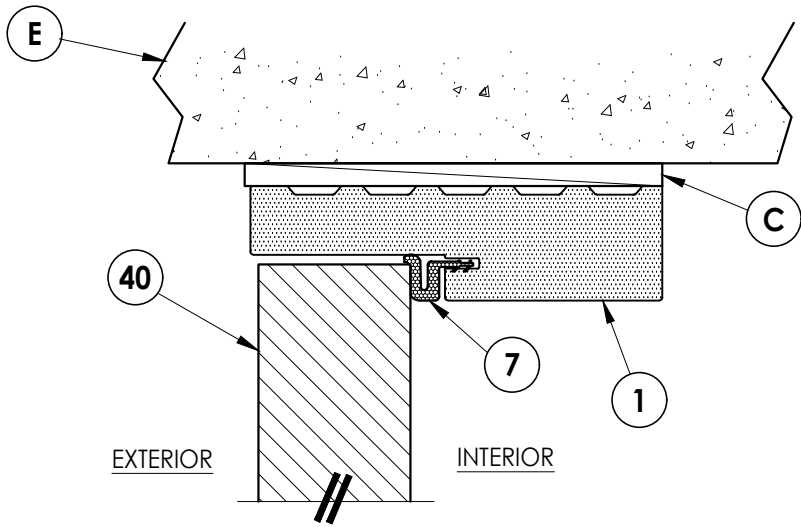

2
5 **VERTICAL CROSS SECTION**
Outswing shown - Inswing also approved

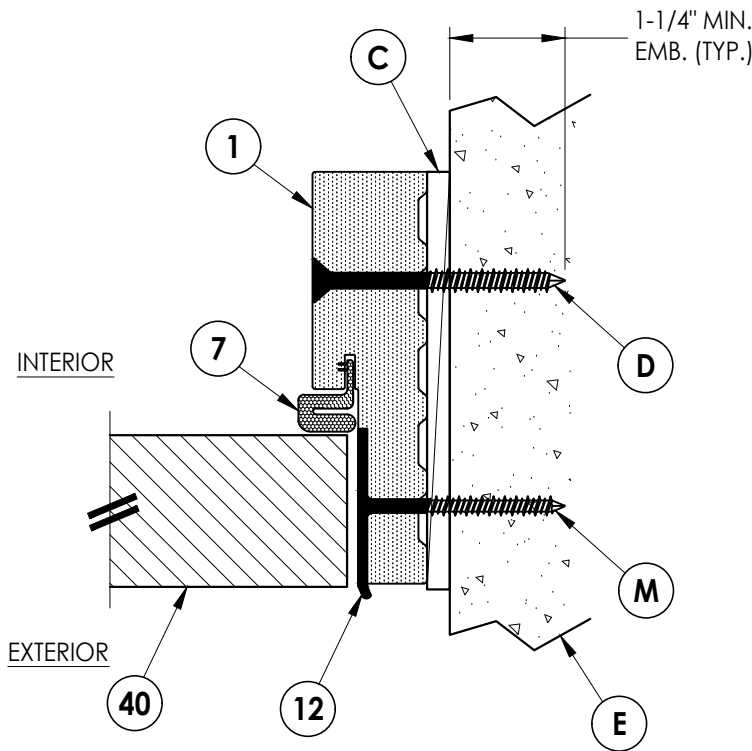

3
5 **HORIZONTAL CROSS SECTION**
Outswing shown - Inswing also approved


DATE: 9/18/24
SCALE: N.T.S.
DWG. BY: LFS
CHK. BY: RW
DRAWING NO.: FL-39764.5
SHEET 5 OF 8

PRODUCT: GLASSCRAFT DOOR CO.
PART OR ASSEMBLY: HORIZONTAL AND VERTICAL CROSS SECTIONS (DIRECT TO MASONRY)


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\GlassCraft Door Corp\FL-39764 R3\FL-39764.5.dwg

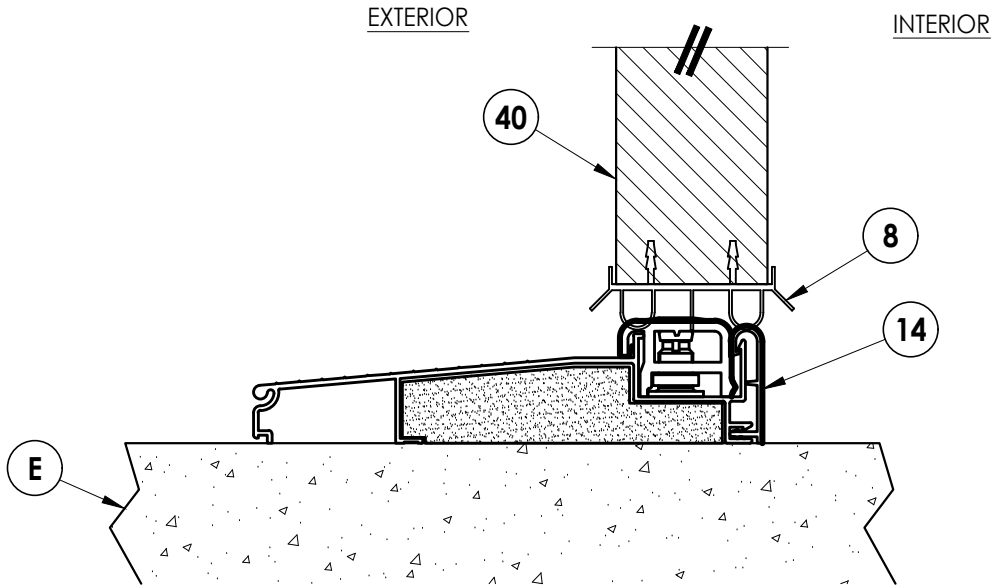

1 **VERTICAL CROSS SECTION**
6 Inswing sill

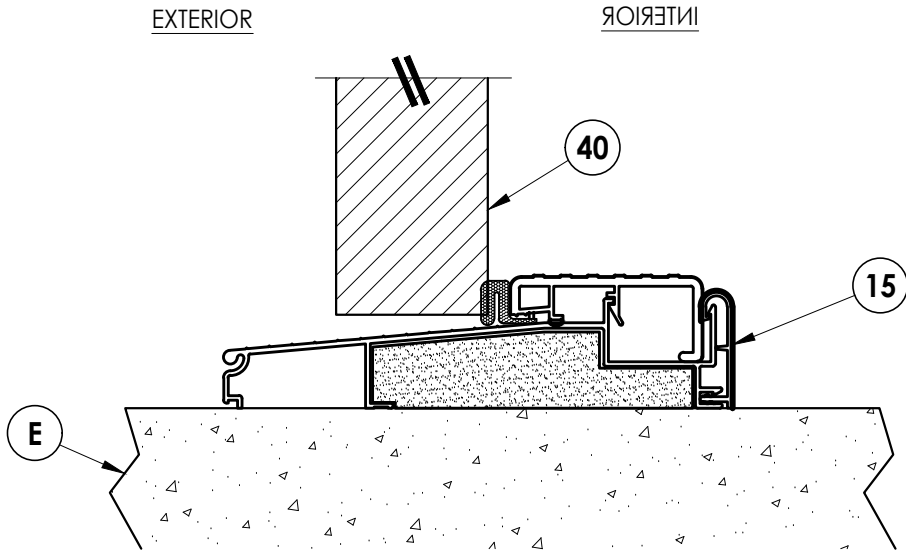

2 **VERTICAL CROSS SECTION**
6 Outswing sill

DATE: 9/18/24

SCALE: N.T.S.

DWG. BY: LFS

CHK. BY: RW

DRAWING NO.:
FL-39764.5

SHEET 6 OF 8

PRODUCT:

GLASSCRAFT DOOR CO.

PART OR ASSEMBLY:

VERTICAL CROSS SECTIONS

Documents Prepared By:

Lyndon F. Schmidt
P.E. No. 43409


RW

BUILDING CONSULTANTS, INC.

P.O. Box 230, Valrico, FL 33595

Phone No.: 813.659.9197

FBPE Registry No. 9813

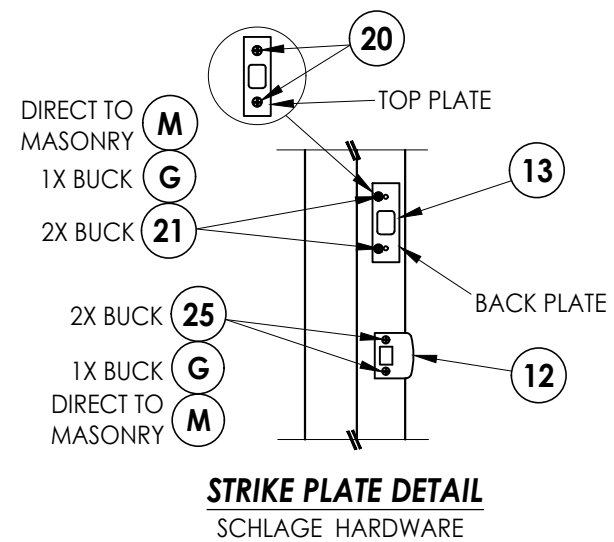

HARDWARE DETAILS

[illegible]

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R^W BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

© 2024 R.W. BUILDING CONSULTANTS INC.

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (G >= 0.42)	WOOD
B	2X BUCK (G >= 0.42)	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
G	3/16" X 3-1/4" PFH ITW CONCRETE SCREW	STEEL
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMB.)	STEEL
M	3/16" X 2-1/4" PFH ITW CONCRETE SCREW	STEEL
P	1/4" X 2-1/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
1	COMPOSITE JAMB	COMP
7	WEATHERSTRIP	FOAM
8	DOOR SWEEP	VINYL
9	4" X 4" HINGE	STEEL
10	#9 X 3/4" PFH WOOD SCREW	STEEL
12	LATCH STRIKE PLATE	STEEL
13	DEADBOLT STRIKE PLATE	STEEL
14	INSWING THRESHOLD	ALUM/COMP
15	OUTSWING THRESHOLD	ALUM/COMP
20	#8 X 1/2" PFH WOOD SCREW	STEEL
21	#12 X 2-1/2" PFH WOOD SCREW	STEEL
22	#8 X 5/8" PFH MACHINE SCREW	STEEL
25	#8 X 2-1/2" PFH WOOD SCREW	STEEL
40	DOOR PANEL	-


CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW BUILDEX TAPCON®	3/16"	1-1/4"	AS SHOWN	1-1/2"
	1/4"	1-1/4"	2"	4"
DeWALT ULTRA-CON®	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

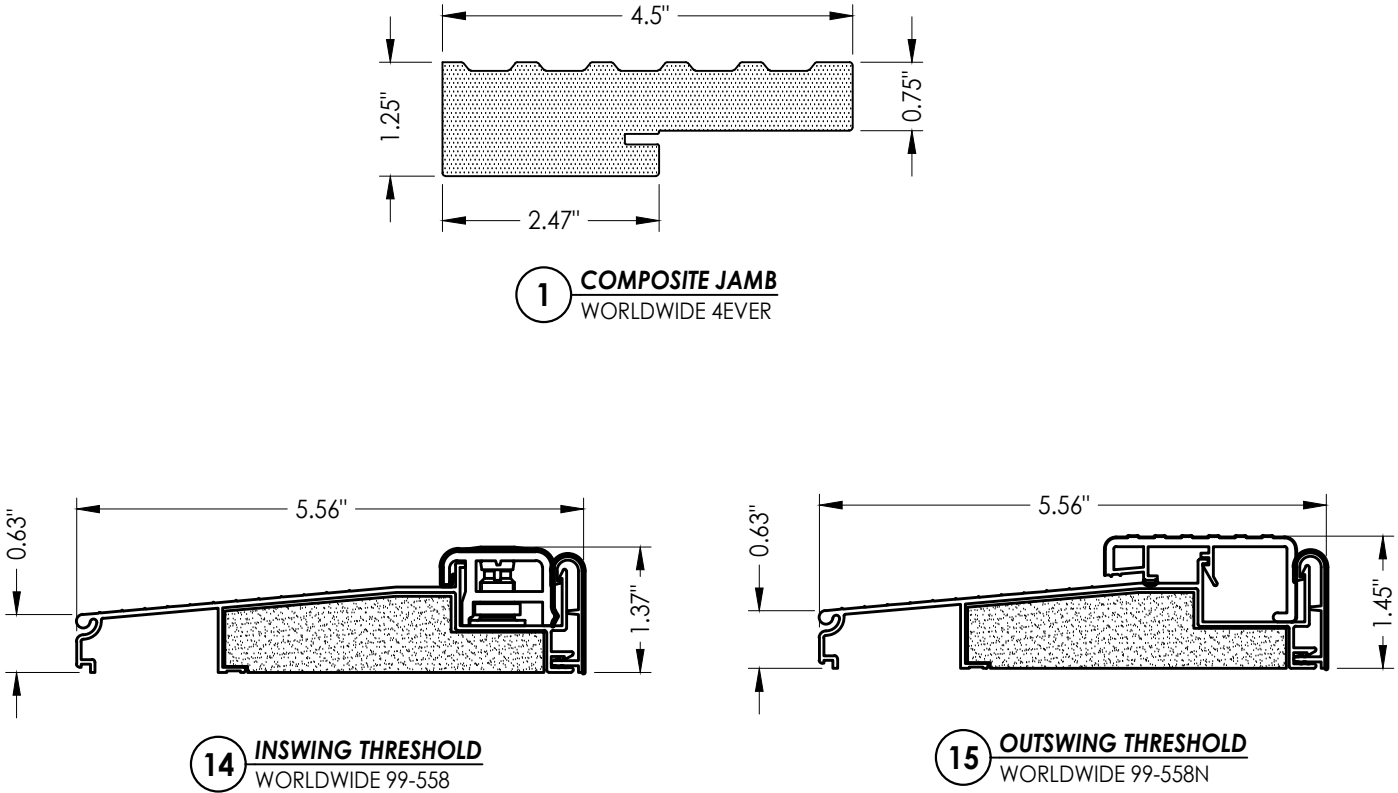[illegible]

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813