

Evaluation Report "Englert® Series 1500" Metal Roof Assembly

Manufacturer:

Englert, Inc.

1200 Amboy Avenue
Perth Amboy, NJ 08862

for

Florida Product Approval

FL 40562.1 R2

Florida Building Code 9th Edition (2026)

(HVHZ)

Method: 1 - D

Category: Roofing

Sub - Category: Metal Roofing

Product: "Series 1500" Roof Panel

Material: Aluminum

Panel Thickness: 0.032"

Panel Width: 15-1/4"

Panel Seam: Snap-Lock

Support: Wood Deck

This item has been digitally signed and sealed by James L. Buckner, P.E., on this date below. Printed copies of this document are not considered signed and sealed, and the signature must be verified on any electronic copies.


Prepared by:

James L. Buckner, P.E., SECB
Florida Professional Engineer # 31242
Florida Evaluation ANE ID: 1916
Project Manager: Diana Galloway
Report No. 26-805-S1500-A3W-hz-ER
(Revises No. 23-555-S1500-A3W-hz-ER, FL40562.1 R1)
Date: 08/12/2026

Contents:

Evaluation Report

Pages 1 – 8

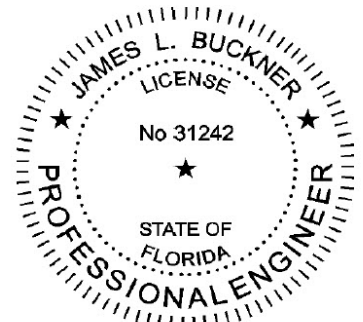

James L. Buckner, P.E.
FL31242

A handwritten signature in black ink, appearing to read "James L. Buckner".

2026.08.12 14:13:24 -04'00'

CBUCK, Inc. dba CBUCK Engineering

Phone: (561) 491-9927 · Email: cbuck@cbuckinc.net · Website: www.cbuckinc.net

Business: 1374 Community Dr., Jupiter, FL 33458

Manufacturer:	Englert, Inc. 1200 Amboy Avenue Perth Amboy, NJ 08862 (732) 826-8614 https://www.englertinc.com/
Product Name:	"Series 1500"
Product Category:	Roofing
Product Sub-Category	Metal Roofing
Compliance Method:	State Product Approval Rule 61G20-3.005 (1) (d)
Product/System Description:	"Series 1500" Standing Seam Roof Panel 0.032" Aluminum Snap-Lock roof panel mechanically attached to Wood Deck with fixed panel clips & screws.
Product Assembly as Evaluated:	Refer to Page 4 of this report for product assembly components/materials & standards: 1. Roof Panel 2. Panel Clip 3. Fasteners 4. Seam Adhesive 5. Underlayment 6. Insulation (Optional)
Support:	Type: Wood Deck (Design of support and its attachment to support framing is outside the scope of this evaluation.) Description: • 15/32" or 19/32" or greater plywood, (Per Table A) • or Wood plank (min. specific gravity of 0.42)
Slope:	3:12 (Non-HVHZ) and in compliance with FBC 1507.4.2 2:12 (HVHZ) Per FBC 1515.2 Roof slope shall be in compliance with FBC Chapter 15 based on the type of roof covering, applicable code sections and in accordance with manufacturer's recommendations.
Performance:	Wind Uplift Resistance: • Design Uplift Pressure: Refer to Table A (Refer to "Table A" attachment details herein)

Performance Standards:	The product described herein has demonstrated compliance with: TAS 125-03 – <i>Standard Requirements for Metal Roofing Systems</i>
Code Compliance:	The product(s) described herein have demonstrated compliance with the performance standards listed above as referenced in the: Florida Building Code 9th Edition (2026) Florida Building Code 9th Edition (2026), HVHZ
Evaluation Report Scope:	This product evaluation is limited to compliance with the structural requirements of the Florida Building Code, as related to the scope section to Florida Product Approval Rule 61G20-3.001.
Limitations and Conditions of Use:	<u>Scope of “Limitations and Conditions of Use” for this evaluation:</u> This evaluation report for “Optional Statewide Approval” contains technical documentation, specifications and installation method(s) which include “Limitations and Conditions of Use” throughout the report in accordance with Rule 61G20-3.005. Per Rule 61G20-3.004, the Florida Building Commission is the authority to approve products under “Optional Statewide Approval”. - This report is a building code product evaluation per FLPE rule (FAC) 61G15-36 to comply with Florida product approval rule (FAC) 61G20-3. This evaluation report is part of the Florida Building Commission approval for the listed code related criteria. This report by James Buckner, P.E. and CBUCK Engineering is not a design certification of code compliance construction submittal documentation, per FBC section 107, for any individual structure, site specific or permit design. - Metal roof and hip ridge covers are outside the scope of this evaluation. For installations outside HVHZ refer to FBC Section 1504.3.1.1. Inside HVHZ areas, Refer to FBC Section 1517.6 - Fasteners shall be corrosion resistant in accordance with applicable sections of FBC. Inside HVHZ fasteners shall comply with FBC Section 1517.5 - Installations located within 3000 feet of a saltwater coastline shall comply with FBC Section 1711 in accordance with authorities having jurisdiction. - All insulation fasteners, membrane fasteners and stress plates shall comply with FBC Section 1520.4 as applicable. - The design pressures listed herein is applicable to all roof pressure zones. Rational analysis or extrapolation to enhance pressure is not permitted in HVHZ zones. - Maximum panel lengths, valleys & panel accessories shall comply with Roofing Application Standard RAS 133 as applicable in HVHZ areas. - Deck shall be in compliance with applicable building code. - Fire Classification is outside the scope of Rule 61G20-3 and is therefore not included in this evaluation. - All panels shall be permanently labeled with the manufacturer’s name and/or logo. - This evaluation report approves the product assembly as described in this report for use in the High Velocity Hurricane Zone (HVHZ) code section. (Dade & Broward Counties) <u>Option for application outside “Limitations and Conditions of Use”</u> Rule 61G20-3.005(1)(e) allows engineering analysis for “project specific approval by the local authorities having jurisdiction in accordance with the alternate methods and materials authorized in the Code”. Any modification of the product as evaluated in this report and approved by the Florida Building Commission is outside the scope of this evaluation and will be the responsibility of others.

Quality Assurance: The manufacturer has demonstrated compliance of roof panel products in accordance with the Florida Building Code and Rule 61G20-3.0005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity through Keystone Certifications, Inc. (FBC Organization ID# QUA 1824).

**Components/Materials
(by Manufacturer):**

Roof Panel: Englert Series 1500
Material: Aluminum
Thickness: 0.032" (min.)
Panel Widths: 15-1/4" (max.) Coverage
Rib Height: 1-1/2"
Alloy Type: 3105-H14 (in compliance with ASTM B 209)
Corrosion Resistance: Per FBC 1507.4.3(2) (Non-HVHZ), 1518.9 (HVHZ)

Roof Panel Clips:

Product Name: Englert "Series 1500 Clip"
Type: One-piece, fixed clip
Material: Galvanized Steel
Thickness: 24 Gauge min,
Yield Strength: 40 ksi min.
Dimensions: 1-1/2" (tall) x 3-1/2" (wide)
Corrosion Resistance: Per FBC Section 1506.7

Fastener:

Type: Pancake-Head Wood Screw
Size: #10 x 1"
Corrosion Resistance: Per FBC 1506.6 & 1507.4.4 (Non-HVHZ), 1518.9 (HVHZ)
Standard: Per ANSI/ASME B18.6.1 (Non-HVHZ), 1517.5 (HVHZ)

Seam Adhesive/Sealant:

Product Name: Bostik 915
Type: One component, polyurethane adhesive
Application Size: 1/8" bead
Application Location: along female flange the full length of panel
(Refer to drawing Page 7)

**Components& Materials:
(by Others)**

Underlayment:

Non-HVHZ:

One of the following per FBC 9th Edition (2026), Section 1507.1.1.
ASTM D226, D1970, D4869, D6757, D8257
Installation shall comply with FBC including Sections 1507.1.1.1, 1507.1.1.2 where applicable and in accordance with roof manufacturer's recommendations.

HVHZ:

One of the following per FBC 9th Edition (2026), Section 1518.2.
ASTM D226, D1970, D4869, D6757, D8257
Installation shall comply with FBC including Sections 1518.2, 1518.2.1, Table, 1518.2.1, 1518.2.2, 1518.2.3, 1518.2.4 where applicable and in accordance with roof manufacturer's recommendations.

Components & Materials
Cont'd:
(by Others)

Fire Barrier Board:

Any approved fire barrier with current approval.

½" min. fire barrier shall be anchored with min. 12 Ga. X 1-1/4" galvanized annular ring shank roofing nails with 32 ga. tin tags spaced 6" o.c. in rows at perimeter and overlaps, and two intermediate staggered rows at 12" o.c.

(Fire classification is outside the scope of this evaluation. Refer to current fire listings for installation of fire barrier & fire rating of this system.)

Insulation (Optional):

Type: Rigid Insulation Board

Thickness: 3" (max.)

Properties:

Density: 2.25 pcf (lbs/ft³) min.

Or Compressive Strength: 20 psi min.

Insulation Notes:

- Rigid Insulation shall meet minimum density OR compressive strength.
- Insulation shall comply with FBC Section 1508. When insulation is incorporated, fastener length shall conform to penetrate thru bottom of support a minimum of 1/4".

Installation:

Installation Method:

(Refer to "TABLE A" below and drawings at the end of this evaluation report.)

- Clip Spacing: **Refer to "TABLE A" Below**
(along the length of the panel)
- Two (2) fasteners per Clip
- Rib Interlock: Snap-Lock
(Panel ribs shall be fully engaged to form an integral snap-lock.)
- Minimum fastener penetration thru bottom of support, 3/15-1/4".
- For panel construction at the end of panels, refer to manufacturer's instructions and any site specific design.

TABLE "A" ALLOWABLE LOADS							
"Series 1500" (.032" Aluminum) Roof Panel attached to Wood Deck							
#	Panel Width (max.)	Panel Clip	Clip Spacing (max.)	# of Fasteners per Clip	Seam Adhesive	Panel Seam (min.)	Design Pressure (ASD)
1	15-1/4"	3-1/2" Fixed	18"	2	YES	SnapLock	- 89.75 PSF
2	15-1/4"	3-1/2" Fixed	8"	2	YES	SnapLock	- 116 PSF
Note: Allowable design pressure(s) for allowable stress design (ASD).							

Install the "Series 1500" roof panel assembly in compliance with the installation method listed in this report and applicable code sections of FBC 9th Edition (2026). The installation method described herein is in accordance with the scope of this evaluation report. Refer to manufacturer's installation instructions as a supplemental guide for attachment.

Referenced Data:


1. TAS 125 Uplift Test
By Intertek/Architectural Testing, Inc. (FBC Organization ID# TST 1558)
Report No. M5609.01-450-18-r0 (Specimens #1-3) Date: 11/10/21
2. Quality Assurance
Keystone Certifications, Inc. (FBC Organization ID# QUA 1824)
Englert, Inc. Licensee #420
3. Certification of Independence
By James L. Buckner, P.E. @ CBUCK Engineering
(FBC Organization # ANE 1916)

**Tests Performed But
Not Evaluated In This
Report:**


1. TAS 100-95 Wind Driven Rain Test
By Intertek Testing, Inc. (FBC Organization ID# TST 3892)
Report No. N0693.01-450-44, Date: 12/06/21

Installation Method
Englert, Inc.
"Series 1500" (0.032" Aluminum) Roof Panel attached to Wood Deck

Drawings

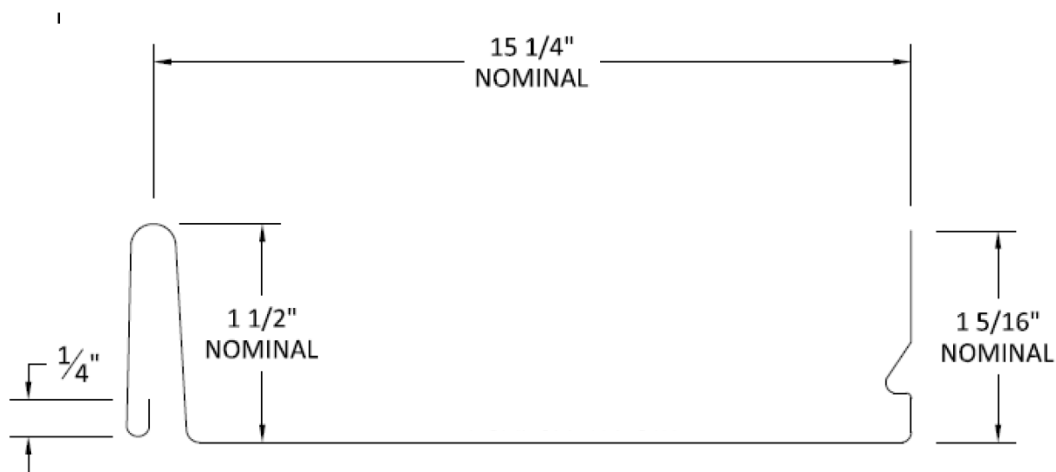

Panel Profile

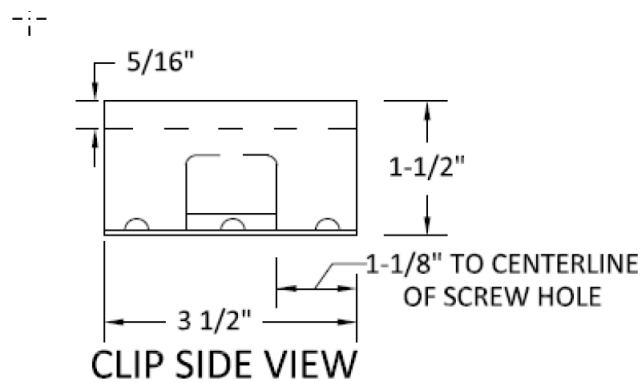


Panel Clip Profile
Englert "Series 1500 Clip"

Installation Method

Englert, Inc.

“Series 1500” (0.032” Aluminum) Roof Panel attached to Wood Deck

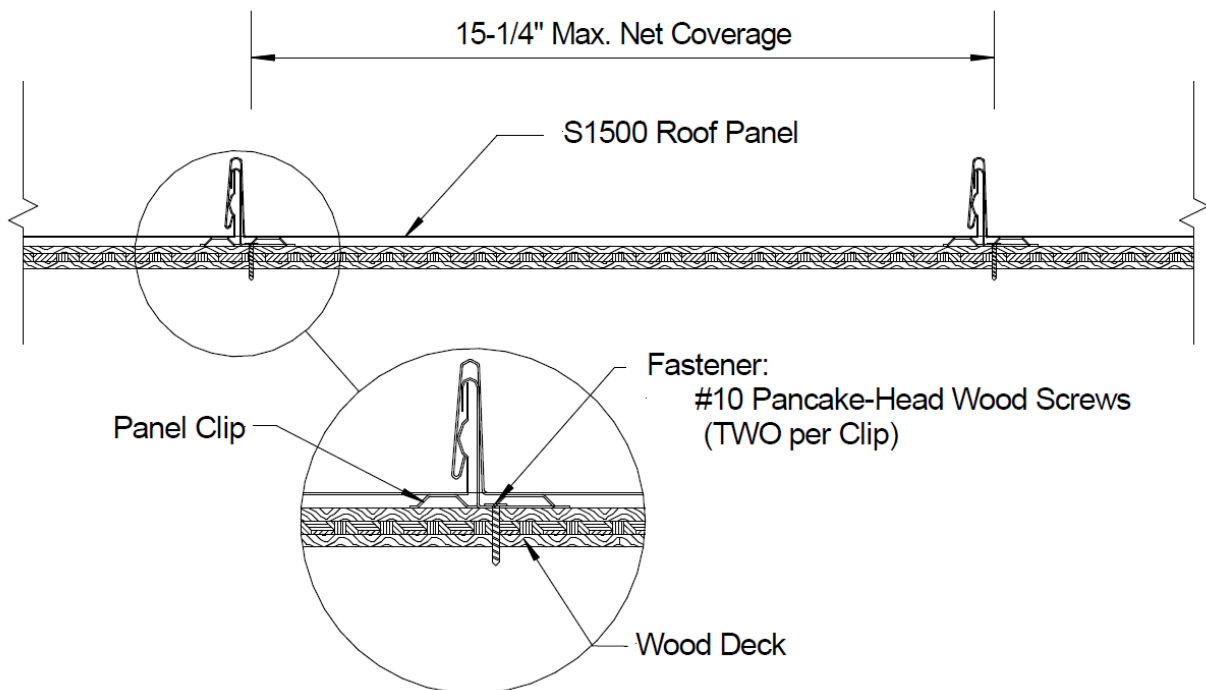

**Typical Assembly Profile View
(Typical Fastening Pattern Across Width)**

TABLE "A" ALLOWABLE LOADS "Series 1500" (.032" Aluminum) Roof Panel attached to Wood Deck							
#	Panel Width (max.)	Panel Clip	Clip Spacing (max.)	# of Fasteners per Clip	Seam Adhesive	Panel Seam (min.)	Design Pressure (ASD)
1	15-1/4"	3-1/2" Fixed	18"	2	YES	SnapLock	- 89.75 PSF
2	15-1/4"	3-1/2" Fixed	8"	2	YES	SnapLock	- 116 PSF

Note: Allowable design pressure(s) for allowable stress design (ASD).