

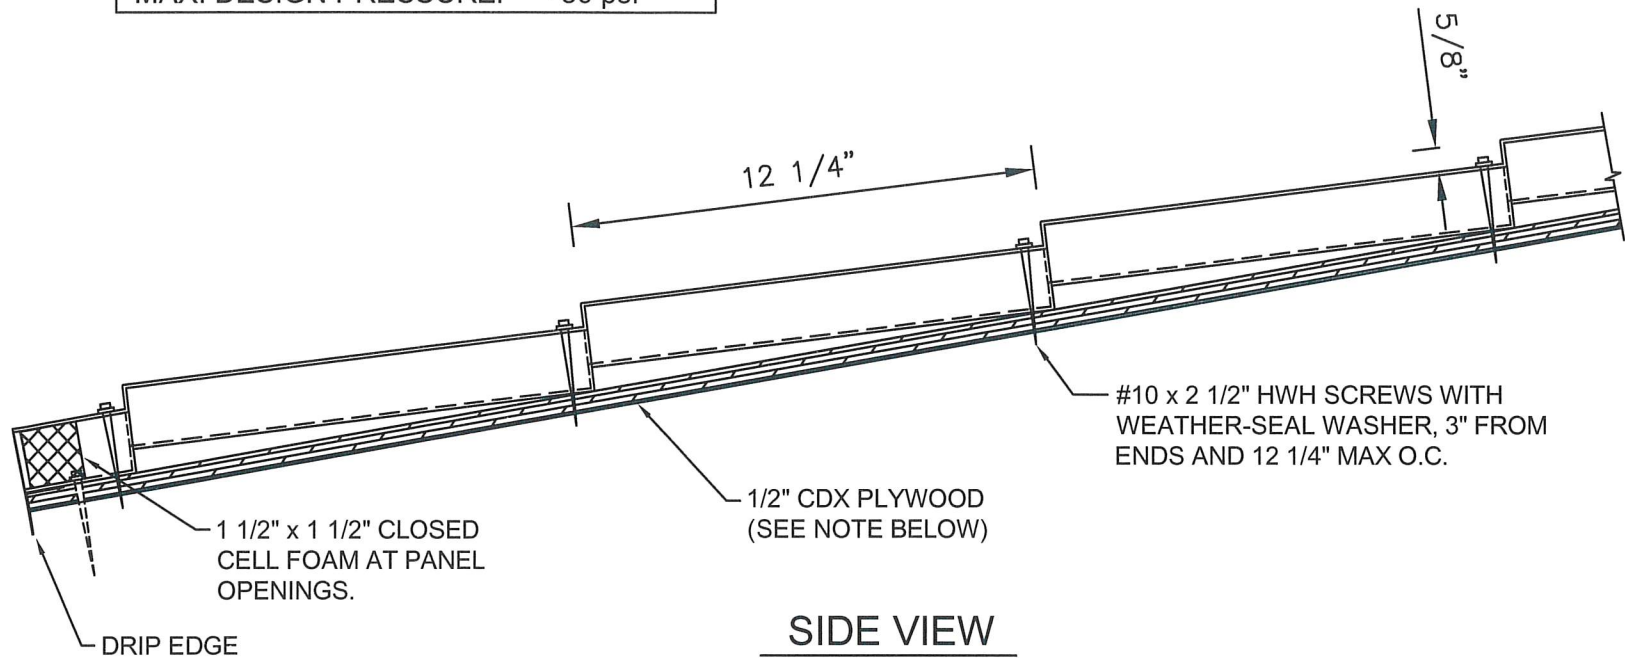


EVERLAST BARREL STEP TILE
24 Ga. STEEL ROOF PANEL OVER 1/2" PLYWOOD

MAX. DESIGN PRESSURE: -86 psf

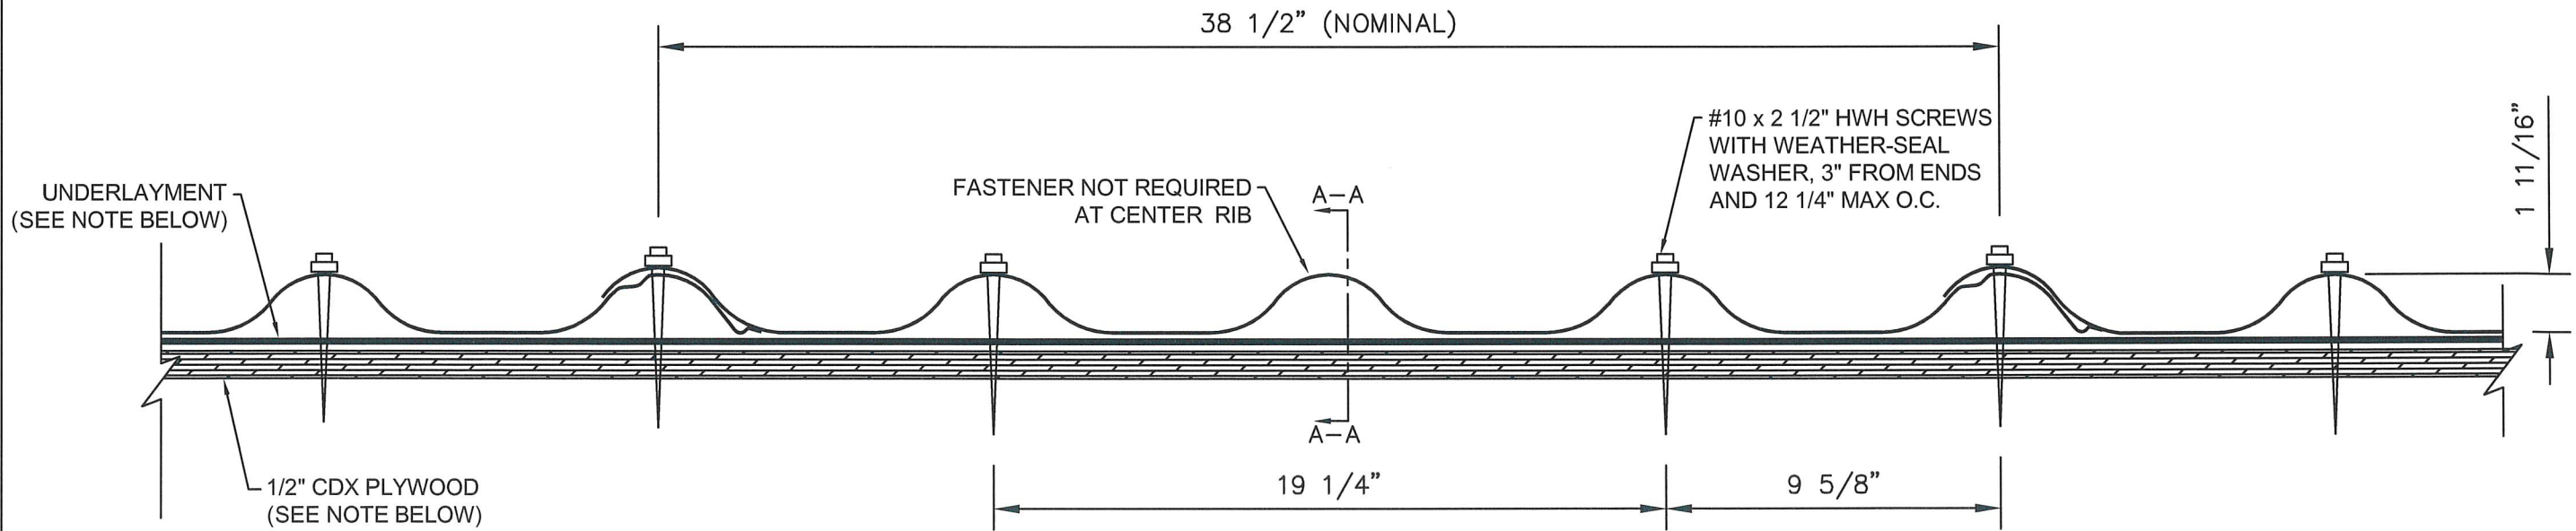

SIDE VIEW
(SECT A-A)

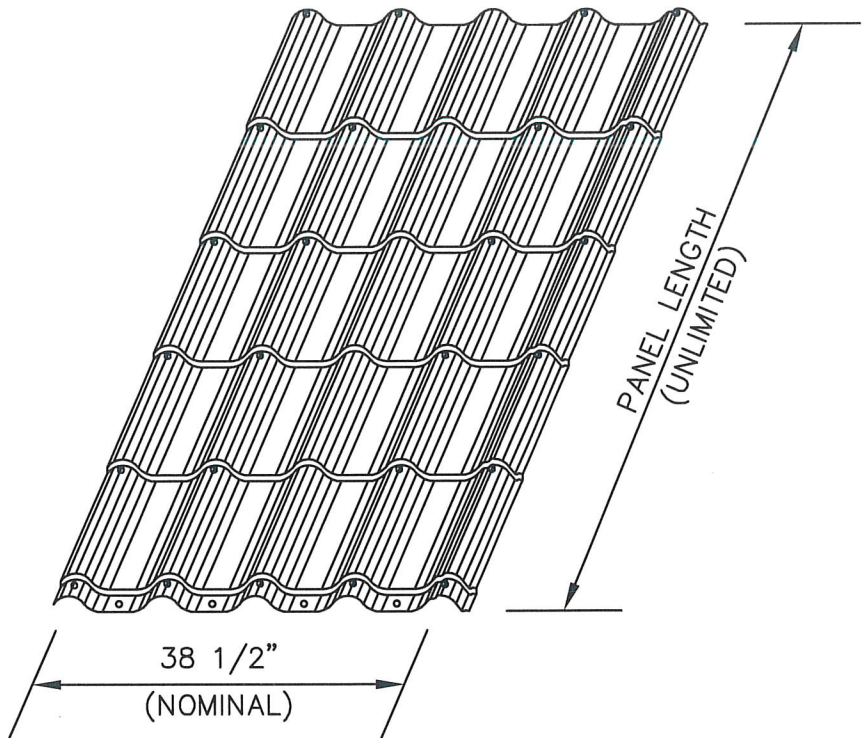

FRONT VIEW

MINIMUM ROOF DECK REQUIREMENTS


1/2" CDX PLYWOOD, FASTENED TO 2x (min) SUPPORTS SPACED 24" MAX. O.C. WITH 8d x 2" GALVANIZED RING-SHANK ROOFING NAILS SPACED 12" MAX O.C. IN THE FIELD AND 6" O.C. AT THE PERIMETER. THE ENTIRE DECK MUST BE COVERED WITH A MINERAL SURFACED PEAL AND STICK UNDERLAYMENT (min) MEETING THE REQUIREMENTS OF FBC SECTION 1507.1.1.1.

EVERLAST METAL TILE ROOF, LLC

DWG: EBST-HZ
SHEET: 1/2


912/914 ANGLE ROAD
FT. PIERCE, FL 34947
PH: (772) 343-9072
FX: (772) 343-9072

SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412
(561) 225-1982

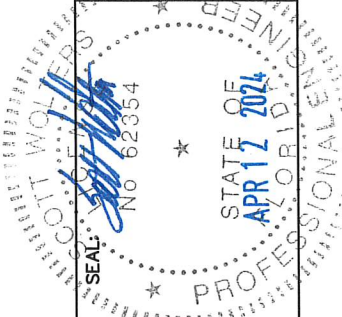

REV#	DATE	PRINTS ISSUED FOR
1	4/12/24	2023 CODE UPDATE
2	12/17/21	1ST SUBMITTAL

EVERLAST BARREL STEP TILE
24 Ga. STEEL ROOF PANEL OVER 1/2" PLYWOOD

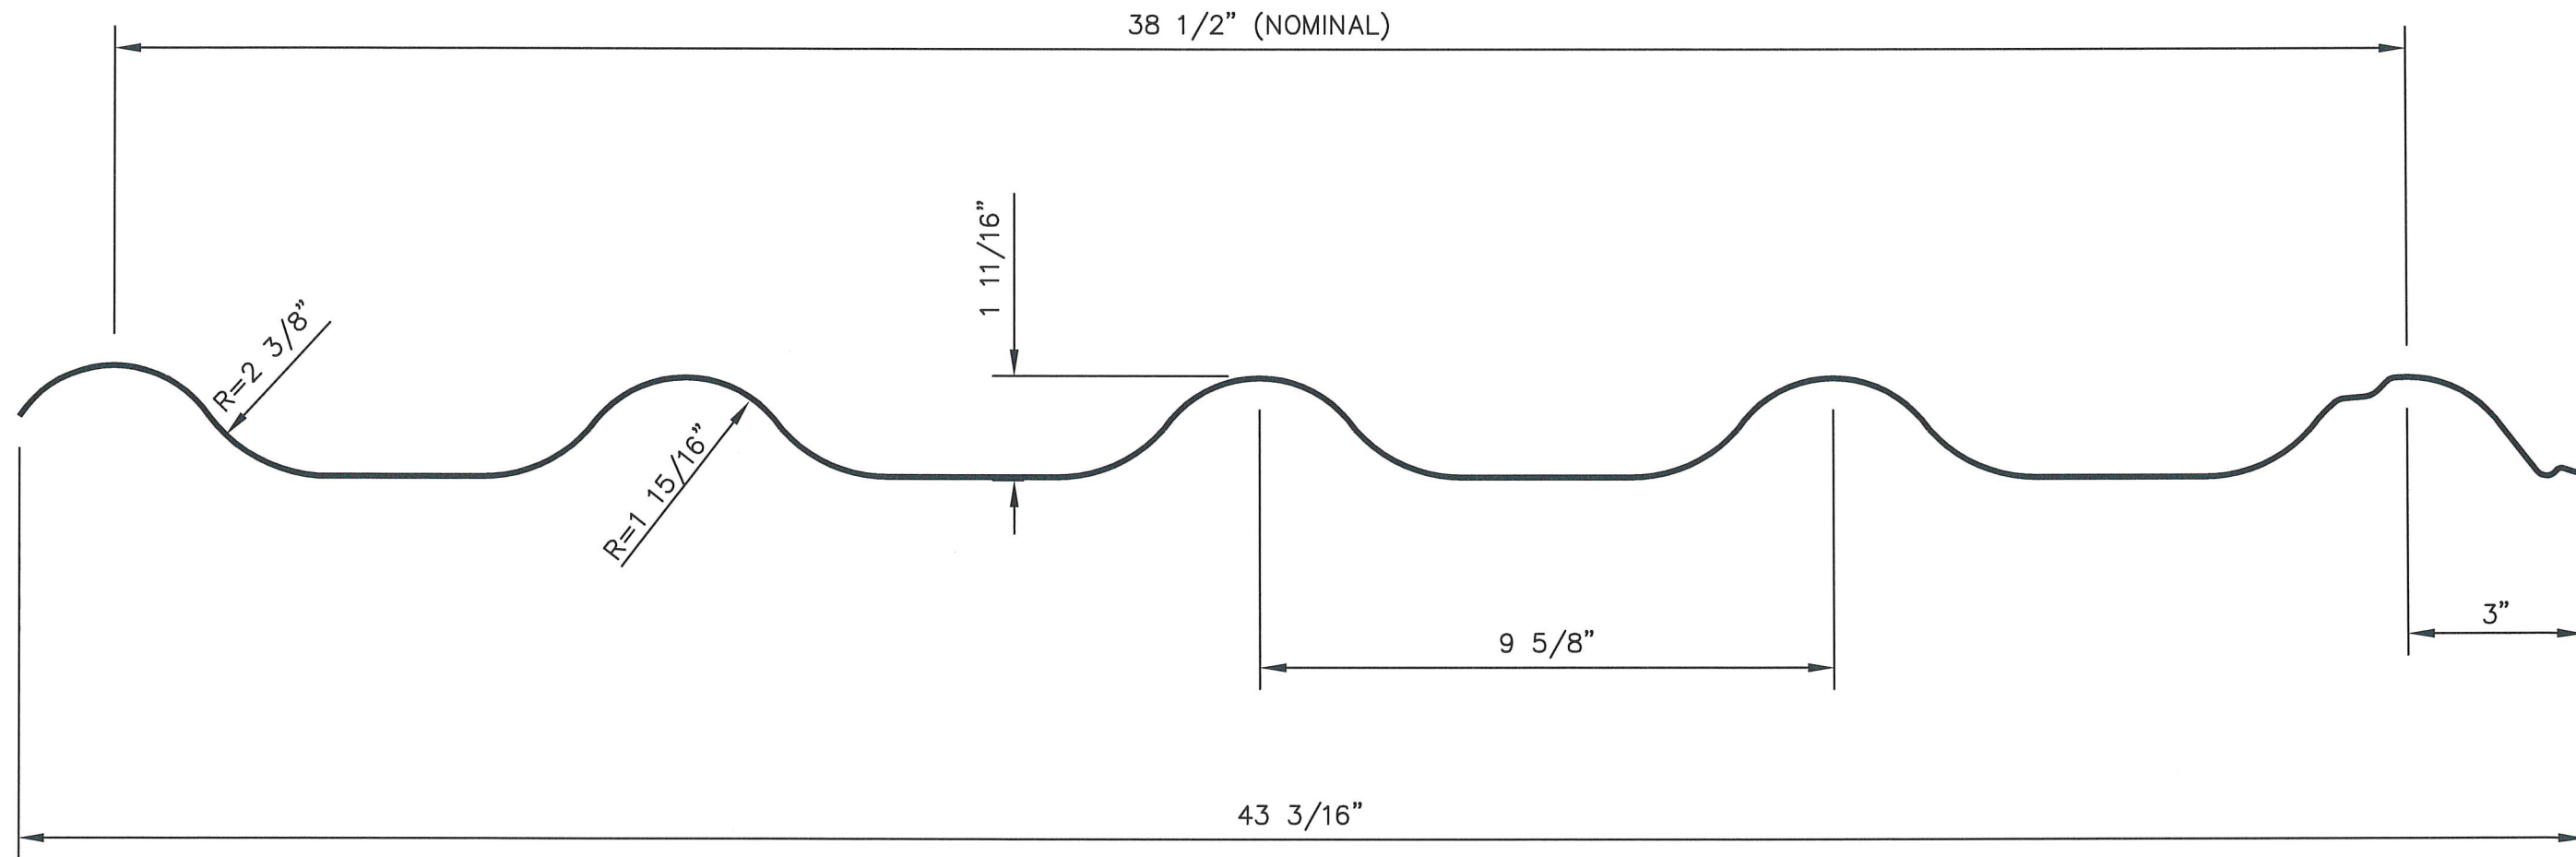


EVERLAST METAL TILE ROOF, LLC

912/914 ANGLE ROAD
FT. PIERCE, FL 34947
PH: (772) 343-9072
FX: (772) 343-9072

SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33411
(561) 225-1982

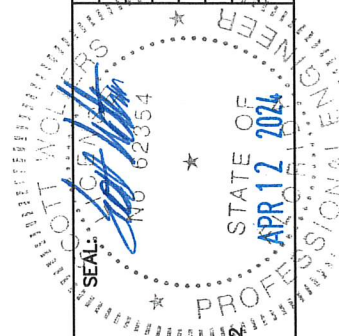[illegible]

DWG:	EBST-HZ
SHEET:	2/2