




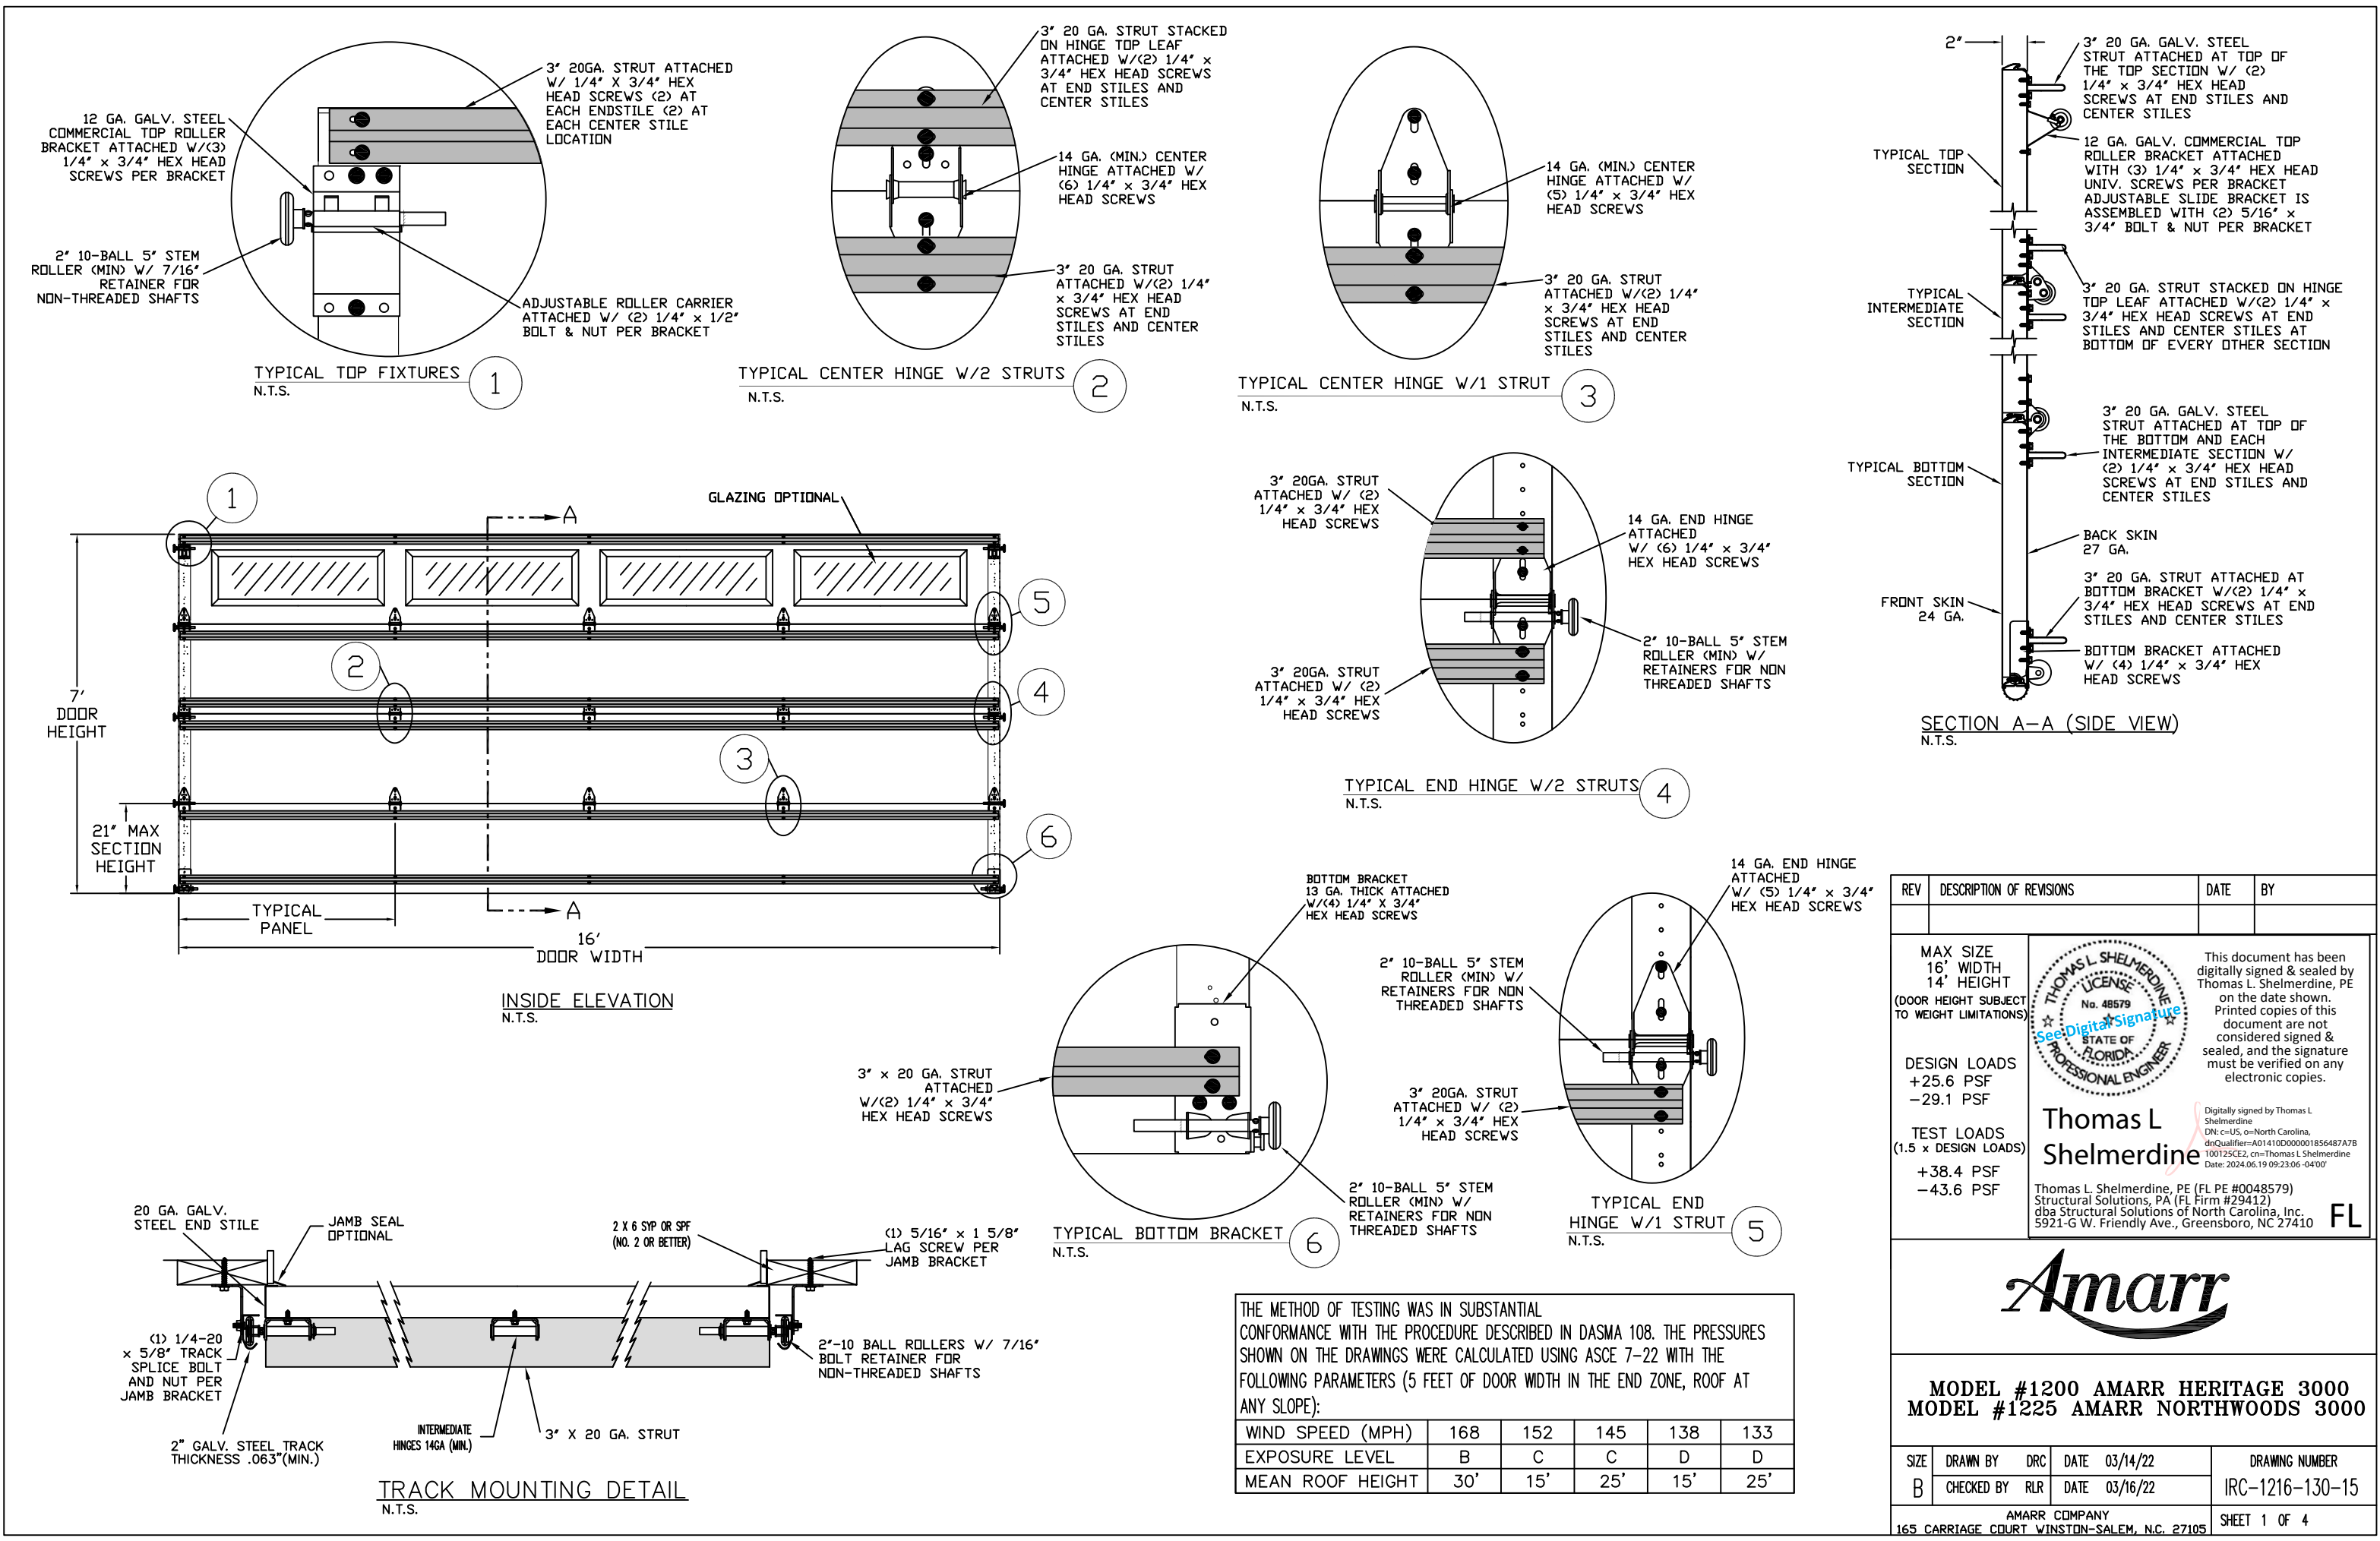


OPTIONAL SHORT AND LONG PANEL GLAZING LAYOUTS
STRUT SPACERS MAY BE USED ON GLAZED SECTIONS

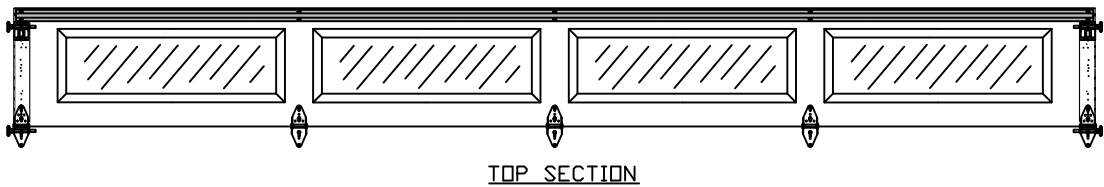


TOP SECTION

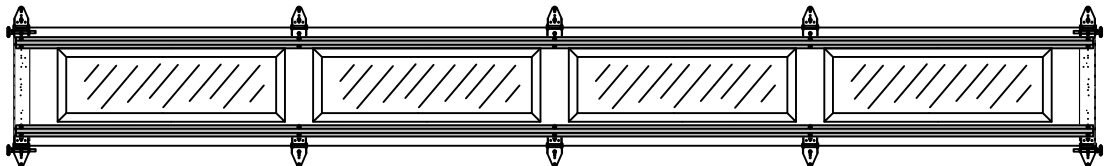


INTERMEDIATE SECTION

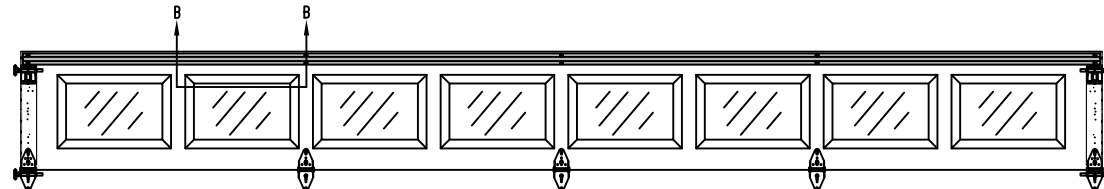


TOP SECTION

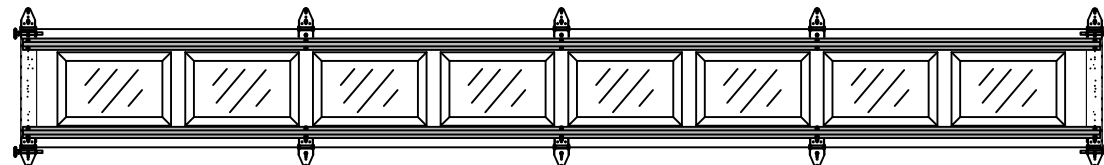

INTERMEDIATE SECTION

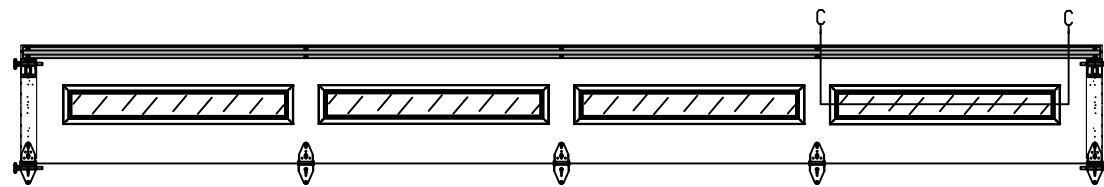


TOP SECTION

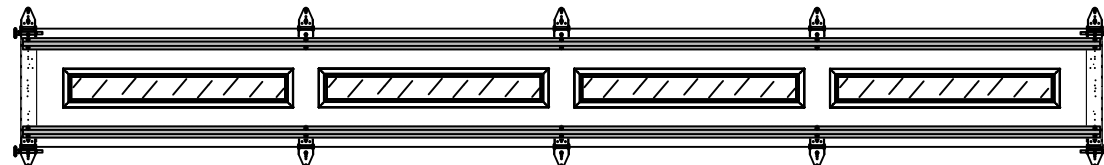


INTERMEDIATE SECTION

GLAZING OPTION CROSS SECTION


GLAZING NOT AVAILABLE IN WIND-BORNE DEBRIS REGION
GLAZING MEETS ASTM E1300-04

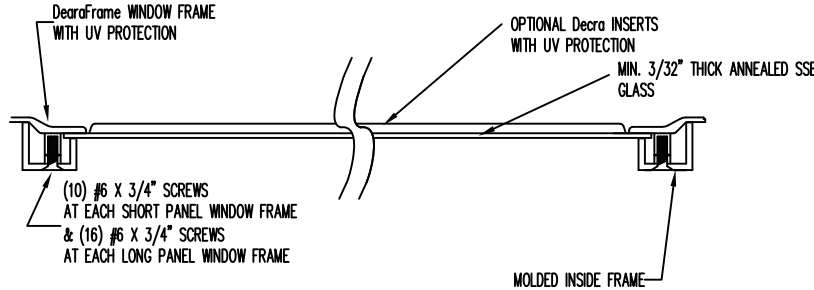


SECTION B-B

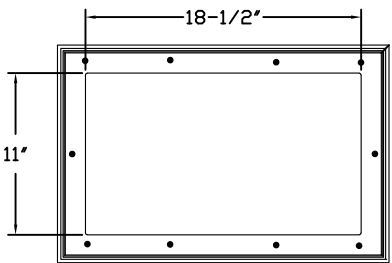

SHORT PANEL GLAZING FASTENER DETAIL
N.T.S.

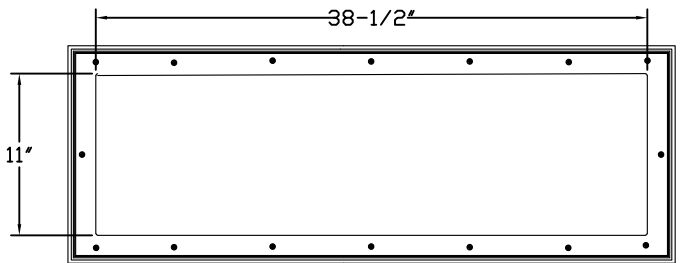

LONG PANEL GLAZING FASTENER DETAIL
N.T.S.

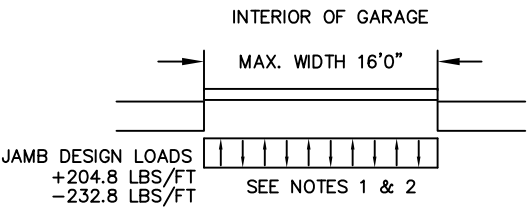


SPECIFICATIONS AND NOTES


1. ALL THE LOAD FROM THE DOOR IS TRANSFERRED TO THE VERTICAL TRACK, FROM THE TRACK THE LOAD IS TRANSFERRED TO THE VERTICAL JAMBS. THE HORIZONTAL JAMB OR HEADER RECEIVES NO PORTION OF THE LOAD TRANSFERRED FROM THE DOOR.
2. EACH VERTICAL JAMBS RECEIVES MAXIMUM DESIGN LOADS OF: +204.8 LBS/FT & -232.8 LBS/FT
3. DOOR AND HARDWARE WILL BE DESIGNED, MANUFACTURED AND INSTALLED WITH STANDARDS AS SET FORTH BY DASMA.
4. DOOR SECTIONS SHALL BE 24 GA. (.0216) MIN. EXTERIOR SKIN ROLLED FORMED, W/ BAKED ON POLYESTER FINISH
5. SUPPORTING STRUCTURAL ELEMENTS SHALL BE DESIGNED BY A REGISTRED PROFESSIONAL ENGINEER FOR WIND LOADS INDICATED ON THIS DRAWING IN ADDITION TO OTHER LOADINGS.

GLAZING OPTION CROSS SECTION

GLAZING NOT AVAILABLE IN WIND-BORNE DEBRIS REGION
GLAZING MEETS ASTM E1300-04

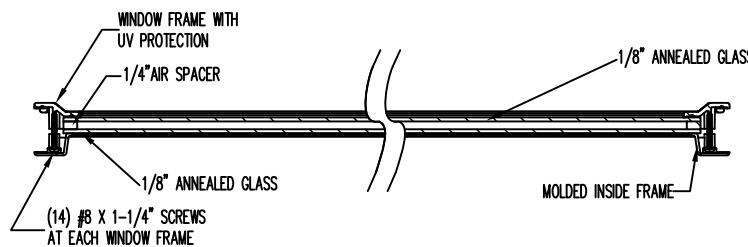

SECTION C-C

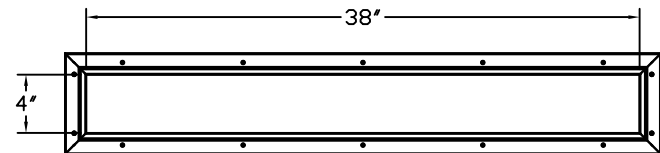


SLIMLINE PANEL GLAZING FASTENER DETAIL
N.T.S.

REV	DESCRIPTION OF REVISIONS	DATE	BY
MAX SIZE 16' WIDTH 14' HEIGHT (DOOR HEIGHT SUBJECT TO WEIGHT LIMITATIONS) DESIGN LOADS +25.6 PSF -29.1 PSF TEST LOADS (1.5 x DESIGN LOADS) +38.4 PSF -43.6 PSF		 This document has been digitally signed & sealed by Thomas L. Shelmerdine, PE on the date shown. Printed copies of this document are not considered signed & sealed, and the signature must be verified on any electronic copies. Thomas L. Shelmerdine, PE (FL PE #0048579) Structural Solutions, PA (FL Firm #29412) dba Structural Solutions of North Carolina, Inc. 5921 G W. Friendly Ave., Greensboro, NC 27410 FL	
Amarr			
MODEL #1200 AMARR HERITAGE 3000 MODEL #1225 AMARR NORTHWOODS 3000			
SIZE	DRAWN BY DRC	DATE 03/14/22	DRAWING NUMBER
B	CHECKED BY RLR	DATE 03/16/22	IRC-1216-130-15
AMARR COMPANY 165 CARRIAGE COURT WINSTON-SALEM, N.C. 27105			SHEET 2 OF 4

TABLE 4

Section	Panel Type	Center Stile Locations (Measured from Left Edge)				Max Design Loads Allowed	
		1st (in)	2st (in)	3rd (in)	4th (in)	Positive (PSF)	Negative (PSF)
10' 0	Short	48.41	71.59			34.2	38.8
10' 0	Long	60.00				20.4	23.2
10' 0	Bead Board	60.00				20.4	23.2
12' 0	Short	48.81	95.19			25.7	29.2
12' 0	Long	49.63	94.38			25.9	29.5
12' 0	Bead Board	48.31	95.69			25.6	29.0
12' 2	Short	49.64	96.36			25.4	28.8
12' 2	Long	50.08	95.92			25.5	29.0
12' 2	Bead Board	49.06	96.94			25.2	28.7
12' 4	Short	50.64	97.36			25.1	28.5
12' 4	Long	51.08	96.92			25.2	28.7
12' 4	Bead Board	49.81	98.19			24.9	28.3
12' 6	Short	50.67	99.33			24.6	28.0
12' 6	Long	51.17	98.83			24.7	28.1
12' 6	Bead Board	50.56	99.44			24.6	28.0
12' 8	Short	51.67	100.33			24.4	27.7
12' 8	Long	52.10	99.90			24.5	27.8
12' 8	Bead Board	51.31	100.69			24.3	27.6
12' 10	Short	52.25	101.75			24.0	27.3
12' 10	Long	53.10	100.90			24.2	27.5
12' 10	Bead Board	52.06	101.94			24.0	27.3
13' 0	Short	53.00	103.00			23.7	27.0
13' 0	Long	54.10	101.90			24.0	27.3
13' 0	Bead Board	52.81	103.19			23.7	26.9
13' 2	Short	54.00	104.00			23.5	26.7
13' 2	Long	55.10	102.90			23.8	27.0
13' 2	Bead Board	53.56	104.44			23.4	26.6
13' 4	Short	54.40	105.60			23.2	26.3
13' 4	Long	54.90	105.10			23.3	26.4
13' 4	Bead Board	54.31	105.69			23.1	26.3
13' 6	Short	55.40	106.60			22.9	26.1
13' 6	Long	55.90	106.10			23.0	26.2
13' 6	Bead Board	55.06	106.94			22.9	26.0
13' 8	Short	56.40	107.60			22.7	25.8
13' 8	Long	56.63	107.38			22.8	25.9
13' 8	Bead Board	55.81	108.19			22.6	25.7
13' 10	Short	57.16	83.00	108.71		29.5	33.5
13' 10	Long	57.17	108.83			22.5	25.5
13' 10	Bead Board	56.56	109.44			22.3	25.4

Section	Panel Type	Center Stile Locations (Measured from Left Edge)				Max Design Loads Allowed	
		1st (in)	2st (in)	3rd (in)	4th (in)	Positive (PSF)	Negative (PSF)
14' 0	Short	57.76	84.00	110.11		29.1	33.1
14' 0	Long	58.63	84.00	109.38		29.1	33.1
14' 0	Bead Board	57.31	110.69			22.1	25.1
14' 2	Short	58.85	85.00	111.41		28.8	32.7
14' 2	Long	59.17	85.00	110.83		28.8	32.7
14' 2	Bead Board	58.06	111.94			21.8	24.8
14' 4	Short	59.16	86.00	112.71		28.4	32.3
14' 4	Long	60.17	86.00	111.83		28.4	32.3
14' 4	Bead Board	58.81	113.19			21.6	24.6
14' 6	Short	59.86	87.00	114.01		28.1	31.9
14' 6	Long	61.17	87.00	112.83		28.1	31.9
14' 6	Bead Board	59.56	114.44			21.4	24.3
14' 8	Short	60.56	88.00	115.31		27.8	31.6
14' 8	Long	44.81	88.00	131.19		27.8	31.6
14' 8	Bead Board	60.31	115.69			21.1	24.0
14' 10	Short	61.26	89.00	116.61		27.5	31.2
14' 10	Long	45.60	89.00	132.40		27.5	31.2
14' 10	Bead Board	61.06	116.94			20.9	23.8
15' 0	Short	61.94	90.00	117.94		27.2	30.9
15' 0	Long	46.60	90.00	133.40		27.2	30.9
15' 0	Bead Board	61.81	118.19			20.7	23.5
15' 2	Short	62.66	91.00	119.21		26.9	30.5
15' 2	Long	47.60	91.00	134.40		26.9	30.5
15' 2	Bead Board	62.56	119.44			20.5	23.3
15' 4	Short	53.60	79.20	104.80	130.40	26.6	30.2
15' 4	Long	47.25	92.00	136.75		26.6	30.2
15' 4	Bead Board	63.31	120.69			20.3	23.0
15' 6	Short	46.62	93.00	139.38		26.3	29.9
15' 6	Long	47.60	93.00	138.40		26.3	29.9
15' 6	Bead Board	47.42	93.00	138.58		26.3	29.9
15' 8	Short	47.62	94.00	140.38		26.0	29.6
15' 8	Long	48.60	94.00	139.40		26.0	29.6
15' 8	Bead Board	48.02	94.00	139.98		26.0	29.6
15' 10	Short	48.62	95.00	141.38		25.7	29.3
15' 10	Long	49.17	95.00	140.83		25.7	29.3
15' 10	Bead Board	48.62	95.00	141.38		25.7	29.3
16' 0	Short	49.62	96.00	142.38		25.6	29.1
16' 0	Long	50.60	96.00	141.40		25.6	29.1
16' 0	Bead Board	48.42	96.00	143.58		25.6	29.1

REV	DESCRIPTION OF REVISIONS	DATE	BY
MAX SIZE 16' WIDTH 14' HEIGHT (DOOR HEIGHT SUBJECT TO WEIGHT LIMITATIONS) DESIGN LOADS +25.6 PSF -29.1 PSF TEST LOADS (1.5 x DESIGN LOADS) +38.4 PSF -43.6 PSF		 This document has been digitally signed & sealed by Thomas L. Shelmerdine, PE on the date shown. Printed copies of this document are not considered signed & sealed, and the signature must be verified on any electronic copies. Thomas L. Shelmerdine, PE (FL PE #0048579) Structural Solutions, PA (FL Firm #29412) dba Structural Solutions of North Carolina, Inc. 5921-G W. Friendly Ave., Greensboro, NC 27410 FL	
			
MODEL #1200 AMARR HERITAGE 3000 MODEL #1225 AMARR NORTHWOODS 3000			
SIZE	DRAWN BY	DRC	DATE
B	CHECKED BY	RLR	DATE
		03/14/22	03/16/22
DRAWING NUMBER			
AMARR COMPANY			
165 CARRIAGE COURT WINSTON-SALEM, N.C. 27105			SHEET 4 OF 4