

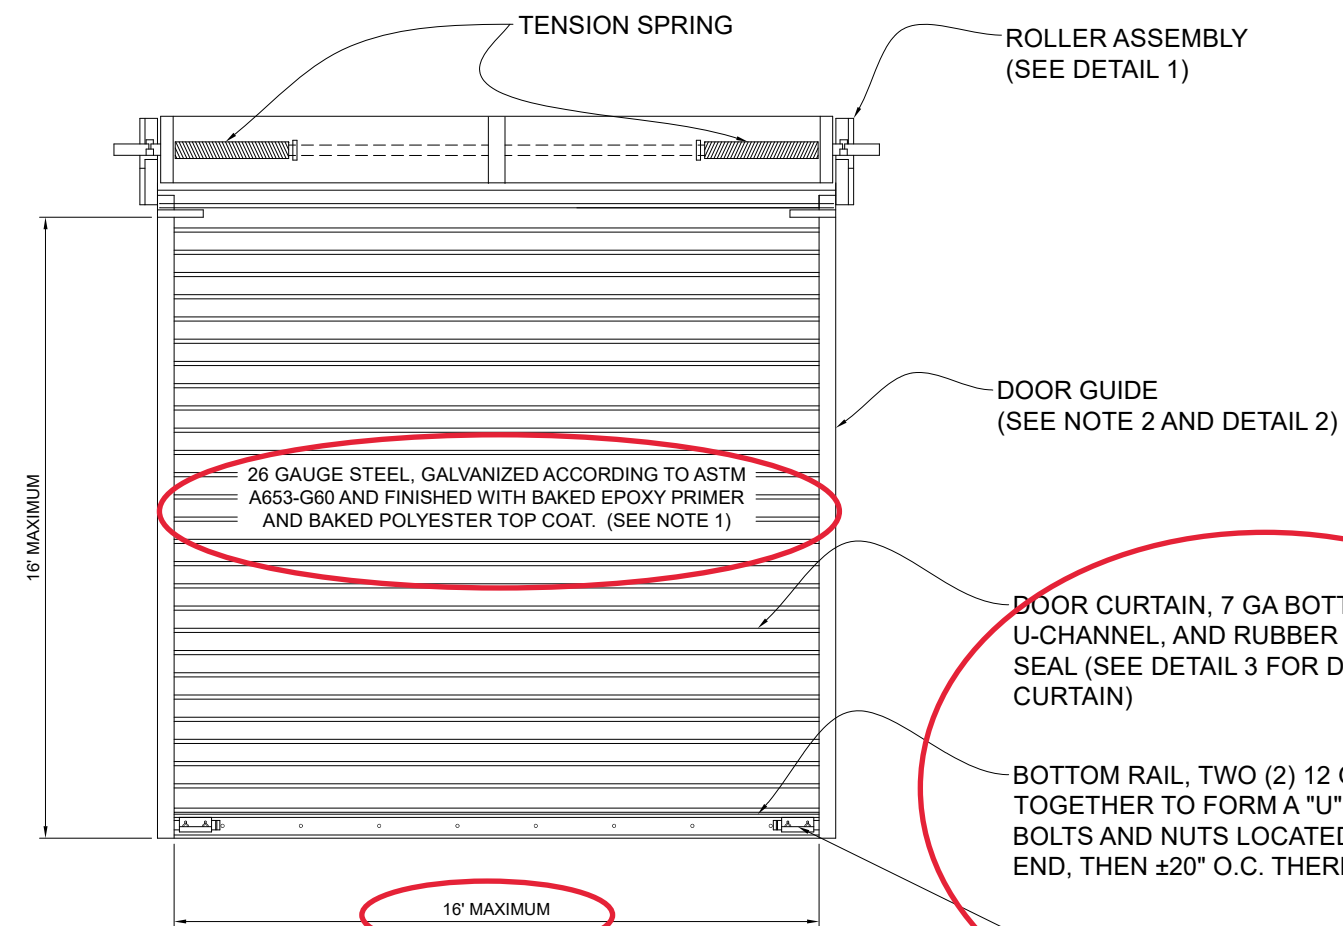
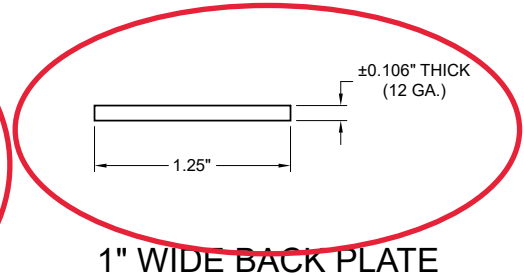
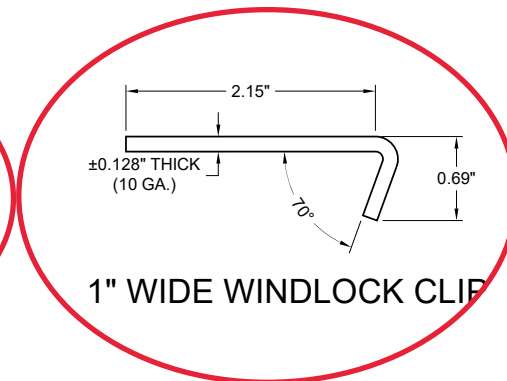
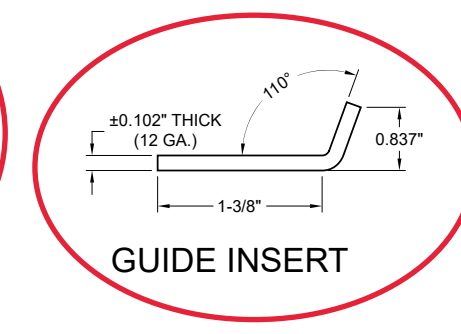
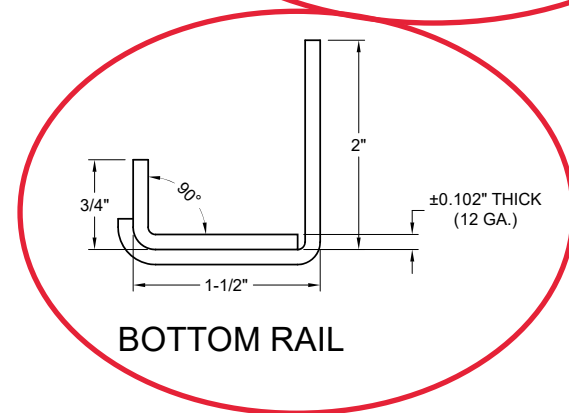
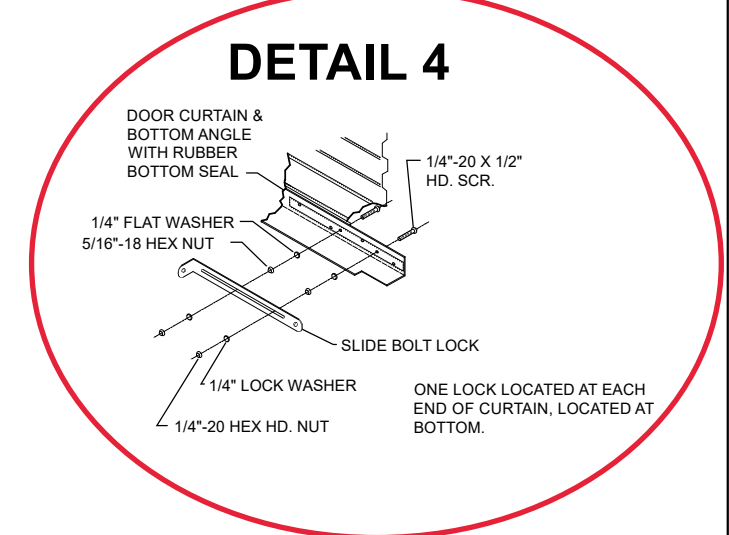
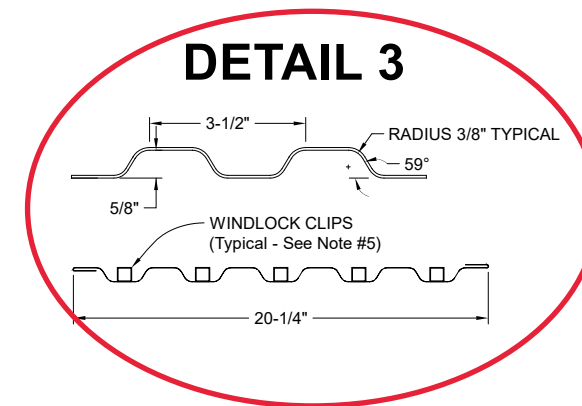


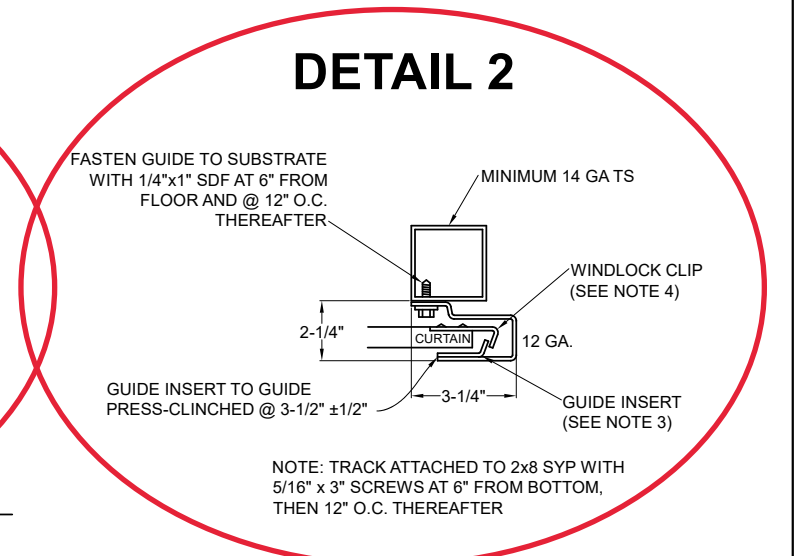

INTERIOR ELEVATION

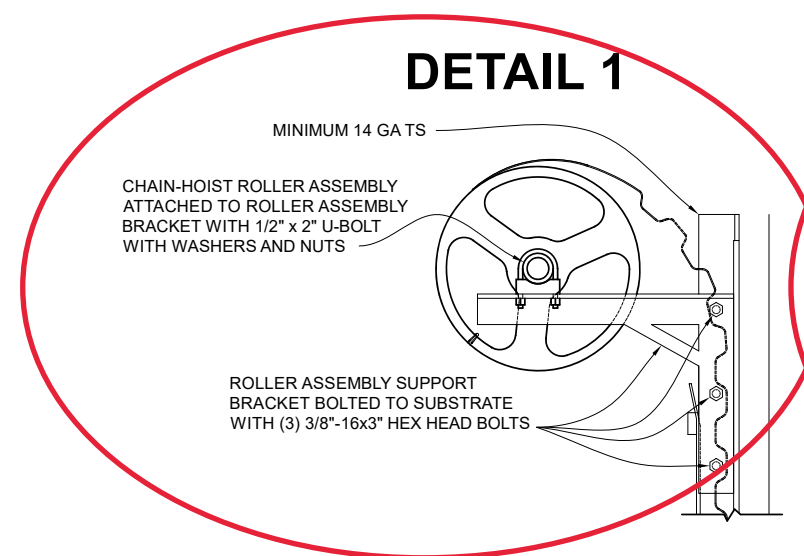

NOTES:

1. STEEL FOR CORRUGATED SHEET ASTM A653 WITH A MINIMUM YIELD STRENGTH OF 80 KSI AND TENSILE STRENGTH OF 82 KSI. (GRADE 80)
2. GUIDES ROLL FORMED 12 GAUGE GALVANIZED STEEL.
3. GUIDE INSERT FORMED 12 GAUGE GALVANIZED STEEL.
4. 10 GAUGE GALVANIZED STEEL WINDLOCK CLIP FASTENED WITH TWO 3/16\" X .440\" POP RIVETS ON FIVE CORRUGATIONS PER SIDE OF EACH SHEET (SEE DETAILS #2 AND #3).
5. ROLL-UP DOORS REQUIRE WINDLOCK CLIPS IN EVERY CHANNEL OF THE DOOR CURTAIN, FASTENED WITH POP RIVETS.

AMERICAN TEST LAB NORTH
DATE 04/14/22
REPORT NO. ATLNC 0131.01-22

Keith Owen
ATL INSPECTOR

TEST SIZE	DESIGN PRESSURE	TEST PRESSURE
16' WIDE x 8' HIGH	+35 psf / -38 psf	+52.5 psf / -57 psf
CAROLINA CARPORTS, INC. ROLL-UP SHEET DOOR 16' MAXIMUM WIDTH		
Carolina Carports Inc. 187 Cardinal Ridge Trail Dobson, NC 27017 Phone: (800) 670-4262		FIELD: N/A DATE: 04/12/22 DRAWN: RR SCALE: NTS CHECKED: TB PROJ. NO.: G22001 APPROVED: TB SHEET 1 OF 1