


7/13/2026 10:37 AM
c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 17111.dwg
c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 17111.dwg

DRUTEX S.A.


IGLO ENERGY CLASSIC FIXED WINDOW (HVHZ)(IMPACT)

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
 - AAMA/WDMA/CSA 101/I.S.2/A440-17
 - ASTM E1886-13a
 - ASTM E1996-17
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: uPVC
- GLASS MEETS THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAILS.

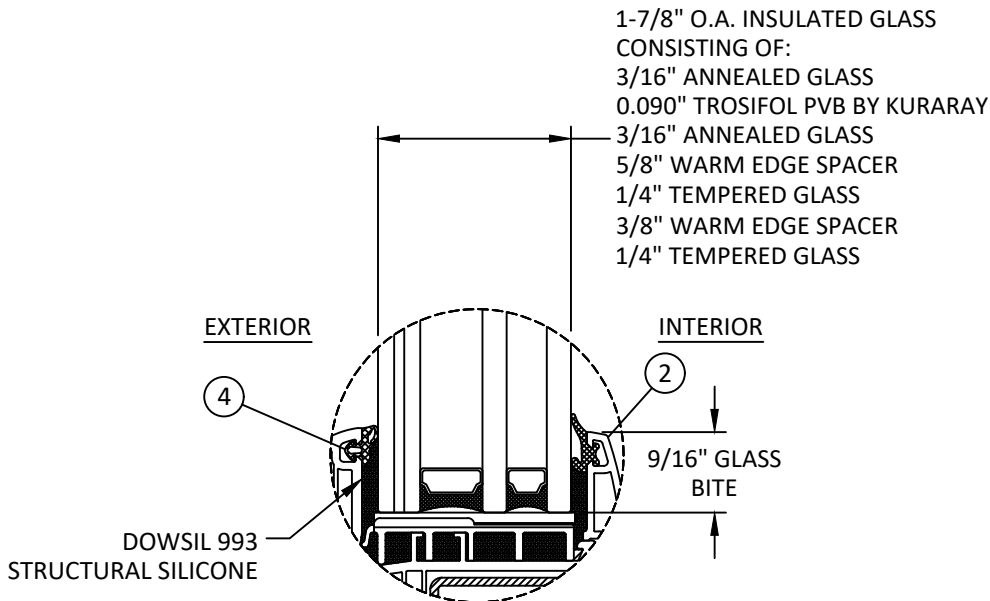

GLAZING DETAIL 1

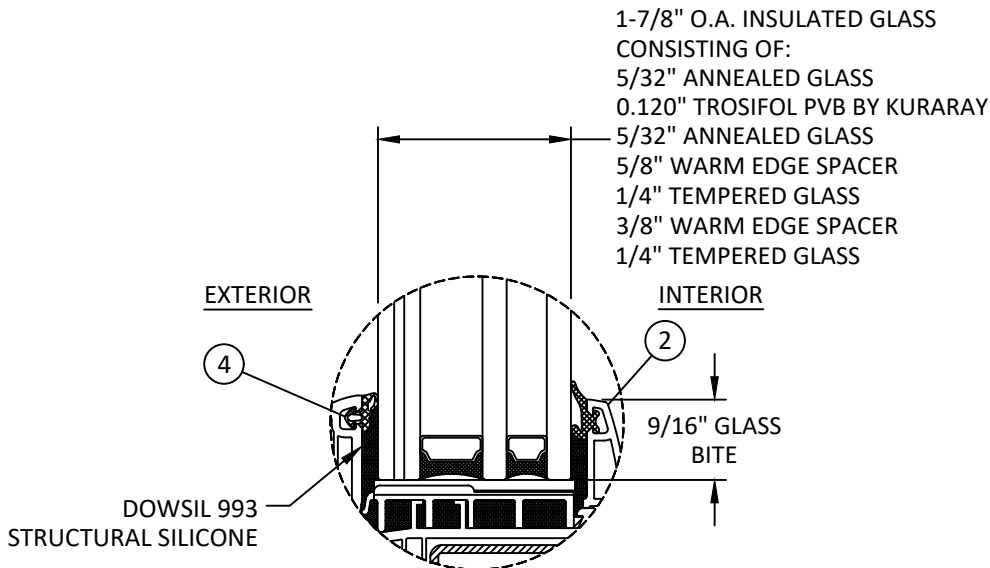


GLAZING DETAIL 1

GLAZING NOTES:

- GLASS TYPE COMPLIES WITH ASTM E1300 REQUIREMENTS. PER THE FBC TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
- SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
- SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
- D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES AND GLAZING DETAILS
2	ELEVATION AND DESIGN PRESSURE TABLE
3	ANCHOR LAYOUTS
4	VERTICAL SECTIONS
5	HORIZONTAL SECTIONS
6	ANCHOR DETAILS AND INSTALLATION NOTES
7	BILL OF MATERIALS & COMPONENTS

DESIGN PRESSURE RATING (PSF)				
CONFIGURATION	WIDTH (IN.)	HEIGHT (IN.)	DESIGN PRESSURE	MISSILE IMPACT RATING
O	SEE TABLE ON SHEET 2			LARGE & SMALL MISSILE IMPACT

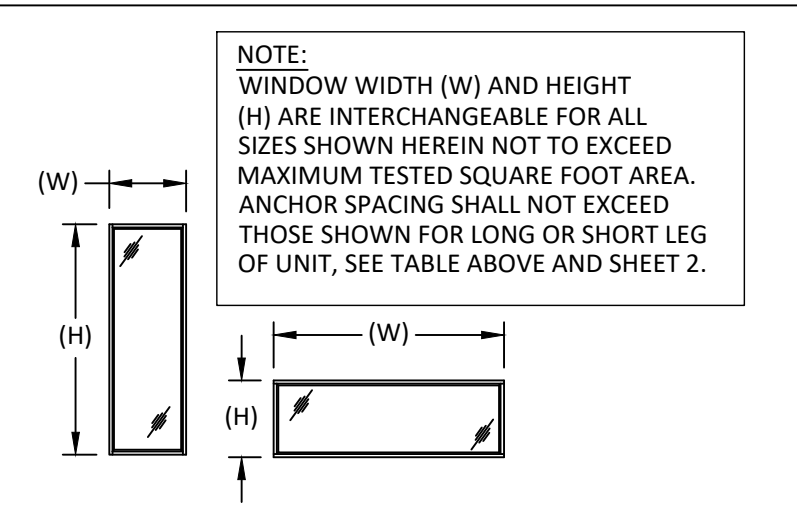

LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE: IGLO ENERGY CLASSIC FIXED WINDOW (HVHZ) (IMPACT)

GENERAL NOTES & GLAZING DETAILS

PREPARED BY:

BUILDING DROPS, INC.


1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE CHANGE	FB	10/23
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.08.07 10:11:57 -0400

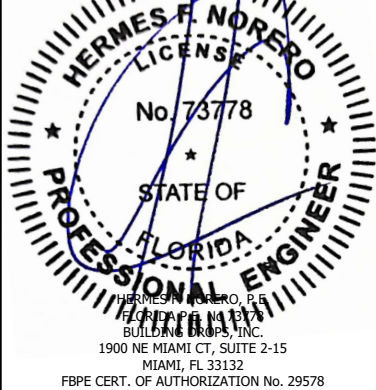

FL #:	FL41835
DATE:	10.03.23
DWG. BY:	SH
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	DRU013
SHEET:	1
REV.	B
OF 7	



DESIGN PRESSURE TABLE (PSF)			
NOMINAL DIMS.		GLASS TYPE 1	GLASS TYPE 2
FRAME WIDTH (in.)	FRAME HEIGHT (in.)	EXT. (+) INT. (-)	EXT. (+) INT. (-)
36.0	54.0	55.0	70.0
42.0		55.0	70.0
48.0		55.0	70.0
54.0		55.0	70.0
36.0	60.0	55.0	70.0
42.0		55.0	70.0
48.0		55.0	70.0
54.0		55.0	70.0
60.0		55.0	70.0
36.0	66.0	55.0	70.0
42.0		55.0	70.0
48.0		55.0	70.0
54.0		55.0	70.0
60.0		55.0	70.0
36.0	72.0	55.0	70.0
42.0		55.0	70.0
48.0		55.0	70.0
54.0		55.0	70.0
60.0		55.0	70.0
36.0	78.0	55.0	70.0
42.0		55.0	70.0
48.0		55.0	70.0
54.0		54.5	69.4
36.0	84.0	55.0	70.0
42.0		55.0	70.0
48.0		55.0	70.0
36.0	90.0	55.0	70.0
42.0		55.0	70.0
48.0		54.7	69.6
36.0	96.0	55.0	70.0
42.0		55.0	70.0
36.0	102.0	55.0	70.0
42.0		55.0	70.0
36.0	108.0	55.0	70.0
36.0	114.0	55.0	70.0
36.0	120.0	55.0	70.0



LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE: IGLU ENERGY CLASSIC FIXED WINDOW (HVHZ) (IMPACT)

ELEVATION & DESIGN
PRESSURE TABLE

PREPARED BY:

BUILDING DROPS, INC.

MIAMI COURT, STE. 2-15
MIAMI, FL 33132


PH: (954) 399-8478
FAX: (954) 744 4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE CHANGE	FB	10/23
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

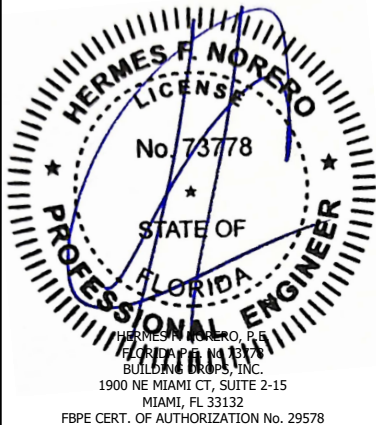

FL #:

FL41835

DATE: 10.03.23

DWG. BY:
SH

CHK. BY:
HFN

SCALE: NTS

DWG. #: DRU013


SHEET:

2

REV.


B

c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 1711\dwgs\141835-r2\dr013.dwg 7/13/2026 10:37 AM

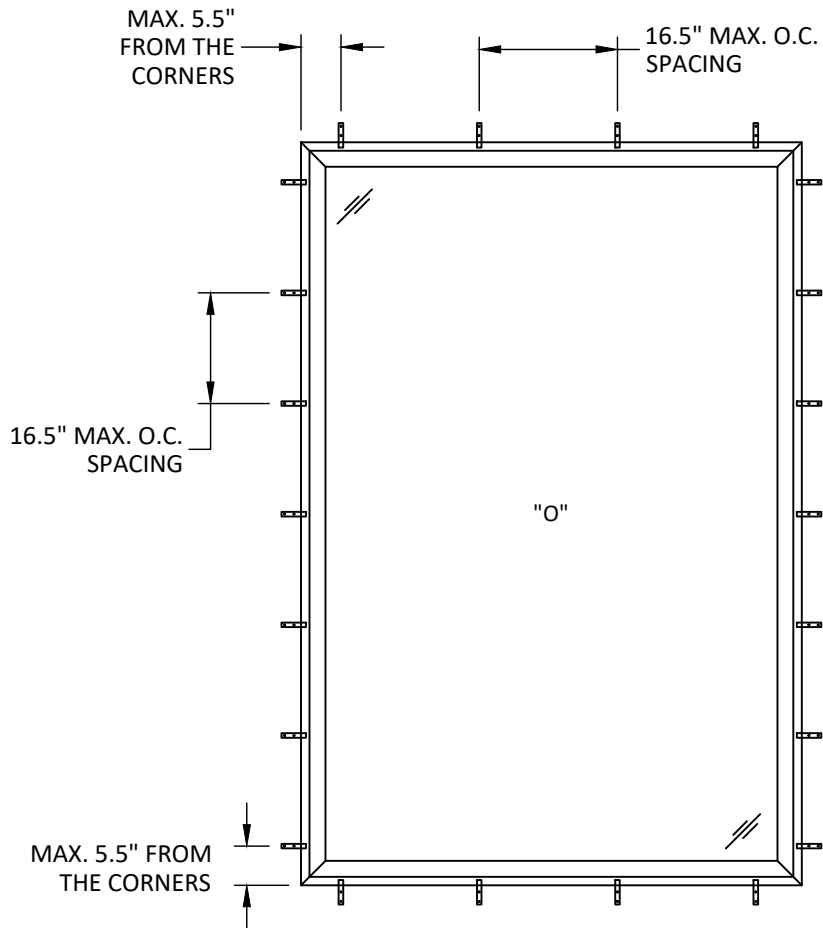

ANCHOR LAYOUT
STRAP INSTALLATION

NOTE: TWO (2) INSTALLATION ANCHORS
PER STRAP LOCATION.

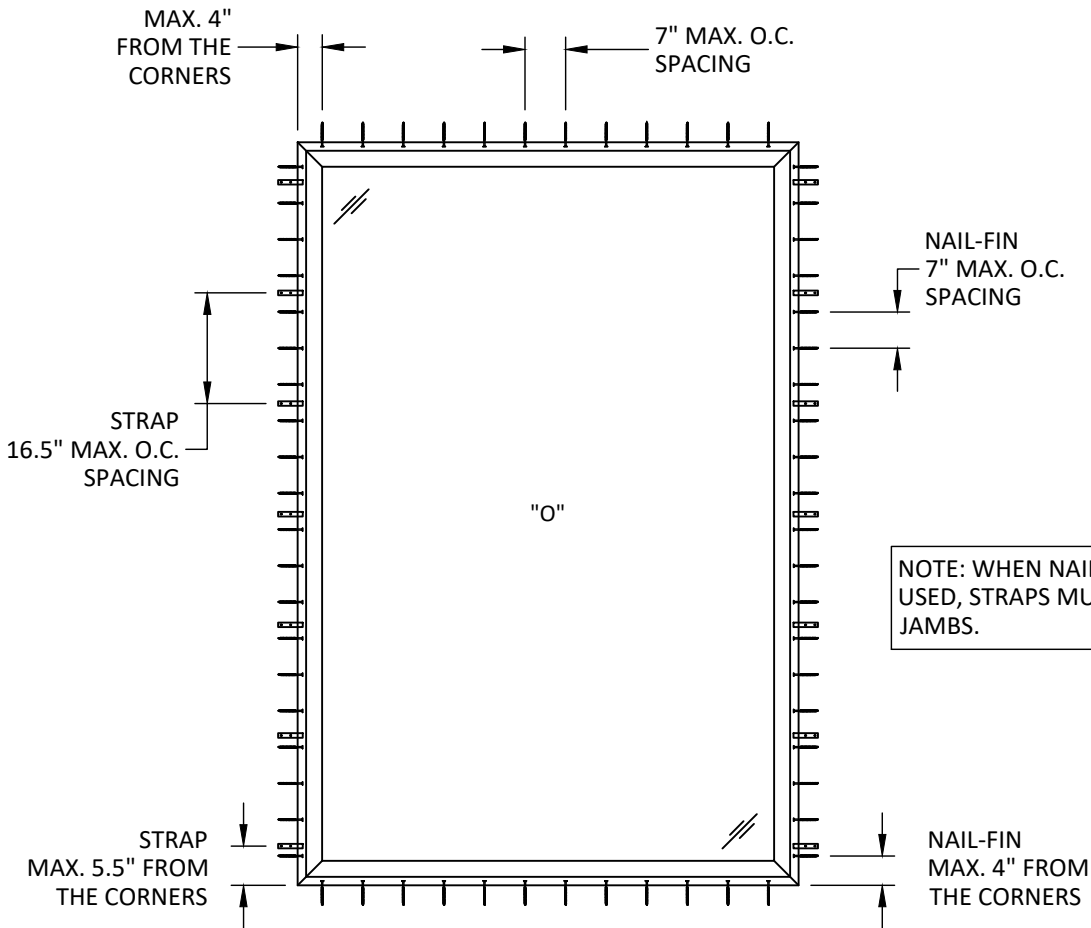

ANCHOR LAYOUT
NAIL-FIN & STRAP INSTALLATION

NOTE: WHEN NAIL-FIN INSTALLATION IS
USED, STRAPS MUST BE USED AT THE
JAMBS.

INSTALLATION LEGEND:

- NAIL-FIN
- STRAP



LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE: IGLO ENERGY CLASSIC FIXED
WINDOW (HVHZ) (IMPACT)


ANCHOR LAYOUTS

PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
FBC CODE CHANGE	FB	10/23
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

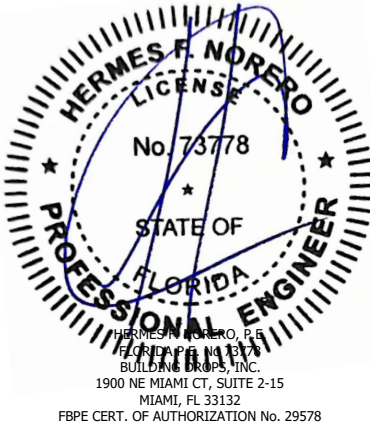

FL #:
FL41835

DATE: **10.03.23**


DWG. BY: **SH** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **DRU013**

SHEET: **3** REV. **B**

c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 1711.dwg(141835+2)\dru013.dwg 7/13/2026 10:37 AM

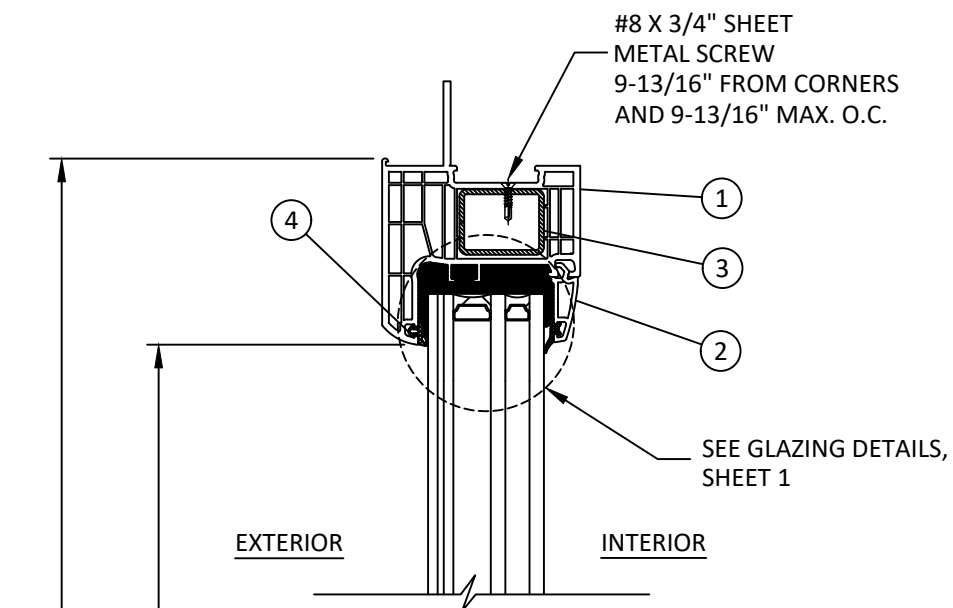

A
4 VERTICAL SECTION
FIN SECTION DETAIL

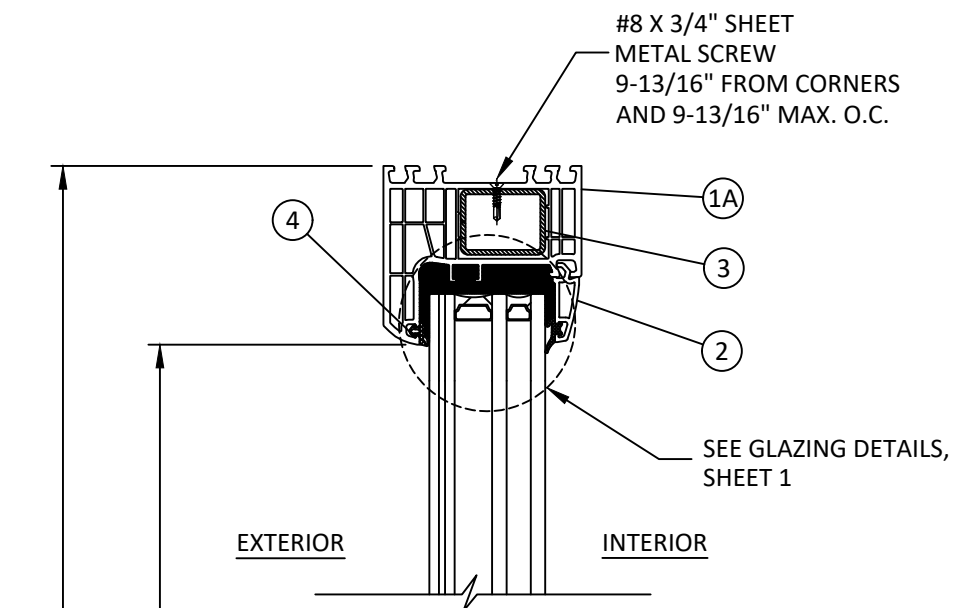

B
4 VERTICAL SECTION
FINLESS SECTION DETAIL



LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE: IGLO ENERGY CLASSIC FIXED
WINDOW (HVHZ) (IMPACT)

VERTICAL SECTIONS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
FBC CODE CHANGE	FB	10/23
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

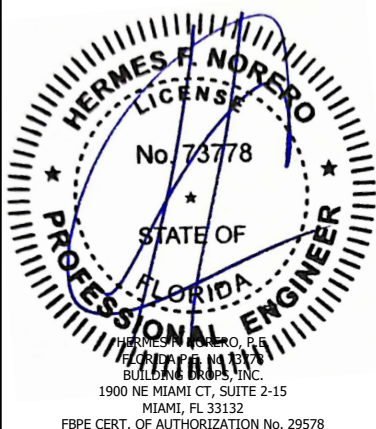


FL #:	FL41835	
DATE:	10.03.23	
DWG. BY:	SH	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	DRU013	
SHEET:	4	REV. B
OF 7		

c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 1711.dwg; c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 1711.dwg; c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 1711.dwg; c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 1711.dwg

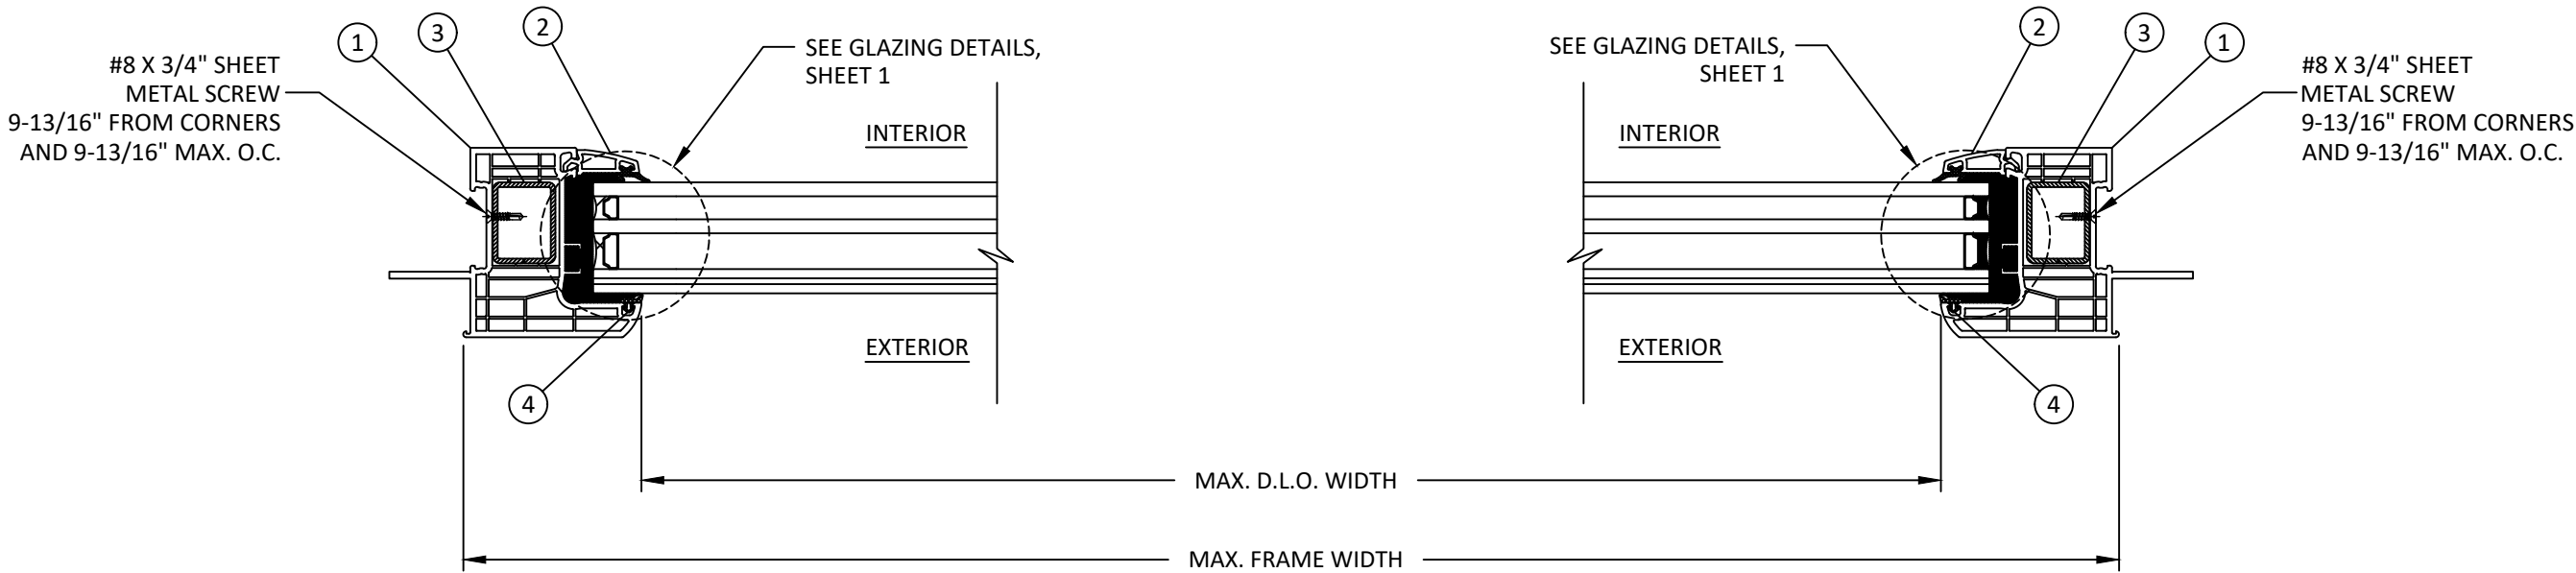

C
5 HORIZONTAL SECTION
FIN SECTION DETAIL

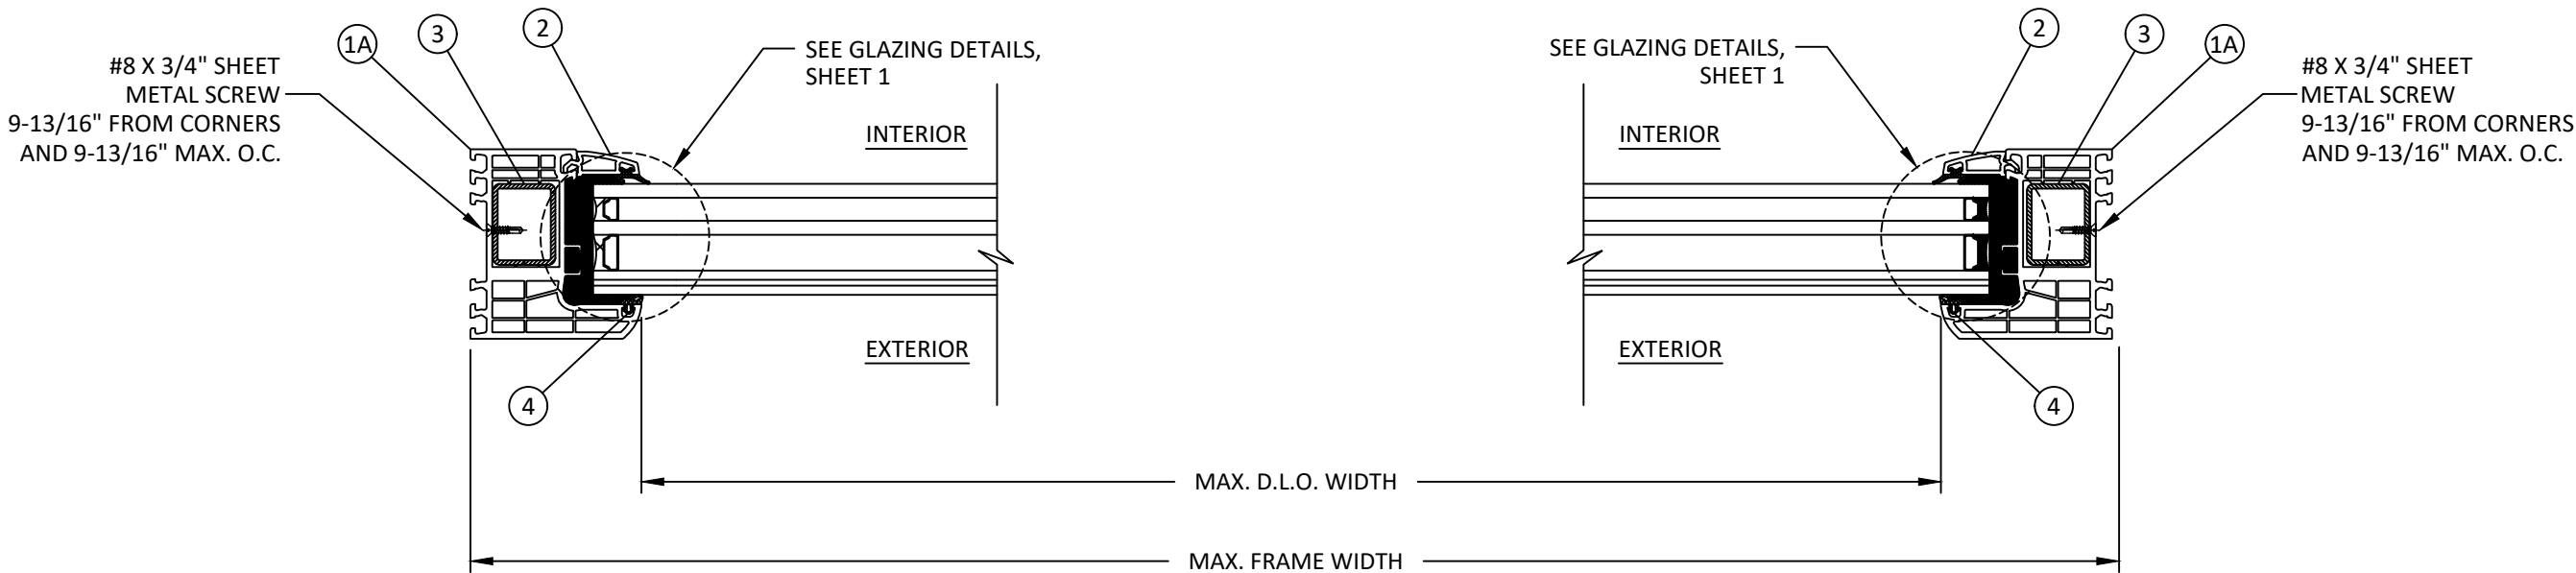

D
5 HORIZONTAL SECTION
FINLESS SECTION DETAIL



LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE: IGLU ENERGY CLASSIC FIXED
WINDOW (HVHZ) (IMPACT)

HORIZONTAL SECTIONS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
FBC CODE CHANGE	FB	10/23
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

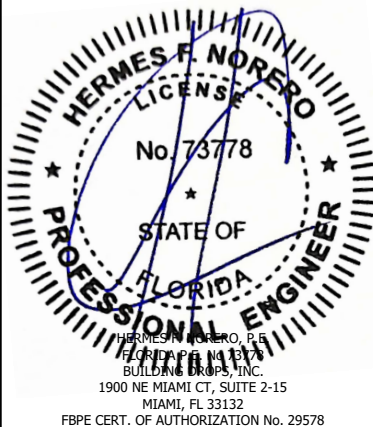


FL #:	FL41835
DATE:	10.03.23
DWG. BY:	CHK. BY:
SH	HFN
SCALE:	NTS
DWG. #:	DRU013
SHEET:	REV.
5	B
OF 7	


c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 1711.dwg
7/13/2026 10:37 AM
c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 1711.dwg

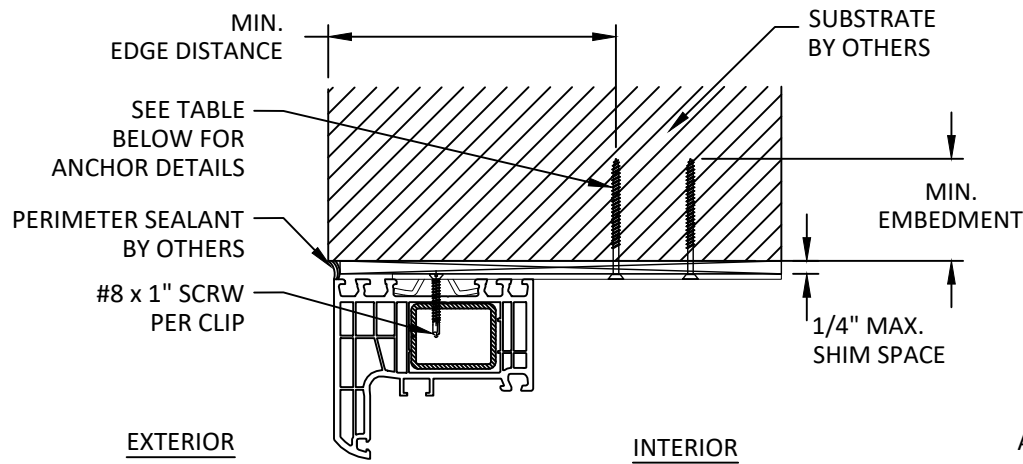

A
6
VERTICAL SECTION
HEAD - STRAP

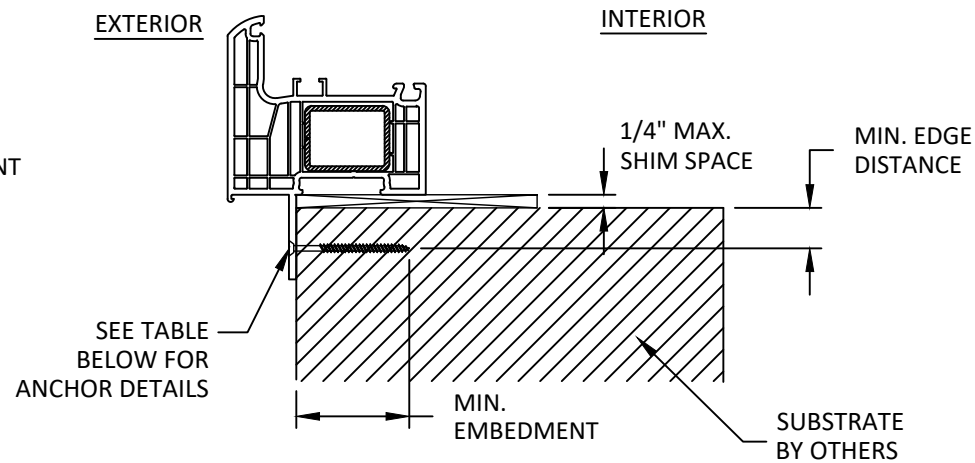

B
6
VERTICAL SECTION
SILL - NAIL-FIN

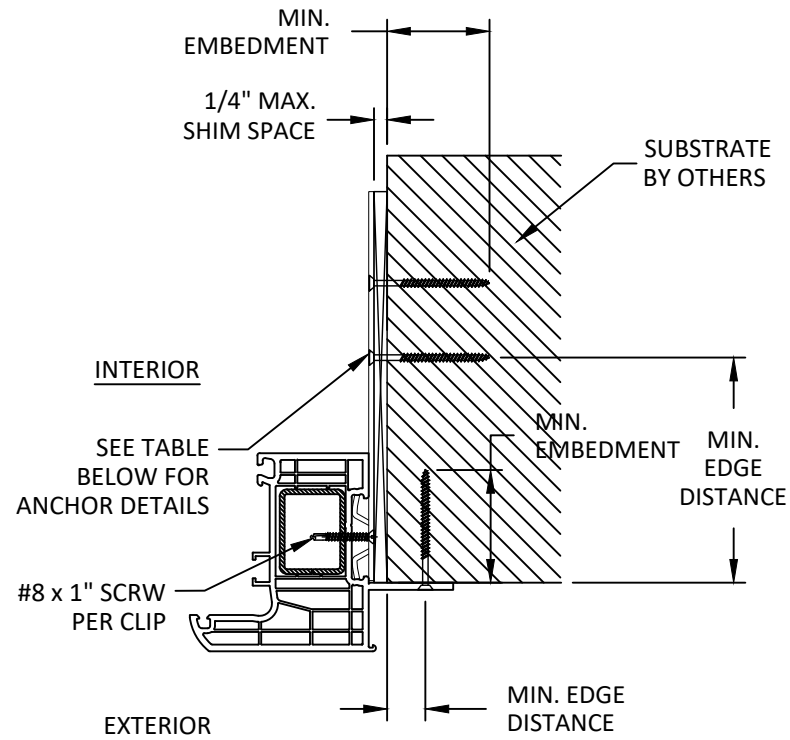

C
6
HORIZONTAL SECTION
JAMB - NAIL-FIN & STRAP

INSTALLATION NOTES:

NOTE: SILL & JAMB SIMILAR

NOTE: HEAD SIMILAR

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN, UNLESS OTHERWISE STATED ON SHEET 3.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING:
 - FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).
 - CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE					
METHOD	SUBSTRATE	ANCHOR TYPE	MIN EMBEDMENT	MIN. EDGE DISTANCE	SPACING
NAIL-FIN	WOOD: MIN. SG = 0.55	#8 WOOD SCREW	1.50"	0.75"	SEE SHEET 3
	METAL: 18 GAUGE STEEL MIN. Fy = 33KSI ALUMINUM: 1/8" MIN., 6063-T5	#8 SELF-DRILLING SCREW	3 THREADS MIN PENETRATION BEYOND STRUCTURE	0.50"	
	CONCRETE: f _c =3000PSI	3/16" ITW TAPCON	1.25"	2.00"	
	MASONRY: CMU per ASTM C90 MIN. 2000 PSI	3/16" ITW TAPCON	1.00"	2.00"	
STRAP	WOOD: MIN. SG = 0.55	#10 WOOD SCREW	1.50"	0.75"	SEE SHEET 3
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI ALUMINUM: 1/8" MIN., 6063-T5	#10 SELF-DRILLING SCREW	3 THREADS MIN PENETRATION BEYOND STRUCTURE	0.50"	
	CONCRETE: f _c =3000PSI	3/16" ITW TAPCON	1.25"	2.00"	
	MASONRY: CMU per ASTM C90 MIN. 2000 PSI	3/16" ITW TAPCON	1.00"	2.00"	



LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE: IGLO ENERGY CLASSIC FIXED WINDOW (HVHZ) (IMPACT)


ANCHOR DETAILS & INSTALLATION NOTES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com










REMARKS	BY	DATE
FBC CODE CHANGE	FB	10/23
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

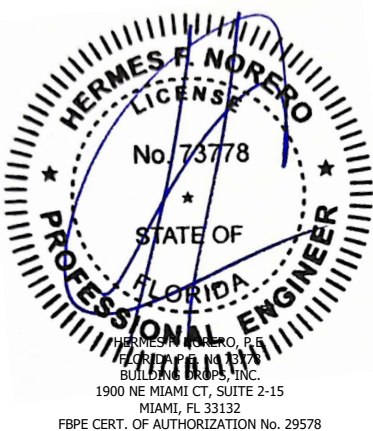

FL #:		FL41835
DATE:		10.03.23
DWG. BY:	CHK. BY:	
SH	HFN	
SCALE:		NTS
DWG. #:		DRU013
SHEET:		6
REV.		B
		OF 7

BILL OF MATERIALS			
ITEM	PART NO.	DESCRIPTION	MATERIAL
1	70009	FRAME (FIN)	uPVC
1A	70001	FRAME (FINLESS)	uPVC
2	70948	GLAZING BEAD	uPVC
3	250030	FRAME REINFORCEMENT	STEEL
4	S-BLC	GASKET	EPDM
5	-	DRAIN PLUG	ASA
6	-	STRAP	STEEL

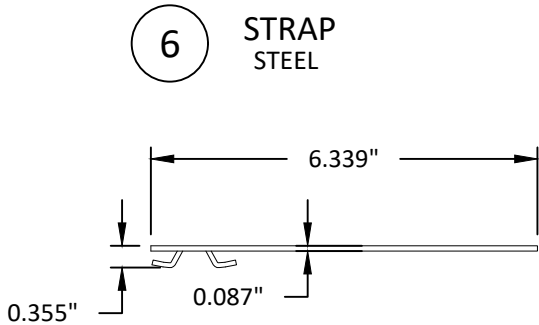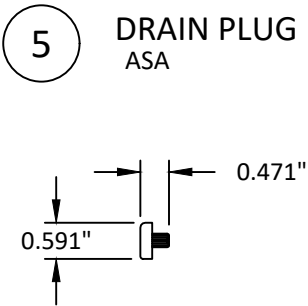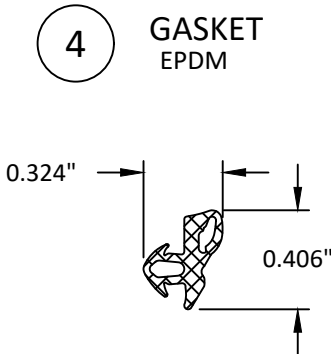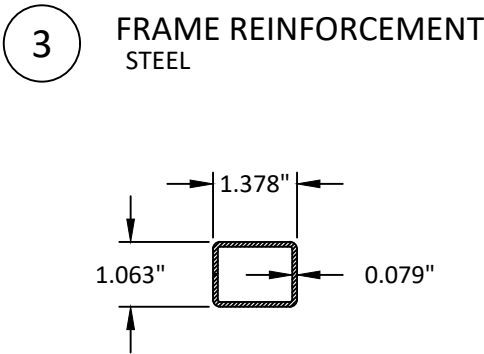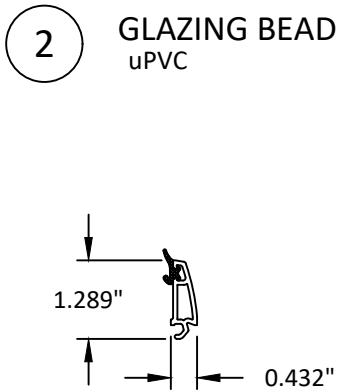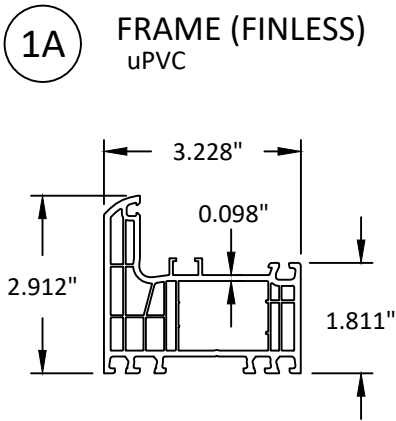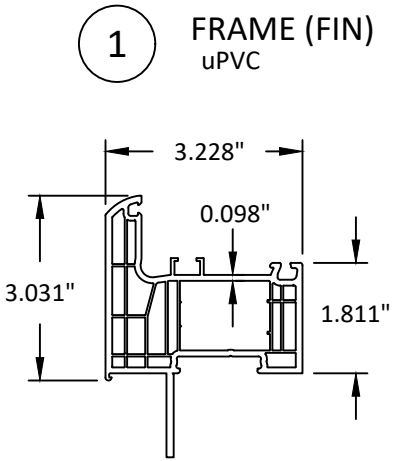

LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE: IGLO ENERGY CLASSIC FIXED WINDOW (HVHZ) (IMPACT)

BILL OF MATERIALS & COMPONENTS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE CHANGE	FB	10/23
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

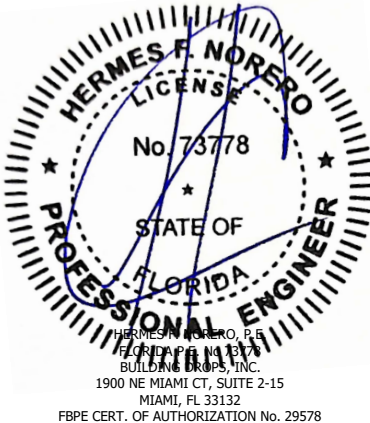

FL #:		FL41835
DATE:		10.03.23
DWG. BY:	CHK. BY:	
SH	HFN	
SCALE:		NTS
DWG. #:		DRU013
SHEET:		7
		REV. B
		OF 7